

Architectural
Structural
Geotechnical



Materials Testing
Forensic
Civil/Planning

Job No. 195345

April 24, 2024

Challenger Communities
8605 Explorer Drive, Suite 250
Colorado Springs, CO 80920

Re: Response to CGS Review Comments dated August 4, 2022 and October 26, 2022
Lots 1-39, Falcon Meadows at Bent Grass, Filing No. 4
El Paso County, Colorado

Dear Challenger:

RMG – Rocky Mountain Group prepared the *Soils and Geology Study* (RMG Job No. 176147) last dated December 3, 2021 for the proposed development originally comprising 280 single-family residential lots located approximately 1 mile to the northwest of the intersection of Woodmen Road and Meridian Road. The report was reviewed by the Colorado Geological Survey (CGS). It is our understanding the comments were not addressed previously and it has now been requested we respond to CGS comments. The purpose of this letter is to provide our response to the latest CGS review comments.

For clarity and ease of review we have “snipped” each of the CGS Comments followed by our response.

Concerning Soils and Geology Study (Colorado Geological Survey - CGS)

CGS Comment:

As stated on page 14 in RMG’s soil and geology study (Rocky Mountain Group (RMG), Revised December 3, 2021), “In areas where groundwater is anticipated to be within 14 feet of the original ground surface, Challenger Homes is proposing the use of non-basement foundations.” RMG’s study includes test holes and specific recommendations for Filing No. 1 through 3. The letter of intent (N.E.S., Inc., Revised October 2022) states, “The overall Bent Grass development restricts several lots to non-basement construction. However, all 39 lots in Falcon Meadows at Bent Grass Filing No. 4 were not specified for non-basement construction. Individual site-specific soils and geology studies will verify if basement construction is feasible for each lot.” CGS disagrees with verifying basement construction feasibility during individual site-specific studies.

RMG Response:

The *Soils and Geology Study* completed for Falcon Meadows at Bent Grass was completed for the entire development. Since the issuance of this report the subdivision has been split into 4 filings. Filing No. 4 was included in the 2021 study but not identified as Filing No. 4 at that time. The subject lots

have since been allocated to Filing No. 4 and renumbered as lots 1-39. An updated Development Plan showing just Filing No. 4, is presented in Figure 1.

All 39 lots included in Filing No. 4 are to be stiffened slab-on-grade foundations with no below ground habitable or inhabitable space. It is our understanding basements are not to be utilized in Filing No. 4.

CGS Comment:

Also, the Geologic Hazards note on the final plat (Galloway, October 4, 2022) states, "The builder has agreed to restrict construction to non-basement foundation types in areas where groundwater is anticipated to be shallower than 14 feet below ground surface. The soils and geology study did not restrict any lots in Falcon Meadows at Bent Grass Filing No. 4 due to shallow groundwater." However, the December 3, 2021, report by RMG does not investigate or include any reference (or updates) to Filing No. 4. Therefore, our previous recommendation remains valid.

RMG Response:

As noted above, all 39 lots in Filing No. 4 are to be stiffened slab-on-grade foundations with no below ground habitable or inhabitable space.

The plat note is to be updated to state "*The builder has agreed to restrict all construction in Filing No. 4 to non-basement foundation types*".

CGS Comment:

CGS recommends a site-specific study for Filing No. 4 that includes an updated Engineering and Geology Map illustrating lots to be restricted to non-basement construction. If basements are planned within Filing No. 4, CGS recommends the county require groundwater monitoring/observation to verify that proposed floor levels are at least three feet above maximum anticipated groundwater levels (and maintained year-round) or groundwater is greater than 14 feet below the original ground surface. This monitoring/observation program should be conducted immediately (prior to final plat approval) and before the installation of public infrastructure to determine if basements are feasible, to design detention ponds, and understand the effect groundwater will have on public infrastructure. Groundwater levels typically rise after development, and measurements of groundwater variations provide a basis for anticipating future groundwater levels.

RMG Response:

This letter includes an updated Engineering and Geology Map, Figure 2 illustrating the lots be restricted to non-basement construction. All other recommendations within the referenced *Soils and Geology Study* report are still valid.

CGS Comment:

The 100-year FEMA floodplain (Unnamed Tributary to Black Squirrel Creek No. 2, issued December 7, 2018) that traverses Filing No. 4 is marked and the proposed lots are outside the limits of the floodplain. However, we recommend a building setback of sufficient distance from flood zone limits to reduce hazards associated with rising floodwaters and erosion and scour.

RMG Response:

It is our opinion that the measures already discussed (locating the proposed homes outside of the designated floodplain and utilizing stiffened slab-on-grade foundations with no below ground space) achieves the desired reduction in associated hazards, and that no additional setbacks are required.


I hope this provides the information you have requested. Should you have questions, please feel free to contact our office.

Cordially,

Reviewed by,

RMG – Rocky Mountain Group


RMG – Rocky Mountain Group



Kelli Zigler
Project Geologist

Tony Munger, P.E.
Sr. Geotechnical Project Manager

FILING NO. 4

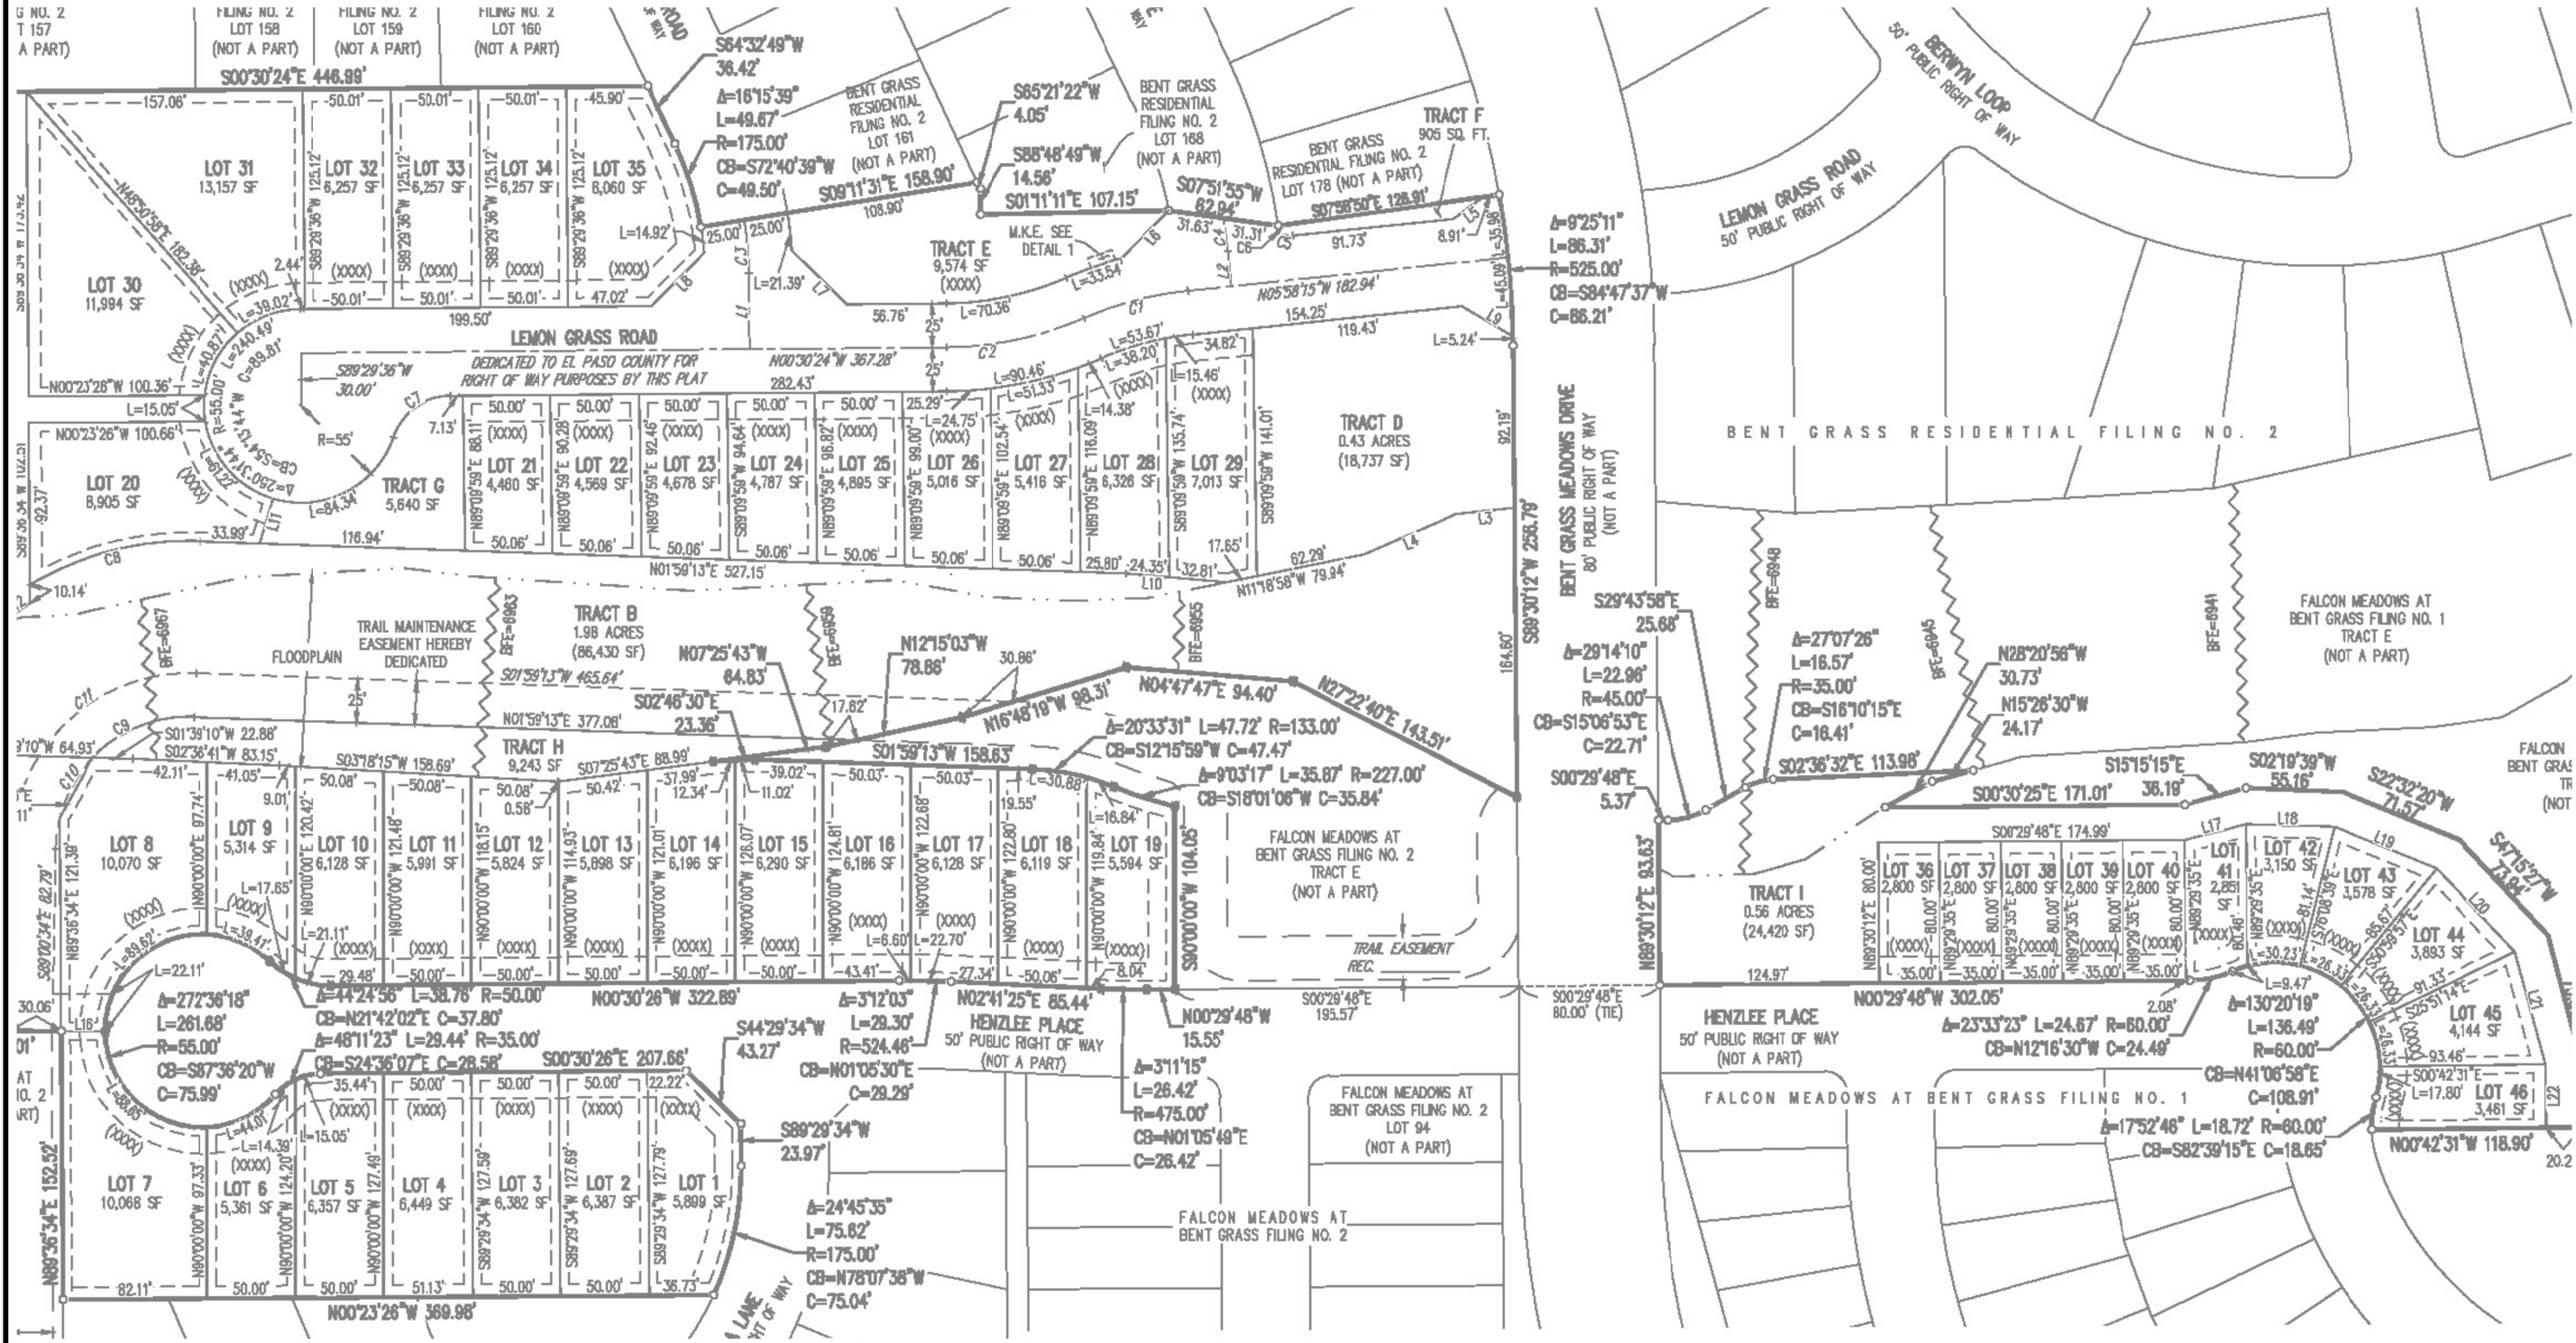


NOT TO SCALE
BASE MAP PROVIDED BY GALLOWAY

JOB No. 195345




ROCKY MOUNTAIN GROUP

Southern Office
Colorado Springs, CO
80918
(719) 548-0600
Central Office:
Englewood, CO 80112
(303) 638-9475
Northern Office:
Greeley / Evans, CO 80620
(970) 330-1071
Woodland Park Office:
(719) 637-6077
Monument Office:
(719) 438-2145
Pueblo / Canon City:
(719) 544-7750

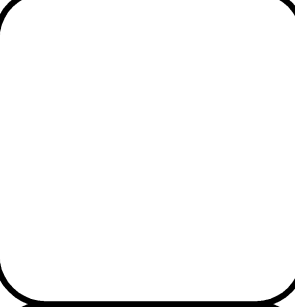

FALCON MEADOWS
AT BENT GRASS, FILING NO. 4
EL PASO COUNTY, COLORADO
CHALLENGER COMMUNITIES

ENGINEER: TPM
DRAIN BY: KMZ
CHECKED BY: TPM
ISSUED: 4-23-2024



PROPOSED
LOT LAYOUT

SHEET No.
FIG-1



ROCKY MOUNTAIN GROUP

Southern Office

Colorado Springs, CO 80918

(719) 548-0600

Central Office:

Englewood, CO 80112 (303) 638-9475

Northern Office:

Greeley / Evans, CO 80620 (970) 330-1071

Woodland Park Office:


(719) 637-6077

Monument Office:

(719) 438-2145

Pueblo / Canon City:

(719) 544-7750

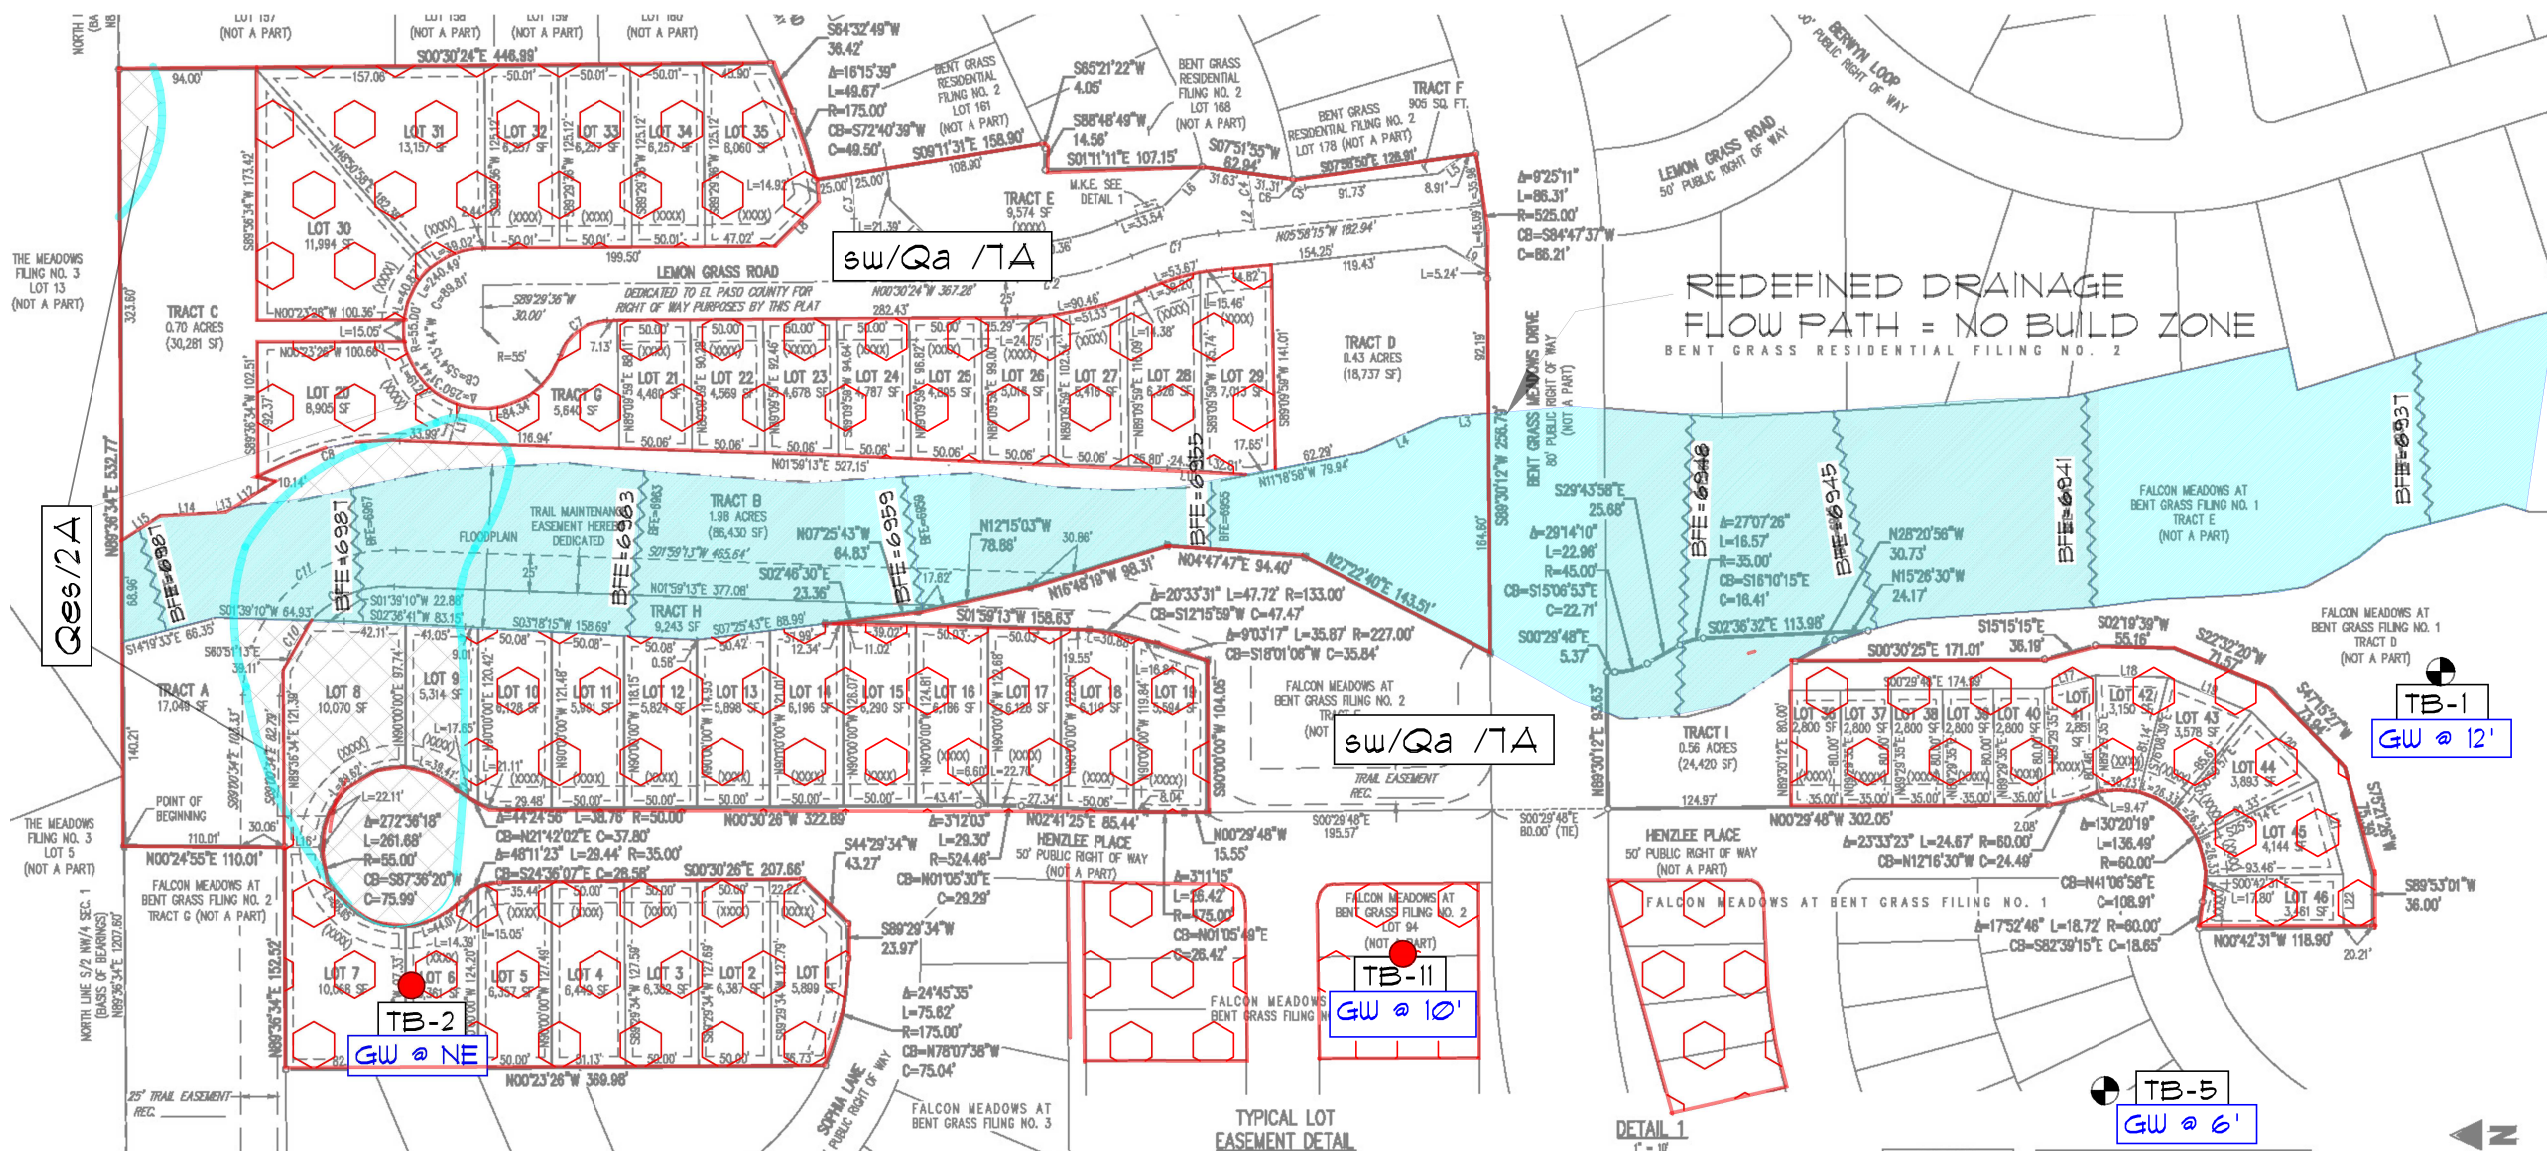

● DENOTES APPROXIMATE LOCATION OF TEST BORINGS PERFORMED APRIL 2019 FOR THE PRELIMINARY SUBSURFACE SOIL INVESTIGATION BY RMG - ROCKY MOUNTAIN GROUP (JOB NO. 169345)

⊕ DENOTES APPROXIMATE LOCATION OF TEST BORINGS PERFORMED APRIL 2020 FOR THE ORIGINAL INVESTIGATION BY RMG (JOB NO. 176147)

Geologic

Qes - Eolian Sand; likely deposited as a sandsheet by winds capable of moving very fine gravel-sized clasts

Qa - Alluvium three; stream deposits approximately 10-20 feet above the modern floodplain or as non-terrace forming alluvium in valley headwaters that underlies the younger alluviums

sw - seasonally wet area where near-surface moisture conditions may occasionally occur

Engineering

2A - Stable alluvium, colluvium and bedrock on gentle to moderate slopes

7A - Physiographic floodplain where erosion and deposition presently occur and is generally subject to recurrent flooding. Includes 100-year floodplain along major streams where floodplain studies have been conducted and Base Floor Elevations have been determined



GW @

Lots to be restricted to non-basement construction.

Area defined as subject to inundation by the 1-percent annual chance flood event.

Groundwater depths at time of drilling and/or when checked three days subsequent to drilling



NOT TO SCALE

FALCON MEADOWS AT BENT GRASS, FILING NO. 4
EL PASO COUNTY, COLORADO
CHALLENGER COMMUNITIES

ENGINEER: TPM
DRAWN BY: KMZ
CHECKED BY: TPM
ISSUED: 4-23-2024

ENGINEERING AND GEOLOGY MAP

SHEET No. FIG-2

Architecture
Structural
Geotechnical



Materials Testing
Forensic
Civil/Planning

SOILS AND GEOLOGY STUDY

Falcon Meadows at Bent Grass
(Formerly Bent Grass West)
El Paso County, Colorado

PREPARED FOR:

Challenger Communities
8605 Explorer Drive, Suite 250
Colorado Springs, CO 80920

JOB NO. 176147

June 22, 2020
Last Revised December 3, 2021

Respectfully Submitted,
RMG – Rocky Mountain Group

Reviewed by,
RMG – Rocky Mountain Group

Kelli Zigler
Project Geologist



Tony Munger, P.E.
Geotechnical Project Manager

TABLE OF CONTENTS

1.0 GENERAL SITE AND PROJECT DESCRIPTION.....	4
1.1 Project Location	4
1.2 Existing and Proposed Land Use.....	4
1.3 Project Description	4
2.0 QUALIFICATIONS OF PREPARERS	5
3.0 STUDY OVERVIEW	5
3.1 Scope and Objective	5
3.2 Site Evaluation Techniques	6
3.3 Previous Studies and Filed Investigation	6
3.4 Additional Documents.....	7
4.0 SITE CONDITIONS	7
4.1 Land Use.....	7
4.2 Topography	7
4.3 Vegetation	7
5.0 FIELD INVESTIGATION	7
5.1 Drilling	7
5.2 Laboratory Testing	8
6.0 GEOLOGIC AND SUBSURFACE CONDITIONS.....	8
6.1 General Physiographic Setting	8
6.2 General Geology.....	8
6.3 Soil Conservation Service	9
6.4 Subsurface Materials	10
6.5 Bedrock Conditions.....	10
6.6 Structural Features.....	10
6.7 Surficial (Unconsolidated) Deposits.....	10
6.8 Drainage of Water and Groundwater	10
6.9 Features of Special Significance	10
6.10 Engineering Geology.....	11
6.11 Mineral Resources.....	11
6.12 Permeability.....	11
7.0 POTENTIAL GEOLOGIC CONDITIONS	11
7.1 Hydrocompactive and/or Potentially Expansive Soils (Moisture Sensitive Soils).....	12
7.2 Faults and Seismicity.....	12
7.3 Radon.....	13
7.4 Flooding and Surface Drainage	13
7.5 Springs and High Groundwater	14
7.6 Erosion and Corrosion.....	14
7.7 Surface Grading and Drainage	15
7.8 Proposed Grading, Erosion Control, Cuts and Masses of Fill.....	15
8.0 BEARING OF GEOLOGIC CONDITIONS UPON PROPOSED DEVELOPMENT.....	16
9.0 BURIED UTILITIES	16
10.0 PAVEMENTS	17
11.0 ANTICIPATED FOUNDATION SYSTEMS.....	17
11.1 Subexcavation and Moisture Conditioned Fill	18
11.2 Foundation Stabilization.....	18
11.3 Foundation Drains	18
11.4 Design Parameters.....	19
12.0 DETENTION STORAGE CRITERIA.....	19
12.1 Soil and Rock Design Parameters	19
12.2 Embankment Recommendations	20

13.0 ADDITIONAL STUDIES.....	20
14.0 CONCLUSIONS	21
15.0 CLOSING.....	21

FIGURES

Site Vicinity Map	1
Site Plan with Test Boring Locations	2
Explanation of Test Boring Logs.....	3
Test Boring Logs.....	4-6
Summary of Laboratory Test Results	7
Soil Classification Data.....	8
Swell/Consolidation Test Results	9
Engineering and Geology Map	10
USDA Soils Survey Map	11
Fountain Quadrangle	12
FEMA Map	13
Perimeter Drain	14

APPENDIX A

Additional Referenced Documents

APPENDIX B

Guideline Site Grading Specifications

APPENDIX C

Preliminary Subsurface Soil Investigation, Bent Grass, Filing No. 2, Colorado Springs, Colorado Springs, Colorado, prepared by RMG – Rocky Mountain Group, Job No. 169845, revised August 6, 2019.

1.0 GENERAL SITE AND PROJECT DESCRIPTION

1.1 Project Location

The project lies in a portion of the western one-third of Section 1, Township 13 South, Range 65 West of the 6th Principal Meridian in El Paso County, Colorado. The site is located approximately 1 mile to the northwest of the intersection of Woodmen Road and Meridian Road. The approximate location of the site is shown on the Site Vicinity Map, Figure 1.

1.2 Existing Land Use

The site currently consists of portions of four parcels. The combined total area of the proposed site is to be approximately 67.012 acres. The three parcels included are:

- Schedule No. 5301000019 which consists of approximately 35 acres and is located in the northwestern portion of the site. The parcel is currently not developed.
- Schedule No. 5301000020 which consists of approximately 10 acres and is located in the northeastern portion of the site. The parcel is currently not developed.
- Schedule No. 5301000023 which consists of approximately 14.34 acres and is located on the southern portion of the site. The parcel is currently not developed.
- A portion of Schedule No. 5301000036 which consists of approximately 16.12 acres and is located along the central portion of the site. The parcel is currently not developed.

The parcels are zoned "PUD" (Planned Unit Development).

An "Unnamed Tributary to Black Squirrel Creek No. 2" is included in this development, but is to be platted outside of the buildable lots.

A future well site has been allocated along Bent Grass Meadows Drive at the request of (and in the location identified by) Woodmen Hills. It is our understanding that the well site is not to be developed at this time.

1.3 Project Description

The proposed site development is to be developed as a single-family residential subdivision and is proposed to contain a total of 280 single-family lots. The development is to utilize sewer and water services. Individual wells and on-site wastewater treatment systems are not proposed. The proposed development will consist of the replat of portions of the four existing parcels into one parcel totaling approximately 67.012 acres.

The main access to the filing is to be from the south and/or east, from Bent Grass Meadows Drive. Bent Grass Meadows Drive is to be constructed with an 80-foot public ROW that will meet the requirements of an El Paso County Urban Residential Collector roadway. The interior roads are to be constructed as private drives. However, it is assumed these roadways are to be classified as Local and will need to meet the El Paso County requirements for roadway construction. The Site Plan with Test Boring Locations is presented in Figure 2.

Rocky Mountain Group - RMG was retained to explore the subsurface conditions at the site and develop geotechnical engineering recommendations for the proposed land development operations.

2.0 QUALIFICATIONS OF PREPARERS

This Geology and Soils Study was prepared by a professional geologist as defined by Colorado Revised Statutes section 34-1-201(3) and by a qualified geotechnical engineer as defined by policy statement 15, "Engineering in Designated Natural Hazards Areas" of the Colorado State Board of Registration for Professional Engineers and Professional Land Surveyors. (Ord. 96-74; Ord. 01-42)

The principle investigators for this study are Kelli Zigler P.G., and Tony Munger, P.E. Ms. Zigler is a Professional Geologist as defined by State Statute (C.R.S 34-1-201) with over 19 years of experience in the geological and geotechnical engineering field. Ms. Kelli Zigler holds a B.S. in Geology from the University of Tulsa. Ms. Zigler has supervised and performed numerous geological and geotechnical field investigations throughout Colorado.

Tony Munger is a licensed professional engineer with over 19 years of experience in the construction engineering (residential) field. Mr. Munger and holds a Bachelor of Science in Architectural Engineering from the University of Wyoming.

3.0 STUDY OVERVIEW

The purpose of this investigation is to characterize the general geotechnical and geologic site conditions, and present our opinions of the potential effect of these conditions on the proposed development of single-family residences within the referenced site. As such, our services exclude evaluation of the environmental and/or human, health-related work products or recommendations previously prepared, by others, for this project.

Revisions to the conclusions presented in this report may be issued based upon submission of the Development Plan. This study has been prepared in accordance with the requirements outlined in the *El Paso County Land Development Code (LDC) specifically Chapter 8 last updated August 27, 2019 applicable sections include 8.4.8 and 8.4.9 and the Engineering Criteria Manual (ECM), specifically Appendix C last updated July 9, 2019.*

This report presents the findings of the study performed by RMG relating to the geotechnical and geologic conditions of the above-referenced site. Revisions and modifications to the conclusions and recommendations presented in this report may be issued subsequently by RMG based upon additional observations made during grading and construction which may indicate conditions that require re-evaluation of some of the criteria presented in this report.

3.1 Scope and Objective

The scope of this study is to include a physical reconnaissance of the site and a review of pertinent, publically available documents including (but not limited to) previous geologic and geotechnical reports, overhead and remote sensing imagery, published geology and/or hazard maps, design documents, etc. Our services exclude the evaluation of the environmental and/or human, health-related work products or recommendations previously prepared, by others, for this project.

The objectives of our study are to:

- Identify geologic conditions that are present on this site,
- Analyze the potential negative impacts of these conditions on the proposed site development,
- Analyze the potential negative impacts to the surrounding properties and/or public services resulting from the proposed site development as it relates to existing geologic hazards,
- Provide our opinion of suitable techniques that may be utilized to mitigate the potential negative impacts identified herein.

This report presents the findings of the study performed by RMG relating to the geologic conditions of the above-referenced site. Revisions and modifications to this report may be issued subsequently by RMG, based upon:

- Additional observations made during grading and construction which may indicate conditions that require re-evaluation of some of the criteria presented in this report,
- Review of pertinent documents (development plans, plat maps, drainage reports/plans, etc.) not available at the time of this study,
- Comments received from the governing jurisdiction and/or their consultants subsequent to submission of this document.

3.2 Site Evaluation Techniques

The information included in this report has been compiled from:

- Field reconnaissance
- Geologic and topographic maps
- Review of selected publicly available, pertinent engineering reports
- Available aerial photographs
- Exploratory soil test borings by RMG
- Laboratory testing of representative site soil and rock samples by RMG
- Geologic research and analysis
- Site development plans prepared by others

Geophysical investigations were not considered necessary for characterization of the site geology. Monitoring programs, which typically include instrumentation and/or observations for changes in groundwater, surface water flows, slope stability, subsidence, and similar conditions, are not known to exist and were not considered applicable for the scope of this report.

3.3 Previous Studies and Field Investigation

Reports of previous geotechnical engineering/geologic investigations for this site and nearby sites were available for our review and are listed below:

1. *Subsurface Soil Investigation, Lots 1-178, Bent Grass Residential, Filing No. 2, El Paso County, Colorado*, prepared by RMG – Rocky Mountain Group, Job No. 173093, dated January 21, 2020.
2. *Geology and Soils Report, Bent Grass Residential, Filing No. 2, El Paso County, Colorado*, by RMG – Rocky Mountain Group, Job No. 169845, amended January 13, 2020.

3. *Preliminary Subsurface Soil Investigation, Bent Grass Meadows Filing No. 2, Colorado Springs, Colorado*, by RMG – Rocky Mountain Group, Job No. 169845, dated May 15, 2019, revised August 6, 2019.
4. *Geologic Hazard / Land Use Study and Preliminary Subsurface Soil investigation, Bent Grass – 201-acre site, El Paso County, Colorado*, prepared by Entech Engineering, Inc., Entech Job No. 40515 (Old Job No. 99214), originally dated March 15, 2004 and last revised September 28, 2006.

3.4 Additional Documents

Additional documents reviewed during the performance of this study are included in Appendix A.

4.0 SITE CONDITIONS

4.1 Proposed Land Use and Zoning

It is our understanding that the project is to consist of single-family residential construction on 280 lots at the Falcon Meadows at Bent Grass subdivision. The residential structures are anticipated to be one to two-stories in height with multi-car garages. The homes may be constructed with or without basements.

Figure 2 presents the general boundaries of our investigation.

4.2 Topography

Based on our site observations, the ground surface generally slopes gently down to the south across the entire site. The elevation difference across the site from north to south is approximately 50 to 60 feet. An "Unnamed Tributary to Black Squirrel Creek No. 2" runs along the eastern boundary of the site. The "Unnamed Tributary" was dry at the time of the site reconnaissance on April 18, 2020 and at the time of the site reconnaissance for the adjacent property to the east on October 8, 2019.

4.3 Vegetation

The majority of the site consists of tall native grasses and weeds. Some deciduous trees are present near the eastern boundary. Vegetation is denser along the "Unnamed Tributary", particularly where it intersects the northern property boundary.

5.0 FIELD INVESTIGATION

5.1 Drilling

The subsurface conditions within the property were explored by drilling twenty-five exploratory borings on April 5, 15, and 18, 2019 and an additional 5 exploratory borings on April 17, 2020. The borings extended to depths of approximately 15 to 30 feet below the existing ground surface. The test borings were performed to explore the subsurface soils underlying an area that encompasses this proposed development and an adjacent site to the east. 11 of the test borings performed for that investigation were located within the currently proposed development. The test borings for the previous investigation and this investigation are presented in the Test Boring Location Plan, Figure 2. The number of borings is in

excess of the minimum one test boring per 10 acres of development up to 100 acres and one additional boring for every 25 acres of development above 100 acres as required by the ECM, Section C.3.3.

The test borings were drilled with a power-driven, continuous-flight auger drill rig. Samples were obtained during drilling of the test borings in general accordance with ASTM D-1586 utilizing a 2-inch O.D. split barrel sampler or in general accordance with ASTM D-3550 utilizing a 2½-inch OD modified California sampler. Results of the penetration tests are shown on the drilling logs. The Test Boring Logs from the original investigation are presented in Figures 4 through 16 of the *Preliminary Subsurface Soil Investigation* report by RMG, referenced above and attached in Appendix C. The Test Boring Logs for the supplemental test boring performed in conjunction with this investigation are presented in Figures 4 through 6 of this report.

5.2 Laboratory Testing

Soil laboratory testing was performed as part of the *Preliminary Subsurface Soil Investigation* report by RMG, referenced above. The laboratory tests included moisture content, dry density, grain-size analyses, Atterberg Limits and Swell/Consolidation tests. The results of that testing are presented in in Figures 17 through 27 of the *Preliminary Subsurface Soil Investigation* report by RMG, referenced above and attached in Appendix C.

Soil laboratory testing was also performed for the additional 5 exploratory test borings. The moisture content for the recovered samples was obtained in the laboratory. Grain-size analysis, Atterberg Limits, and Denver Swell/Consolidation tests were performed on selected samples for purposes of classification and to develop pertinent engineering properties. A Summary of Laboratory Test Results is presented in Figure 7. Soil Classification Data are presented in Figure 8. Swell/Consolidation Test Results are presented in Figure 9.

6.0 GEOLOGIC AND SUBSURFACE CONDITIONS

6.1 Geologic Conditions

Based upon review of the *Falcon Quadrangle Geologic Map, El Paso County, Colorado*, the site reconnaissance and exploratory drilling, the site and surrounding area generally consists of a silty to clayey sand and sandy clay overlying the Dawson Arkose. The Dawson Arkose was encountered in the Test Borings at the time of drilling.

6.2 General Geology

Our field investigation included a site reconnaissance with consideration given to geologic features and significant surficial deposits. The general geology of the area is typically stream terrace deposits, alluvium soils and windblown deposits overlying the Dawson Arkose. Five general geology units were mapped in the vicinity of the site and are identified (Morgan, et al., 2012) as:

- Qes: Eolian sand (Holocene to upper Pleistocene) – Yellowish-brown to tan, fine- to coarse-grained, frosted sand and silt deposited by wind. Typically this unit is faintly stratified and non-cohesive; dune forms are not present. The unit is likely deposited as a sandsheet by winds capable of moving very fine gravel-sized clasts. Eolian sand is moderately compacted, easily excavated, and drains well. The Eolian sand encompasses the majority of the site. According to

the Falcon Quadrangle, isolated “pockets” exist near the northeastern corner of the property. However, visually undiscernible differentiation of the soil is not apparent in the samples recovered at the time of drilling.

- Qa1: Alluvium one: sandy gravel, gravelly sand, silty sand, and sandy silt in modern channels, floodplains, and adjacent low-lying terraces that are approximately 5 feet or less above modern channels. Thickness of the unit is estimated to range from about 2 to 15 feet but could be greater in places.
- Qa2: Alluvium two (lower Holocene) – Dark gray to brown, poorly to well sorted, moderately consolidated, silt, sand, gravel, and minor clay and occasional boulders in stream terrace deposits approximately 6-12 feet above the modern flood plain or as non-terrace forming alluvium in valley headwaters. Clasts are subrounded to well-rounded and the dominant sediment is sandy gravel with a silty sand matrix. This unit encroaches slightly west of the “Unnamed Tributary”.
- Qa3: Alluvium three (upper Pleistocene) – Tan to reddish brown to grayish brown, poorly sorted, moderately consolidated, poorly to moderately stratified silt, sand, gravel, and cobbly gravel and occasional boulders in stream terrace deposits approximately 10-20 feet above the modern flood plain or as non-terrace forming alluvium in valley headwaters that underlies the younger alluviums. The unit contains dark gray clay beds that may be expansive. Clasts are subrounded to well-rounded and the dominant sediment is sandy gravel with a sandy matrix. This alluvium encompasses the majority of the site.
- sw – seasonally wet area – area where near-surface moisture conditions may occasionally occur, as indicated by historical aerial photos.

The general geology is presented in the Engineering and Geology Map, Figure 10.

6.3 U.S. Soil Conservation Service

The U.S. Soil Conservation Service along with United States Department of Agriculture (USDA) has identified the soils on the property as:

- 8 – Blakeland loamy sand, 1 to 9% slopes. Properties of the Blakeland loamy sand include, somewhat excessively drained soils, depth of the water table is anticipated to be greater than 6.5 feet, run-off is anticipated to be low, frequency of flooding and/or ponding is none, and landforms include hills and flats.
- 19 – Columbine gravelly sandy loam, 0 to 3 percent slopes. Properties of the Columbine gravelly sandy loam include, well-drained soils, depth of the water table is anticipated to be greater than 6.5 feet, runoff is anticipated to be very low, frequency of flooding and/or ponding is none, and landforms include flood plains, fan terraces, and fans.

The USDA Soil Survey Map is presented in Figure 11.

6.4 Subsurface Materials

The subsurface materials encountered in the test borings were classified using the Unified Soils Classification System (USCS) and the materials were grouped into the general categories of native sand with various amounts of silt and clay, native sandy clay, silty sandstone, and sandy claystone.

Additional descriptions and the interpreted distribution (approximate depths) of the subsurface materials are presented on the Test Boring Logs. The classifications shown on the logs are based upon the engineer's classification of the samples at the depths indicated. Stratification lines shown on the logs represent the approximate boundaries between material types and the actual transitions may be gradual and vary with location.

6.5 Bedrock Conditions

Bedrock was encountered in all but one of the test borings performed for the above-referenced investigation by RMG. The bedrock beneath the site is considered to be part of the Dawson Arkose and consists of sandy claystone and silty to clayey sandstone.

6.6 Structural Features

Structural features such as schistosity, folds, zones of contortion or crushing, joints, shear zones or faults were not observed on the site, surrounding the site or in the soil samples collected for laboratory testing.

6.7 Surficial (Unconsolidated) Deposits

Various lake and pond sediments, swamp accumulations, sand dunes, marine and non-marine terrace deposits, talus accumulations, creep or slope wash were not observed along the "Unnamed Tributary" or elsewhere on the site. Slump and slide debris were not observed on the site.

6.8 Drainage of Water and Groundwater

The overall topography of the site slopes down to the south. Groundwater was encountered in eight of the test borings at depths ranging from approximately 7.5 to 27 feet at the time of drilling.

The "Unnamed Tributary" is currently a defined drainage way located along the eastern boundary of the site. Review of the historical photos provided by Google Earth depict that the "Unnamed Tributary" adjacent to the site has remained relatively undisturbed since at least 1947. Based on the review of the *GEC (Grading and Erosion Control) Plans* it appears that the majority of the "Unnamed Tributary" is to remain relatively undisturbed. However, portions of the "Unnamed Tributary" east of the currently proposed development are to undergo additional grading and drainage improvements to allow for a future extension of Bent Grass Meadows Drive.

6.9 Features of Special Significance

Features of special significance such as accelerated erosion, (advancing gully heads, badlands or cliff reentrants) were not observed on the property. Features indicating settlement or subsidence such as fissures, scarplets and offset reference features were also not observed on the property.

Features indicating creep, slump or slide masses in bedrock and surficial deposits were also not observed on the property.

6.10 Engineering Geology

The Engineering Geology is presented below. Charles Robinson and Associates have mapped two environmental engineering units the site as:

- 2A: Stable alluvium, colluvium and bedrock on gentle to moderate slopes (5%-12%).
- 7A: Physiographic floodplain where erosion and deposition presently occur and is generally subject to recurrent flooding. Includes 100-year floodplain along major streams where floodplain studies have been conducted and Base Flood Elevations have been determined.

The engineering geology is presented in the Engineering and Geology Map, Figure 10.

6.11 Mineral Resources

Under the provision of House Bill 1529, it was made a policy by the State of Colorado to preserve for extraction commercial mineral resources located in a populous county. Review of the *Master Plan for Mineral Extraction, Map 2* indicates the site is not identified as an aggregate resource. Extraction of the sand and sandstone resources are not considered to be economical compared to materials available elsewhere within the county.

6.12 Permeability

The permeability of a soil measures how well air and water can flow within the soil. Soil permeability varies according to the type of soil and other factors.

The infiltration rate of a soil refers to how much water a type of soil can absorb over a specific time period. Infiltration rates are determined by soil permeability and surface conditions, and usually are measured in inches per hour.

The materials encountered in the test borings at the time of drilling were silty to clayey sand, sandy clay, silty sandstone, and sandy claystone. The permeability of the sands is anticipated to be moderate to high. The permeability of the sandstone is anticipated to range from low to high. The permeability of the clay and claystone is anticipated to be low.

7.0 POTENTIAL GEOLOGIC CONDITIONS

The El Paso County Engineering Criteria Manual recognizes and delineates the difference between hazards and constraints. A geologic hazard is one of several types of adverse geologic conditions capable of causing significant damage or loss of property and life. Geologic hazards are defined in Section C.2.2 Sub-section E.1 of the ECM. A geologic constraint is one of several types of adverse geologic conditions capable of limiting or restricting construction on a particular site. Geologic constraints are defined in Section C.2.2 Sub-section E.2 of the ECM (1.15 Definitions of Specific Terms and Phrases). The following geologic constraints were considered in the preparation of this report, and are not are not anticipated to pose a significant risk to the proposed development:

- Avalanches
- Debris Flows, Debris Fans, Mudslides
- Floodplains
- Ground Subsidence
- Landslides
- Rockfall
- Ponding water
- Steeply Dipping Bedrock
- Unstable or Potentially Unstable Slopes
- Scour, Erosion, Accelerated Erosion along creek banks and drainageways
- Springs and High Groundwater
- Corrosive Minerals

The following sections discuss potential geologic conditions that are anticipated to impact the subject site:

7.1 Compressible and/or Potentially Expansive Soils (Moisture Sensitive Soils)

The subsurface materials at the site generally consist of silty to clayey sand and sandy clay. Based on the *Preliminary Subsurface Soil Investigation* report referenced above, the soils and bedrock encountered at the site generally possess low to moderate swell potential and the soils at the site generally possess low to moderate compressibility potential. It is anticipated that if these materials are encountered in the excavations for the proposed residences, they can readily be mitigated with typical construction practices common to this region of El Paso County, Colorado.

Mitigation

Shallow foundations are anticipated for structures within this development. Foundation design and construction are typically adjusted for expansive or compressible soils. Mitigation of expansive soils is typically accomplished by overexcavation and replacement with structural fill, or subexcavation and/or replacement with on-site moisture-conditioned soils. Mitigation of compressible soils is typically accomplished by removal and recompaction, or subexcavation and/or replacement with on-site moisture-conditioned soils.

7.2 Faults and Seismicity

Review of the *Geologic Map of the Colorado Springs Quadrangle* and *Map of Areas Susceptible to Differential Heave in Expansive, Steeply Dipping Bedrock, City of Colorado Springs, Colorado* indicates the Rampart Range Fault lies approximately 12.5 miles to the west of the proposed residential development, and the Ute Pass Fault lies approximately 15 miles to the south and west of the proposed residential development. According to the CGS, these faults are not considered to be recently active. However, they have been active during geologic times and could affect the site if they did rupture.

Information presented by the CGS indicates that several recent earthquakes have occurred in the vicinity of the Ute Pass Fault near Colorado Springs and Woodland Park. The earthquakes, with magnitudes in the range of 3.0 to 3.9, occurred approximately from 1962 to 2007.

Earthquakes felt at this site will most likely result from minor shifting of the granite mass within the Pikes Peak Batholith which includes pull from minor movements along faults found in the Denver basin.

Ground motions resulting from small earthquakes are more likely to affect structures at this site and will likely only affect slopes stability to a minimal degree.

Mitigation

The Pikes Peak Regional Building Code, 2017 Edition, indicates maximum considered earthquake spectral response accelerations of 0.185g for a short period (S_s) and 0.059g for a 1-second period (S_1). Based on the results of our experience with similar subsurface conditions, we recommend the site be classified as Site Class B, with average shear wave velocities ranging from 2,500 to 5,000 feet per second for the materials in the upper 100 feet.

7.3 Radon

"Radon Act 51 passed by Congress set the natural outdoor level of radon gas (0.4 pCi/L) as the target radon level for indoor radon levels.

The 80931 zip code located in El Paso County, has an EPA assigned Radon Zone of 1. A radon zone of 1 predicts an average indoor radon screening level greater than 4 pCi/L, which is above the recommended levels assigned by the EPA. Black Forest is located in a high risk area of the country. *The EPA recommends you take corrective measures to reduce your exposure to radon gas.*

Most of Colorado is generally considered to have the potential of high levels of radon gas, based on the information provided at: http://county-radon.info/CO/El_Paso.html. There is not believed to be unusually hazardous levels of radon from naturally occurring sources at this site.

Mitigation

Radon hazards are best mitigated at the building design and construction phases. Providing increased ventilation of basements, crawlspaces, creating slightly positive pressures within structures, and sealing of joints and cracks in the foundations and below-grade walls can help mitigate radon hazards.

7.4 Flooding and Surface Drainage

The "Unnamed Tributary" resides along the eastern portion of the proposed development. Per the Flood Insurance Study report and Flood Insurance Rate Map for FEMA Map Number 08041C0553G dated December 7, 2018, the "Unnamed Tributary" resides in Zone AE, which is defined by FEMA as areas subject to inundation by the 1-percent-annual chance-flood event determined by detailed methods. This area is shown hatched on the Engineering and Geology Map, Figure 10.

The remainder of the site lies in the Zone X. Zone X is defined by FEMA as an area of minimal flood hazard that is determined to be outside the Special Flood Hazard Area and higher than the elevation of the 0.2-percent-annual-chance (or 500-year) flood.

Mitigation

No construction is currently proposed within the areas identified as Zone AE. Construction on nearby lots should be configured such that the lowest floor elevation is maintained at least 1 foot above the applicable Base Flood Elevation (BFE).

7.5 Springs and High Groundwater

Based on the site observations, review of USGS topographic maps dating back to 1951, and Google Earth images dating back to September 1999, springs do not appear to originate on the subject site. Areas of seasonal shallow groundwater were observed in the test boring performed by RMG. In these areas, we would anticipate the potential for periodically high subsurface moisture conditions and frost heave potential. These areas lie within low-lying areas along the southern portion of the site. Ponding water was not observed on the site.

Fluctuations in groundwater and subsurface moisture conditions may occur due to variations in rainfall and other factors not readily apparent at this time. Groundwater information obtained at the time of the preliminary investigations performed prior to the land development phase may or may not be representative of the conditions present at the time of construction. Furthermore, the development processes (reshaping of the ground surface, installation of buried utilities, installation of an underdrain below the roadways, etc.) can significantly alter the depth and flow paths of the subsurface water. The construction of surrounding lots can also alter the amount and depth of subsurface groundwater below a given lot. The potential exists for high groundwater levels during high moisture periods and should structures encroach on these areas the following mitigations should be followed.

Mitigation

Foundations must have a minimum 30-inch depth for frost protection. Perimeter drains are recommended around portions of the structures which will have habitable or storage space located below the finished ground surface. This includes crawlspace areas but not the walkout trench, if applicable. Perimeter drains help prevent the intrusion of water into areas below grade. A perimeter drain detail is presented in Figure 14.

If groundwater is encountered at the time of the site-specific subsurface soil investigations within 4 to 6 feet of the proposed basement slab elevation, an underslab drain would be considered in conjunction with the perimeter drain. It must be understood that subsurface drains are designed to intercept some types of subsurface moisture and not others. Therefore, the drain(s) could operate properly and not mitigate all moisture problems relating to foundation performance or moisture intrusion into the basement area.

Mitigation of groundwater is most readily accomplished by avoidance. In areas where groundwater is anticipated to be within 14 feet of original ground surface, Challenger Homes is proposing the use of non-basement foundations. As such, Lots 1-71 in Filing No.1, Lots 1-9, 23-59, and 68-108 in Filing No. 2, and Lots 1-4 in Filing No. 3 are to be limited to non-basement construction unless a groundwater monitoring study (performed at some future date) indicates that the lots are suitable for basement construction.

7.6 Erosion and Corrosion

The upper sands encountered at the site are susceptible to erosion by wind and flowing water. The sandstone and claystone at this site typically have low resistivity values (less than 2,000 ohm-cm) and are likely to be potentially corrosive to buried, ferrous metal piping and other structures.

Mitigation

Due to the nature of the soils on the site, it is anticipated that the majority of the surficial soils (silty to clayey sand and sandy clay) are subject to erosion by wind or water. The majority of the site has low

lying vegetation that is reducing the potential for erosion. During development and construction, disturbance of the site most likely will occur and may require regrading and revegetation.

Sandstone bedrock underlies the entire site. Sandstone bedrock is generally considered to contain corrosive minerals. To help mitigate potential corrosion, buried ferrous metal piping, conduit, and similar construction materials should be coated, wrapped or otherwise protected to avoid or reduce contact with the on-site soils. For environments corrosive to concrete, sulfate-resistant cement and additives should be used.

7.7 Surface Grading and Drainage

The recommendations listed in this report are intended to address normal surface drainage conditions, assuming the presence of groundcover (established vegetation, paved surfaces, and/or structures) throughout the regions upslope from this structure. However, groundcover may not be present due to a variety of factors (ongoing construction/development, wildfires, etc.). During periods when groundcover is not present in the "upslope" regions, higher than normal surface drainage conditions may occur, resulting in perched water tables, excess runoff, flash floods, etc. In these cases, the surface drainage recommendations presented herein (even if properly maintained) may not mitigate all groundwater problems or moisture intrusion into the structure. We recommend that the site plan be prepared with consideration of increased runoff during periods when groundcover is not present on the upslope areas.

Mitigation

The ground surface should be sloped from the buildings with a minimum gradient of 10 percent for the first 10 feet. This is equivalent to 12 inches of fall across this 10-foot zone. If a 10-foot zone is not possible on the upslope side of the structure, then a well-defined swale should be created a minimum 5 feet from the foundation and sloped parallel with the wall with a minimum slope of 2 percent to intercept the surface water and transport it around and away from the structure. Roof drains should extend across backfill zones and landscaped areas to a region that is graded to direct flow away from the structure. Homeowners should maintain the surface grading and drainage recommended in this report to help prevent water from being directed toward and/or ponding near the foundations.

Landscaping should be selected to reduce irrigation requirements. Plants used close to foundation walls should be limited to those with low moisture requirements and irrigated grass should not be located within 5 feet of the foundation. To help control weed growth, geotextiles should be used below landscaped areas adjacent to foundations. Impervious plastic membranes are not recommended.

Irrigation devices should not be placed within 5 feet of the foundation. Irrigation should be limited to the amount sufficient to maintain vegetation. Application of more water will increase the likelihood of slab and foundation movements.

7.8 Proposed Grading, Erosion Control, Cuts and Masses of Fill

Preliminary grading plans were not provided or reviewed at the time the report was issued. It is assumed based on the test borings for this investigation that the excavations will encounter silty to clayey sands, sandy clay, silty to clayey sandstone, and sandy claystone.

Mitigation

The on-site soils can be used as site grading fill, though the clay and claystone should be avoided in areas where the proposed foundations are not anticipated to penetrate through the grading fill.

The on-site soils are mildly susceptible to wind and water erosion. Minor wind erosion and dust may be an issue for a short time during and immediately after construction. Should the problem be considered severe during construction, watering of the cut areas may be required. Once construction is complete, vegetation should be re-established.

Prior to placement of overlot fill or removal and recompaction of the existing materials, topsoil, low-density native soil, all uncontrolled or undocumented fill, and organic matter should be removed from the proposed fill area. The subgrade should be scarified, moisture conditioned to within 2% of the optimum moisture content, and recompacted to the same degree as the overlying fill to be placed. The placement and compaction of fill should be periodically observed and tested by a representative of RMG during construction.

Guideline Site Grading Specifications are included in the Appendix B.

8.0 BEARING OF GEOLOGIC CONDITIONS UPON PROPOSED DEVELOPMENT

Geologic hazards (as described in section 7.0 of this report) and geologic constraints (also as described in section 7.0 of this report) were found to be present at this site.

The geologic hazards anticipated to affect this site are faults/seismicity and radioactivity/radon gas. The most significant geologic constraints to development recognized at this site are expansive/compressible soils and shallow groundwater. The geologic conditions encountered at this site are relatively common to the immediate area and mitigation can be accomplished by implementing common engineering and construction practices. None of these conditions are anticipated to preclude the proposed development.

9.0 BURIED UTILITIES

Based upon the conditions encountered in the exploratory test borings, we anticipate that the soils encountered in the utility trench excavations will consist of silty to clayey sands, (SM and SC) well graded to poorly graded sand and sandstone with various amounts of silt (SP-SM and SW-SM) and sandy clay (CL and CH). It is anticipated that the sands will be encountered at loose to medium dense relative densities, the clays at medium stiff to very stiff consistencies. Bedrock consisting of sandstone and claystone may be encountered at hard to very hard consistencies. Depending on the depth of excavations, temporary shoring and hydraulic water pumps may be required to prevent the collapse of trenches and the accumulation of water at the bottom of the excavation.

We believe the sand and clays will classify as Type C materials as defined by OSHA in 29 CFR Part 1926. OSHA requires that temporary excavations made in Type B and C materials be laid back at ratios no steeper than 1:1 (horizontal to vertical) and 1½:1 (horizontal to vertical), respectively, unless the excavation is shored and braced. Excavations deeper than 20 feet, or when water is present, should always be braced or the slope designed by a professional engineer.

Utility mains such as water and sanitary sewer lines are typically placed beneath paved roadways. The settlement of the utility trench backfill can have a detrimental effect on pavements and roadway surfaces. We recommend that utility trench backfill be placed in thin loose lifts, moisture conditioned as required and compacted to the recommendations outlined in the **Backfill** section of this report. The placement and compaction of utility trench backfill should be observed and tested by a representative of RMG Engineers during construction.

10.0 PAVEMENTS

Preliminary roadway plans were not provided prior to the report issue date. Roadways throughout the proposed development are classified as “Local” (Local low volume) and are anticipated to have 50 to 80-foot Public Right of Ways. ***The actual pavement section design for individual streets will be completed following overlot grading and rough cutting of the street subgrade.***

For purposes of this report (preliminary planning), we anticipate the subgrade soils will primarily have an American Association of State Highway and Transportation Officials (AASHTO) Soil Classification of A-2-4, A-4, A-6, and A-7-6 with an estimated California Bearing Ratio (CBR) value of approximately 5 to 15.

The above values are for preliminary planning purposes and may vary upon final design, dependent upon the soil material used for subgrade construction.

Pavement materials should be selected, prepared, and placed in accordance with the El Paso County specification and the Pikes Peak Region Asphalt Paving Specifications. Tests should be performed in accordance with the applicable procedures presented in the final design.

11.0 ANTICIPATED FOUNDATION SYSTEMS

Based on the information presented previously, conventional shallow foundation systems consisting of standard spread footings/stemwalls are anticipated to be suitable for the proposed residential structures. It is assumed that the deepest excavation cuts will be approximately 6 to 8 feet below the final ground surface, not including overexcavation which may be required on a lot-by-lot basis.

Due to its swell potential, the sandy clay is generally not suitable for support of spread footing foundations or floor slabs. Where expansive soils are encountered near spread footing foundation or floor slab levels, they should be removed and replaced with granular, non-expansive structural fill. Foundation systems which may reduce or eliminate the need for overexcavation include (but are not limited to) post-tension slabs-on-grade, integral stiffened (ribbed) slab foundations, driller pier (caisson) foundations with or without a structural floor, etc.

If loose or hydrocompactive sands are encountered, they may require additional compaction. In some cases, removal and recompaction may be required for loose soils. Similarly, if shallow groundwater conditions result in unstable soils, unsuitable for bearing of residential foundations, these soils may require stabilization or overexcavation and replacement prior to construction of foundation components.

The foundation system for each lot should be designed and constructed based upon recommendations developed in a detailed Subsurface Soil Investigation completed after site development activities are

complete. The recommendations presented in the Subsurface Soil Investigation should be verified by an Open Excavation Observation following the excavation on each lot.

11.1 Subexcavation and Moisture-Conditioned Fill

Based upon the field exploration and laboratory testing, subexcavation and replacement is not anticipated. However, prior to performing excavation and/or filling operations, vegetation, organic and deleterious material shall be cleared and disposed of in accordance with applicable requirements. The excavation should extend to a minimum depth below and laterally beyond the bottom of foundations as determined based on final grading plans.

11.2 Foundation Stabilization

Groundwater and loose soils were encountered at the time of drilling. If moisture conditions encountered at the time of the foundation excavation result in water flow into the excavation and/or destabilization of the foundation bearing soils, stabilization techniques should be implemented. Various stabilization methods can be employed, and can be discussed at the time of construction. However, a method that affords potentially a reduced amount of overexcavation (versus other methods) and provides increased performance under moderately to severely unstable conditions is the use of a layered geogrid and structural fill system.

Additionally, dependent upon the rate of groundwater flow into the excavation, a geosynthetic vertical drain and an overexcavation perimeter drain may be required around the lower portions of the excavation to allow for installation of the layered geogrid and structural fill system.

11.3 Foundations Drains

A subsurface perimeter drain is required around portions of the structure which will have habitable or storage space located below the finished ground surface. This includes crawlspace areas but not the walkout trench, if applicable.

Groundwater conditions were encountered in the test borings at the time of field exploration. The proposed detention ponds appear to be located at proposed basement foundation elevations. Depending on the conditions encountered during the lot specific Subsurface Soil Investigation and the conditions observed at the time of the Open Excavation Observation, additional subsurface drainage systems may be recommended.

One such system is an underslab drainage layer to help intercept groundwater before it enters the slab area should the groundwater levels rise. In general, if groundwater was encountered within 4 to 6 feet of the proposed basement slab elevation, an underslab drain should be anticipated. Another such system would consist of a subsurface drain and/or vertical drain board placed around the perimeter of the overexcavation to help intercept groundwater and allow for proper placement and compaction of the replacement structural fill. Careful attention should be paid to grade and discharge of the drain pipes of these systems.

It must be understood that the drain systems are designed to intercept some types of subsurface moisture and not others. Therefore, the drains could operate properly and not mitigate all moisture problems relating to foundation performance or moisture intrusion into the basement area.

11.4 Structural Fill

Areas to receive structural fill should have topsoil, organic material, or debris removed. The upper 6 inches of the exposed surface soils should be scarified and moisture conditioned to facilitate compaction (usually within 2 percent of the optimum moisture content) and compacted to a minimum of 95 percent of the maximum dry density as determined by the Standard Proctor test (ASTM D-698) or to a minimum of 92 percent of the maximum dry density as determined by the Modified Proctor test (ASTM D-1557) prior to placing structural fill.

Structural fill placed on slopes should be benched into the slope. Maximum bench heights should not exceed 4 feet, and bench widths should be wide enough to accommodate compaction equipment.

Structural fill shall consist of granular, non-expansive material. It should be placed in loose lifts not exceeding 8 to 12 inches, moisture conditioned to facilitate compaction (usually within 2 percent of the optimum moisture content) and compacted to a minimum of 92 percent of the maximum dry density as determined by the Modified Proctor test, ASTM D-1557. The materials should be compacted by mechanical means.

Materials used for structural fill should be approved by RMG prior to use. Structural fill should not be placed on frozen subgrade or allowed to freeze during moisture conditioning and placement.

11.4 Design Parameters

The allowable bearing pressure of the subsurface soils should be determined by a detailed site specific Subsurface Soil Investigation and verified by and Open Excavation Observation, as noted above.

12.0 DETENTION STORAGE CRITERIA

This section has been prepared in accordance with the requirements outlined in the El Paso County Land Development Code (LDC), the Engineering Criteria Manual (ECM) Section 2.2.6 and Appendix C.3.2.B, and the El Paso County (EPC) Drainage Criteria Manual, Volume 1 Section 11.3.3.

12.1 Soil and Rock Design Parameters

One detention pond is proposed in Filing No. 2 along the southern boundary within the designated Tract E as designated on the Final Grading & Erosion Plans, dated August 23, 2021. It is our understanding that the proposed detention pond is to be built-up approximately 5 to 7 feet below grade. RMG has performed laboratory tests of soil from across the proposed development. Test boring TB-11 is located just east of the proposed detention pond area. Based upon field and laboratory testing, the following soil and rock parameters are typical for the soils likely to be encountered, and are recommended for use in detention pond embankment design.

Soil Description	Unit Weight (lb/ft ³)	Friction Angle (degree)	Active Earth Pressure, K _a	Passive Earth Pressure, K _p	At Rest Earth Pressure, K _o
Silty to Clayey Sand (SC/SM)	115	28	0.36	2.77	0.53
Silty Sandstone	120	30	0.33	3.00	0.50
Sandy Claystone	120	20	0.49	2.04	0.66

12.2 Embankment Recommendations

Below-grade embankments are to be constructed with 4:1 slopes. Embankments should be constructed in accordance with applicable sections of the El Paso County Engineering Criteria Manual, the El Paso County Drainage Criteria Manual, and the El Paso County Land Development Manual. The following recommendations are in accordance with the El Paso county DCM Volume 2, Extended Detention Basin (EDB), Design Procedure and Criteria, paragraph 8.

The ground area to receive embankments should be cleared and grubbed to a minimum depth of two-feet to remove grass, shrubs, trees, roots, stumps, and other organic material. The exposed soil should be moisture-conditioned to facilitate compaction (usually within 2 percent of the optimum moisture content) and compacted to a minimum of 95 percent of the maximum dry density as determined by the Modified Proctor test (ASTM D-1557). The prepared surface should present a firm and stable condition.

Embankment should be constructed as structural fill on a prepared stable base. On-site native soil, when screened of all deleterious material and cobbles greater than 6-inches in any dimension, is anticipated to be suitable for embankment construction. Structural fill should be placed in 10-inch loose lifts, moisture-conditioned to facilitate compaction (usually within 2 percent of the optimum moisture content), and compacted to a minimum of 95 percent of the maximum dry density as determined by the Modified Proctor test (ASTM D-1557).

Structural fill placed on slopes should be benched into the slope. Maximum bench heights should not exceed 4 feet, and bench widths should be wide enough to accommodate compaction equipment. Structural fill should not be placed on frozen subgrade or allowed to freeze during moisture conditioning and placement. To verify the condition of the compacted soils, density tests should be performed during placement. The first density tests should be conducted when 24 inches of fill have been placed.

13.0 ADDITIONAL STUDIES

The findings, conclusions and recommendations presented in this report were provided to evaluate the suitability of the site for future development. Unless indicated otherwise, the test borings, laboratory test results, conclusions and recommendations presented in this report are not intended for use for design and construction. ***A site-specific subsurface soil investigation will be required for all proposed structures including (but not limited to) residences, retaining walls and pumphouses, commercial buildings, etc.***

To develop recommendations for construction of the proposed roadways, a pavement design investigation should be performed. This investigation should consist of additional test borings, soil

laboratory testing and specific recommendations for the design and construction of roadway pavement sections.

14.0 CONCLUSIONS

Based upon our evaluation of the geologic conditions, it is our opinion that the proposed development is feasible. The potential for expansive/compressible soils and shallow groundwater are not considered unusual for the Front Range region of Colorado. Mitigation of geologic hazards is most effectively accomplished by avoidance. However, where avoidance is not a practical or acceptable alternative, geologic hazards should be mitigated by implementing appropriate planning, engineering, and local construction practices.

In addition to the previously identified mitigation alternatives, surface and subsurface drainage systems should be implemented. Exterior, perimeter foundation drains should be installed around each proposed building structure. Surface water should be efficiently removed from the building area to prevent ponding and infiltration into the subsurface soil. Due to the shallow groundwater conditions and proximity to the Creek, additional subsurface drainage systems may also be required.

Stiffened slab foundations are to be required on Lots 1-71 in Filing No.1, Lots 1-9, 23-59, and 68-108 in Filing No. 2, and Lots 1-4 in Filing No. 3. These lots are within the areas where the shallowest of seasonal groundwater was encountered, at or less than 14 feet below the ground surface. The remainder of the lots are to have the option for basement construction, as groundwater level were greater than 14 feet below the surface.

The foundation and floor slabs of the structure should be designed using the recommendations provided in the site specific Subsurface Soil Investigation performed for each lot. In addition, appropriate surface drainage should be established during construction and maintained by the homeowner.

The recommendations in this and the referenced reports are intended to address normal surface drainage conditions, assuming the presence of groundcover (established vegetation, paved surfaces, and/or structures) throughout the regions upslope from this structure. However, groundcover may not be present due to a variety of factors (ongoing construction/development, wildfires, etc.). During periods when groundcover is not present in the "upslope" regions, higher than normal surface drainage conditions may occur, resulting in perched water tables, excess runoff, flash floods, etc. In these cases, the surface drainage recommendations presented herein (even if properly maintained) may not mitigate all groundwater problems or moisture intrusion into the structure.

Revisions and modifications to the conclusions and recommendations presented in this report may be issued subsequently by RMG based upon additional observations made during grading and construction which may indicate conditions that require re-evaluation of some of the criteria presented in this report.

15.0 CLOSING

This report is for the exclusive purpose of providing geologic hazards information and preliminary geotechnical engineering recommendations. The scope of services did not include, either specifically or by implication, evaluation of wild fire hazards, environmental assessment of the site, or identification of contaminated or hazardous materials or conditions. Development of recommendations for the mitigation of environmentally related conditions, including but not limited to, biological or toxicological issues, are

beyond the scope of this report. If the owner is concerned about the potential for such contamination or conditions, other studies should be undertaken.

This report has been prepared for **Challenger Communities** in accordance with generally accepted geotechnical engineering and engineering geology practices. The conclusions and recommendations in this report are based in part upon data obtained from review of available topographic and geologic maps, review of available reports of previous studies conducted in the site vicinity, a site reconnaissance, and research of available published information, soil test borings, soil laboratory testing, and engineering analyses. The nature and extent of variations may not become evident until construction activities begin. If variations then become evident, RMG should be retained to re-evaluate the recommendations of this report, if necessary.

Our professional services were performed using that degree of care and skill ordinarily exercised, under similar circumstances, by geotechnical engineers and engineering geologists practicing in this or similar localities. RMG does not warrant the work of regulatory agencies or other third parties supplying information which may have been used during the preparation of this report. No warranty, express or implied, is made by the preparation of this report. Third parties reviewing this report should draw their own conclusions regarding site conditions and specific construction techniques to be used on this project.

If we can be of further assistance in discussing the contents of this report or analysis of the proposed development, from a geotechnical engineering and/or geologic hazards point-of-view, please feel free to contact us.

APPENDIX A

Additional Referenced Documents

1. Final Grading & Erosion Control Plans, Falcon Meadows at Bent Grass, Filing No. 2, prepared by Galloway, Project No. CLH000019, dated June 23, 2021.
2. Concept Layout, Bent Grass Future Phases, prepared by NES, dated April 10, 2020.
3. El Paso County, updated thru July 9, 2019, Section 8.4.9, *El Paso County Land Development Code*.
4. El Paso County, revise July 9, 2019, *Appendix C, Soils Investigation Reports and Mitigation, Engineering Criteria Manual*.
5. Google Maps, Aerial Photograph, downloaded June 15, 2020.
6. El Paso County, February 8, 1996, *Master Plan for Mineral Extraction, Map 2*.
7. Kirkham, R.M. and Rogers, W.P., 1981, *Earthquake Potential in Colorado, A Preliminary Evaluation*, Colorado Geological Survey, Bulletin 43.
8. Colorado Geological Survey, 1991, *Results of the 1987-88 EPA Supported Radon Study in Colorado, with a discussion on Geology*, Open file Report 91-4.
9. Dames and Moore, 1985, *Colorado Springs Subsidence Investigation, State of Colorado Mined Land Reclamation*. (Reviewed to verify project location)
10. Federal Emergency Management Agency (FEMA), dated December 7, 2018, *Flood Insurance Rate Map, El Paso County, Colorado and Unincorporated Areas, Community Panel No. 08041C0553G*.
11. United States Department of Agriculture Soils Conservation Service, 1980, *Soil Survey of El Paso County Area, Colorado*.
<http://websoilsurvey.sc.egov.usda.gov/App/WebSoilSurvey.aspx>
12. On-site Wastewater Treatment Systems (OWTS) Regulations, El Paso County, Colorado, Chapter 8, effective April 10, 2014 amended July 7, 2018.
13. Wait, T.C. & White, J.L., 2006. *Rockfall Hazard Susceptibility in Colorado Springs*, El Paso County, Colorado. Colorado Geological Survey, Open-File Report 06-3
14. Colorado Geologic Survey, Colorado Landslide Inventory:
15. <https://cologeosurvey.maps.arcgis.com/apps/webappviewer/index.html?id=5e7484a637c4432e84f4f16d0af306d3>
16. Himmelreich, J.W. & Noe, D.C., 1999, *Map of Areas Susceptible to Differential Heave in Expansive, Steeply Dipping Bedrock*, City of Colorado Springs, Colorado. Colorado Geological Survey, Map Series 32. (Reviewed to verify project location)
17. Charles S. Robinson and Associates, Inc., 1977, El Paso County, Colorado – *Potential Geologic Hazards and Surficial Deposits, Environmental and Engineering Geologic Maps and Tales for Land Use*.
18. Morgan, M.L., and White, J.L., 2012, Geologic Map of the Falcon Quadrangle, El Paso County, Colorado, Colorado Geological Survey, Open File Report 12-05.

APPENDIX B

Guideline Site Grading Specifications

Description: Unless specified otherwise by local or state regulatory agencies, these guideline specifications are for the excavation, placement and compaction of material from locations indicated on the plans, or staked by the Engineer, as necessary to achieve the required elevations. These specifications shall also apply to compaction of materials that may be placed outside of the project.

General: The Geotechnical Engineer shall approve fill materials, method of placement, moisture contents and percent compactions, and shall give written approval of the compacted fill.

Clearing Site: The Contractor shall remove trees, brush, rubbish, vegetation, topsoil and existing structures before excavation or fill placement is commenced. The Contractor shall dispose of the cleared material to provide the Owner with a clean job site. Cleared material shall not be placed in areas to receive fill or where the material will support structures. Clearing shall also include removal of existing fills that do not meet the requirements of this specification and existing structures.

Preparation of Slopes or Drainage Areas to Receive Fill: Natural slopes or slopes of drainage gullies where grades are 20 percent (5:1, horizontal to vertical) or steeper shall be benched prior to fill placement. Benches shall be at least 10 feet wide. Benches may require additional width to accommodate excavation or compaction equipment. At least one bench shall be provided for each 5 feet or less of vertical elevation difference. The bench surface shall be essentially horizontal perpendicular to the slope or at a slight incline into the slope.

Scarifying: Topsoil and vegetation shall be removed from the ground surface in areas to receive fill. The surface shall be plowed or scarified a minimum of 12 inches until the surface is free from ruts, hummocks or other uneven features which would prevent uniform compaction by the equipment to be used.

Compacting Area to Receive Fill: After the area to receive fill has been cleared and scarified, it shall be disked or bladed until it is free from large clods, moisture conditioned to a proper moisture content and compacted to the maximum density as specified for the overlying fill. Areas to receive fill shall be worked, stabilized, or removed and replaced, if necessary, in accordance with the Geotechnical Engineer's recommendations in preparation for fill.

Fill Materials: Fill material shall be free from organic material or other deleterious substances, and shall not contain rocks or lumps having a diameter greater than six inches. Fill materials shall be obtained from cut areas shown on the plans or staked in the field by the Engineer or imported to the site and shall be approved by the Geotechnical Engineer prior to placement. It is recommended that the fill materials have nil to low expansion potential, i.e., consist of silty to slightly clayey sand.

Moisture Content: Fill materials shall be moisture conditioned to within limits of optimum moisture content specified. Sufficient laboratory compaction tests shall be made to determine the optimum moisture content for the various soils encountered in borrow areas or imported to the site.

The contractor may be required to add moisture to the excavation materials in the borrow area if, in the opinion of the Geotechnical Engineer, it is not possible to obtain uniform moisture content by

adding water to the fill material during placement. The Contractor may be required to rake or disk the fill soils to provide uniform moisture content through the soils.

The application of water to embankment materials shall be made with watering equipment, approved by the Geotechnical Engineer, which will give the desired results. Water jets from the spreader shall not be directed at the embankment with such force that fill materials are eroded.

Should too much water be added to the fill, such that the material is too wet to permit the desired compaction to be obtained, compacting and work on that section of the fill shall be delayed until the material has been allowed to dry to the required moisture content. The Contractor will be permitted to rework the wet material in an approved manner to hasten its drying.

Compaction of Fill Areas: Selected fill material shall be placed and mixed in evenly spread layers. After each fill layer has been placed, it shall be uniformly compacted to not less than the specified percentage of maximum density. Fill materials shall be placed such that the thickness of loose material does not exceed 10 inches and the compacted lift thickness does not exceed 6 inches.

Compaction, as specified above, shall be obtained by the use of sheepsfoot rollers, multiple-wheel pneumatic-tired rollers, or other equipment approved by the Geotechnical Engineer. Granular fill shall be compacted using vibratory equipment or other equipment approved by the Geotechnical Engineer. Compaction shall be accomplished while the fill material is at the specified moisture content. Compaction of each layer shall be continuous over the entire area.

Moisture Content and Density Criteria:

- A. For on-site, structural fills and fills supporting utilities, roadways and buildings, 95% maximum Standard Proctor dry density at $2\% \pm$ of optimum moisture content.
- B. For imported, granular, structural fills and granular fills supporting utilities, roadways and buildings, 90% maximum Modified Proctor dry density at $2\% \pm$ of optimum moisture content.
- C. For general grading fills, 92% maximum Standard Proctor dry density at $2\% \pm$ of optimum moisture content.

Compaction of Slopes: Fill slopes shall be compacted by means of sheepsfoot rollers or other suitable equipment. Compaction operations shall be continued until slopes are stable, but not too dense for planting, and such that there is no appreciable amount of loose soil on the slopes. Compaction of slopes may be done progressively in increments of three to five feet in height or after the fill is brought to its total height. Permanent fill slopes shall not exceed 3:1 (horizontal to vertical).

Density Testing: Field density testing shall be performed by the Geotechnical Engineer at locations and depths of his choosing. Where sheepsfoot rollers are used, the soil may be disturbed to a depth of several inches. Density tests shall be taken in compacted material below the disturbed surface. When density tests indicate the density or moisture content of any layer of fill or portion thereof is below that required, the particular layer or portion shall be reworked until the required density or moisture content has been achieved.

Observation and Testing of Fill: Observation by the Geotechnical Engineer shall be sufficient during the placement of fill and compaction operations so that he can declare the fill was placed in

general conformance with Specifications. All observations necessary to test the placement of fill and observe compaction operations will be at the expense of the Owner.

Seasonal Limits: No fill material shall be placed, spread or rolled while it is frozen, thawing, or during unfavorable weather conditions. When work is interrupted by heavy precipitation, fill operations shall not be resumed until the Geotechnical Engineer indicates the moisture content and density of previously placed materials are as specified.

Reporting of Field Density Tests: Density tests made by the Geotechnical Engineer shall be submitted progressively to the Owner. Dry density, moisture content, percent compaction, and approximate location shall be reported for each test taken.

FIGURES



NOT TO SCALE



ROCKY MOUNTAIN GROUP

Southern Office
 Colorado Springs, CO
 80918
 (719) 548-0600
Central Office:
 Englewood, CO 80112
 (303) 688-9475
Northern Office:
 Greeley / Evans, CO 80620
 (970) 330-1071

SITE VICINITY MAP

FALCON MEADOWS AT GRASS WEST
 EL PASO COUNTY, CO
 CHALLENGER COMMUNITIES

JOB No. 176147

FIG No. 1

DATE 6-22-2020
 revised 12-10-2020



ROCKY MOUNTAIN GROUP

Southern Office
 Colorado Springs, CO
 80918
 (719) 548-0600

Central Office:
 Englewood, CO 80112
 (303) 688-9475

Northern Office:
 Greeley / Evans, CO 80620
 (970) 330-1071

Woodland Park Office:
 (719) 687-6077

Monument Office:
 (719) 488-2145

Pueblo / Canon City:
 (719) 544-7750

FALCON MEADOWS AT BENT GRASS
 EL PASO COUNTY, CO
 CHALLENGER COMMUNITIES

ENGINEER: TFM
 DRAWN BY: KZ
 CHECKED BY: TFM
 ISSUED: 6-22-2020
 REVISION: 12-10-2020

SITE PLAN WITH TEST BORING LOCATIONS

SHEET No. FIG-2



- DENOTES APPROXIMATE LOCATION OF TEST BORINGS PERFORMED FOR THE PRELIMINARY SUBSURFACE SOILS INVESTIGATION BY RMG - ROCKY MOUNTAIN GROUP (JOB NO. 169845)
- ⊙ DENOTES APPROXIMATE LOCATION OF TEST BORINGS PERFORMED FOR THIS INVESTIGATION



NOT TO SCALE
 BASE MAP PROVIDED BY: N.E.S., INC.

SOILS DESCRIPTION



CLAYEY SAND



CLAYSTONE



SANDSTONE



SILTY SAND



SILTY TO CLAYEY SAND

UNLESS NOTED OTHERWISE, ALL LABORATORY TESTS PRESENTED HEREIN WERE PERFORMED BY:
 RMG - ROCKY MOUNTAIN GROUP
 2910 AUSTIN BLUFFS PARKWAY
 COLORADO SPRINGS, COLORADO

SYMBOLS AND NOTES



XX

STANDARD PENETRATION TEST - MADE BY DRIVING A SPLIT-BARREL SAMPLER INTO THE SOIL BY DROPPING A 140 LB. HAMMER 30", IN GENERAL ACCORDANCE WITH ASTM D-1586. NUMBER INDICATES NUMBER OF HAMMER BLOWS PER FOOT (UNLESS OTHERWISE INDICATED).



XX

UNDISTURBED CALIFORNIA SAMPLE - MADE BY DRIVING A RING-LINED SAMPLER INTO THE SOIL BY DROPPING A 140 LB. HAMMER 30", IN GENERAL ACCORDANCE WITH ASTM D-3550. NUMBER INDICATES NUMBER OF HAMMER BLOWS PER FOOT (UNLESS OTHERWISE INDICATED).



FREE WATER TABLE



DEPTH AT WHICH BORING CAVED



BULK DISTURBED BULK SAMPLE



AUG AUGER "CUTTINGS"

4.5

WATER CONTENT (%)

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs: (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

EXPLANATION OF TEST BORING LOGS

JOB No. 176147

FIGURE No. 3

DATE Jun/22/2020

TEST BORING: 1 ELEVATION (FT): DATE DRILLED: 4/17/20 GROUNDWATER @ 12.0' 4/20/20	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %	TEST BORING: 2 ELEVATION (FT): DATE DRILLED: 4/17/20 GROUNDWATER @ 16.5' 4/20/20	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %
SAND., SILTY, light gray with rust staining, dense, moist	5			40	5.1	SAND, SILTY, tan to brown, medium dense, moist	5			17	7.1
SAND, CLAYEY, gray with rust staining, very stiff, moist to wet	10			28	18.0		10			25	10.8
SANDSTONE, SILTY, gray to olive, very hard, moist to wet	15			50/6"	9.9	CLAYSTONE, SANDY, gray, medium hard, moist to wet	15			50/7"	15.8
	20			50/5"	9.7		20			41	12.3

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs - (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

TEST BORING LOG

JOB No. 176147

FIGURE No. 4

DATE Jun/22/2020

TEST BORING: 3 ELEVATION (FT): DATE DRILLED: 4/17/20 GROUNDWATER @ 7.5' 4/20/20	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %	TEST BORING: 4 ELEVATION (FT): DATE DRILLED: 4/17/20 NO GROUNDWATER ON 4/20/20	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %
SAND, SILTY, tan to gray, loose to very dense, moist to wet	5			9	12.2	SANDTONE, SILTY, gray, hard to very hard, moist	5			50/10"	6.6
CLAYSTONE, SANDY, gray, moist to wet	10			16	16.6		10			50/6"	6.2
	15			39	19.1		15			50/6"	6.6
					24.2	CLAYSTONE, SANDY, gray with rust staining, hard, moist	20			50/9"	13.1

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs - (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600









SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

TEST BORING LOG

JOB No. 176147

FIGURE No. 5

DATE Jun/22/2020

TEST BORING: 5 ELEVATION (FT): DATE DRILLED: 4/17/20 GROUNDWATER @ 6.0' 4/20/20	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %	
SAND, SILTY TO CLAYEY, gray with rust staining, medium dense, moist to wet	5			13	1.6	
	10			17	12.5	
	15				15.0	
					16.3	

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs - (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

TEST BORING LOG

JOB No. 176147

FIGURE No. 6

DATE Jun/22/2020

Test Boring No.	Depth	Water Content (%)	Dry Density (pcf)	Liquid Limit	Plasticity Index	% Retained No.4 Sieve	% Passing No. 200 Sieve	FHA Expansion Pressure (psf)	% Swell/Collapse	USCS Classification
1	4.0	5.1								
1	9.0	18.0		38	20	3.5	12.5			SC
1	14.0	9.9								
1	19.0	9.7								
2	4.0	7.1								
2	9.0	10.8								
2	14.0	15.8	117.5	42	19		60.8		0.3	CL
2	19.0	12.3								
3	4.0	12.2		NP	NP	9.9	5.2			SP-SM
3	9.0	16.6								
3	14.0	19.1								
3	18.0	24.2								
4	4.0	6.6								
4	9.0	6.2		NP	NP	9.0	10.4			SW-SM
4	14.0	6.6								
4	19.0	13.1								
5	4.0	1.6		NP	NP	9.5	6.7			SW-SM
5	9.0	12.5								
5	14.0	15.0								
5	18.0	16.3								

ROCKY MOUNTAIN GROUP

ARCHITECTS
RMG
ENGINEERS


Colorado Springs: (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

Geotechnical
Materials Testing
Civil, Planning

SUMMARY OF LABORATORY TEST RESULTS

JOB No. 176147
 FIGURE No. 7
 PAGE 1 OF 1
 DATE Jun/22/2020

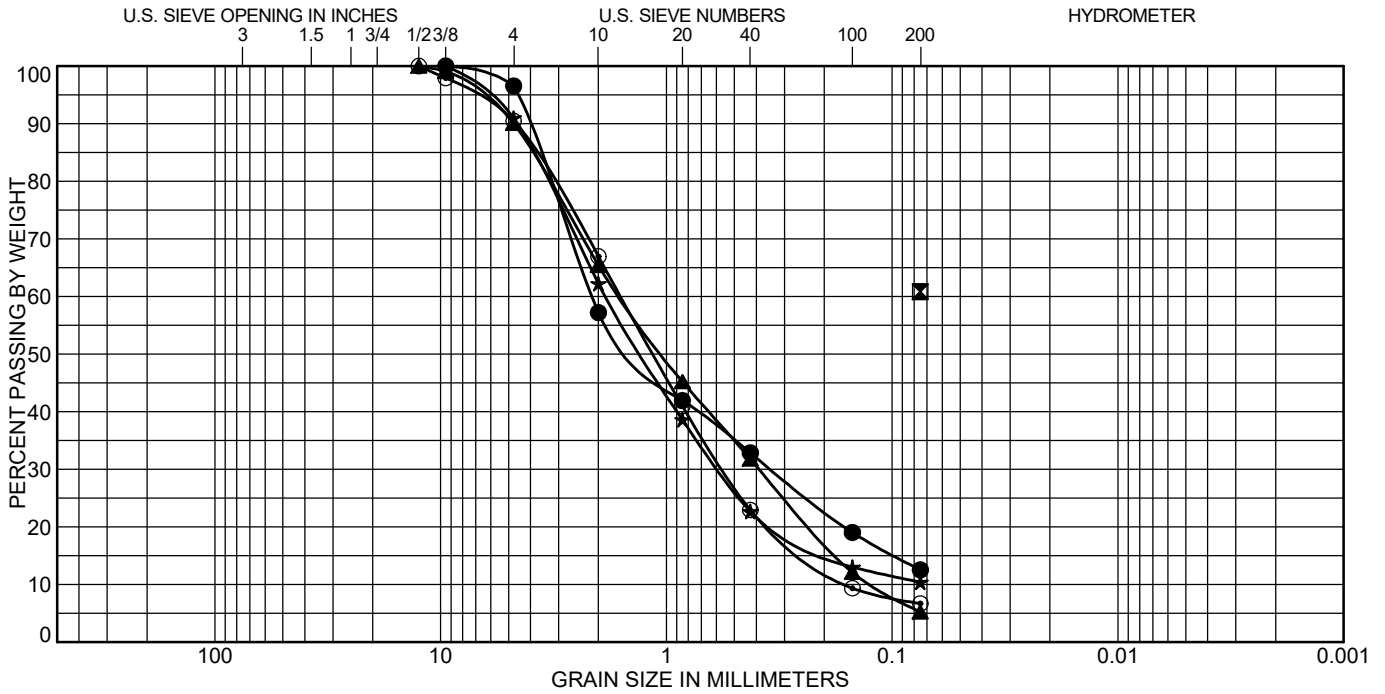

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Test Boring	Depth (ft)	Classification	LL	PL	PI
● 1	9.0	CLAYEY SAND(SC)	38	18	20
☒ 2	14.0	SANDY LEAN CLAY(CL)	42	23	19
▲ 3	4.0	POORLY GRADED SAND with SILT(SP-SM)	NP	NP	NP
★ 4	9.0	WELL-GRADED SAND with SILT(SW-SM)	NP	NP	NP
⊙ 5	4.0	WELL-GRADED SAND with SILT(SW-SM)	NP	NP	NP

Test Boring	Depth (ft)	%Gravel	%Sand	%Silt	%Clay
● 1	9.0	3.5	84.0	12.5	
☒ 2	14.0			60.8	
▲ 3	4.0	9.9	84.8	5.2	
★ 4	9.0	9.0	80.6	10.4	
⊙ 5	4.0	9.5	83.8	6.7	

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Colorado Springs (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO


Geotechnical
Materials Testing
Civil, Planning

SOIL CLASSIFICATION DATA

JOB No. 176147

FIGURE No. 8

DATE Jun/22/2020

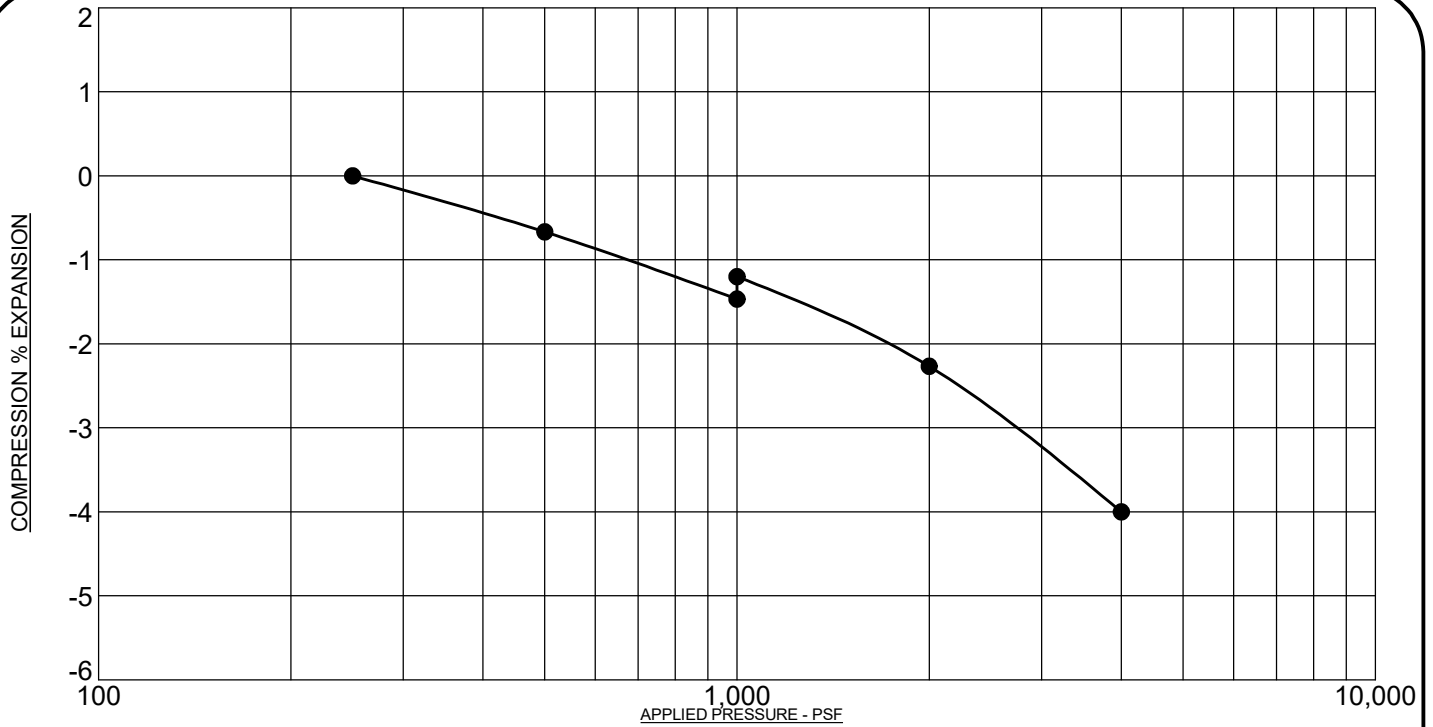

PROJECT: **Bent Grass West El Paso County, Colorado**
 SAMPLE DESCRIPTION: **CLAYSTONE, SANDY**
 NOTE: **SAMPLE WAS INUNDATED WITH WATER AT 1,000 PSF**

SAMPLE LOCATION: **2 @ 14 FT**
 NATURAL DRY UNIT WEIGHT: **117.5 PCF**
 NATURAL MOISTURE CONTENT: **10.0%**
 PERCENT SWELL/COMPRESSION: **0.3**

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs - (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

SWELL/CONSOLIDATION TEST RESULTS

JOB No. 176147

FIGURE No. 9

DATE Jun/22/2020



ROCKY MOUNTAIN GROUP

Southern Office
 Colorado Springs, CO
 80918
 (719) 548-0600
Central Office:
 Englewood, CO 80112
 (303) 688-9475
Northern Office:
 Greeley / Evans, CO 80620
 (970) 330-1071
Woodland Park Office:
 (719) 687-6077
Monument Office:
 (719) 488-2145
Pueblo / Canon City:
 (719) 544-7750

FALCON MEADOWS AT BENT GRASS
 EL PASO COUNTY, CO
 CHALLENGER COMMUNITIES

ENGINEER:	TFM
DRAWN BY:	KZ
CHECKED BY:	TFM
ISSUED:	6-22-2020
REVISION:	12-10-2020
REVISION:	12-3-2021

ENGINEERING AND GEOLOGY MAP


SHEET No.
FIG-10

Geologic


- Qes - Eolian Sand: likely deposited as a sandsheet by winds capable of moving very fine gravel-sized clasts
- Qa₁ - Alluvium one: sandy gravel, gravelly sand, silty sand, and sandy silt in modern channels, floodplains, and adjacent low-lying terraces that are approximately 5 feet or less above modern channels. Thickness of the unit is estimated to range from about 2 to 15 feet but could be greater in places.
- Qa₂ - Alluvium two: stream terrace deposits approximately 6-12 feet above the modern flood plain or as non-terrace forming alluvium in valley headwaters.
- Qa₃ - Alluvium three: stream deposits approximately 10-20 feet above the modern floodplain or as non-terrace forming alluvium in valley headwaters that underlies the younger alluviums
- sw - seasonally wet area where near-surface moisture conditions may occasionally occur

Engineering

- 2A - Stable alluvium, colluvium and bedrock on gentle to moderate slopes
- 7A - Physiographic floodplain where erosion and deposition presently occur and is generally subject to recurrent flooding. Includes 100-year floodplain along major streams where floodplain studies have been conducted and Base Floor Elevations have been determined



Lots to be restricted to non-basement construction. However, if a groundwater monitoring study performed at some future date indicates that the lots have suitable separation from groundwater, basement construction may be considered.



Area defined as subject to inundation by the 1-percent annual chance flood event.

GW @

Groundwater depths at time of drilling and/or when checked three days subsequent to drilling



ASSUMED PROPERTY LINE

BLAKELAND LOAMY SAND - 1 TO 3% SLOPES

8

19

COLUMBINE GRAVELLY SANDY LOAM, 0 TO 3% SLOPES

19

COLUMBINE GRAVELLY SANDY LOAM, 0 TO 3% SLOPES

9

BLAKELAND-FLUVAQUENTIC HAPLAQUOLLS



NOT TO SCALE

BASE MAP PROVIDED BY: USDA



ROCKY MOUNTAIN GROUP

Southern Office
Colorado Springs, CO
80918
(719) 548-0600
Central Office:
Englewood, CO 80112
(303) 688-9475
Northern Office:
Greeley / Evans, CO 80620
(970) 330-1071


USDA SOIL SURVEY MAP

FALCON MEADOWS AT GRASS WEST
EL PASO COUNTY, CO
CHALLENGER COMMUNITIES

JOB No. 176147

FIG No. 11

DATE 6-22-2020
revised 12-10-2020

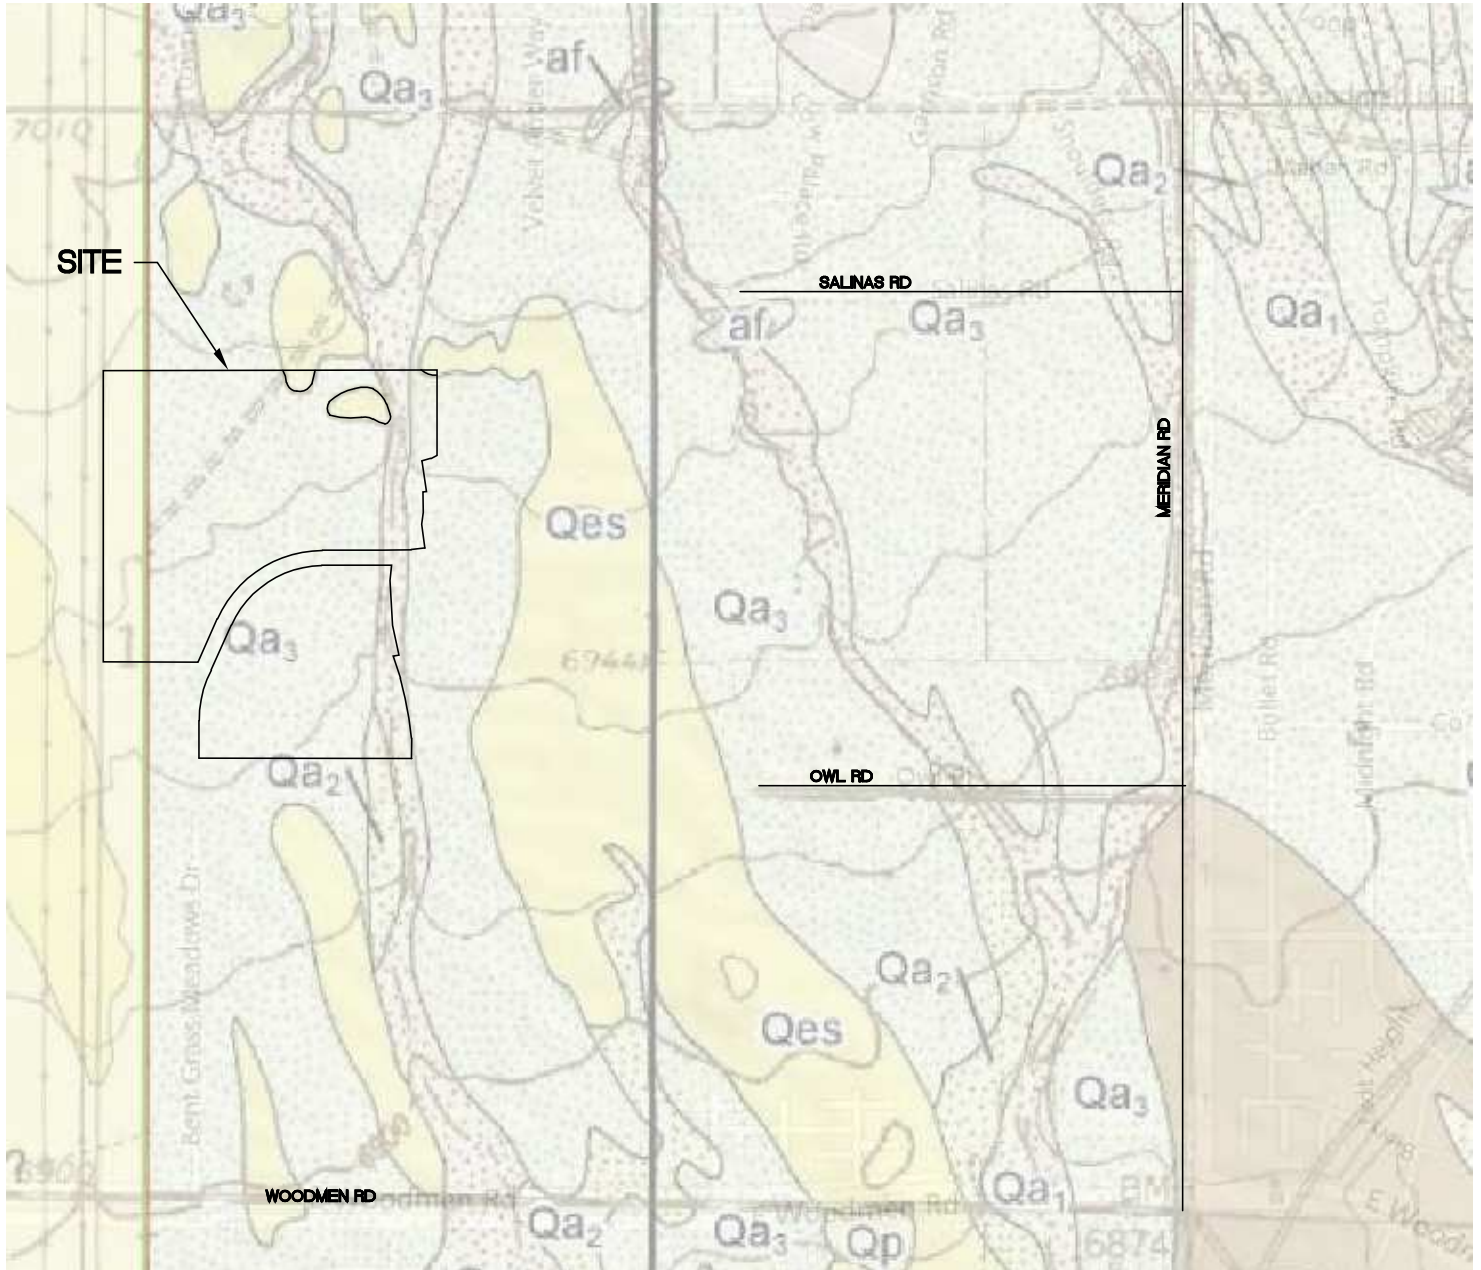

NOT TO SCALE
 BASE MAP PROVIDED BY: CGS



ROCKY MOUNTAIN GROUP

Southern Office
 Colorado Springs, CO
 80918
 (719) 548-0600
Central Office:
 Englewood, CO 80112
 (303) 688-9475
Northern Office:
 Greeley / Evans, CO 80620
 (970) 330-1071


FALCON QUADRANGLE

FALCON MEADOWS AT GRASS WEST
 EL PASO COUNTY, CO
 CHALLENGER COMMUNITIES

JOB No. 176147

FIG No. 12

DATE 6-22-2020
 revised 12-10-2020

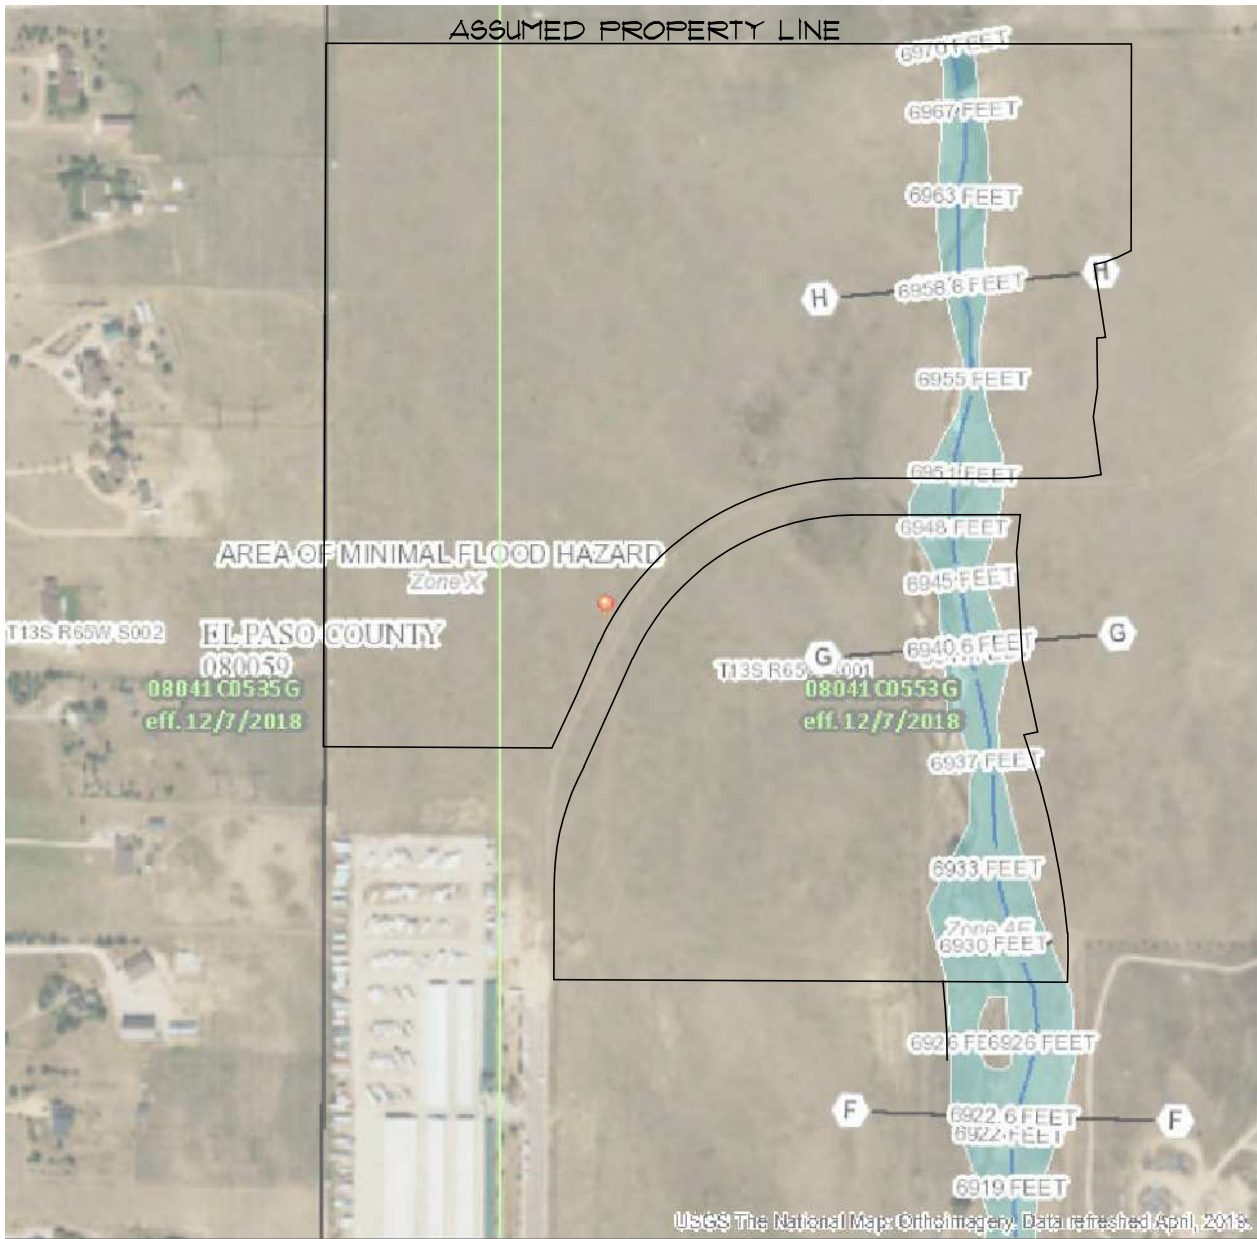

NOT TO SCALE
BASE MAP PROVIDED BY: FEMA



Southern Office
Colorado Springs, CO
80918
(719) 548-0600
Central Office
Englewood, CO 80112
(303) 688-9475
Northern Office
Greeley / Evans, CO 80620
(970) 330-1071

FEMA MAP

FALCON MEADOWS AT GRASS WEST
EL PASO COUNTY, CO
CHALLENGER COMMUNITIES

JOB No. 176147

FIG No. 13

DATE 6-22-2020
revised 12-10-2020

APPENDIX A

Additional Referenced Documents

1. PUD Preliminary Plan, Bent Grass West,
 2. Concept Layout, Bent Grass Future Phases, prepared by NES, dated April 10, 2020.
 3. El Paso County, updated thru July 9, 2019, Section 8.4.9, *El Paso County Land Development Code*.
 4. El Paso County, revise July 9, 2019, *Appendix C, Soils Investigation Reports and Mitigation, Engineering Criteria Manual*.
 5. Google Maps, Aerial Photograph, downloaded June 15, 2020.
 6. El Paso County, February 8, 1996, *Master Plan for Mineral Extraction, Map 2*.
 7. Kirkham, R.M. and Rogers, W.P., 1981, *Earthquake Potential in Colorado, A Preliminary Evaluation*, Colorado Geological Survey, Bulletin 43.
 8. Colorado Geological Survey, 1991, *Results of the 1987-88 EPA Supported Radon Study in Colorado, with a discussion on Geology*, Open file Report 91-4.
 9. Dames and Moore, 1985, *Colorado Springs Subsidence Investigation, State of Colorado Mined Land Reclamation*. (Reviewed to verify project location)
 10. Federal Emergency Management Agency (FEMA), dated December 7, 2018, *Flood Insurance Rate Map, El Paso County, Colorado and Unincorporated Areas, Community Panel No. 08041C0553G*.
 11. United States Department of Agriculture Soils Conservation Service, 1980, *Soil Survey of El Paso County Area, Colorado*.
<http://websoilsurvey.sc.egov.usda.gov/App/WebSoilSurvey.aspx>
 12. On-site Wastewater Treatment Systems (OWTS) Regulations, El Paso County, Colorado, Chapter 8, effective April 10, 2014 amended July 7, 2018.
 13. Wait, T.C. & White, J.L., 2006. *Rockfall Hazard Susceptibility in Colorado Springs*, El Paso County, Colorado. Colorado Geological Survey, Open-File Report 06-3
 14. Colorado Geologic Survey, Colorado Landslide Inventory:
 15. <https://cologeosurvey.maps.arcgis.com/apps/webappviewer/index.html?id=5e7484a637c4432e84f4f16d0af306d3>
 16. Himmelreich, J.W. & Noe, D.C., 1999, *Map of Areas Susceptible to Differential Heave in Expansive, Steeply Dipping Bedrock*, City of Colorado Springs, Colorado. Colorado Geological Survey, Map Series 32. (Reviewed to verify project location)
 17. Charles S. Robinson and Associates, Inc., 1977, El Paso County, Colorado – *Potential Geologic Hazards and Surficial Deposits, Environmental and Engineering Geologic Maps and Tales for Land Use*.
 18. Morgan, M.L., and White, J.L., 2012, Geologic Map of the Falcon Quadrangle, El Paso County, Colorado, Colorado Geological Survey, Open File Report 12-05.
-

APPENDIX B

Guideline Site Grading Specifications

Description: Unless specified otherwise by local or state regulatory agencies, these guideline specifications are for the excavation, placement and compaction of material from locations indicated on the plans, or staked by the Engineer, as necessary to achieve the required elevations. These specifications shall also apply to compaction of materials that may be placed outside of the project.

General: The Geotechnical Engineer shall approve fill materials, method of placement, moisture contents and percent compactions, and shall give written approval of the compacted fill.

Clearing Site: The Contractor shall remove trees, brush, rubbish, vegetation, topsoil and existing structures before excavation or fill placement is commenced. The Contractor shall dispose of the cleared material to provide the Owner with a clean job site. Cleared material shall not be placed in areas to receive fill or where the material will support structures. Clearing shall also include removal of existing fills that do not meet the requirements of this specification and existing structures.

Preparation of Slopes or Drainage Areas to Receive Fill: Natural slopes or slopes of drainage gullies where grades are 20 percent (5:1, horizontal to vertical) or steeper shall be benched prior to fill placement. Benches shall be at least 10 feet wide. Benches may require additional width to accommodate excavation or compaction equipment. At least one bench shall be provided for each 5 feet or less of vertical elevation difference. The bench surface shall be essentially horizontal perpendicular to the slope or at a slight incline into the slope.

Scarifying: Topsoil and vegetation shall be removed from the ground surface in areas to receive fill. The surface shall be plowed or scarified a minimum of 12 inches until the surface is free from ruts, hummocks or other uneven features which would prevent uniform compaction by the equipment to be used.

Compacting Area to Receive Fill: After the area to receive fill has been cleared and scarified, it shall be disked or bladed until it is free from large clods, moisture conditioned to a proper moisture content and compacted to the maximum density as specified for the overlying fill. Areas to receive fill shall be worked, stabilized, or removed and replaced, if necessary, in accordance with the Geotechnical Engineer's recommendations in preparation for fill.

Fill Materials: Fill material shall be free from organic material or other deleterious substances, and shall not contain rocks or lumps having a diameter greater than six inches. Fill materials shall be obtained from cut areas shown on the plans or staked in the field by the Engineer or imported to the site and shall be approved by the Geotechnical Engineer prior to placement. It is recommended that the fill materials have nil to low expansion potential, i.e., consist of silty to slightly clayey sand.

Moisture Content: Fill materials shall be moisture conditioned to within limits of optimum moisture content specified. Sufficient laboratory compaction tests shall be made to determine the optimum moisture content for the various soils encountered in borrow areas or imported to the site.

The contractor may be required to add moisture to the excavation materials in the borrow area if, in the opinion of the Geotechnical Engineer, it is not possible to obtain uniform moisture content by

adding water to the fill material during placement. The Contractor may be required to rake or disk the fill soils to provide uniform moisture content through the soils.

The application of water to embankment materials shall be made with watering equipment, approved by the Geotechnical Engineer, which will give the desired results. Water jets from the spreader shall not be directed at the embankment with such force that fill materials are eroded.

Should too much water be added to the fill, such that the material is too wet to permit the desired compaction to be obtained, compacting and work on that section of the fill shall be delayed until the material has been allowed to dry to the required moisture content. The Contractor will be permitted to rework the wet material in an approved manner to hasten its drying.

Compaction of Fill Areas: Selected fill material shall be placed and mixed in evenly spread layers. After each fill layer has been placed, it shall be uniformly compacted to not less than the specified percentage of maximum density. Fill materials shall be placed such that the thickness of loose material does not exceed 10 inches and the compacted lift thickness does not exceed 6 inches.

Compaction, as specified above, shall be obtained by the use of sheepsfoot rollers, multiple-wheel pneumatic-tired rollers, or other equipment approved by the Geotechnical Engineer. Granular fill shall be compacted using vibratory equipment or other equipment approved by the Geotechnical Engineer. Compaction shall be accomplished while the fill material is at the specified moisture content. Compaction of each layer shall be continuous over the entire area.

Moisture Content and Density Criteria:

- A. For on-site, structural fills and fills supporting utilities, roadways and buildings, 95% maximum Standard Proctor dry density at $2\% \pm$ of optimum moisture content.
- B. For imported, granular, structural fills and granular fills supporting utilities, roadways and buildings, 90% maximum Modified Proctor dry density at $2\% \pm$ of optimum moisture content.
- C. For general grading fills, 92% maximum Standard Proctor dry density at $2\% \pm$ of optimum moisture content.

Compaction of Slopes: Fill slopes shall be compacted by means of sheepsfoot rollers or other suitable equipment. Compaction operations shall be continued until slopes are stable, but not too dense for planting, and such that there is no appreciable amount of loose soil on the slopes. Compaction of slopes may be done progressively in increments of three to five feet in height or after the fill is brought to its total height. Permanent fill slopes shall not exceed 3:1 (horizontal to vertical).

Density Testing: Field density testing shall be performed by the Geotechnical Engineer at locations and depths of his choosing. Where sheepsfoot rollers are used, the soil may be disturbed to a depth of several inches. Density tests shall be taken in compacted material below the disturbed surface. When density tests indicate the density or moisture content of any layer of fill or portion thereof is below that required, the particular layer or portion shall be reworked until the required density or moisture content has been achieved.

Observation and Testing of Fill: Observation by the Geotechnical Engineer shall be sufficient during the placement of fill and compaction operations so that he can declare the fill was placed in

general conformance with Specifications. All observations necessary to test the placement of fill and observe compaction operations will be at the expense of the Owner.

Seasonal Limits: No fill material shall be placed, spread or rolled while it is frozen, thawing, or during unfavorable weather conditions. When work is interrupted by heavy precipitation, fill operations shall not be resumed until the Geotechnical Engineer indicates the moisture content and density of previously placed materials are as specified.

Reporting of Field Density Tests: Density tests made by the Geotechnical Engineer shall be submitted progressively to the Owner. Dry density, moisture content, percent compaction, and approximate location shall be reported for each test taken.

Appendix C

Preliminary Subsurface Soil Investigation, Bent Grass, Filing No. 2, Colorado Springs, Colorado Springs, Colorado, prepared by RMG – Rocky Mountain Group, Job No. 169845, revised August 6, 2019.

Architecture
Structural
Geotechnical



Materials Testing
Forensic
Civil/Planning

ROCKY MOUNTAIN GROUP
EMPLOYEE OWNED

PRELIMINARY SUBSURFACE SOIL INVESTIGATION

**Bent Grass Meadows Filing No. 2
Colorado Springs, Colorado**

PREPARED FOR:

**Challenger Colorado, LLC
8605 Explorer Drive, Suite 250
Colorado Springs, CO 80920**

JOB NO. 169845

**May 15, 2019
Revised August 6, 2019**

Respectfully Submitted,

RMG – Rocky Mountain Group

A handwritten signature in purple ink, appearing to read "Brian Griffith".

**Brian Griffith, E.I.
Geotechnical Staff Engineer**

Reviewed by,

RMG – Rocky Mountain Group

**Geoff Webster, P.E.
Sr. Geotechnical Project Engineer**



TABLE OF CONTENTS

GENERAL SITE AND PROJECT DESCRIPTION.....	3
Project Description	3
Existing Site Conditions	3
FIELD INVESTIGATION AND LABORATORY TESTING	3
Drilling	3
Laboratory Testing	3
SUBSURFACE CONDITIONS.....	4
Subsurface Materials	4
Groundwater.....	4
CONCLUSIONS AND RECOMMENDATIONS.....	5
Geotechnical Considerations	5
Open Excavation Observations	6
Proposed Grading, Cuts and Masses of Fill	6
Anticipated Foundation Concepts	6
Floor Slabs.....	7
Structural Fill - General.....	7
Foundation Drains	8
Surface Grading and Drainage	8
Concrete.....	9
Exterior Backfill.....	9
BURIED UTILITIES	9
PRELIMINARY PAVEMENT RECOMMENDATIONS.....	10
ADDITIONAL STUDIES.....	10
CLOSING.....	10
FIGURES	
Site Vicinity Map	1
Test Boring Location Plan	2
Anticipated Overexcavation Areas – Stiffened Slabs	2-1
Anticipated Overexcavation Areas - Basements	2-2
Explanation of Test Boring Logs	3
Test Boring Logs.....	4-16
Summary of Laboratory Test Results.....	17
Soil Classification Data	18-22
Swell/Consolidation Test Results.....	23-27
APPENDIX A	
Guideline Site Grading Specifications	

GENERAL SITE AND PROJECT DESCRIPTION

Project Description

The site is located northeast of Colorado Springs, Colorado, generally north of the intersection of Woodmen Road and Meridian Road. The approximate location of the site is shown on the Site Vicinity Map, Figure 1.

The site is being considered for residential development. RMG – Rocky Mountain Group was retained to explore the subsurface conditions at the site and provide preliminary information to assess the suitability of the land for development.

Existing Site Conditions

The site is undeveloped ranch land bounded by and connecting to the developed Bent Grass Meadows Filing No. 1 to the east.

FIELD INVESTIGATION AND LABORATORY TESTING

Drilling

The subsurface conditions on the site were investigated by drilling twenty-five (25) exploratory test borings. The approximate locations of the test borings are presented in the Test Boring Location Plan Figure 2. The areas where overexcavation of cohesive soils is anticipated (based on our preliminary investigation) for stiffened slab-on-grade foundations and basement foundations are presented in Figure 2-1 and Figure 2-2.

The test borings were advanced with a power-driven, continuous-flight auger drill rig to depths of 15 to 30-feet below the existing ground surface. Samples were obtained in general accordance with ASTM D-1586 utilizing a 2-inch OD split-barrel sampler or in general accordance with ASTM D-3550 utilizing a 2½-inch OD modified California sampler. An Explanation of Test Boring Logs is presented in Figure 3. The Test Boring Logs are presented in Figures 4 through 16.

Laboratory Testing

The moisture content for the recovered samples was obtained in the laboratory. Grain-size analysis, Atterberg Limits, and Denver Swell/Consolidation tests were performed on selected samples for purposes of classification and to develop pertinent engineering properties. A Summary of Laboratory Test Results is presented in Figure 17 (three pages). Soil Classification Data are presented in Figures 18 through 22. Swell/Consolidation Test Results are presented in Figures 23 through 27.

SUBSURFACE CONDITIONS

Subsurface Materials

The subsurface materials encountered in the Test Borings are typical for this region of Colorado. The Dawson Formation is characterized by layers of alluvial soil of varying thickness overlying alternating layers of sandstone and claystone. The bedding of the soils is irregular and discontinuous and each soil profile was different in the arrangement of strata. In general the surficial soils were comprised of silty to clayey sand underlain by sandstone and claystone bedrock. The bedrock was encountered at the ground surface in some locations and at shallow depths across the site.

Subsurface soils encountered in the test borings classified in accordance with the Unified Soils Classification System (USCS) as native SM-SC, silty to clayey sand, SW-SM, well-graded sand with silt, and CL, sandy lean clay. The surficial soils exhibited almost no expansive characteristics, whereas the claystone exhibited low swell potential.

Additional descriptions and the interpreted distribution (approximate depths) of the subsurface materials are presented on the Test Boring Logs. The descriptions in the logs are based upon the engineer's visual classification of the samples at the depths indicated. Stratification lines shown on the logs represent the approximate boundaries between material types and the actual transitions may be gradual and vary with location.

Groundwater

Groundwater was observed in several of the test borings at the time of field exploration sporadically across the site. Depth to groundwater in the various Test Borings is presented in the table below. Fluctuations in groundwater and subsurface moisture conditions may occur due to variations in rainfall and other factors not readily apparent at this time. Depending upon depths of excavations, groundwater may be a factor in foundation construction. The Contractor should always be prepared to control groundwater during construction.

Groundwater	
Test Boring	Depth Below Ground Surface (feet)
1	27
5	14
14	14
16	28
19	14
23	19
25	19

CONCLUSIONS AND RECOMMENDATIONS

The following discussion is based on the subsurface conditions encountered in the test borings and on the project characteristics previously described. If conditions are different from those described in this report or the project characteristics change, RMG should be retained to review our recommendations and adjust them, if necessary.

Geotechnical Considerations

Preliminary grading plans were not provided or reviewed by RMG at the time this report was issued. The relationship of existing ground surface where soil test borings were performed may differ from final grades, and this could affect the depth to groundwater and the depth to bedrock and / or expansive soil layers.

The site is generally characterized as surficial soils of medium dense silty and clayey sand overlying hard silty sandstone and medium hard weathered to formational claystone bedrock at varying depths. Sandstone was encountered at or near the ground surface in Test Borings 8, 13, 16, 22, and 25. Claystone was encountered at or near the ground surface in Test Borings 20 and 21.

Final site grading will determine the extent to which sandstone and claystone may affect foundation construction, but in general, if basement construction is proposed, overexcavation of bedrock may be anticipated. Claystone exhibited low expansion potential in laboratory testing, but as always a minimum of 3-foot separation from foundation elements should be anticipated. If sandstone is encountered, 12-inches of sandstone removal and replacement with structural fill may be necessary to ensure foundations bear upon soil of equal bearing capacity.

Foundation design considerations, based on the field investigation and laboratory testing, are presented below. It must be understood that these considerations should be verified after the excavation for individual structures is completed.

Overexcavation and Replacement

The claystone at this site exhibited low swell potential and should not be considered suitable for direct bearing of shallow foundations. Where claystone is encountered under building sites a minimum 3-foot of separation from foundation components and floor slabs may be necessary to provide stable support. Based on our preliminary investigation, we anticipate that overexcavation of cohesive soils will be required for stiffened slab-on-grade foundations on approximately 41 lots and for basement foundations on approximately 131 lots as demonstrated in Figures 2-1 and 2-2.

If loose soils are encountered, they may require additional compaction to achieve the allowable bearing capacity indicated in this report. Structures should not be supported atop soil/bedrock of significantly different bearing capacities such as silty sand and sandstone bedrock. Where any portion of a structure is to be supported atop compacted structural fill, the remaining portions of the excavation should have the top 12-inches of exposed sandstone scarified and compacted, or removed and replaced with structural fill.

Open Excavation Observations

During construction, foundation excavations should be observed by RMG prior to placing structural fill, forms, or concrete to verify the foundation bearing conditions for each structure. Based on the conditions observed in the foundation excavation, the recommendations made at the time of construction may vary from those contained herein. In the case of differences, the Open Excavation Observation report shall be considered to be the governing document. The recommendations presented herein are intended only as preliminary guidelines to be used for interpreting the subsurface soil conditions exposed in the excavation and determining the final recommendations for foundation construction.

Proposed Grading, Cuts and Masses of Fill

Preliminary grading plans were not provided or reviewed by RMG at the time the report was issued. Based on the test borings for this investigation soils that will be encountered include native silty and clayey sand, silty sandstone, and claystone. The on-site sand soils can generally be used as site grading fill or structural fill. Any clay or claystone encountered is not recommended for use as structural fill or for use as site grading fill in areas that will be below or directly adjacent to the proposed structures. Prior to placement of overlot fill or removal and recompaction of the existing materials, topsoil, fill and organic matter should be removed from fill areas. The subgrade should be scarified and moisture conditioned to within 2% of the optimum moisture content and recompacted to the same degree as the overlying fill to be placed. The placement and compaction of fill should be periodically observed and tested by a representative of RMG during construction.

- *Guideline Site Grading Specifications are included in the Appendix A.*

Anticipated Foundation Concepts

Final grades as they relate to the top of soil test borings were not available at the time this report was prepared. The in situ site soil encountered in the test borings is generally suitable to support conventional shallow foundation systems consisting of standard spread footings/stemwalls or stiffened slabs. Alternative foundation systems are not anticipated. It is assumed that the deepest excavation cuts will be approximately 6 to 8 feet below the final ground surface, not including overexcavation or subexcavation which may be required. The native silty sand is generally suitable as structural fill when prepared in accordance with recommendations herein.

Foundations in general

Structures should not be supported atop soils and bedrock of significantly different bearing capacities. Formational sandstone bedrock for instance, if encountered at bottom of footing grade, should be overexcavated 12-inches and either recompacted or replaced with structural fill.

The foundation system for each proposed structure should be designed based upon recommendations developed in a detailed Subsurface Soil Investigation completed after overlot grading and site development activities are complete. The results presented in this Preliminary Subsurface Soils Investigation should be verified following the excavation for each structure and evaluation of the building loads.

The allowable bearing pressures to be used for design of foundation components should be determined by a detailed site specific Subsurface Soils Investigation. An allowable bearing pressure of 2,500 psf is anticipated for the native granular, non-expansive soils or imported structural fill compacted as indicated

herein. The foundation design should be prepared by a qualified Colorado Registered Professional Engineer using the recommendations presented in this report. Bottoms of foundations should be at least 30 inches below finished grade for frost protection. Settlements of 1-inch or less overall and ½-inch or less differential may be anticipated. Settlement in granular soil will occur immediately upon construction loads. Long term consolidation settlement is not anticipated.

Foundation and basement walls should be designed to resist lateral pressures. For granular, non-expansive soils used as exterior backfill around foundations, an equivalent fluid pressure (EFP) of 40 pcf may be used for design in addition to any lateral pressure from high groundwater conditions. Expansive soils as exterior backfill around foundations should typically be avoided. However, if the client elects to use expansive soils (claystone bedrock is not recommended) as backfill against foundation walls, higher lateral pressures should be anticipated. The lateral pressures presented herein apply to level, drained backfill conditions. Lateral pressures for sloping/undrained conditions or for expansive backfill soils should be determined on an individual basis.

Stiffened Slab-on-grade Foundations

The native silty sand soil is suitable for stiffened slab-on-grade foundations. When site soil is properly prepared a maximum allowable bearing pressure of 2,500 psf may be used for design. Expansive soils should not be used beneath slabs-on-grade as the potential for swell can lead to slab movement and heaving and cracking of slabs.

Floor Slabs

Floor slabs should be supported on 12-inches of structural fill to control slab movement due to potential moisture changes in the supporting soil. Structural fill material for support of the floor slab should be placed in 6-inch loose lifts near optimum moisture content and compacted to 95 percent of Standard Proctor maximum dry density (ASTM D698). To provide uniform support and to aid controlling moisture consideration may be given to installing 4-inches of free-draining gravel beneath concrete slabs. Depending upon interior floor finish, the use of a vapor retarding barrier over the gravel may be considered. Floor slabs should be separated from all bearing walls, columns, mechanical equipment and piping with an expansion joint that allows unrestrained vertical movement. Contraction joints should be placed in the slab in accordance with American Concrete Institute (ACI) guidelines.

Structural Fill - General

Areas to receive structural fill should have topsoil, organic material, or debris removed. The upper 6 inches of the exposed surface soils should be scarified and moisture conditioned to facilitate compaction (usually within 2 percent of the optimum moisture content) and compacted to a minimum of 95 percent of the maximum dry density as determined by the Modified Proctor test (ASTM D-1557) prior to placing structural fill.

Structural fill shall consist of granular, non-expansive material. It should be placed in loose lifts not exceeding 10-inches, moisture conditioned to facilitate compaction (usually within 2 percent of the optimum moisture content) and compacted to a minimum of 95 percent of the maximum dry density as determined by the Modified Proctor test, ASTM D-1557. The materials should be compacted by mechanical means.

Structural fill placed on slopes should be benched into the slope. Maximum bench heights should not exceed 4 feet, and bench widths should be wide enough to accommodate compaction equipment.

Structural fill should not be placed on frozen subgrade or allowed to freeze during moisture conditioning and placement. The on-site clay soils are not recommended for use as structural fill below foundation components.

Foundations Drains

A subsurface perimeter drain is recommended around portions of the structure which will have habitable or storage space located below the finished ground surface. This includes crawlspace areas but not walkout trenches, if applicable. Groundwater encountered during the subsurface investigation was intermittent in the borings and showed at 14 to 29 feet below existing ground surface where present. Depending on the conditions encountered during the lot specific Subsurface Soils Investigation and the conditions observed at the time of the Open Excavation Observation, additional subsurface drainage systems may be recommended.

One such system is an underslab drainage layer to help intercept groundwater before it enters the slab area should the groundwater levels rise. In general, if groundwater was encountered within 4 to 6 feet of the proposed basement slab elevation, an underslab drain should be anticipated. Another such system would consist of a subsurface drain and/or vertical drain board placed around the perimeter of the overexcavation to help intercept groundwater and allow for proper placement and compaction of the replacement structural fill. Careful attention should be paid to grade and discharge of the drain pipes of these systems.

Drain systems are designed to intercept some types of subsurface moisture and not others. Therefore, the drains could operate properly and not mitigate all moisture problems relating to foundation performance or moisture intrusion into the basement area.

Surface Grading and Drainage

The ground surface should be sloped from the building with a minimum gradient of 10 percent for the first 10 feet. This is equivalent to 12 inches of fall across this 10-foot zone. If a 10-foot zone is not possible on the upslope side of the structure, then a well-defined swale should be created a minimum 5 feet from the foundation and sloped parallel with the wall with a minimum slope of 2 percent to intercept the surface water and transport it around and away from the structure. Roof drains should extend across backfill zones and landscaped areas to a region that is graded to direct flow away from the structure. Owners should maintain the surface grading and drainage recommended in this report to help prevent water from being directed toward and/or ponding near the foundations.

Landscaping should be selected to reduce irrigation requirements. Plants used close to foundation walls should be limited to those with low moisture requirements and irrigated grass should not be located within 5 feet of the foundation. To help control weed growth, geotextiles should be used below landscaped areas adjacent to foundations. Impervious plastic membranes are not recommended.

Irrigation devices should not be placed within 5 feet of the foundation. Irrigation should be limited to the amount sufficient to maintain vegetation. Application of more water will increase the likelihood of slab and foundation movements.

The recommendations listed in this report are intended to address normal surface drainage conditions, assuming the presence of groundcover (established vegetation, paved surfaces, and/or structures)

throughout the regions upslope from this structure. However, groundcover may not be present due to a variety of factors (ongoing construction/development, wildfires, etc.). During periods when groundcover is not present in the "upslope" regions, higher than normal surface drainage conditions may occur, resulting in perched water tables, excess runoff, flash floods, etc. In these cases, the surface drainage recommendations presented herein (even if properly maintained) may not mitigate all groundwater problems or moisture intrusion into the structure. We recommend that the site plan be prepared with consideration of increased runoff during periods when groundcover is not present on the upslope areas.

Concrete

Type I/II cement is recommended for concrete in contact with the subsurface materials. Calcium chloride should be used with caution for soils with high sulfate contents. The concrete should not be placed on frozen ground. If placed during periods of cold temperatures, the concrete should be kept from freezing. This may require covering the concrete with insulated blankets and heating. Concrete work should be completed in accordance with the latest applicable guidelines and standards published by ACI.

Exterior Backfill

Backfill should be placed in loose lifts not exceeding 8 to 12 inches, moisture conditioned to facilitate compaction (usually within 2 percent of the optimum moisture content) and compacted to 85 percent of the maximum dry density as determined by the Modified Proctor test, ASTM D-1557 on exterior sides of walls in landscaped areas. In areas where backfill supports pavement and concrete flatwork, the materials should be compacted to 95 percent of the maximum dry density.

Fill placed on slopes should be benched into the slope. Maximum bench heights should not exceed 4 feet, and bench widths should be wide enough to accommodate compaction equipment. The backfill should not be placed on frozen subgrade or allowed to freeze during moisture conditioning and placement. Backfill should be compacted by mechanical means, and foundation walls should be braced during backfilling and compaction.

BURIED UTILITIES

Based upon the conditions encountered in the exploratory test borings, we anticipate that the soils encountered in the individual utility trench excavations will consist of native silty to clayey sand sandy lean clay, silty sandstone and sandy claystone. It is anticipated that the sand and sandstone will be encountered at loose to hard relative densities and the clays and claystone at stiff to hard consistencies.

We believe the sand and sandstone will classify as Type C materials and the clay and claystone will classify as Type B materials as defined by OSHA in 29 CFR Part 1926. OSHA requires that temporary excavations made in Type B and C materials be laid back at ratios no steeper than 1:1 (horizontal to vertical) and 1½:1 (horizontal to vertical), respectively, unless the excavation is shored and braced. Excavations deeper than 20 feet, or when water is present, should always be braced or the slope designed by a professional engineer.

Utility mains such as water and sanitary sewer lines are typically placed beneath paved roadways. The settlement of the utility trench backfill can have a detrimental effect on pavements and roadway

surfaces. We recommend that utility trench backfill be placed in thin loose lifts, moisture conditioned as required and compacted to the recommendations outlined in the **Structural Fill** section of this report. The placement and compaction of utility trench backfill should be observed and tested by a representative of RMG Engineers during construction. Use of “flowable fill,” (i.e., a controlled low strength material (CLSM), or a similar material) should be considered in lieu of compacted soil backfill for areas with low tolerances for surface settlements in deep excavations and areas with difficult access.

It is a common local practice for underdrains to be placed at the bottom of sanitary sewer trenched within drive lanes. Underdrains placed in the sanitary sewer trenches in areas where groundwater is anticipated will likely be the "active" type, which uses a perforated drain pipe. In areas where groundwater is not anticipated, “passive” type underdrains may be used. The outfall for the sanitary sewer trench underdrain was not known at the time of this investigation because the development plan and grading plan were not available for our review.

PRELIMINARY PAVEMENT RECOMMENDATIONS

Roadway plans had not been provided at the time of the report issue date. However, roadways throughout the proposed development are anticipated to be classified mainly as Local in accordance with the Colorado Springs Engineering Criteria Manual. The actual pavement section design for individual streets will be completed following overlot grading and installation of utilities. A site specific pavement design should be conducted to determine the design pavement sections for the proposed roadways.

ADDITIONAL STUDIES

The findings, conclusions and recommendations presented in this report were provided to evaluate the suitability of the site for future development. Unless indicated otherwise, the test borings, laboratory test results, conclusions and recommendations presented in this report are not intended for use for design and construction. **We recommend that a site specific Subsurface Soil Investigation be performed for all proposed structures including (but not limited to) residences, community or common buildings, retaining walls and pumphouses, commercial buildings, etc.**

To develop recommendations for construction of the proposed roadways, a pavement design investigation should be performed. This investigation should consist of additional test borings, soil laboratory testing and specific recommendations for the design and construction of roadway pavement sections.

CLOSING

This report has been prepared for the exclusive purpose of providing geotechnical engineering information and recommendations for development described in this report. RMG should be retained to review the final construction documents prior to construction to verify our findings, conclusions and recommendations have been appropriately implemented.

This report has been prepared for the exclusive use by **Challenger Colorado, LLC** for application as an aid in the design and construction of the proposed development in accordance with generally accepted geotechnical engineering practices. The analyses and recommendations in this report are based in part

upon data obtained from test borings, site observations and the information presented in referenced reports. The nature and extent of variations may not become evident until construction. If variations then become evident, RMG should be retained to review the recommendations presented in this report considering the varied condition, and either verify or modify them in writing.

Our professional services were performed using that degree of care and skill ordinarily exercised, under similar circumstances, by geotechnical engineers practicing in this or similar localities. RMG does not warrant the work of regulatory agencies or other third parties supplying information which may have been used during the preparation of this report. No warranty, express or implied is made by the preparation of this report. Third parties reviewing this report should draw their own conclusions regarding site conditions and specific construction techniques to be used on this project.

The scope of services for this project does not include, either specifically or by implication, environmental assessment of the site or identification of contaminated or hazardous materials or conditions. Development of recommendations for the mitigation of environmentally related conditions, including but not limited to biological or toxicological issues, are beyond the scope of this report. If the Client desires investigation into the potential for such contamination or conditions, other studies should be undertaken.

If we can be of further assistance in discussing the contents of this report or analysis of the proposed development, from a geotechnical engineering point-of-view, please feel free to contact us.

FIGURES



REFERENCE
NOT TO SCALE



ROCKY MOUNTAIN GROUP

Southern Office
Colorado Springs, CO
80918
(719) 548-0600
Central Office:
Englewood, CO 80112
(303) 688-9475
Northern Office:
Greeley / Evans, CO 80620
(970) 330-1071

SITE VICINITY MAP

PRELIMINARY SUBSURFACE SOILS
INVESTIGATION
BENT GRASS, FILING NO. 2
EL PASO COUNTY, CO
CHALLENGER COLORADO, LLC

JOB No. 169845

FIG No. 1

DATE 5-14-2019



ROCKY MOUNTAIN GROUP

Southern Office
 Colorado Springs, CO
 80918
 (719) 548-0600


Central Office:
 Englewood, CO 80112
 (303) 688-9475

Northern Office:
 Greeley / Evans, CO 80620
 (970) 330-1071

Woodland Park Office:
 (719) 687-6077

Monument Office:
 (719) 488-2145

Pueblo / Canon City:
 (719) 544-7750

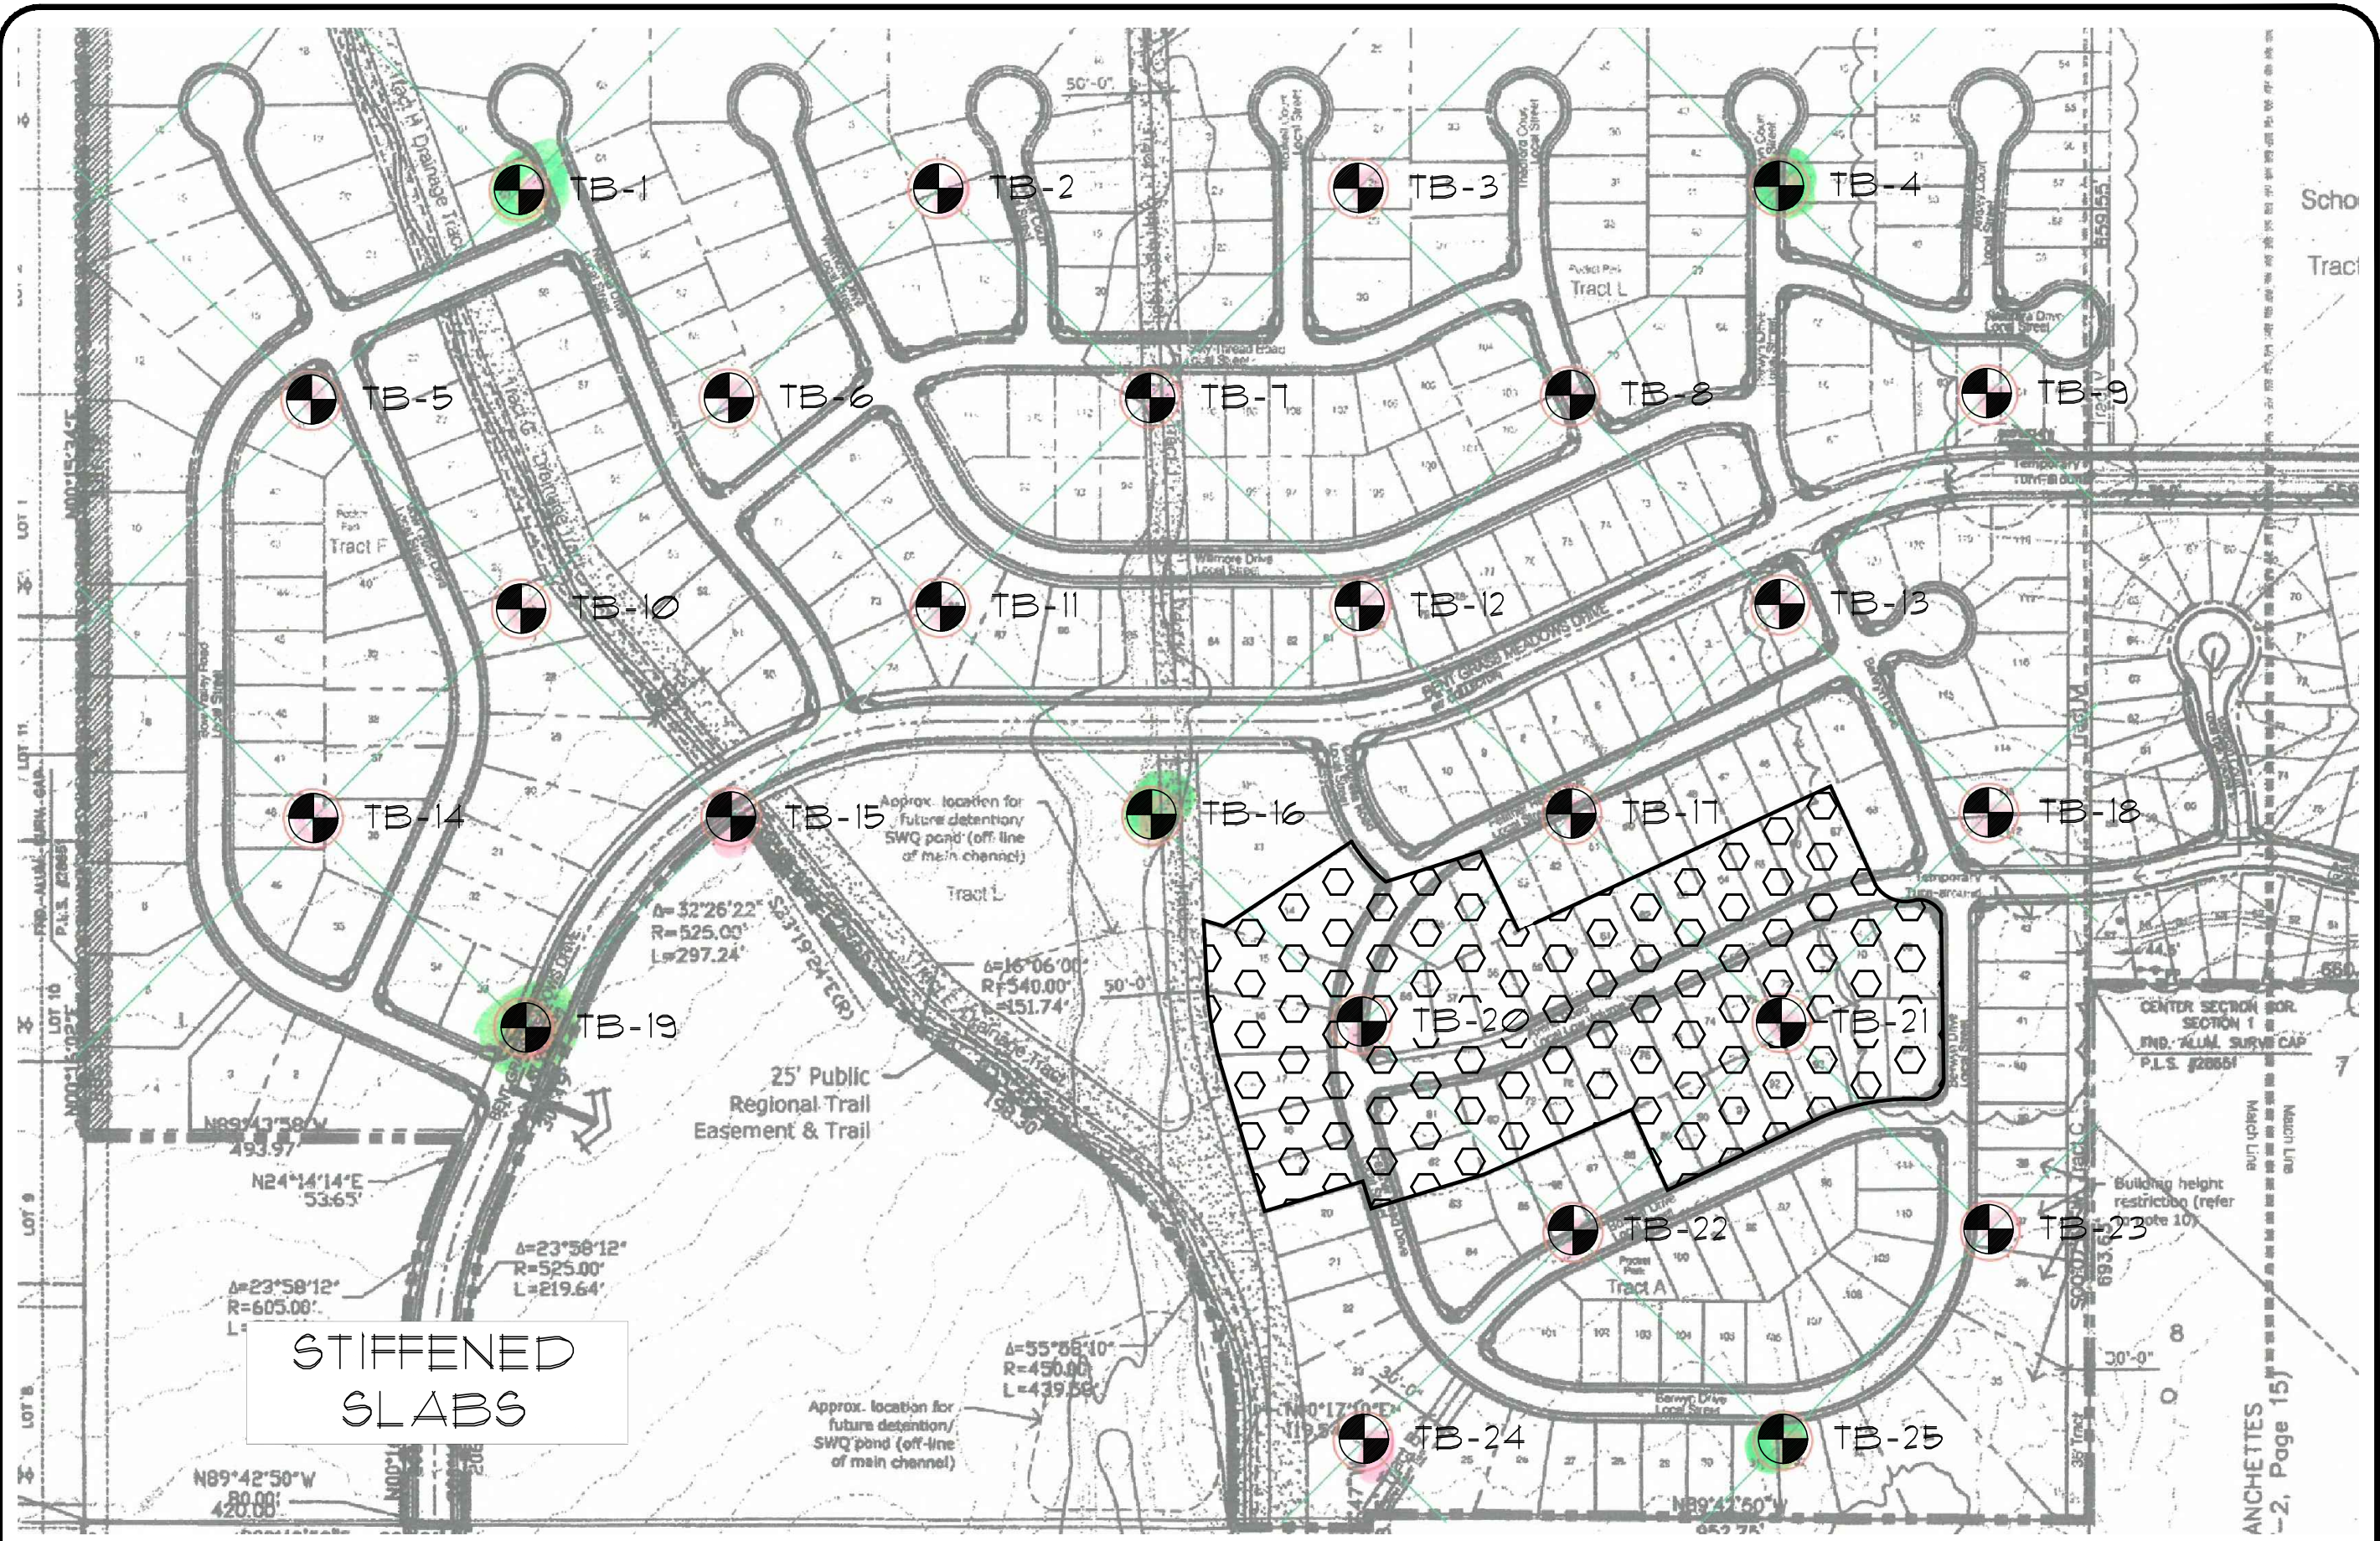

PRELIMINARY SUBSURFACE SOILS INVESTIGATION
 THE MEADOWS, FILING NO. 3
 EL PASO COUNTY, CO
 CHALLENGER COLORADO, LLC

ENGINEER:	GW
DRAWN BY:	BG
CHECKED BY:	GW
ISSUED:	5-14-19
REVISION:	8-6-19 169845

ANTICIPATED OVEREXCAVATION AREAS - STIFFENED SLABS



BASEMENTS

131 LOTS IMPACTED

AREAS WHERE IT IS ANTICIPATED THAT OVEREXCAVATION WILL BE REQUIRED FOR COHESIVE SOILS WITHIN 3 FEET OF BASEMENT FOUNDATION COMPONENTS

⊗ DENOTES APPROXIMATE LOCATION OF TEST BORINGS

NOT TO SCALE

JOB No. 169845

ARCHITECTS
RMG
ENGINEERS

ROCKY MOUNTAIN GROUP

Southern Office
Colorado Springs, CO
80918
(719) 548-0600

Central Office
Englewood, CO 80112
(303) 688-9475

Northern Office
Greeley / Evans, CO 80620
(970) 330-1071

Woodland Park Office
(719) 687-6077

Monument Office
(719) 488-2145

Pueblo / Canon City
(719) 544-7750

PRELIMINARY SUBSURFACE SOILS INVESTIGATION







THE MEADOWS, FILING NO. 3
EL PASO COUNTY, CO
CHALLENGER COLORADO, LLC

ENGINEER:	GW
DRAWN BY:	BG
CHECKED BY:	GW
ISSUED:	5-14-19
REVISION:	8-6-19 169845

ANTICIPATED OVEREXCAVATION AREA - BASEMENTS







SHEET No.
FIG-2-2

SOILS DESCRIPTION

-  CLAYEY SAND
-  CLAYSTONE
-  SANDSTONE
-  SANDY CLAY
-  SILTY SAND
-  SILTY TO CLAYEY SAND

UNLESS NOTED OTHERWISE, ALL LABORATORY TESTS PRESENTED HEREIN WERE PERFORMED BY:
 RMG - ROCKY MOUNTAIN GROUP
 2910 AUSTIN BLUFFS PARKWAY
 COLORADO SPRINGS, COLORADO

SYMBOLS AND NOTES

-  XX STANDARD PENETRATION TEST - MADE BY DRIVING A SPLIT-BARREL SAMPLER INTO THE SOIL BY DROPPING A 140 LB. HAMMER 30", IN GENERAL ACCORDANCE WITH ASTM D-1586. NUMBER INDICATES NUMBER OF HAMMER BLOWS PER FOOT (UNLESS OTHERWISE INDICATED).
-  XX UNDISTURBED CALIFORNIA SAMPLE - MADE BY DRIVING A RING-LINED SAMPLER INTO THE SOIL BY DROPPING A 140 LB. HAMMER 30", IN GENERAL ACCORDANCE WITH ASTM D-3550. NUMBER INDICATES NUMBER OF HAMMER BLOWS PER FOOT (UNLESS OTHERWISE INDICATED).
-  FREE WATER TABLE
-  DEPTH AT WHICH BORING CAVED
-  BULK DISTURBED BULK SAMPLE
-  AUG AUGER "CUTTINGS"
- 4.5 WATER CONTENT (%)

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs: (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

EXPLANATION OF TEST BORING LOGS

JOB No. 169845

FIGURE No. 3

DATE 5/14/19

TEST BORING: 1 DATE DRILLED: 4/5/19 ELEVATION (FT): GROUNDWATER @ 27.0' 4/5/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %	TEST BORING: 2 DATE DRILLED: 4/5/19 ELEVATION (FT): NO GROUNDWATER ON 4/5/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %
SAND, SILTY, with gravel, light brown to olive, medium dense to dense, moist	5			18	1.9	SAND, SILTY, light brown, medium dense, moist	5			10	1.4
SANDSTONE, CLAYEY, light gray to olive with rust staining, hard to very hard, moist	10			34	10.0	CLAY, SANDY, brown to olive, very stiff, moist	10			22	18.4
	15			50/9"	16.6	CLAYSTONE, SANDY, brown, very hard, moist	15			50/5"	12.5
	20			50/6"	15.1	SANDSTONE, CLAYEY, olive, very hard, moist	20			50/6"	10.8
				50/4"	23.1						

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs - (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

TEST BORING LOG

JOB No. 169845

FIGURE No. 4

DATE 5/14/19

TEST BORING: 3 DATE DRILLED: 4/18/19 ELEVATION (FT): NO GROUNDWATER ON 4/18/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %	TEST BORING: 4 DATE DRILLED: 4/18/19 ELEVATION (FT): NO GROUNDWATER ON 4/18/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %
SAND, SILTY, light brown, moist						SAND, SILTY, tan, medium dense, moist					
SANDSTONE, SILTY, light brown and brown to olive, medium hard to hard, moist	5		■	41	2.5		5		■	18	1.5
CLAYSTONE, SANDY, brown to gray and olive, moist	10		■	50	12.5	SANDSTONE, SILTY, brown to olive, medium hard, moist	10		▲	50/10"	9.7
SANDSTONE, SILTY, brown to olive, very hard, moist	15		■	50/4"	9.6	CLAYSTONE, SANDY, gray, medium hard, moist	15		▲	50/9"	15.3
	20		■								

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs - (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

TEST BORING LOG

JOB No. 169845

FIGURE No. 5

DATE 5/14/19

TEST BORING: 5 DATE DRILLED: 4/15/19 ELEVATION (FT): GROUNDWATER @ 14.0' 4/15/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %	TEST BORING: 6 DATE DRILLED: 4/15/19 ELEVATION (FT): NO GROUNDWATER ON 4/15/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %
SAND, SILTY, with gravel, tan and brown to olive, medium dense, moist to wet	5		11	2.1	2.1	SAND, CLAYEY, with gravel, light brown, medium dense, moist	5		23	5.0	5.0
SANDSTONE, CLAYEY, light brown to olive, hard, moist to wet	10		14	3.8	3.8	SANDSTONE, SILTY TO CLAYEY, olive, hard, moist	10		50/6"	11.8	11.8
	15		17	15.1	15.1	CLAYSTONE, SANDY, olive, moist	15		50/5"	12.1	12.1
	20		50/10"	14.3	14.3	SANDSTONE, SILTY TO CLAYEY, gray to light brown, very hard, moist	20		50/4"	7.5	7.5

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs - (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

TEST BORING LOG

JOB No. 169845

FIGURE No. 6

DATE 5/14/19

TEST BORING: 7 DATE DRILLED: 4/5/19 ELEVATION (FT): NO GROUNDWATER ON 4/5/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %	TEST BORING: 8 DATE DRILLED: 4/18/19 ELEVATION (FT): NO GROUNDWATER ON 4/18/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %
SAND, CLAYEY, dark gray, loose, moist	5			12	17.5	SAND, SILTY, tan, medium dense, moist	5			26	12.6
SANDSTONE, SILTY, light brown, medium hard to very hard, moist	10			50/8"	8.2	SANDSTONE, CLAYEY, brown to olive, firm, moist	10			50/7"	15.4
	15			50/8"	12.2	CLAYSTONE, SANDY, brown to olive, medium hard, moist	15			50/8"	17.0
	20			50/6"	10.1	SANDSTONE, SILTY, brown with rust staining, medium hard, moist					

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs - (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

TEST BORING LOG

JOB No. 169845

FIGURE No. 7

DATE 5/14/19

TEST BORING: 9 DATE DRILLED: 4/18/19 ELEVATION (FT): NO GROUNDWATER ON 4/18/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %	TEST BORING: 10 DATE DRILLED: 4/5/19 ELEVATION (FT): NO GROUNDWATER ON 4/5/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %
SAND, SILTY, tan, loose, moist	5			9	13.8	SAND, SILTY, with gravel, light brown and brown to olive, medium dense, moist to wet	5			11	7.3
SANDSTONE, SILTY, tan and brown to gray, firm to very hard, moist	10			27	7.9		10			14	10.4
	15			50/5"	7.4		15			11	16.3
	20			50/5"	6.3	SANDSTONE, CLAYEY, olive, very hard, moist to wet	20			50/7"	15.0

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs - (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

TEST BORING LOG

JOB No. 169845

FIGURE No. 8

DATE 5/14/19

TEST BORING: 11 DATE DRILLED: 4/5/19 ELEVATION (FT): NO GROUNDWATER ON 4/5/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %	TEST BORING: 12 DATE DRILLED: 4/18/19 ELEVATION (FT): NO GROUNDWATER ON 4/18/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %
SAND, SILTY TO CLAYEY, tan to olive, loose, moist	5			13	19.6	SAND, SILTY, tan, medium dense, moist	5			15	2.5
SANDSTONE, CLAYEY, brown to olive with rust staining, medium hard, moist	10			50/7"	16.5	SANDSTONE, SILTY TO CLAYEY, brown to gray, hard to very hard, moist	10			50/11"	9.0
CLAYSTONE, SANDY, brown to gray and olive with rust staining, medium hard, moist	15			50/7"	14.1		15				
SANDSTONE, CLAYEY, gray, very hard, moist	20			50/6"	9.1		20			50/4"	-

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs - (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

TEST BORING LOG

JOB No. 169845

FIGURE No. 9

DATE 5/14/19

TEST BORING: 13 DATE DRILLED: 4/18/19 ELEVATION (FT): NO GROUNDWATER ON 4/18/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %	TEST BORING: 14 DATE DRILLED: 4/18/19 ELEVATION (FT): GROUNDWATER @ 14.0' 4/18/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %
SAND, SILTY, tan, moist						SAND, SILTY, light brown to brown, loose to medium dense, moist					
SANDSTONE, SILTY, light brown and brown to gray with rust staining, medium hard to very hard, moist	5		■	41	9.3		5		■	6	8.9
	10		▲	34	10.3		10		■	17	9.3
	15		▲	50/9"	10.0	CLAY, SANDY, olive, very stiff, moist to wet	15	▽	■	21	21.7
	20		■	50/7"	8.8	SANDSTONE, SILTY, light brown to light gray, very hard, moist to wet	20		▲	50/4"	9.6

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs - (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

TEST BORING LOG

JOB No. 169845

FIGURE No. 10

DATE 5/14/19

TEST BORING: 15 DATE DRILLED: 4/18/19 ELEVATION (FT): NO GROUNDWATER ON 4/18/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %	TEST BORING: 16 DATE DRILLED: 4/15/19 ELEVATION (FT): GROUNDWATER @ 28.0' 4/15/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %
SAND, SILTY, with gravel, light brown, loose, moist	5			13	3.4	SANDSTONE, CLAYEY, brown to olive with rust staining, hard, moist	5			50/8"	15.0
CLAYSTONE, SANDY, gray to olive, firm to very hard, moist	10			42	12.3	CLAYSTONE, SANDY, brown, hard, moist	10			50/6"	10.1
SANDSTONE, SILTY, light brown to gray, very hard, moist	15			50/4"	10.1	SANDSTONE, CLAYEY, light brown to gray and olive, hard to very hard, moist to wet	15			50/6"	16.5
	20			50/5"	11.0		20			50/6"	11.8
							25				
							30			50/4"	16.5

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs - (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

TEST BORING LOG

JOB No. 169845

FIGURE No. 11

DATE 5/14/19

TEST BORING: 17 DATE DRILLED: 4/18/19 ELEVATION (FT): NO GROUNDWATER ON 4/18/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %	TEST BORING: 18 DATE DRILLED: 4/18/19 ELEVATION (FT): NO GROUNDWATER ON 4/18/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %
SAND, SILTY, tan to brown, medium dense, moist	5			24	5.0	SAND, SILTY, tan, medium dense, moist	5			30	2.9
SANDSTONE, SILTY TO CLAYEY, gray to olive, medium hard, moist	10			50/8"	10.0	SANDSTONE, SILTY, brown to olive, firm to hard, moist	10			13/6"	8.4
	15					SANDSTONE, CLAYEY, light brown, hard, moist	15			50/6"	18.3
							20			50/9"	9.6

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs - (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

TEST BORING LOG

JOB No. 169845

FIGURE No. 12

DATE 5/14/19

TEST BORING: 19 DATE DRILLED: 4/18/19 ELEVATION (FT): GROUNDWATER @ 14.0' 4/18/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %	TEST BORING: 20 DATE DRILLED: 4/18/19 ELEVATION (FT): NO GROUNDWATER ON 4/18/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %
SAND, SILTY, with gravel, tan, medium dense, moist	5			25	3.3	CLAYSTONE, SANDY, olive, medium hard, moist	5			50/11"	14.6
SANDSTONE, CLAYEY, light brown to olive, medium hard, moist to wet	10			25	4.6	SANDSTONE, CLAYEY, light brown to olive, medium hard to very hard, moist	10			50/8"	15.5
SANDSTONE, CLAYEY, light brown to olive, medium hard, moist to wet	15			50/11"	10.6		15			50/5"	8.3
CLAYSTONE, SANDY, gray to olive, medium hard, moist to wet	20			35	15.7		20			50/6"	10.0
SANDSTONE, CLAYEY, light brown to olive, hard, moist to wet	25			50/6"	15.2						

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs - (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

TEST BORING LOG

JOB No. 169845

FIGURE No. 13

DATE 5/14/19

TEST BORING: 21 DATE DRILLED: 4/18/19 ELEVATION (FT): NO GROUNDWATER ON 4/18/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %	TEST BORING: 22 DATE DRILLED: 4/18/19 ELEVATION (FT): NO GROUNDWATER ON 4/18/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %
SAND, CLAYEY, with gravel, brown to olive, medium dense, moist	5			28	7.4	SANDSTONE, SILTY TO CLAYEY, light brown to light gray, hard to very hard, moist	5			50/9"	6.3
CLAYSTONE, SANDY, brown to olive, medium hard to hard, moist	10			50/11"	17.1		10			50/4"	7.7
	15			50/6"	12.1		15			50/4"	9.2

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs - (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

TEST BORING LOG

JOB No. 169845

FIGURE No. 14

DATE 5/14/19

TEST BORING: 23 DATE DRILLED: 4/18/19 ELEVATION (FT): GROUNDWATER @ 19.0' 4/18/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %	TEST BORING: 24 DATE DRILLED: 4/18/19 ELEVATION (FT): NO GROUNDWATER ON 4/18/19	DEPTH (FT)	SYMBOL	SAMPLES	BLOWS PER FT.	WATER CONTENT %
SAND, CLAYEY, light brown, medium dense, moist	5			10	12.6	SAND, SILTY, with gravel, tan, medium dense, moist	5			21	2.2
SANDSTONE, SILTY TO CLAYEY, with gravel, light brown to light gray and gray, hard to very hard, moist to wet	10			50/6"	6.0	SANDSTONE, SILTY, light brown, medium hard to hard, moist	10			46	8.0
	15			50/5"	7.8		15			50/6"	11.1
	20			50/3"	14.0						

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs - (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

TEST BORING LOG

JOB No. 169845

FIGURE No. 15

DATE 5/14/19

Test Boring No.	Depth	Water Content (%)	Dry Density (pcf)	Liquid Limit	Plasticity Index	% Retained No.4 Sieve	% Passing No. 200 Sieve	FHA Expansion Pressure (psf)	% Swell/Collapse	USCS Classification
1	4.0	1.9								
1	9.0	10.0		NP	NP	4.1	25.0			SM
1	14.0	16.6								
1	19.0	15.1								
1	29.0	23.1								
2	4.0	1.4								
2	9.0	18.4								
2	14.0	12.5		33	19	0.7	52.6			CL
2	19.0	10.8								
3	4.0	2.5								
3	9.0	12.5		NP	NP	0.3	36.4			SM
3	19.0	9.6								
4	4.0	1.5								
4	9.0	9.7		NP	NP	3.9	13.8			SM
4	14.0	15.3								
5	4.0	2.1								
5	9.0	3.8		NP	NP	9.0	6.2			SW-SM
5	14.0	15.1								
5	19.0	14.3								
6	4.0	5.0								
6	9.0	11.8	107.8	35	21	0.2	48.7		- 0.4	SC
6	14.0	12.1								
6	19.0	7.5								
7	4.0	17.5	100.5	51	36	3.9	48.8		1.3	SC
7	9.0	8.2								
7	14.0	12.2								
7	19.0	10.1								
8	4.0	12.6								
8	9.0	15.4	112.1	36	18	1.1	54.3		0.6	CL
8	14.0	17.0								
9	4.0	13.8								
9	9.0	7.9		NP	NP	13.5	9.2			SW-SM
9	14.0	7.4								
9	19.0	6.3								

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs, (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Spings, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

SUMMARY OF LABORATORY TEST RESULTS

JOB No. 169845
FIGURE No. 17
PAGE 1 OF 3
DATE 5/14/19

Test Boring No.	Depth	Water Content (%)	Dry Density (pcf)	Liquid Limit	Plasticity Index	% Retained No.4 Sieve	% Passing No. 200 Sieve	FHA Expansion Pressure (psf)	% Swell/Collapse	USCS Classification
10	4.0	7.3								
10	9.0	10.4		NP	NP	5.7	18.4			SM
10	14.0	16.3								
10	19.0	15.0								
11	4.0	19.6								
11	9.0	16.5	109.2	39	20	0.4	48.2		0.3	SC
11	14.0	14.1								
11	19.0	9.1								
12	4.0	2.5								
12	9.0	9.0								
12	14.0	9.0								
13	4.0	9.3								
13	9.0	10.3		NP	NP	15.9	10.0			SW-SM
13	14.0	10.0								
13	19.0	8.8								
14	4.0	8.9								
14	9.0	9.3		NP	NP	6.0	15.7			SM
14	14.0	21.7								
14	19.0	9.6								
15	4.0	3.4								
15	9.0	12.3	124.0	25	14	0.2	47.7		- 0.6	SC
15	14.0	10.1								
15	19.0	11.0								
16	4.0	15.0								
16	9.0	10.1	107.3	29	17	0.4	53.2		- 1.3	CL
16	14.0	16.5	96.9	37	17	0.0	39.7		- 1.3	SC
16	19.0	11.8								
16	29.0	16.5								
17	4.0	5.0		NP	NP	18.8	10.0			SP-SM
17	9.0	10.0								
17	19.0	10.4								
18	4.0	2.9								
18	9.0	8.4								
18	14.0	18.3	102.6	43	16	4.0	49.0		- 1.1	SM

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs: (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

SUMMARY OF LABORATORY TEST RESULTS

JOB No. 169845
FIGURE No. 17
PAGE 2 OF 3
DATE 5/14/19

Test Boring No.	Depth	Water Content (%)	Dry Density (pcf)	Liquid Limit	Plasticity Index	% Retained No.4 Sieve	% Passing No. 200 Sieve	FHA Expansion Pressure (psf)	% Swell/Collapse	USCS Classification
18	19.0	9.6								
19	4.0	3.3		NP	NP	10.3	6.6			SW-SM
19	9.0	4.6								
19	14.0	10.6								
19	19.0	15.7								
19	24.0	15.2								
20	4.0	14.6	117.0	39	22	1.9	56.3		0.3	CL
20	9.0	15.5								
20	14.0	8.3								
20	19.0	10.0								
21	4.0	7.4								
21	9.0	17.1	106.8	38	22	0.0	73.1		- 0.6	CL
21	14.0	12.1								
22	4.0	6.3								
22	9.0	7.7								
22	14.0	9.2								
23	4.0	12.6		25	12	6.6	12.7			SC
23	9.0	6.0								
23	14.0	7.8								
23	19.0	14.0								
24	4.0	2.2		NP	NP	9.0	5.2			SP-SM
24	9.0	8.0								
24	14.0	11.1								
25	4.0	6.7								
25	9.0	6.4		NP	NP	5.6	10.3			SW-SM
25	14.0	9.7								
25	19.0	12.7								
25	29.0	15.7				0.0	58.4			CL

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics




Geotechnical
Materials Testing
Civil, Planning

Colorado Springs, (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

SUMMARY OF LABORATORY TEST RESULTS

JOB No. 169845
FIGURE No. 17
PAGE 3 OF 3
DATE 5/14/19

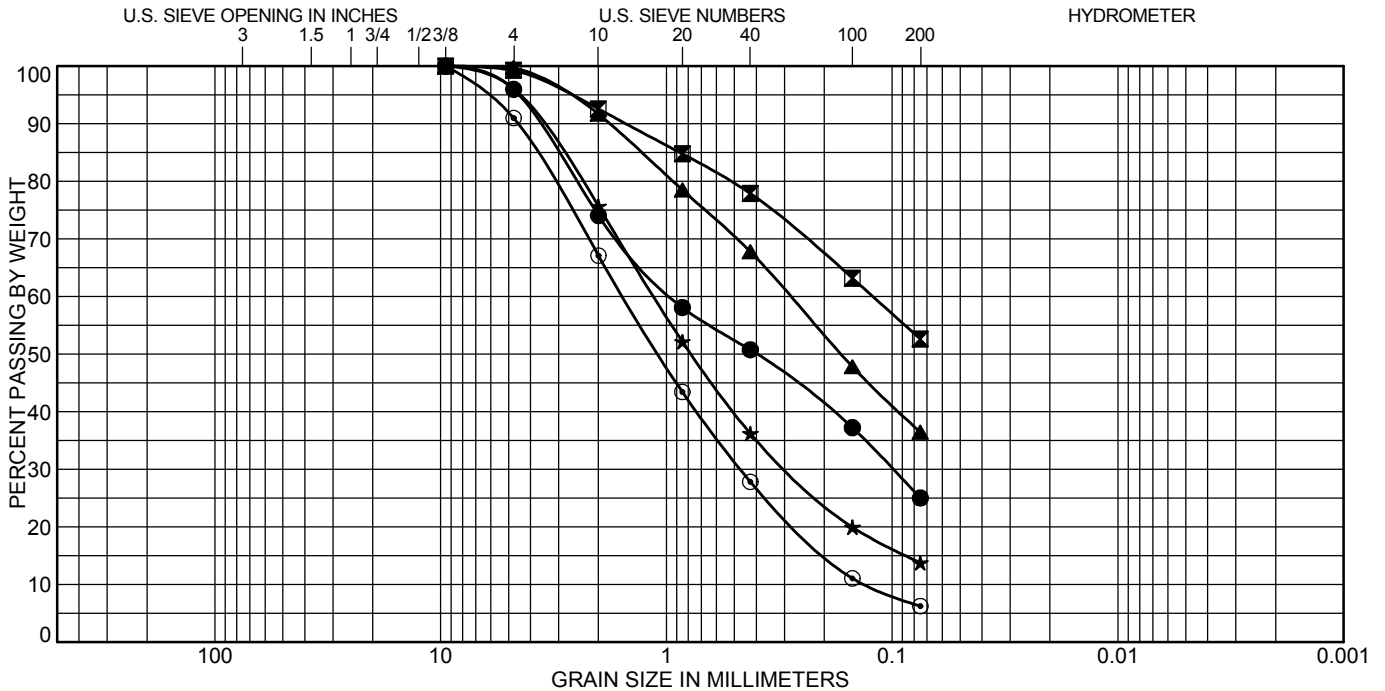

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Test Boring	Depth (ft)	Classification	LL	PL	PI
● 1	9.0	SILTY SAND(SM)	NP	NP	NP
☒ 2	14.0	SANDY LEAN CLAY(CL)	33	14	19
▲ 3	9.0	SILTY SAND(SM)	NP	NP	NP
★ 4	9.0	SILTY SAND(SM)	NP	NP	NP
⊙ 5	9.0	WELL-GRADED SAND with SILT(SW-SM)	NP	NP	NP

Test Boring	Depth (ft)	%Gravel	%Sand	%Silt	%Clay
● 1	9.0	4.1	70.9	25.0	
☒ 2	14.0	0.7	46.7	52.6	
▲ 3	9.0	0.3	63.3	36.4	
★ 4	9.0	3.9	82.3	13.8	
⊙ 5	9.0	9.0	84.7	6.2	

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs: (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600


SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

SOIL CLASSIFICATION DATA

JOB No. 169845

FIGURE No. 18

DATE 5/14/19

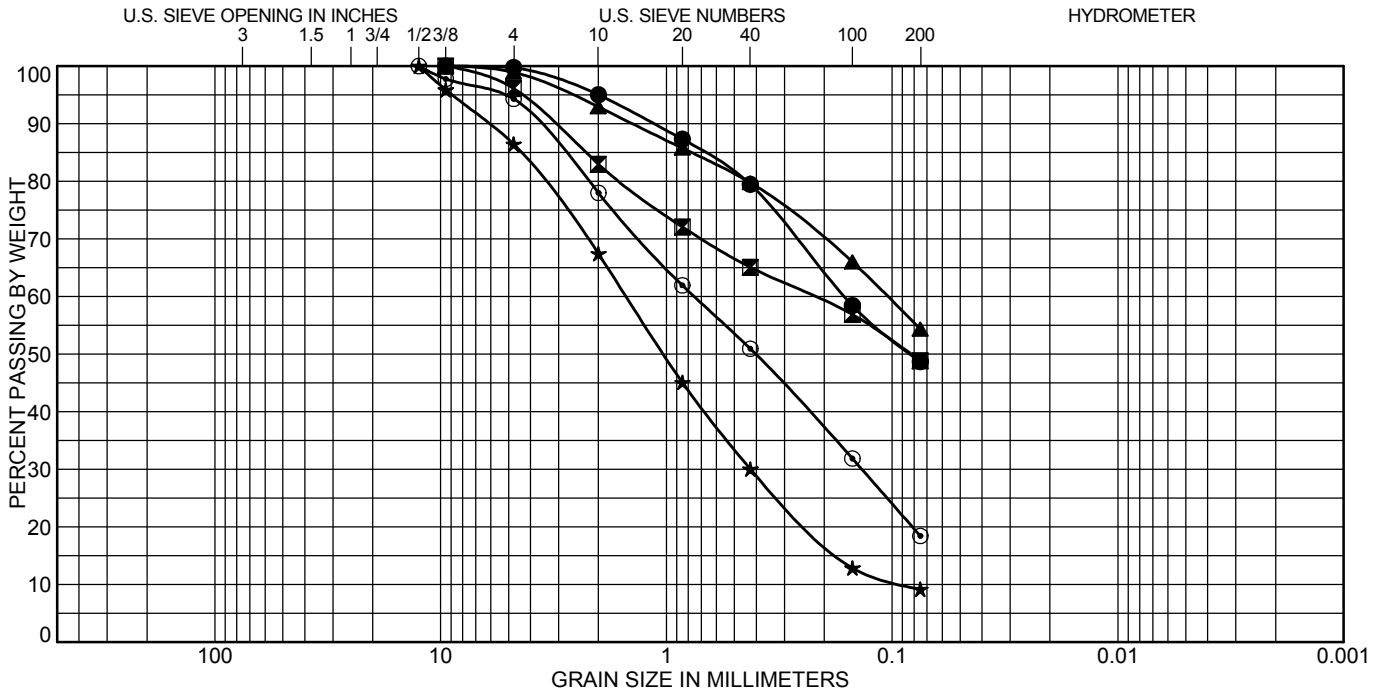

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Test Boring	Depth (ft)	Classification	LL	PL	PI
● 6	9.0	CLAYEY SAND(SC)	35	14	21
☒ 7	4.0	CLAYEY SAND(SC)	51	15	36
▲ 8	9.0	SANDY LEAN CLAY(CL)	36	18	18
★ 9	9.0	WELL-GRADED SAND with SILT(SW-SM)	NP	NP	NP
⊙ 10	9.0	SILTY SAND(SM)	NP	NP	NP

Test Boring	Depth (ft)	%Gravel	%Sand	%Silt	%Clay
● 6	9.0	0.2	51.1	48.7	
☒ 7	4.0	3.9	47.3	48.8	
▲ 8	9.0	1.1	44.6	54.3	
★ 9	9.0	13.5	77.3	9.2	
⊙ 10	9.0	5.7	75.9	18.4	

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Colorado Springs (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO


Geotechnical
Materials Testing
Civil, Planning

SOIL CLASSIFICATION DATA

JOB No. 169845

FIGURE No. 19

DATE 5/14/19

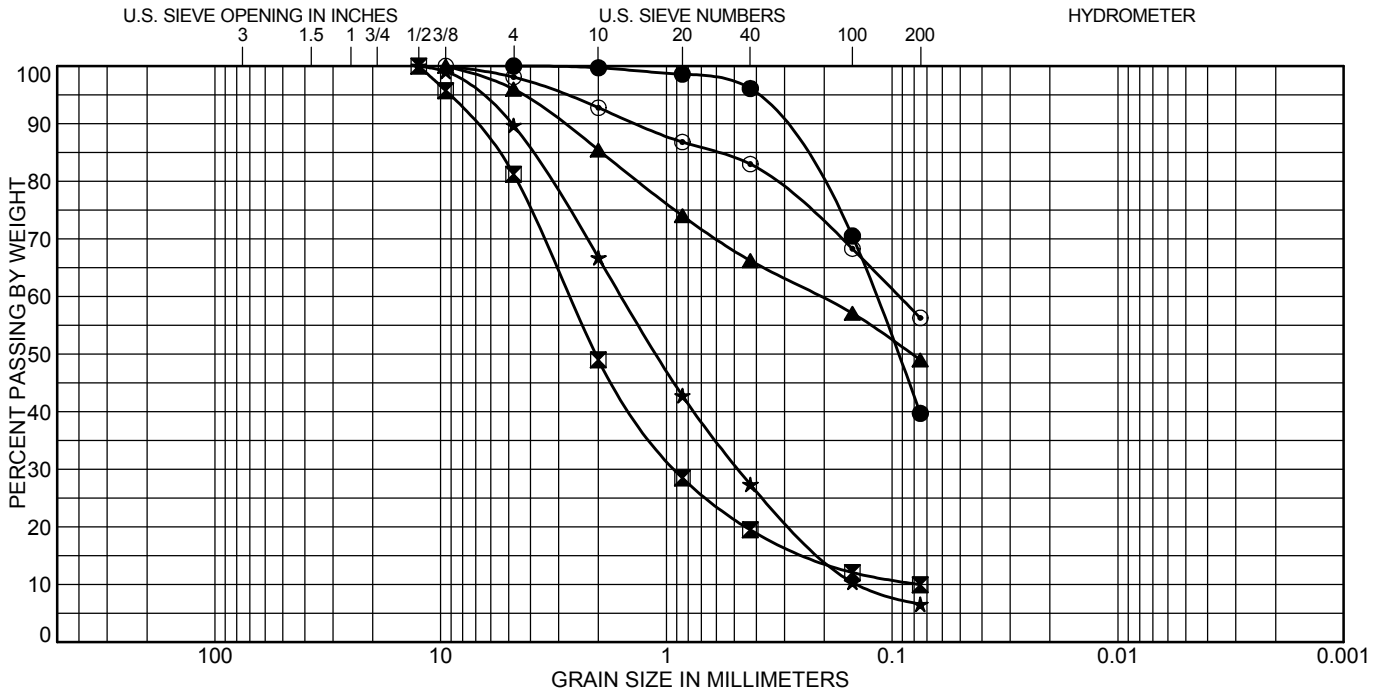

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Test Boring	Depth (ft)	Classification	LL	PL	PI
● 16	14.0	CLAYEY SAND(SC)	37	20	17
⊠ 17	4.0	POORLY GRADED SAND with SILT and GRAVEL(SP-SM)	NP	NP	NP
▲ 18	14.0	SILTY SAND(SM)	43	27	16
★ 19	4.0	WELL-GRADED SAND with SILT(SW-SM)	NP	NP	NP
⊙ 20	4.0	SANDY LEAN CLAY(CL)	39	17	22

Test Boring	Depth (ft)	%Gravel	%Sand	%Silt	%Clay
● 16	14.0	0.0	60.3	39.7	
⊠ 17	4.0	18.8	71.3	10.0	
▲ 18	14.0	4.0	47.0	49.0	
★ 19	4.0	10.3	83.1	6.6	
⊙ 20	4.0	1.9	41.8	56.3	

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Colorado Springs (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO


Geotechnical
Materials Testing
Civil, Planning

SOIL CLASSIFICATION DATA

JOB No. 169845


FIGURE No. 21

DATE 5/14/19

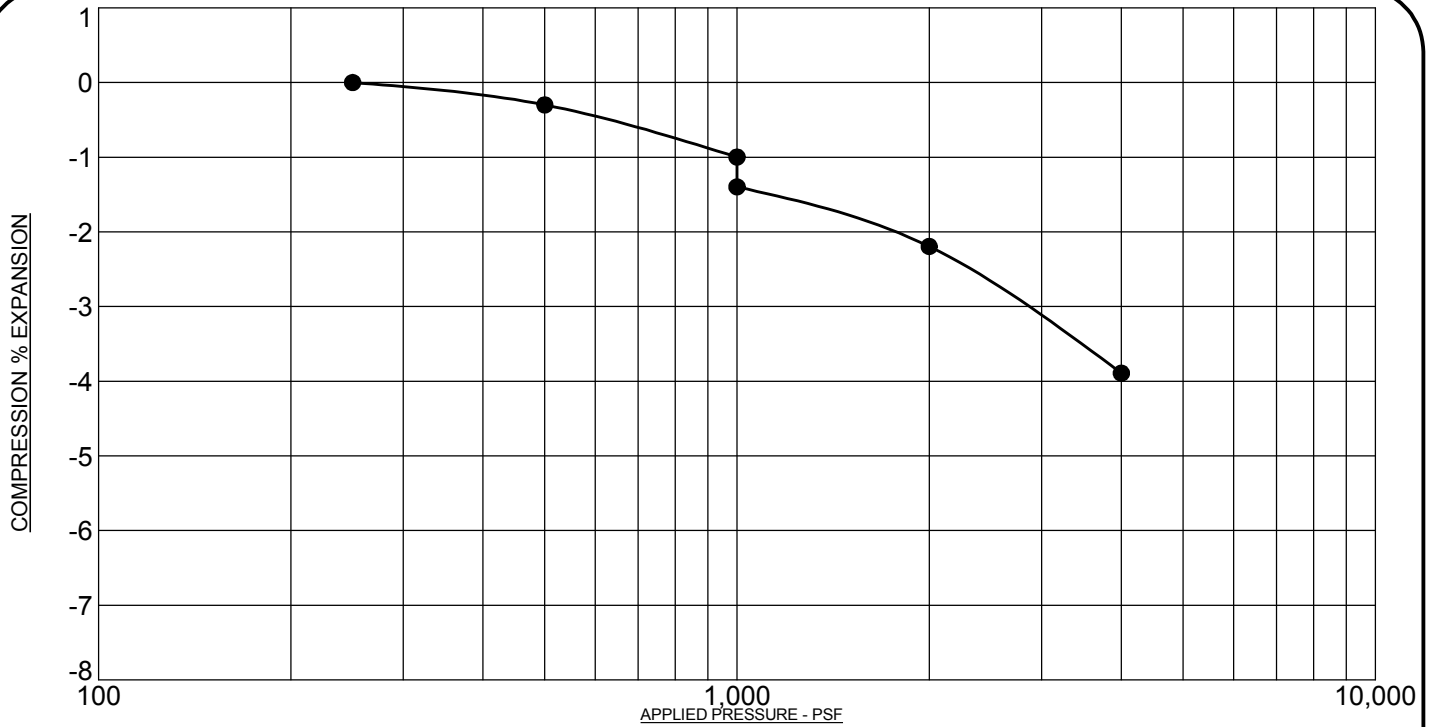

PROJECT: Bent Grass Meadows, Filing No. 2, El Paso County, Colorado
 SAMPLE DESCRIPTION: SANDSTONE, SILTY TO CLAYEY
 NOTE: SAMPLE WAS INUNDATED WITH WATER AT 1,000 PSF

SAMPLE LOCATION: 6 @ 9 FT
 NATURAL DRY UNIT WEIGHT: 107.8 PCF
 NATURAL MOISTURE CONTENT: 11.8%
 PERCENT SWELL/COMPRESSION: - 0.4

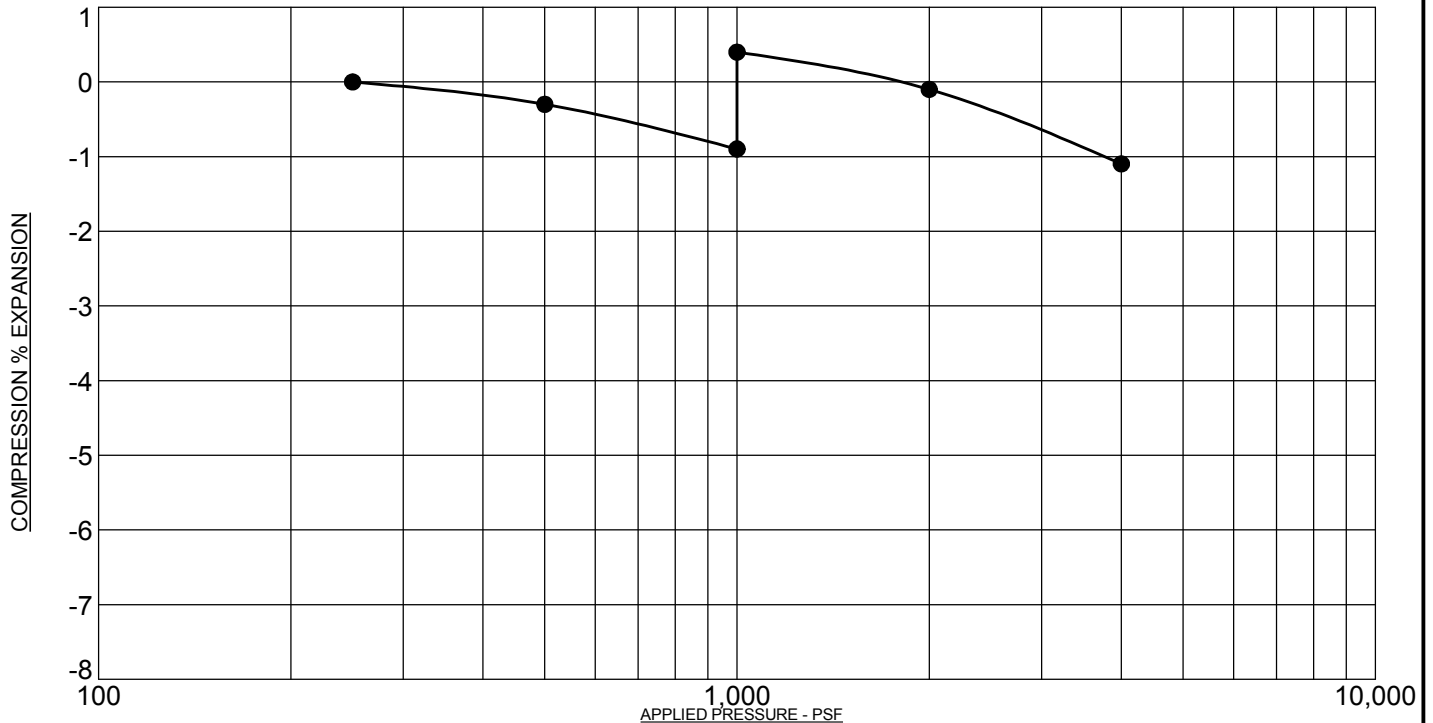

PROJECT: Bent Grass Meadows, Filing No. 2, El Paso County, Colorado
 SAMPLE DESCRIPTION: SAND, CLAYEY
 NOTE: SAMPLE WAS INUNDATED WITH WATER AT 1,000 PSF

SAMPLE LOCATION: 7 @ 4 FT
 NATURAL DRY UNIT WEIGHT: 100.5 PCF
 NATURAL MOISTURE CONTENT: 17.5%
 PERCENT SWELL/COMPRESSION: 1.3

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs: (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600


SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

SWELL/CONSOLIDATION TEST RESULTS

JOB No. 169845


FIGURE No. 23

DATE 5/14/19

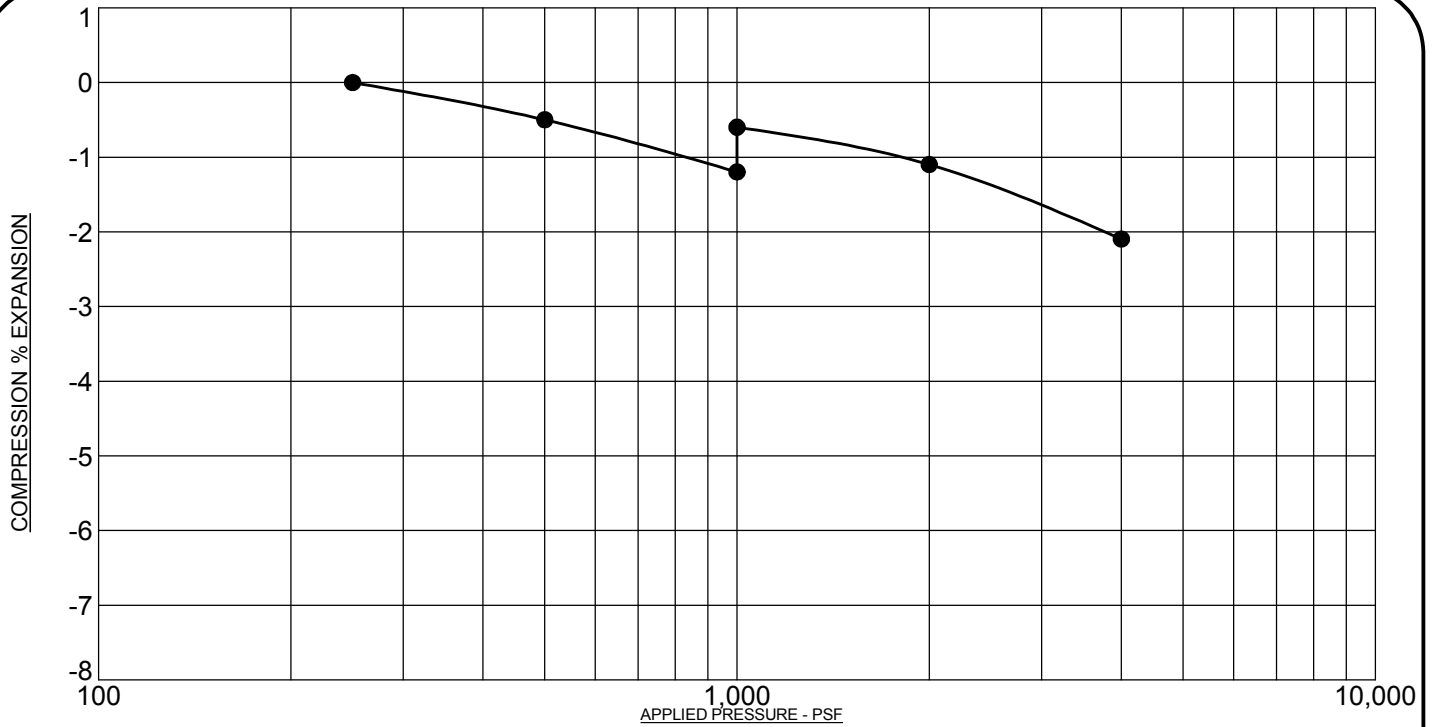

PROJECT: Bent Grass Meadows, Filing No. 2, El Paso County, Colorado
 SAMPLE DESCRIPTION: CLAYSTONE, SANDY
 NOTE: SAMPLE WAS INUNDATED WITH WATER AT 1,000 PSF

SAMPLE LOCATION: 8 @ 9 FT
 NATURAL DRY UNIT WEIGHT: 112.1 PCF
 NATURAL MOISTURE CONTENT: 15.4%
 PERCENT SWELL/COMPRESSION: 0.6

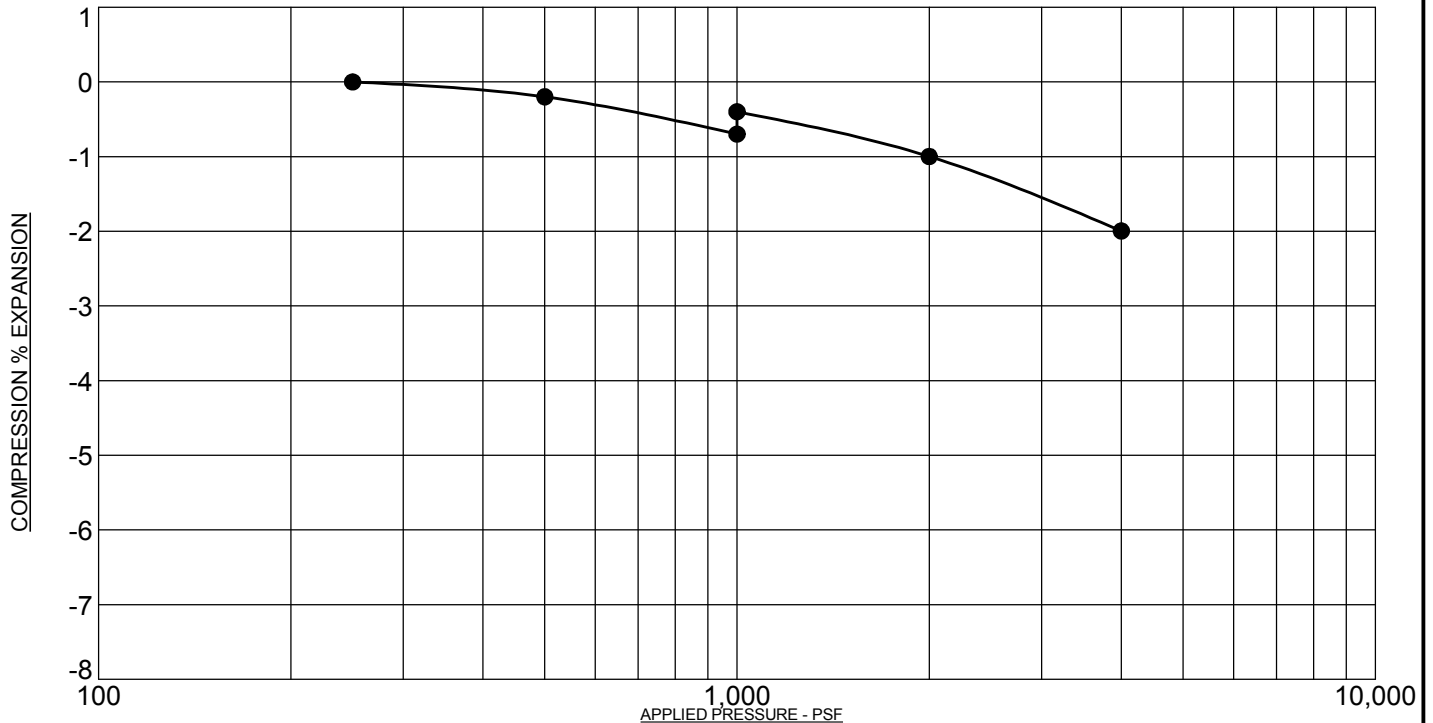

PROJECT: Bent Grass Meadows, Filing No. 2, El Paso County, Colorado
 SAMPLE DESCRIPTION: SANDSTONE, CLAYEY
 NOTE: SAMPLE WAS INUNDATED WITH WATER AT 1,000 PSF

SAMPLE LOCATION: 11 @ 9 FT
 NATURAL DRY UNIT WEIGHT: 109.2 PCF
 NATURAL MOISTURE CONTENT: 16.5%
 PERCENT SWELL/COMPRESSION: 0.3

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs: (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600


SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

SWELL/CONSOLIDATION TEST RESULTS

JOB No. 169845


FIGURE No. 24

DATE 5/14/19

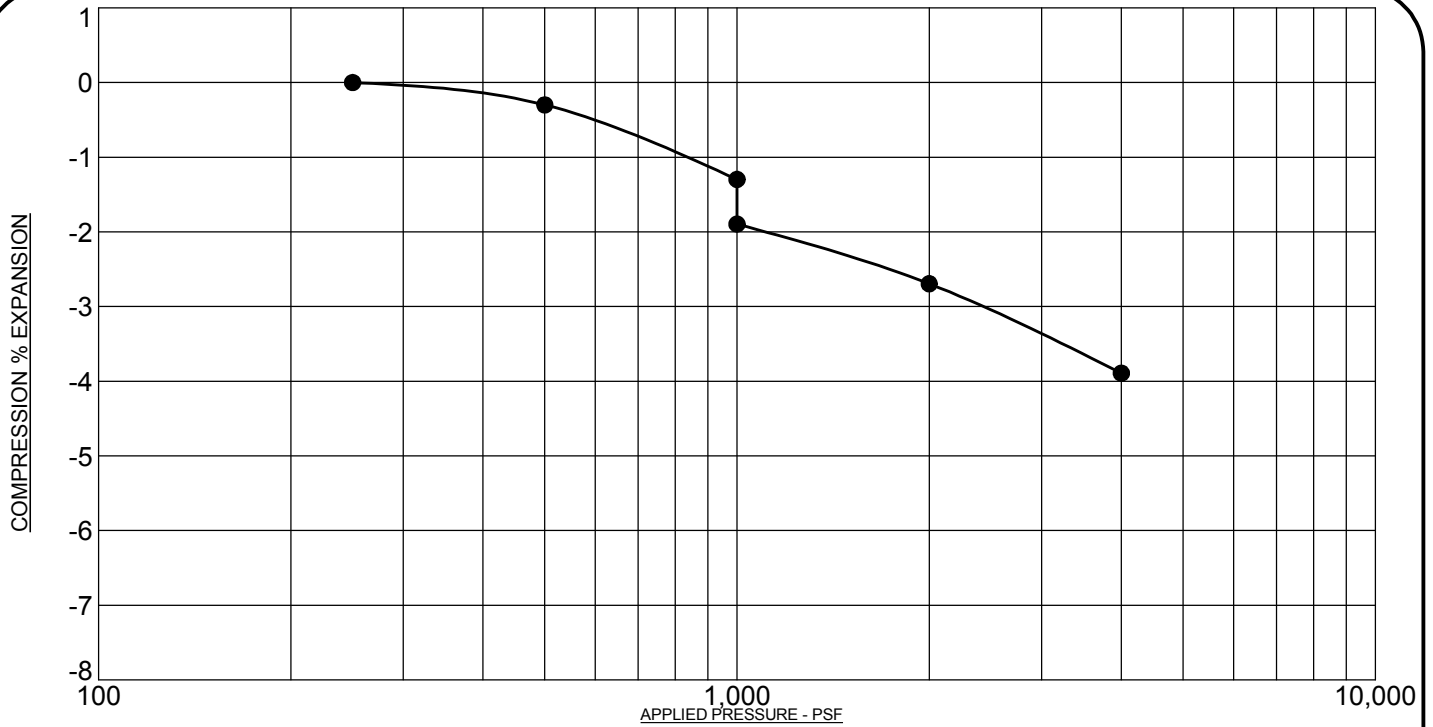

PROJECT: **Bent Grass Meadows, Filing No. 2, El Paso County, Colorado**
 SAMPLE DESCRIPTION: **CLAYSTONE, SANDY**
 NOTE: **SAMPLE WAS INUNDATED WITH WATER AT 1,000 PSF**

SAMPLE LOCATION: **15 @ 9 FT**
 NATURAL DRY UNIT WEIGHT: **124.0 PCF**
 NATURAL MOISTURE CONTENT: **12.3%**
 PERCENT SWELL/COMPRESSION: **- 0.6**

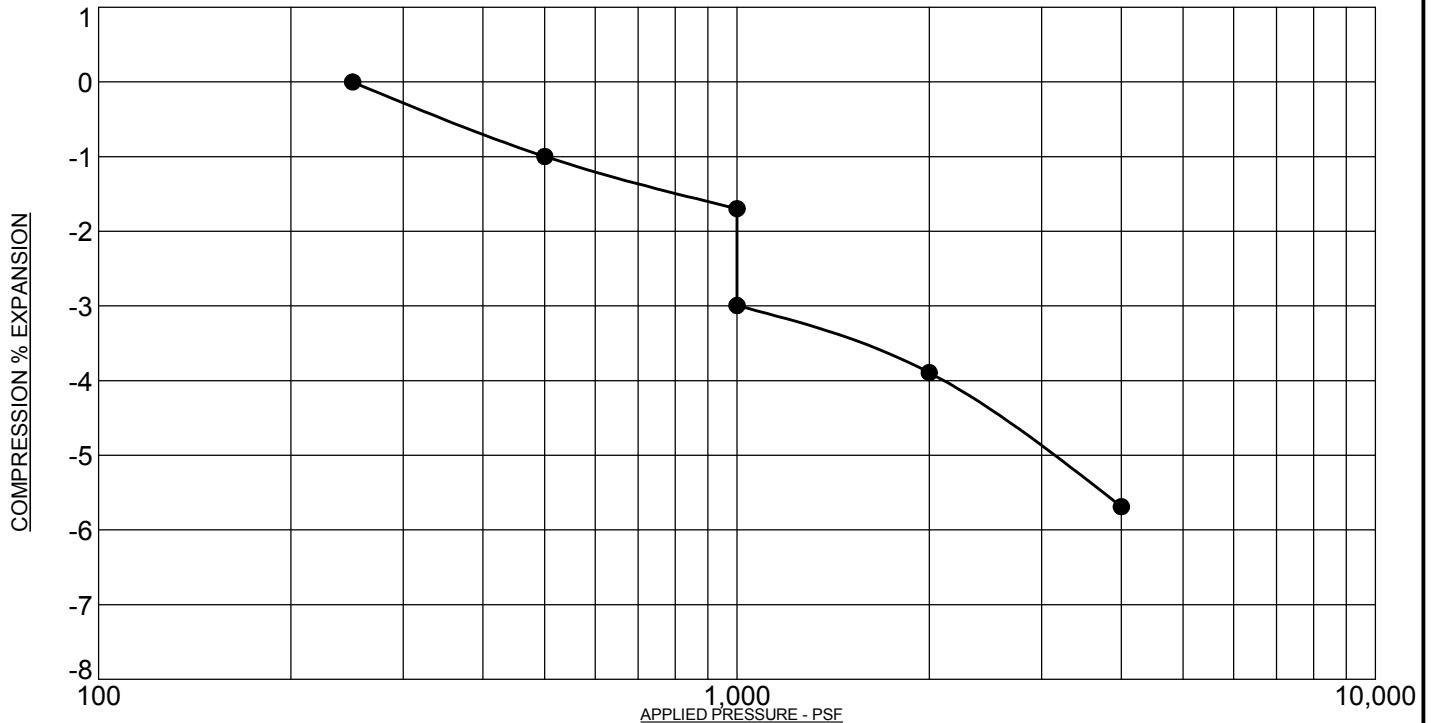

PROJECT: **Bent Grass Meadows, Filing No. 2, El Paso County, Colorado**
 SAMPLE DESCRIPTION: **CLAYSTONE, SANDY**
 NOTE: **SAMPLE WAS INUNDATED WITH WATER AT 1,000 PSF**

SAMPLE LOCATION: **16 @ 9 FT**
 NATURAL DRY UNIT WEIGHT: **107.3 PCF**
 NATURAL MOISTURE CONTENT: **10.1%**
 PERCENT SWELL/COMPRESSION: **- 1.3**

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning


Colorado Springs: (Corporate Office)
 2910 Austin Bluffs Parkway
 Colorado Springs, CO 80918
 (719) 548-0600
 SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

SWELL/CONSOLIDATION TEST RESULTS

JOB No. 169845


FIGURE No. 25

DATE 5/14/19

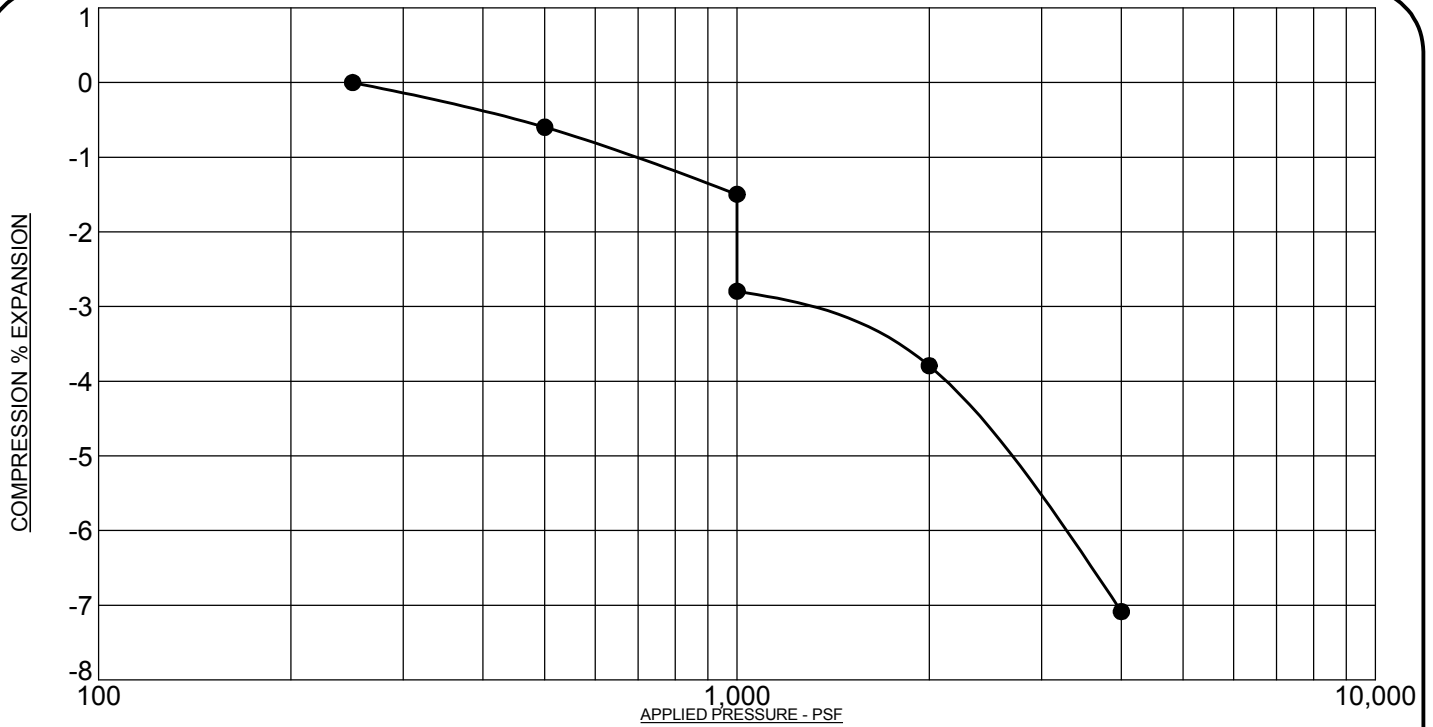

PROJECT: **Bent Grass Meadows, Filing No. 2, El Paso County, Colorado**
 SAMPLE DESCRIPTION: **SANDSTONE, CLAYEY**
 NOTE: **SAMPLE WAS INUNDATED WITH WATER AT 1,000 PSF**

SAMPLE LOCATION: **16 @ 14 FT**
 NATURAL DRY UNIT WEIGHT: **96.9 PCF**
 NATURAL MOISTURE CONTENT: **16.5%**
 PERCENT SWELL/COMPRESSION: **- 1.3**

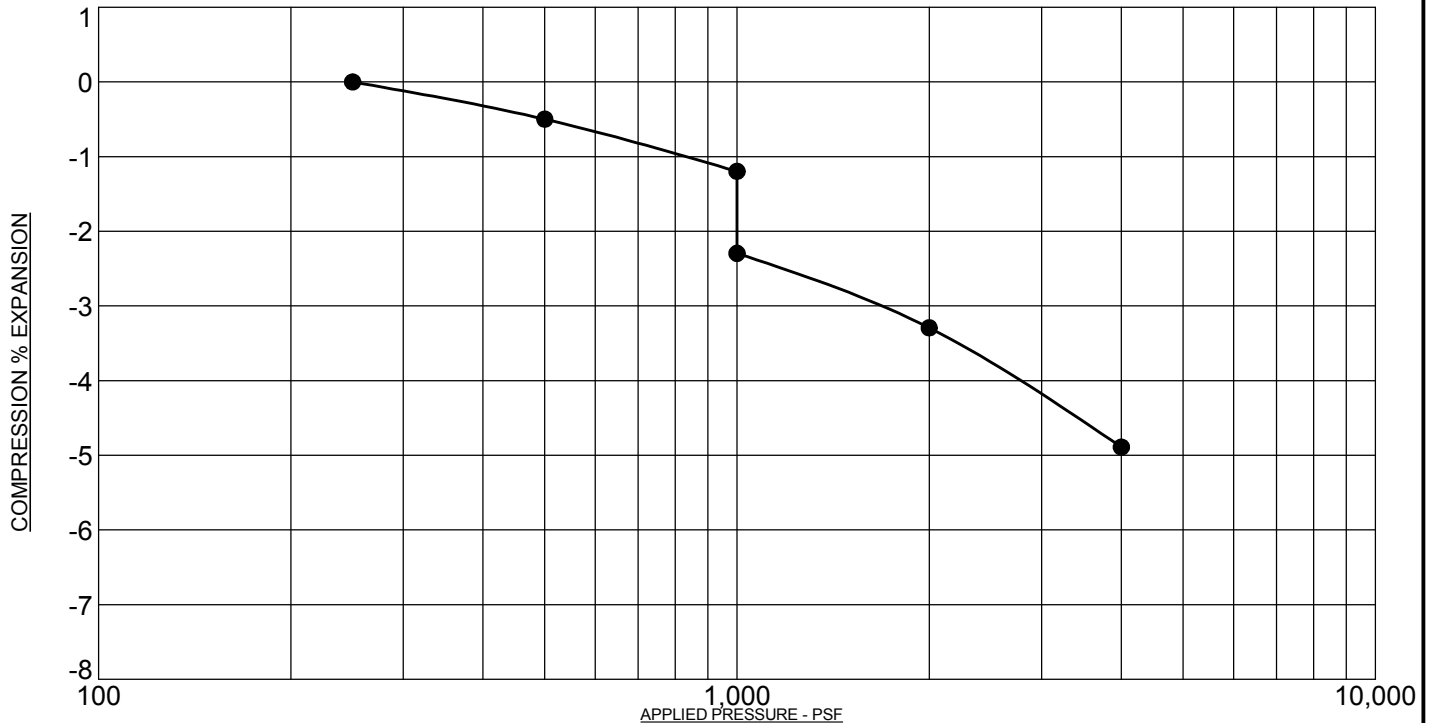

PROJECT: **Bent Grass Meadows, Filing No. 2, El Paso County, Colorado**
 SAMPLE DESCRIPTION: **SANDSTONE, CLAYEY**
 NOTE: **SAMPLE WAS INUNDATED WITH WATER AT 1,000 PSF**

SAMPLE LOCATION: **18 @ 14 FT**
 NATURAL DRY UNIT WEIGHT: **102.6 PCF**
 NATURAL MOISTURE CONTENT: **18.3%**
 PERCENT SWELL/COMPRESSION: **- 1.1**

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs: (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600


SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

SWELL/CONSOLIDATION TEST RESULTS

JOB No. 169845


FIGURE No. 26

DATE 5/14/19

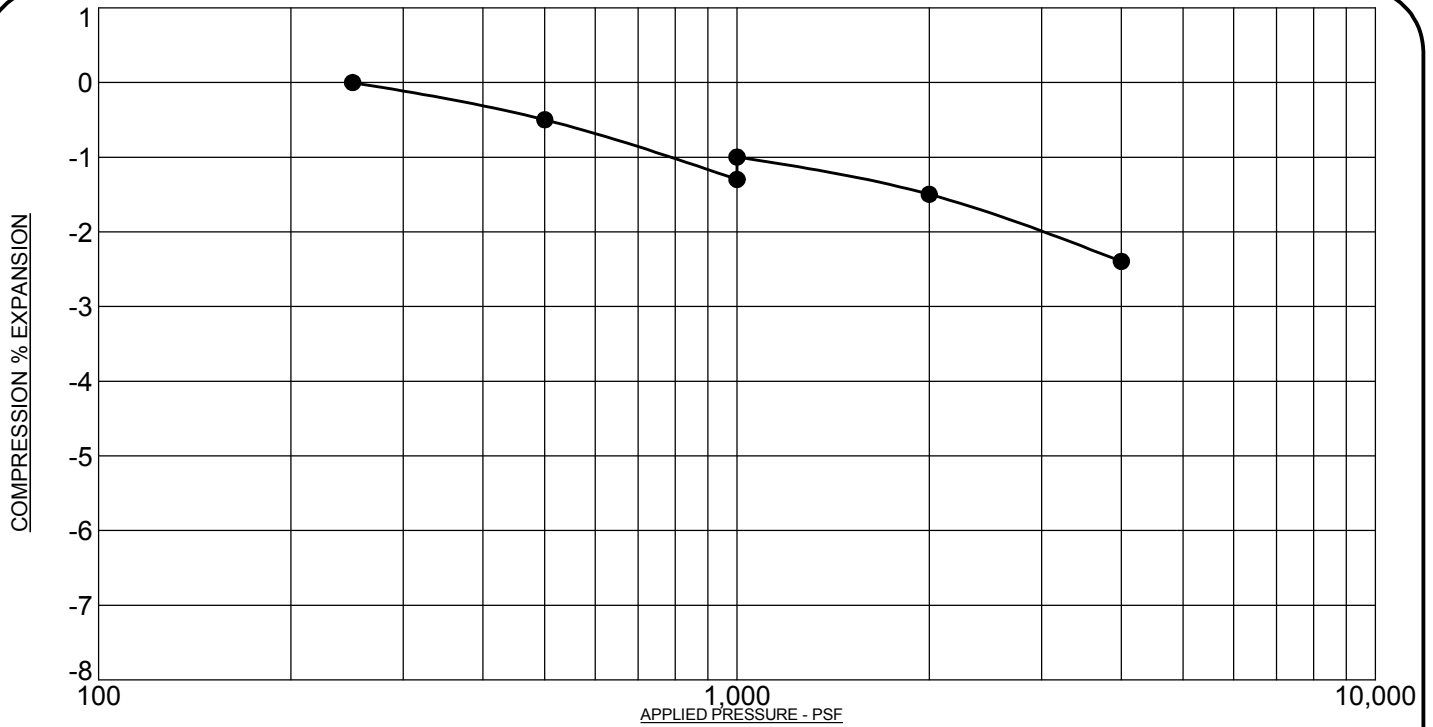

PROJECT: Bent Grass Meadows, Filing No. 2, El Paso County, Colorado
 SAMPLE DESCRIPTION: CLAYSTONE, SANDY
 NOTE: SAMPLE WAS INUNDATED WITH WATER AT 1,000 PSF

SAMPLE LOCATION: 20 @ 4 FT
 NATURAL DRY UNIT WEIGHT: 117.0 PCF
 NATURAL MOISTURE CONTENT: 14.6%
 PERCENT SWELL/COMPRESSION: 0.3

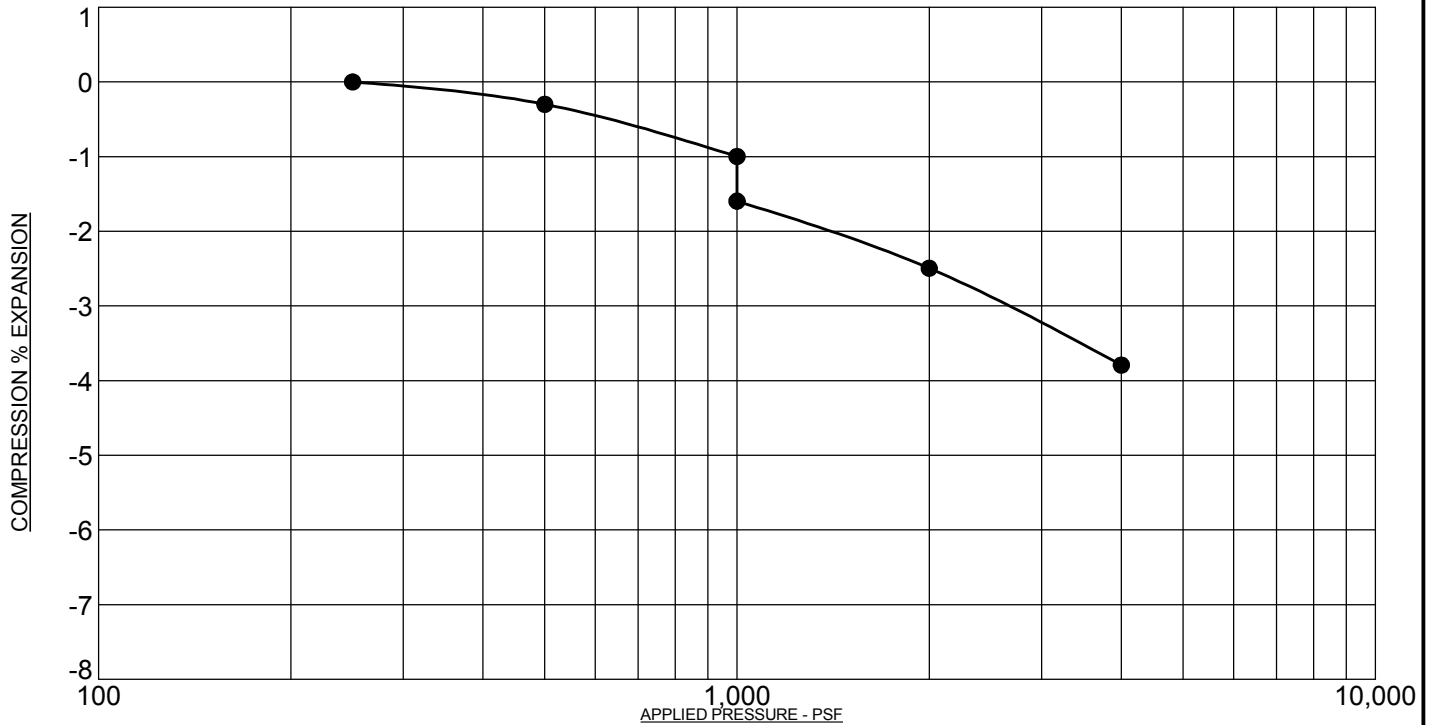

PROJECT: Bent Grass Meadows, Filing No. 2, El Paso County, Colorado
 SAMPLE DESCRIPTION: CLAYSTONE, SANDY
 NOTE: SAMPLE WAS INUNDATED WITH WATER AT 1,000 PSF

SAMPLE LOCATION: 21 @ 9 FT
 NATURAL DRY UNIT WEIGHT: 106.8 PCF
 NATURAL MOISTURE CONTENT: 17.1%
 PERCENT SWELL/COMPRESSION: -0.6

ROCKY MOUNTAIN GROUP

Architectural
Structural
Forensics



Geotechnical
Materials Testing
Civil, Planning

Colorado Springs: (Corporate Office)
2910 Austin Bluffs Parkway
Colorado Springs, CO 80918
(719) 548-0600

SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

SWELL/CONSOLIDATION TEST RESULTS

JOB No. 169845

FIGURE No. 27

DATE 5/14/19

APPENDIX A

Guideline Site Grading Specifications

Description: Unless specified otherwise by local or state regulatory agencies, these guideline specifications are for the excavation, placement and compaction of material from locations indicated on the plans, or staked by the Engineer, as necessary to achieve the required elevations. These specifications shall also apply to compaction of materials that may be placed outside of the project.

General: The Geotechnical Engineer shall approve fill materials, method of placement, moisture contents and percent compactions, and shall give written approval of the compacted fill.

Clearing Site: The Contractor shall remove trees, brush, rubbish, vegetation, topsoil and existing structures before excavation or fill placement is commenced. The Contractor shall dispose of the cleared material to provide the Owner with a clean job site. Cleared material shall not be placed in areas to receive fill or where the material will support structures. Clearing shall also include removal of existing fills that do not meet the requirements of this specification and existing structures.

Preparation of Slopes or Drainage Areas to Receive Fill: Natural slopes or slopes of drainage gullies where grades are 20 percent (5:1, horizontal to vertical) or steeper shall be benched prior to fill placement. Benches shall be at least 10 feet wide. Benches may require additional width to accommodate excavation or compaction equipment. At least one bench shall be provided for each 5 feet or less of vertical elevation difference. The bench surface shall be essentially horizontal perpendicular to the slope or at a slight incline into the slope.

Scarifying: Topsoil and vegetation shall be removed from the ground surface in areas to receive fill. The surface shall be plowed or scarified a minimum of 12 inches until the surface is free from ruts, hummocks or other uneven features which would prevent uniform compaction by the equipment to be used.

Compacting Area to Receive Fill: After the area to receive fill has been cleared and scarified, it shall be disked or bladed until it is free from large clods, moisture conditioned to a proper moisture content and compacted to the maximum density as specified for the overlying fill. Areas to receive fill shall be worked, stabilized, or removed and replaced, if necessary, in accordance with the Geotechnical Engineer's recommendations in preparation for fill.

Fill Materials: Fill material shall be free from organic material or other deleterious substances, and shall not contain rocks or lumps having a diameter greater than six inches. Fill materials shall be obtained from cut areas shown on the plans or staked in the field by the Engineer or imported to the site and shall be approved by the Geotechnical Engineer prior to placement. It is recommended that the fill materials have nil to low expansion potential, i.e., consist of silty to slightly clayey sand.

Moisture Content: Fill materials shall be moisture conditioned to within limits of optimum moisture content specified. Sufficient laboratory compaction tests shall be made to determine the optimum moisture content for the various soils encountered in borrow areas or imported to the site.

The contractor may be required to add moisture to the excavation materials in the borrow area if, in the opinion of the Geotechnical Engineer, it is not possible to obtain uniform moisture content by adding water to the fill material during placement. The Contractor may be required to rake or disk the fill soils to provide uniform moisture content through the soils.

The application of water to embankment materials shall be made with watering equipment, approved by the Geotechnical Engineer, which will give the desired results. Water jets from the spreader shall not be directed at the embankment with such force that fill materials are eroded.

Should too much water be added to the fill, such that the material is too wet to permit the desired compaction to be obtained, compacting and work on that section of the fill shall be delayed until the material has been allowed to dry to the required moisture content. The Contractor will be permitted to rework the wet material in an approved manner to hasten its drying.

Compaction of Fill Areas: Selected fill material shall be placed and mixed in evenly spread layers. After each fill layer has been placed, it shall be uniformly compacted to not less than the specified percentage of maximum density. Fill materials shall be placed such that the thickness of loose material does not exceed 10 inches and the compacted lift thickness does not exceed 6 inches.

Compaction, as specified above, shall be obtained by the use of sheepsfoot rollers, multiple-wheel pneumatic-tired rollers, or other equipment approved by the Geotechnical Engineer. Granular fill shall be compacted using vibratory equipment or other equipment approved by the Geotechnical Engineer. Compaction shall be accomplished while the fill material is at the specified moisture content. Compaction of each layer shall be continuous over the entire area.

Moisture Content and Density Criteria:

- A. For on-site, structural fills and fills supporting utilities, roadways and buildings, 95% maximum Standard Proctor dry density at $2\% \pm$ of optimum moisture content.
- B. For imported, granular, structural fills and granular fills supporting utilities, roadways and buildings, 90% maximum Modified Proctor dry density at $2\% \pm$ of optimum moisture content.
- C. For general grading fills, 92% maximum Standard Proctor dry density at $2\% \pm$ of optimum moisture content.

Compaction of Slopes: Fill slopes shall be compacted by means of sheepsfoot rollers or other suitable equipment. Compaction operations shall be continued until slopes are stable, but not too dense for planting, and such that there is no appreciable amount of loose soil on the slopes. Compaction of slopes may be done progressively in increments of three to five feet in height or after the fill is brought to its total height. Permanent fill slopes shall not exceed 3:1 (horizontal to vertical).

Density Testing: Field density testing shall be performed by the Geotechnical Engineer at locations and depths of his choosing. Where sheepsfoot rollers are used, the soil may be disturbed to a depth of several inches. Density tests shall be taken in compacted material below the disturbed surface. When density tests indicate the density or moisture content of any layer of fill or portion thereof is below that required, the particular layer or portion shall be reworked until the required density or moisture content has been achieved.

Observation and Testing of Fill: Observation by the Geotechnical Engineer shall be sufficient during the placement of fill and compaction operations so that he can declare the fill was placed in general conformance with Specifications. All observations necessary to test the placement of fill and observe compaction operations will be at the expense of the Owner.

Seasonal Limits: No fill material shall be placed, spread or rolled while it is frozen, thawing, or during unfavorable weather conditions. When work is interrupted by heavy precipitation, fill operations shall not be resumed until the Geotechnical Engineer indicates the moisture content and density of previously placed materials are as specified.

Reporting of Field Density Tests: Density tests made by the Geotechnical Engineer shall be submitted progressively to the Owner. Dry density, moisture content, percent compaction, and approximate location shall be reported for each test taken.