

LES SCHWAB TIRE CENTER
GRADING AND EROSION CONTROL PLAN
7105 OLD MERIDIAN ROAD
FALCON, COLORADO 80831

Cushing
Terrell.

cushingterrell.com
800.757.9522



DEVELOPER/OWNER CONTACT

OWNER/DEVELOPER
SFP-E, LLC
GEORGE BUNTING
PO BOX 5350
20900 COOLEY RD.
BEND, OR 97701

JURISDICTIONAL CONTACTS

EL PASO COUNTY
PLANNING DEPARTMENT
JOHN GREEN
2880 INTERNATIONAL CIRCLE #110
COLORADO SPRINGS, CO 80910
(719) 520-6442

UTILITY COMPANY


SANITARY SEWER
WOODMAN HILLS METRO DISTRICT
8046 EASTON RD.
FALCON, CO 80831
(719) 295-2500

WATER
FALCON HIGHLANDS METRO DISTRICT
111 S. TEJON ST. #705
COLORADO SPRINGS, CO 80903
(719) 635-0330

PHONE/CABLE
CONTRACTOR TO COORDINATE SERVICE
PROVIDER WITH OWNER

GAS
COLORADO SPRINGS UTILITIES
111 S. CASCADE AVE.
COLORADO SPRINGS, CO 80903
(719) 448-4808

POWER
MOUNTAIN VIEW ELECTRIC
11140 E WOODMEN ROAD
FALCON, CO 80831
(800) 388-9881

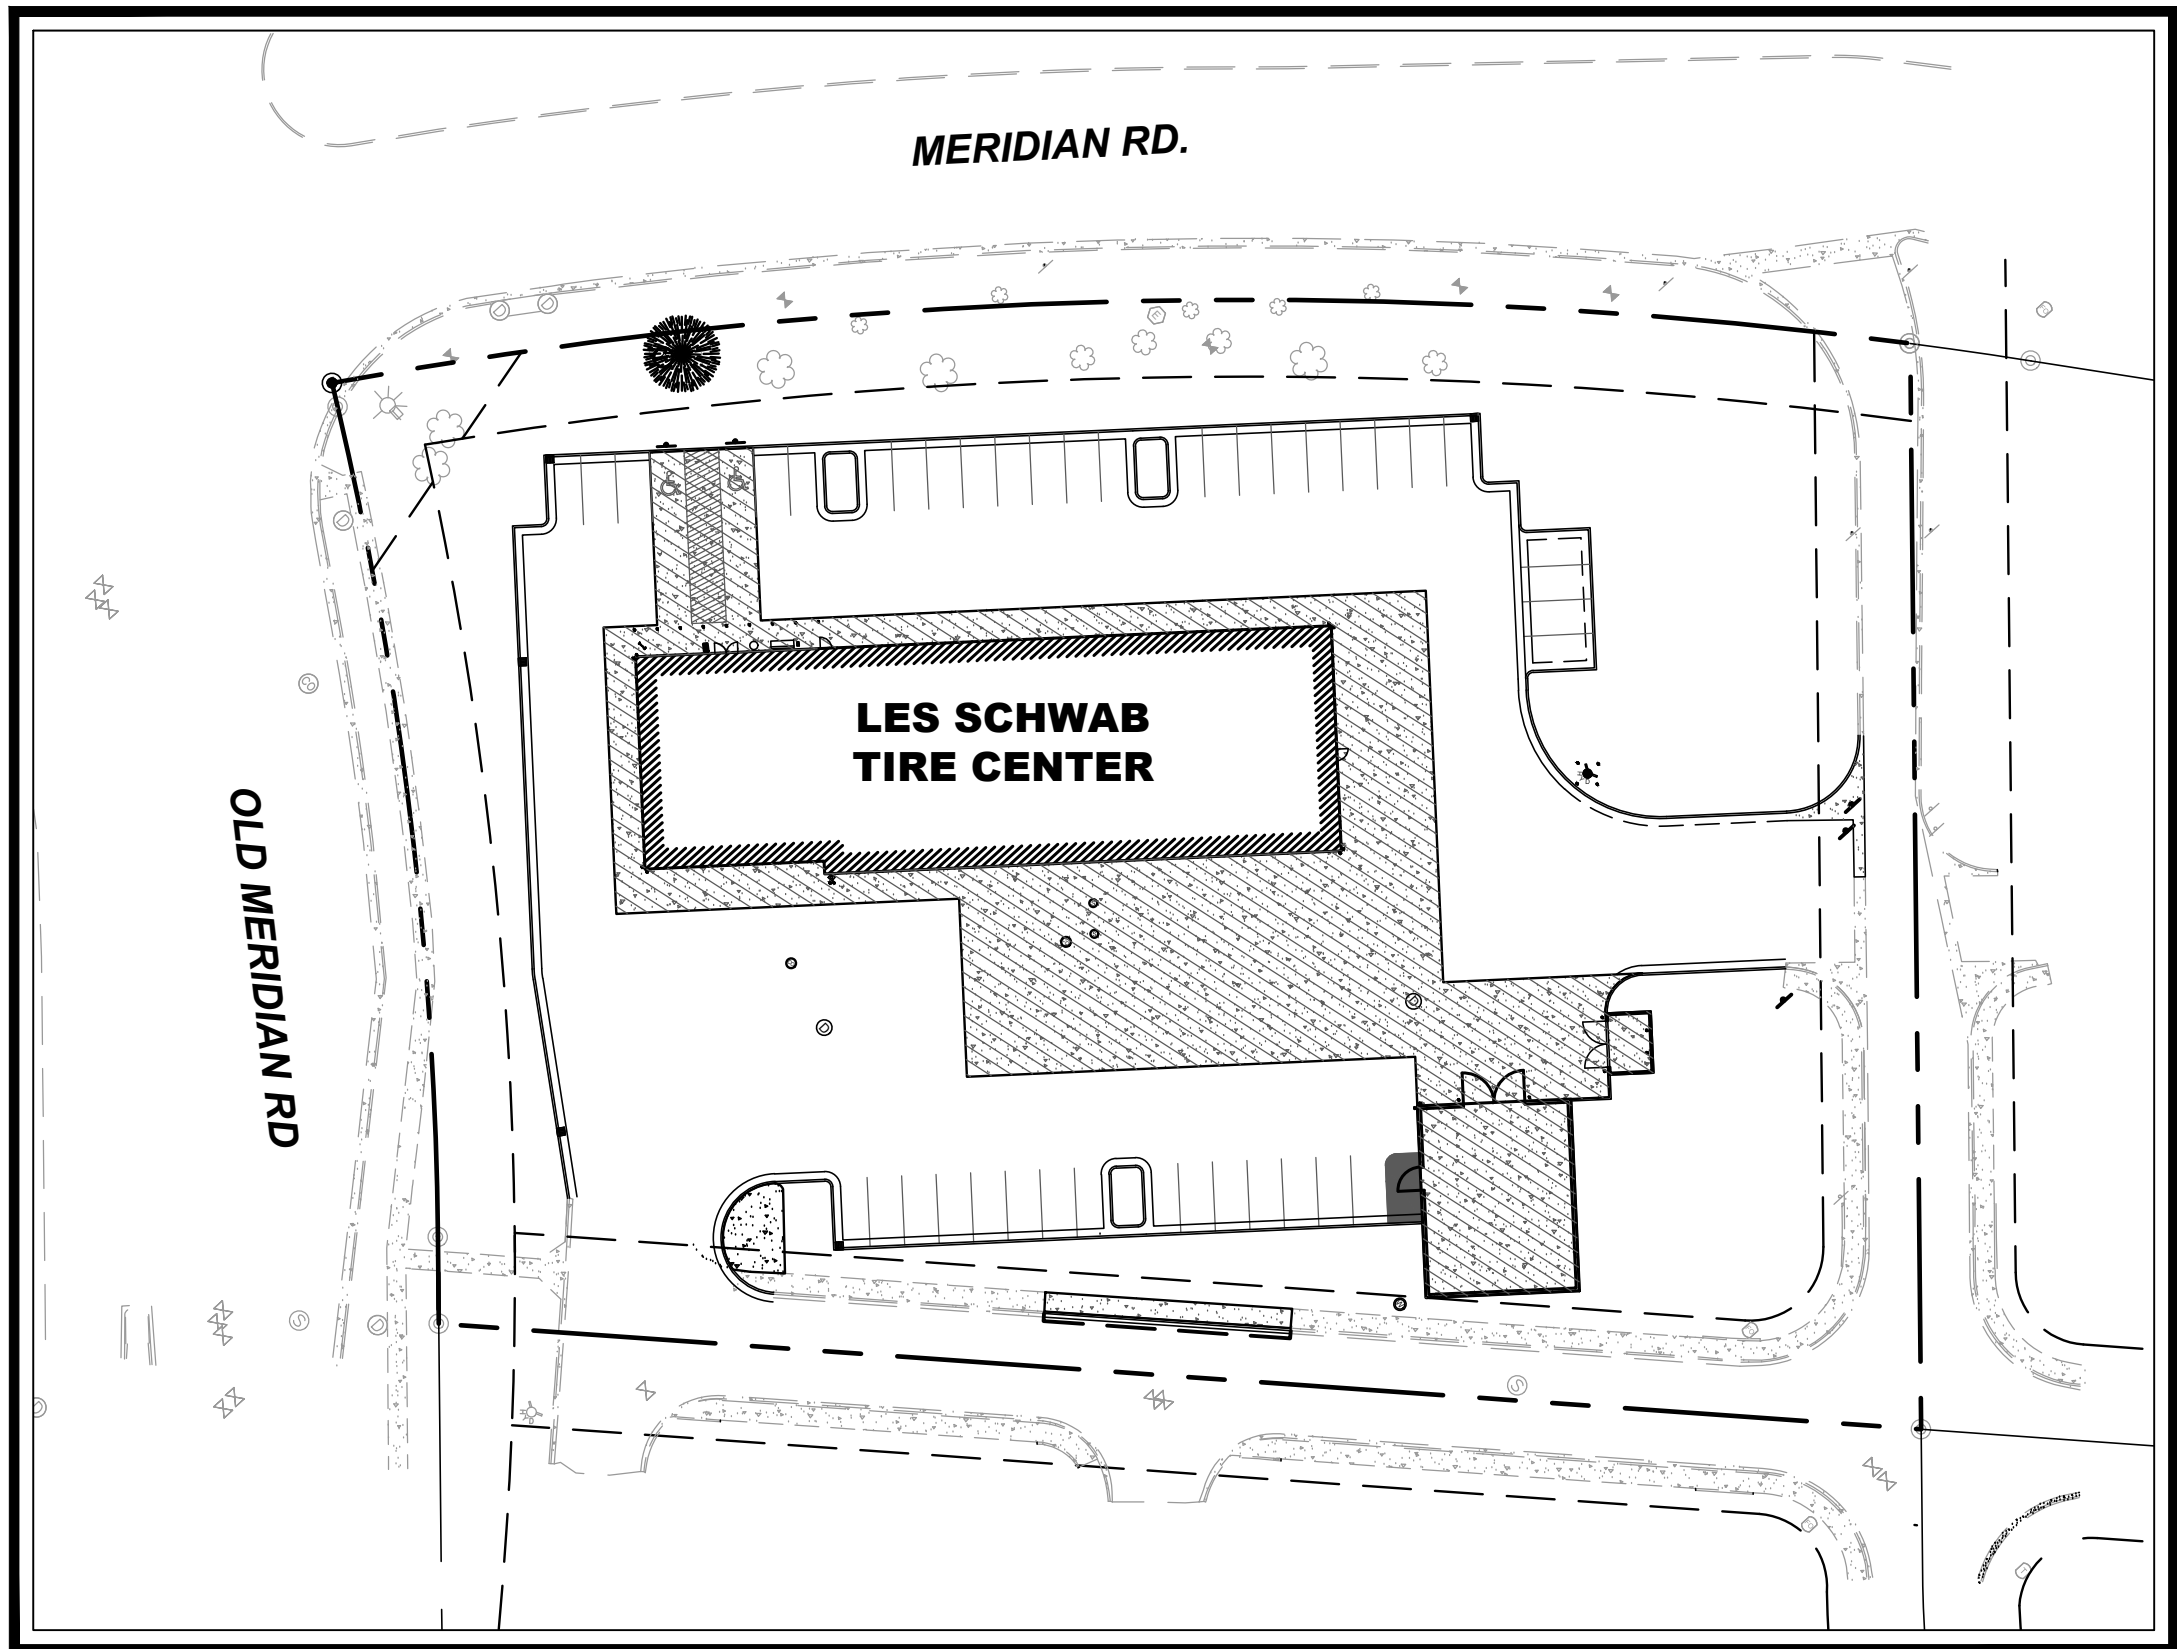

SITE MAP
1" = 50'
NORTH

LEGAL DESCRIPTION

(THE FOLLOWING LEGAL DESCRIPTION WAS TAKEN FROM FIRST AMERICAN TITLE INSURANCE COMPANY COMMITMENT NO. NCS-975191-X17-OR1 WITH A COMMITMENT DATE OF OCTOBER 24, 2019 AT 5:00 P.M.)

PARCEL A:

LOT 1, MERIDIAN CROSSING FILING NO. 1A, ACCORDING TO THE PLAT RECORDED OCTOBER 3, 2018 AT RECEPTION NO. 218714221, COUNTY OF EL PASO, STATE OF COLORADO .

PARCEL B:

NON EXCLUSIVE EASEMENTS FOR CROSS ACCESS, INGRESS AND EGRESS AS SET FORTH AND GRANTED IN THE MERIDIAN CROSSING MAINTENANCE AGREEMENT AND DECLARATION OF COVENANTS CONDITIONS AND RESTRICTIONS RECORDED SEPTEMBER 8, 2008 AT RECEPTION NO. 208099925 AND FIRST AMENDMENT THERETO RECORDED APRIL 8, 2009 AT RECEPTION NO. 20935924.

FOR INFORMATIONAL PURPOSES ONLY: APN: 5312114001

SHEET LIST

- CIVIL
C010 COVER SHEET
C011 GESC NOTES
C012 INITIAL GESC PLAN
C013 INTERIM/FINAL GESC PLAN
C014 GESC DETAILS
C015 GESC DETAILS
C016 GESC DETAILS
C017 CUT / FILL GESC EXHIBIT

ENGINEERS STATEMENT

THIS GRADING AND EROSION CONTROL PLAN WAS PREPARED UNDER MY DIRECTION AND SUPERVISION AND IS CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF. SAID PLAN HAS BEEN PREPARED ACCORDING TO THE CRITERIA ESTABLISHED BY THE COUNTY FOR GRADING AND EROSION CONTROL PLANS. I ACCEPT RESPONSIBILITY FOR ANY LIABILITY CAUSED BY ANY NEGLIGENT ACTS, ERRORS OR OMISSIONS ON MY PART IN PREPARING THIS PLAN.

ENGINEER OF RECORD SIGNATURE _____ DATE _____

OWNERS STATEMENT

OWNER'S STATEMENT (FOR STANDALONE GEC PLAN): I, THE OWNER/DEVELOPER HAVE READ AND WILL COMPLY WITH THE REQUIREMENTS OF THE GRADING AND EROSION CONTROL PLAN.

OWNER SIGNATURE _____ DATE _____

EL PASO COUNTY

COUNTY PLAN REVIEW IS PROVIDED ONLY FOR GENERAL CONFORMANCE WITH COUNTY DESIGN CRITERIA. THE COUNTY IS NOT RESPONSIBLE FOR THE ACCURACY AND ADEQUACY OF THE DESIGN, DIMENSIONS, AND/ OR ELEVATIONS WHICH SHALL BE CONFIRMED AT THE JOB SITE. THE COUNTY THROUGH THE APPROVAL OF THIS DOCUMENT ASSUMES NO RESPONSIBILITY FOR COMPLETENESS AND/ OR ACCURACY OF THIS DOCUMENT.


FILED IN ACCORDANCE WITH THE REQUIREMENTS OF THE EL PASO COUNTY LAND DEVELOPMENT CODE, DRAINAGE CRITERIA MANUAL VOLUMES 1 AND 2, AND ENGINEERING CRITERIA MANUAL, AS AMENDED.

IN ACCORDANCE WITH ECM SECTION 1.12, THESE CONSTRUCTION DOCUMENTS WILL BE VALID FOR CONSTRUCTION FOR A PERIOD OF 2 YEARS FROM THE DATE SIGNED BY THE EL PASO COUNTY ENGINEER. IF CONSTRUCTION HAS NOT STARTED WITHIN THOSE 2 YEARS, THE PLANS WILL NEED TO BE RESUBMITTED FOR APPROVAL, INCLUDING PAYMENT OF REVIEW FEES AT THE PLANNING AND COMMUNITY DEVELOPMENT DIRECTOR'S DISCRETION.

COUNTY PROJECT ENGINEER SIGNATURE _____ DATE _____



VICINITY MAP
NTS



CONSULTANT TEAM

ARCHITECT
CUSHING TERRELL
CORY NELSON
800 W MAIN ST. STE 800
BOISE, ID 83702
(208) 336-4900

CIVIL ENGINEER
CUSHING TERRELL
ZACK GRAHAM, PE
411 E MAIN STREET SUITE 101
BOZEMAN, MT 59715
(406) 922-7137

ELECTRICAL ENGINEER
CUSHING TERRELL
MIKE BEGLINGER, PE
306 W RAILROAD ST. STE 104
BOISE, ID 83702
(406) 728-9522

LANDSCAPE ARCHITECT
CUSHING TERRELL
ANGELA HANSEN
800 W MAIN ST. STE 800
BOISE, ID 83702
(208) 336-4900

GEOTECHNICAL ENGINEER
PICKERING, COLE, & HYNTER
GLEN D. OHLSEN, PE
1070 WEST 124TH AVE, SUITE 300
WESTMINSTER, CO 80234
(208) 323-9520



Know what's below.
Call before you dig.

7105 OLD MERIDIAN RD.
FALCON, CO

LES SCHWAB TIRE CENTER



© 2021 | ALL RIGHTS RESERVED

SITE DEVELOPEMENT
PLANS

04.16.2021
DRAWN BY | WALKER
CHECKED BY | GRAHAM
REVISIONS

NOT FOR CONSTRUCTION - PRELIMINARY DESIGN

GRADING AND EROSION
CONTROL COVER SHEET

C010

LEGEND		
EXISTING	PROPOSED	
		ASPHALT
		CONCRETE
		HEAVY DUTY ASPHALT
		HEAVY DUTY CONCRETE
		GRAVEL
		LANDSCAPE
		LANDSCAPE
		WM WATER MAIN
		F FIRE SERVICE
		WS DOMESTIC WATER SERVICE
		ST STORM DRAIN
		SS SANITARY SEWER
		BP BURIED POWER
		OHP OVERHEAD POWER
		BT BURIED TELEPHONE
		GAS BURIED GAS
		FO BURIED FIBER OPTIC
		FENCE - CHAINLINK
		FENCE - WOODEN
		FENCE - BARBED WIRE
		BUILDING
		BUILDING ROOF OVERHANG
		VERTICAL CURB
		CURB AND GUTTER
		CURB AND GUTTER - CATCH
		CURB AND GUTTER - SPILL
		VEGETATION EXTENTS
		PROPERTY LINE - SUBJECT
		PROPERTY LINE - ADJACENT
		EASEMENT
		CONTROL POINT
		FOUND PROPERTY CORNER AS NOTED
		FIRE HYDRANT/ CONTROL POINT HYDRANT
		WATER VALVE
		WATER SHUTOFF
		WATER METER
		STORM DRAIN MANHOLE
		STORM DRAIN INLET STRUCTURE
		STORM DRAIN CURB INLET
		STORM DRAIN OUTLET STRUCTURE
		STORM DRAIN ROOF DOWNSPOUT
		STORM DRAIN CLEANOUT
		SANITARY SEWER MANHOLE
		SANITARY SEWER CLEANOUT
		UTILITY POLE
		GUY WIRE
		LIGHT POLE (ONE LIGHT AND DIRECTION)
		LIGHT POLE
		TRANSFORMER
		POWER METER OR POWER HANDHOLE
		GAS METER
		TELEPHONE PEDESTAL
		IRRIGATION CONTROL VALVE
		POLE SIGN AND DOUBLE POLE SIGN
		BOLLARD (OR AS NOTED)
		PARKING STALL COUNT
		DECIDUOUS TREE
		CONIFEROUS TREE
		BUSH

NOTE: ALL EXISTING LAYERS SUBJECT TO DEMOLITION TO BE SHOWN DARKER THAN INDICATED IN THIS LEGEND.

STANDARD NOTES FOR EL PASO COUNTY GESC PLAN

- STORMWATER DISCHARGES FROM CONSTRUCTION SITES SHALL NOT CAUSE OR THREATEN TO CAUSE POLLUTION, CONTAMINATION, OR DEGRADATION OF STATE WATERS. ALL WORK AND EARTH DISTURBANCE SHALL BE DONE IN A MANNER THAT MINIMIZES POLLUTION OF ANY ON-SITE OR OFF-SITE WATERS, INCLUDING WETLANDS.
- NOTWITHSTANDING ANYTHING DEPICTED IN THESE PLANS IN WORDS OR GRAPHIC REPRESENTATION, ALL DESIGN AND CONSTRUCTION RELATED TO ROADS, STORM DRAINAGE AND EROSION CONTROL SHALL CONFORM TO THE STANDARDS AND REQUIREMENTS OF THE MOST RECENT VERSION OF THE RELEVANT ADOPTED EL PASO COUNTY STANDARDS, INCLUDING THE LAND DEVELOPMENT CODE, THE ENGINEERING CRITERIA MANUAL, THE DRAINAGE CRITERIA MANUAL, AND THE DRAINAGE CRITERIA MANUAL VOLUME 2. ANY DEVIATIONS FROM REGULATIONS AND STANDARDS MUST BE REQUESTED, AND APPROVED, IN WRITING.
- A SEPARATE STORMWATER MANAGEMENT PLAN (SMWP) FOR THIS PROJECT SHALL BE COMPLETED AND AN EROSION AND STORMWATER QUALITY CONTROL PERMIT (ESQCP) ISSUED PRIOR TO COMMENCING CONSTRUCTION. MANAGEMENT OF THE SWMP DURING CONSTRUCTION IS THE RESPONSIBILITY OF THE DESIGNATED QUALIFIED STORMWATER MANAGER OR CERTIFIED EROSION CONTROL INSPECTOR. THE SWMP SHALL BE LOCATED ON-SITE AT ALL TIMES DURING CONSTRUCTION AND SHALL BE KEPT UP TO DATE WITH WORK PROGRESS AND CHANGES IN THE FIELD
- ONCE THE ESQCP IS APPROVED AND A "NOTICE TO PROCEED" HAS BEEN ISSUED, THE CONTRACTOR MAY INSTALL THE INITIAL STAGE EROSION AND SEDIMENT CONTROL MEASURES AS INDICATED ON THE APPROVED GEC. A PRECONSTRUCTION MEETING BETWEEN THE CONTRACTOR, ENGINEER, AND EL PASO COUNTY WILL BE HELD PRIOR TO ANY CONSTRUCTION. IT IS THE RESPONSIBILITY OF THE APPLICANT TO COORDINATE THE MEETING TIME AND PLACE WITH COUNTY STAFF.
- CONTROL MEASURES MUST BE INSTALLED PRIOR TO COMMENCEMENT OF ACTIVITIES THAT COULD CONTRIBUTE POLLUTANTS TO STORMWATER. CONTROL MEASURES FOR ALL SLOPES, CHANNELS, DITCHES, AND DISTURBED LAND AREAS SHALL BE INSTALLED IMMEDIATELY UPON COMPLETION OF THE DISTURBANCE
- ALL TEMPORARY SEDIMENT AND EROSION CONTROL MEASURES SHALL BE MAINTAINED AND REMAIN IN EFFECTIVE OPERATING CONDITION UNTIL PERMANENT SOIL EROSION CONTROL MEASURES ARE IMPLEMENTED AND FINAL STABILIZATION IS ESTABLISHED. ALL PERSONS ENGAGED IN LAND DISTURBANCE ACTIVITIES SHALL ASSESS THE ADEQUACY OF CONTROL MEASURES AT THE SITE AND IDENTIFY IF CHANGES TO THOSE CONTROL MEASURES ARE NEEDED TO ENSURE THE CONTINUED EFFECTIVE PERFORMANCE OF THE CONTROL MEASURES. ALL CHANGES TO TEMPORARY SEDIMENT AND EROSION CONTROL MEASURES MUST BE INCORPORATED INTO THE STORMWATER MANAGEMENT PLAN.
- TEMPORARY STABILIZATION SHALL BE IMPLEMENTED ON DISTURBED AREAS AND STOCKPILES WHERE GROUND DISTURBING CONSTRUCTION ACTIVITY HAS PERMANENTLY CEASED OR TEMPORARILY CEASED FOR LONGER THAN 14 DAYS.
- FINAL STABILIZATION MUST BE IMPLEMENTED AT ALL APPLICABLE CONSTRUCTION SITES. FINAL STABILIZATION IS ACHIEVED WHEN ALL GROUND DISTURBING ACTIVITIES ARE COMPLETE AND ALL DISTURBED AREAS EITHER HAVE A UNIFORM VEGETATIVE COVER WITH INDIVIDUAL PLANT DENSITY OF 70 PERCENT OF PRE-DISTURBANCE LEVELS ESTABLISHED OR EQUIVALENT PERMANENT ALTERNATIVE STABILIZATION METHOD IS IMPLEMENTED. ALL TEMPORARY SEDIMENT AND EROSION CONTROL MEASURES SHALL BE REMOVED UPON FINAL STABILIZATION AND BEFORE PERMIT CLOSURE.
- ALL PERMANENT STORMWATER MANAGEMENT FACILITIES SHALL BE INSTALLED AS DESIGNED IN THE APPROVED PLANS. ANY PROPOSED CHANGES THAT EFFECT THE DESIGN OR FUNCTION OF PERMANENT STORMWATER MANAGEMENT STRUCTURES MUST BE APPROVED BY THE ECM ADMINISTRATOR PRIOR TO IMPLEMENTATION.
- EARTH DISTURBANCES SHALL BE CONDUCTED IN SUCH A MANNER SO AS TO EFFECTIVELY MINIMIZE ACCELERATED SOIL EROSION AND RESULTING SEDIMENTATION. ALL DISTURBANCES SHALL BE DESIGNED, CONSTRUCTED, AND COMPLETED SO THAT THE EXPOSED AREA OF ANY DISTURBED LAND SHALL BE LIMITED TO THE SHORTEST PRACTICAL PERIOD OF TIME. PRE-EXISTING VEGETATION SHALL BE PROTECTED AND MAINTAINED WITHIN 50 HORIZONTAL FEET OF A WATERS OF THE STATE UNLESS SHOWN TO BE INFEASIBLE AND SPECIFICALLY REQUESTED AND APPROVED.
- COMPACTION OF SOIL MUST BE PREVENTED IN AREAS DESIGNATED FOR INFILTRATION CONTROL MEASURES OR WHERE FINAL STABILIZATION WILL BE ACHIEVED BY VEGETATIVE COVER. AREAS DESIGNATED FOR INFILTRATION CONTROL MEASURES SHALL ALSO BE PROTECTED FROM SEDIMENTATION DURING CONSTRUCTION UNTIL FINAL STABILIZATION IS ACHIEVED. IF COMPACTION PREVENTION IS NOT FEASIBLE DUE TO SITE CONSTRAINTS, ALL AREAS DESIGNATED FOR INFILTRATION AND VEGETATION CONTROL MEASURES MUST BE LOOSENED PRIOR TO INSTALLATION OF THE CONTROL MEASURE(S).
- ANY TEMPORARY OR PERMANENT FACILITY DESIGNED AND CONSTRUCTED FOR THE CONVEYANCE OF STORMWATER AROUND, THROUGH, OR FROM THE EARTH DISTURBANCE AREA SHALL BE A STABILIZED CONVEYANCE DESIGNED TO MINIMIZE EROSION AND THE DISCHARGE OF SEDIMENT OFF-SITE.
- CONCRETE WASH WATER SHALL BE CONTAINED AND DISPOSED OF IN ACCORDANCE WITH THE SWMP. NO WASH WATER SHALL BE DISCHARGED TO OR ALLOWED TO ENTER STATE WATERS, INCLUDING ANY SURFACE OR SUBSURFACE STORM DRAINAGE SYSTEM OR FACILITIES. CONCRETE WASHOUTS SHALL NOT BE LOCATED IN AN AREA WHERE SHALLOW GROUNDWATER MAY BE PRESENT, OR WITHIN 50 FEET OF A SURFACE WATER BODY, CREEK OR STREAM.
- DURING DEWATERING OPERATIONS, UNCONTAMINATED GROUNDWATER MAY BE DISCHARGED ON-SITE, BUT SHALL NOT LEAVE THE SITE IN THE FORM OF SURFACE RUNOFF UNLESS AN APPROVED STATE DEWATERING PERMIT IS IN PLACE.
- EROSION CONTROL BLANKETING OR OTHER PROTECTIVE COVERING SHALL BE USED ON SLOPES STEEPER THAN 3:1.
- CONTRACTOR SHALL BE RESPONSIBLE FOR THE REMOVAL OF ALL WASTES FROM THE CONSTRUCTION SITE FOR DISPOSAL IN ACCORDANCE WITH LOCAL AND STATE REGULATORY REQUIREMENTS. NO CONSTRUCTION DEBRIS, TREE SLASH, BUILDING MATERIAL WASTES OR UNUSED BUILDING MATERIALS SHALL BE BURIED, DUMPED, OR DISCHARGED AT THE SITE.
- WASTE MATERIALS SHALL NOT BE TEMPORARILY PLACED OR STORED IN THE STREET, ALLEY, OR OTHER PUBLIC WAY, UNLESS IN ACCORDANCE WITH AN APPROVED TRAFFIC CONTROL PLAN. CONTROL MEASURES MAY BE REQUIRED BY EL PASO COUNTY ENGINEERING IF DEEMED NECESSARY, BASED ON SPECIFIC CONDITIONS AND CIRCUMSTANCES
- TRACKING OF SOILS AND CONSTRUCTION DEBRIS OFF-SITE SHALL BE MINIMIZED. MATERIALS TRACKED OFF-SITE SHALL BE CLEANED UP AND PROPERLY DISPOSED OF IMMEDIATELY.
- THE OWNER/DEVELOPER SHALL BE RESPONSIBLE FOR THE REMOVAL OF ALL CONSTRUCTION DEBRIS, DIRT, TRASH, ROCK, SEDIMENT, SOIL, AND SAND THAT MAY ACCUMULATE IN ROADS, STORM DRAINS AND OTHER DRAINAGE CONVEYANCE SYSTEMS AND STORMWATER APPURTENANCES AS A RESULT OF SITE DEVELOPMENT.
- THE QUANTITY OF MATERIALS STORED ON THE PROJECT SITE SHALL BE LIMITED, AS MUCH AS PRACTICAL, TO THAT QUANTITY REQUIRED TO PERFORM THE WORK IN AN ORDERLY SEQUENCE. ALL MATERIALS STORED ON-SITE SHALL BE STORED IN A NEAT, ORDERLY MANNER, IN THEIR ORIGINAL CONTAINERS, WITH ORIGINAL MANUFACTURER'S LABELS.
- NO CHEMICAL(S) HAVING THE POTENTIAL TO BE RELEASED IN STORMWATER ARE TO BE STORED OR USED ON-SITE UNLESS PERMISSION FOR THE USE OF SUCH CHEMICAL(S) IS GRANTED IN WRITING BY THE ECM ADMINISTRATOR. IN GRANTING APPROVAL FOR THE USE OF SUCH CHEMICAL(S), SPECIAL CONDITIONS AND MONITORING MAY BE REQUIRED.
- BULK STORAGE OF ALLOWED PETROLEUM PRODUCTS OR OTHER ALLOWED LIQUID CHEMICALS IN

- EXCESS OF 55 GALLONS SHALL REQUIRE ADEQUATE SECONDARY CONTAINMENT PROTECTION TO CONTAIN ALL SPILLS ON-SITE AND TO PREVENT ANY SPILLED MATERIALS FROM ENTERING STATE WATERS, ANY SURFACE OR SUBSURFACE STORM DRAINAGE SYSTEM OR OTHER FACILITIES.
- NO PERSON SHALL CAUSE THE IMPEDIMENT OF STORMWATER FLOW IN THE CURB AND GUTTER OR DITCH EXCEPT WITH APPROVED SEDIMENT CONTROL MEASURES.
 - OWNER/DEVELOPER AND THEIR AGENTS SHALL COMPLY WITH THE "COLORADO WATER QUALITY CONTROL ACT" (TITLE 25, ARTICLE 8, CRS), AND THE "CLEAN WATER ACT" (33 USC 1344), IN ADDITION TO THE REQUIREMENTS OF THE LAND DEVELOPMENT CODE, DCM VOLUME II AND THE ECM APPENDIX I. ALL APPROPRIATE PERMITS MUST BE OBTAINED BY THE CONTRACTOR PRIOR TO CONSTRUCTION (1041, NPDES, FLOODPLAIN, 404, FUGITIVE DUST, ETC.). IN THE EVENT OF CONFLICTS BETWEEN THESE REQUIREMENTS AND OTHER LAWS, RULES, OR REGULATIONS OF OTHER FEDERAL, STATE, LOCAL, OR COUNTY AGENCIES, THE MOST RESTRICTIVE LAWS, RULES, OR REGULATIONS SHALL APPLY.
 - ALL CONSTRUCTION TRAFFIC MUST ENTER/EXIT THE SITE ONLY AT APPROVED CONSTRUCTION ACCESS POINTS.
 - PRIOR TO CONSTRUCTION THE PERMITTEE SHALL VERIFY THE LOCATION OF EXISTING UTILITIES.
 - A WATER SOURCE SHALL BE AVAILABLE ON-SITE DURING EARTHWORK OPERATIONS AND SHALL BE UTILIZED AS REQUIRED TO MINIMIZE DUST FROM EARTHWORK EQUIPMENT AND WIND.
 - THE SOILS REPORT FOR THIS SITE HAS BEEN PREPARED BY PICKERING, COLE & HIVNER, LLC. DATED SEPTEMBER 27TH, 2016 AND SHALL BE CONSIDERED A PART OF THESE PLANS.
 - AT LEAST TEN (10) DAYS PRIOR TO THE ANTICIPATED START OF CONSTRUCTION, FOR PROJECTS THAT WILL DISTURB ONE (1) ACRE OR MORE, THE OWNER OR OPERATOR OF CONSTRUCTION ACTIVITY SHALL SUBMIT A PERMIT APPLICATION FORSTORMWATER DISCHARGE TO THE COLORADO DEPARTMENT OF PUBLIC HEALTH AND ENVIRONMENT, WATER QUALITYDIVISION. THE APPLICATION CONTAINS CERTIFICATION OF COMPLETION OF A STORMWATER MANAGEMENT PLAN(SWMP), OF WHICH THIS GRADING AND EROSION CONTROL PLAN MAY BE A PART. FOR INFORMATION OR APPLICATION MATERIALS CONTACT:

COLORADO DEPARTMENT OF PUBLIC HEALTH AND ENVIRONMENT
WATER QUALITY CONTROL DIVISION
WQCD – PERMITS
4300 CHERRY CREEK DRIVE SOUTH
DENVER, CO 80246-1530
ATTN: PERMITS UNIT

ABBREVIATIONS

@	AT	LT	LEFT
AB	ABANDONED	MEG	MATCH EXISTING GRADE
AHJ	AUTHORITIES HAVING JURISDICTION	MH	MANHOLE
APPROX	APPROXIMATE	MTR	METER
ASCE	AMERICAN SOCIETY OF CIVIL ENGINEERS	NTS	NOT TO SCALE
BC	BACK OF CURB	OC	ON CENTER
BCR	BACK OF CURB RADIUS	OH, OHP	OVERHEAD, OVERHEAD POWER
BM	BENCHMARK	OHU	OVERHEAD UTILITIES
BOT	BOTTOM	PB	PULL BOX
BP	BURIED POWER	PC	POINT OF CURVATURE
BT	BURIED TELEPHONE	PIP	PROTECT IN PLACE
BW	BOTTOM OF WALL	PL	PROPERTY LINE
C&G	CURB & GUTTER	PP	POWER POLE
CATV, TV	CABLE TELEVISION	PRC	POINT OF REVERSE CURVE
CI	CAST IRON	PT	POINT OF TANGENCY
CIPP	CURED IN PLACE PIPE	PVC	POLYVINYL CHLORIDE PIPE
CL	CENTERLINE	RCP	REINFORCED CONCRETE PIPE
CMP	CORRUGATED METAL PIPE	RIM	RIM OF MANHOLE LID OR GRATE
CO	CLEANOUT	ROW	RIGHT OF WAY
D, DIA	DIAMETER	SF	SQUARE FOOT, SQUARE FEET
DG	DECOMPOSED GRANITE	SP	SPECIAL PROVISIONS
DI	DUCTILE IRON	SS	SANITARY SEWER
DIP	DUCTILE IRON PIPE	SSMH	SANITARY SEWER MANHOLE
DOM	DOMESTIC WATER	ST	STORM DRAIN
DW	DRIVEWAY	STA	STATION
DWG	DRAWING	STCB	STORM CATCH BASIN
EG	EXISTING GRADE	STCI	STORM CURB INLET
ELEC, E	ELECTRIC	STD	STANDARD
EL, ELEV	ELEVATION	STMH	STORM MANHOLE
EOP, EP	EDGE OF PAVEMENT	STYD	STORM YARD DRAIN
ESCP	EROSION AND SEDIMENT CONTROL PLAN	SW	SIDEWALK
EX	EXISTING	SWPPP	STORMWATER POLLUTION PREVENTION PLAN
FC	FACE OF CURB	SY	SQUARE YARD
FG	FINISHED GRADE	T, TEL	TELEPHONE
FH, HYD	FIRE HYDRANT	TA	TOP OF ASPHALT
FL	FLOW LINE	TBC	TOP BACK OF CURB
FT	FOOT, FEET	TC	TOP OF CONCRETE
G	GAS	TEMP	TEMPORARY
GM	GAS METER	TRANS	TRANSITION
GV	GAS VALVE	TW	TOP OF WALL
GW	GUY WIRE	TYP	TYPICAL
HP	HIGH PRESSURE	VCP	VITRIFIED CLAY PIPE
IE	INVERT ELEVATION	WM	WATER MAIN
INT	INTERSECTION	WV	WATER VALVE
IRR	IRRIGATION	W/	WITH
L	LENGTH	Δ	DELTA
LF	LINEAL FOOT, LINEAR FEET		
LS	LANDSCAPING		

NOT FOR CONSTRUCTION - PRELIMINARY DESIGN

Cushing
Terrell

cushingterrell.com
800.757.9522

Tires LES SCHWAB

7105 OLD MERIDIAN RD.
FALCON, CO

LES SCHWAB TIRE CENTER




© 2021 | ALL RIGHTS RESERVED

SITE DEVELOPEMENT
PLANS

04.16.2021
DRAWN BY | WALKER
CHECKED BY | GRAHAM
REVISIONS

GESC NOTES

C011

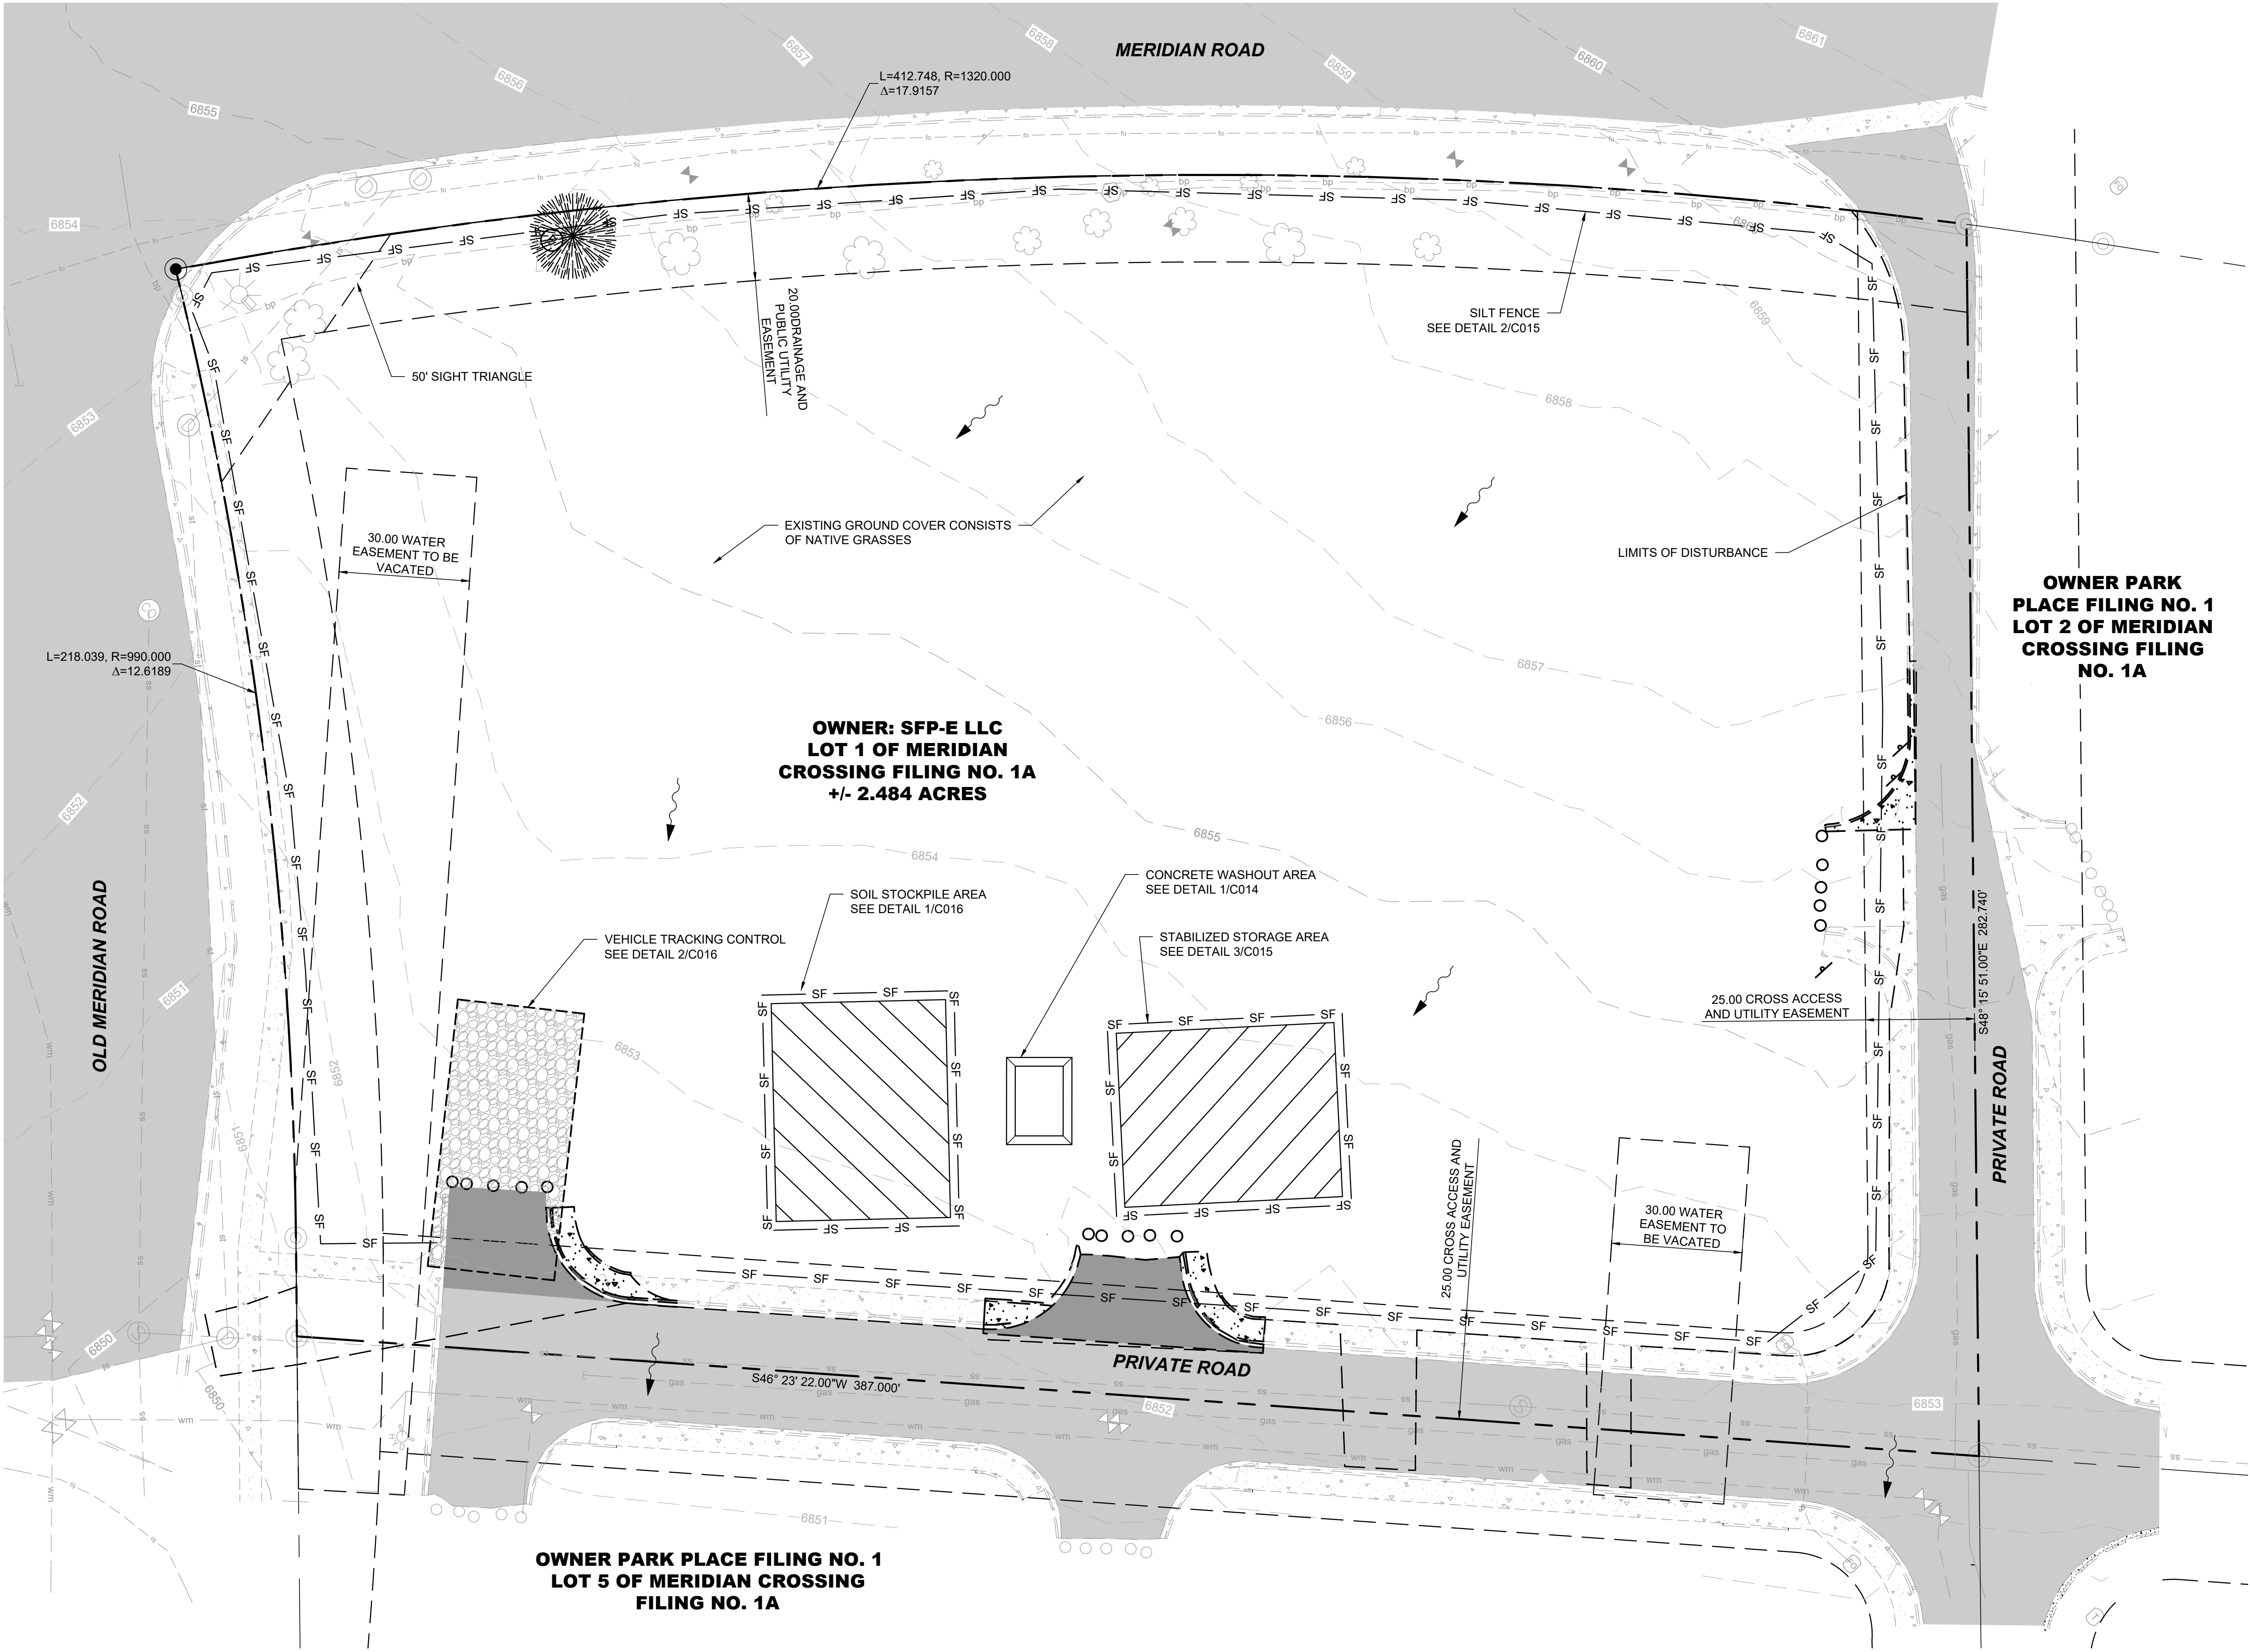

EROSION CONTROL PLAN LEGEND

- FLOW ARROW
- LIMITS OF DISTURBANCE
- SILT FENCE
- CONSTRUCTION ENTRANCE
- ROCK SOCK
- INLET PROTECTION
- SOIL STOCKPILE
- CONCRETE WASHOUT

GESC NOTES

1. THE PROJECT SITE FALLS OUTSIDE FEMA DESIGNATED FLOODPLAIN AND IS DESIGNATED ZONE X AREA OF MINIMAL FLOOD HAZARD

Cushing
Terrell

cushingterrell.com
800.757.9522

Tires LES SCHWAB

NOT FOR CONSTRUCTION - PRELIMINARY DESIGN

7105 OLD MERIDIAN RD.
FALCON, CO
LES SCHWAB TIRE CENTER




© 2021 | ALL RIGHTS RESERVED

SITE DEVELOPMENT
PLANS

04.16.2021
DRAWN BY | WALLKER
CHECKED BY | GRAHAM
REVISIONS

INITIAL GESC PLAN

C012

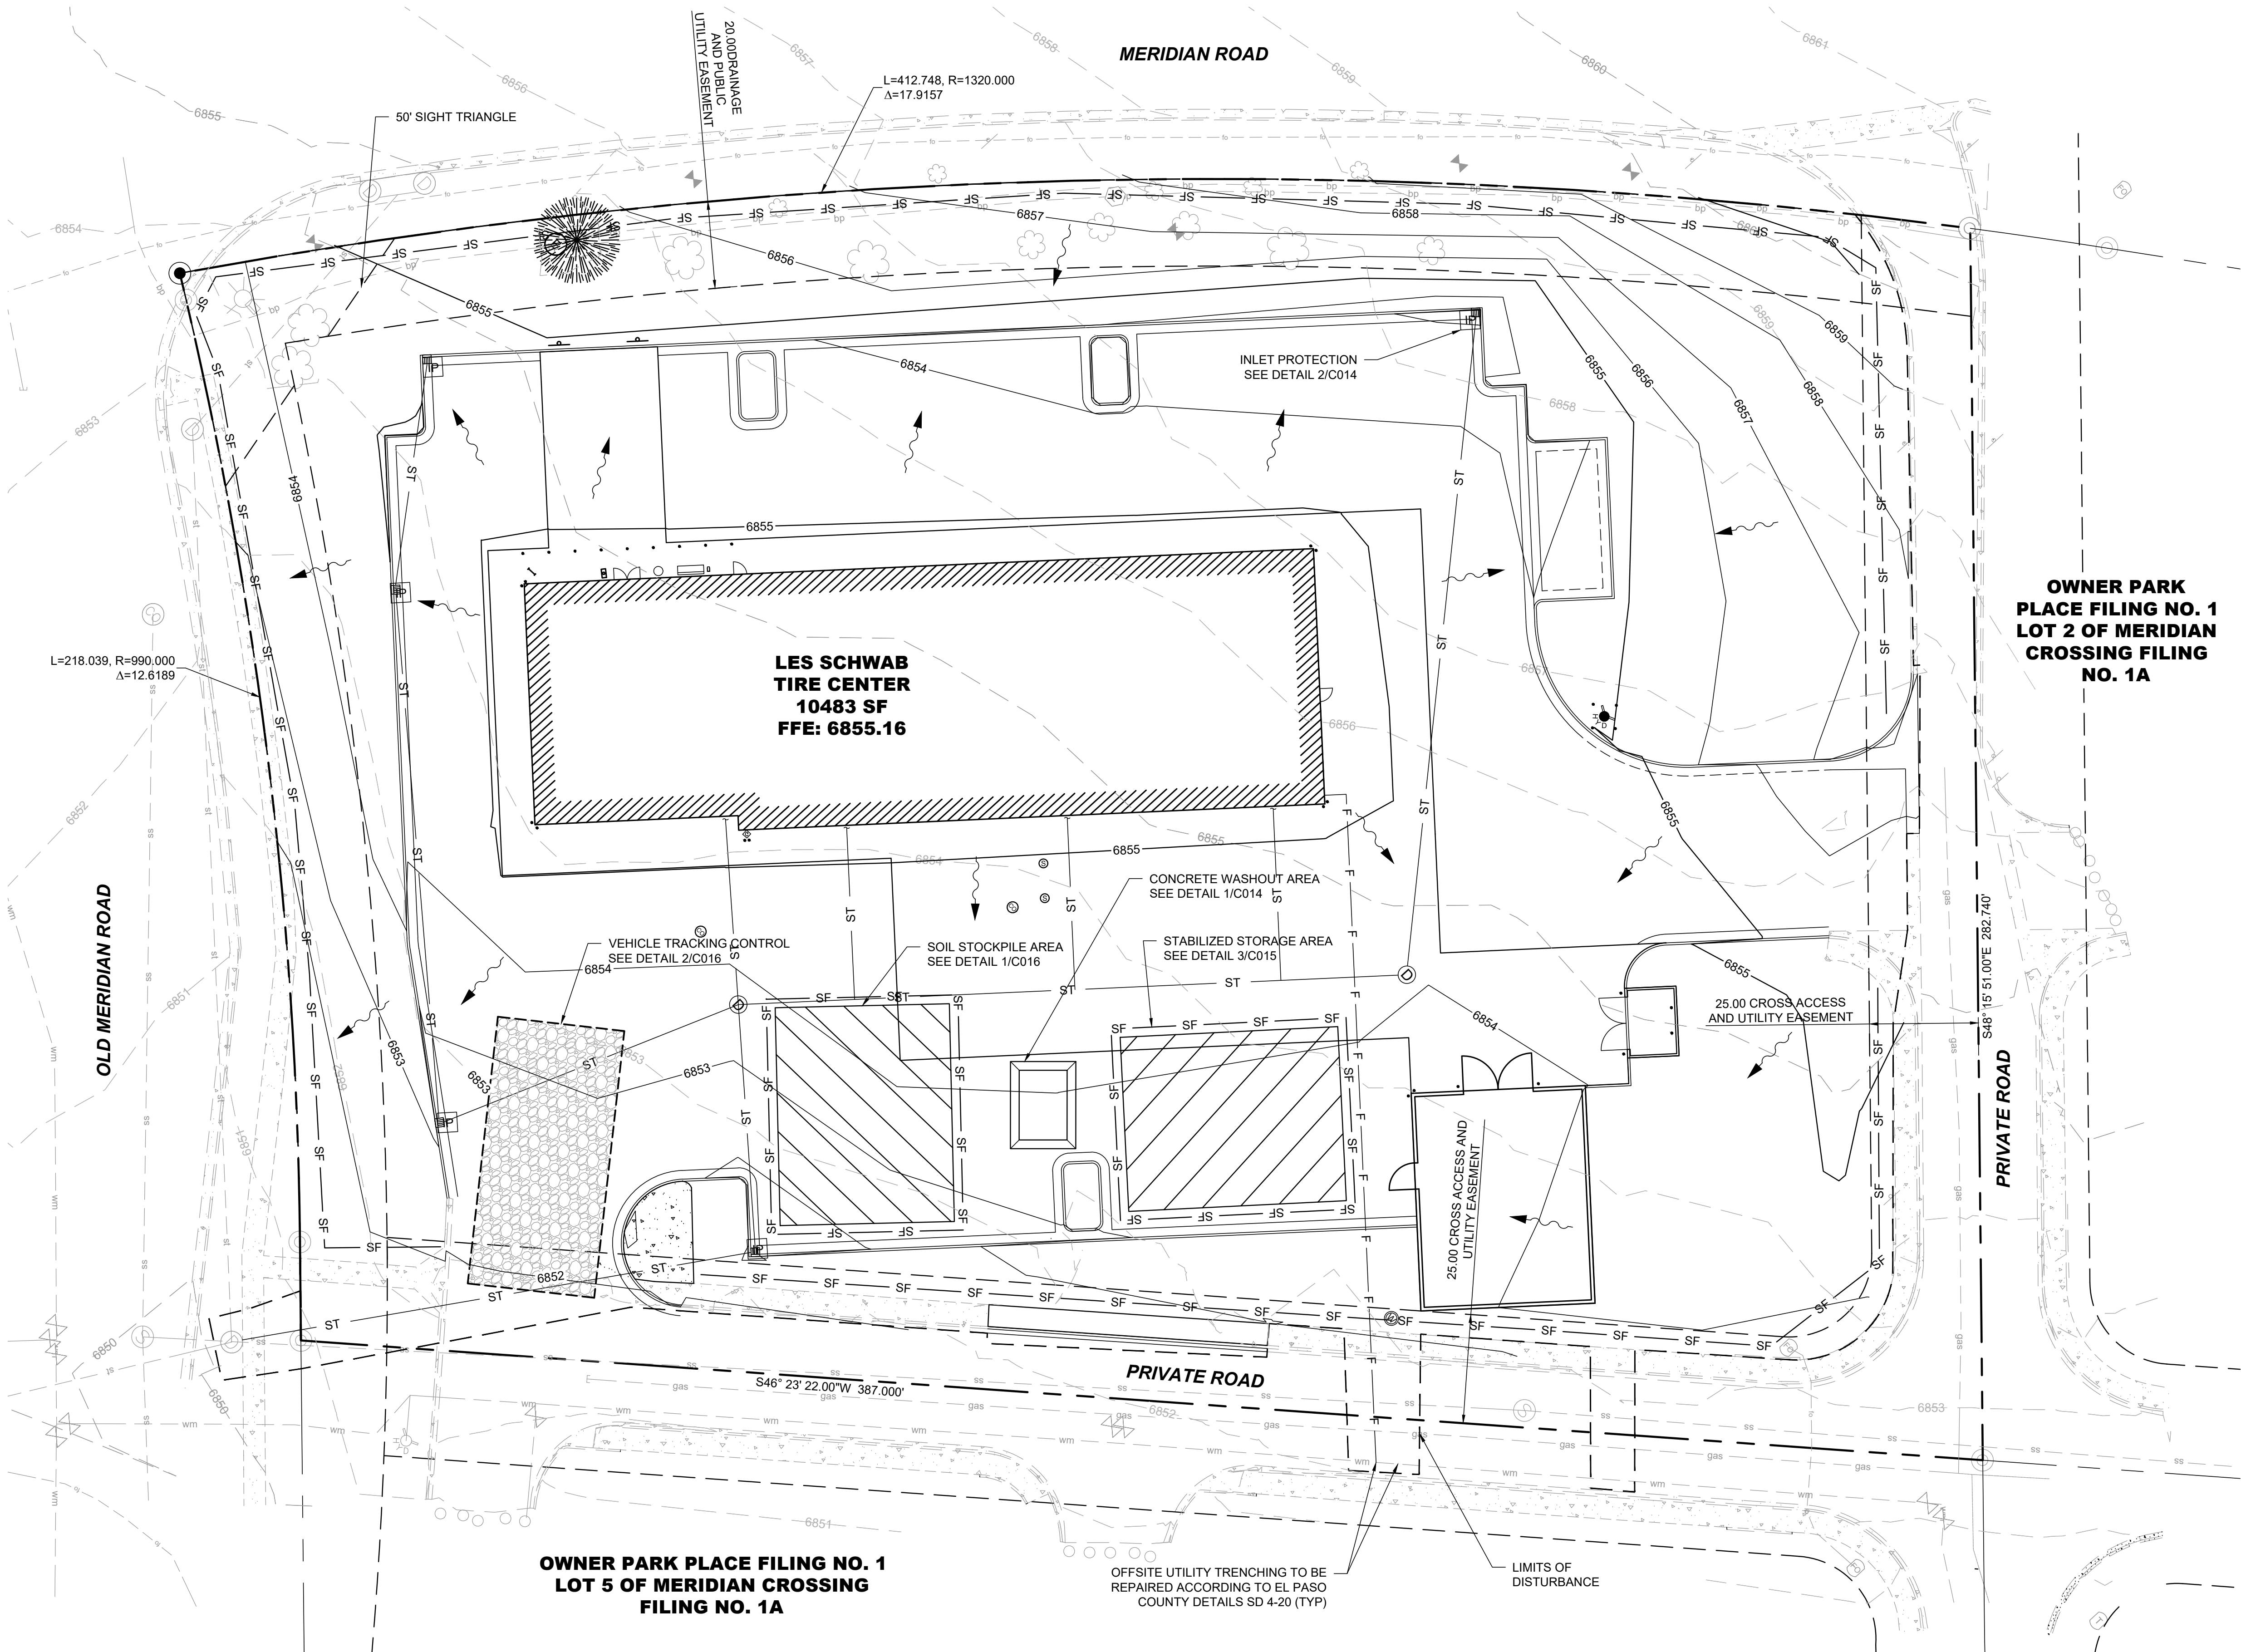

EROSION CONTROL PLAN LEGEND

- FLOW ARROW
- LIMITS OF DISTURBANCE
- SILT FENCE
- CONSTRUCTION ENTRANCE
- ROCK SOCK
- INLET PROTECTION
- SOIL STOCKPILE
- CONCRETE WASHOUT


GESC NOTES

1. THE PROJECT SITE FALLS OUTSIDE FEMA DESIGNATED FLOODPLAIN AND IS DESIGNATED ZONE X AREA OF MINIMAL FLOOD HAZARD

OWNER PARK
PLACE FILING NO. 1
LOT 2 OF MERIDIAN
CROSSING FILING
NO. 1A

OWNER PARK PLACE FILING NO. 1
LOT 5 OF MERIDIAN CROSSING
FILING NO. 1A

1
C012 INTERIM / FINAL GESC PLAN

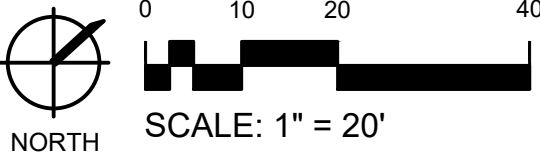

Cushing Terrell

cushingterrell.com
800.757.9522

Tires LES SCHWAB

NOT FOR CONSTRUCTION - PRELIMINARY DESIGN

7105 OLD MERIDIAN RD.
FALCON, CO
LES SCHWAB TIRE CENTER



© 2021 | ALL RIGHTS RESERVED


SITE DEVELOPMENT
PLANS

04.16.2021
DRAWN BY | WALLKER
CHECKED BY | GRAHAM
REVISIONS

INTERIM / FINAL
GESC PLAN

C013

Concrete Washout Area (CWA) MM-1

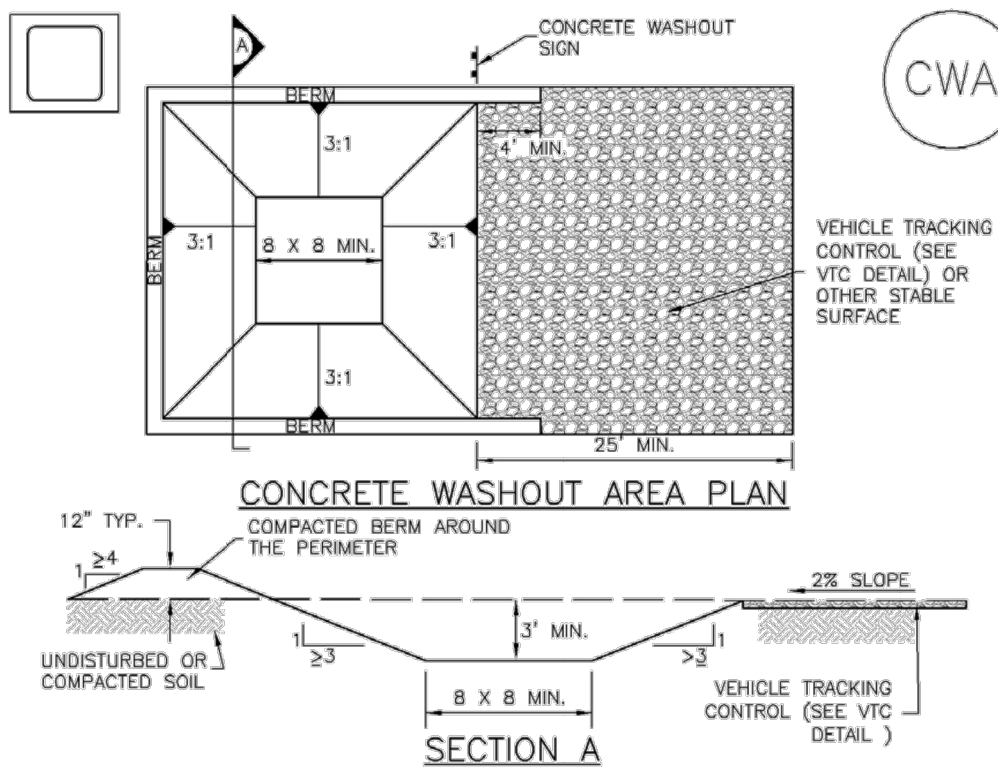

- CWA-1. CONCRETE WASHOUT AREA**
- CWA INSTALLATION NOTES**
- SEE PLAN VIEW FOR:
-CWA INSTALLATION LOCATION.
 - DO NOT LOCATE AN UNLINED CWA WITHIN 400' OF ANY NATURAL DRAINAGE PATHWAY OR WATERBODY. DO NOT LOCATE WITHIN 1,000' OF ANY WELLS OR DRINKING WATER SOURCES. IF SITE CONSTRAINTS MAKE THIS INFEASIBLE, OR IF HIGHLY PERMEABLE SOILS EXIST ON SITE, THE CWA MUST BE INSTALLED WITH AN IMPERMEABLE LINER (18 MIL MIN. THICKNESS) OR SURFACE STORAGE ALTERNATIVES USING PREFABRICATED CONCRETE WASHOUT DEVICES OR A LINED ABOVE GROUND STORAGE ARE SHOULD BE USED.
 - THE CWA SHALL BE INSTALLED PRIOR TO CONCRETE PLACEMENT ON SITE.
 - CWA SHALL INCLUDE A FLAT SUBSURFACE PIT THAT IS AT LEAST 8' BY 8' SLOPES LEADING OUT OF THE SUBSURFACE PIT SHALL BE 3:1 OR FLATTER. THE PIT SHALL BE AT LEAST 3' DEEP.
 - BERM SURROUNDING SIDES AND BACK OF THE CWA SHALL HAVE MINIMUM HEIGHT OF 1'.
 - VEHICLE TRACKING PAD SHALL BE SLOPED 2% TOWARDS THE CWA.
 - SIGNS SHALL BE PLACED AT THE CONSTRUCTION ENTRANCE, AT THE CWA, AND ELSEWHERE AS NECESSARY TO CLEARLY INDICATE THE LOCATION OF THE CWA TO OPERATORS OF CONCRETE TRUCKS AND PUMP RIGS.
 - USE EXCAVATED MATERIAL FOR PERIMETER BERM CONSTRUCTION.


November 2010 Urban Drainage and Flood Control District CWA-3
Urban Storm Drainage Criteria Manual Volume 3

Concrete Washout Area (CWA) MM-1

- CWA MAINTENANCE NOTES**
- INSPECT BMPs EACH WORKDAY, AND MAINTAIN THEM IN EFFECTIVE OPERATING CONDITION. MAINTENANCE OF BMPs SHOULD BE PROACTIVE, NOT REACTIVE. INSPECT BMPs AS SOON AS POSSIBLE (AND ALWAYS WITHIN 24 HOURS) FOLLOWING A STORM THAT CAUSES SURFACE EROSION, AND PERFORM NECESSARY MAINTENANCE.
 - FREQUENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN BMPs IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.
 - WHERE BMPs HAVE FAILED, REPAIR OR REPLACEMENT SHOULD BE INITIATED UPON DISCOVERY OF THE FAILURE.
 - THE CWA SHALL BE REPAIRED, CLEANED, OR ENLARGED AS NECESSARY TO MAINTAIN CAPACITY FOR CONCRETE WASTE. CONCRETE MATERIALS, ACCUMULATED IN PIT, SHALL BE REMOVED ONCE THE MATERIALS HAVE REACHED A DEPTH OF 2'.
 - CONCRETE WASHOUT WATER, WASTED PIECES OF CONCRETE AND ALL OTHER DEBRIS IN THE SUBSURFACE PIT SHALL BE TRANSPORTED FROM THE JOB SITE IN A WATER-TIGHT CONTAINER AND DISPOSED OF PROPERLY.
 - THE CWA SHALL REMAIN IN PLACE UNTIL ALL CONCRETE FOR THE PROJECT IS PLACED.
 - WHEN THE CWA IS REMOVED, COVER THE DISTURBED AREA WITH TOP SOIL, SEED AND MULCH OR OTHERWISE STABILIZED IN A MANNER APPROVED BY THE LOCAL JURISDICTION.
- (DETAIL ADAPTED FROM DOUGLAS COUNTY, COLORADO AND THE CITY OF PARKER, COLORADO, NOT AVAILABLE IN AUTOCAD)
- NOTE:** MANY JURISDICTIONS HAVE BMP DETAILS THAT VARY FROM UDFCD STANDARD DETAILS. CONSULT WITH LOCAL JURISDICTIONS AS TO WHICH DETAIL SHOULD BE USED WHEN DIFFERENCES ARE NOTED.


CWA-4 Urban Drainage and Flood Control District November 2010
Urban Storm Drainage Criteria Manual Volume 3

Inlet Protection (IP) SC-6

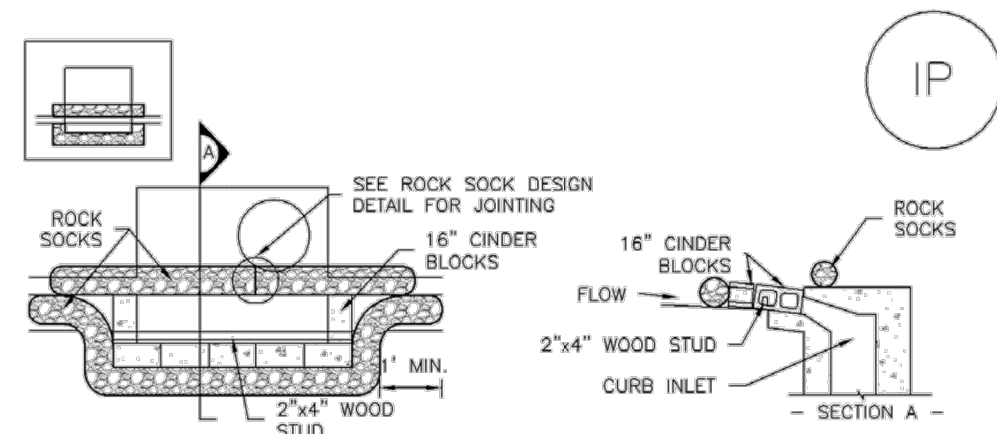

IP-1. BLOCK AND ROCK SOCK SUMP OR ON GRADE INLET PROTECTION

- BLOCK AND CURB SOCK INLET PROTECTION INSTALLATION NOTES**
- SEE ROCK SOCK DESIGN DETAIL FOR INSTALLATION REQUIREMENTS.
 - CONCRETE "CINDER" BLOCKS SHALL BE LAID ON THEIR SIDES AROUND THE INLET IN A SINGLE ROW, ABUTTING ONE ANOTHER WITH THE OPEN END FACING AWAY FROM THE CURB.
 - GRAVEL BAGS SHALL BE PLACED AROUND CONCRETE BLOCKS, CLOSELY ABUTTING ONE ANOTHER AND JOINED TOGETHER IN ACCORDANCE WITH ROCK SOCK DESIGN DETAIL.

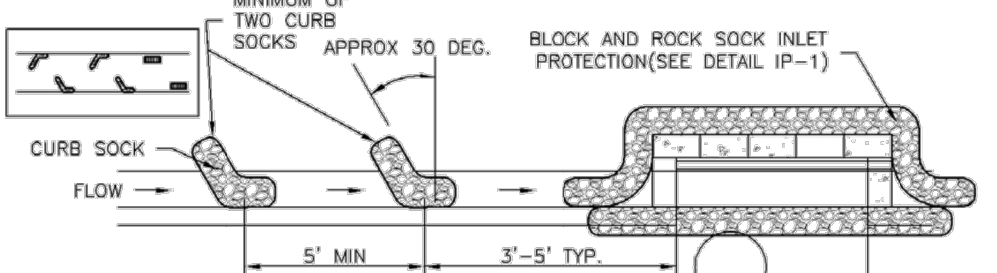


IP-2. CURB ROCK SOCKS UPSTREAM OF INLET PROTECTION

- CURB ROCK SOCK INLET PROTECTION INSTALLATION NOTES**
- SEE ROCK SOCK DESIGN DETAIL INSTALLATION REQUIREMENTS.
 - PLACEMENT OF THE SOCK SHALL BE APPROXIMATELY 30 DEGREES FROM PERPENDICULAR IN THE OPPOSITE DIRECTION OF FLOW.
 - SOCKS ARE TO BE FLUSH WITH THE CURB AND SPACED A MINIMUM OF 5 FEET APART.
 - AT LEAST TWO CURB SOCKS IN SERIES ARE REQUIRED UPSTREAM OF ON-GRADE INLETS.


IP-4 Urban Drainage and Flood Control District August 2013
Urban Storm Drainage Criteria Manual Volume 3

Inlet Protection (IP) SC-6

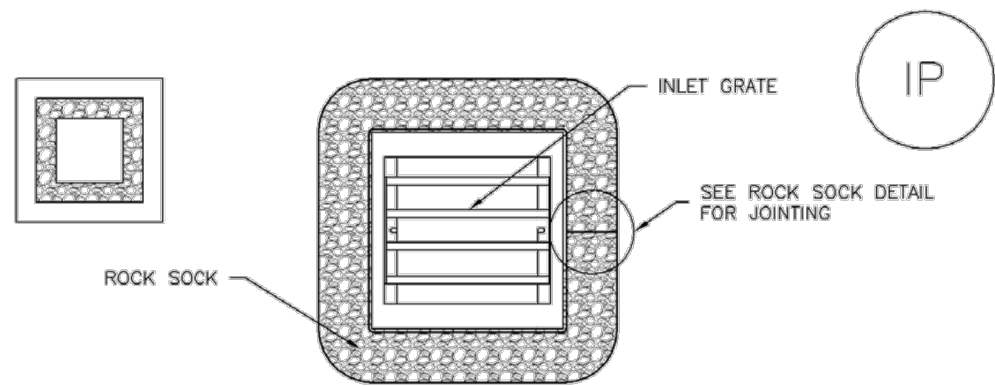

IP-3. ROCK SOCK SUMP/AREA INLET PROTECTION

- ROCK SOCK SUMP/AREA INLET PROTECTION INSTALLATION NOTES**
- SEE ROCK SOCK DESIGN DETAIL FOR INSTALLATION REQUIREMENTS.
 - STRAW WATTLES/SEDIMENT CONTROL LOGS MAY BE USED IN PLACE OF ROCK SOCKS FOR INLETS IN PERVIOUS AREAS. INSTALL PER SEDIMENT CONTROL LOG DETAIL.

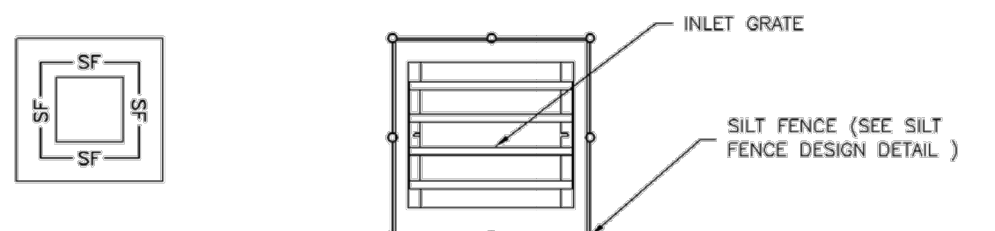


IP-4. SILT FENCE FOR SUMP INLET PROTECTION

- SILT FENCE INLET PROTECTION INSTALLATION NOTES**
- SEE SILT FENCE DESIGN DETAIL FOR INSTALLATION REQUIREMENTS.
 - POSTS SHALL BE PLACED AT EACH CORNER OF THE INLET AND AROUND THE EDGES AT A MAXIMUM SPACING OF 3 FEET.
 - STRAW WATTLES/SEDIMENT CONTROL LOGS MAY BE USED IN PLACE OF SILT FENCE FOR INLETS IN PERVIOUS AREAS. INSTALL PER SEDIMENT CONTROL LOG DETAIL.


August 2013 Urban Drainage and Flood Control District IP-5
Urban Storm Drainage Criteria Manual Volume 3

Inlet Protection (IP) SC-6

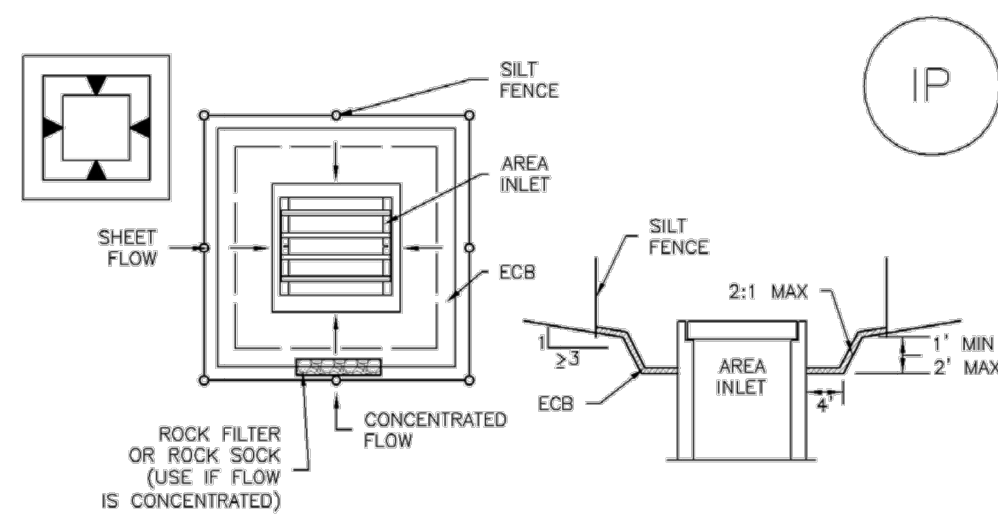

IP-5. OVEREXCAVATION INLET PROTECTION

- OVEREXCAVATION INLET PROTECTION INSTALLATION NOTES**
- THIS FORM OF INLET PROTECTION IS PRIMARILY APPLICABLE FOR SITES THAT HAVE NOT YET REACHED FINAL GRADE AND SHOULD BE USED ONLY FOR INLETS WITH A RELATIVELY SMALL CONTRIBUTING DRAINAGE AREA.
 - WHEN USING FOR CONCENTRATED FLOWS, SHAPE BASIN IN 2:1 RATIO WITH LENGTH ORIENTED TOWARDS DIRECTION OF FLOW.
 - SEDIMENT MUST BE PERIODICALLY REMOVED FROM THE OVEREXCAVATED AREA.

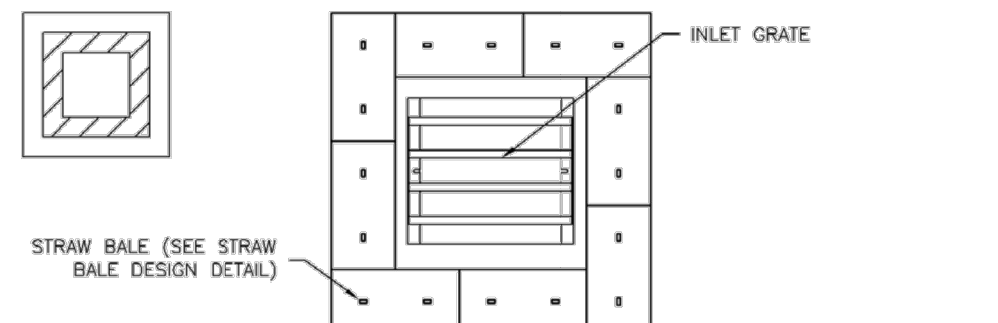


IP-6. STRAW BALE FOR SUMP INLET PROTECTION

- STRAW BALE BARRIER INLET PROTECTION INSTALLATION NOTES**
- SEE STRAW BALE DESIGN DETAIL FOR INSTALLATION REQUIREMENTS.
 - BALES SHALL BE PLACED IN A SINGLE ROW AROUND THE INLET WITH ENDS OF BALES TIGHTLY ABUTTING ONE ANOTHER.

IP-6 Urban Drainage and Flood Control District August 2013
Urban Storm Drainage Criteria Manual Volume 3

Inlet Protection (IP) SC-6

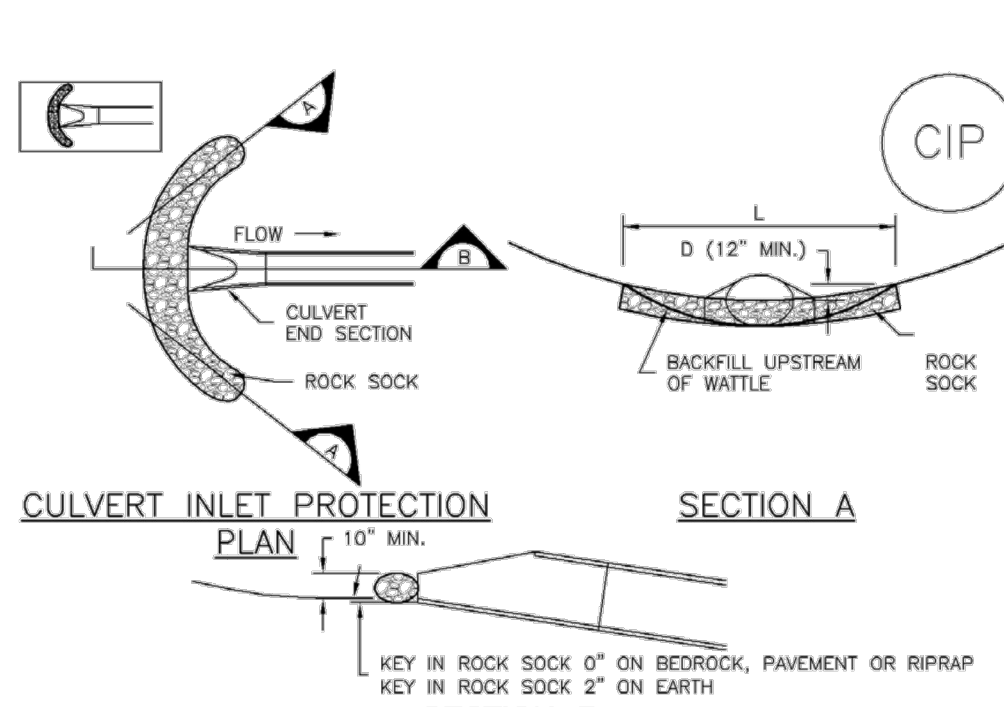

CIP-1. CULVERT INLET PROTECTION

- CULVERT INLET PROTECTION INSTALLATION NOTES**
- SEE PLAN VIEW FOR:
-LOCATION OF CULVERT INLET PROTECTION.
 - SEE ROCK SOCK DESIGN DETAIL FOR ROCK GRADATION REQUIREMENTS AND JOINING DETAIL.
- CULVERT INLET PROTECTION MAINTENANCE NOTES**
- INSPECT BMPs EACH WORKDAY, AND MAINTAIN THEM IN EFFECTIVE OPERATING CONDITION. MAINTENANCE OF BMPs SHOULD BE PROACTIVE, NOT REACTIVE. INSPECT BMPs AS SOON AS POSSIBLE (AND ALWAYS WITHIN 24 HOURS) FOLLOWING A STORM THAT CAUSES SURFACE EROSION, AND PERFORM NECESSARY MAINTENANCE.
 - FREQUENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN BMPs IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.
 - WHERE BMPs HAVE FAILED, REPAIR OR REPLACEMENT SHOULD BE INITIATED UPON DISCOVERY OF THE FAILURE.
 - SEDIMENT ACCUMULATED UPSTREAM OF THE CULVERT SHALL BE REMOVED WHEN THE SEDIMENT DEPTH IS 1/2 THE HEIGHT OF THE ROCK SOCK.
 - CULVERT INLET PROTECTION SHALL REMAIN IN PLACE UNTIL THE UPSTREAM DISTURBED AREA IS PERMANENTLY STABILIZED AND APPROVED BY THE LOCAL JURISDICTION.
- (DETAILS ADAPTED FROM AURORA, COLORADO, NOT AVAILABLE IN AUTOCAD)
- NOTE:** MANY JURISDICTIONS HAVE BMP DETAILS THAT VARY FROM UDFCD STANDARD DETAILS. CONSULT WITH LOCAL JURISDICTIONS AS TO WHICH DETAIL SHOULD BE USED WHEN DIFFERENCES ARE NOTED.

August 2013 Urban Drainage and Flood Control District IP-7
Urban Storm Drainage Criteria Manual Volume 3

Inlet Protection (IP) SC-6

- GENERAL INLET PROTECTION INSTALLATION NOTES**
- SEE PLAN VIEW FOR:
-LOCATION OF INLET PROTECTION.
-TYPE OF INLET PROTECTION (IP-1, IP-2, IP-3, IP-4, IP-5, IP-6)
 - INLET PROTECTION SHALL BE INSTALLED PROMPTLY AFTER INLET CONSTRUCTION OR PAVING IS COMPLETE (TYPICALLY WITHIN 48 HOURS). IF A RAINFALL/RUNOFF EVENT IS FORECAST, INSTALL INLET PROTECTION PRIOR TO ONSET OF EVENT.
 - MANY JURISDICTIONS HAVE BMP DETAILS THAT VARY FROM UDFCD STANDARD DETAILS. CONSULT WITH LOCAL JURISDICTIONS AS TO WHICH DETAIL SHOULD BE USED WHEN DIFFERENCES ARE NOTED.

- INLET PROTECTION MAINTENANCE NOTES**
- INSPECT BMPs EACH WORKDAY, AND MAINTAIN THEM IN EFFECTIVE OPERATING CONDITION. MAINTENANCE OF BMPs SHOULD BE PROACTIVE, NOT REACTIVE. INSPECT BMPs AS SOON AS POSSIBLE (AND ALWAYS WITHIN 24 HOURS) FOLLOWING A STORM THAT CAUSES SURFACE EROSION, AND PERFORM NECESSARY MAINTENANCE.
 - FREQUENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN BMPs IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.
 - WHERE BMPs HAVE FAILED, REPAIR OR REPLACEMENT SHOULD BE INITIATED UPON DISCOVERY OF THE FAILURE.
 - SEDIMENT ACCUMULATED UPSTREAM OF INLET PROTECTION SHALL BE REMOVED AS NECESSARY TO MAINTAIN BMP EFFECTIVENESS. TYPICALLY WHEN STORAGE VOLUME REACHES 50% OF CAPACITY, A DEPTH OF 6" WHEN SILT FENCE IS USED, OR 1/4 OF THE HEIGHT FOR STRAW BALES.
 - INLET PROTECTION IS TO REMAIN IN PLACE UNTIL THE UPSTREAM DISTURBED AREA IS PERMANENTLY STABILIZED, UNLESS THE LOCAL JURISDICTION APPROVES EARLIER REMOVAL OF INLET PROTECTION IN STREETS.
 - WHEN INLET PROTECTION AT AREA INLETS IS REMOVED, THE DISTURBED AREA SHALL BE COVERED WITH TOP SOIL, SEEDED AND MULCHED, OR OTHERWISE STABILIZED IN A MANNER APPROVED BY THE LOCAL JURISDICTION.
- (DETAIL ADAPTED FROM TOWN OF PARKER, COLORADO AND CITY OF AURORA, COLORADO, NOT AVAILABLE IN AUTOCAD)
- NOTE:** THE DETAILS INCLUDED WITH THIS FACT SHEET SHOW COMMONLY USED, CONVENTIONAL METHODS OF INLET PROTECTION IN THE DENVER METROPOLITAN AREA. THERE ARE MANY PROPRIETARY INLET PROTECTION METHODS ON THE MARKET. UDFCD NEITHER ENDORSES NOR DISCOURAGES USE OF PROPRIETARY INLET PROTECTION; HOWEVER, IN THE EVENT PROPRIETARY METHODS ARE USED, THE APPROPRIATE DETAIL FROM THE MANUFACTURER MUST BE INCLUDED IN THE SWMP AND THE BMP MUST BE INSTALLED AND MAINTAINED AS SHOWN IN THE MANUFACTURER'S DETAILS.
- NOTE:** SOME MUNICIPALITIES DISCOURAGE OR PROHIBIT THE USE OF STRAW BALES FOR INLET PROTECTION. CHECK WITH LOCAL JURISDICTION TO DETERMINE IF STRAW BALE INLET PROTECTION IS ACCEPTABLE.

IP-8 Urban Drainage and Flood Control District August 2013
Urban Storm Drainage Criteria Manual Volume 3

INLET PROTECTION (CONT.)

Cushing Terrell

cushingterrell.com
800.757.9522

Tires LES SCHWAB

7105 OLD MERIDIAN RD.
FALCON, CO



© 2021 | ALL RIGHTS RESERVED

SITE DEVELOPEMENT
PLANS


04.16.2021
DRAWN BY | WALKER
CHECKED BY | GRAHAM
REVISIONS

GESC
DETAILS

C014

Stockpile Management (SP)

MM-2

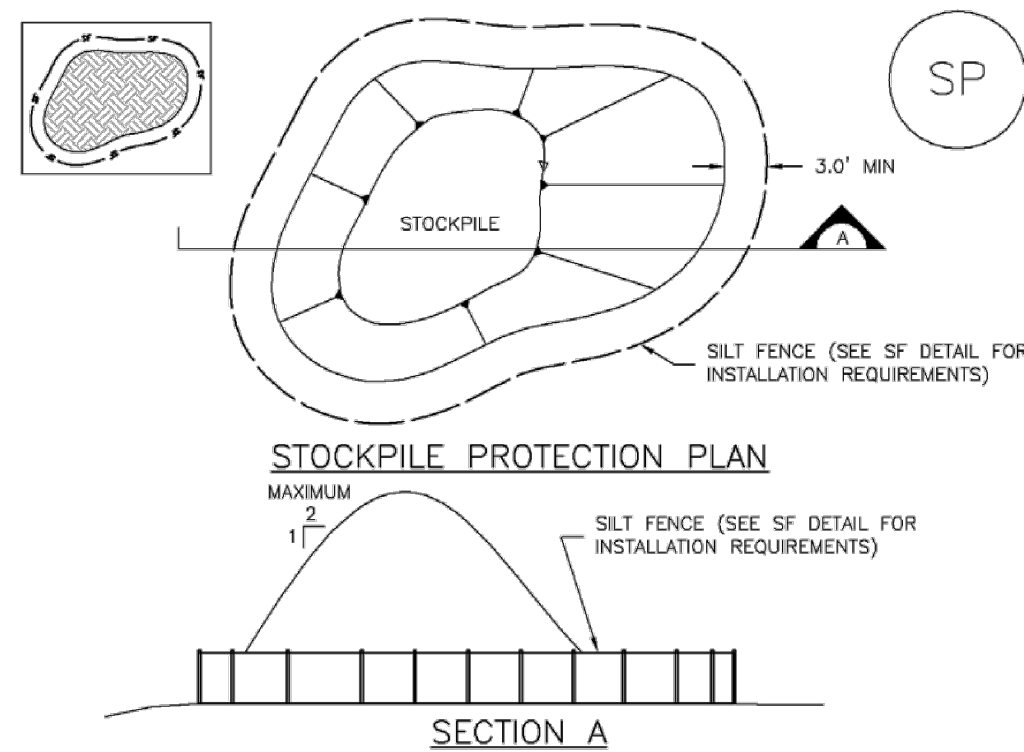

SP-1. STOCKPILE PROTECTION

STOCKPILE PROTECTION INSTALLATION NOTES

1. SEE PLAN VIEW FOR:
 - LOCATION OF STOCKPILES
 - TYPE OF STOCKPILE PROTECTION
2. INSTALL PERIMETER CONTROLS IN ACCORDANCE WITH THEIR RESPECTIVE DESIGN DETAILS. SILT FENCE IS SHOWN IN THE STOCKPILE PROTECTION DETAILS; HOWEVER, OTHER TYPES OF PERIMETER CONTROLS INCLUDING SEDIMENT CONTROL LOGS OR ROCK SOCKS MAY BE SUITABLE IN SOME CIRCUMSTANCES. CONSIDERATIONS FOR DETERMINING THE APPROPRIATE TYPE OF PERIMETER CONTROL FOR A STOCKPILE INCLUDE WHETHER THE STOCKPILE IS LOCATED ON A PERVIOUS OR IMPVIOUS SURFACE, THE RELATIVE HEIGHTS OF THE PERIMETER CONTROL AND STOCKPILE, THE ABILITY OF THE PERIMETER CONTROL TO CONTAIN THE STOCKPILE WITHOUT FAILING IN THE EVENT THAT MATERIAL FROM THE STOCKPILE SHIFTS OR SLIPS AGAINST THE PERIMETER, AND OTHER FACTORS.
3. STABILIZE THE STOCKPILE SURFACE WITH SURFACE ROUGHENING, TEMPORARY SEEDING AND MULCHING, EROSION CONTROL BLANKETS, OR SOIL BINDERS. SOILS STOCKPILED FOR AN EXTENDED PERIOD (TYPICALLY FOR MORE THAN 60 DAYS) SHOULD BE SEED AND MULCHED WITH A TEMPORARY GRASS COVER ONCE THE STOCKPILE IS PLACED (TYPICALLY WITHIN 14 DAYS). USE OF MULCH ONLY OR A SOIL BINDER IS ACCEPTABLE IF THE STOCKPILE WILL BE IN PLACE FOR A MORE LIMITED TIME PERIOD (TYPICALLY 30-60 DAYS).
4. FOR TEMPORARY STOCKPILES ON THE INTERIOR PORTION OF A CONSTRUCTION SITE, WHERE OTHER DOWNDRIFT CONTROLS, INCLUDING PERIMETER CONTROL, ARE IN PLACE, STOCKPILE PERIMETER CONTROLS MAY NOT BE REQUIRED.

November 2010 Urban Drainage and Flood Control District SP-3
Urban Storm Drainage Criteria Manual Volume 3

MM-2

Stockpile Management (SM)

STOCKPILE PROTECTION MAINTENANCE NOTES

1. INSPECT BMPs EACH WORKDAY, AND MAINTAIN THEM IN EFFECTIVE OPERATING CONDITION. MAINTENANCE OF BMPs SHOULD BE PROACTIVE, NOT REACTIVE. INSPECT BMPs AS SOON AS POSSIBLE (AND ALWAYS WITHIN 24 HOURS) FOLLOWING A STORM THAT CAUSES SURFACE EROSION, AND PERFORM NECESSARY MAINTENANCE.
2. FREQUENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN BMPs IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.
3. WHERE BMPs HAVE FAILED, REPAIR OR REPLACEMENT SHOULD BE INITIATED UPON DISCOVERY OF THE FAILURE.
4. IF PERIMETER PROTECTION MUST BE MOVED TO ACCESS SOIL STOCKPILE, REPLACE PERIMETER CONTROLS BY THE END OF THE WORKDAY.
5. STOCKPILE PERIMETER CONTROLS CAN BE REMOVED ONCE ALL THE MATERIAL FROM THE STOCKPILE HAS BEEN USED.


(DETAILS ADAPTED FROM PARKER, COLORADO, NOT AVAILABLE IN AUTOCAD)

NOTE: MANY JURISDICTIONS HAVE BMP DETAILS THAT VARY FROM UDFCD STANDARD DETAILS. CONSULT WITH LOCAL JURISDICTIONS AS TO WHICH DETAIL SHOULD BE USED WHEN DIFFERENCES ARE NOTED.

SP-4 Urban Drainage and Flood Control District November 2010
Urban Storm Drainage Criteria Manual Volume 3

Stockpile Management (SP)

MM-2

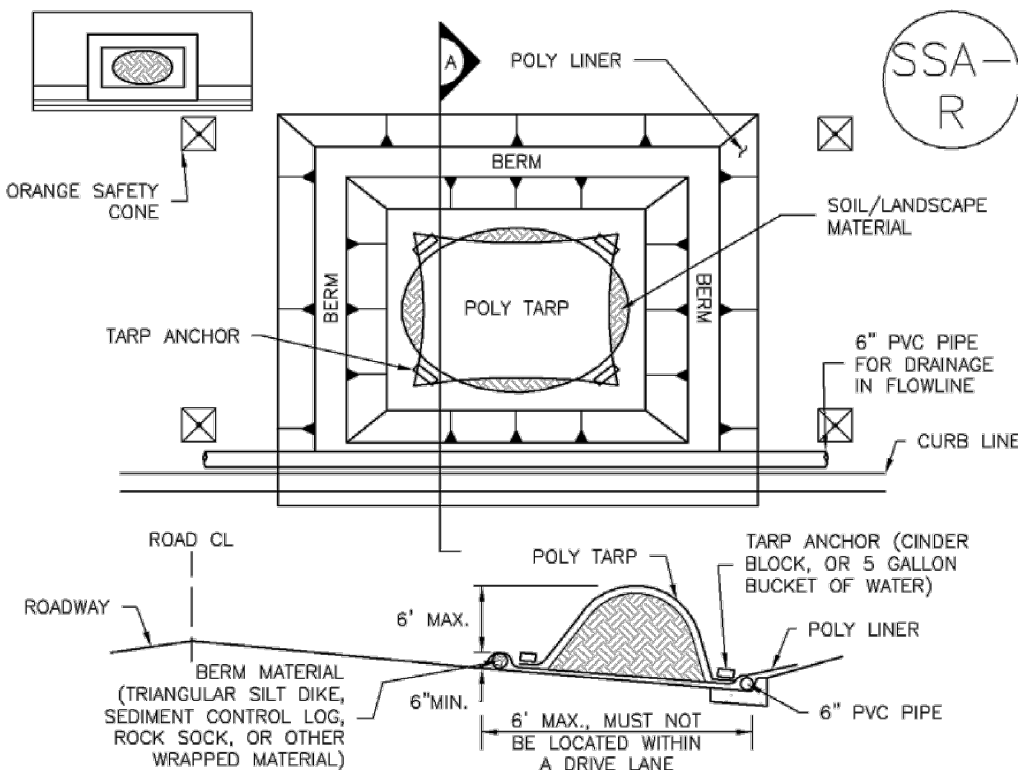

SP-2. MATERIALS STAGING IN ROADWAY

MATERIALS STAGING IN ROADWAYS INSTALLATION NOTES

1. SEE PLAN VIEW FOR:
 - LOCATION OF MATERIAL STAGING AREA(S).
 - CONTRACTOR MAY ADJUST LOCATION AND SIZE OF STAGING AREA WITH APPROVAL FROM THE LOCAL JURISDICTION.
2. FEATURE MUST BE INSTALLED PRIOR TO EXCAVATION, EARTHWORK OR DELIVERY OF MATERIALS.
3. MATERIALS MUST BE STATIONED ON THE POLY LINER. ANY INCIDENTAL MATERIALS DEPOSITED ON PAVED SECTION OR ALONG CURB LINE MUST BE CLEANED UP PROMPTLY.
4. POLY LINER AND TARP COVER SHOULD BE OF SIGNIFICANT THICKNESS TO PREVENT DAMAGE OR LOSS OF INTEGRITY.
5. SAND BAGS MAY BE SUBSTITUTED TO ANCHOR THE COVER TARP OR PROVIDE BERMING UNDER THE BASE LINER.
6. FEATURE IS NOT INTENDED FOR USE WITH WET MATERIAL THAT WILL BE DRAINING AND/OR SPREADING OUT ON THE POLY LINER OR FOR DEMOLITION MATERIALS.
7. THIS FEATURE CAN BE USED FOR:
 - UTILITY REPAIRS.
 - WHEN OTHER STAGING LOCATIONS AND OPTIONS ARE LIMITED.
 - OTHER LIMITED APPLICATION AND SHORT DURATION STAGING.

November 2010 Urban Drainage and Flood Control District SP-5
Urban Storm Drainage Criteria Manual Volume 3

MM-2

Stockpile Management (SM)

MATERIALS STAGING IN ROADWAY MAINTENANCE NOTES

1. INSPECT BMPs EACH WORKDAY, AND MAINTAIN THEM IN EFFECTIVE OPERATING CONDITION. MAINTENANCE OF BMPs SHOULD BE PROACTIVE, NOT REACTIVE. INSPECT BMPs AS SOON AS POSSIBLE (AND ALWAYS WITHIN 24 HOURS) FOLLOWING A STORM THAT CAUSES SURFACE EROSION, AND PERFORM NECESSARY MAINTENANCE.
2. FREQUENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN BMPs IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.
3. WHERE BMPs HAVE FAILED, REPAIR OR REPLACEMENT SHOULD BE INITIATED UPON DISCOVERY OF THE FAILURE.
4. INSPECT PVC PIPE ALONG CURB LINE FOR CLOGGING AND DEBRIS. REMOVE OBSTRUCTIONS PROMPTLY.
5. CLEAN MATERIAL FROM PAVED SURFACES BY SWEEPING OR VACUUMING.

(DETAILS ADAPTED FROM AURORA, COLORADO)


NOTE: MANY JURISDICTIONS HAVE BMP DETAILS THAT VARY FROM UDFCD STANDARD DETAILS. CONSULT WITH LOCAL JURISDICTIONS AS TO WHICH DETAIL SHOULD BE USED WHEN DIFFERENCES ARE NOTED.

SP-6 Urban Drainage and Flood Control District November 2010
Urban Storm Drainage Criteria Manual Volume 3

1 STOCKPILE AREA

Vehicle Tracking Control (VTC)

SM-4

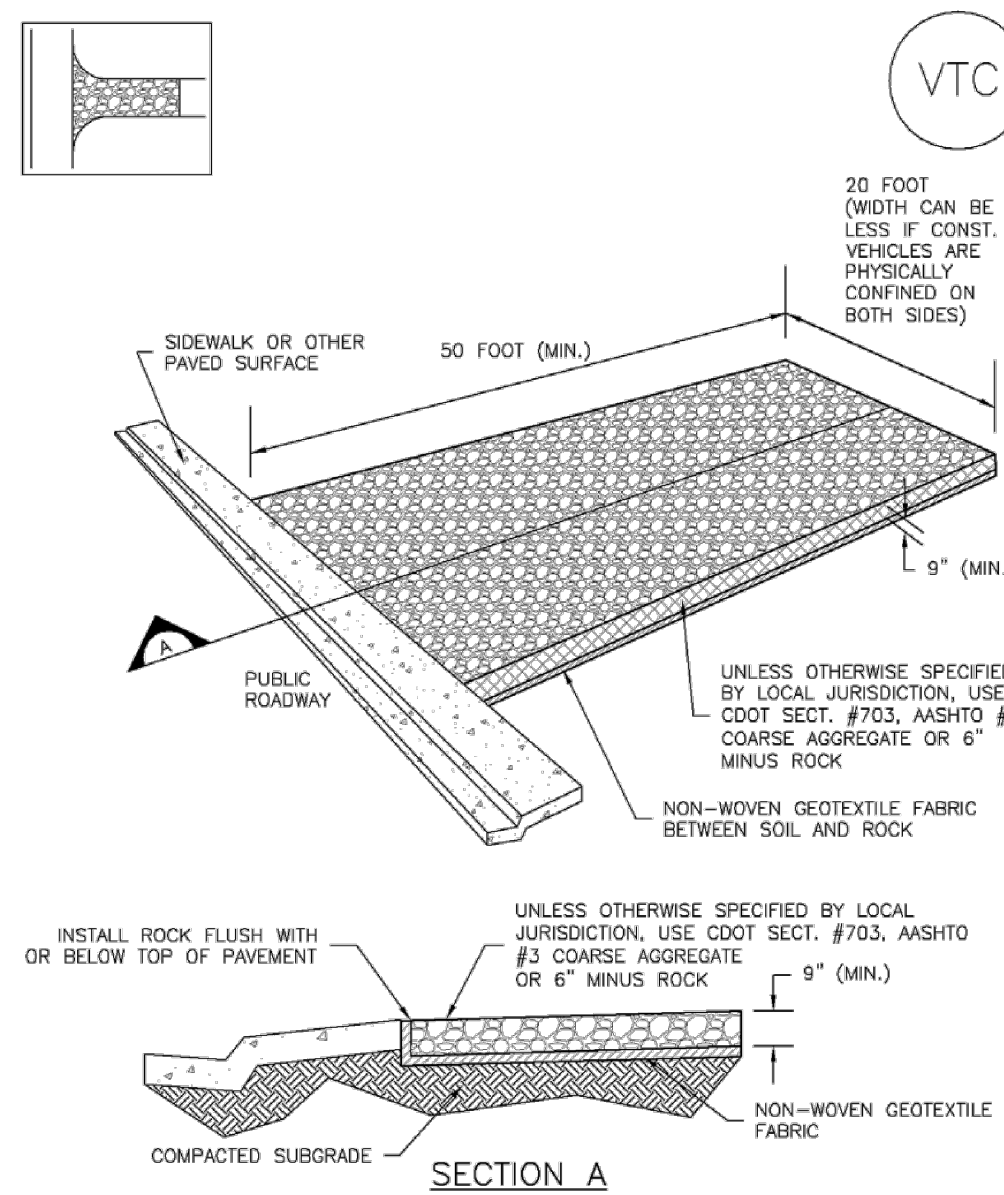


VTC-1. AGGREGATE VEHICLE TRACKING CONTROL

November 2010 Urban Drainage and Flood Control District VTC-3
Urban Storm Drainage Criteria Manual Volume 3

SM-4

Vehicle Tracking Control (VTC)

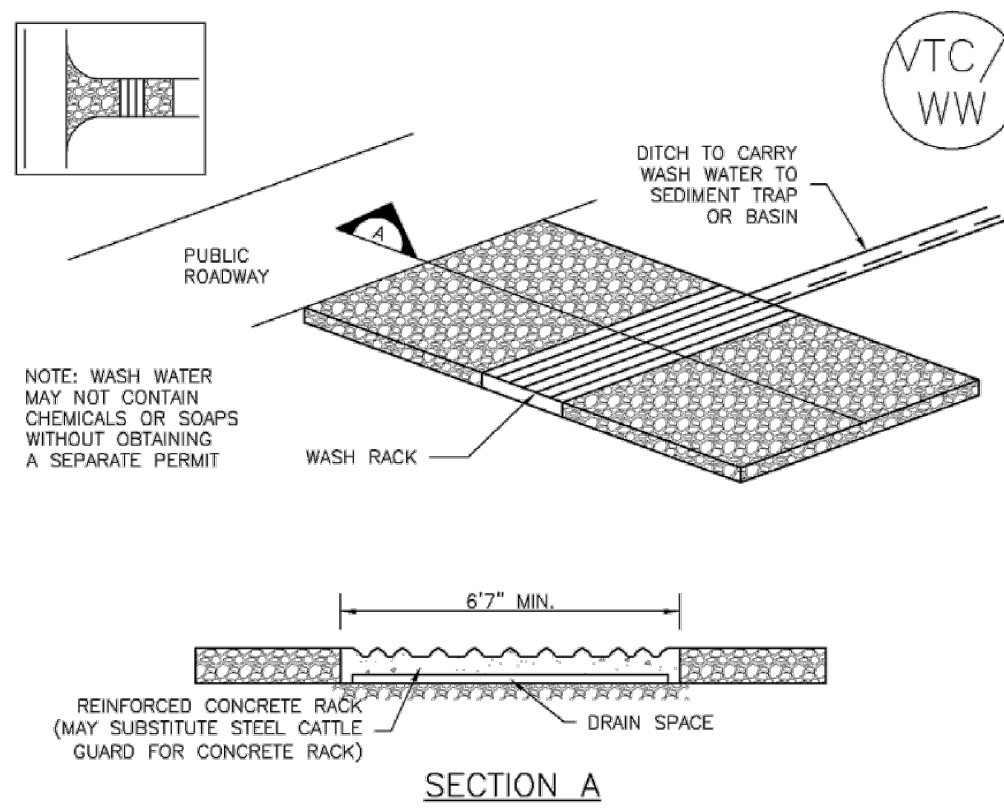


VTC-2. AGGREGATE VEHICLE TRACKING CONTROL WITH WASH RACK

VTC-4 Urban Drainage and Flood Control District November 2010
Urban Storm Drainage Criteria Manual Volume 3

Vehicle Tracking Control (VTC)

SM-4

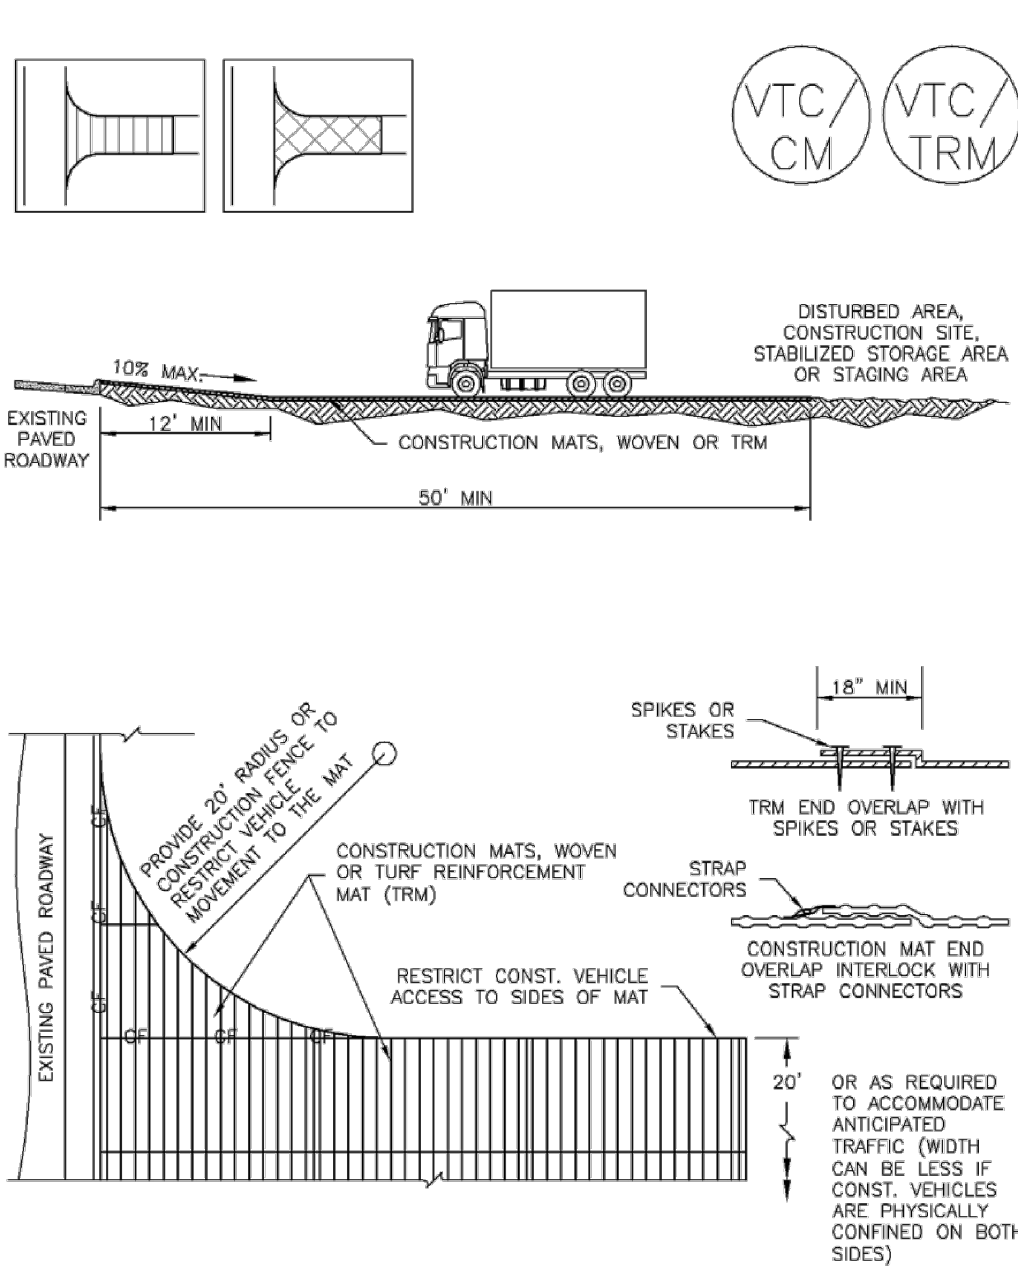

VTC-3. VEHICLE TRACKING CONTROL W/ CONSTRUCTION MAT OR TURF REINFORCEMENT MAT (TRM)

November 2010 Urban Drainage and Flood Control District VTC-5
Urban Storm Drainage Criteria Manual Volume 3

SM-4

Vehicle Tracking Control (VTC)

STABILIZED CONSTRUCTION ENTRANCE/EXIT INSTALLATION NOTES

1. SEE PLAN VIEW FOR:
 - LOCATION OF CONSTRUCTION ENTRANCE(S)/EXIT(S).
 - TYPE OF CONSTRUCTION ENTRANCE(S)/EXIT(S) (WITH/WITHOUT WHEEL WASH, CONSTRUCTION MAT OR TRM).
2. CONSTRUCTION MAT OR TRM STABILIZED CONSTRUCTION ENTRANCES ARE ONLY TO BE USED ON SHORT DURATION PROJECTS (TYPICALLY RANGING FROM A WEEK TO A MONTH) WHERE THERE WILL BE LIMITED VEHICULAR ACCESS.
3. A STABILIZED CONSTRUCTION ENTRANCE/EXIT SHALL BE LOCATED AT ALL ACCESS POINTS WHERE VEHICLES ACCESS THE CONSTRUCTION SITE FROM PAVED RIGHT-OF-WAYS.
4. STABILIZED CONSTRUCTION ENTRANCE/EXIT SHALL BE INSTALLED PRIOR TO ANY LAND DISTURBING ACTIVITIES.
5. A NON-WOVEN GEOTEXTILE FABRIC SHALL BE PLACED UNDER THE STABILIZED CONSTRUCTION ENTRANCE/EXIT PRIOR TO THE PLACEMENT OF ROCK.
6. UNLESS OTHERWISE SPECIFIED BY LOCAL JURISDICTION, ROCK SHALL CONSIST OF DOT SECT. #703, ASHTO #3 COARSE AGGREGATE OR 6" (MINUS) ROCK.

STABILIZED CONSTRUCTION ENTRANCE/EXIT MAINTENANCE NOTES

1. INSPECT BMPs EACH WORKDAY, AND MAINTAIN THEM IN EFFECTIVE OPERATING CONDITION. MAINTENANCE OF BMPs SHOULD BE PROACTIVE, NOT REACTIVE. INSPECT BMPs AS SOON AS POSSIBLE (AND ALWAYS WITHIN 24 HOURS) FOLLOWING A STORM THAT CAUSES SURFACE EROSION, AND PERFORM NECESSARY MAINTENANCE.
2. FREQUENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN BMPs IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.
3. WHERE BMPs HAVE FAILED, REPAIR OR REPLACEMENT SHOULD BE INITIATED UPON DISCOVERY OF THE FAILURE.
4. ROCK SHALL BE REPLACED OR REGRADED AS NECESSARY TO THE STABILIZED ENTRANCE/EXIT TO MAINTAIN A CONSISTENT DEPTH.
5. SEDIMENT TRACKED ONTO PAVED ROADS IS TO BE REMOVED THROUGHOUT THE DAY AND AT THE END OF THE DAY BY SHOVELING OR SWEEPING. SEDIMENT MAY NOT BE WASHED DOWN STORM SEWER DRAINS.

NOTE: MANY JURISDICTIONS HAVE BMP DETAILS THAT VARY FROM UDFCD STANDARD DETAILS. CONSULT WITH LOCAL JURISDICTIONS AS TO WHICH DETAIL SHOULD BE USED WHEN DIFFERENCES ARE NOTED.

(DETAILS ADAPTED FROM CITY OF BROOMFIELD, COLORADO, NOT AVAILABLE IN AUTOCAD)

VTC-6 Urban Drainage and Flood Control District November 2010
Urban Storm Drainage Criteria Manual Volume 3

2 VEHICLE TRACKING CONTROL

Cushing Terrell

cushingterrell.com
800.757.9522

Tires LES SCHWAB

7105 OLD MERIDIAN RD.
FALCON, CO




© 2021 | ALL RIGHTS RESERVED

SITE DEVELOPEMENT
PLANS


04.16.2021
DRAWN BY | WALKER
CHECKED BY | GRAHAM
REVISIONS

GESC
DETAILS


C016

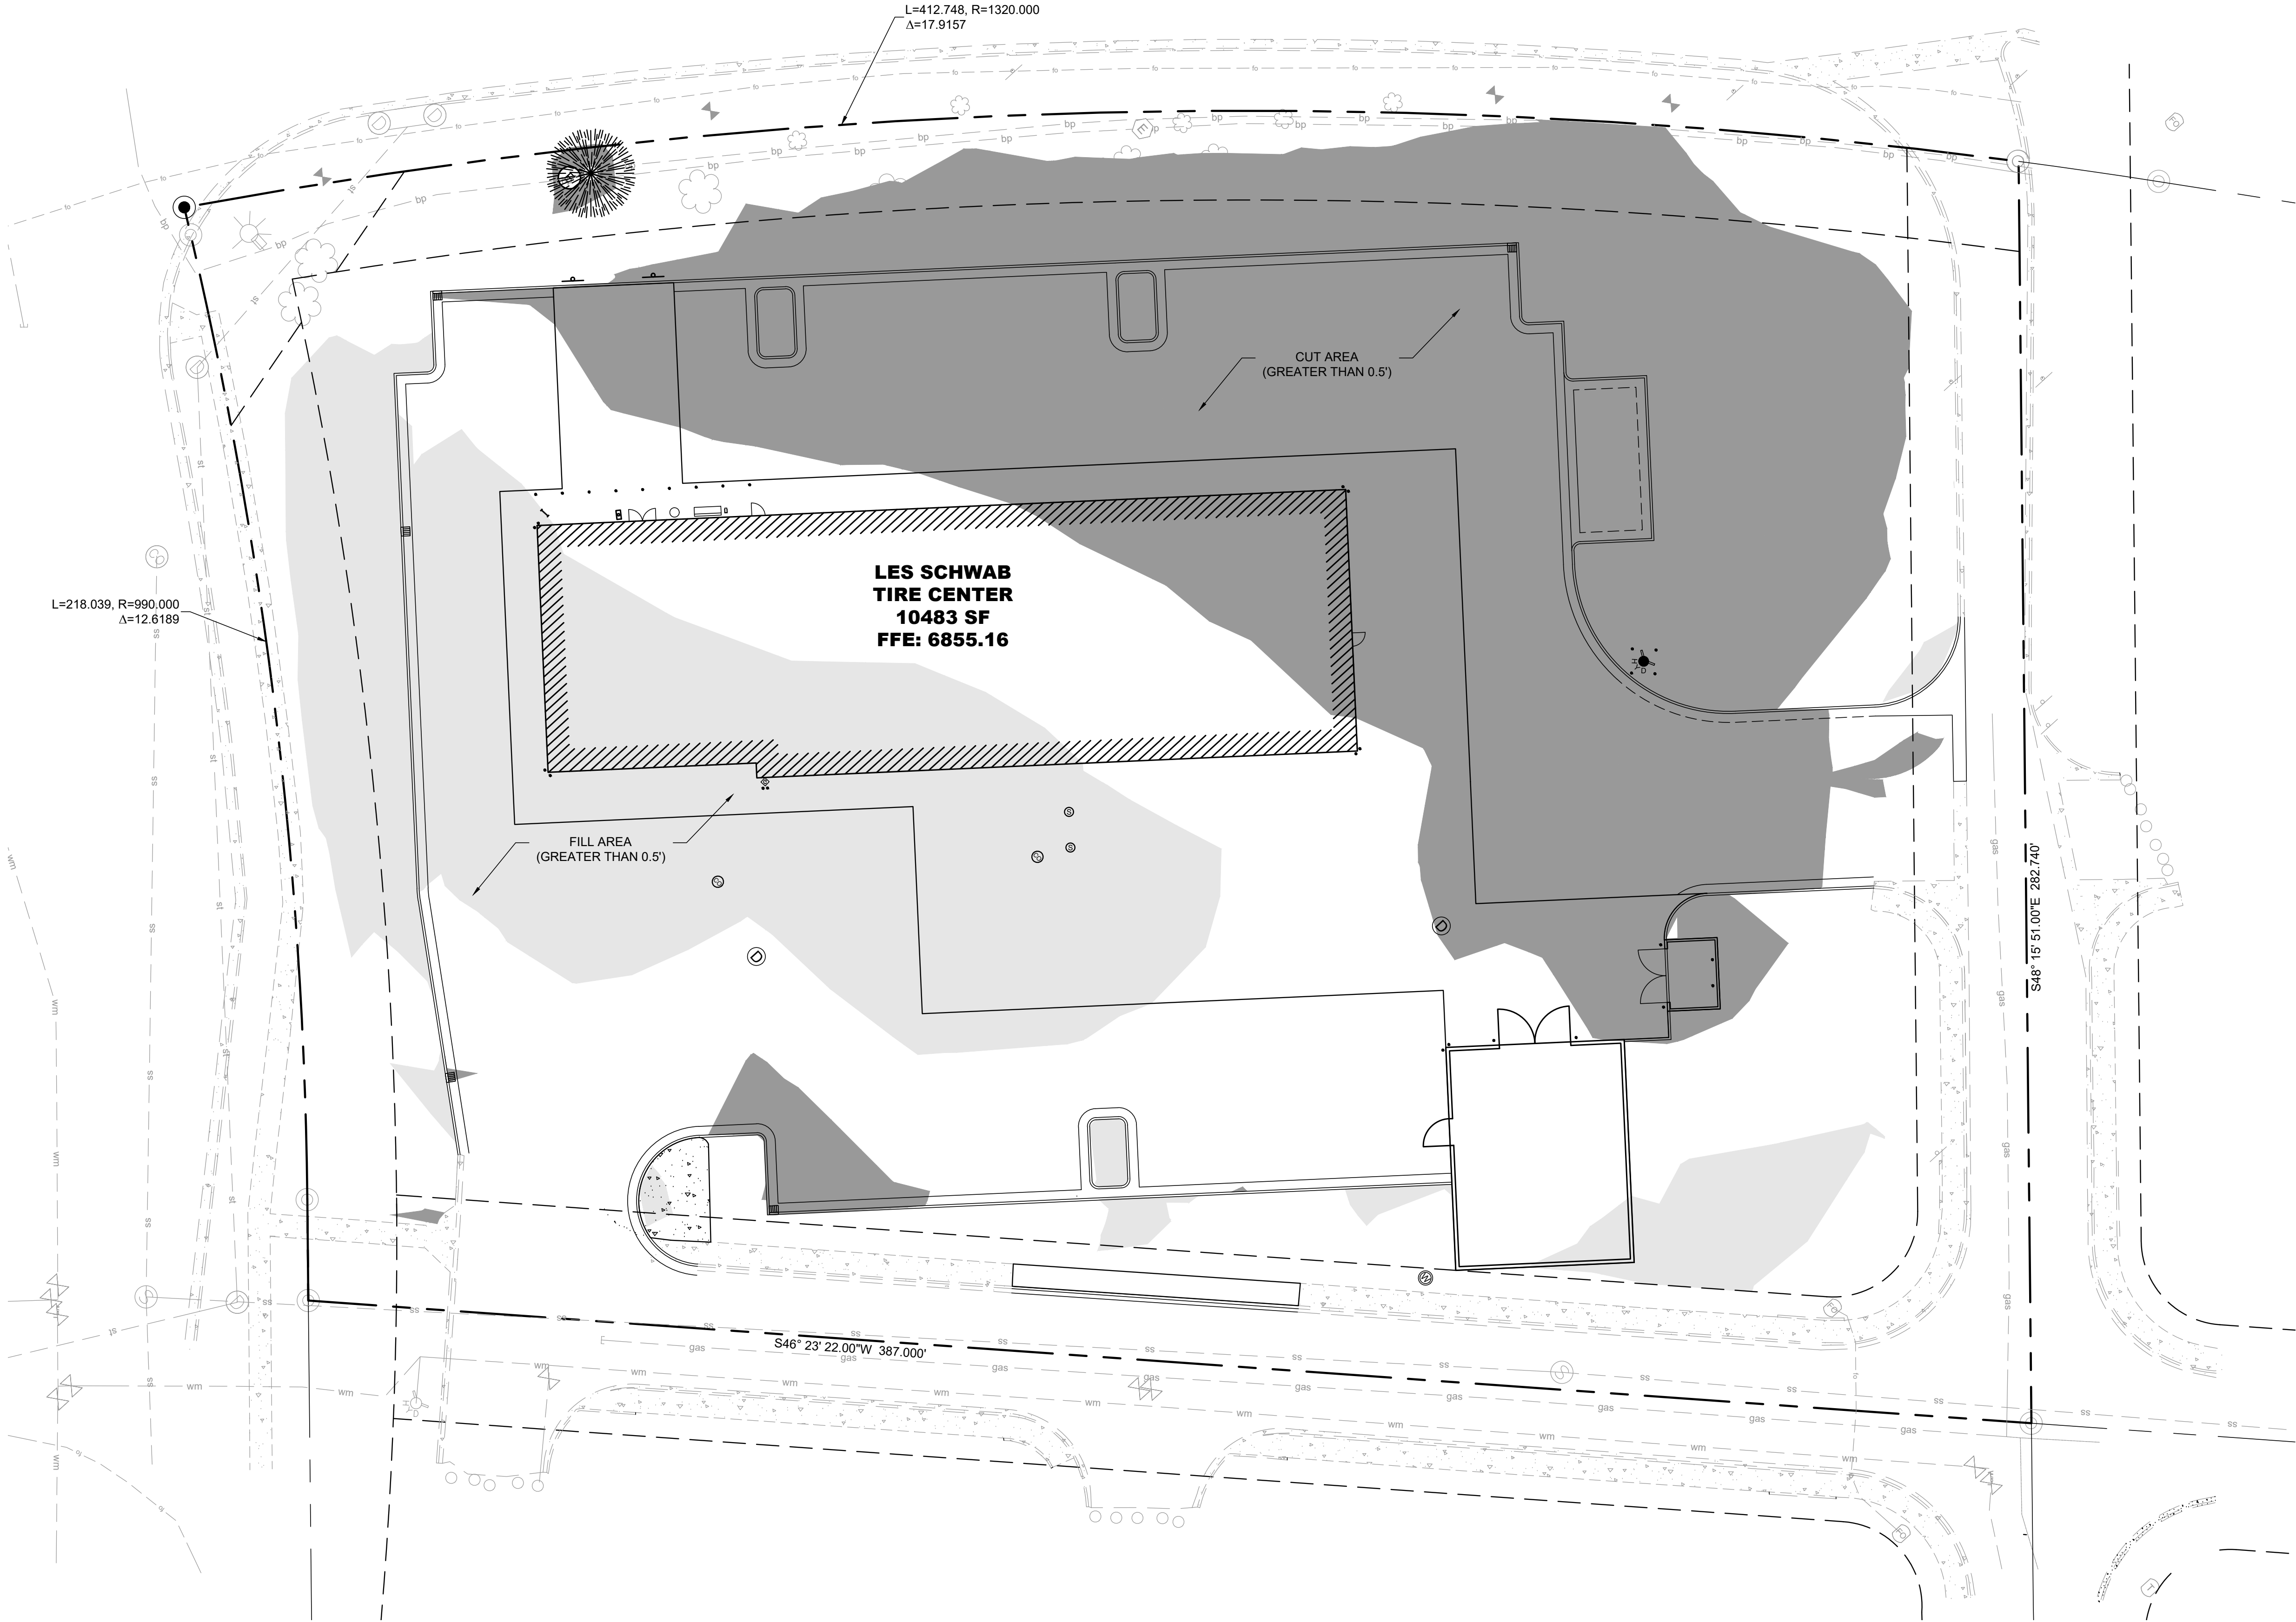

1 CUT FILL GESC EXHIBIT
C017

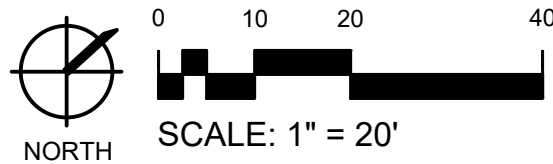

7105 OLD MERIDIAN RD.
FALCON, CO
LES SCHWAB TIRE CENTER

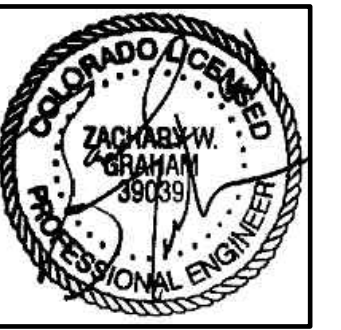

© 2021 | ALL RIGHTS RESERVED

SITE DEVELOPMENT
PLANS

04.16.2021
DRAWN BY | WALLKER
CHECKED BY | GRAHAM
REVISIONS

CUT / FILL GESC
EXHIBIT

C017



Geotechnical Engineering Report

***Proposed Les Schwab Tire Center
NEC of Meridian Road and Rolling Thunder Way
Falcon, Colorado***

Prepared for:

SFP-E, LLC

P.O. Box 5350

Bend, Oregon 97708-5350

Prepared by:

Pickering, Cole & Hivner, LLC

PCH Project No. 12.298.16

September 27, 2016



September 27, 2016

SFP-E, LLC
P.O. Box 5350
Bend, Oregon 97708-5350

Attn: Mr. Matt Hannigan

**Re: Geotechnical Engineering Report
Proposed Les Schwab Tire Center
NEC of Meridian Road and Rolling Thunder Way
Falcon, Colorado
PCH Project No. 12.298.16**

Pickering Cole & Hivner, LLC (PCH) has completed a geotechnical engineering investigation for the proposed Les Schwab Tire Center to be located at the northeast corner of the above-referenced intersection in Falcon, Colorado. This study was performed in general accordance with our proposal number P12.333.16, executed August 10, 2016.

This geotechnical summary should be used in conjunction with the entire report for design and/or construction purposes. It should be recognized that specific details were not included or fully developed in this section, and the report must be read in its entirety for a comprehensive understanding of the items contained herein. The section titled General Comments should be read for an understanding of the report limitations.

- **Subsurface Conditions:** The soils at the site consist of silty to clayey sands, fine to coarse sands, and varying layers of lean clays. Sedimentary claystone bedrock was encountered below the sands/clays at depths ranging from about 13 to 18 feet below existing site grades. The bedrock extended to the depths explored. Groundwater was encountered in our building borings immediately after drilling at depths ranging from about 10 to 15 feet below existing site grades. The shallow pavement borings were dry at that time. When checked about three weeks later, ***groundwater was encountered in the deeper borings at depths ranging from about 4 to 7-½ feet below existing site grades.*** The shallow pavement borings remained dry at that time. Other specific information regarding the lithology encountered is noted on the attached Boring Logs.
- **Shallow Groundwater and Below-Grade Construction:** As discussed, groundwater was encountered at the site at depths ranging from about 4 to 7-½ feet below existing site grades. As currently planned the northeast portion of the building will include below-grade maintenance pits (maximum of about 7 feet below planned FFE). ***We recommend construction be limited to excavation depths as high as practical in these areas in order to reduce the potential for water intrusion, as well as to minimize encountering potentially soft/unstable soil conditions during construction.***

We recommend these maintenance pit areas be designed as water-tight structures, designed for buoyancy and hydrostatic pressures. Waterproofing consultants should be contacted for recommendations regarding the design and construction of water-tight below-grade foundations. As an alternative, subsurface drainage systems can be installed to collect subsurface water and maintain dry interior conditions. At a minimum, the drainage system would include installation of a perimeter drain system around and below the foundations of these below grade areas which would empty into the storm sewer or a sump pit where collected water could be discharged via a submersible pump.


- **Foundations and Floor Slabs:** Based on the information obtained from our subsurface exploration and laboratory testing of selected samples, the site appears suitable for proposed development. The native sand/clay soils encountered near foundation bearing elevations are considered suitable for support of conventional spread footing foundations and slab-on-grade floors at the site. However, areas of soft, unstable or low-density soils may also be encountered in the foundation excavations and may require the need for removal and recompaction/replacement prior to foundation and floor slab construction. Therefore, it is imperative that the soils exposed in foundation excavations be observed by the geotechnical engineer to confirm or modify our recommendations.
- **Pavement Design and Structural Sections:** Design of pavements for the project is based on the procedures outlined in the 1993 *Guideline for Design of Pavement Structures* by the American Association of State Highway and Transportation Officials (AASHTO) using an assumed traffic volume.

Light-duty pavements for automobile parking areas should include a minimum of 5-½ inches of asphalt concrete or, alternately, 5 inches of Portland cement concrete. Paved access drives should be paved with 6-½ inches of asphalt concrete. Heavy-duty pavements such as for driveway entrances, drive isles, heavy truck parking, and other areas where trucks will park and turn should include a minimum of 6 inches of Portland cement concrete.


We appreciate being of service to you in the geotechnical engineering phase of this project, and are prepared to assist you during the construction phases as well. Please do not hesitate to contact us if you have any questions concerning this report or any of our testing, inspection, design and consulting services.

Sincerely,

Pickering, Cole & Hivner, LLC



Glenn D. Ohlsen, P.E.
Project Engineer

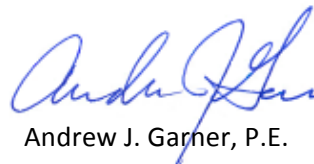

Andrew J. Garner, P.E.
Senior Project Manager



Copies to: Addressee (1 PDF copy)

TABLE OF CONTENTS

	Page No.
Letter of Transmittal.....	ii
INTRODUCTION	1
PROJECT INFORMATION	1
SITE EXPLORATION PROCEDURES.....	2
Field Exploration	2
Laboratory Testing	2
SITE CONDITIONS	3
SUBSURFACE CONDITIONS	3
Geology	3
Soil and Bedrock Conditions.....	4
Field and Laboratory Test Results	4
Groundwater Conditions.....	4
ENGINEERING RECOMMENDATIONS.....	4
Geotechnical Considerations	4
Foundation Design and Construction.....	5
Lateral Earth Pressures	6
Below-grade Construction	7
Seismic Considerations	8
Floor Slab Design and Construction	8
Private Pavement Thickness Design & Construction.....	9
Earthwork.....	12
General Considerations	12
Site Preparation	13
Subgrade Preparation.....	13
Fill Materials	14
Compaction Requirements.....	14
Excavation and Trench Construction	14
Additional Design and Construction Considerations.....	15
Exterior Slab Design and Construction	15
Underground Utility Systems.....	15
Concrete Corrosion Protection	16
Surface Drainage.....	16
GENERAL COMMENTS.....	17
 APPENDIX A: BORING LOCATION DIAGRAM, BORING LOGS	
APPENDIX B: LABORATORY TEST RESULTS	
APPENDIX C: GENERAL NOTES, PERIMETER DRAIN DETAIL	



GEOTECHNICAL ENGINEERING REPORT

PROPOSED LES SCHWAB TIRE CENTER NEC of MERIDIAN ROAD and ROLLING THUNDER WAY FALCON, COLORADO

PCH Project No. 12.298.16

September 27, 2016

INTRODUCTION

This report contains the results of our geotechnical engineering exploration for the proposed Les Schwab Tire Center to be located at the northeast corner of the intersection of Meridian Road and Rolling Thunder Way in Falcon, Colorado.

The purpose of these services is to provide information and geotechnical engineering recommendations relative to:

- Subsurface soil and bedrock conditions
- Groundwater conditions
- Foundation design and construction
- Lateral earth pressures
- Floor slab design and construction
- Pavement structural sections
- Earthwork
- Drainage

The recommendations contained in this report are based upon the results of field and laboratory testing, engineering analyses, our experience with similar subsurface conditions and structures, and our understanding of the proposed project.

PROJECT INFORMATION

We understand that the project will include the development of an approximate 2.5-acre site at the referenced intersection. Development will include construction of a new single-story Les Schwab Tire Center building encompassing approximately 11,878 square feet. We assume construction will include either load bearing CMU or light-gauge steel framed superstructure along with interior steel columns supporting a metal roof system. Reinforced concrete foundations will support the structures. The interior of the structures will include a conventional slab-on-grade with some bays having a recessed slab. Portions of the slab will bear approximately 6-½ to 7 feet below finished floor elevation (FFE). Maximum wall and column loads are anticipated to be on the order of about 3 to 5 kips per lineal foot and 100 to 200 kips,

respectively. We assume that a majority of the site is near rough construction grade, slightly below planned FFE.

Other major site development will include the installation of underground utilities, construction of a trash enclosure, as well as the construction of private asphalt or concrete paved parking areas and site landscape improvements.

If our understanding of the project, or assumptions above, is not accurate, or if you have additional useful information, please inform us as soon as possible.

SITE EXPLORATION PROCEDURES

The scope of the services performed for this project included site reconnaissance by a field engineer, a subsurface exploration program, laboratory testing and engineering analysis.

Field Exploration: As part of this study, we investigated the subsurface conditions on the site with a total of six (6) test borings. Borings were advanced to depths of about 25 to 35 feet below existing site grades with a truck-mounted drilling rig utilizing 4-inch diameter, solid stem auger.

A lithologic log of each boring was recorded by our field representative during the drilling operations. At selected intervals, samples of the subsurface materials were obtained by driving modified California barrel samplers. Penetration resistance measurements were obtained by driving the sample barrel into the subsurface materials with a 140-pound automatic hammer falling 30 inches. The penetration resistance value is a useful index to the consistency, relative density or hardness of the materials encountered.

Groundwater measurements were made in each boring at the time of site exploration and about three weeks later. Borings were loosely backfilled with the auger cuttings upon completion of groundwater measurements.

Laboratory Testing: Samples retrieved during the field exploration were returned to the laboratory for observation by the project geotechnical engineer, and were classified in general accordance with the Unified Soil Classification System described in Appendix C. Samples of bedrock were classified in general accordance with the general notes for Rock Classification. At that time, an applicable laboratory-testing program was formulated to determine engineering properties of the subsurface materials. Following the completion of the laboratory testing, the field descriptions were confirmed or modified as necessary, and Boring Logs were prepared. These logs are presented in Appendix A.

Laboratory test results are presented in Appendix B. These results were used for the geotechnical engineering analyses and the development of foundation and earthwork recommendations. Laboratory tests were performed in general accordance with the applicable local or other accepted standards.

Selected soil and bedrock samples were tested for the following engineering properties:

- Water content
- Dry density
- Consolidation/Swell
- Grain size
- Plasticity Index
- Water-soluble sulfates

SITE CONDITIONS

The site is located at the northeast corner of Meridian Road and Rolling Thunder Way in Falcon, Colorado. The site is generally bordered by Meridian Road to the northwest, Rolling Thunder Way/Old Meridian Road to the southwest, and currently undeveloped lots and asphalt-paved private access roads in the other directions. In general, the surrounding area consists of commercial/retail development. At the time of our field exploration, the ground surface at the site was covered with a low to moderate growth of grass and weeds. The site was generally level, with a slight slope downwards to the south. We anticipate that cuts and fills of up to about 1 to 3 feet could be required to bring the site to construction grades and to provide positive site drainage.

SUBSURFACE CONDITIONS

Geology: Surficial geologic conditions at (or in the vicinity of) the site, as mapped by the U.S. Geological Survey (USGS) (¹Scott, et al, 1976) and (²Madole, R.F., 2003), consist of Eolian Sand of Holocene and Pleistocene Age. These materials are typically described as sand, sandy silt, and sandy clay. Bedrock underlying the surface units consists of the Dawson Formation of Paleocene and Upper Cretaceous Age. This formation generally includes sandstone, claystone and conglomerate.

The site is located just east of mapping completed by the Colorado Geological Survey (³Hart, 1972) for potentially swelling soil and bedrock. However, areas of “Low Swell Potential” were mapped to the west of the site. Potentially expansive materials in this category generally include bedrock and some surficial soils.

Due to the gently sloping nature of the site, the potential for other geologic hazards at the site is anticipated to be low. Seismic activity in the area is anticipated to be low, and the property should be relatively stable from a structural standpoint. With proper site grading around proposed structures, erosional problems at the site should be reduced.

¹ Scott, G.R., Taylor, R.B., Epis, R.C., and Wobus, R.A., 1976, *Geologic Map of the Pueblo 1 Degree x 2 Degree Quadrangle, South-Central Colorado*, United States Geological Survey, Map MF-775.

² Madole, R.F., 2003, *Geologic Map of the Falcon, NW 7.5 Minute Quadrangle, El Paso County, Colorado*, United States Geological Survey, Map OF03-08.

³ Hart, Stephen S., 1972, *Potentially Swelling Soil and Rock in the Front Range Urban Corridor, Colorado*, Colorado Geological Survey, Sheet 3 of 4.

Soil and Bedrock Conditions: The soils at the site consist of silty to clayey sands, fine to coarse sands, and varying layers of lean clays. Sedimentary claystone bedrock was encountered below the sands/clays at depths ranging from about 13 to 18 feet below existing site grades. The bedrock extended to the depths explored. Other specific information regarding the lithology encountered is noted on the attached Boring Logs.

Field and Laboratory Test Results: Field test results indicate that the sand soils vary from medium dense to dense in relative density. The clay soils are very stiff to hard in consistency. Laboratory test results indicate that the clayey soils and claystone bedrock at the site exhibit low expansive potential when inundated in our laboratory.

Groundwater Conditions: Groundwater was encountered in our building borings immediately after drilling at depths ranging from about 10 to 15 feet below existing site grades. The shallow pavement borings were dry at that time. ***When checked about three weeks later, groundwater was encountered in the deeper borings at depths ranging from about 4 to 7-½ feet below existing site grades.*** The shallow pavement borings remained dry at that time.

Based upon review of U.S. Geological Survey Maps (⁴Hillier, et al, 1980), regional groundwater beneath the project area is expected to be encountered in unconsolidated alluvial deposits or in the Dawson Aquifer at depths generally greater than 20 feet below present ground surface.

Zones of perched and/or trapped groundwater, where not already present, may also occur at times in the subsurface soils overlying bedrock, on top of the bedrock surface or within permeable fractures in the bedrock materials. The location and amount of perched water is dependent upon several factors including hydrologic conditions, type of site development, irrigation demands on or adjacent to the site, fluctuations in water features, seasonal and weather conditions.

The possibility of groundwater fluctuations should be considered when developing design and construction plans for the project.

ENGINEERING RECOMMENDATIONS

Geotechnical Considerations: The site appears suitable for the proposed construction as long as the recommendations included herein are incorporated into the design and construction aspects of the project. Based on our borings, the site should be suitable for the proposed construction, however, the presence of relatively shallow groundwater may impact both the design and construction of the project.

As discussed, groundwater was encountered at the site at depths ranging from about 4 to 7-½ feet below existing site grades. As currently planned the northeast portion of the building will include below-

⁴Hillier, Donald E.; and Hutchinson, E. Carter, 1980, *Depth to Water Table (1976-1977) in the Colorado Springs-Castle Rock Area, Front Range Urban Corridor, Colorado*, United States Geological Survey, Map I-857-H.

grade maintenance pits (maximum of about 7 feet below planned FFE). ***We recommend construction be limited to excavation depths as high as practical in these areas in order to reduce the potential for water intrusion, as well as to minimize encountering potentially soft/unstable soil conditions during construction.***

We recommend these maintenance pit areas be designed as water-tight structures, designed for buoyancy and hydrostatic pressures. Waterproofing consultants should be contacted for recommendations regarding the design and construction of water-tight below-grade foundations. As an alternative, subsurface drainage systems can be installed to collect subsurface water and maintain dry interior conditions. At a minimum, the drainage system would include installation of a perimeter drain system around and below the foundations of these below grade areas which would empty into the storm sewer or a sump pit where collected water could be discharged via a submersible pump.

Design and construction recommendations for the foundation system and other earth-connected phases of the project are outlined below.

Foundation Design and Construction: Due to the presence of non- to low expansive soils, spread footing foundations are considered acceptable for support of the structure on this site. Based on the borings advanced on the site, we believe that the native soils will be suitable for support of foundations; however, it is possible that soft, unstable, or low-density soils may also be present, particularly for foundations approaching the groundwater level. ***The geotechnical engineer responsible for special inspections should be contacted to observe and evaluate the suitability of the soils beneath foundation excavations at the site, prior to forming for footing construction. If any areas of soft, unstable or low-density soils are observed, removal and recompaction/replacement will be required.***

The following foundation design criteria may be used for the structural design of foundations:


Criteria	Design Value
Bearing Strata	Undisturbed native sand/clay soils or properly compacted fill materials approved by the Geotechnical Engineer
Maximum net allowable bearing pressure ¹	2,000 psf
Min. depth below grade, exterior wall footings ²	36 inches
Min. depth below grade, interior footings ²	12 inches
Estimated maximum total foundation movement ³	1 inch
Estimated maximum differential foundation movement ³	½ to ¾ inch

1. The design bearing pressure above applies to dead loads plus one-half of design live load conditions. The design bearing pressure may be increased by 1/3 when considering total loads that include wind or seismic conditions.
2. Finished grade is the lowest adjacent grade for perimeter footings and floor level for interior footings.

3. Based on assumed structural loads. Footings should be proportioned to apply relative constant dead load pressure in order to reduce differential movement between adjacent footings.

Foundation movements could occur if water from any source infiltrates the foundation soils; therefore, proper drainage should be provided in the final design and during construction. Failure to maintain proper surface drainage could result in excessive soil-related foundation movement.

Lateral Earth Pressures: Earth pressures will be influenced by structural design of the walls, conditions of wall restraint, methods of construction, wetting of backfill materials, and/or compaction and the strength of the materials being restrained. Loads that should be considered by the structural engineer on walls are shown below.

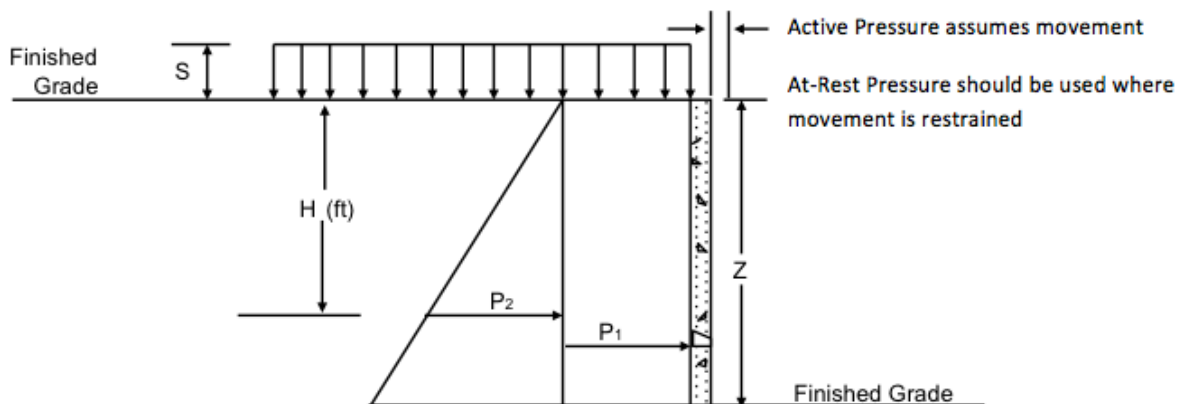

Active earth pressure is commonly used for design of freestanding cantilever retaining walls and assumes wall movement. The "at-rest" condition assumes no wall rotation. Walls with unbalanced backfill levels on opposite sides (i.e. basement walls) should be designed for earth pressures at least equal to those indicated in the following table. The recommended design lateral earth pressures do not include a factor of safety and do not provide for possible hydrostatic pressure on the walls.

EARTH PRESSURE COEFFICIENTS

Earth pressure conditions	Coefficient for backfill type	Equivalent fluid pressure, pcf	Surcharge pressure P_1 , psf	Earth pressure P_2 , psf
Active (K_a)	On-site clayey soils - 0.38	45	$(0.38)S$	$(45)H$
At-Rest (K_o)	On-site clayey soils - 0.54	65	$(0.54)S$	$(65)H$
Passive (K_p)	On-site clayey soils – 2.3	275	---	---

Conditions applicable to the above conditions include:

- for active earth pressure, wall must rotate about base, with top lateral movements $0.01 Z$ to $0.02 Z$, where Z is wall height

- for passive earth pressure, wall must move horizontally to mobilize resistance
- uniform surcharge, where S is surcharge pressure
- in-situ soil backfill weight a maximum of 120 pcf
- horizontal backfill, compacted to at least 95 percent of standard Proctor maximum dry density
- loading from heavy compaction equipment not included
- **no groundwater acting on wall**
- no safety factor included
- ignore passive pressure in frost zone

Backfill placed against structures may consist of the on-site soils processed to a soil-like consistency with maximum particle sizes on the order of 4 to 6 inches. The design equivalent fluid pressures may be reduced if the imported granular soils are used. To calculate the resistance to sliding, a value of 0.35 may be used as the ultimate coefficient of friction between the footing and the underlying soil. If utilizing passive pressure for resistance, a coefficient of 0.30 should be used.

We recommend a perimeter drain be installed at the foundation level to control the water level behind any basement/below-grade walls. ***If this is not possible or if the below-grade space is being designed to be watertight, then combined hydrostatic and lateral earth pressures should be calculated for lean clay backfill using an equivalent fluid weighing 90 and 100 pcf for active and at-rest conditions, respectively.*** These pressures do not include the influence of surcharge, equipment or floor loading, which should be added. Heavy equipment should not operate within a distance closer than the exposed height of retaining walls to prevent lateral pressures more than those provided.

Below-grade Construction: As discussed, groundwater (perched water) was encountered at the site at depths ranging from about 4 to 7-½ feet below existing site grades. As currently planned the northeast portion of the building will include below-grade maintenance pits (maximum of about 7 feet below planned FFE). ***We recommend construction be limited to excavation depths as high as practical in these areas in order to reduce the potential for water intrusion, as well as to minimize encountering potentially soft/loose soil conditions during construction.***

Based on the limited size of the maintenance pits, we believe it is prudent to construct these below-grade areas to be water-tight. This would include waterproofing the foundation and walls of the pits and designing the pits for buoyancy forces and hydrostatic lateral loading conditions below groundwater depth. Waterproofing consultants should be contacted for recommendations regarding the design and construction of water-tight below-grade foundations.

As an alternative, installation of a perimeter drainage system is recommended around the perimeter of these below-grade spaces. The drainage system should include a trench in which a perforated pipe is placed, sloped at a minimum 1/8 inch per foot to a suitable outlet, such as the storm sewer or a sump and pump system.

In our opinion, the drainage system should consist of a minimum 4-inch diameter perforated or slotted pipe, embedded in free-draining gravel, placed in a trench at least 12 inches in width. The edge of the trench should be sloped at a 1:1 slope beginning at the bottom outside edge of the footing. The trench should not be cut vertically at the edge of the footing. Gravel should extend a minimum of 2 to 3 inches beneath the bottom of the pipe and at least 6 inches above the pipe. The gravel should be encapsulated in a filter fabric prior to placement of foundation backfill. A general detail of this system is included herein. If the pits are designed to be water-tight, the drain system would not be required.

Seismic Considerations: Based on the soil conditions encountered in the test holes drilled on the site, we estimate that a Site Class D is appropriate for the site according to the 2009 International Building Code (Table 1613.5.2). This parameter was estimated based on extrapolation of data beyond the deepest depth explored, using methods allowed by the code. Actual shear wave velocity testing/analysis and/or exploration to 100 feet was not performed.

Floor Slab Design and Construction: The existing, non- to low expansive soils at the site are generally considered suitable for support of the floor slab. Some movement of a slab-on-grade floor system is still possible should the subgrade soils become elevated in moisture content. We estimate that total slab movement will be about 1-inch. If movement cannot be tolerated, we should be contacted to provide alternatives for additional subgrade preparation or the use of a structural floor system.

To reduce potential slab movements, the subgrade soils should be prepared as outlined in the "Earthwork" section of this report and adequate surface drainage needs to be maintained.

For structural design of concrete slabs-on-grade, a modulus of subgrade reaction of 100 pounds per cubic inch (pci) may be used for floors supported on the on-site soils. Additional floor slab design and construction recommendations are as follows:

- Positive separations and/or isolation joints should be provided between slabs and all foundations, columns or utility lines to allow independent movement.
- Control joints should be provided in slabs to control the location and extent of cracking.
- A minimum 2-inch void space should be constructed above or below non-bearing partition walls placed on the floor slab. If this void space is constructed as a slip joint at the top of the wall, some minor drywall cracking could occur due to slab movement, prior to mobilization of this joint. Special framing details should be provided at doorjamb and frames within partition walls to avoid potential distortion. Partition walls should be isolated from suspended ceilings.
- Interior trench backfill placed beneath slabs should be compacted in accordance with recommended specifications outlined below.

- The use of a vapor retarder should be considered beneath concrete slabs on grade that will be covered with wood, tile, carpet or other moisture sensitive or impervious coverings, or when the slab will support equipment sensitive to moisture. When conditions warrant the use of a vapor retarder, the slab designer and slab contractor should refer to ACI 302 for procedures and cautions regarding the use and placement of a vapor retarder.
- Floor slabs should not be constructed on frozen subgrade.
- Other design and construction considerations, as outlined in Section 302.1R of the *ACI Design Manual*, are recommended.

Private Pavement Thickness Design and Construction: Design of private pavements for the project is based on the procedures outlined in the 1993 *Guideline for Design of Pavement Structures* by the American Association of State Highway and Transportation Officials (AASHTO). The AASHTO design method takes into account several variables, including subgrade soil and traffic conditions. We assume that there will be no new pavements in the public right-of-way. If public roadway construction is to be included in the project, additional geotechnical investigation and a formal pavement design may be required for those improvements.

- **Subgrade Soil:** The on-site sandy and clayey soils are considered to generally provide good to poor pavement support, respectively. We estimated a design R-value of 5 for flexible pavement (asphalt) thickness design based on the properties of the poorer clayey soils. Likewise, modulus of subgrade reaction (K-value) of 100 pounds per cubic inch (pci) was used for design of rigid concrete pavements.
- **Assumed Traffic:** We assume that pavements associated with the project will include private drive lanes, driveways, fire lanes, and surface parking for automobiles and light trucks. We assume that private pavements will be surfaced with either asphalt concrete or Portland cement concrete. Any improvements to adjacent public roadways will need to be designed and constructed according to the governing standards.

Based on our experience with similar projects, the following traffic criteria were used for determining pavement thicknesses using a design life of 20 years:

- Driveways and parking stalls - maximum daily traffic of 1,000 cars per day (equivalent single-axle loads, ESAL's of 22,000)
- Main site access drives and fire lanes – up to 5 trips/day by single-axle delivery trucks per day, 1 combined-axle truck per day and 1 trash truck per day, plus maximum daily traffic of 1,000 cars per day (73,000 ESAL's)

The owner should review these assumptions, and we should be contacted to confirm or modify these resulting pavement sections, if needed.

- **Pavement Sections:** For flexible pavement design a drainage coefficient of 1.0, a terminal serviceability index of 2.0, and an inherent reliability of 85 percent were used. Using, the appropriate ESAL values, environmental criteria and other factors, the design structural numbers (SN) of the pavement sections were determined on the basis of the 1993 AASHTO design equation.

In addition to the flexible pavement design analyses, a rigid pavement design analysis was completed based upon AASHTO design procedures. Along with soil and traffic conditions, rigid pavement design is based on the Modulus of Rupture of the concrete, and other factors previously outlined. A modulus of rupture of 600 psi (working stress 450 psi) was used for pavement concrete. The rigid pavement thickness for each traffic category was determined on the basis of the AASHTO design equation.

We have considered full depth-asphalt paving, a composite section with asphalt concrete over aggregate base course, and full depth rigid concrete sections. Alternatives for flexible and rigid pavements are summarized for each traffic area as follows:

Traffic Area	Alternative	Private Pavement Thickness (Inches)		
		Asphalt Concrete (AC)	Aggregate Base Course (ABC)	Portland Cement Concrete (PCC)
Automobile Parking and Standard-Duty Automobile and Light Truck Parking Only	A	5-½	--	--
	B	4	6	--
	C	--	--	5
Main Access Drives, and Heavy-Duty areas Private Drives, Fire Lanes, Delivery truck access	A	6-½	--	--
	B1	4	9	--
	B2	4-½	7	--
	B3	5	6	--
	C	--	--	6

A minimum 6-inch thickness of Portland cement concrete pavement is recommended at the location of dumpsters where trash trucks park and load, and should be considered in other areas with heavy truck traffic. Each alternative should be investigated with respect to current material availability and economic conditions.

- **Subgrade Preparation:** We recommend the pavement areas be rough graded and then thoroughly proof rolled with a loaded tandem axle dump truck, water truck, or other heavy equipment approved by the observing engineer prior to final grading and paving. Particular attention should be

paid to high traffic areas that were rutted and disturbed earlier and to areas where backfilled trenches are located. Areas where unsuitable conditions are located should be repaired by removing and replacing the materials with properly compacted engineered fills.

At a minimum, in order to provide a more uniform subgrade for site pavements, we recommend that all pavements be constructed on a minimum of 12 inches of properly moisture conditioned and recompacted on-site soils. Confirmation of the moisture content and compaction level of the subgrade soils should be confirmed just prior to paving.

- **Pavement Materials:** Aggregate base course (if used on the site) should consist of a blend of sand and gravel which meets strict specifications for quality and gradation. Use of materials meeting Colorado Department of Transportation (CDOT) Class 5 or 6 specifications is recommended for base course. Aggregate base course should be placed in lifts not exceeding 6 inches and compacted to a minimum of 95 percent of the standard Proctor density (ASTM D698).

Asphalt concrete should be composed of a mixture of aggregate, filler and additives (if required) and approved bituminous material. The asphalt concrete should conform to approved mix designs stating the Hveem properties, optimum asphalt content, and job mix formula and recommended mixing and placing temperatures. Aggregate used in asphalt concrete should meet particular gradations. Material meeting CDOT Grading S or SX specifications or equivalent is recommended for asphalt concrete. Mix designs should be submitted prior to construction to verify their adequacy. Asphalt material should be placed in maximum 3-inch lifts and compacted within a range of 92 to 96 percent of the theoretical maximum (Rice) density (ASTM D2041) or 95 percent Hveem density (ASTM D1560, D1561).

Where rigid pavements are used, the concrete should meet CDOT Class P requirements and be obtained from an approved mix design with the following minimum properties:

- Modulus of Rupture @ 28 days 600 psi minimum
- Strength Requirements.....ASTM C94
- Cement Type.....Type II Portland
- Entrained Air Content 6 to 8%
- Concrete Aggregate ASTM C33 and CDOT Section 703

Concrete should be deposited by truck mixers or agitators and placed a maximum of 90 minutes from the time the water is added to the mix. Other specifications outlined by CDOT should be followed.

Longitudinal and transverse joints should be provided as needed in concrete pavements for expansion/contraction and isolation. The location and extent of joints should be based upon the final pavement geometry. Sawed joints should be cut within 24 hours of concrete placement and

should be a minimum of 25 percent of slab thickness plus 1/4 inch. All joints should be sealed to prevent entry of foreign material and doweled where necessary for load transfer.

- **Compliance:** Recommendations for pavement design and construction presented depend upon compliance with recommended material specifications. To assess compliance, observation and testing should be performed under the observation of the geotechnical engineer.
- **Pavement Performance:** Future performance of pavements constructed on the subgrade at this site will be dependent upon several factors, including:
 - Maintaining stable moisture content of the subgrade soils.
 - Providing for a planned program of preventative maintenance.

The performance of all pavements can be enhanced by minimizing excess moisture, which can reach the subgrade soils. The following recommendations should be considered at minimum:

- Site grading at a minimum 2 percent grade onto or away from pavements.
- Water should not be allowed to pond behind curbs.
- Compaction of any utility trenches for landscaped areas to the same criteria as the pavement subgrade.
- Sealing all landscaped areas in or adjacent to pavements to minimize or prevent moisture migration to subgrade soils.
- Placing compacted backfill against the exterior side of curb and gutter.
- Placing curb, gutter and/or sidewalk directly on subgrade soils without the use of base course materials.

Preventative maintenance should be planned and provided for an ongoing pavement management program in order to enhance future pavement performance. Preventative maintenance activities are intended to slow the rate of pavement deterioration and to preserve the pavement investment.

Preventative maintenance consists of both localized maintenance (e.g. crack sealing and patching) and global maintenance (e.g. surface sealing). Preventative maintenance is usually the first priority when implementing a planned pavement maintenance program and provides the highest return on investment for pavements.

Earthwork:

General Considerations: The following presents recommendations for site preparation, excavation, subgrade preparation and placement of engineered fills on the project.

All earthwork on the project should be observed and evaluated by the geotechnical engineer contracted for special inspection services. The evaluation of earthwork should include observation and testing of engineered fills, subgrade preparation, foundation bearing soils and other geotechnical conditions exposed during the construction of the project.

Site Preparation: Strip and remove existing vegetation and other deleterious materials from proposed building and pavement areas. All exposed surfaces should be free of mounds and depressions that could prevent uniform compaction. Stripped materials consisting of vegetation and organic materials should be wasted from the site or used to revegetate landscaped areas or exposed slopes after completion of grading operations.

The site should be initially graded to create a relatively level surface to receive fill and to provide for a relatively uniform thickness of fill beneath proposed building structures. All exposed areas that will receive fill, once properly cleared, should be scarified to a minimum depth of 8 to 12 inches, conditioned to near optimum moisture content and compacted.

Perched groundwater and/or soft subgrade soils may be encountered in foundation excavations. Stabilization of these materials will be required prior to foundation construction, if encountered. Stabilization would likely include placing or “crowding” larger-sized crushed gravel or recycled concrete into the high moisture content, weak clay soils in order to provide for a stable base. We estimate that the amount of aggregate required to build a stable base may be on the order of 18 to 24 inches in thickness. The thickness of this gravel layer may be reduced using a layer bi-axial (or triaxial) geogrid reinforcement below the gravel. The removed clays should be replaced with engineered fill consisting of imported granular soils. Engineered fills should be placed as described below. ***The geotechnical engineer contracted for special inspection services should be contacted during excavation to provide further guidance based on actual site conditions.***

It is anticipated that excavations for the proposed construction can be accomplished with conventional, heavy-duty earthmoving equipment. The stability of the site subgrade may also be affected by precipitation, repetitive construction traffic, or other factors. If unstable conditions are encountered or develop during construction, workability may be improved by scarifying and aeration. Overexcavation of wet zones and replacement with granular materials may be necessary.

Subgrade Preparation: The engineer should evaluate foundation subgrade soils in order to confirm or modify our recommendations for the bearing soils. All subgrade soils below new fill, slab-on-grade floors, exterior PCC flatwork, and pavements should be scarified to a minimum depth of 12 inches, moisture conditioned and compacted as discussed below just prior to construction of these elements.

Fill Materials: Clean on-site soils or approved imported materials may be used as fill material. Imported soils (if required) should conform to the following:

<u>Gradation</u>	<u>Percent finer by weight (ASTM C136)</u>
6"	100
3"	70-100
No. 4 Sieve.....	50-100
No. 200 Sieve.....	20-50
• Liquid Limit	35 (max)
• Plasticity Index	15 (max)
• Maximum expansive potential (%)*	1.0

*Measured on a sample compacted to approximately 95 percent of the ASTM D698 maximum dry density at about optimum water content. The sample is confined under a 500 psf surcharge and submerged.

Compaction Requirements: Engineered fill for site development and grading should be placed and compacted in horizontal lifts, using equipment and procedures that will produce recommended moisture contents and densities throughout the lift. Fill soils should be placed and compacted according to the following criteria:

Item	Description
Fill Lift Thickness	8 to 12 inches or less in loose thickness
Compaction Requirements	Clayey soils: 95% of standard Proctor dry density (ASTM D698) Non-plastic sands: 95% of modified Proctor dry density (ASTM 1557)
Moisture Content	Clayey soils: Optimum to +4% above optimum moisture content Optimum to +2% above optimum in pavement areas Non-plastic sands: -2% below to +2% above optimum

At a minimum, fill soils placed for any sub-excavation fill, site grading, utility trench backfill and foundation backfill should be tested to confirm that earthwork is being performed according to our recommendations and project specifications. Subsequent lifts of fill should not be placed on previous lifts if the moisture content or dry density is determined to be less than specified.

Excavation and Trench Construction: Caving sand soils may be encountered in excavations during construction. The individual contractor(s) should be made responsible for designing and constructing stable, temporary excavations as needed to maintain stability of both the excavation sides and bottom. All excavations should be sloped or shored in the interest of safety following local and federal regulations, including current OSHA excavation and trench safety standards.

The soils to be penetrated by the proposed excavations may vary significantly across the site. The contractor should verify that similar conditions exist throughout the proposed area of excavation. If different subsurface conditions are encountered at the time of construction, the actual conditions should be evaluated to determine any excavation modifications necessary to maintain safe conditions.

As a safety measure, it is recommended that all vehicles and soil piles be kept to a minimum lateral distance from the crest of the slope equal to no less than the slope height. The exposed slope face should be protected against the elements.

As discussed, shallow groundwater was encountered at depths ranging from 4 to 7-½ feet below existing site grades. Where excavations penetrate the groundwater, temporary dewatering will be required during excavation, foundation work and backfilling operations for proper construction. Pumping from sumps may be utilized to control water within the excavations.

Additional Design and Construction Considerations:

Exterior Slab Design and Construction: Flatwork will be subject to movement, particularly when bearing on backfill soils adjacent to the foundation and underground utility lines. The amount of movement will be related to the compactive effort used when the fill soils are placed and future wetting of the subgrade soils. The potential for damage would be greatest where exterior slabs are constructed adjacent to the building or other structural elements.

To reduce the potential for damage, we recommend:

- exterior slabs in critical areas be supported on a zone of recompacted soils.
- Supporting of flatwork at building entrances and other critical areas on haunches attached by the building foundations.
- placement of effective control joints on relatively close centers and isolation joints between slabs and other structural elements.
- provision for adequate drainage in areas adjoining the slabs.
- use of designs which allow vertical movement between the exterior slabs and adjoining structural elements.

Underground Utility Systems: All underground piping within or near the proposed structure should be designed with flexible couplings, so minor deviations in alignment do not result in breakage or distress. Utility knockouts in foundation walls should be oversized to accommodate differential movements.

It is strongly recommended that a representative of the geotechnical engineer provide full-time observation and compaction testing of trench backfill within building and pavement areas.

Concrete Corrosion Protection: Water-soluble sulfate concentrations of select samples ranged up to 400 parts per million (ppm). ACI rates the measured concentrations as being a low to moderate risk of concrete sulfate attack. Based on these results, Type II Portland cement (or equivalent) should be used for concrete on and below grade. Project concrete should be designed in accordance with the provisions of the *ACI Design Manual*, Section 318, Chapter 4.

Surface Drainage: All grades must be adjusted to provide positive drainage away from the structures during construction and maintained throughout the life of the proposed project. Infiltration of water into utility or foundation excavations must be prevented during construction. Landscaped irrigation adjacent to the foundation system should be minimized or eliminated.

Water permitted to pond near or adjacent to the perimeter of the structure (either during or post-construction) can result in significantly higher soil movements than those discussed in this report. As a result, any estimations of potential movement described in this report cannot be relied upon if positive drainage is not obtained and maintained, and water is allowed to infiltrate the fill and/or subgrade.

Exposed ground (unpaved, landscaped areas) should be sloped at a minimum of 5 to 10 percent grade for at least 5 feet beyond the perimeter of the building/structure, where possible. Swales sidewalk chases, area drains may be required to facilitate drainage. Backfill against footings, exterior walls and in utility and sprinkler line trenches should be well compacted and free of all construction debris to reduce the possibility of moisture infiltration. After building construction and prior to project completion, we recommend that verification of final grading be performed to document that positive drainage, as described above, has been achieved.

Flatwork will be subject to post construction movement due to soil heave/settlement and frost action. Maximum grades practical should be used for paving and flatwork to prevent areas where water can pond. In addition, allowances in final grades should take into consideration post-construction movement of flatwork, particularly if such movement would be critical. Where paving or flatwork abuts the structure, care should be taken that joints are properly sealed and maintained to prevent the infiltration of surface water.

Planters located adjacent to the structure should preferably be self-contained. Landscaping in close proximity to the foundation should be limited to well-maintained and timed drip irrigation only. Sprinkler mains and spray heads should be located a minimum of 5 feet away from the building line.

Roof drains should discharge on pavements or be extended away from the structure a minimum of 5 feet through the use of splash blocks or downspout extensions. A preferred alternative is to have the roof drains discharge to storm sewers by solid pipe or daylighted to a detention pond or other appropriate outfall.

GENERAL COMMENTS

PCH should be retained to review the final design plans and specifications so comments can be made regarding interpretation and implementation of our geotechnical recommendations in the design and specifications. PCH should also be retained to provide testing and observation during the excavation, grading, foundation and construction phases of the project.


The analysis and recommendations presented in this report are based upon the data obtained from the borings performed at the indicated locations and from other information discussed in this report. This report does not reflect variations that may occur between borings, across the site, or due to the modifying effects of weather. The nature and extent of such variations may not become evident until during or after construction. If variations appear, we should be immediately notified so that further evaluation and supplemental recommendations can be provided.


The scope of services for this project does not include, either specifically or by implication, any environmental or biological (e.g., mold, fungi, bacteria) assessment of the site or identification or prevention of pollutants, hazardous materials or conditions. If the owner is concerned about the potential for such contamination or pollution, other studies should be undertaken.

This report has been prepared for the exclusive use of our client for specific application to the project discussed and has been prepared in accordance with generally accepted geotechnical engineering practices. No warranties, either express or implied, are intended or made. Site safety, excavation support, and dewatering requirements are the responsibility of others. In the event that changes are planned in the nature, design, or location of the project as outlined in this report, the conclusions and recommendations contained in this report shall not be considered valid unless PCH reviews the changes, and either verifies or modifies the conclusions of this report in writing.

APPENDIX A


**BORING LOCATION DIAGRAM
BORING LOGS**






1
 PROPOSED BORING LOCATIONS

BORING LOCATION DIAGRAM
LES SCHWAB TIRE CENTER
FALCON, COLORADO
PCH PROJECT NO. 12.298.16



Pickering, Cole, & Hivner, LLC
 1070 W. 124th Ave., Suite 300
 Westminster, CO 80234
 (303) 996-2999

PCH



Pickering, Cole, & Hivner
1070 W. 124 Avenue, Suite 300
Westminster, CO. 80234
Telephone: 303.996.2999

BORING NUMBER 1

PAGE 1 OF 1


CLIENT SFP-E, LLC c/o Galloway
PROJECT NUMBER 12.298.16
DATE STARTED 8/17/16 COMPLETED 8/17/16
DRILLING CONTRACTOR Elite Drilling
DRILLING METHOD CME-55/Solid Stem Auger
HAMMER TYPE Automatic
LOGGED BY SM CHECKED BY AG

PROJECT NAME Les Schwab Tire Center - Falcon, CO
PROJECT LOCATION Meridian Rd. & Rolling Thunder Way
GROUND SURFACE ELEV. Not Provided PROPOSED ELEV. Not Provided
SURFACE CONDITIONS Low to moderate growth of grass and weeds
GROUND WATER LEVELS:
▽ DURING DRILLING 15.00 ft
▽ AFTER DRILLING 7.50 ft - 9/6/16

GEOTECH BH COLUMNS - GINT STD US LAB.GDT - 9/27/16 09:01 - C:\USERS\PUBLIC\DOCUMENTS\BENTLEY\GINT\PROJECTS GEO 2016\12.298.16 LES SCHWAB - FALCON.GPJ

GRAPHIC LOG	MATERIAL DESCRIPTION	DEPTH (ft)	USCS SYMBOL	SAMPLE TYPE	RECOVERY %	PENETRATION blows/in	MOISTURE CONTENT (%)	DRY UNIT WT. (pcf)	SWELL-CONSOL /SURCHARGE LOAD, %psf
		0							
	FINE to COARSE SAND with SILT , varies trace clay, brown, light brown, white, moist, medium dense	5	SW-SM	CB	100	30 / 12	5.8	121	
	CLAYEY SAND , grey to bluish-grey, moist to wet, medium dense	7							
		10	SC	CB	100	38 / 12	11.1	123	+0.3/500
		15	SC	CB	100	46 / 12	12.1	124	
	CLAYSTONE BEDROCK , varies sandy, brown, dark brown, grey, calcareous, moist to wet, very hard	20	-	CB	100	50 / 7	11.7	125	
		25	-	CB	100	50 / 6	10.1	127	
		30	-	CB	100	50 / 4	11.5	126	
		35	-	CB	100	50 / 6	15.6	117	

Approximate bottom of borehole at 35.0 feet.



Pickering, Cole, & Hivner
1070 W. 124 Avenue, Suite 300
Westminster, CO. 80234
Telephone: 303.996.2999


BORING NUMBER 2

PAGE 1 OF 1

CLIENT SFP-E, LLC c/o Galloway **PROJECT NAME** Les Schwab Tire Center - Falcon, CO
PROJECT NUMBER 12.298.16 **PROJECT LOCATION** Meridian Rd. & Rolling Thunder Way
DATE STARTED 8/17/16 **COMPLETED** 8/17/16 **GROUND SURFACE ELEV.** Not Provided **PROPOSED ELEV.** Not Provided
DRILLING CONTRACTOR Elite Drilling **SURFACE CONDITIONS** Low to moderate growth of grass and weeds
DRILLING METHOD CME-55/Solid Stem Auger **GROUND WATER LEVELS:**
HAMMER TYPE Automatic **▽ DURING DRILLING** 10.00 ft
LOGGED BY SM **CHECKED BY** AG **▽ AFTER DRILLING** 7.50 ft - 9/6/16

GRAPHIC LOG	MATERIAL DESCRIPTION	DEPTH (ft)	USCS SYMBOL	SAMPLE TYPE	RECOVERY %	PENETRATION blows/in	MOISTURE CONTENT (%)	DRY UNIT WT. (pcf)	SWELL-CONSOL /SURCHARGE LOAD, %psf
		0							
	CLAYEY SAND , varies to Silty Sand, dark brown, light brown, white, grey, calcareous, moist to wet, medium dense to dense		SC	CB	100	23 / 12	6.9	126	-0.2/200
		5	SM	CB	100	25 / 12	4.1	117	
		10	SC	CB	100	50 / 9	8.3	134	
	CLAYSTONE BEDROCK , varies sandy, grey to bluish-grey, moist, hard to very hard	15	-	CB	100	50 / 9	10.9	119	+0.6/1000
		20	-	CB	100	50 / 5	12.2	126	
		25	-	CB	100	50 / 3	10.7	128	

Approximate bottom of borehole at 25.0 feet.



Pickering, Cole, & Hivner
1070 W. 124 Avenue, Suite 300
Westminster, CO. 80234
Telephone: 303.996.2999

BORING NUMBER 3

PAGE 1 OF 1

CLIENT SFP-E, LLC c/o Galloway
PROJECT NUMBER 12.298.16
DATE STARTED 8/17/16 COMPLETED 8/17/16
DRILLING CONTRACTOR Elite Drilling
DRILLING METHOD CME-55/Solid Stem Auger
HAMMER TYPE Automatic
LOGGED BY SM CHECKED BY AG

PROJECT NAME Les Schwab Tire Center - Falcon, CO
PROJECT LOCATION Meridian Rd. & Rolling Thunder Way
GROUND SURFACE ELEV. Not Provided PROPOSED ELEV. Not Provided
SURFACE CONDITIONS Low to moderate growth of grass and weeds
GROUND WATER LEVELS:
▽ DURING DRILLING 11.00 ft
▽ AFTER DRILLING 5.00 ft - 9/6/16


GRAPHIC LOG	MATERIAL DESCRIPTION	DEPTH (ft)	USCS SYMBOL	SAMPLE TYPE	RECOVERY %	PENETRATION blows/in	MOISTURE CONTENT (%)	DRY UNIT WT. (pcf)	SWELL-CONSOL /SURCHARGE LOAD, %psf
		0							
	SILTY to CLAYEY SAND , brown, grey to bluish-grey, moist, medium dense to dense ▽ ▽	5	SM	CB	100	25 / 12	9.5	118	
		10	SM	CB	100	50 / 12	9.5	127	
		15	-	CB	100	50 / 6	9.4	123	+0.4/1000
		20	-	CB	100	50 / 6	11.1	125	
	CLAYSTONE BEDROCK , varies sandy, grey to bluish-grey, moist, very hard	25	-	CB	100	50 / 4	10.5	123	

13

25

Approximate bottom of borehole at 25.0 feet.

GEOTECH BH COLUMNS - GINT STD US LAB.GDT - 9/27/16 09:01 - C:\USERS\PUBLIC\DOCUMENTS\BENTLEY\GINT\PROJECTS GEO 2016\12.298.16 LES SCHWAB - FALCON.GPJ



Pickering, Cole, & Hivner
1070 W. 124 Avenue, Suite 300
Westminster, CO. 80234
Telephone: 303.996.2999

BORING NUMBER 4


PAGE 1 OF 1

CLIENT	SFP-E, LLC c/o Galloway	PROJECT NAME	Les Schwab Tire Center - Falcon, CO
PROJECT NUMBER	12.298.16	PROJECT LOCATION	Meridian Rd. & Rolling Thunder Way
DATE STARTED	8/17/16	COMPLETED	8/17/16
GROUND SURFACE ELEV.	Not Provided	PROPOSED ELEV.	Not Provided
DRILLING CONTRACTOR	Elite Drilling	SURFACE CONDITIONS	Low to moderate growth of grass and weeds
DRILLING METHOD	CME-55/Solid Stem Auger	GROUND WATER LEVELS:	
HAMMER TYPE	Automatic	▽ DURING DRILLING	11.00 ft
LOGGED BY	SM	▽ AFTER DRILLING	4.00 ft - 9/6/16
CHECKED BY	AG		

GEOTECH BH COLUMNS - GINT STD US LAB.GDT - 9/27/16 09:01 - C:\USERS\PUBLIC\DOCUMENTS\BENTLEY\GINT\PROJECTS GEO 2016\112.298 - 16 LES SCHWAB - FALCON.GPJ

GRAPHIC LOG	MATERIAL DESCRIPTION	DEPTH (ft)	USCS SYMBOL	SAMPLE TYPE	RECOVERY %	PENETRATION blows/in	MOISTURE CONTENT (%)	DRY UNIT WT. (pcf)	SWELL-CONSOL /SURCHARGE LOAD, %psf
		0							
	CLAYEY SAND , dark brown, moist, medium dense								
		5	SC	CB	100	29 / 12	9.8	117	
7	LEAN CLAY with SAND , grey to bluish-grey, moist, very stiff to hard								
		10	CL	CB	100	32 / 12	10.7	122	+1.8/500
		15	CL	CB	100	50 / 8	10.6	117	+0.1/1000
18	CLAYSTONE BEDROCK , varies sandy, brown, grey to bluish-grey, olive, dry to moist, hard to very hard								
		20	-	CB	100	50 / 6	11.1	125	
		25	-	CB	100	50 / 3	10.8	125	
		30	-	CB	100	50 / 9	18.1	112	
		35	-	CB	100	50 / 3	10.9	121	

Approximate bottom of borehole at 35.0 feet.





Pickering, Cole, & Hivner
1070 W. 124 Avenue, Suite 300
Westminster, CO. 80234
Telephone: 303.996.2999


BORING NUMBER P1

PAGE 1 OF 1

CLIENT	SFP-E, LLC c/o Galloway	PROJECT NAME	Les Schwab Tire Center - Falcon, CO
PROJECT NUMBER	12.298.16	PROJECT LOCATION	Meridian Rd. & Rolling Thunder Way
DATE STARTED	8/17/16	COMPLETED	8/17/16
DRILLING CONTRACTOR	Elite Drilling	GROUND SURFACE ELEV.	Not Provided
DRILLING METHOD	CME-55/Solid Stem Auger	PROPOSED ELEV.	Not Provided
HAMMER TYPE	Automatic	SURFACE CONDITIONS	Low to moderate growth of grass and weeds
LOGGED BY	SM	GROUND WATER LEVELS:	
CHECKED BY	AG	▽ DURING DRILLING	None
		▽ AFTER DRILLING	None - 9/6/16

GRAPHIC LOG	MATERIAL DESCRIPTION	DEPTH (ft)	USCS SYMBOL	SAMPLE TYPE	RECOVERY %	PENETRATION blows/in	MOISTURE CONTENT (%)	DRY UNIT WT. (pcf)	SWELL-CONSOL /SURCHARGE LOAD, %psf
		0							
	SILTY SAND , brown, light brown, white, tan, dry to moist, medium dense								
			SM	CB	100	20 / 12	4.6	122	
	SANDY LEAN CLAY , bluish-grey, dry to moist, very stiff								
		5	CL	CB	100	34 / 12	4.6	116	

Approximate bottom of borehole at 5.0 feet.



Pickering, Cole, & Hivner
1070 W. 124 Avenue, Suite 300
Westminster, CO. 80234
Telephone: 303.996.2999

BORING NUMBER P2

CLIENT SFP-E, LLC c/o Galloway

PROJECT NAME Les Schwab Tire Center - Falcon, CO

PROJECT NUMBER 12.298.16

PROJECT LOCATION Meridian Rd. & Rolling Thunder Way

DATE STARTED 8/17/16 COMPLETED 8/17/16

GROUND SURFACE ELEV. Not Provided PROPOSED ELEV. Not Provided

DRILLING CONTRACTOR Elite Drilling

SURFACE CONDITIONS Low to moderate growth of grass and weeds

DRILLING METHOD CME-55/Solid Stem Auger



GROUND WATER LEVELS:

HAMMER TYPE Automatic

▽ DURING DRILLING None

LOGGED BY SM CHECKED BY AG


▽ AFTER DRILLING None - 9/6/16


GRAPHIC LOG	MATERIAL DESCRIPTION	DEPTH (ft)	USCS SYMBOL	SAMPLE TYPE	RECOVERY %	PENETRATION blows/in	MOISTURE CONTENT (%)	DRY UNIT WT. (pcf)	SWELL-CONSOL /SURCHARGE LOAD, %psf
		0							
	SANDY LEAN CLAY , dark brown, grey to bluish-grey, moist								
	SILTY SAND , white, tan, dry to moist, medium dense		SM	CB	100	23 / 12	8.7	115	-0.1/200
		5	SM	CB	100	18 / 12	12.1	121	

Approximate bottom of borehole at 5.0 feet.

APPENDIX B

LABORATORY TEST RESULTS





Pickering, Cole, & Hivner
1070 W. 124 Avenue, Suite 300
Westminster, CO. 80234
Telephone: 303.996.2999


SWELL/CONSOLIDATION TEST

CLIENT SFP-E, LLC c/o Galloway

PROJECT NAME Les Schwab Tire Center - Falcon, CO

PROJECT NUMBER 12.298.16


PROJECT LOCATION Meridian Rd. & Rolling Thunder Way

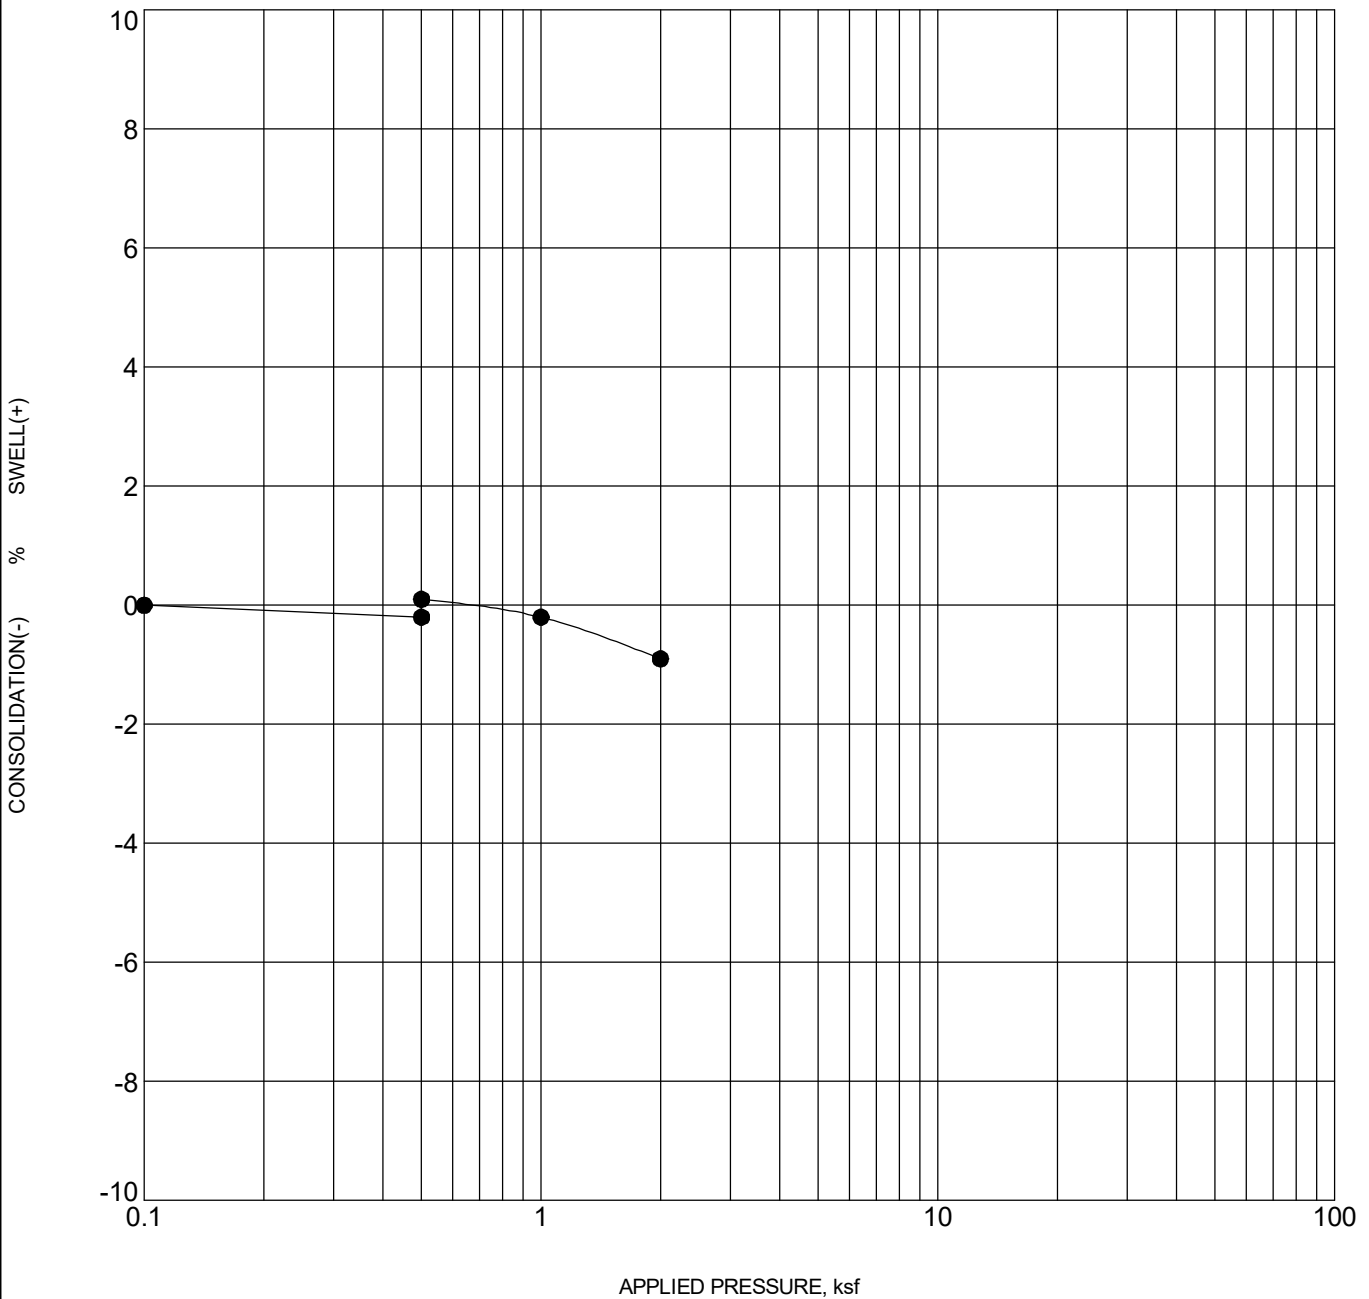

BOREHOLE	DEPTH	Classification	γ_d	MC%
● 1	9.0	CLAYEY SAND	123	11

Note: Water Added to Sample at 500 psf.

Date: 9/6/16



Pickering, Cole, & Hivner
1070 W. 124 Avenue, Suite 300
Westminster, CO. 80234
Telephone: 303.996.2999


SWELL/CONSOLIDATION TEST

CLIENT SFP-E, LLC c/o Galloway

PROJECT NAME Les Schwab Tire Center - Falcon, CO

PROJECT NUMBER 12.298.16


PROJECT LOCATION Meridian Rd. & Rolling Thunder Way

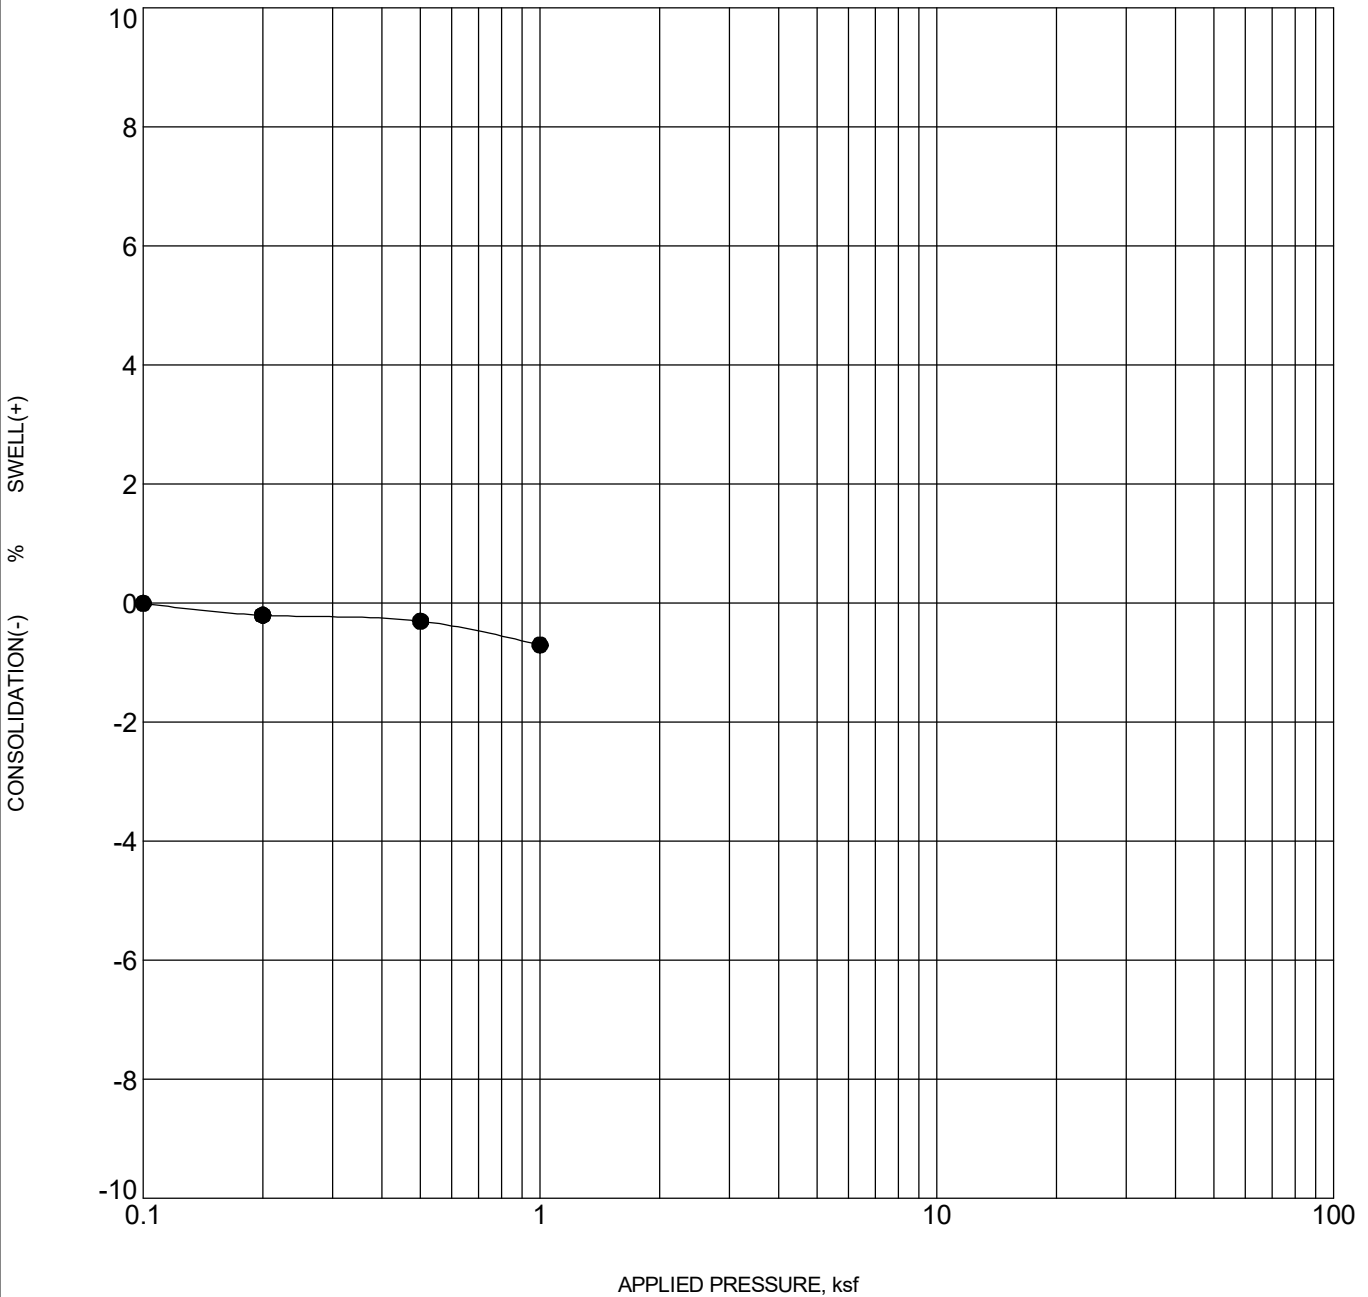

BOREHOLE	DEPTH	Classification	γ_d	MC%
● 2	2.0	CLAYEY SAND	126	7

Note: Water Added to Sample at 200 psf.

Date: 9/6/16



Pickering, Cole, & Hivner
1070 W. 124 Avenue, Suite 300
Westminster, CO. 80234
Telephone: 303.996.2999

SWELL/CONSOLIDATION TEST


CLIENT SFP-E, LLC c/o Galloway

PROJECT NAME Les Schwab Tire Center - Falcon, CO

PROJECT NUMBER 12.298.16

PROJECT LOCATION Meridian Rd. & Rolling Thunder Way


CONSOL STRAIN - GINT STD US LAB.GDT - 9/26/16 15:41 - C:\USERS\PUBLIC\DOCUMENTS\BENTLEY\GINT\PROJECTS GEO 2016\12.298.16 LES SCHWAB - FALCON.GPJ

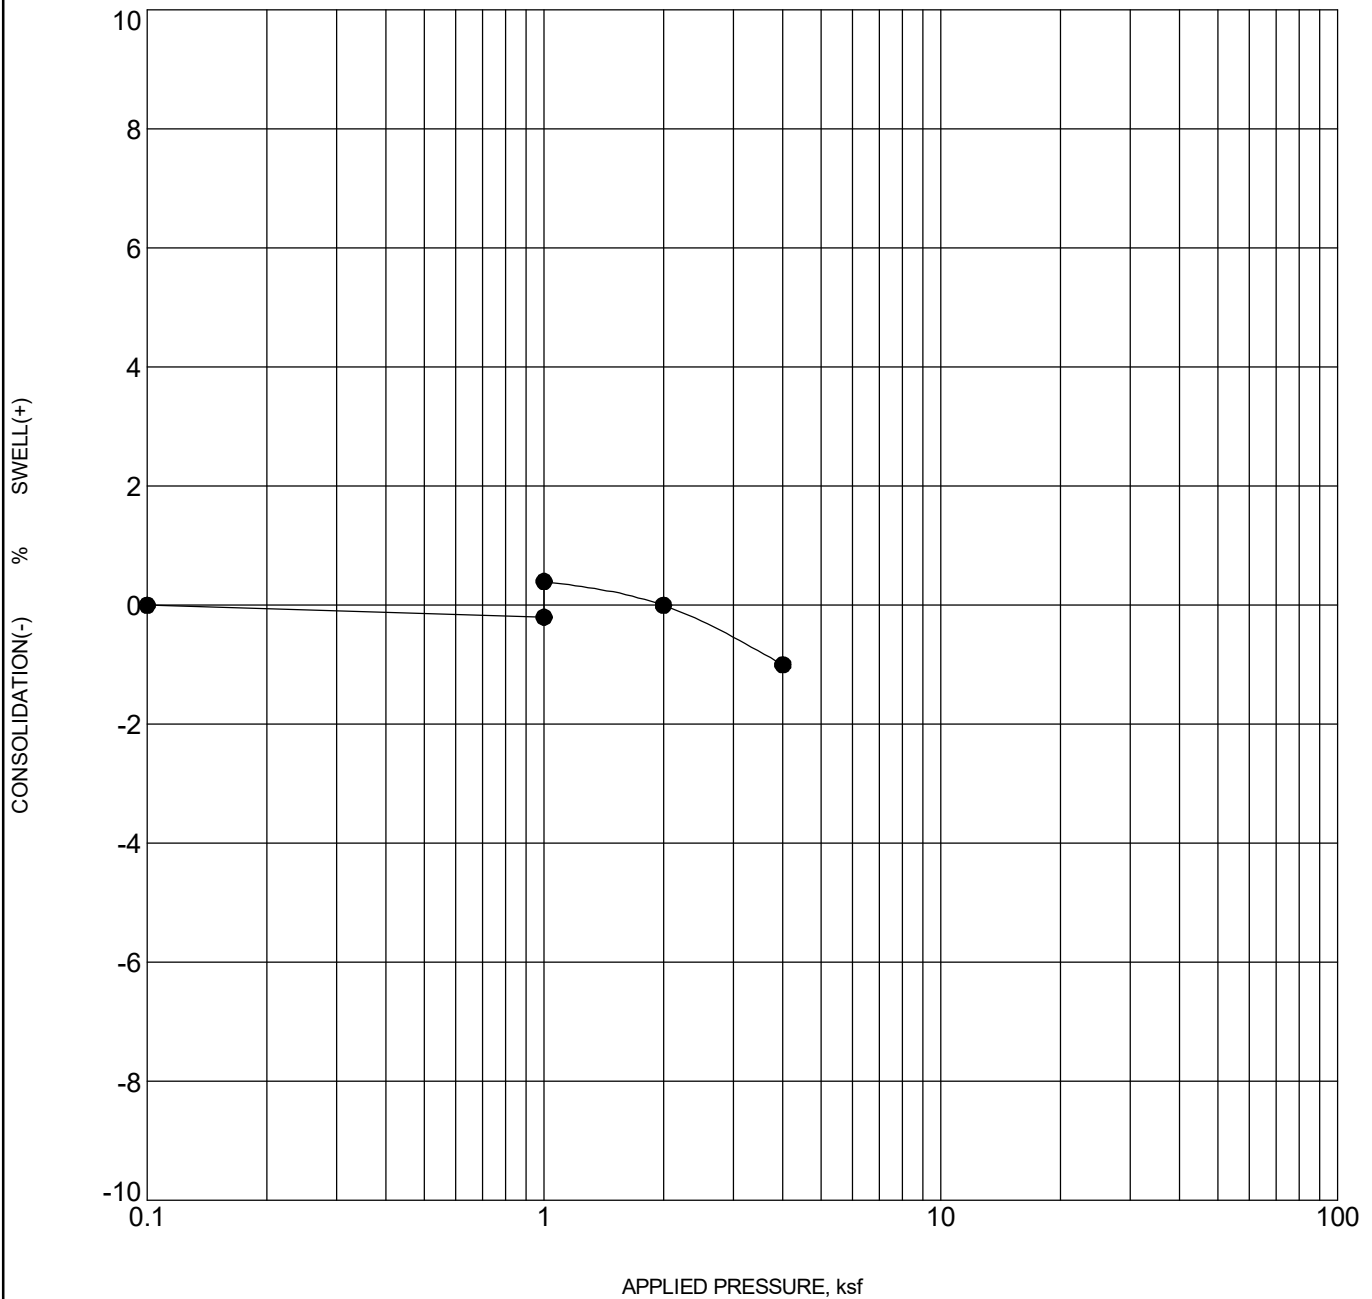

BOREHOLE	DEPTH	Classification	γ_d	MC%
● 2	14.0	CLAYSTONE BEDROCK	119	11

Note: Water Added to Sample at 1000 psf.

Date: 9/6/16



Pickering, Cole, & Hivner
1070 W. 124 Avenue, Suite 300
Westminster, CO. 80234
Telephone: 303.996.2999


SWELL/CONSOLIDATION TEST

CLIENT SFP-E, LLC c/o Galloway

PROJECT NAME Les Schwab Tire Center - Falcon, CO

PROJECT NUMBER 12.298.16


PROJECT LOCATION Meridian Rd. & Rolling Thunder Way

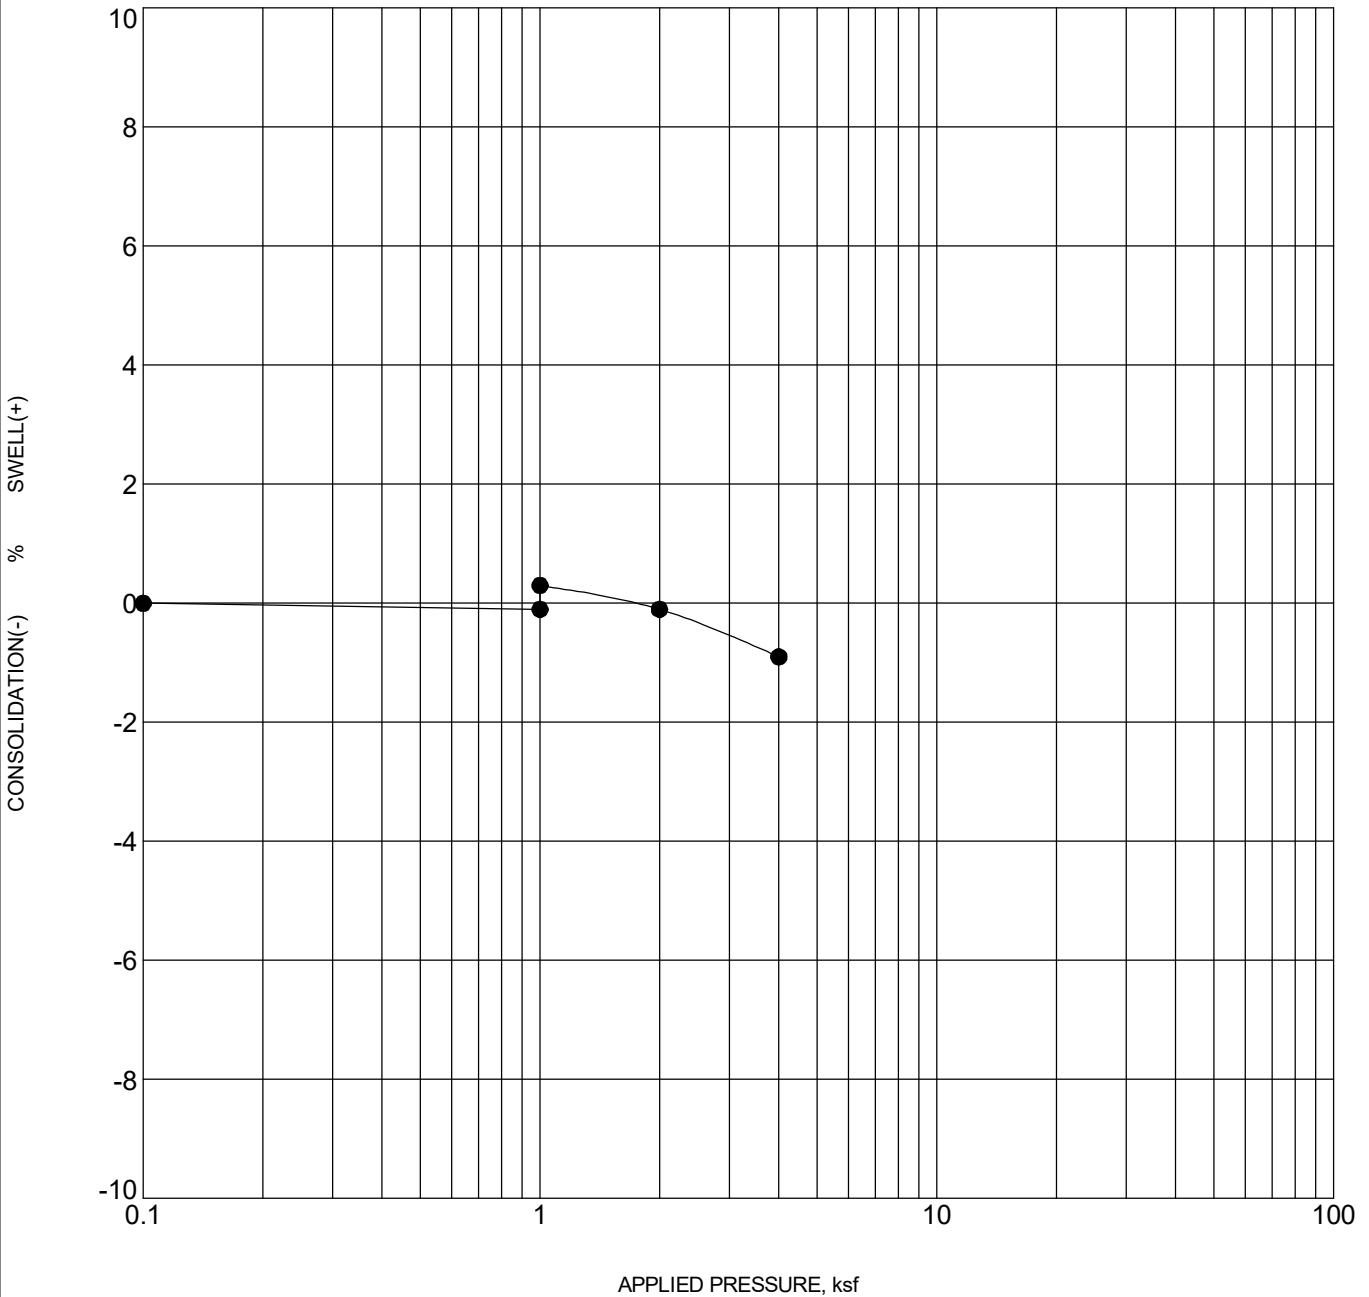

BOREHOLE	DEPTH	Classification	γ_d	MC%
● 3	14.0	CLAYSTONE BEDROCK	123	9

Note: Water Added to Sample at 1000 psf.

Date: 9/6/16



Pickering, Cole, & Hivner
1070 W. 124 Avenue, Suite 300
Westminster, CO. 80234
Telephone: 303.996.2999


SWELL/CONSOLIDATION TEST

CLIENT SFP-E, LLC c/o Galloway

PROJECT NAME Les Schwab Tire Center - Falcon, CO

PROJECT NUMBER 12.298.16


PROJECT LOCATION Meridian Rd. & Rolling Thunder Way

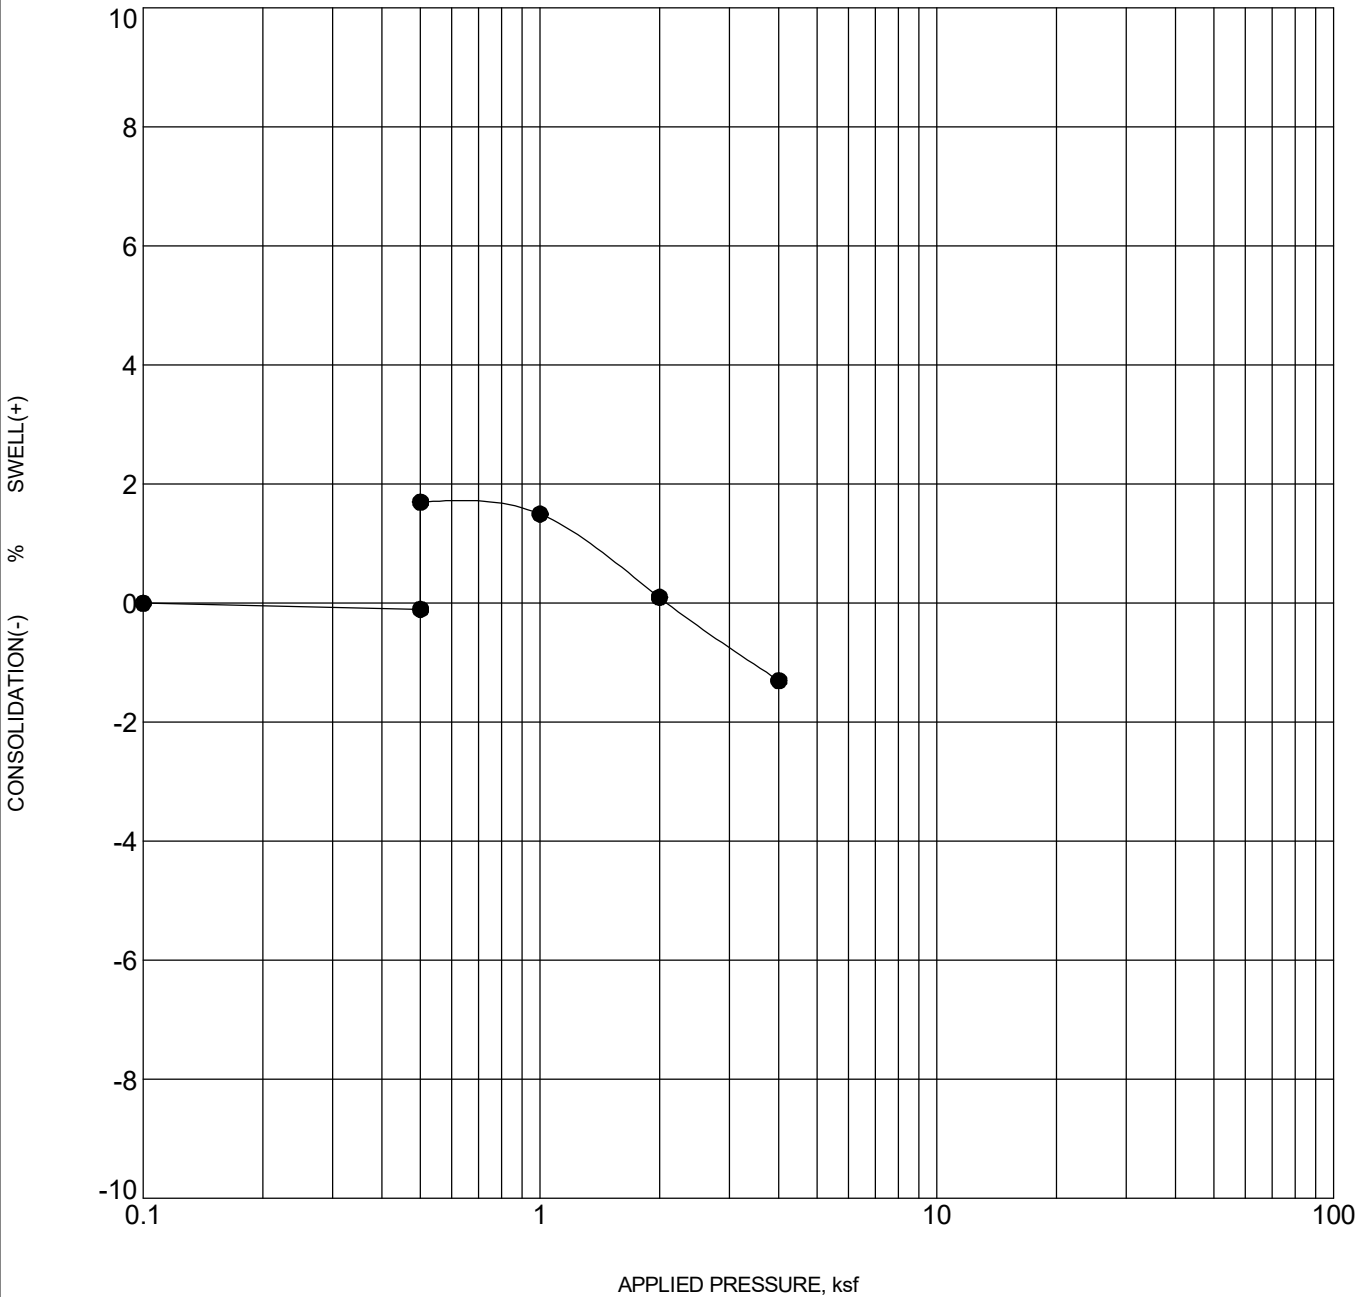

BOREHOLE	DEPTH	Classification	γ_d	MC%
● 4	9.0	SANDY LEAN CLAY(CL)	122	11

Note: Water Added to Sample at 500 psf.

Date: 9/6/16



Pickering, Cole, & Hivner
1070 W. 124 Avenue, Suite 300
Westminster, CO. 80234
Telephone: 303.996.2999


SWELL/CONSOLIDATION TEST

CLIENT SFP-E, LLC c/o Galloway

PROJECT NAME Les Schwab Tire Center - Falcon, CO

PROJECT NUMBER 12.298.16


PROJECT LOCATION Meridian Rd. & Rolling Thunder Way

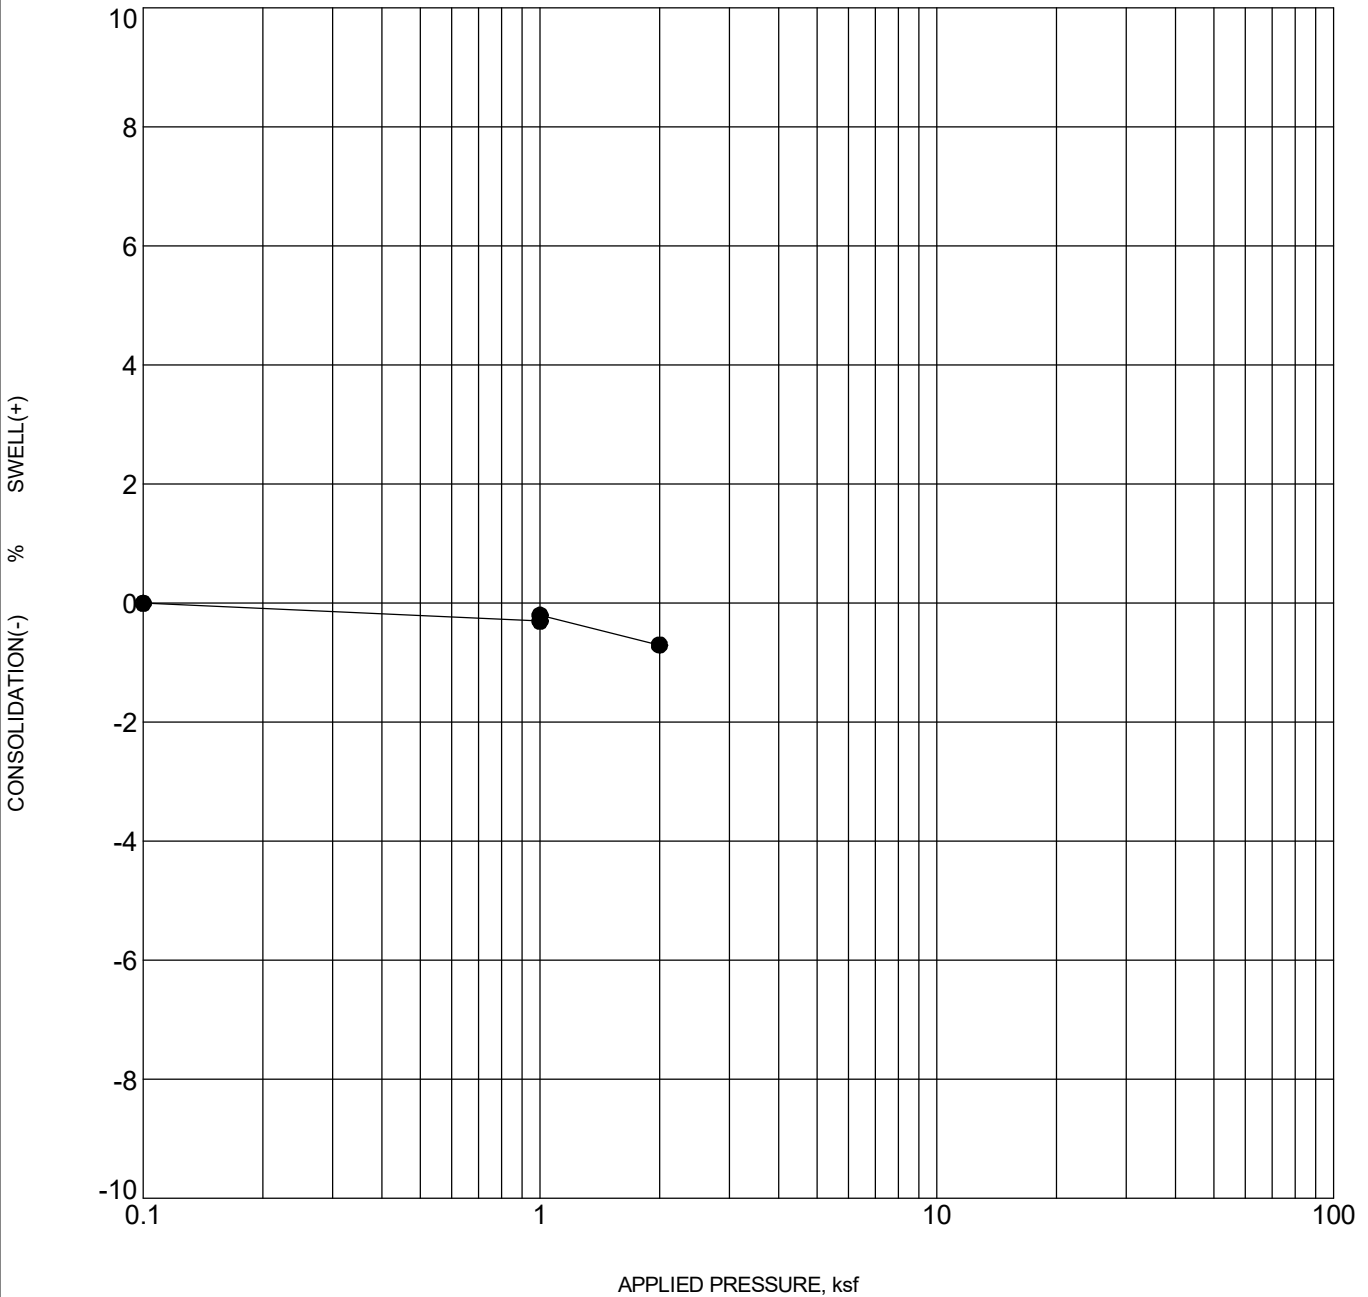

BOREHOLE	DEPTH	Classification	γ_d	MC%
● 4	14.0	LEAN CLAY with SAND	117	11

Note: Water Added to Sample at 1000 psf.

Date: 9/6/16



Pickering, Cole, & Hivner
1070 W. 124 Avenue, Suite 300
Westminster, CO. 80234
Telephone: 303.996.2999


SWELL/CONSOLIDATION TEST

CLIENT SFP-E, LLC c/o Galloway

PROJECT NAME Les Schwab Tire Center - Falcon, CO

PROJECT NUMBER 12.298.16


PROJECT LOCATION Meridian Rd. & Rolling Thunder Way

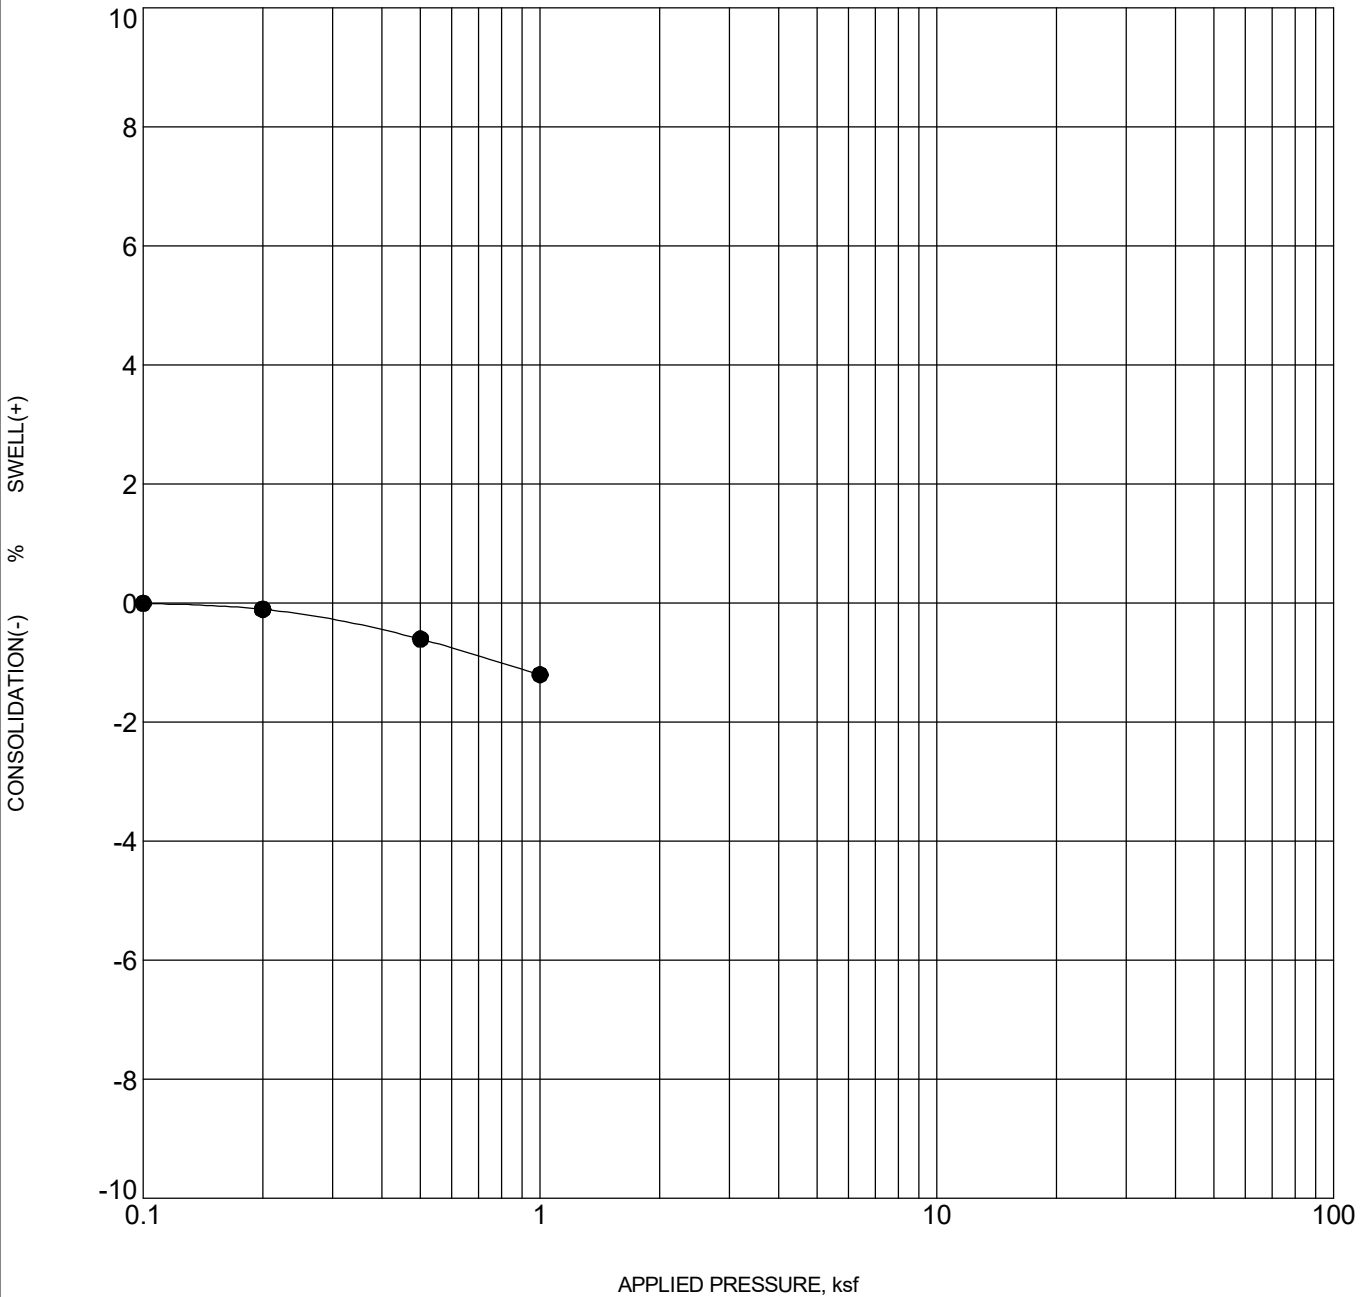

BOREHOLE	DEPTH	Classification	γ_d	MC%
● P2	2.0	SILTY SAND(SM)	115	9

Note: Water Added to Sample at 200 psf.

Date: 9/6/16



Pickering, Cole, & Hivner
1070 W. 124 Avenue, Suite 300
Westminster, CO. 80234
Telephone: 303.996.2999


GRAIN SIZE DISTRIBUTION

CLIENT SFP-E, LLC c/o Galloway

PROJECT NAME Les Schwab Tire Center


PROJECT NUMBER 12.298.16

PROJECT LOCATION Meridian Rd. & Rolling Thunder Way - Falcon, CO

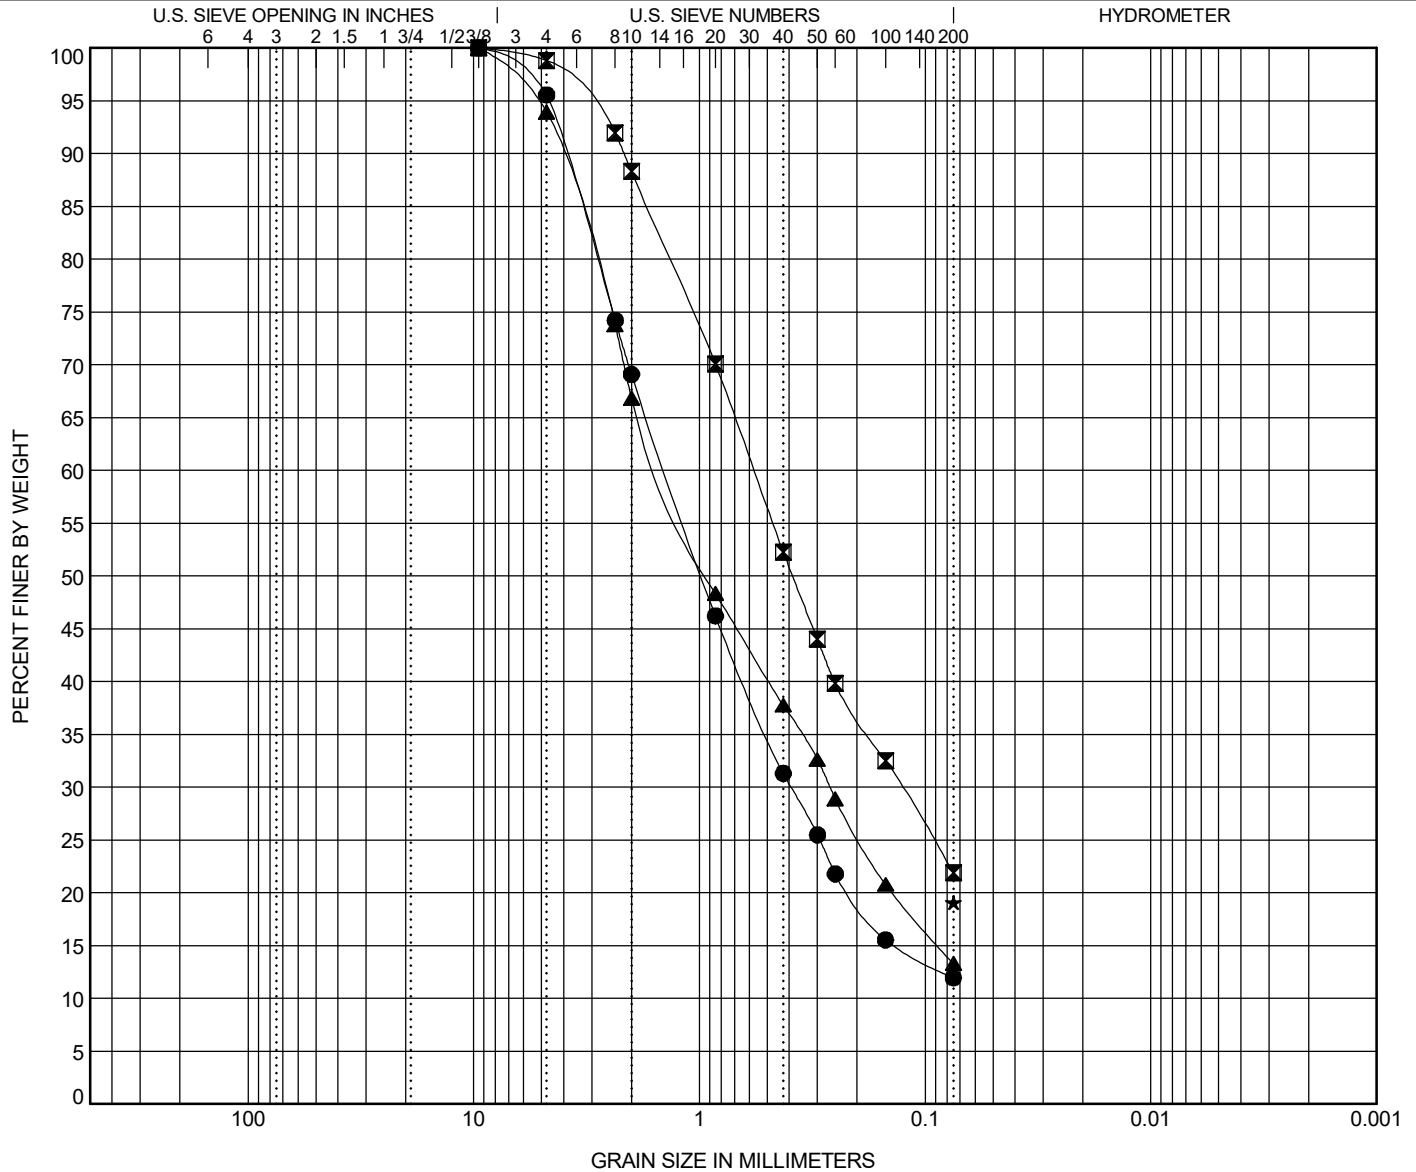

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

BOREHOLE	DEPTH	Classification					LL	PL	PI	Cc	Cu
● 1	4.0	WELL-GRADED SAND with SILT(SW-SM)					NP	NP	NP	2.11	27.68
☒ 3	9.0	SILTY SAND(SM)					NP	NP	NP		
▲ P1	2.0	SILTY SAND(SM)					NP	NP	NP		
★ P2	2.0	SILTY SAND(SM)					NP	NP	NP		
BOREHOLE	DEPTH	D100	D60	D30	D10	%Gravel	%Sand	%Silt		%Clay	
● 1	4.0	9.5	1.423	0.393		4.4	83.6	12.0			
☒ 3	9.0	9.5	0.574	0.127		1.2	76.9	21.9			
▲ P1	2.0	9.5	1.456	0.264		6.1	80.6	13.3			
★ P2	2.0	0.075						19.1			



Pickering, Cole, & Hivner
1070 W. 124 Avenue, Suite 300
Westminster, CO. 80234
Telephone: 303.996.2999

SUMMARY OF LABORATORY RESULTS

PAGE 1 OF 1

CLIENT SFP-E, LLC c/o Galloway

PROJECT NAME Les Schwab Tire Center - Falcon, CO

PROJECT NUMBER 12.298.16

PROJECT LOCATION Meridian Rd. & Rolling Thunder Way

Borehole	Depth	Soil Description	Water Content (%)	Dry Density (pcf)	Swell (+) or Consolidation (-)/ Surcharge (%/psf)	Water Soluble Sulfates (ppm)	Passing #200 Sieve (%)	Atterberg Limits		
								Liquid Limit	Plastic Limit	Plasticity Index
1	4	FINE to COARSE SAND with SILT	5.8	121.4			12	NP	NP	NP
1	9	CLAYEY SAND	11.1	122.9	+0.3/500					
1	14	CLAYEY SAND	12.1	124.2						
1	19	CLAYSTONE BEDROCK	11.7	125.0						
1	24	CLAYSTONE BEDROCK	10.1	127.5						
1	29	CLAYSTONE BEDROCK	11.5	125.7						
1	34	CLAYSTONE BEDROCK	15.6	117.2						
2	2	CLAYEY SAND	6.9	126.2	-0.2/200	0				
2	4	CLAYEY SAND	4.1	117.5						
2	9	CLAYEY SAND	8.3	134.1						
2	14	CLAYSTONE BEDROCK	10.9	118.6	+0.6/1000					
2	19	CLAYSTONE BEDROCK	12.2	125.8						
2	24	CLAYSTONE BEDROCK	10.7	127.7						
3	4	CLAYEY SAND to SILTY SAND	9.5	117.9						
3	9	SILTY SAND(SM)	9.5	127.1			22	NP	NP	NP
3	14	CLAYSTONE BEDROCK	9.4	123.2	+0.4/1000					
3	19	CLAYSTONE BEDROCK	11.1	125.1						
3	24	CLAYSTONE BEDROCK	10.5	123.3						
4	4	CLAYEY SAND	9.8	117.3						
4	9	SANDY LEAN CLAY(CL)	10.7	122.4	+1.8/500	400	70	39	22	17
4	14	LEAN CLAY with SAND	10.6	117.3	+0.1/1000					
4	19	CLAYSTONE BEDROCK	11.1	124.7						
4	24	CLAYSTONE BEDROCK	10.8	124.9						
4	29	CLAYSTONE BEDROCK	18.1	111.8						
4	34	CLAYSTONE BEDROCK	10.9	121.1						
P1	2	SILTY SAND (SM)	4.6	122.5			13	NP	NP	NP
P1	4	SANDY LEAN CLAY	4.6	115.9						
P2	2	SILTY SAND(SM)	8.7	115.0	-0.1/200		19	NP	NP	NP
P2	4	SILTY SAND	12.1	121.2						

APPENDIX C

**GENERAL NOTES
PERIMETER DRAIN DETAIL**



GENERAL NOTES

DRILLING & SAMPLING SYMBOLS:

SS:	Split Spoon - 1½" I.D., 2" O.D., unless otherwise noted	HS:	Hollow Stem Auger
ST:	Thin-Walled Tube – 2.5" O.D., unless otherwise noted	PA:	Power Auger
RS:	Ring Sampler - 2.42" I.D., 3" O.D., unless otherwise noted	HA:	Hand Auger
CB:	California Barrel - 1.92" I.D., 2.5" O.D., unless otherwise noted	RB:	Rock Bit
BS:	Bulk Sample or Auger Sample	WB:	Wash Boring or Mud Rotary

The number of blows required to advance a standard 2-inch O.D. split-spoon sampler (SS) the last 12 inches of the total 18-inch penetration with a 140-pound hammer falling 30 inches is considered the "Standard Penetration" or "N-value". For 2.5" O.D. California Barrel samplers (CB) the penetration value is reported as the number of blows required to advance the sampler 12 inches using a 140-pound hammer falling 30 inches, reported as "blows per inch," and is not considered equivalent to the "Standard Penetration" or "N-value".

WATER LEVEL MEASUREMENT SYMBOLS:

WL:	Water Level	WS:	While Sampling
WCI:	Wet Cave in	WD:	While Drilling
DCI:	Dry Cave in	BCR:	Before Casing Removal
AB:	After Boring	ACR:	After Casing Removal

Water levels indicated on the boring logs are the levels measured in the borings at the times indicated. Groundwater levels at other times and other locations across the site could vary. In pervious soils, the indicated levels may reflect the location of groundwater. In low permeability soils, the accurate determination of groundwater levels may not be possible with only short-term observations.

DESCRIPTIVE SOIL CLASSIFICATION: Soil classification is based on the Unified Classification System. Coarse Grained Soils have more than 50% of their dry weight retained on a #200 sieve; their principal descriptors are: boulders, cobbles, gravel or sand. Fine Grained Soils have less than 50% of their dry weight retained on a #200 sieve; they are principally described as clays if they are plastic, and silts if they are slightly plastic or non-plastic. Major constituents may be added as modifiers and minor constituents may be added according to the relative proportions based on grain size. In addition to gradation, coarse-grained soils are defined on the basis of their in-place relative density and fine-grained soils on the basis of their consistency.

FINE-GRAINED SOILS

<u>(CB)</u> <u>Blows/Ft.</u>	<u>(SS)</u> <u>Blows/Ft.</u>	<u>Consistency</u>
< 3	0-2	Very Soft
3-5	3-4	Soft
6-10	5-8	Medium Stiff
11-18	9-15	Stiff
19-36	16-30	Very Stiff
> 36	> 30	Hard

COARSE-GRAINED SOILS

<u>(CB)</u> <u>Blows/Ft.</u>	<u>(SS)</u> <u>Blows/Ft.</u>	<u>Relative</u> <u>Density</u>
0-5	< 3	Very Loose
6-14	4-9	Loose
15-46	10-29	Medium Dense
47-79	30-50	Dense
> 79	> 50	Very Dense

BEDROCK

<u>(CB)</u> <u>Blows/Ft.</u>	<u>(SS)</u> <u>Blows/Ft.</u>	<u>Consistency</u>
< 24	< 20	Weathered
24-35	20-29	Firm
36-60	30-49	Medium Hard
61-96	50-79	Hard
> 96	> 79	Very Hard

RELATIVE PROPORTIONS OF SAND AND GRAVEL

<u>Descriptive Terms of</u> <u>Other Constituents</u>	<u>Percent of</u> <u>Dry Weight</u>
Trace	< 15
With	15 – 29
Modifier	> 30

GRAIN SIZE TERMINOLOGY

<u>Major Component</u> <u>of Sample</u>	<u>Particle Size</u>
Boulders	Over 12 in. (300mm)
Cobbles	12 in. to 3 in. (300mm to 75 mm)
Gravel	3 in. to #4 sieve (75mm to 4.75 mm)
Sand	#4 to #200 sieve (4.75mm to 0.075mm)
Silt or Clay	Passing #200 Sieve (0.075mm)

RELATIVE PROPORTIONS OF FINES

<u>Descriptive Terms of</u> <u>Other Constituents</u>	<u>Percent of</u> <u>Dry Weight</u>
Trace	< 5
With	5 – 12
Modifiers	> 12

PLASTICITY DESCRIPTION

<u>Term</u>	<u>Plasticity Index</u>
Non-plastic	0
Low	1-10
Medium	11-30
High	30+

UNIFIED SOIL CLASSIFICATION SYSTEM

Criteria for Assigning Group Symbols and Group Names Using Laboratory Tests^A

				Soil Classification	
				Group Symbol	Group Name ^B
Coarse Grained Soils More than 50% retained on No. 200 sieve	Gravels More than 50% of coarse fraction retained on No. 4 sieve	Clean Gravels Less than 5% fines ^C	$Cu \geq 4$ and $1 \leq Cc \leq 3^E$	GW	Well graded gravel ^F
			$Cu < 4$ and/or $1 > Cc > 3^E$	GP	Poorly graded gravel ^F
		Gravels with Fines More than 12% fines ^C	Fines classify as ML or MH	GM	Silty gravel ^{F,G,H}
			Fines classify as CL or CH	GC	Clayey gravel ^{F,G,H}
	Sands 50% or more of coarse fraction passes No. 4 sieve	Clean Sands Less than 5% fines ^D	$Cu \geq 6$ and $1 \leq Cc \leq 3^E$	SW	Well graded sand ^I
			$Cu < 6$ and/or $1 > Cc > 3^E$	SP	Poorly graded sand ^I
Fine-Grained Soils 50% or more passes the No. 200 sieve	Sils and Clays Liquid limit less than 50	Inorganic	$PI > 7$ and plots on or above "A" line ^J	CL	Lean clay ^{K,L,M}
			$PI < 4$ or plots below "A" line ^J	ML	Silt ^{K,L,M}
		Organic	Liquid limit - oven dried	< 0.75	OL
			Liquid limit - not dried		
					Organic clay ^{K,L,M,N}
					Organic silt ^{K,L,M,O}
	Sils and Clays Liquid limit 50 or more	Inorganic	PI plots on or above "A" line	CH	Fat clay ^{K,L,M}
			PI plots below "A" line	MH	Elastic silt ^{K,L,M}
		Organic	Liquid limit - oven dried	< 0.75	OH
			Liquid limit - not dried		
					Organic clay ^{K,L,M,P}
					Organic silt ^{K,L,M,Q}
Highly organic soils		Primarily organic matter, dark in color, and organic odor		PT	Peat

^ABased on the material passing the 3-in. (75-mm) sieve

^BIf field sample contained cobbles or boulders, or both, add "with cobbles or boulders, or both" to group name.

^CGravels with 5 to 12% fines require dual symbols: GW-GM well graded gravel with silt, GW-GC well graded gravel with clay, GP-GM poorly graded gravel with silt, GP-GC poorly graded gravel with clay.

^DSands with 5 to 12% fines require dual symbols: SW-SM well graded sand with silt, SW-SC well graded sand with clay, SP-SM poorly graded sand with silt, SP-SC poorly graded sand with clay

$$^E Cu = D_{60}/D_{10} \quad Cc = \frac{(D_{30})^2}{D_{10} \times D_{60}}$$

^FIf soil contains $\geq 15\%$ sand, add "with sand" to group name.

^GIf fines classify as CL-ML, use dual symbol GC-GM, or SC-SM.

^HIf fines are organic, add "with organic fines" to group name.

^IIf soil contains $\geq 15\%$ gravel, add "with gravel" to group name.

^JIf Atterberg limits plot in shaded area, soil is a CL-ML, silty clay.

^KIf soil contains 15 to 29% plus No. 200, add "with sand" or "with gravel," whichever is predominant.

^LIf soil contains $\geq 30\%$ plus No. 200 predominantly sand, add "sandy" to group name.


^MIf soil contains $\geq 30\%$ plus No. 200, predominantly gravel, add "gravelly" to group name.

^N $PI \geq 4$ and plots on or above "A" line.

^O $PI < 4$ or plots below "A" line.

^P PI plots on or above "A" line.

^Q PI plots below "A" line.

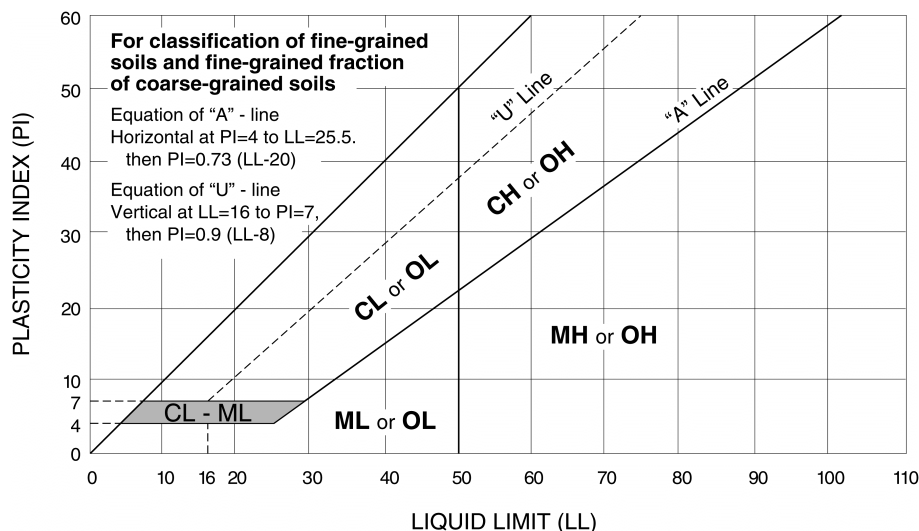

ROCK CLASSIFICATION

(Based on ASTM C-294)

Sedimentary Rocks

Sedimentary rocks are stratified materials laid down by water or wind. The sediments may be composed of particles or pre-existing rocks derived by mechanical weathering, evaporation or by chemical or organic origin. The sediments are usually indurated by cementation or compaction.

Chert	Very fine-grained siliceous rock composed of micro-crystalline or cryptocrystalline quartz, chalcedony or opal. Chert is various colored, porous to dense, hard and has a conchoidal to splintery fracture.
Claystone	Fine-grained rock composed of or derived by erosion of silts and clays or any rock containing clay. Soft massive and may contain carbonate minerals.
Conglomerate	Rock consisting of a considerable amount of rounded gravel, sand and cobbles with or without interstitial or cementing material. The cementing or interstitial material may be quartz, opal, calcite, dolomite, clay, iron oxides or other materials.
Dolomite	A fine-grained carbonate rock consisting of the mineral dolomite $[\text{CaMg}(\text{CO}_3)_2]$. May contain noncarbonate impurities such as quartz, chert, clay minerals, organic matter, gypsum and sulfides. Reacts with hydrochloric acid (HCL).
Limestone	A fine-grained carbonate rock consisting of the mineral calcite (CaCO_3). May contain noncarbonate impurities such as quartz, chert, clay minerals, organic matter, gypsum and sulfides. Reacts with hydrochloric acid (HCL).
Sandstone	Rock consisting of particles of sand with or without interstitial and cementing materials. The cementing or interstitial material may be quartz, opal, calcite, dolomite, clay, iron oxides or other material.
Shale	Fine-grained rock composed of or derived by erosion of silts and clays or any rock containing clay. Shale is hard, platy, of fissile may be gray, black, reddish or green and may contain some carbonate minerals (calcareous shale).
Siltstone	Fine grained rock composed of or derived by erosion of silts or rock containing silt. Siltstones consist predominantly of silt sized particles (0.0625 to 0.002 mm in diameter) and are intermediate rocks between claystones and sandstones and may contain carbonate minerals.

ROCK CLASSIFICATION

(Based on ASTM C-294)

Metamorphic Rocks

Metamorphic rocks form from igneous, sedimentary, or pre-existing metamorphic rocks in response to changes in chemical and physical conditions occurring within the earth's crust after formation of the original rock. The changes may be textural, structural, or mineralogic and may be accompanied by changes in chemical composition. The rocks are dense and may be massive but are more frequently foliated (laminated or layered) and tend to break into platy particles. The mineral composition is very variable depending in part on the degree of metamorphism and in part on the composition of the original rock.

Marble	A recrystallized medium- to coarse-grained carbonate rock composed of calcite or dolomite, or calcite and dolomite. The original impurities are present in the form of new minerals, such as micas, amphiboles, pyroxenes, and graphite.
Metaquartzite	A granular rock consisting essentially of recrystallized quartz. Its strength and resistance to weathering derive from the interlocking of the quartz grains.
Slate	A fine-grained metamorphic rock that is distinctly laminated and tends to split into thin parallel layers. The mineral composition usually cannot be determined with the unaided eye.
Schist	A highly layered rock tending to split into nearly parallel planes (schistose) in which the grain is coarse enough to permit identification of the principal minerals. Schists are subdivided into varieties on the basis of the most prominent mineral present in addition to quartz or to quartz and feldspars; for instance, mica schist. Greenschist is a green schistose rock whose color is due to abundance of one or more of the green minerals, chlorite or amphibole, and is commonly derived from altered volcanic rock.
Gneiss	One of the most common metamorphic rocks, usually formed from igneous or sedimentary rocks by a higher degree of metamorphism than the schists. It is characterized by a layered or foliated structure resulting from approximately parallel lenses and bands of platy minerals, usually micas or prisms, usually amphiboles, and of granular minerals, usually quartz and feldspars. All intermediate varieties between gneiss and schist and between gneiss and granite are often found in the same areas in which well-defined gneisses occur.

ROCK CLASSIFICATION

(Based on ASTM C-294)

Igneous Rocks

Igneous rocks are formed by cooling from a molten rock mass (magma). Igneous rocks are divided into two classes (1) plutonic, or intrusive, that have cooled slowly within the earth; and (2) volcanic, or extrusive, that formed from quickly cooled lavas. Plutonic rocks have grain sizes greater than approximately 1 mm, and are classified as coarse- or medium-grained. Volcanic rocks have grain sizes less than approximately 1 mm, and are classified as fine-grained. Volcanic rocks frequently contain glass. Both plutonic and volcanic rocks may consist of porphyries that are characterized by the presence of large mineral grains in a fine-grained or glassy groundmass. This is the result of sharp changes in rate of cooling or other physico-chemical conditions during solidification of the melt.

Granite

Granite is a medium- to coarse-grained light-colored rock characterized by the presence of potassium feldspar with lesser amounts of plagioclase feldspars and quartz. The characteristic potassium feldspars are orthoclase or microcline, or both; the common plagioclase feldspars are albite and oligoclase. Feldspars are more abundant than quartz. Dark-colored mica (biotite) is usually present, and light-colored mica (muscovite) is frequently present. Other dark-colored ferromagnesian minerals, especially hornblende, may be present in amounts less than those of the light-colored constituents.

Quartz-Monzonite and Grano-Diorite

Rocks similar to granite but contain more plagioclase feldspar than potassium feldspar.

Basalt

Fine-grained extrusive equivalent of gabbro and diabase. When basalt contains natural glass, the glass is generally lower in silica content than that of the lighter-colored extrusive rocks.

**LABORATORY TEST
SIGNIFICANCE AND PURPOSE**

TEST	SIGNIFICANCE	PURPOSE
<i>California Bearing Ratio</i>	Used to evaluate the potential strength of subgrade soil, subbase, and base course material, including recycled materials for use in road and airfield pavements.	<i>Pavement Thickness Design</i>
<i>Consolidation</i>	Used to develop an estimate of both the rate and amount of both differential and total settlement of a structure.	<i>Foundation Design</i>
<i>Direct Shear</i>	Used to determine the consolidated drained shear strength of soil or rock.	<i>Bearing Capacity, Foundation Design, and Slope Stability</i>
<i>Dry Density</i>	Used to determine the in-place density of natural, inorganic, fine-grained soils.	<i>Index Property Soil Behavior</i>
<i>Expansion</i>	Used to measure the expansive potential of fine-grained soil and to provide a basis for swell potential classification.	<i>Foundation and Slab Design</i>
<i>Gradation</i>	Used for the quantitative determination of the distribution of particle sizes in soil.	<i>Soil Classification</i>
<i>Liquid & Plastic Limit, Plasticity Index</i>	Used as an integral part of engineering classification systems to characterize the fine-grained fraction of soils, and to specify the fine-grained fraction of construction materials.	<i>Soil Classification</i>
<i>Permeability</i>	Used to determine the capacity of soil or rock to conduct a liquid or gas.	<i>Groundwater Flow Analysis</i>
<i>pH</i>	Used to determine the degree of acidity or alkalinity of a soil.	<i>Corrosion Potential</i>
<i>Resistivity</i>	Used to indicate the relative ability of a soil medium to carry electrical currents.	<i>Corrosion Potential</i>
<i>R-Value</i>	Used to evaluate the potential strength of subgrade soil, subbase, and base course material, including recycled materials for use in road and airfield pavements.	<i>Pavement Thickness Design</i>
<i>Soluble Sulfate</i>	Used to determine the quantitative amount of soluble sulfates within a soil mass.	<i>Corrosion Potential</i>
<i>Unconfined Compression</i>	To obtain the approximate compressive strength of soils that possess sufficient cohesion to permit testing in the unconfined state.	<i>Bearing Capacity Analysis for Foundations</i>
<i>Water Content</i>	Used to determine the quantitative amount of water in a soil mass.	<i>Index Property Soil Behavior</i>


REPORT TERMINOLOGY (Based on ASTM D653)

<i>Allowable Soil Bearing Capacity</i>	The recommended maximum contact stress developed at the interface of the foundation element and the supporting material.
<i>Alluvium</i>	Soil, the constituents of which have been transported in suspension by flowing water and subsequently deposited by sedimentation.
<i>Aggregate Base Course</i>	A layer of specified material placed on a subgrade or subbase usually beneath slabs or pavements.
<i>Backfill</i>	A specified material placed and compacted in a confined area.
<i>Bedrock</i>	A natural aggregate of mineral grains connected by strong and permanent cohesive forces. Usually requires drilling, wedging, blasting or other methods of extraordinary force for excavation.
<i>Bench</i>	A horizontal surface in a sloped deposit.
<i>Caisson (Drilled Pier or Shaft)</i>	A concrete foundation element cast in a circular excavation which may have an enlarged base. Sometimes referred to as a cast-in-place pier or drilled shaft.
<i>Coefficient of Friction</i>	A constant proportionality factor relating normal stress and the corresponding shear stress at which sliding starts between the two surfaces.
<i>Colluvium</i>	Soil, the constituents of which have been deposited chiefly by gravity such as at the foot of a slope or cliff.
<i>Compaction</i>	The densification of a soil by means of mechanical manipulation
<i>Concrete Slab-on-Grade</i>	A concrete surface layer cast directly upon a base, subbase or subgrade, and typically used as a floor system.
<i>Differential Movement</i>	Unequal settlement or heave between, or within foundation elements of structure.
<i>Earth Pressure</i>	The pressure exerted by soil on any boundary such as a foundation wall.
<i>ESAL</i>	Equivalent Single Axle Load, a criteria used to convert traffic to a uniform standard, (18,000 pound axle loads).
<i>Engineered Fill</i>	Specified material placed and compacted to specified density and/or moisture conditions under observations of a representative of a geotechnical engineer.
<i>Equivalent Fluid</i>	A hypothetical fluid having a unit weight such that it will produce a pressure against a lateral support presumed to be equivalent to that produced by the actual soil. This simplified approach is valid only when deformation conditions are such that the pressure increases linearly with depth and the wall friction is neglected.
<i>Existing Fill (or Man-Made Fill)</i>	Materials deposited throughout the action of man prior to exploration of the site.
<i>Existing Grade</i>	The ground surface at the time of field exploration.

REPORT TERMINOLOGY (Based on ASTM D653)

<i>Expansive Potential</i>	The potential of a soil to expand (increase in volume) due to absorption of moisture.
<i>Finished Grade</i>	The final grade created as a part of the project.
<i>Footing</i>	A portion of the foundation of a structure that transmits loads directly to the soil.
<i>Foundation</i>	The lower part of a structure that transmits the loads to the soil or bedrock.
<i>Frost Depth</i>	The depth at which the ground becomes frozen during the winter season.
<i>Grade Beam</i>	A foundation element or wall, typically constructed of reinforced concrete, used to span between other foundation elements such as drilled piers.
<i>Groundwater</i>	Subsurface water found in the zone of saturation of soils or within fractures in bedrock.
<i>Heave</i>	Upward movement.
<i>Lithologic</i>	The characteristics which describe the composition and texture of soil and rock by observation.
<i>Native Grade</i>	The naturally occurring ground surface.
<i>Native Soil</i>	Naturally occurring on-site soil, sometimes referred to as natural soil.
<i>Optimum Moisture Content</i>	The water content at which a soil can be compacted to a maximum dry unit weight by a given compactive effort.
<i>Perched Water</i>	Groundwater, usually of limited area maintained above a normal water elevation by the presence of an intervening relatively impervious continuous stratum.
<i>Scarify</i>	To mechanically loosen soil or break down existing soil structure.
<i>Settlement</i>	Downward movement.
<i>Skin Friction (Side Shear)</i>	The frictional resistance developed between soil and an element of the structure such as a drilled pier.
<i>Soil (Earth)</i>	Sediments or other unconsolidated accumulations of solid particles produced by the physical and chemical disintegration of rocks, and which may or may not contain organic matter.
<i>Strain</i>	The change in length per unit of length in a given direction.
<i>Stress</i>	The force per unit area acting within a soil mass.
<i>Strip</i>	To remove from present location.
<i>Subbase</i>	A layer of specified material in a pavement system between the subgrade and base course.
<i>Subgrade</i>	The soil prepared and compacted to support a structure, slab or pavement system.

COHEISVE, ON-SITE CLAY BACKFILL SOILS
PROPERLY MOISTURE CONDITIONED AND
COMPACTED AS RECOMMENDED IN THE
GEOTECHNICAL ENGINEERING REPORT.

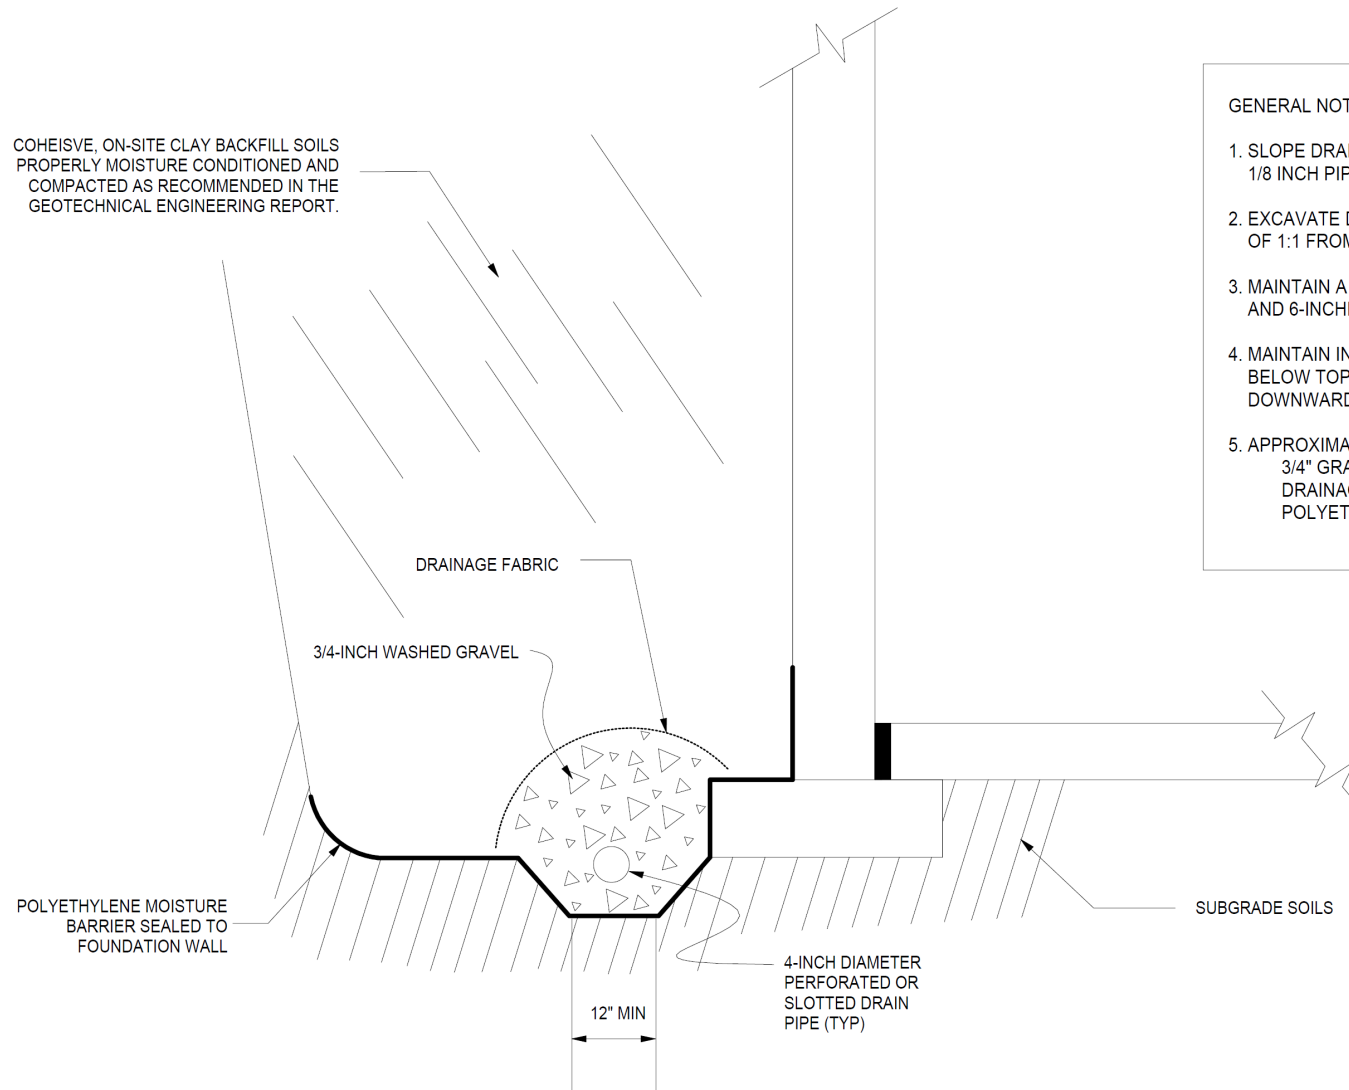


GENERAL NOTES:

1. SLOPE DRAIN TRENCH AND PIPE AT A MINIMUM OF 1/8 INCH PER LINEAL FOOT TO SUITABLE OUTFALL.
2. EXCAVATE DRAIN TRENCH AT A MAXIMUM SLOPE OF 1:1 FROM EDGE OF FOOTING.
3. MAINTAIN A MINIMUM OF 3-INCHES OF GRAVEL BELOW AND 6-INCHES ABOVE DRAIN PIPES.
4. MAINTAIN INVERT OF DRAIN PIPE A MINIMUM OF 6 INCHES BELOW TOP OF FOOTING. PERFORATIONS SHOULD BE FACING DOWNWARD.
5. APPROXIMATE QUANTITIES (PER LINEAL FOOT):
3/4" GRAVEL - 1 1/2 CUBIC FT.
DRAINAGE FABRIC - 2 SQUARE FT.
POLYETHELENE - 6 SQUARE FT.

NOT TO SCALE

TYPICAL EXTERIOR PERIMETER DRAIN DETAIL FOOTING FOUNDATION



Pickering, Cole, & Hivner, LLC
1070 W. 124TH Ave., Suite 300
Westminster, CO 80234
(303) 996-2999