

REVISION TO:
MASTER DEVELOPMENT
DRAINAGE PLAN
MERIDIAN RANCH
EL PASO COUNTY, COLORADO



MERIDIAN RANCH

A GOLF & RECREATIONAL COMMUNITY

June 2017

Prepared For:

GTL DEVELOPMENT, INC.
P.O. Box 80036
San Diego, CA 92138

Prepared By:
Tech Contractors
11886 Stapleton Drive
Falcon, CO 80831
719.495.7444

PCD Project No.

CERTIFICATIONS

Design Engineer's Statement:

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the applicable master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.

Thomas A. Kerby, P.E. #31429

Date

Owner/Developer's Statement:

I, the owner/developer have read and will comply with all of the requirements specified in this drainage report and plan.

Raul Guzman, Vice President
GTL Development, Inc.
P.O. Box 80036
San Diego, CA 92138

Date

El Paso County:

Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 & 2, El Paso County Engineering Criteria Manual and Land Development Code as amended.

Jennifer Irvine, P.E.
County Engineer / ECM Administrator

Date

Stonebridge Filing 3 at Meridian Ranch Final Drainage Plan

Table of Contents

| | |
|---|-----------|
| <i>EXECUTIVE SUMMARY</i> _____ | <i>i</i> |
| <i>INTRODUCTION</i> _____ | <i>1</i> |
| Purpose _____ | 1 |
| Scope _____ | 1 |
| <i>EXISTING CONDITIONS</i> _____ | <i>1</i> |
| General Location _____ | 1 |
| Land Use _____ | 1 |
| Topography and Floodplains _____ | 3 |
| Geology _____ | 3 |
| Columbine series _____ | 3 |
| Pring series _____ | 5 |
| Stapleton series _____ | 5 |
| Climate _____ | 6 |
| Natural Hazards Analysis _____ | 6 |
| <i>DRAINAGE BASINS AND SUB-BASINS</i> _____ | <i>8</i> |
| Falcon Basin _____ | 8 |
| Bennett Ranch Basin _____ | 8 |
| Haegler Ranch Basin _____ | 8 |
| Gieck Ranch Basin _____ | 8 |
| <i>DRAINAGE DESIGN CRITERIA</i> _____ | <i>9</i> |
| SCS Hydrograph Procedure _____ | 9 |
| Channel Improvements _____ | 10 |
| Detention Storage Criteria _____ | 10 |
| <i>DRAINAGE CALCULATIONS</i> _____ | <i>11</i> |
| General Concept _____ | 11 |
| Existing Drainage Characteristics _____ | 11 |
| Falcon Basin _____ | 11 |
| Bennett Ranch Basin _____ | 11 |
| Haegler Ranch Basin _____ | 11 |
| Gieck Ranch Basin _____ | 11 |
| Proposed Design Drainage Characteristics _____ | 14 |
| Falcon Basin _____ | 14 |
| Bennett Ranch Basin _____ | 14 |
| Gieck Ranch Basin _____ | 14 |
| Haegler Ranch Basin _____ | 19 |
| <i>MAJOR DRAINAGE STRUCTURES</i> _____ | <i>19</i> |
| <i>EROSION CONTROL DESIGN</i> _____ | <i>21</i> |
| General Concept _____ | 21 |
| Four Step Process _____ | 21 |
| Detention Pond _____ | 22 |
| Silt Fence _____ | 22 |
| Erosion Bales _____ | 22 |
| Miscellaneous _____ | 22 |
| <i>REFERENCES</i> _____ | <i>23</i> |

Figures

Figure 1: Vicinity Map 2
Figure 2: FEMA Floodplain Map..... 4
Figure 3: Soils Map 7
Figure 4 - Meridian Ranch SCS Method – Historic Basin Map..... BACK POCKET
Figure 5 - Meridian Ranch SCS Method – Future Basin Map BACK POCKET

Tables

Table 1: Master Plan Land Use 3
Table 2: SCS Runoff Curve Numbers 9
Table 3 - Historic Condition Peak Flow Rates..... 12
Table 4 - Developed Condition Peak Flow Rates..... 15
Table 5 - Allowable Discharge Rates from Meridian Ranch 19
Table 6 - Detention Pond Summary 19
Table 7 - Major Drainage Structures 20

Appendices:

- Appendix A - SCS Input Data (HEC-HMS)
- Appendix B - HEC-HMS Results
- Appendix C - Detention Pond Information

EXECUTIVE SUMMARY

The purpose of the revision to the following Master Development Drainage Plan is to present updated conceptual drainage improvements for the Meridian Ranch Development based upon the proposed sketch plan amendment, ZCP and up to date data from within the development. Runoff quantities and proposed facilities have been calculated using the current City of Colorado Springs/El Paso County Drainage Criteria Manual (DCM) (1994 version) and the City of Colorado Springs Drainage Criteria Manual, Volume 1 (DCM-1) ((2014 version). Concepts presented in this report will be refined and specific improvements addressed during the Final Plat process.

The revisions included within this report include the density increase as proposed with this sketch plan amendment. The previous revision to the MDDP (2015) included the removal of the regional park land mass from the Meridian Ranch developed property and the relocation of the detention ponds originally located along Eastonville Road to locations upstream and immediately adjacent to the parklands. The relocation of the detention ponds designated as Ponds G and I result in a change in the release rate at that location. The historic calculations remain the same from the 2015 MDDP revision. The developed calculations reflect the density increase sought in this revision.

The original boundary limits of Meridian Ranch encompassed 2620 acre proposed development and is located approximately 12 miles northeast of the City of Colorado Springs, 2.5 miles north of the town of Falcon and immediately north of the Woodmen Hills development.

The Sketch Plan amendment includes all the remaining 850 acres of undeveloped portion of Meridian Ranch. Of the undeveloped land it is proposed to have 415 acres of residential development; 3 acres of metropolitan district facilities; 255 acres of open space, drainage/detention facilities and park sites; 53 acres dedicated to school sites; and 124 acres of R.O.W.

The calculated developed flows in excess of the existing runoff discharge will be mitigated with the use of full spectrum detention facilities to be located within the project and along eastern boundary of the project. The Meridian Ranch Development will not adversely impact the downstream properties.

Revise. The calculations seem to be designed to release at historic rate.

Revise statement and note 90% of predevelopment per current Full Spectrum Detention criteria.

INTRODUCTION

Purpose

The purpose of the revision to the following Master Development Drainage Plan is to present updated conceptual drainage improvements for the Meridian Ranch Development based upon the proposed sketch plan and up to date construction within the development. The calculated developed flows in excess of eighty percent (80%) of the historic runoff discharge across eastern boundary of the project will be mitigated with the use of detention facilities to be located within the project and along eastern project boundary. Concepts presented in this report will be refined and specific improvements addressed during the Final Plat process.

Scope

The scope of this report includes:

- Location and description of the proposed development stating the proposed land use, density, acreage and adjacent features to the site.
- Calculations for design peak flows from all off-site tributary drainage areas.
- Calculations for design peak flows within the proposed development for all drainage areas.
- Discussion of major drainage facilities required as a result of the development.
- Discussion and analysis of existing and proposed facilities.

Runoff quantities and proposed facilities have been calculated using the current City of Colorado Springs/El Paso County Drainage Criteria Manual (DCM) (1994 version) and the City of Colorado Springs Drainage Criteria Manual, Volume 1 (DCM-1) ((2014 version).

EXISTING CONDITIONS

General Location

Meridian Ranch encompasses 2620 acres of proposed residential development and is located approximately 12 miles northeast of the City of Colorado Springs, 2.5 miles north of the town of Falcon and immediately north of the Woodmen Hills development in El Paso County. Please see Figure 1: Vicinity Map.

Land Use

In the past farming and ranching dominated the area surrounding Meridian Ranch. However, urbanization has been occurring in the general vicinity for several years. Most notably, urbanization is occurring within the Meridian Ranch Development with the completion of several filings, Woodmen Hills to the south, to the west is the Paint Brush Hills subdivision, 4 Way Ranch to the east and Latigo Trails and Antlers Ridge to the north.

The Sketch Plan amendment includes all the remaining 850 acres of undeveloped portion of Meridian Ranch. Of the undeveloped land it is proposed to have 415 acres of residential development; 3 acres of metropolitan district facilities; 255 acres of open space, drainage/detention facilities and park sites; 53 acres dedicated to school sites; and 124 acres of R.O.W.

Figure 1: Vicinity Map

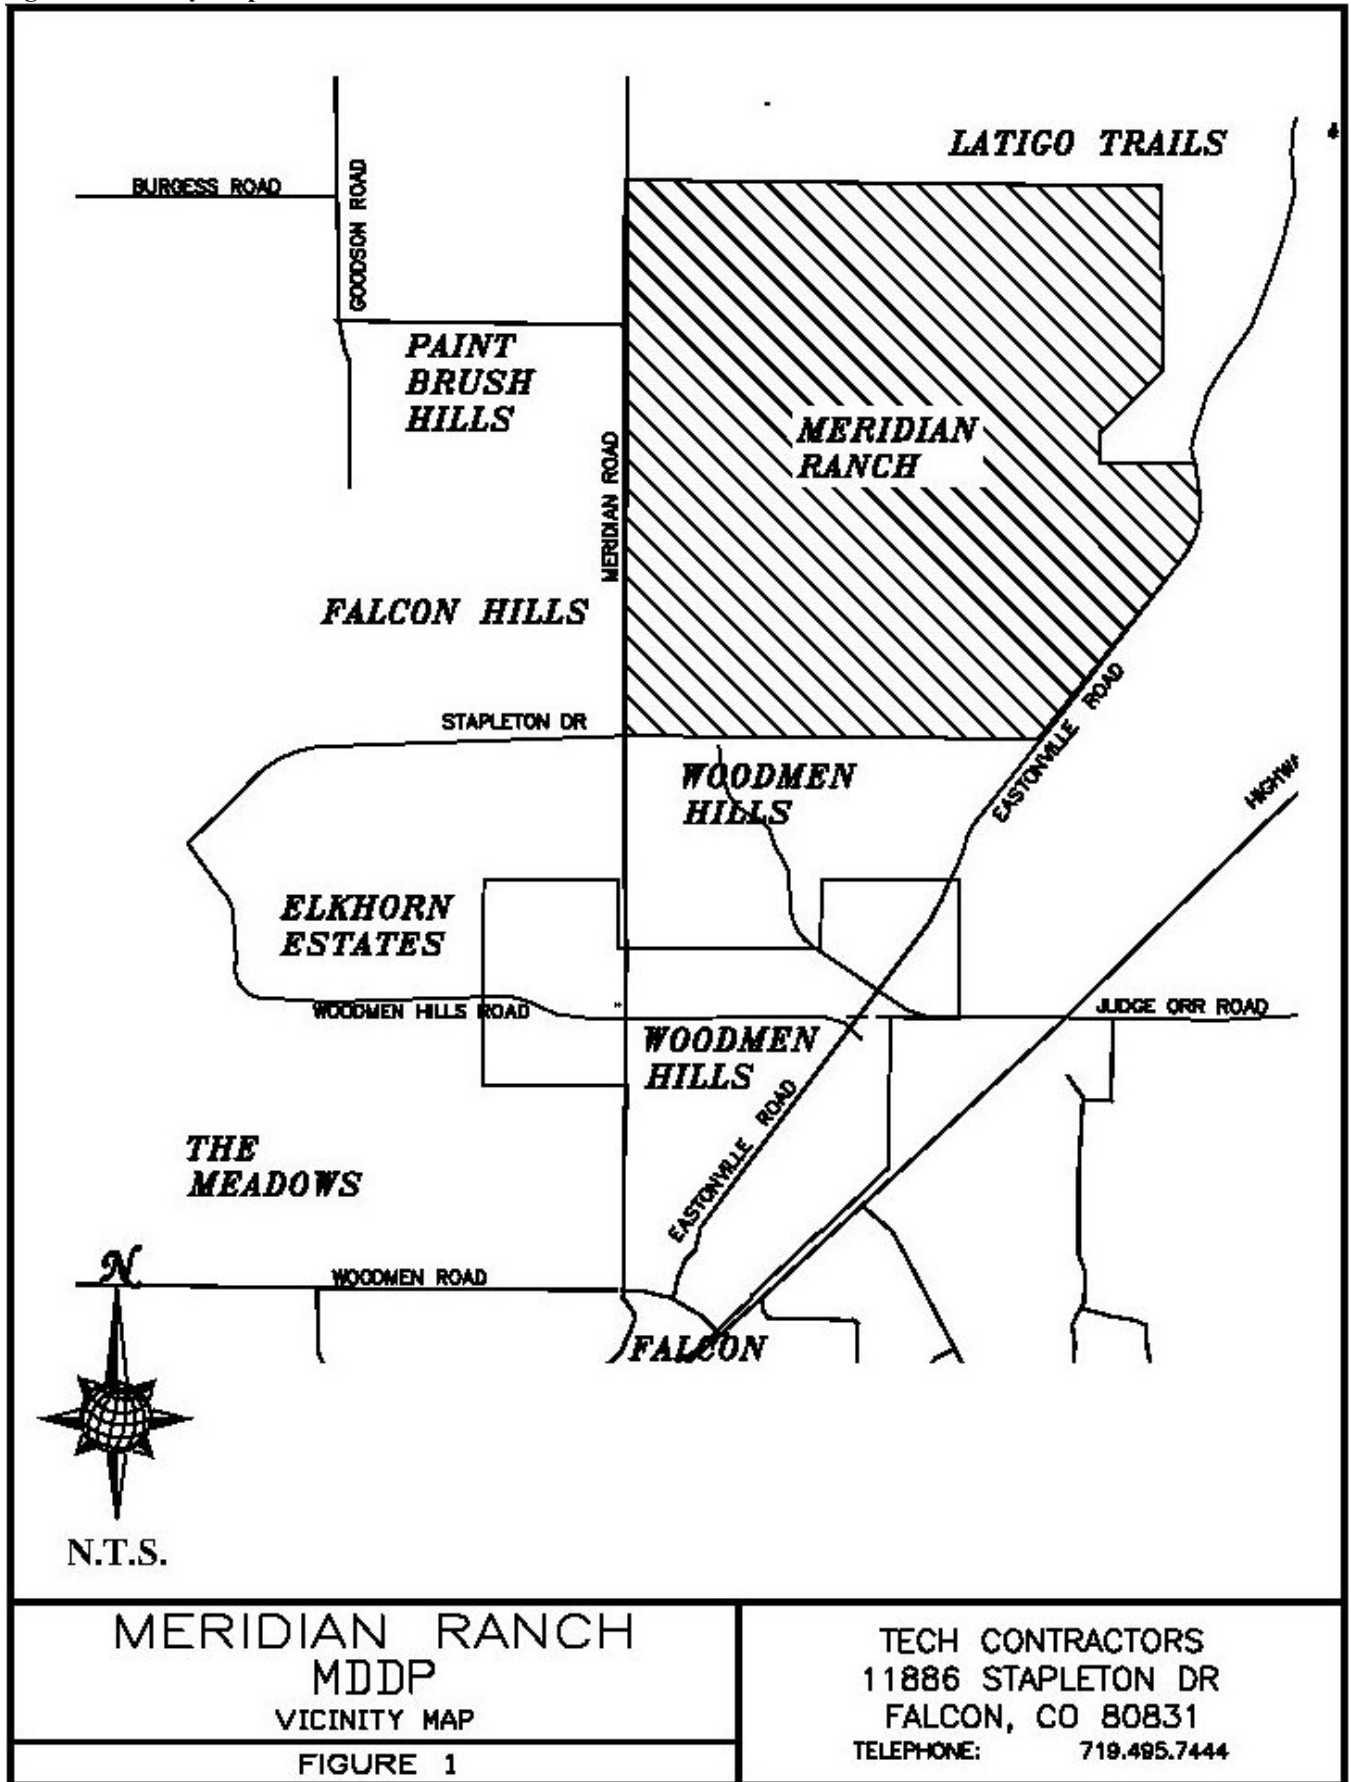


Table 1: Master Plan Land Use

| Land Use | Original Acres | Amended | Notes |
|------------------------------|-----------------------|----------------|--------------|
| Single Family Residential | 1115 | 415 | 4400 DU |
| Commercial/Business | 15 | 0 | |
| Dedicated School Sites | 128 | 53 | |
| Metro District Facilities | 46 | 3 | |
| Wastewater Facility | 14 | 0 | |
| Right of Way | 387 | 124 | |
| Park/Open Space/Det. Fac. | 875 | 255 | |
| Total | 2620 | 850 | |

Topography and Floodplains

The topography of the site is typical of a high desert, short grass prairie with relatively flat slopes generally ranging from 2% to 4%. The area drains generally from northwest to southeast being tributary to the Bennett Ranch, Haegler Ranch and Gieck Ranch Drainage Basins, all of which are tributary to Black Squirrel Creek.

The Federal Emergency Management Agency (FEMA) has established floodplain along portions of the tributary streams located in the Gieck Ranch Basin. A LOMR was processed through FEMA in 2014, becoming effective on March 24, 2015 over the eastern portion of the site within the Gieck Ranch Drainage Basin. See

Figure 2: FEMA Floodplain Map

Geology


Soil Conservation Service soil survey records indicate that the service area is predominately covered by soils classified in the Stapleton series (83) with portions classified from the Pring series (71), both categorized in the Hydrological Group B, areas of Columbine soils (19) are also found on the site, categorized in the Hydrological Group A. For the purposes of this report all soils were assumed to be from the Hydrological Group B, producing a higher runoff value. Typically, these soils are well drained, gravelly sandy loams that form on alluvial terraces and fans and exhibit high permeability and low available water capacity with depth to bedrock greater than 6 feet.

Columbine series

The Columbine series consists of deep, well drained to excessively drained soils that formed in very gravelly ar-kosic alluvium. These soils are on terraces, flood plains, and alluvial fans and in drainageways. They have slopes of 0 to 3 percent. Average annual precipitation is about 15 inches, and average annual air temperature is about 47 degrees F.

Columbine soils are similar to Chaseville soils and are near Ellicott and Pring soils. Chaseville soils have hue of 5YR to 10YR. Ellicott soils have a light colored surface layer. Pring soils are less than 35 percent gravel and have a mean annual soil temperature of less than 47 degrees F.

Figure 2: FEMA Floodplain Map

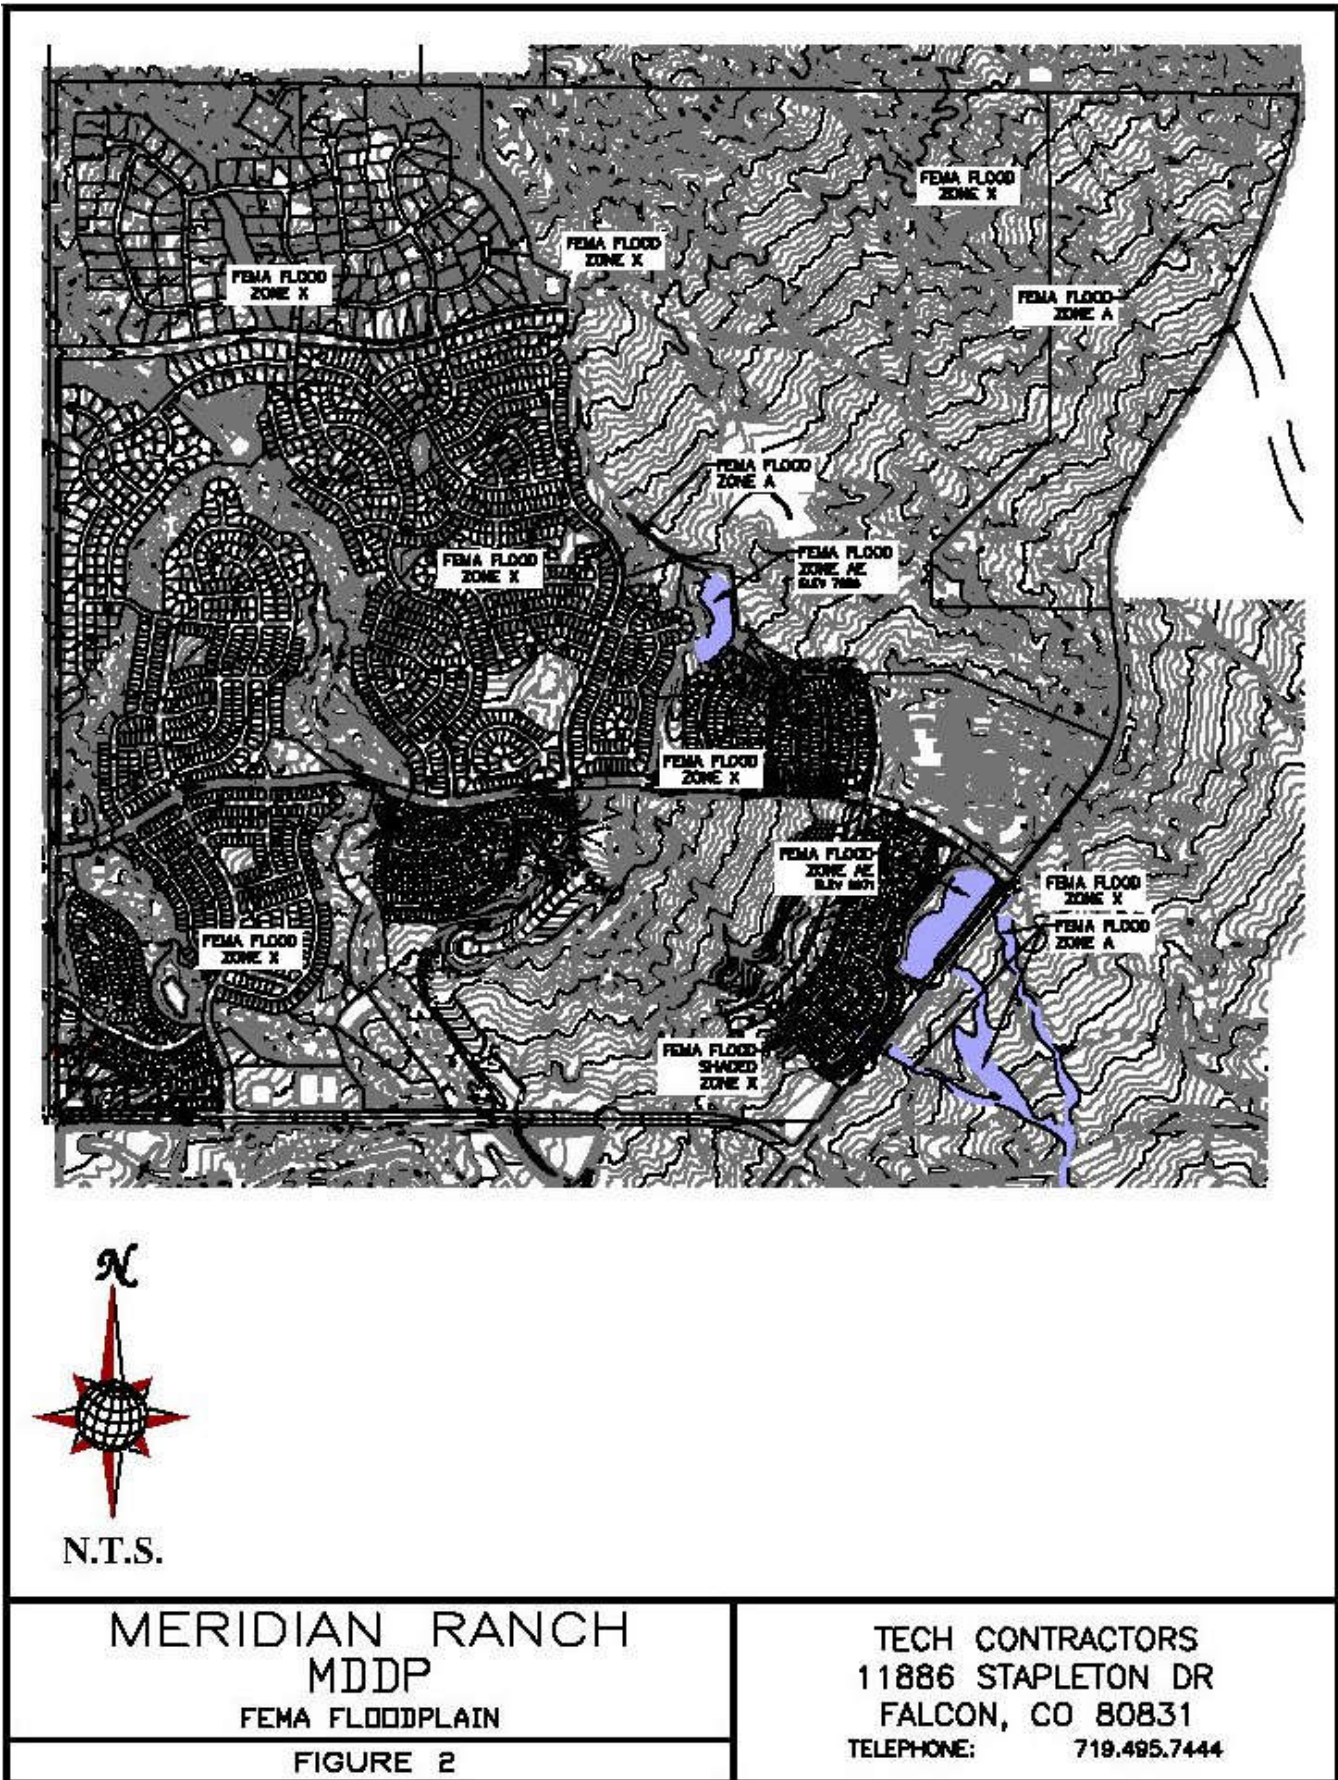

Typical pedon of Columbine gravelly sandy loam, 0 to 3 percent slopes, approximately 1/2 mile northeast of the Black Squirrel bridge on U. S. Highway 24, near center of sec. 13, T. 12 S., R. 64 W.:

A11-0 to 6 inches; grayish brown (10YR 5/2) gravelly sandy loam, very dark grayish brown (10YR 3/2) moist; moderate fine granular structure; soft, very friable; 20 percent fine angular gravel; neutral; gradual smooth boundary.

A12-6 to 14 inches; brown (10YR 5/3) very gravelly loamy sand, dark brown (10YR 3/3) moist; weak medium granular structure; slightly hard; very friable; 40 percent fine angular gravel; neutral; gradual wavy boundary.

C-14 to 60 inches; light yellowish brown (2.5Y 6/4) very gravelly loamy sand, light olive brown (2.5Y 5/4) moist; massive; hard, very friable; 60 percent fine angular gravel; neutral.

The solum ranges from 10 to 20 inches in thickness, The control section is 35 to 75 percent coarse fragments. It ranges from slightly acid to mildly alkaline. The A1 horizon is grayish bl"OW11, brown, or dark grayish brown. The C horizon is light yellowish brown to yellowish brown.

Pring series

The Pring series consists of deep, well drained soils that formed in arkosic sandy sediment, These soils are on valley side slopes and uplands, They have slopes of 3 to 30 percent, Average annual precipitation is about 17 inches, and average annual air temperature is about 43 degrees F.

Pring soils are similar to Kutler and Stapleton soils and are near Elbeth, Peyton, and Tomah soils, Kutler soils have a paralithic contact at a depth of 20 to 40 inches, Stapleton soils have warmer soil temperatures, Elbeth soils have A2 and B2t horizons, Peyton soils have a B2t horizon, Tomah oils have an A2 horizon and a B2t horizon in which clay is accumulating in lamellae and thin bands.

Typical pedon of Pring coarse sandy loam, 8 to 15 percent slopes, about 950 feet south and 300 feet east of the northwest corner of the NW 1/4SE1/4 of sec, 17, T, 11 S.,R. 63 W.:

A1-0 to 4 inches; dad< grayish brown (10YR 4/2) coarse sandy loam, very dark brown (10YR 2/2) moist; moderate fine granular structure; soft, very friable; slightly acid; clear smooth boundary.

AC-4 to 14 inches; dark grayish brown (10YR 4/2) coarse sandy loam, very dark brown (10YR 2/2) moist; weak coarse prismatic structure parting to moderate medium subangular blocky; hard, very friable; neutral; clear smooth boundary.

C-14 to 60 inches; pale brown (10YR (6/3) gravelly sandy loam, brown (10YR 5/3) moist; massive; very hard, very friable; 15 percent fine and medium gravel; neutral.

The solum ranges from 10 to 20 inches in thickness. It is 0 to 15 percent coarse fragments. It is slightly acid or neutral. The A1 horizon is dark grayish brown to very dark grayish brown. The C horizon is pale brown or brown.

Stapleton series

The Stapleton series consists of deep, well drained soils that formed in sandy alluvium derived from arkosic bedrock. These soils are on uplands. They have slopes of 3 to 20 percent. Average annual precipitation is about 15 inches, and average annual air temperature is about 47 degrees F.

Stapleton soils are similar to Columbine and Pring soils. They are near Bresser and Truckton soils. Columbine soils have more than 35 percent coarse fragments. Pring soils have mean annual soil temperatures of less than 47 degrees F. Bresser soils have a B2t horizon of sandy clay loam. Truckton soils have a B2t horizon of sandy loam.

Typical pedon of Stapleton sandy loam, 3 to 8 percent slopes, about 800 feet north and 300 feet east of the southwest corner of sec. 16, T. 12 S., R. 64 W.:

A1-O to 11 inches; grayish brown (10YR 5/2) sandy loam, very dark grayish brown (10YR 3/2) moist; moderate fine granular structure; soft, very friable; 5 percent gravel; neutral; clear smooth boundary.

B2-11 to 17 inches; grayish brown (10YR 5/2) gravelly sandy loam, dark grayish brown (10YR 4/2) moist; moderate medium subangular structure; slightly hard, very friable, slightly sticky; 15 percent fine gravel; neutral; gradual smooth boundary.

C1-17 to 26 inches; pale brown (10YR 6/3) gravelly sandy loam, brown (10YR 4/3) moist; massive; very hard, very friable; 15 percent fine gravel; neutral; gradual smooth boundary.

C2-26 to 60 inches; pale brown (10YR 6/3) gravelly loamy sand, brown (10YR 5/3) moist; massive; 30 percent gravel; neutral.

The solum ranges from 12 to 20 inches in thickness. It is 0 to 35 percent coarse fragments. It is slightly acid or neutral. The A1 horizon is grayish brown or dark grayish brown sandy loam or gravelly sandy loam. The B horizon is brown or grayish brown gravelly sandy loam or coarse sandy loam. The C horizon is pale brown or light brownish gray.

Note: (#) indicates Soil Conservation Survey soil classification number. See Figure 3: Soils Map.

Climate


Mild summers and winters, light precipitation, high evaporation and moderately high wind velocities characterize the climate of the study area.

The average annual monthly temperature is 48.4 F with an average monthly low of 30.3 F in the winter and an average monthly high of 68.1 F in the summer. Two years in ten will have a maximum temperature higher than 98 F and a minimum temperature lower than -16 F. Precipitation averages 15.73 inches annually, with 80% of this occurring during the months of April through September. The average annual Class A pan evaporation is 45 inches.

Natural Hazards Analysis

Natural hazards analysis indicates that no unusual surface or subsurface hazards are located near the vicinity. However, because the soils are cohesionless, sloughing of steep banks during drilling and/or excavation could occur. By placing improvements in a manner that provides an opportunity to lay the banks of excavations back at a slope greater than 1:1 during construction, the problems associated with sloughing soils can be minimized.

Figure 3: Soils Map

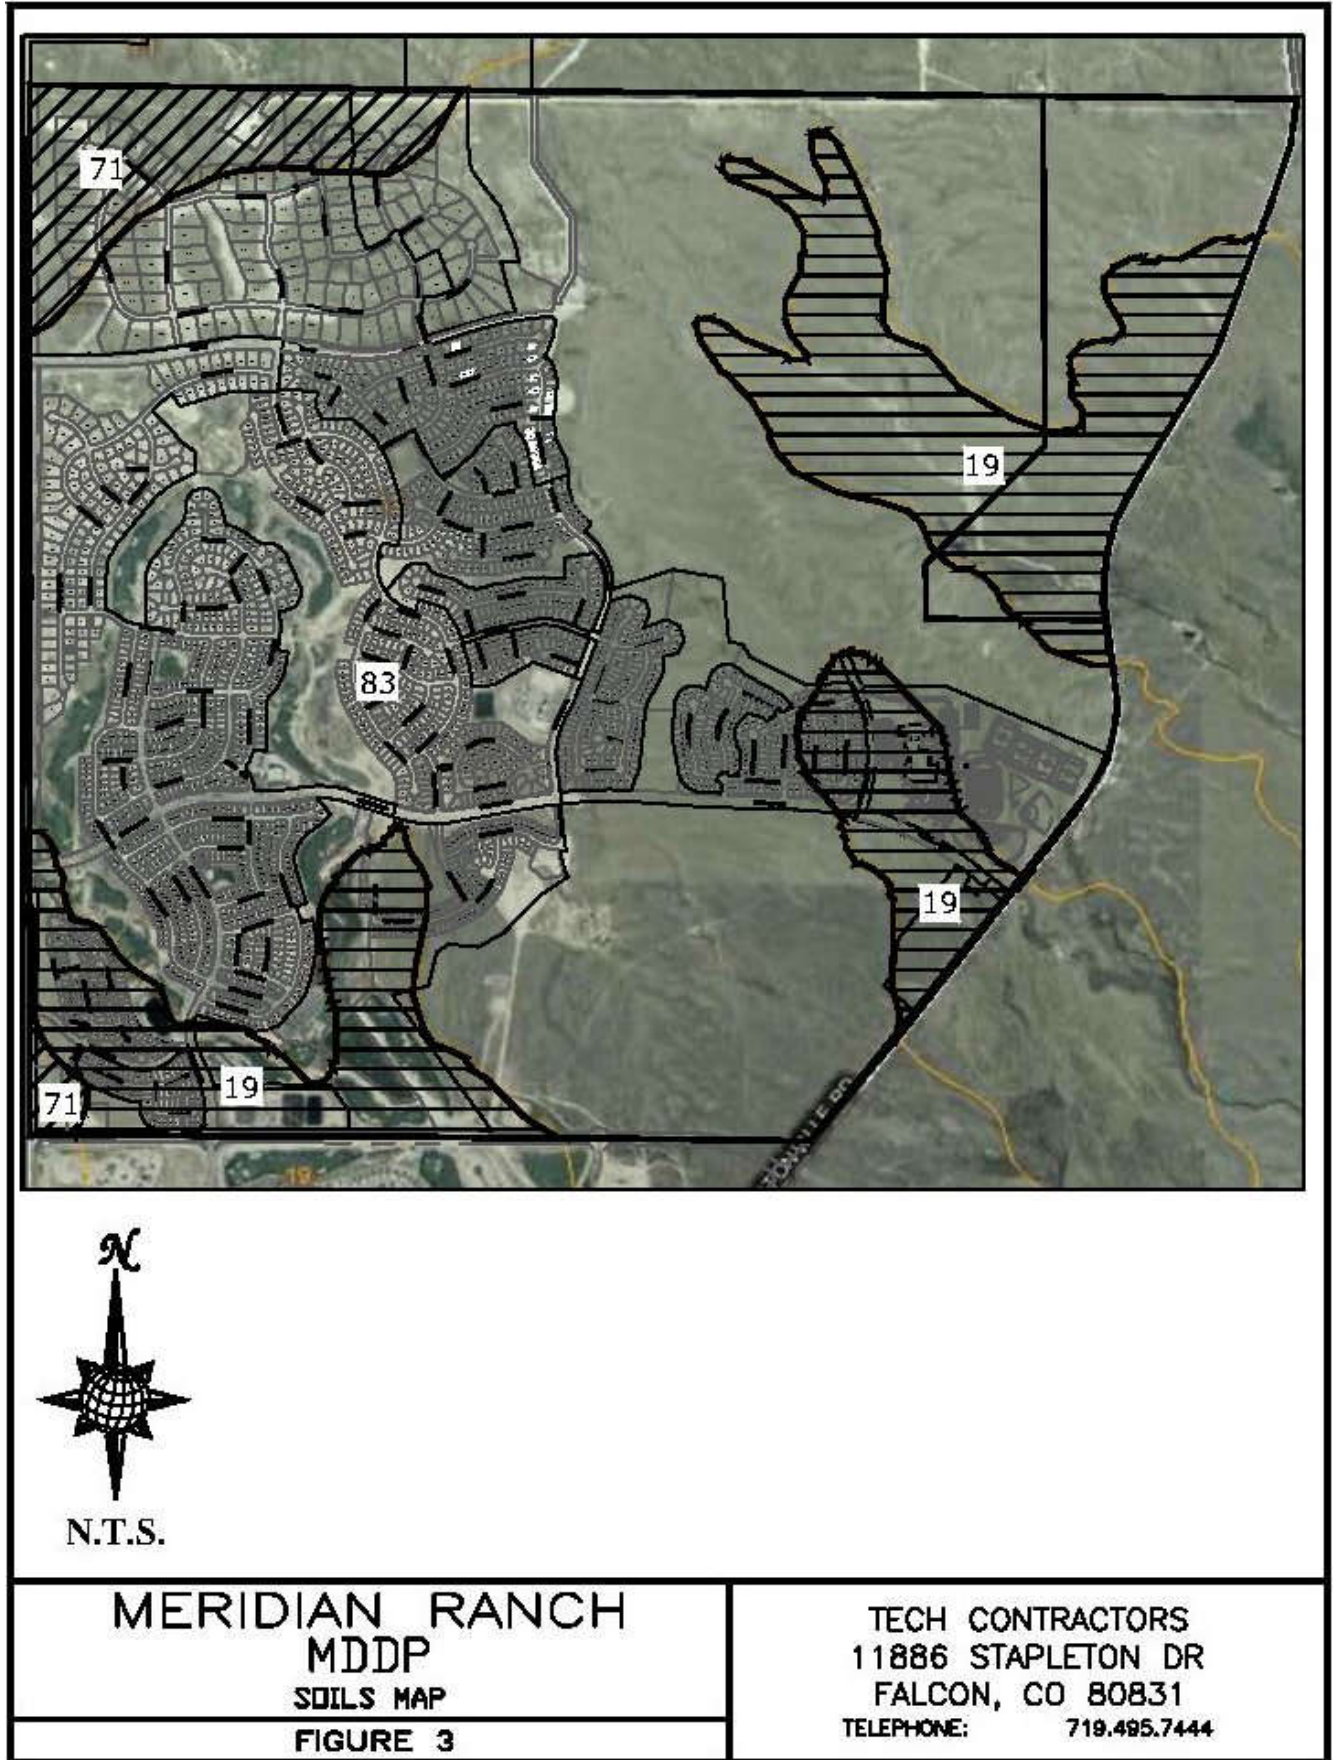

DRAINAGE BASINS AND SUB-BASINS

El Paso County has identified four major drainage basins within Meridian Ranch. Please see Figure 4: Existing Condition Major Drainage Basin Map.

Falcon Basin

El Paso County processed a Drainage Basin Planning Study (DBPS) for the Falcon Basin (CHWS1400).

The southwestern corner of Meridian Ranch (44 ac.) was located within the Falcon Drainage Basin, accepting drainage from the eastern portion of Meridian Road and draining south by southeast onto the Woodmen Hill Development.

As a result of the development of this property; runoff from this portion of the Falcon Basin has been redirected easterly along Stapleton Drive to the main channel of the Bennett Ranch Basin and thus removed from the Falcon Drainage Basin. Therefore, this basin was studied for the historic condition only.

Bennett Ranch Basin

The western third of Meridian Ranch is within the Bennett Ranch Basin and accepts flow from Falcon Hills and Paint Brush Hills to the west and from unplatted areas north of Paint Brush Hills and Antlers Ridge north of Meridian Ranch. Runoff from this basin flows southerly to the Stapleton Drive where it enters the Woodmen Hills Development at Design Point B26. This basin consists of two channels, the main branch flows southeasterly from Meridian Road north of Londonderry Drive toward the confluence point with the second branch at Design Point B19. The second branch runs from the northwestern portion of the site near Meridian Road and Rex Road southerly toward DP B19 where it joins the main branch north of Stapleton Drive. The Bennett Ranch Basin flow exits Meridian Ranch at DP26 crossing under Stapleton Drive.

A Drainage Basin Planning Study for the Bennett Ranch Basin (CHWS1200) has been completed and adopted per El Paso County regulations.

Haegler Ranch Basin

The Haegler Ranch Drainage Basin has been studied and during the process it was determined that the existing boundary line between the Gieck Ranch Basin and the Haegler Ranch Basin should be shifted south. With the approval of the Haegler Ranch Basin Study, the basin boundary was moved (Figure 4: Existing Condition Major Drainage Basin Map).

The Haegler Ranch Basin is located within the extreme southeast corner of Meridian Ranch. The Haegler Ranch Basin begins within Meridian Ranch and flows in a southeasterly direction toward the intersection of Stapleton Drive and Eastonville Road.

A Drainage Basin Planning Study for the Haegler Ranch Basin (CHMS0200) has been completed and adopted per El Paso County regulations.

Gieck Ranch Basin

Approximately 1,300 acres of Meridian Ranch is located within the Gieck Ranch Basin. Surface runoff enters the site unplatted land, Antlers Ridge and Latigo Trails located to the north and continues in a southeasterly direction toward the El Paso County Regional Park along easterly

boundary of the site and Eastonville Road. There are several points along the eastern boundary of the project and Eastonville Road that discharge the runoff off the site.

Information obtained from the Latigo Trails MDDP completed in October 2001 identifies several acres that discharge un-detained developed flow onto Meridian Ranch property; these areas are modeled as developed 2.5 acre density in both the Existing and Developed models. Those areas that drain un-detained directly onto Meridian Ranch were modeled using a Curve Number (CN) of 66.

Additionally, the Latigo MDDP used higher CN values for the existing condition, therefore the existing detention facilities located on the Latigo property release at a higher rate than the original Meridian Ranch MDDP had modeled. The calculations within these areas of Latigo were re-modeled with the 2015 Revised MDDP; this report makes no changes to the Latigo calculations from the 2015 Revised MDDP. Latigo run off that is released through a detention pond onto Meridian Ranch has been modeled using the higher Latigo undeveloped pasture CN value of 65 in both models.

The Gieck Ranch Drainage Basin has been approved by the County, during the process it was determined that the existing boundary line between the Gieck Ranch Basin and the Haegler Ranch Basin should be shifted south. (Figure 4: Existing Condition Major Drainage Basin Map).

DRAINAGE DESIGN CRITERIA

SCS Hydrograph Procedure

The Soil Conservation Service (SCS) Hydrograph (HEC-HMS) procedure was used to determine final design parameters for the major drainage facilities within the project. Onsite basin areas were calculated using aerial topography of the site and approved final design data. Times of concentration were estimated using the SCS procedures described in the DCM. Based upon the hydrologic soil type, the natural conditions found in the basins and the runoff curve numbers (CN) chart from Table 6-9 for Pre-development Thunderstorm Conditions (ARCI) and Table 6-10 for Frontal Storms & Thunderstorms for Developed Conditions (ARCII), the following CN values were used for the given conditions.

Table 2: SCS Runoff Curve Numbers

| Condition | CN* |
|-----------------------------|-----|
| Residential Lots (5 acre) | 63 |
| Residential Lots (2.5 acre) | 66 |
| Residential Lots (1 acre) | 68 |
| Residential Lots (1/2 acre) | 70 |
| Residential Lots (1/3 acre) | 72 |
| Residential Lots (1/4 acre) | 75 |
| Residential Lots (1/5 acre) | 78 |
| Residential Lots (1/6 acre) | 80 |
| School | 80 |
| Parks/Open Space | 62 |
| Commercial | 85 |
| Roadways | 98 |
| Golf Course | 62 |
| Latigo (undetained) | 66 |
| Latigo (detained) | 65 |
| Undeveloped | 61 |

*Curve Numbers were interpolated and based on amount of impervious area per lot. The 24 hour storm precipitation values were selected from the NOAA Atlas 14, Volume 8, Version 2 for the Meridian Ranch location (Latitude 38.9783°, Longitude -104.5842°, Elevation 7054 ft). These numbers along with SCS information were used as input to the U.S. Army Corp of Engineers HEC-HMS computer model to determine design runoffs.

Channel Improvements

It has always been the intent that the existing channels shall be preserved as natural as possible outside the limits of the proposed detention facilities and the proposed golf course. The channels will be analyzed using the methods outlined in the DCM to determine if protection will be necessary due to the increased flows as a result of development. Riprap grade control structures will be used where needed to maintain proper velocities in grass-lined channels. It is recommended that storm sewer discharge points be limited to within the pond areas whenever possible to help preserve the natural channel and to avoid erosion of a low flow channel.

Detention Storage Criteria

Preliminary detention storage requirements were estimated graphically using the SCS method for single stage structure routing. The relationship between allowable outflow (Q_{out}) and inflow (Q_{in}) to the pond is directly correlated to the volume of direct runoff (V_r) and volume of storage (V_{stor}) to obtain a graphic solution. These estimates were then refined using the HEC-HMS model.

Preliminary storage volumes and outflow quantities have been provided for each of the detention facilities to be located within the development. The actual storage volumes and discharge rates will be determined upon a complete analysis for each detention facility prior to construction. The values given for discharge and volume are estimates for planning purposes only. The future detention ponds are to be designed as identified in those portions of the City of Colorado Springs Drainage Criteria Manual (DCMV1), Volume 1 dated May 2014 as adopted by El Paso County by Resolution 15-042 on January 28, 2015. Section 3.2.1 of Chapter 13 of the DCMV1 states detention ponds are to be designed to meet the Full Spectrum Design (FSD) concept introduced by the Urban Drainage and Flood Control District. The concept of FSD is for the detention pond to discharge the developed flow at a rate less than or equal to the historic rate for each design storm as identified in Chapter 6 (Hydrology) of the DCMV1. There are six existing detention facilities located within Meridian Ranch, the storage volumes and discharge rates for these ponds were calculated using as-built information. No modifications are proposed for any existing detention pond that has been designed and constructed prior to the effective date of Resolution 15-042.

Water Quality Capture Volume (WQCV) is to be included with the detention volume calculated to provide for water quality, allowing sediment to settle out and accumulate over time to improve the quality of the discharged flow from the project site. To maintain full volume for detention during the life of the facility regular maintenance must be performed to remove sediment. The WQCV is to be based on the equations found in Volume 2, City of Colorado Springs/El Paso County Drainage Criteria Manual. Detention of the WQCV is used to meet El Paso County criteria for a storm water quality discharge. The release rates from the WQCV are generally small, which help minimize downstream impacts. Detaining the WQCV also serves to cleanse the “first flush” of runoff from the higher initial concentration of sediment and pollutants by allowing for sedimentation. This greatly improves the quality of runoff leaving the facilities and reduces the potential for erosion. The positive impact on water quality is expected to be significant, particularly during construction. WQCV is required for all detention facilities within the Meridian Ranch development.

DRAINAGE CALCULATIONS

General Concept

Drainage patterns on the project site generally flow in south or southeasterly direction. The project site has been analyzed with the SCS method for both the historic and the developed conditions for the design storms outlined in the adopted sections of the City of Colorado Springs Hydrology Chapter of the Drainage Criteria Manual, Volume 1. Detention ponds will be placed or have been placed within the development or at the downstream boundary of the project such that the release rate for each design storm will be at or below the historic flow rates as determined by the historic model. The exception is the Bennett Basin where regional detention and water quality has been provided for Meridian Ranch at the Bennett Ranch Regional Detention Pond located within Woodmen Hills adjacent and north of Eastonville Road.

Existing Drainage Characteristics

Table 3: Historic Condition Peak Flows summarizes existing condition peak flows for the subbasins.

Falcon Basin

The Falcon Basin covered approximately 44 acres of the southwest corner of the development. The area was bounded by Meridian Road to the west, Bennett Ranch Basin along the northeast boundary and the extension of Stapleton Drive to the south. In the past the land was used as pasture and covered with native grasses, the land gently slopes to the south. Surface runoff from this area ($Q_{100} = 37$ cfs) exited the site to the south and was intercepted by a natural channel and then conveyed south through Bennett Basin.

Bennett Ranch Basin

Runoff from the Paint Brush Hills development and open range/pasture land comprising a total of approximately 1,000 acres discharged onto Meridian Road via triple 48" RCPs at Design Point B14, where it enters the site approximately 0.5 mi. north of Stapleton Drive. A composite curve number of 62.9 was used for the offsite area tributary to the site, combining the pasture land with that of Paint Brush Hills development, consisting of 2.5 to 5.0 acre single family residential lots, and Falcon Hills Subdivision made up of 0.5-acre lots. Falcon Hills installed detention facilities in order to reduce the developed peak runoff rate. The offsite tributary area generates a peak flow rate of approximately 55 cfs for the 5-year storm event and 757 cfs for the 100-year event across Meridian Road as it enters the site. The runoff then continues south toward DP B19 where it joins easterly branch.

The runoff from Branch 2 originates offsite from areas north of Meridian Ranch. These offsite tributary areas were open range/pasture lands totaling more than 355 acres. Surface flow entered the site at three separate locations. The combined flow from the two channels at DP19 ($Q_5 = 105$ cfs, $Q_{100} = 1563$ cfs) continues south to DP 26 where it exits the site under Stapleton Drive. Meridian Ranch discharges 113 cfs under existing conditions during the 5-year storm event and 1737 cfs during the 100-year storm event to the south. The surface flow continues southerly toward Eastonville Road (DP32, $Q_5 = 115$ cfs, $Q_{100} = 1782$ cfs) and Judge Orr Road (DP37, $Q_5 = 131$ cfs, $Q_{100} = 2117$ cfs).

Haegler Ranch Basin

The Haegler Ranch Basin comprises approximately 63 acres of area in the southeast corner of Meridian Ranch. The Haegler Ranch Basin begins within Meridian Ranch and flows in a southeasterly direction toward the intersection of Stapleton Drive and Eastonville Road.

Gieck Ranch Basin

Most of the eastern half of Meridian Ranch lies within the Gieck Ranch Basin. Surface runoff enters the site via overland flow from Antlers Ridge and Latigo Trails subdivisions and unplatted land

Table 3 - Historic Condition Peak Flow Rates

| HISTORIC MDDP (Full Spectrum) | | | | | | | |
|-------------------------------|-------------------------|---------------------------|--------------------------|--------------------------|--------------------------|-------------------------|-------------------------|
| | DRAINAGE AREA (SQ. MI.) | PEAK DISCHARGE Q100 (CFS) | PEAK DISCHARGE Q50 (CFS) | PEAK DISCHARGE Q25 (CFS) | PEAK DISCHARGE Q10 (CFS) | PEAK DISCHARGE Q5 (CFS) | PEAK DISCHARGE Q2 (CFS) |
| OS02 | 0.2219 | 148 | 102 | 65 | 30 | 13 | 3 |
| B01 | 0.2219 | 148 | 102 | 65 | 30 | 13 | 3 |
| B01-B07 | 0.2219 | 148 | 102 | 65 | 30 | 13 | 3 |
| OS03 | 0.1984 | 130 | 88 | 55 | 23 | 9 | 2 |
| B02-B03 | 0.1984 | 129 | 88 | 55 | 23 | 9 | 2 |
| HB01 | 0.0234 | 19 | 13 | 8 | 3 | 1 | 0 |
| B03 | 0.2218 | 140 | 95 | 59 | 25 | 10 | 2 |
| B03-B07 | 0.2218 | 140 | 94 | 59 | 25 | 10 | 2 |
| OS04 | 0.1359 | 83 | 54 | 32 | 12 | 4 | 1 |
| B04-B05 | 0.1359 | 82 | 54 | 32 | 12 | 4 | 1 |
| HB03 | 0.1266 | 103 | 68 | 41 | 15 | 5 | 1 |
| B05 | 0.2625 | 144 | 91 | 52 | 20 | 7 | 1 |
| B05-B07 | 0.2625 | 144 | 91 | 52 | 20 | 7 | 1 |
| HB02 | 0.1063 | 77 | 51 | 30 | 11 | 4 | 0 |
| HB04 | 0.0609 | 47 | 31 | 19 | 7 | 2 | 0 |
| B07 | 0.8734 | 519 | 344 | 207 | 86 | 33 | 6 |
| B07-B12 | 0.8734 | 518 | 343 | 207 | 86 | 33 | 6 |
| HB05 | 0.1375 | 102 | 67 | 40 | 15 | 5 | 1 |
| HB06 | 0.1641 | 111 | 73 | 43 | 16 | 5 | 1 |
| B12 | 1.175 | 679 | 440 | 259 | 103 | 40 | 7 |
| B12-PB | 1.175 | 677 | 440 | 259 | 103 | 39 | 7 |
| HB07 | 0.0313 | 29 | 19 | 12 | 4 | 1 | 0 |
| POND B | 1.2063 | 688 | 446 | 262 | 105 | 40 | 7 |
| PB-19 | 1.2063 | 687 | 444 | 261 | 104 | 40 | 7 |
| OS01 | 1.5594 | 757 | 510 | 316 | 136 | 55 | 11 |
| OS01-B19 | 1.5594 | 756 | 509 | 315 | 136 | 55 | 11 |
| HB08 | 0.1344 | 81 | 53 | 32 | 12 | 4 | 1 |
| HB09 | 0.3047 | 138 | 90 | 54 | 21 | 7 | 1 |
| B19 | 3.2048 | 1563 | 1041 | 635 | 266 | 105 | 20 |
| B19-B26 | 3.2048 | 1563 | 1039 | 634 | 266 | 105 | 20 |
| HB10 | 0.3047 | 172 | 113 | 67 | 26 | 9 | 1 |
| HB12 | 0.0797 | 54 | 36 | 21 | 8 | 3 | 0 |
| HB12-B26 | 0.0797 | 54 | 35 | 21 | 8 | 3 | 0 |
| B26 | 3.5892 | 1737 | 1147 | 693 | 288 | 113 | 21 |
| 26-32 | 3.5892 | 1734 | 1146 | 693 | 287 | 113 | 21 |
| B-11 | 0.1125 | 60 | 40 | 23 | 9 | 3 | 0 |
| 32 | 3.7017 | 1782 | 1177 | 709 | 293 | 115 | 22 |
| 32-37 | 3.7017 | 1782 | 1175 | 708 | 293 | 115 | 22 |
| B-14 | 0.4039 | 178 | 117 | 70 | 27 | 10 | 2 |
| B-13 | 0.2813 | 127 | 83 | 50 | 19 | 7 | 1 |
| 36 | 0.6852 | 306 | 200 | 119 | 47 | 17 | 3 |
| 36-37 | 0.6852 | 305 | 200 | 119 | 47 | 17 | 3 |
| B-15 | 0.075 | 39 | 26 | 15 | 6 | 2 | 0 |
| 37 | 4.4619 | 2117 | 1391 | 834 | 338 | 131 | 25 |
| OS06 | 0.1313 | 87 | 57 | 34 | 13 | 4 | 1 |
| OS06-G02 | 0.1313 | 86 | 57 | 34 | 13 | 4 | 1 |
| OS05 | 0.0578 | 48 | 32 | 19 | 7 | 2 | 0 |
| OS05-G01 | 0.0578 | 47 | 31 | 19 | 7 | 2 | 0 |
| HG01 | 0.0547 | 35 | 23 | 14 | 5 | 2 | 0 |
| G01 | 0.1125 | 82 | 54 | 32 | 12 | 4 | 0 |
| G01-G02 | 0.1125 | 81 | 53 | 32 | 12 | 4 | 0 |
| HG02 | 0.0906 | 49 | 32 | 19 | 7 | 2 | 0 |
| G02 | 0.3344 | 216 | 142 | 85 | 32 | 10 | 1 |
| G02-G03 | 0.3344 | 215 | 141 | 84 | 32 | 10 | 1 |
| HG03 | 0.1828 | 82 | 54 | 32 | 13 | 5 | 1 |
| OS07 | 0.0328 | 28 | 19 | 12 | 5 | 2 | 0 |
| OS07-G03 | 0.0328 | 27 | 19 | 12 | 5 | 2 | 0 |

| HISTORIC MDDP (Full Spectrum) | | | | | | | |
|-------------------------------|-------------------------|---------------------------|--------------------------|--------------------------|--------------------------|-------------------------|-------------------------|
| | DRAINAGE AREA (SQ. MI.) | PEAK DISCHARGE Q100 (CFS) | PEAK DISCHARGE Q50 (CFS) | PEAK DISCHARGE Q25 (CFS) | PEAK DISCHARGE Q10 (CFS) | PEAK DISCHARGE Q5 (CFS) | PEAK DISCHARGE Q2 (CFS) |
| G03 | 0.55 | 323 | 213 | 127 | 49 | 16 | 2 |
| G03-G04 | 0.55 | 322 | 212 | 127 | 49 | 16 | 2 |
| OS09 | 0.1547 | 96 | 67 | 43 | 20 | 9 | 2 |
| OS09-G04 | 0.1547 | 96 | 67 | 43 | 20 | 9 | 2 |
| HG04 | 0.0891 | 42 | 28 | 17 | 6 | 2 | 0 |
| HG05 | 0.1125 | 52 | 34 | 20 | 8 | 3 | 0 |
| OS08 | 0.0406 | 39 | 27 | 18 | 9 | 4 | 1 |
| OS08-G04 | 0.0406 | 38 | 27 | 18 | 8 | 4 | 1 |
| G04 | 0.9469 | 551 | 367 | 223 | 89 | 32 | 5 |
| G04-G05 | 0.9469 | 548 | 366 | 222 | 88 | 31 | 5 |
| HG06A | 0.1375 | 51 | 34 | 20 | 8 | 3 | 1 |
| G05 | 1.0844 | 596 | 399 | 242 | 96 | 34 | 6 |
| G05-G06 | 1.0844 | 596 | 397 | 241 | 96 | 34 | 6 |
| HG06B | 0.1031 | 35 | 23 | 14 | 6 | 2 | 0 |
| G06 | 1.1875 | 628 | 418 | 254 | 101 | 36 | 6 |
| HG07 | 0.0984 | 50 | 32 | 19 | 7 | 3 | 0 |
| HG07-G11 | 0.0984 | 50 | 32 | 19 | 7 | 3 | 0 |
| HG08 | 0.1328 | 77 | 51 | 30 | 11 | 4 | 1 |
| G11 | 0.2312 | 122 | 79 | 47 | 18 | 6 | 1 |
| G11-G12 | 0.2312 | 121 | 79 | 47 | 18 | 6 | 1 |
| HG09 | 0.1781 | 76 | 50 | 30 | 12 | 4 | 1 |
| G12 | 0.4093 | 196 | 128 | 76 | 29 | 10 | 2 |
| G12-H08 | 0.4093 | 196 | 128 | 76 | 29 | 10 | 2 |
| HG10 | 0.1375 | 40 | 26 | 16 | 7 | 3 | 1 |
| H08 | 0.5468 | 227 | 149 | 89 | 35 | 13 | 2 |
| HG14 | 0.2297 | 83 | 55 | 33 | 13 | 5 | 1 |
| HG13 | 0.0844 | 59 | 40 | 25 | 11 | 4 | 1 |
| G07 | 0.0844 | 59 | 40 | 25 | 11 | 4 | 1 |
| G07-G08 | 0.0844 | 59 | 40 | 25 | 11 | 4 | 1 |
| G08 | 0.3141 | 122 | 81 | 49 | 20 | 8 | 1 |
| HG15 | 0.2563 | 71 | 47 | 28 | 12 | 5 | 1 |
| H13 | 0.2563 | 71 | 47 | 28 | 12 | 5 | 1 |
| HG11 | 0.2047 | 80 | 53 | 31 | 13 | 5 | 1 |
| H09 | 0.2047 | 80 | 53 | 31 | 13 | 5 | 1 |
| HH01 | 0.0984 | 70 | 46 | 27 | 10 | 3 | 0 |
| H12 | 0.0984 | 70 | 46 | 27 | 10 | 3 | 0 |
| HG12 | 0.1297 | 60 | 39 | 23 | 9 | 3 | 1 |
| H10 | 0.1297 | 60 | 39 | 23 | 9 | 3 | 1 |

located to the north. Runoff is generally southeasterly, there are several culvert crossings under Eastonville Road to discharge runoff from the site.

There are three main drainage courses through the Gieck Basin, the first drainage course begins at offsite Basin OS-6, and traverses the Gieck Ranch Basin to Eastonville Road. Approximately 240 Acres north of the main drainage way also discharge from the site via two other minor crossings of Eastonville Road. The drainage ways in these areas are not as well defined as the main drainage way, and in some cases are virtually nonexistent.

The second main drainage way through the Gieck Ranch Basin accepts runoff off-site from roughly 270 acres of land along the northern property boundary from Antlers Ridge, unplatted land and Latigo Trails. The drainage course collects surface runoff from approximately 490 acres within Meridian Ranch. The channel flow traverses southeasterly toward Eastonville Road where a total flow of $Q_5=36$ cfs, $Q_{100}=6248$ cfs exits the site at DP G06.

The final main channel, begins within Meridian Ranch and conveys it southeasterly through the site to Eastonville Road where a total flow of $Q_5=13$ cfs, $Q_{100}=227$ cfs exits the site at DP-H08.

Proposed Design Drainage Characteristics

Figure 5: Developed Condition Subbasins illustrates the subbasin boundaries used for the hydrologic analysis for each of the major basins. Note that the existing condition subbasin boundaries, design points, and numbers do not necessarily correspond to those used for developed conditions. Table 4: Developed Condition Peak Flow summarizes developed condition peak flows for the subbasins.

Falcon Basin

When the site was developed, the area that was formerly within the Falcon Basin was redirected easterly toward DP B26, just north of Stapleton Drive and east of the wastewater treatment plant. Please refer to the discussion of the Bennett Ranch Basin below.

Bennett Ranch Basin

As discussed earlier in this report, the southwest corner of Meridian Ranch, which was originally part of the Falcon Basin, has been diverted to the Bennett Ranch Basin due to development via storm drain where it joins the remainder of the surface flow from the Bennett Basin at DP26

Runoff from the Bennett Ranch Basin is directed to DP B26 where the surface flow discharges under Stapleton Drive. The overall drainage pattern in the rest of Bennett Ranch Basin remains essentially unchanged, utilizing storm drains as necessary to convey runoff to the main channels. The major drainage ways in the Bennett Ranch Basin are used as part of the golf course. The channel remained in its natural state with the exception of the golf cart crossings, drop/grade control structures and two detention ponds.

Three detention ponds are located within the Bennett Ranch Basin in Meridian Ranch: near Design Points B6, B12 and B16. A summary of peak runoff rates is found in Table 4: Developed Condition Peak Flow

The surface flow continues south of Stapleton Drive where it enters the Bennett Ranch Regional Detention Pond. The regional pond is designed to anticipate the future developed runoff from Meridian Ranch and provide water quality for the area tributary to the pond.

Gieck Ranch Basin

Originally, there were several unstudied FEMA floodplains within the Gieck Basin. The channels are very poorly defined, and have been redefined by CLOMR/LOMR process. Storm drains are used to convey runoff through the basin due to the development.

The Gieck Ranch Basin accepts surface runoff from the Latigo Trails Subdivision located to the north of Meridian Ranch. Runoff is generally southeasterly; there are several culvert crossings under Eastonville Road to discharge runoff from the site. The Offsite and onsite flows for developed subbasins are summarized in Table 4: Developed Condition Peak Flow.

Runoff begins offsite and flows southeasterly toward Eastonville Road. The runoff will be collected in a combination of storm sewers and open channels and conveyed southeasterly toward the proposed detention Pond G where the pond will discharge to the El Paso County Falcon Regional Park. The detention facility will release near DP G12 at a rate equal to or below the existing flow rate for the full spectrum of design storms into the existing drainage course within the Regional Park and drain southeasterly to Eastonville Road near DP G06.

Table 4 - Developed Condition Peak Flow Rates

| FUTURE MDDP (Full Spectrum) | | | | | | | |
|-----------------------------|-------------------------|---------------------------|--------------------------|--------------------------|--------------------------|-------------------------|-------------------------|
| | DRAINAGE AREA (SQ. MI.) | PEAK DISCHARGE Q100 (CFS) | PEAK DISCHARGE Q50 (CFS) | PEAK DISCHARGE Q25 (CFS) | PEAK DISCHARGE Q10 (CFS) | PEAK DISCHARGE Q5 (CFS) | PEAK DISCHARGE Q2 (CFS) |
| OS01 | 1.5594 | 757 | 510 | 316 | 136 | 55 | 11 |
| DB16 | 0.0578 | 92 | 72 | 54 | 35 | 23 | 13 |
| B10 | 1.6172 | 793 | 537 | 335 | 147 | 62 | 13 |
| B10-B11 | 1.6172 | 793 | 537 | 335 | 147 | 62 | 13 |
| DB17 | 0.0048 | 15 | 13 | 11 | 9 | 7 | 6 |
| B11 | 1.6220 | 795 | 538 | 336 | 148 | 63 | 15 |
| B11-POND C | 1.6220 | 794 | 538 | 336 | 148 | 62 | 15 |
| DB21 | 0.0519 | 54 | 38 | 25 | 12 | 5 | 1 |
| DB18 | 0.0346 | 64 | 50 | 39 | 26 | 18 | 10 |
| DB19 | 0.0281 | 36 | 27 | 20 | 11 | 7 | 3 |
| DB20 | 0.0147 | 24 | 19 | 15 | 9 | 6 | 3 |
| POND C | 1.7513 | 749 | 507 | 310 | 128 | 50 | 11 |
| POND C-B16 | 1.7513 | 749 | 507 | 309 | 128 | 50 | 11 |
| DB25 | 0.0211 | 45 | 35 | 27 | 18 | 12 | 7 |
| B16 | 1.7724 | 754 | 511 | 313 | 130 | 51 | 11 |
| B16-B17 | 1.7724 | 754 | 510 | 312 | 130 | 51 | 11 |
| DB26 | 0.0682 | 136 | 110 | 88 | 62 | 46 | 29 |
| B17 | 1.8406 | 778 | 529 | 326 | 138 | 56 | 34 |
| B17-B18 | 1.8406 | 778 | 529 | 326 | 138 | 56 | 34 |
| OS03 | 0.1984 | 130 | 88 | 55 | 23 | 9 | 2 |
| DB01 | 0.0719 | 90 | 66 | 46 | 25 | 14 | 5 |
| B01 | 0.2703 | 199 | 138 | 89 | 42 | 19 | 5 |
| B01-B02 | 0.2703 | 199 | 138 | 89 | 42 | 19 | 5 |
| OS02 | 0.2219 | 148 | 102 | 65 | 30 | 13 | 3 |
| DB02 | 0.0516 | 71 | 52 | 36 | 20 | 10 | 3 |
| B02 | 0.5438 | 380 | 263 | 169 | 79 | 36 | 9 |
| B02-POND A | 0.5438 | 379 | 263 | 169 | 79 | 36 | 9 |
| OS04 | 0.1359 | 83 | 54 | 32 | 12 | 4 | 1 |
| DB03 | 0.0703 | 70 | 49 | 32 | 16 | 7 | 2 |
| B03 | 0.2062 | 145 | 98 | 61 | 26 | 10 | 2 |
| B03-B04 | 0.2062 | 145 | 98 | 60 | 25 | 10 | 2 |
| DB04 | 0.0422 | 44 | 31 | 21 | 10 | 5 | 1 |
| DB05 | 0.0384 | 37 | 27 | 18 | 9 | 5 | 1 |
| B04 | 0.2868 | 218 | 149 | 94 | 42 | 18 | 4 |
| B04-B05 | 0.2868 | 218 | 149 | 94 | 42 | 18 | 4 |
| DB06 | 0.0219 | 44 | 35 | 28 | 19 | 14 | 9 |
| B05 | 0.3087 | 253 | 176 | 115 | 55 | 25 | 10 |
| B05-POND A | 0.3087 | 252 | 176 | 114 | 55 | 25 | 10 |
| DB07 | 0.0254 | 35 | 26 | 18 | 10 | 6 | 2 |
| DB08 | 0.0297 | 32 | 22 | 15 | 7 | 3 | 0 |
| POND A | 0.9076 | 557 | 401 | 244 | 98 | 34 | 6 |
| POND A-B06 | 0.9076 | 557 | 400 | 244 | 98 | 34 | 6 |
| DB09 | 0.0189 | 34 | 26 | 19 | 12 | 8 | 4 |
| B06 | 0.9265 | 565 | 407 | 248 | 100 | 35 | 6 |
| B06-B07 | 0.9265 | 564 | 406 | 247 | 99 | 35 | 6 |
| DB11 | 0.0969 | 114 | 85 | 60 | 35 | 20 | 8 |
| DB10 | 0.0364 | 56 | 43 | 32 | 19 | 12 | 6 |
| B07 | 1.0598 | 652 | 469 | 286 | 116 | 42 | 15 |
| B07-B09 | 1.0598 | 651 | 468 | 285 | 116 | 42 | 14 |
| DB12 | 0.0453 | 81 | 63 | 48 | 31 | 21 | 11 |
| B09 | 1.1051 | 677 | 486 | 296 | 121 | 45 | 19 |
| B09-POND B | 1.1051 | 676 | 485 | 296 | 121 | 45 | 19 |
| DB15 | 0.1234 | 105 | 75 | 50 | 25 | 12 | 3 |
| DB13 | 0.0703 | 89 | 67 | 49 | 29 | 18 | 8 |
| DB14 | 0.0556 | 93 | 72 | 54 | 35 | 23 | 12 |
| POND B | 1.3544 | 688 | 539 | 337 | 140 | 69 | 30 |

| FUTURE MDDP (Full Spectrum) | | | | | | | |
|-----------------------------|-------------------------|---------------------------|--------------------------|--------------------------|--------------------------|-------------------------|-------------------------|
| | DRAINAGE AREA (SQ. MI.) | PEAK DISCHARGE Q100 (CFS) | PEAK DISCHARGE Q50 (CFS) | PEAK DISCHARGE Q25 (CFS) | PEAK DISCHARGE Q10 (CFS) | PEAK DISCHARGE Q5 (CFS) | PEAK DISCHARGE Q2 (CFS) |
| POND B-B12 | 1.3544 | 688 | 539 | 336 | 140 | 69 | 30 |
| DB22 | 0.0516 | 91 | 72 | 55 | 36 | 25 | 14 |
| DB23 | 0.0172 | 45 | 38 | 31 | 23 | 18 | 13 |
| B12 | 1.4232 | 714 | 562 | 352 | 148 | 83 | 38 |
| B12-B14 | 1.4232 | 714 | 562 | 352 | 148 | 83 | 38 |
| DB24 | 0.0531 | 94 | 73 | 56 | 36 | 24 | 13 |
| B14 | 1.4763 | 743 | 577 | 363 | 162 | 92 | 46 |
| B14-B15 | 1.4763 | 742 | 576 | 362 | 162 | 92 | 46 |
| DB28 | 0.0516 | 79 | 61 | 46 | 30 | 20 | 11 |
| B15 | 1.5279 | 783 | 595 | 375 | 179 | 107 | 56 |
| B15-B18 | 1.5279 | 781 | 595 | 374 | 179 | 107 | 56 |
| DB27 | 0.1578 | 140 | 101 | 70 | 37 | 20 | 7 |
| DB29 | 0.0959 | 89 | 65 | 46 | 25 | 14 | 5 |
| B26 | 3.6222 | 1621 | 1178 | 735 | 316 | 186 | 95 |
| B26-27 | 3.6222 | 1621 | 1177 | 735 | 316 | 185 | 94 |
| FB-01 | 0.0630 | 81 | 63 | 47 | 29 | 19 | 10 |
| FB01-27a | 0.0630 | 81 | 63 | 47 | 29 | 19 | 10 |
| FB-02 | 0.0375 | 75 | 60 | 47 | 32 | 23 | 14 |
| B19 | 0.1005 | 146 | 114 | 87 | 57 | 38 | 21 |
| B19-27 | 0.1005 | 146 | 114 | 87 | 56 | 38 | 21 |
| 27 | 3.7227 | 1663 | 1209 | 756 | 337 | 213 | 108 |
| 27-32 | 3.7227 | 1662 | 1208 | 755 | 336 | 212 | 107 |
| WH-24 | 0.1325 | 217 | 170 | 129 | 84 | 56 | 31 |
| WH-26 | 0.0839 | 49 | 33 | 20 | 8 | 3 | 0 |
| WH-27 | 0.0217 | 23 | 16 | 10 | 4 | 1 | 0 |
| 30 | 0.2381 | 271 | 205 | 150 | 91 | 59 | 31 |
| 30-31 | 0.2381 | 270 | 205 | 149 | 91 | 59 | 31 |
| WH-28 | 0.0398 | 60 | 47 | 36 | 23 | 15 | 8 |
| 31 | 0.2779 | 330 | 252 | 185 | 114 | 74 | 39 |
| 31-32 | 0.2779 | 329 | 251 | 185 | 113 | 73 | 39 |
| WH-29 | 0.0511 | 80 | 62 | 47 | 30 | 20 | 11 |
| WH-31 | 0.0406 | 75 | 59 | 46 | 30 | 21 | 12 |
| WH-30 | 0.0159 | 26 | 19 | 13 | 7 | 4 | 1 |
| 32 | 4.1082 | 1815 | 1302 | 817 | 457 | 287 | 139 |
| WH32 | 0.0458 | 54 | 38 | 24 | 10 | 4 | 0 |
| BEN POND | 4.1540 | 1409 | 1000 | 607 | 259 | 105 | 46 |
| WH-33 | 0.0064 | 12 | 9 | 7 | 5 | 3 | 2 |
| 33 | 4.1604 | 1411 | 1001 | 607 | 259 | 105 | 46 |
| 33-37 | 4.1604 | 1410 | 1001 | 607 | 259 | 105 | 46 |
| WH35 | 0.1550 | 171 | 124 | 84 | 44 | 22 | 6 |
| WH34 | 0.0450 | 68 | 52 | 38 | 23 | 15 | 7 |
| B34-36 | 0.0450 | 68 | 52 | 38 | 23 | 15 | 7 |
| 36 | 0.2000 | 239 | 176 | 122 | 67 | 37 | 13 |
| 36-37 | 0.2000 | 238 | 174 | 121 | 66 | 37 | 13 |
| WH36 | 0.0750 | 63 | 43 | 27 | 11 | 4 | 1 |
| 37 | 4.4354 | 1449 | 1031 | 627 | 269 | 109 | 50 |
| FG01 | 0.1127 | 58 | 40 | 25 | 11 | 5 | 1 |
| OS05 | 0.0578 | 43 | 29 | 17 | 6 | 2 | 0 |
| G1 | 0.1705 | 83 | 55 | 34 | 14 | 6 | 1 |
| G1-G2 | 0.1705 | 83 | 55 | 34 | 14 | 6 | 1 |
| OS06 | 0.1313 | 87 | 57 | 34 | 13 | 4 | 1 |
| G1a | 0.1313 | 87 | 57 | 34 | 13 | 4 | 1 |
| G1a-G2 | 0.1313 | 87 | 57 | 34 | 13 | 4 | 1 |
| FG02 | 0.0391 | 35 | 24 | 16 | 7 | 3 | 1 |
| G2 | 0.3409 | 200 | 132 | 80 | 32 | 12 | 2 |
| G2-G3 | 0.3409 | 199 | 132 | 80 | 32 | 12 | 2 |
| FG03 | 0.0203 | 26 | 19 | 13 | 7 | 1 | 1 |

| FUTURE MDDP (Full Spectrum) | | | | | | | |
|-----------------------------|-------------------------|---------------------------|--------------------------|--------------------------|--------------------------|-------------------------|-------------------------|
| | DRAINAGE AREA (SQ. MI.) | PEAK DISCHARGE Q100 (CFS) | PEAK DISCHARGE Q50 (CFS) | PEAK DISCHARGE Q25 (CFS) | PEAK DISCHARGE Q10 (CFS) | PEAK DISCHARGE Q5 (CFS) | PEAK DISCHARGE Q2 (CFS) |
| FG04 | 0.0172 | 23 | 16 | 11 | 6 | 3 | 1 |
| G3 | 0.3784 | 222 | 147 | 89 | 36 | 13 | 3 |
| G3-POND F | 0.3784 | 221 | 147 | 89 | 36 | 13 | 3 |
| FG05 | 0.0922 | 65 | 46 | 30 | 15 | 7 | 2 |
| FG06 | 0.0188 | 21 | 15 | 10 | 5 | 3 | 1 |
| POND F | 0.4894 | 181 | 126 | 65 | 17 | 8 | 2 |
| POND F-G7 | 0.4894 | 181 | 126 | 65 | 17 | 8 | 2 |
| FG21 | 0.0656 | 55 | 39 | 26 | 13 | 6 | 2 |
| OS07 | 0.0328 | 28 | 19 | 12 | 5 | 2 | 0 |
| OS07-G7 | 0.0328 | 27 | 19 | 12 | 5 | 2 | 0 |
| G7 | 0.5878 | 223 | 151 | 77 | 22 | 10 | 3 |
| G7-G8 | 0.5878 | 223 | 151 | 77 | 22 | 10 | 3 |
| FG22 | 0.0641 | 46 | 33 | 22 | 11 | 5 | 1 |
| G8 | 0.6519 | 261 | 172 | 87 | 29 | 12 | 3 |
| G8-G8A | 0.6519 | 261 | 172 | 87 | 29 | 12 | 3 |
| FG23 | 0.0813 | 59 | 42 | 27 | 13 | 6 | 2 |
| OS08 | 0.0406 | 39 | 27 | 18 | 9 | 4 | 1 |
| OS11-G8A | 0.0406 | 39 | 27 | 18 | 9 | 4 | 1 |
| G8A | 0.7738 | 331 | 209 | 105 | 46 | 21 | 6 |
| G8A-G9 | 0.7738 | 331 | 209 | 105 | 46 | 21 | 6 |
| FG25 | 0.0219 | 19 | 14 | 10 | 6 | 3 | 1 |
| G9 | 0.7957 | 349 | 219 | 115 | 51 | 24 | 7 |
| G9-G11 | 0.7957 | 348 | 219 | 115 | 51 | 24 | 7 |
| OS09 | 0.1547 | 96 | 67 | 43 | 20 | 9 | 2 |
| OS09-G10 | 0.1547 | 96 | 67 | 43 | 20 | 9 | 2 |
| FG24 | 0.1047 | 77 | 54 | 34 | 16 | 7 | 1 |
| G10 | 0.2594 | 166 | 115 | 74 | 34 | 15 | 3 |
| G10-G11 | 0.2594 | 166 | 115 | 73 | 34 | 15 | 3 |
| FG26 | 0.0813 | 81 | 61 | 43 | 25 | 15 | 6 |
| FG27B | 0.0508 | 61 | 48 | 35 | 22 | 14 | 7 |
| FG27A | 0.0259 | 16 | 11 | 7 | 3 | 2 | 0 |
| FG27A-G11 | 0.0259 | 16 | 11 | 7 | 3 | 2 | 0 |
| G11 | 1.2131 | 632 | 400 | 258 | 125 | 62 | 18 |
| FG28 | 0.0203 | 18 | 13 | 8 | 4 | 2 | 0 |
| POND G | 1.2334 | 549 | 348 | 187 | 66 | 31 | 9 |
| G12 | 1.2334 | 549 | 348 | 187 | 66 | 31 | 9 |
| G12-G06 | 1.2334 | 548 | 348 | 187 | 66 | 31 | 9 |
| FG29 | 0.1031 | 60 | 40 | 24 | 9 | 3 | 0 |
| FG32 | 0.0402 | 74 | 58 | 45 | 29 | 20 | 11 |
| FG32-G06 | 0.0402 | 73 | 58 | 44 | 29 | 20 | 11 |
| G06 | 1.3767 | 591 | 374 | 203 | 73 | 35 | 12 |
| FG10 | 0.0963 | 71 | 53 | 37 | 21 | 12 | 5 |
| FG08A | 0.0750 | 125 | 97 | 73 | 46 | 30 | 15 |
| FG08A-G05 | 0.0750 | 125 | 97 | 72 | 45 | 30 | 15 |
| FG08B | 0.0630 | 94 | 72 | 54 | 34 | 22 | 11 |
| FG08B-G05 | 0.0630 | 93 | 72 | 54 | 34 | 22 | 11 |
| FG11 | 0.0625 | 81 | 63 | 47 | 30 | 20 | 11 |
| FG09 | 0.0484 | 52 | 39 | 27 | 16 | 9 | 4 |
| FG09-G05 | 0.0484 | 52 | 39 | 27 | 16 | 9 | 4 |
| G05 | 0.3452 | 385 | 295 | 217 | 133 | 84 | 42 |
| FG13 | 0.0656 | 44 | 31 | 20 | 10 | 5 | 1 |
| FG12 | 0.0328 | 55 | 44 | 33 | 22 | 15 | 8 |
| POND D | 0.4436 | 126 | 85 | 47 | 18 | 11 | 4 |
| POND D-G17 | 0.4436 | 126 | 85 | 47 | 18 | 11 | 4 |
| FG15 | 0.1217 | 84 | 62 | 44 | 25 | 15 | 6 |
| FG14 | 0.0359 | 49 | 38 | 29 | 18 | 12 | 6 |
| FG14-G17 | 0.0359 | 49 | 38 | 29 | 18 | 12 | 6 |

| FUTURE MDDP (Full Spectrum) | | | | | | | |
|-----------------------------|-------------------------|---------------------------|--------------------------|--------------------------|--------------------------|-------------------------|-------------------------|
| | DRAINAGE AREA (SQ. MI.) | PEAK DISCHARGE Q100 (CFS) | PEAK DISCHARGE Q50 (CFS) | PEAK DISCHARGE Q25 (CFS) | PEAK DISCHARGE Q10 (CFS) | PEAK DISCHARGE Q5 (CFS) | PEAK DISCHARGE Q2 (CFS) |
| G17a | 0.1576 | 117 | 88 | 64 | 38 | 23 | 11 |
| FG15a | 0.0156 | 30 | 23 | 18 | 12 | 8 | 4 |
| G17 | 0.6168 | 222 | 153 | 87 | 49 | 27 | 13 |
| G17-G18 | 0.6168 | 222 | 153 | 87 | 49 | 27 | 13 |
| FG16 | 0.0773 | 135 | 105 | 79 | 51 | 34 | 18 |
| G18 | 0.6941 | 249 | 182 | 131 | 81 | 51 | 26 |
| G18-POND E | 0.6941 | 249 | 181 | 131 | 80 | 51 | 26 |
| FG31 | 0.0922 | 123 | 97 | 74 | 48 | 33 | 19 |
| FG30 | 0.0400 | 82 | 65 | 50 | 33 | 23 | 13 |
| FG30-PONDHS | 0.0400 | 81 | 64 | 49 | 33 | 22 | 13 |
| POND HS | 0.1322 | 159 | 113 | 63 | 37 | 27 | 16 |
| FG17a | 0.0694 | 117 | 91 | 69 | 44 | 29 | 16 |
| FG17a-POND E | 0.0694 | 116 | 90 | 68 | 44 | 29 | 16 |
| FG18 | 0.0688 | 64 | 48 | 34 | 20 | 12 | 5 |
| FG18-POND E | 0.0688 | 63 | 48 | 34 | 20 | 12 | 5 |
| FG19 | 0.0464 | 80 | 63 | 48 | 32 | 22 | 12 |
| FG17c | 0.0313 | 34 | 24 | 16 | 7 | 3 | 1 |
| FG17b | 0.0214 | 42 | 33 | 26 | 17 | 12 | 7 |
| POND E | 1.0636 | 299 | 202 | 117 | 44 | 20 | 9 |
| FG20 | 0.0109 | 31 | 26 | 21 | 16 | 13 | 9 |
| H08-H09 | 1.0745 | 301 | 204 | 118 | 44 | 20 | 11 |
| FG34 | 0.0922 | 64 | 43 | 27 | 12 | 5 | 1 |
| G13 | 0.0922 | 64 | 43 | 27 | 12 | 5 | 1 |
| POND I | 0.0922 | 49 | 33 | 19 | 8 | 3 | 2 |
| G14 | 0.0922 | 49 | 33 | 19 | 8 | 3 | 2 |
| G14-G15 | 0.0922 | 49 | 33 | 19 | 8 | 3 | 2 |
| FG35 | 0.0566 | 39 | 26 | 16 | 7 | 3 | 0 |
| G15 | 0.1488 | 77 | 49 | 28 | 11 | 5 | 2 |
| G15-G08 | 0.1488 | 77 | 49 | 28 | 11 | 5 | 2 |
| FG37 | 0.0797 | 48 | 31 | 19 | 7 | 2 | 0 |
| FG36 | 0.0281 | 15 | 10 | 6 | 2 | 1 | 0 |
| FG36-G08 | 0.0281 | 15 | 10 | 6 | 2 | 1 | 0 |
| G08 | 0.2566 | 129 | 80 | 46 | 18 | 7 | 2 |
| FH01 | 0.1377 | 186 | 143 | 105 | 65 | 41 | 20 |
| POND H | 0.1377 | 53 | 30 | 17 | 7 | 5 | 3 |
| H12 | 0.1377 | 53 | 30 | 17 | 7 | 5 | 3 |

A second major tributary begins onsite and flows across the southwestern part of the basin toward Eastonville Road. The runoff will be collected in storm sewers and conveyed southeasterly toward Eastonville Road to the proposed detention Pond E. The detention facility will release at rates equal to or below the existing flow rate for the full spectrum of design storms into the existing drainage courses southeast of Eastonville Road. The detention pond discharges into two existing FEMA mapped drainage courses within the 4-Way Ranch subdivision located on the southeast side of Eastonville Road near DPs H08 and H09.

A smaller channel in the northeast corner of Meridian Ranch will be collected in a combination of storm sewers and open channels and conveyed southeasterly toward the proposed detention Pond I where the pond will discharge to the El Paso County Falcon Regional Park. The detention facility will release near DP G14 at a rate equal to or below the existing flow rate for the full spectrum of design storms into the existing drainage course within the Regional Park and drain southeasterly to Eastonville Road near DP G08.

Table 5 - Allowable Discharge Rates from Meridian Ranch

| MERIDIAN RANCH DISCHARGE KEY DESIGN POINTS | | | | | |
|--|---|--|--|--|---|
| | PEAK DISCHARGE Q ₁₀₀ (CFS) | PEAK DISCHARGE Q ₅₀ (CFS) | PEAK DISCHARGE Q ₂₅ (CFS) | PEAK DISCHARGE Q ₁₀ (CFS) | PEAK DISCHARGE Q ₅ (CFS) |
| 37 - JUDGE ORR ROAD | 2117 | 1391 | 834 | 338 | 131 |
| G12 - POND G OUTLET REGIONAL PARK | 596 | 399 | 242 | 96 | 34 |
| G06 - EASTONVILLE RD ¹ | 628 | 418 | 254 | 101 | 36 |
| H08 - EASTONVILLE ROAD | 227 | 149 | 89 | 35 | 13 |
| H09 - EASTONVILLE ROAD | 80 | 53 | 31 | 13 | 5 |
| G14 - POND I OUTLET REGIONAL PARK | 59 | 40 | 25 | 11 | 4 |
| G08 - EASTONVILLE RD ¹ | 122 | 81 | 49 | 20 | 8 |
| H12 - STAPLETON DRIVE EASTONVILLE ROAD | 70 | 46 | 27 | 10 | 3 |

¹ Flow rate at Eastonville Rd. listed for reference only

Haegler Ranch Basin

The runoff begins near the south east corner of Meridian Ranch within FH1. The runoff will be conveyed through the proposed development to the proposed Pond H. The outlet structure discharges through a 36” RCP. The discharge at DP H12 is not to exceed the existing flow rate for the full spectrum of design storms.

Table 6 - Detention Pond Summary

| POND | BASIN | PEAK INFLOW | PEAK OUTFLOW | STORAGE ELEV. | STORAGE VOL. |
|------------|---------|-------------|------------------|---------------------|-------------------|
| | | CFS | CFS | FT | AC-FT |
| EX POND A | BENNETT | 675 | 557 | 7144.0 | 10.7 |
| EX POND B | BENNETT | 879 | 688 | 7082.9 | 13.2 |
| EX POND C | BENNETT | 848 | 749 | 7073.7 | 19.7 |
| EX POND D | GIECK | 473 | 126 | 7056.9 | 24.5 |
| EX POND E | GIECK | 626 | 300 ¹ | 6973.0 ² | 36.7 ² |
| EX POND F | GIECK | 299 | 181 | 7136.2 | 8.8 |
| PR POND G | GIECK | 642 | 596 ¹ | 7033.3 ² | 14.3 ² |
| PR POND H | HAEGLER | 186 | 70 ¹ | 6973.4 ² | 7.8 ² |
| PR POND I | GIECK | 64 | 59 ¹ | 7071.6 ² | 1.1 ² |
| EX BENNETT | BENNETT | 1823 | 1409 | 6973.9 | 87 |

¹ Approximate discharge rate = historic peak rate

² Estimated value, actual value based on final design

Values do not match the Drainage Map

MAJOR DRAINAGE STRUCTURES

Several major drainage crossings exist along Eastonville Road either are or were undersized for the historic flow rates generated upstream. Ten locations were identified in the original Meridian Ranch MDDP in 2000 at the beginning of the project as existing road crossings along Eastonville Road that

Revise. Per UDFCD DCM regarding Full Spectrum "The maximum allowable 100-yr release rate should not exceed 90% of the approved predevelopment release rate..."

were undersized to convey existing flow. Several of the crossings have been replaced to date, while several others will require replacement with improvements to Eastonville Road. Please see Table 7: Major Drainage Structures for the status of the several crossings and a summary of the estimated equivalent pipe size necessary for each crossing. The actual size and type of conduit will be determined during final design.

Table 7 - Major Drainage Structures

| DESIGN POINT | ROAD NAME | BASIN | 100-YR PEAK FLOW RATE | PROPOSED CULVERT TYPE | ESTIMATED EQUIVALENT CULVERT SIZE ³ |
|-------------------|---------------------|---------|-----------------------|-----------------------|--|
| B10 | LONDONDERRY ROAD | BENNETT | 793 | EXISTING | EX. CONSPAN |
| POND B | LONDONDERRY ROAD | BENNETT | 688 | EXISTING | EX. CONSPAN |
| POND C | MERIDIAN RANCH BLVD | BENNETT | 749 | EXISTING | EX. CONSPAN |
| B26 | STAPLETON DRIVE | BENNETT | 1621 | EXISTING | EX. DBL 9'x9' & 10'x10' BOX RCB |
| B19 | STAPLETON DRIVE | BENNETT | 146 | EXISTING | EX. 48" RCP |
| H08 | EASTONVILLE ROAD | GIECK | 227 | EXISTING | EX. 3-48" RCP |
| H09 | EASTONVILLE ROAD | GIECK | 80 | EXISTING | EX. 2-36" RCP |
| H12 | EASTONVILLE ROAD | HAEGLER | 70 | EXISTING | EX. 4'x2' RCB |
| G08A ¹ | REX ROAD | GIECK | 331 | BOX | 2-8'x4' RCB |
| G10 ¹ | REX ROAD | GIECK | 166 | BOX | 10'x4' RCB |
| H13 ² | EASTONVILLE ROAD | GIECK | 71 | CULVERT | 2-30" RCP |
| G6 ² | EASTONVILLE ROAD | GIECK | 628 | BOX | 3-7'x3' RCB |
| G8 ² | EASTONVILLE ROAD | GIECK | 122 | BOX | 2-5'x3' RCB |
| G15 ² | REX ROAD | GIECK | 80 | CULVERT | 2-36" RCP |

¹ FUTURE INTERIOR CULVERT CROSSING

² OFFSITE CULVERT BY OTHERS (FOR REFERENCE ONLY)

³ ACTUAL CULVERT SIZE AND TYPE DETERMINED AT FINAL DESIGN.

The proposed structures located along Eastonville Road will require large multiple cell box culverts or pipes. The flows also justify requiring that the pipes be upgraded to convey the flow under Eastonville Road. The outlet for Pond H is an existing 4' x 2' reinforced concrete box. The existing Pond E requires two outlet control structures to the discharge. Temporary CMP riser structures will be replaced with permanent concrete structures the permanent concrete outlet pipes have been installed along with the appropriate culverts under Eastonville Road. The culvert crossing under Eastonville Road downstream of Pond G may require a triple 7' x 3' reinforced concrete box, or equivalent. The culvert crossing under Eastonville Road downstream of Pond I may require a double 5' x 3' reinforced concrete box, or equivalent.

EROSION CONTROL DESIGN

General Concept

Historically, erosion on this property has been held to a minimum by a variety of natural features and agricultural practices including:

- Substantial prairie grass growth
- Construction of drainage arresting berms
- Construction of multiple stock ponds along drainage courses

Existing detention ponds will also help to minimize erosion by reducing both the volume and velocity of the peak runoff.

During construction, best management practices (BMP) for erosion control will be employed based on El Paso county Criteria. BMP's will be utilized as deemed necessary by the contractor and/or engineer and are not limited to the measures shown on the construction drawing set. The contractor shall minimize the amount of area disturbed during all construction activities. Final erosion control plans will be prepared with final plat submittal.

In general the following shall be applied in developing the sequence of major activities:

- Install down-slope and side-slope perimeter BMP's before the land disturbing activity occurs.
- Do not disturb an area until it is necessary for the construction activity to proceed
- Cover or stabilize as soon as possible.
- Time the construction activities to reduce the impacts from seasonal climatic changes or weather events.
- The construction of filtration BMP's should wait until the end of the construction project when upstream drainage areas have been stabilized.
- Do not remove the temporary perimeter controls until after all upstream areas are stabilized.

Four Step Process

The following four step process is recommended for selecting structural BMP's in developing urban areas:

Step 1: Employ Runoff Reduction Practices

This development incorporates wider rights-of-way than other developments, thus decreasing the amount area devoted to pavement. The rights-of-way within Meridian Ranch are 20% wider, 60 ft. instead of 50 ft., creating more landscaped area within the development.

The project has over ten acres of open space, accounting for over 20% of the entire project, creating a lower density development.

Home owners and builders are encouraged to direct roof drains to the sideyards where the runoff will travel overland to the streets and creating an opportunity to allow the runoff to infiltrate into the ground.

Step 2: Stabilize Drainageways

The drainage swale located adjacent and south of the project was designed to have a wide flat bottom and slope reducing the velocity of the concentrated flow traveling along the drainageway. The construction of the swale also included erosion control mat along the entire length of the swale. At steeper sections of the swale straw logs or rip-rap has been installed to reduce velocities and erosion.

Step 3: Provide Water Quality Capture Volume (WQCV)

An existing extended detention pond with water quality capture volume is located to the east of the project that was designed to accommodate the runoff from this development.

Step 4: Consider Need for Industrial and Commercial BMP's

This project is neither industrial nor commercial and therefore this section does not apply.

Detention Pond

The existing detention ponds will act as the primary sedimentation control facility for the areas upstream. Runoff will be diverted into the detention pond where practical. The pond will serve a dual purpose: first, by facilitating the settling of sediment in runoff during and after construction (by means of the WQCV) and, second, by maintaining runoff at or below existing levels.

Silt Fence

Silt fence will be placed along downstream limits of disturbed areas. This will prevent suspended sediment from leaving the site during infrastructure construction. Silt fencing is to remain in place until vegetation is reestablished.

Erosion Bales

Erosion bales will be placed ten (10) feet from the inlet of all culverts during construction to prevent culverts from filling with sediment. Erosion bales will remain in place until vegetation is reestablished. Erosion bale checks will be used on slopes greater than 1 percent to reduce flow velocities until vegetation is reestablished.

Miscellaneous

Best erosion control practices will be utilized as deemed necessary by the Contractor or Engineer and are not limited to the measures described above.

Analyze and provide a narrative regarding the impact to downstream development moving forward with the design change to 90% release.

REFERENCES

1. “City of Colorado Springs/El Paso County Drainage Criteria Manual” September 1987, Revised November 1991, Revised October 1994.
2. Chapter 6, Hydrology and Chapter 11, Storage, Section 3.2.1 of the “City of Colorado Springs Drainage Criteria Manual” May 2014.
3. “Volume 2, El Paso County/City of Colorado Springs Drainage Criteria Manual- Stormwater Quality Policies, Procedures and Best Management Practices” November 1, 2002.
4. Flood Insurance Rate Study for El Paso County, Colorado and Incorporated Areas. Federal Emergency Management Agency, Revised March 17, 1997.
5. Soils Survey of El Paso County area, Natural Resources Conservation Services of Colorado.
6. Master Development Drainage Plan Meridian Ranch. August 2000. Prepared by URS Corp.
7. Revision to Master Development Drainage Plan Meridian Ranch. May 2012. Prepared by Tech Contractors.
8. Revision to Master Development Drainage Plan Meridian Ranch. May 2015. Prepared by Tech Contractors.
9. Master Development Drainage Plan Latigo Trails. October 2001. Prepared by URS Corp.
10. Final Drainage Report for Meridian Ranch Filing 1. November 2001. Prepared by URS Corp.
11. Preliminary Drainage Plan for Meridian Ranch Phase II. September 2003. Prepared by URS.
12. Final Drainage Plan for The Trails Filing No.7. March 2005. Prepared by URS.
13. Final Drainage Report for Meridian Ranch Filing 3. August 2011. Prepared by Tech Contractors.
14. Preliminary and Final Drainage Report for Meridian Ranch Filing 7. June 2012. Prepared by Tech Contractors.
15. Final Drainage Report for Meridian Ranch Estates Filing 2. July 2013. Prepared by Tech Contractors.
16. Final Drainage Report for Meridian Ranch Filing 11A. March 2014. Prepared by Tech Contractors.

17. Preliminary and Final Drainage Report for Meridian Ranch Filing 8. December 2014. Prepared by Tech Contractors.
18. Preliminary and Final Drainage Report for Meridian Ranch Filing 4B. April 2014. Prepared by Tech Contractors.
19. Final Drainage Report for Stonebridge Filing 1 at Meridian Ranch. June 2014. Prepared by Tech Contractors.
20. Final Drainage Report for Meridian Ranch Filing 9. May 2015. Prepared by Tech Contractors.
21. Final Drainage Report for Meridian Ranch Estates Filing 3. October 2015. Prepared by Tech Contractors.
22. Final Drainage Report for the Vistas Filing 1 at Meridian Ranch. July 2016. Prepared by Tech Contractors.
23. Final Drainage Report for Stonebridge Filing 2 at Meridian Ranch. September 2016. Prepared by Tech Contractors.
24. Final Drainage Report for Stonebridge Filing 3 at Meridian Ranch. April 2017. Prepared by Tech Contractors.

Appendices

Appendix A - SCS Input Data (HEC-HMS)

Add the schematic
diagram in the
appendix.

Include a disc with the HEC-HMS
modeling.

Input Data

Meridian Ranch 2017 MDDP UPDATE

| BASIN | AREA | | CURVE NO. | LAG TIME (min) |
|--|--------|--------------------|-----------|----------------|
| | (acre) | (mi ²) | | |
| HISTORIC | | | | |
| OS01 | 998 | 1.5594 | 62.9 | 35.5 |
| OS02 | 142 | 0.2219 | 64.5 | 25.5 |
| OS03 | 127 | 0.1984 | 63.2 | 23.6 |
| OS04 | 87 | 0.1359 | 61.0 | 21.4 |
| HB01 | 15 | 0.0234 | 61.0 | 12.6 |
| HB02 | 68 | 0.1063 | 61.0 | 16.2 |
| HB03 | 81 | 0.1266 | 61.0 | 13.2 |
| HB04 | 39 | 0.0609 | 61.0 | 14.4 |
| HB05 | 88 | 0.1375 | 61.0 | 15.6 |
| HB06 | 105 | 0.1641 | 61.0 | 18.0 |
| HB07 | 20 | 0.0313 | 61.0 | 10.2 |
| HB08 | 86 | 0.1344 | 61.0 | 21.6 |
| HB09 | 195 | 0.3047 | 61.0 | 33.0 |
| HB10 | 195 | 0.3047 | 61.0 | 24.0 |
| HB12 | 51 | 0.0797 | 61.0 | 18.0 |
| B-11 | 72 | 0.1125 | 61.0 | 25.8 |
| B-13 | 180 | 0.2813 | 61.0 | 33.0 |
| B-14 | 258.5 | 0.4039 | 61.0 | 34.2 |
| B-15 | 48 | 0.0750 | 61.0 | 27.0 |
| * From approved Meridian Ranch MDDP dated Aug 2015 | | | | |
| OS05 | 37 | 0.0578 | 61.0 | 15.2 |
| OS06 | 84 | 0.1313 | 61.0 | 18.7 |
| OS07 | 21 | 0.0328 | 63.1 | 15.4 |
| OS08 | 26 | 0.0406 | 65.7 | 15.9 |
| OS09 | 99 | 0.1547 | 65.0 | 29.5 |
| OS10 | 152 | 0.2375 | 65.0 | 27.9 |
| OS11 | 64 | 0.1000 | 64.1 | 30.0 |
| HG01 | 35 | 0.0547 | 61.0 | 19.6 |
| HG02 | 58 | 0.0906 | 61.0 | 25.4 |
| HG03 | 117 | 0.1828 | 61.1 | 33.8 |
| HG04 | 57 | 0.0891 | 61.0 | 30.7 |
| HG05 | 72 | 0.1125 | 61.0 | 31.8 |
| HG06A | 88 | 0.1375 | 61.0 | 43.2 |
| HG06B | 66 | 0.1031 | 61.0 | 49.5 |
| HG07 | 63 | 0.0984 | 61.0 | 28.3 |
| HG08 | 85 | 0.1328 | 61.0 | 22.9 |
| HG09 | 114 | 0.1781 | 61.0 | 35.6 |
| HG10 | 88 | 0.1375 | 61.0 | 61.4 |
| HG11 | 131 | 0.2047 | 61.0 | 40.4 |
| HG12 | 83 | 0.1297 | 61.0 | 32.0 |
| HG13 | 54 | 0.0844 | 63.1 | 21.2 |
| HG14 | 147 | 0.2297 | 61.0 | 45.1 |
| HG15 | 164 | 0.2563 | 61.0 | 65.1 |
| HG17 | 85 | 0.1328 | 61.9 | 29.9 |
| HG18 | 21 | 0.0328 | 61.0 | 14.1 |
| HG19 | 3 | 0.0047 | 61.0 | 6.1 |
| HG20 | 1 | 0.0016 | 61.0 | 6.9 |
| HG21 | 14 | 0.0219 | 61.0 | 13.8 |
| HH01 | 63 | 0.0984 | 61.0 | 16.6 |

| BASIN | AREA | | CURVE NO. | LAG TIME (min) |
|--|--------|--------------------|-----------|----------------|
| | (acre) | (mi ²) | | |
| FUTURE | | | | |
| OS01 | 998 | 1.5594 | 62.9 | 35.5 |
| OS02 | 142 | 0.2219 | 64.5 | 25.5 |
| OS03 | 127 | 0.1984 | 63.2 | 23.6 |
| OS04 | 87 | 0.1359 | 61.0 | 21.4 |
| DB01 | 46 | 0.0719 | 69.7 | 13.7 |
| DB02 | 33 | 0.0516 | 69.0 | 10.5 |
| DB03 | 45 | 0.0703 | 65.8 | 15.0 |
| DB04 | 27 | 0.0422 | 66.8 | 15.3 |
| DB05 | 25 | 0.0384 | 68.0 | 19.1 |
| DB06 | 14 | 0.0219 | 84.0 | 14.6 |
| DB07 | 16 | 0.0254 | 70.0 | 11.7 |
| DB08 | 19 | 0.0297 | 64.9 | 11.9 |
| DB09 | 12 | 0.0189 | 75.0 | 9.6 |
| DB10 | 23 | 0.0364 | 75.0 | 13.7 |
| DB11 | 62 | 0.0969 | 72.0 | 18.4 |
| DB12 | 29 | 0.0453 | 78.2 | 12.7 |
| DB13 | 45 | 0.0703 | 73.9 | 18.6 |
| DB14 | 36 | 0.0556 | 78.0 | 14.6 |
| DB15 | 79 | 0.1234 | 67.1 | 21.8 |
| DB16 | 37 | 0.0578 | 78.5 | 16.4 |
| DB17 | 3 | 0.0048 | 98.0 | 7.4 |
| DB18 | 22 | 0.0346 | 80.0 | 13.4 |
| DB19 | 18 | 0.0281 | 72.6 | 16.2 |
| DB20 | 9 | 0.0147 | 78.7 | 15.2 |
| DB21 | 33 | 0.0519 | 65.6 | 13.6 |
| DB22 | 33 | 0.0516 | 80.0 | 14.8 |
| DB23 | 11 | 0.0172 | 91.6 | 11.3 |
| DB24 | 34 | 0.0531 | 78.5 | 13.3 |
| DB25 | 14 | 0.0211 | 80.0 | 9.7 |
| DB26 | 44 | 0.0692 | 85.8 | 16.1 |
| DB27 | 101 | 0.1578 | 69.2 | 23.9 |
| DB28 | 33 | 0.0516 | 78.4 | 17.6 |
| DB29 | 61 | 0.0959 | 70.3 | 23.9 |
| FB01 | 37 | 0.0584 | 77.9 | 21.4 |
| FB02 | 20 | 0.0311 | 81.8 | 14.0 |
| WH-24 | 85 | 0.1325 | 79.0 | 16.0 |
| WH-26 | 54 | 0.0839 | 62.0 | 25.1 |
| WH-27 | 14 | 0.0217 | 62.0 | 8.6 |
| WH-28 | 26 | 0.0398 | 78.3 | 17.7 |
| WH-29 | 33 | 0.0511 | 78.0 | 16.6 |
| WH-30 | 10 | 0.0159 | 68.6 | 6.0 |
| WH-31 | 26 | 0.0406 | 80.0 | 13.2 |
| WH-32 | 29 | 0.0458 | 62.0 | 6.0 |
| WH-33 | 4 | 0.0064 | 80.0 | 13.0 |
| WH-34 | 29 | 0.0453 | 75.0 | 14.4 |
| WH-35 | 99 | 0.1547 | 68.0 | 15.0 |
| WH-36 | 48 | 0.0750 | 63.0 | 15.6 |
| * From approved Meridian Ranch MDDP dated Aug 2015 | | | | |
| + From approved Meridian Ranch Final Drainage Reports (Stonebridge Filing 2, Oct 2016) | | | | |
| ** From Retrofit Drainage Analysis for Bennett Regional Detention Pond, Jun 2014) | | | | |

| BASIN | AREA | | CURVE NO. | LAG TIME (min) |
|--------|--------|--------------------|-----------|----------------|
| | (acre) | (mi ²) | | |
| FUTURE | | | | |
| OS05 | 37 | 0.0578 | 61.0 | 15.2 |
| OS06 | 84 | 0.1313 | 61.0 | 18.7 |
| OS07 | 21 | 0.0328 | 63.1 | 15.4 |
| OS08 | 26 | 0.0406 | 65.7 | 15.9 |
| OS09 | 99 | 0.1547 | 65.0 | 29.5 |
| FG01 | 72 | 0.1127 | 63.4 | 33.8 |
| FG02 | 25 | 0.0391 | 64.6 | 16.1 |
| FG03 | 13 | 0.0203 | 68.0 | 11.6 |
| FG04 | 11 | 0.0172 | 68.0 | 7.6 |
| FG05 | 59 | 0.0922 | 66.9 | 28.7 |
| FG06 | 12 | 0.0188 | 68.0 | 15.3 |
| FG08A | 48 | 0.0750 | 76.8 | 13.3 |
| FG08B | 40 | 0.0630 | 76.7 | 16.6 |
| FG09 | 31 | 0.0484 | 71.7 | 20.8 |
| FG10 | 62 | 0.0963 | 72.0 | 37.7 |
| FG11 | 40 | 0.0625 | 78.2 | 23.2 |
| FG12 | 21 | 0.0328 | 80.0 | 16.1 |
| FG13 | 42 | 0.0656 | 66.3 | 29.6 |
| FG14 | 23 | 0.0359 | 78.0 | 20.9 |
| FG15 | 78 | 0.1217 | 72.4 | 42.8 |
| FG15a | 10 | 0.0156 | 78.7 | 11.2 |
| FG16 | 50 | 0.0773 | 78.8 | 13.0 |
| FG17a | 44 | 0.0694 | 78.1 | 14.4 |
| FG17b | 14 | 0.0214 | 79.9 | 11.4 |
| FG17c | 20 | 0.0313 | 65.2 | 11.8 |
| FG18 | 44 | 0.0688 | 73.7 | 30.1 |
| FG19 | 30 | 0.0464 | 80.0 | 15.3 |
| FG20 | 7 | 0.0109 | 92.9 | 10.1 |
| FG21 | 42 | 0.0656 | 66.9 | 22.0 |
| FG22 | 41 | 0.0641 | 66.9 | 27.4 |
| FG23 | 52 | 0.0813 | 66.5 | 26.5 |
| FG24 | 67 | 0.1041 | 64.9 | 22.7 |
| FG25 | 14 | 0.0219 | 70.8 | 26.6 |
| FG26 | 52 | 0.0813 | 72.5 | 24.8 |
| FG27a | 17 | 0.0259 | 65.5 | 31.4 |
| FG27b | 33 | 0.0508 | 77.2 | 24.3 |
| FG28 | 13 | 0.0203 | 65.6 | 17.5 |
| FG29 | 66 | 0.1031 | 61.3 | 23.3 |
| FG30 | 26 | 0.0400 | 80.0 | 10.4 |
| FG31 | 59 | 0.0922 | 80.0 | 24.0 |
| FG32 | 26 | 0.0402 | 80.0 | 13.6 |
| FG33 | 19 | 0.0302 | 71.2 | 12.7 |
| FG34 | 59 | 0.0922 | 63.7 | 22.7 |
| FG35 | 36 | 0.0566 | 62.7 | 20.7 |
| FG36 | 18 | 0.0281 | 61.0 | 24.9 |
| FG37 | 51 | 0.0797 | 61.0 | 21.8 |
| FH01 | 88 | 0.1377 | 75.7 | 18.5 |
| FH02 | 9 | 0.0139 | 98.0 | 10.9 |

Appendix B - HEC-HMS Results

| HISTORIC MDDP (Full Spectrum) | | | | | | | |
|-------------------------------|-------------------------|---------------------------|--------------------------|--------------------------|--------------------------|-------------------------|-------------------------|
| | DRAINAGE AREA (SQ. MI.) | PEAK DISCHARGE Q100 (CFS) | PEAK DISCHARGE Q50 (CFS) | PEAK DISCHARGE Q25 (CFS) | PEAK DISCHARGE Q10 (CFS) | PEAK DISCHARGE Q5 (CFS) | PEAK DISCHARGE Q2 (CFS) |
| OS02 | 0.2219 | 148 | 102 | 65 | 30 | 13 | 3 |
| B01 | 0.2219 | 148 | 102 | 65 | 30 | 13 | 3 |
| B01-B07 | 0.2219 | 148 | 102 | 65 | 30 | 13 | 3 |
| OS03 | 0.1984 | 130 | 88 | 55 | 23 | 9 | 2 |
| B02-B03 | 0.1984 | 129 | 88 | 55 | 23 | 9 | 2 |
| HB01 | 0.0234 | 19 | 13 | 8 | 3 | 1 | 0 |
| B03 | 0.2218 | 140 | 95 | 59 | 25 | 10 | 2 |
| B03-B07 | 0.2218 | 140 | 94 | 59 | 25 | 10 | 2 |
| OS04 | 0.1359 | 83 | 54 | 32 | 12 | 4 | 1 |
| B04-B05 | 0.1359 | 82 | 54 | 32 | 12 | 4 | 1 |
| HB03 | 0.1266 | 103 | 68 | 41 | 15 | 5 | 1 |
| B05 | 0.2625 | 144 | 91 | 52 | 20 | 7 | 1 |
| B05-B07 | 0.2625 | 144 | 91 | 52 | 20 | 7 | 1 |
| HB02 | 0.1063 | 77 | 51 | 30 | 11 | 4 | 0 |
| HB04 | 0.0609 | 47 | 31 | 19 | 7 | 2 | 0 |
| B07 | 0.8734 | 519 | 344 | 207 | 86 | 33 | 6 |
| B07-B12 | 0.8734 | 518 | 343 | 207 | 86 | 33 | 6 |
| HB05 | 0.1375 | 102 | 67 | 40 | 15 | 5 | 1 |
| HB06 | 0.1641 | 111 | 73 | 43 | 16 | 5 | 1 |
| B12 | 1.175 | 679 | 440 | 259 | 103 | 40 | 7 |
| B12-PB | 1.175 | 677 | 440 | 259 | 103 | 39 | 7 |
| HB07 | 0.0313 | 29 | 19 | 12 | 4 | 1 | 0 |
| POND B | 1.2063 | 688 | 446 | 262 | 105 | 40 | 7 |
| PB-19 | 1.2063 | 687 | 444 | 261 | 104 | 40 | 7 |
| OS01 | 1.5594 | 757 | 510 | 316 | 136 | 55 | 11 |
| OS01-B19 | 1.5594 | 756 | 509 | 315 | 136 | 55 | 11 |
| HB08 | 0.1344 | 81 | 53 | 32 | 12 | 4 | 1 |
| HB09 | 0.3047 | 138 | 90 | 54 | 21 | 7 | 1 |
| B19 | 3.2048 | 1563 | 1041 | 635 | 266 | 105 | 20 |
| B19-B26 | 3.2048 | 1563 | 1039 | 634 | 266 | 105 | 20 |
| HB10 | 0.3047 | 172 | 113 | 67 | 26 | 9 | 1 |
| HB12 | 0.0797 | 54 | 36 | 21 | 8 | 3 | 0 |
| HB12-B26 | 0.0797 | 54 | 35 | 21 | 8 | 3 | 0 |
| B26 | 3.5892 | 1737 | 1147 | 693 | 288 | 113 | 21 |
| 26-32 | 3.5892 | 1734 | 1146 | 693 | 287 | 113 | 21 |
| B-11 | 0.1125 | 60 | 40 | 23 | 9 | 3 | 0 |
| 32 | 3.7017 | 1782 | 1177 | 709 | 293 | 115 | 22 |
| 32-37 | 3.7017 | 1782 | 1175 | 708 | 293 | 115 | 22 |
| B-14 | 0.4039 | 178 | 117 | 70 | 27 | 10 | 2 |
| B-13 | 0.2813 | 127 | 83 | 50 | 19 | 7 | 1 |
| 36 | 0.6852 | 306 | 200 | 119 | 47 | 17 | 3 |
| 36-37 | 0.6852 | 305 | 200 | 119 | 47 | 17 | 3 |
| B-15 | 0.075 | 39 | 26 | 15 | 6 | 2 | 0 |
| 37 | 4.4619 | 2117 | 1391 | 834 | 338 | 131 | 25 |
| OS06 | 0.1313 | 87 | 57 | 34 | 13 | 4 | 1 |
| OS06-G02 | 0.1313 | 86 | 57 | 34 | 13 | 4 | 1 |
| OS05 | 0.0578 | 48 | 32 | 19 | 7 | 2 | 0 |
| OS05-G01 | 0.0578 | 47 | 31 | 19 | 7 | 2 | 0 |
| HG01 | 0.0547 | 35 | 23 | 14 | 5 | 2 | 0 |
| G01 | 0.1125 | 82 | 54 | 32 | 12 | 4 | 0 |
| G01-G02 | 0.1125 | 81 | 53 | 32 | 12 | 4 | 0 |
| HG02 | 0.0906 | 49 | 32 | 19 | 7 | 2 | 0 |
| G02 | 0.3344 | 216 | 142 | 85 | 32 | 10 | 1 |
| G02-G03 | 0.3344 | 215 | 141 | 84 | 32 | 10 | 1 |
| HG03 | 0.1828 | 82 | 54 | 32 | 13 | 5 | 1 |
| OS07 | 0.0328 | 28 | 19 | 12 | 5 | 2 | 0 |
| OS07-G03 | 0.0328 | 27 | 19 | 12 | 5 | 2 | 0 |

| HISTORIC MDDP (Full Spectrum) | | | | | | | |
|-------------------------------|-------------------------|---------------------------|--------------------------|--------------------------|--------------------------|-------------------------|-------------------------|
| | DRAINAGE AREA (SQ. MI.) | PEAK DISCHARGE Q100 (CFS) | PEAK DISCHARGE Q50 (CFS) | PEAK DISCHARGE Q25 (CFS) | PEAK DISCHARGE Q10 (CFS) | PEAK DISCHARGE Q5 (CFS) | PEAK DISCHARGE Q2 (CFS) |
| G03 | 0.55 | 323 | 213 | 127 | 49 | 16 | 2 |
| G03-G04 | 0.55 | 322 | 212 | 127 | 49 | 16 | 2 |
| OS09 | 0.1547 | 96 | 67 | 43 | 20 | 9 | 2 |
| OS09-G04 | 0.1547 | 96 | 67 | 43 | 20 | 9 | 2 |
| HG04 | 0.0891 | 42 | 28 | 17 | 6 | 2 | 0 |
| HG05 | 0.1125 | 52 | 34 | 20 | 8 | 3 | 0 |
| OS08 | 0.0406 | 39 | 27 | 18 | 9 | 4 | 1 |
| OS08-G04 | 0.0406 | 38 | 27 | 18 | 8 | 4 | 1 |
| G04 | 0.9469 | 551 | 367 | 223 | 89 | 32 | 5 |
| G04-G05 | 0.9469 | 548 | 366 | 222 | 88 | 31 | 5 |
| HG06A | 0.1375 | 51 | 34 | 20 | 8 | 3 | 1 |
| G05 | 1.0844 | 596 | 399 | 242 | 96 | 34 | 6 |
| G05-G06 | 1.0844 | 596 | 397 | 241 | 96 | 34 | 6 |
| HG06B | 0.1031 | 35 | 23 | 14 | 6 | 2 | 0 |
| G06 | 1.1875 | 628 | 418 | 254 | 101 | 36 | 6 |
| HG07 | 0.0984 | 50 | 32 | 19 | 7 | 3 | 0 |
| HG07-G11 | 0.0984 | 50 | 32 | 19 | 7 | 3 | 0 |
| HG08 | 0.1328 | 77 | 51 | 30 | 11 | 4 | 1 |
| G11 | 0.2312 | 122 | 79 | 47 | 18 | 6 | 1 |
| G11-G12 | 0.2312 | 121 | 79 | 47 | 18 | 6 | 1 |
| HG09 | 0.1781 | 76 | 50 | 30 | 12 | 4 | 1 |
| G12 | 0.4093 | 196 | 128 | 76 | 29 | 10 | 2 |
| G12-H08 | 0.4093 | 196 | 128 | 76 | 29 | 10 | 2 |
| HG10 | 0.1375 | 40 | 26 | 16 | 7 | 3 | 1 |
| H08 | 0.5468 | 227 | 149 | 89 | 35 | 13 | 2 |
| HG14 | 0.2297 | 83 | 55 | 33 | 13 | 5 | 1 |
| HG13 | 0.0844 | 59 | 40 | 25 | 11 | 4 | 1 |
| G07 | 0.0844 | 59 | 40 | 25 | 11 | 4 | 1 |
| G07-G08 | 0.0844 | 59 | 40 | 25 | 11 | 4 | 1 |
| G08 | 0.3141 | 122 | 81 | 49 | 20 | 8 | 1 |
| HG15 | 0.2563 | 71 | 47 | 28 | 12 | 5 | 1 |
| H13 | 0.2563 | 71 | 47 | 28 | 12 | 5 | 1 |
| HG11 | 0.2047 | 80 | 53 | 31 | 13 | 5 | 1 |
| H09 | 0.2047 | 80 | 53 | 31 | 13 | 5 | 1 |
| HH01 | 0.0984 | 70 | 46 | 27 | 10 | 3 | 0 |
| H12 | 0.0984 | 70 | 46 | 27 | 10 | 3 | 0 |
| HG12 | 0.1297 | 60 | 39 | 23 | 9 | 3 | 1 |
| H10 | 0.1297 | 60 | 39 | 23 | 9 | 3 | 1 |

FUTURE MDDP (Full Spectrum)

| | DRAINAGE AREA (SQ. MI.) | PEAK DISCHARGE Q100 (CFS) | PEAK DISCHARGE Q50 (CFS) | PEAK DISCHARGE Q25 (CFS) | PEAK DISCHARGE Q10 (CFS) | PEAK DISCHARGE Q5 (CFS) | PEAK DISCHARGE Q2 (CFS) |
|------------|-------------------------|---------------------------|--------------------------|--------------------------|--------------------------|-------------------------|-------------------------|
| OS01 | 1.5594 | 757 | 510 | 316 | 136 | 55 | 11 |
| DB16 | 0.0578 | 92 | 72 | 54 | 35 | 23 | 13 |
| B10 | 1.6172 | 793 | 537 | 335 | 147 | 62 | 13 |
| B10-B11 | 1.6172 | 793 | 537 | 335 | 147 | 62 | 13 |
| DB17 | 0.0048 | 15 | 13 | 11 | 9 | 7 | 6 |
| B11 | 1.6220 | 795 | 538 | 336 | 148 | 63 | 15 |
| B11-POND C | 1.6220 | 794 | 538 | 336 | 148 | 62 | 15 |
| DB21 | 0.0519 | 54 | 38 | 25 | 12 | 5 | 1 |
| DB18 | 0.0346 | 64 | 50 | 39 | 26 | 18 | 10 |
| DB19 | 0.0281 | 36 | 27 | 20 | 11 | 7 | 3 |
| DB20 | 0.0147 | 24 | 19 | 15 | 9 | 6 | 3 |
| POND C | 1.7513 | 749 | 507 | 310 | 128 | 50 | 11 |
| POND C-B16 | 1.7513 | 749 | 507 | 309 | 128 | 50 | 11 |
| DB25 | 0.0211 | 45 | 35 | 27 | 18 | 12 | 7 |
| B16 | 1.7724 | 754 | 511 | 313 | 130 | 51 | 11 |
| B16-B17 | 1.7724 | 754 | 510 | 312 | 130 | 51 | 11 |
| DB26 | 0.0682 | 136 | 110 | 88 | 62 | 46 | 29 |
| B17 | 1.8406 | 778 | 529 | 326 | 138 | 56 | 34 |
| B17-B18 | 1.8406 | 778 | 529 | 326 | 138 | 56 | 34 |
| OS03 | 0.1984 | 130 | 88 | 55 | 23 | 9 | 2 |
| DB01 | 0.0719 | 90 | 66 | 46 | 25 | 14 | 5 |
| B01 | 0.2703 | 199 | 138 | 89 | 42 | 19 | 5 |
| B01-B02 | 0.2703 | 199 | 138 | 89 | 42 | 19 | 5 |
| OS02 | 0.2219 | 148 | 102 | 65 | 30 | 13 | 3 |
| DB02 | 0.0516 | 71 | 52 | 36 | 20 | 10 | 3 |
| B02 | 0.5438 | 380 | 263 | 169 | 79 | 36 | 9 |
| B02-POND A | 0.5438 | 379 | 263 | 169 | 79 | 36 | 9 |
| OS04 | 0.1359 | 83 | 54 | 32 | 12 | 4 | 1 |
| DB03 | 0.0703 | 70 | 49 | 32 | 16 | 7 | 2 |
| B03 | 0.2062 | 145 | 98 | 61 | 26 | 10 | 2 |
| B03-B04 | 0.2062 | 145 | 98 | 60 | 25 | 10 | 2 |
| DB04 | 0.0422 | 44 | 31 | 21 | 10 | 5 | 1 |
| DB05 | 0.0384 | 37 | 27 | 18 | 9 | 5 | 1 |
| B04 | 0.2868 | 218 | 149 | 94 | 42 | 18 | 4 |
| B04-B05 | 0.2868 | 218 | 149 | 94 | 42 | 18 | 4 |
| DB06 | 0.0219 | 44 | 35 | 28 | 19 | 14 | 9 |
| B05 | 0.3087 | 253 | 176 | 115 | 55 | 25 | 10 |
| B05-POND A | 0.3087 | 252 | 176 | 114 | 55 | 25 | 10 |
| DB07 | 0.0254 | 35 | 26 | 18 | 10 | 6 | 2 |
| DB08 | 0.0297 | 32 | 22 | 15 | 7 | 3 | 0 |
| POND A | 0.9076 | 557 | 401 | 244 | 98 | 34 | 6 |
| POND A-B06 | 0.9076 | 557 | 400 | 244 | 98 | 34 | 6 |
| DB09 | 0.0189 | 34 | 26 | 19 | 12 | 8 | 4 |
| B06 | 0.9265 | 565 | 407 | 248 | 100 | 35 | 6 |
| B06-B07 | 0.9265 | 564 | 406 | 247 | 99 | 35 | 6 |
| DB11 | 0.0969 | 114 | 85 | 60 | 35 | 20 | 8 |
| DB10 | 0.0364 | 56 | 43 | 32 | 19 | 12 | 6 |
| B07 | 1.0598 | 652 | 469 | 286 | 116 | 42 | 15 |
| B07-B09 | 1.0598 | 651 | 468 | 285 | 116 | 42 | 14 |
| DB12 | 0.0453 | 81 | 63 | 48 | 31 | 21 | 11 |
| B09 | 1.1051 | 677 | 486 | 296 | 121 | 45 | 19 |
| B09-POND B | 1.1051 | 676 | 485 | 296 | 121 | 45 | 19 |
| DB15 | 0.1234 | 105 | 75 | 50 | 25 | 12 | 3 |
| DB13 | 0.0703 | 89 | 67 | 49 | 29 | 18 | 8 |
| DB14 | 0.0556 | 93 | 72 | 54 | 35 | 23 | 12 |
| POND B | 1.3544 | 688 | 539 | 337 | 140 | 69 | 30 |

| FUTURE MDDP (Full Spectrum) | | | | | | | |
|-----------------------------|-------------------------|---------------------------|--------------------------|--------------------------|--------------------------|-------------------------|-------------------------|
| | DRAINAGE AREA (SQ. MI.) | PEAK DISCHARGE Q100 (CFS) | PEAK DISCHARGE Q50 (CFS) | PEAK DISCHARGE Q25 (CFS) | PEAK DISCHARGE Q10 (CFS) | PEAK DISCHARGE Q5 (CFS) | PEAK DISCHARGE Q2 (CFS) |
| POND B-B12 | 1.3544 | 688 | 539 | 336 | 140 | 69 | 30 |
| DB22 | 0.0516 | 91 | 72 | 55 | 36 | 25 | 14 |
| DB23 | 0.0172 | 45 | 38 | 31 | 23 | 18 | 13 |
| B12 | 1.4232 | 714 | 562 | 352 | 148 | 83 | 38 |
| B12-B14 | 1.4232 | 714 | 562 | 352 | 148 | 83 | 38 |
| DB24 | 0.0531 | 94 | 73 | 56 | 36 | 24 | 13 |
| B14 | 1.4763 | 743 | 577 | 363 | 162 | 92 | 46 |
| B14-B15 | 1.4763 | 742 | 576 | 362 | 162 | 92 | 46 |
| DB28 | 0.0516 | 79 | 61 | 46 | 30 | 20 | 11 |
| B15 | 1.5279 | 783 | 595 | 375 | 179 | 107 | 56 |
| B15-B18 | 1.5279 | 781 | 595 | 374 | 179 | 107 | 56 |
| DB27 | 0.1578 | 140 | 101 | 70 | 37 | 20 | 7 |
| DB29 | 0.0959 | 89 | 65 | 46 | 25 | 14 | 5 |
| B26 | 3.6222 | 1621 | 1178 | 735 | 316 | 186 | 95 |
| B26-27 | 3.6222 | 1621 | 1177 | 735 | 316 | 185 | 94 |
| FB-01 | 0.0630 | 81 | 63 | 47 | 29 | 19 | 10 |
| FB01-27a | 0.0630 | 81 | 63 | 47 | 29 | 19 | 10 |
| FB-02 | 0.0375 | 75 | 60 | 47 | 32 | 23 | 14 |
| B19 | 0.1005 | 146 | 114 | 87 | 57 | 38 | 21 |
| B19-27 | 0.1005 | 146 | 114 | 87 | 56 | 38 | 21 |
| 27 | 3.7227 | 1663 | 1209 | 756 | 337 | 213 | 108 |
| 27-32 | 3.7227 | 1662 | 1208 | 755 | 336 | 212 | 107 |
| WH-24 | 0.1325 | 217 | 170 | 129 | 84 | 56 | 31 |
| WH-26 | 0.0839 | 49 | 33 | 20 | 8 | 3 | 0 |
| WH-27 | 0.0217 | 23 | 16 | 10 | 4 | 1 | 0 |
| 30 | 0.2381 | 271 | 205 | 150 | 91 | 59 | 31 |
| 30-31 | 0.2381 | 270 | 205 | 149 | 91 | 59 | 31 |
| WH-28 | 0.0398 | 60 | 47 | 36 | 23 | 15 | 8 |
| 31 | 0.2779 | 330 | 252 | 185 | 114 | 74 | 39 |
| 31-32 | 0.2779 | 329 | 251 | 185 | 113 | 73 | 39 |
| WH-29 | 0.0511 | 80 | 62 | 47 | 30 | 20 | 11 |
| WH-31 | 0.0406 | 75 | 59 | 46 | 30 | 21 | 12 |
| WH-30 | 0.0159 | 26 | 19 | 13 | 7 | 4 | 1 |
| 32 | 4.1082 | 1815 | 1302 | 817 | 457 | 287 | 139 |
| WH32 | 0.0458 | 54 | 38 | 24 | 10 | 4 | 0 |
| BEN POND | 4.1540 | 1409 | 1000 | 607 | 259 | 105 | 46 |
| WH-33 | 0.0064 | 12 | 9 | 7 | 5 | 3 | 2 |
| 33 | 4.1604 | 1411 | 1001 | 607 | 259 | 105 | 46 |
| 33-37 | 4.1604 | 1410 | 1001 | 607 | 259 | 105 | 46 |
| WH35 | 0.1550 | 171 | 124 | 84 | 44 | 22 | 6 |
| WH34 | 0.0450 | 68 | 52 | 38 | 23 | 15 | 7 |
| B34-36 | 0.0450 | 68 | 52 | 38 | 23 | 15 | 7 |
| 36 | 0.2000 | 239 | 176 | 122 | 67 | 37 | 13 |
| 36-37 | 0.2000 | 238 | 174 | 121 | 66 | 37 | 13 |
| WH36 | 0.0750 | 63 | 43 | 27 | 11 | 4 | 1 |
| 37 | 4.4354 | 1449 | 1031 | 627 | 269 | 109 | 50 |
| FG01 | 0.1127 | 58 | 40 | 25 | 11 | 5 | 1 |
| OS05 | 0.0578 | 43 | 29 | 17 | 6 | 2 | 0 |
| G1 | 0.1705 | 83 | 55 | 34 | 14 | 6 | 1 |
| G1-G2 | 0.1705 | 83 | 55 | 34 | 14 | 6 | 1 |
| OS06 | 0.1313 | 87 | 57 | 34 | 13 | 4 | 1 |
| G1a | 0.1313 | 87 | 57 | 34 | 13 | 4 | 1 |
| G1a-G2 | 0.1313 | 87 | 57 | 34 | 13 | 4 | 1 |
| FG02 | 0.0391 | 35 | 24 | 16 | 7 | 3 | 1 |
| G2 | 0.3409 | 200 | 132 | 80 | 32 | 12 | 2 |
| G2-G3 | 0.3409 | 199 | 132 | 80 | 32 | 12 | 2 |
| FG03 | 0.0203 | 26 | 19 | 13 | 7 | 1 | 1 |

| FUTURE MDDP (Full Spectrum) | | | | | | | |
|-----------------------------|-------------------------|---------------------------|--------------------------|--------------------------|--------------------------|-------------------------|-------------------------|
| | DRAINAGE AREA (SQ. MI.) | PEAK DISCHARGE Q100 (CFS) | PEAK DISCHARGE Q50 (CFS) | PEAK DISCHARGE Q25 (CFS) | PEAK DISCHARGE Q10 (CFS) | PEAK DISCHARGE Q5 (CFS) | PEAK DISCHARGE Q2 (CFS) |
| FG04 | 0.0172 | 23 | 16 | 11 | 6 | 3 | 1 |
| G3 | 0.3784 | 222 | 147 | 89 | 36 | 13 | 3 |
| G3-POND F | 0.3784 | 221 | 147 | 89 | 36 | 13 | 3 |
| FG05 | 0.0922 | 65 | 46 | 30 | 15 | 7 | 2 |
| FG06 | 0.0188 | 21 | 15 | 10 | 5 | 3 | 1 |
| POND F | 0.4894 | 181 | 126 | 65 | 17 | 8 | 2 |
| POND F-G7 | 0.4894 | 181 | 126 | 65 | 17 | 8 | 2 |
| FG21 | 0.0656 | 55 | 39 | 26 | 13 | 6 | 2 |
| OS07 | 0.0328 | 28 | 19 | 12 | 5 | 2 | 0 |
| OS07-G7 | 0.0328 | 27 | 19 | 12 | 5 | 2 | 0 |
| G7 | 0.5878 | 223 | 151 | 77 | 22 | 10 | 3 |
| G7-G8 | 0.5878 | 223 | 151 | 77 | 22 | 10 | 3 |
| FG22 | 0.0641 | 46 | 33 | 22 | 11 | 5 | 1 |
| G8 | 0.6519 | 261 | 172 | 87 | 29 | 12 | 3 |
| G8-G8A | 0.6519 | 261 | 172 | 87 | 29 | 12 | 3 |
| FG23 | 0.0813 | 59 | 42 | 27 | 13 | 6 | 2 |
| OS08 | 0.0406 | 39 | 27 | 18 | 9 | 4 | 1 |
| OS11-G8A | 0.0406 | 39 | 27 | 18 | 9 | 4 | 1 |
| G8A | 0.7738 | 331 | 209 | 105 | 46 | 21 | 6 |
| G8A-G9 | 0.7738 | 331 | 209 | 105 | 46 | 21 | 6 |
| FG25 | 0.0219 | 19 | 14 | 10 | 6 | 3 | 1 |
| G9 | 0.7957 | 349 | 219 | 115 | 51 | 24 | 7 |
| G9-G11 | 0.7957 | 348 | 219 | 115 | 51 | 24 | 7 |
| OS09 | 0.1547 | 96 | 67 | 43 | 20 | 9 | 2 |
| OS09-G10 | 0.1547 | 96 | 67 | 43 | 20 | 9 | 2 |
| FG24 | 0.1047 | 77 | 54 | 34 | 16 | 7 | 1 |
| G10 | 0.2594 | 166 | 115 | 74 | 34 | 15 | 3 |
| G10-G11 | 0.2594 | 166 | 115 | 73 | 34 | 15 | 3 |
| FG26 | 0.0813 | 81 | 61 | 43 | 25 | 15 | 6 |
| FG27B | 0.0508 | 61 | 48 | 35 | 22 | 14 | 7 |
| FG27A | 0.0259 | 16 | 11 | 7 | 3 | 2 | 0 |
| FG27A-G11 | 0.0259 | 16 | 11 | 7 | 3 | 2 | 0 |
| G11 | 1.2131 | 632 | 400 | 258 | 125 | 62 | 18 |
| FG28 | 0.0203 | 18 | 13 | 8 | 4 | 2 | 0 |
| POND G | 1.2334 | 549 | 348 | 187 | 66 | 31 | 9 |
| G12 | 1.2334 | 549 | 348 | 187 | 66 | 31 | 9 |
| G12-G06 | 1.2334 | 548 | 348 | 187 | 66 | 31 | 9 |
| FG29 | 0.1031 | 60 | 40 | 24 | 9 | 3 | 0 |
| FG32 | 0.0402 | 74 | 58 | 45 | 29 | 20 | 11 |
| FG32-G06 | 0.0402 | 73 | 58 | 44 | 29 | 20 | 11 |
| G06 | 1.3767 | 591 | 374 | 203 | 73 | 35 | 12 |
| FG10 | 0.0963 | 71 | 53 | 37 | 21 | 12 | 5 |
| FG08A | 0.0750 | 125 | 97 | 73 | 46 | 30 | 15 |
| FG08A-G05 | 0.0750 | 125 | 97 | 72 | 45 | 30 | 15 |
| FG08B | 0.0630 | 94 | 72 | 54 | 34 | 22 | 11 |
| FG08B-G05 | 0.0630 | 93 | 72 | 54 | 34 | 22 | 11 |
| FG11 | 0.0625 | 81 | 63 | 47 | 30 | 20 | 11 |
| FG09 | 0.0484 | 52 | 39 | 27 | 16 | 9 | 4 |
| FG09-G05 | 0.0484 | 52 | 39 | 27 | 16 | 9 | 4 |
| G05 | 0.3452 | 385 | 295 | 217 | 133 | 84 | 42 |
| FG13 | 0.0656 | 44 | 31 | 20 | 10 | 5 | 1 |
| FG12 | 0.0328 | 55 | 44 | 33 | 22 | 15 | 8 |
| POND D | 0.4436 | 126 | 85 | 47 | 18 | 11 | 4 |
| POND D-G17 | 0.4436 | 126 | 85 | 47 | 18 | 11 | 4 |
| FG15 | 0.1217 | 84 | 62 | 44 | 25 | 15 | 6 |
| FG14 | 0.0359 | 49 | 38 | 29 | 18 | 12 | 6 |
| FG14-G17 | 0.0359 | 49 | 38 | 29 | 18 | 12 | 6 |

| FUTURE MDDP (Full Spectrum) | | | | | | | |
|-----------------------------|-------------------------|---------------------------|--------------------------|--------------------------|--------------------------|-------------------------|-------------------------|
| | DRAINAGE AREA (SQ. MI.) | PEAK DISCHARGE Q100 (CFS) | PEAK DISCHARGE Q50 (CFS) | PEAK DISCHARGE Q25 (CFS) | PEAK DISCHARGE Q10 (CFS) | PEAK DISCHARGE Q5 (CFS) | PEAK DISCHARGE Q2 (CFS) |
| G17a | 0.1576 | 117 | 88 | 64 | 38 | 23 | 11 |
| FG15a | 0.0156 | 30 | 23 | 18 | 12 | 8 | 4 |
| G17 | 0.6168 | 222 | 153 | 87 | 49 | 27 | 13 |
| G17-G18 | 0.6168 | 222 | 153 | 87 | 49 | 27 | 13 |
| FG16 | 0.0773 | 135 | 105 | 79 | 51 | 34 | 18 |
| G18 | 0.6941 | 249 | 182 | 131 | 81 | 51 | 26 |
| G18-POND E | 0.6941 | 249 | 181 | 131 | 80 | 51 | 26 |
| FG31 | 0.0922 | 123 | 97 | 74 | 48 | 33 | 19 |
| FG30 | 0.0400 | 82 | 65 | 50 | 33 | 23 | 13 |
| FG30-PONDHS | 0.0400 | 81 | 64 | 49 | 33 | 22 | 13 |
| POND HS | 0.1322 | 159 | 113 | 63 | 37 | 27 | 16 |
| FG17a | 0.0694 | 117 | 91 | 69 | 44 | 29 | 16 |
| FG17a-POND E | 0.0694 | 116 | 90 | 68 | 44 | 29 | 16 |
| FG18 | 0.0688 | 64 | 48 | 34 | 20 | 12 | 5 |
| FG18-POND E | 0.0688 | 63 | 48 | 34 | 20 | 12 | 5 |
| FG19 | 0.0464 | 80 | 63 | 48 | 32 | 22 | 12 |
| FG17c | 0.0313 | 34 | 24 | 16 | 7 | 3 | 1 |
| FG17b | 0.0214 | 42 | 33 | 26 | 17 | 12 | 7 |
| POND E | 1.0636 | 299 | 202 | 117 | 44 | 20 | 9 |
| FG20 | 0.0109 | 31 | 26 | 21 | 16 | 13 | 9 |
| H08-H09 | 1.0745 | 301 | 204 | 118 | 44 | 20 | 11 |
| FG34 | 0.0922 | 64 | 43 | 27 | 12 | 5 | 1 |
| G13 | 0.0922 | 64 | 43 | 27 | 12 | 5 | 1 |
| POND I | 0.0922 | 49 | 33 | 19 | 8 | 3 | 2 |
| G14 | 0.0922 | 49 | 33 | 19 | 8 | 3 | 2 |
| G14-G15 | 0.0922 | 49 | 33 | 19 | 8 | 3 | 2 |
| FG35 | 0.0566 | 39 | 26 | 16 | 7 | 3 | 0 |
| G15 | 0.1488 | 77 | 49 | 28 | 11 | 5 | 2 |
| G15-G08 | 0.1488 | 77 | 49 | 28 | 11 | 5 | 2 |
| FG37 | 0.0797 | 48 | 31 | 19 | 7 | 2 | 0 |
| FG36 | 0.0281 | 15 | 10 | 6 | 2 | 1 | 0 |
| FG36-G08 | 0.0281 | 15 | 10 | 6 | 2 | 1 | 0 |
| G08 | 0.2566 | 129 | 80 | 46 | 18 | 7 | 2 |
| FH01 | 0.1377 | 186 | 143 | 105 | 65 | 41 | 20 |
| POND H | 0.1377 | 53 | 30 | 17 | 7 | 5 | 3 |
| H12 | 0.1377 | 53 | 30 | 17 | 7 | 5 | 3 |

Appendix C - Detention Pond Information

**EXISTING DETENTION PONDS
FINAL FUTURE CONDITION
Simulation Run: F-100 YR Reservoir: POND A
BENNETT RANCH BASIN**

| | | | |
|---------------------|--------------------|-------------------------|--------------------|
| Start of Run: | 01Jul2015, 00:00 | Basin Model: | Future SCS |
| End of Run: | 02Jul2015, 00:00 | Meteorologic Model: | SCS TYPE IIA 100YR |
| Compute Time: | 08Oct2017 10:28:34 | Control Specifications: | 24 HR-2 MIN. |
| Volume Units: AC-FT | | | |

Computed Results:

| | | | |
|----------------|--------------|----------------------------|------------------|
| Peak Inflow: | 675 (CFS) | Date/Time of Peak Inflow: | 01Jul2015, 12:14 |
| Peak Outflow: | 557(CFS) | Date/Time of Peak Outflow: | 01Jul2015, 12:26 |
| Total Inflow : | 80.1 (AC-FT) | Peak Storage: | 10.7 (AC-FT) |
| Total Outflow: | 77.2 (AC-FT) | Peak Elevation: | 7144.0 (FT) |

**Simulation Run: F-100 YR Reservoir: POND B
BENNETT RANCH BASIN**

| | | | |
|---------------------|--------------------|-------------------------|--------------------|
| Start of Run: | 01Jul2015, 00:00 | Basin Model: | Future SCS |
| End of Run: | 02Jul2015, 00:00 | Meteorologic Model: | SCS TYPE IIA 100YR |
| Compute Time: | 08Oct2017 10:28:34 | Control Specifications: | 24 HR-2 MIN. |
| Volume Units: AC-FT | | | |

Computed Results:

| | | | |
|----------------|---------------|----------------------------|------------------|
| Peak Inflow: | 879 (CFS) | Date/Time of Peak Inflow: | 01Jul2015, 12:22 |
| Peak Outflow: | 688(CFS) | Date/Time of Peak Outflow: | 01Jul2015, 12:42 |
| Total Inflow : | 129.4 (AC-FT) | Peak Storage: | 13.2 (AC-FT) |
| Total Outflow: | 128.6 (AC-FT) | Peak Elevation: | 7082.9 (FT) |

**Simulation Run: F-100 YR Reservoir: POND C
BENNETT RANCH BASIN**

| | | | |
|---------------------|--------------------|-------------------------|--------------------|
| Start of Run: | 01Jul2015, 00:00 | Basin Model: | Future SCS |
| End of Run: | 02Jul2015, 00:00 | Meteorologic Model: | SCS TYPE IIA 100YR |
| Compute Time: | 08Oct2017 10:28:34 | Control Specifications: | 24 HR-2 MIN. |
| Volume Units: AC-FT | | | |

Computed Results:

| | | | |
|----------------|---------------|----------------------------|------------------|
| Peak Inflow: | 848 (CFS) | Date/Time of Peak Inflow: | 01Jul2015, 12:32 |
| Peak Outflow: | 749(CFS) | Date/Time of Peak Outflow: | 01Jul2015, 12:46 |
| Total Inflow : | 146.1 (AC-FT) | Peak Storage: | 19.7 (AC-FT) |
| Total Outflow: | 141.3 (AC-FT) | Peak Elevation: | 7073.7 (FT) |

**Simulation Run: F-100 YR Reservoir: POND D
GIECK RANCH BASIN**

Start of Run: 01Jul2015, 00:00 Basin Model: Future SCS
End of Run: 02Jul2015, 00:00 Meteorologic Model: SCS TYPE IIA 100YR
Compute Time: 08Oct2017 10:28:34 Control Specifications: 24 HR-2 MIN.
Volume Units: AC-FT

Computed Results:

Peak Inflow: 473 (CFS) Date/Time of Peak Inflow: 01Jul2015, 12:14
Peak Outflow: 126(CFS) Date/Time of Peak Outflow: 01Jul2015, 13:04
Total Inflow : 55.4 (AC-FT) Peak Storage: 24.5 (AC-FT)
Total Outflow: 45.3 (AC-FT) Peak Elevation: 7056.9 (FT)

**Simulation Run: F-100 YR Reservoir: POND E
GIECK RANCH BASIN**

Start of Run: 01Jul2015, 00:00 Basin Model: Future SCS
End of Run: 02Jul2015, 00:00 Meteorologic Model: SCS TYPE IIA 100YR
Compute Time: 08Oct2017 10:28:34 Control Specifications: 24 HR-2 MIN.
Volume Units: AC-FT

Computed Results:

Peak Inflow: 626 (CFS) Date/Time of Peak Inflow: 01Jul2015, 12:16
Peak Outflow: 300(CFS) Date/Time of Peak Outflow: 01Jul2015, 13:14
Total Inflow : 129.1 (AC-FT) Peak Storage: 36.7 (AC-FT)
Total Outflow: 111.6 (AC-FT) Peak Elevation: 6973.1 (FT)

**Simulation Run: F-100 YR Reservoir: POND F
GIECK RANCH BASIN**

Start of Run: 01Jul2015, 00:00 Basin Model: Future SCS
End of Run: 02Jul2015, 00:00 Meteorologic Model: SCS TYPE IIA 100YR
Compute Time: 08Oct2017 10:28:34 Control Specifications: 24 HR-2 MIN.
Volume Units: AC-FT

Computed Results:

Peak Inflow: 299 (CFS) Date/Time of Peak Inflow: 01Jul2015, 12:18
Peak Outflow: 181(CFS) Date/Time of Peak Outflow: 01Jul2015, 12:44
Total Inflow : 39.9 (AC-FT) Peak Storage: 8.8 (AC-FT)
Total Outflow: 37.8 (AC-FT) Peak Elevation: 7136.2 (FT)

**Simulation Run: F-100 YR Reservoir: BENNET REGIONAL POND
BENNETT RANCH BASIN**

| | | | |
|---------------|--------------------|-------------------------|--------------------|
| Start of Run: | 01Jul2015, 00:00 | Basin Model: | Future SCS |
| End of Run: | 02Jul2015, 00:00 | Meteorologic Model: | SCS TYPE IIA 100YR |
| Compute Time: | 08Oct2017 10:28:34 | Control Specifications: | 24 HR-2 MIN. |
| | | Volume Units: | AC-FT |

Computed Results:



| | | | |
|----------------|---------------|----------------------------|------------------|
| Peak Inflow: | 1823 (CFS) | Date/Time of Peak Inflow: | 01Jul2015, 12:38 |
| Peak Outflow: | 1409(CFS) | Date/Time of Peak Outflow: | 01Jul2015, 13:16 |
| Total Inflow : | 400.8 (AC-FT) | Peak Storage: | 87.0 (AC-FT) |
| Total Outflow: | 381.0 (AC-FT) | Peak Elevation: | 6973.9 (FT) |

FUTURE POND ESTIMATES

| | | | |
|--------|---------------------|------------|--------|
| POND G | GIECK RANCH BASIN | 14.3 AC-FT | 7033.3 |
| POND H | HAEGLER RANCH BASIN | 7.8 AC-FT | 6973.4 |
| POND I | GIECK RANCH BASIN | 1.1 AC-FT | 7071.6 |

I

MASTER DEVELOPMENT DRAINAGE PLAN MERIDIAN RANCH

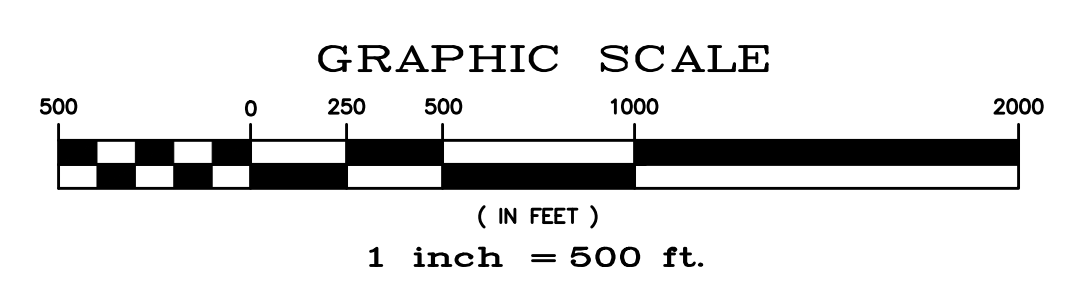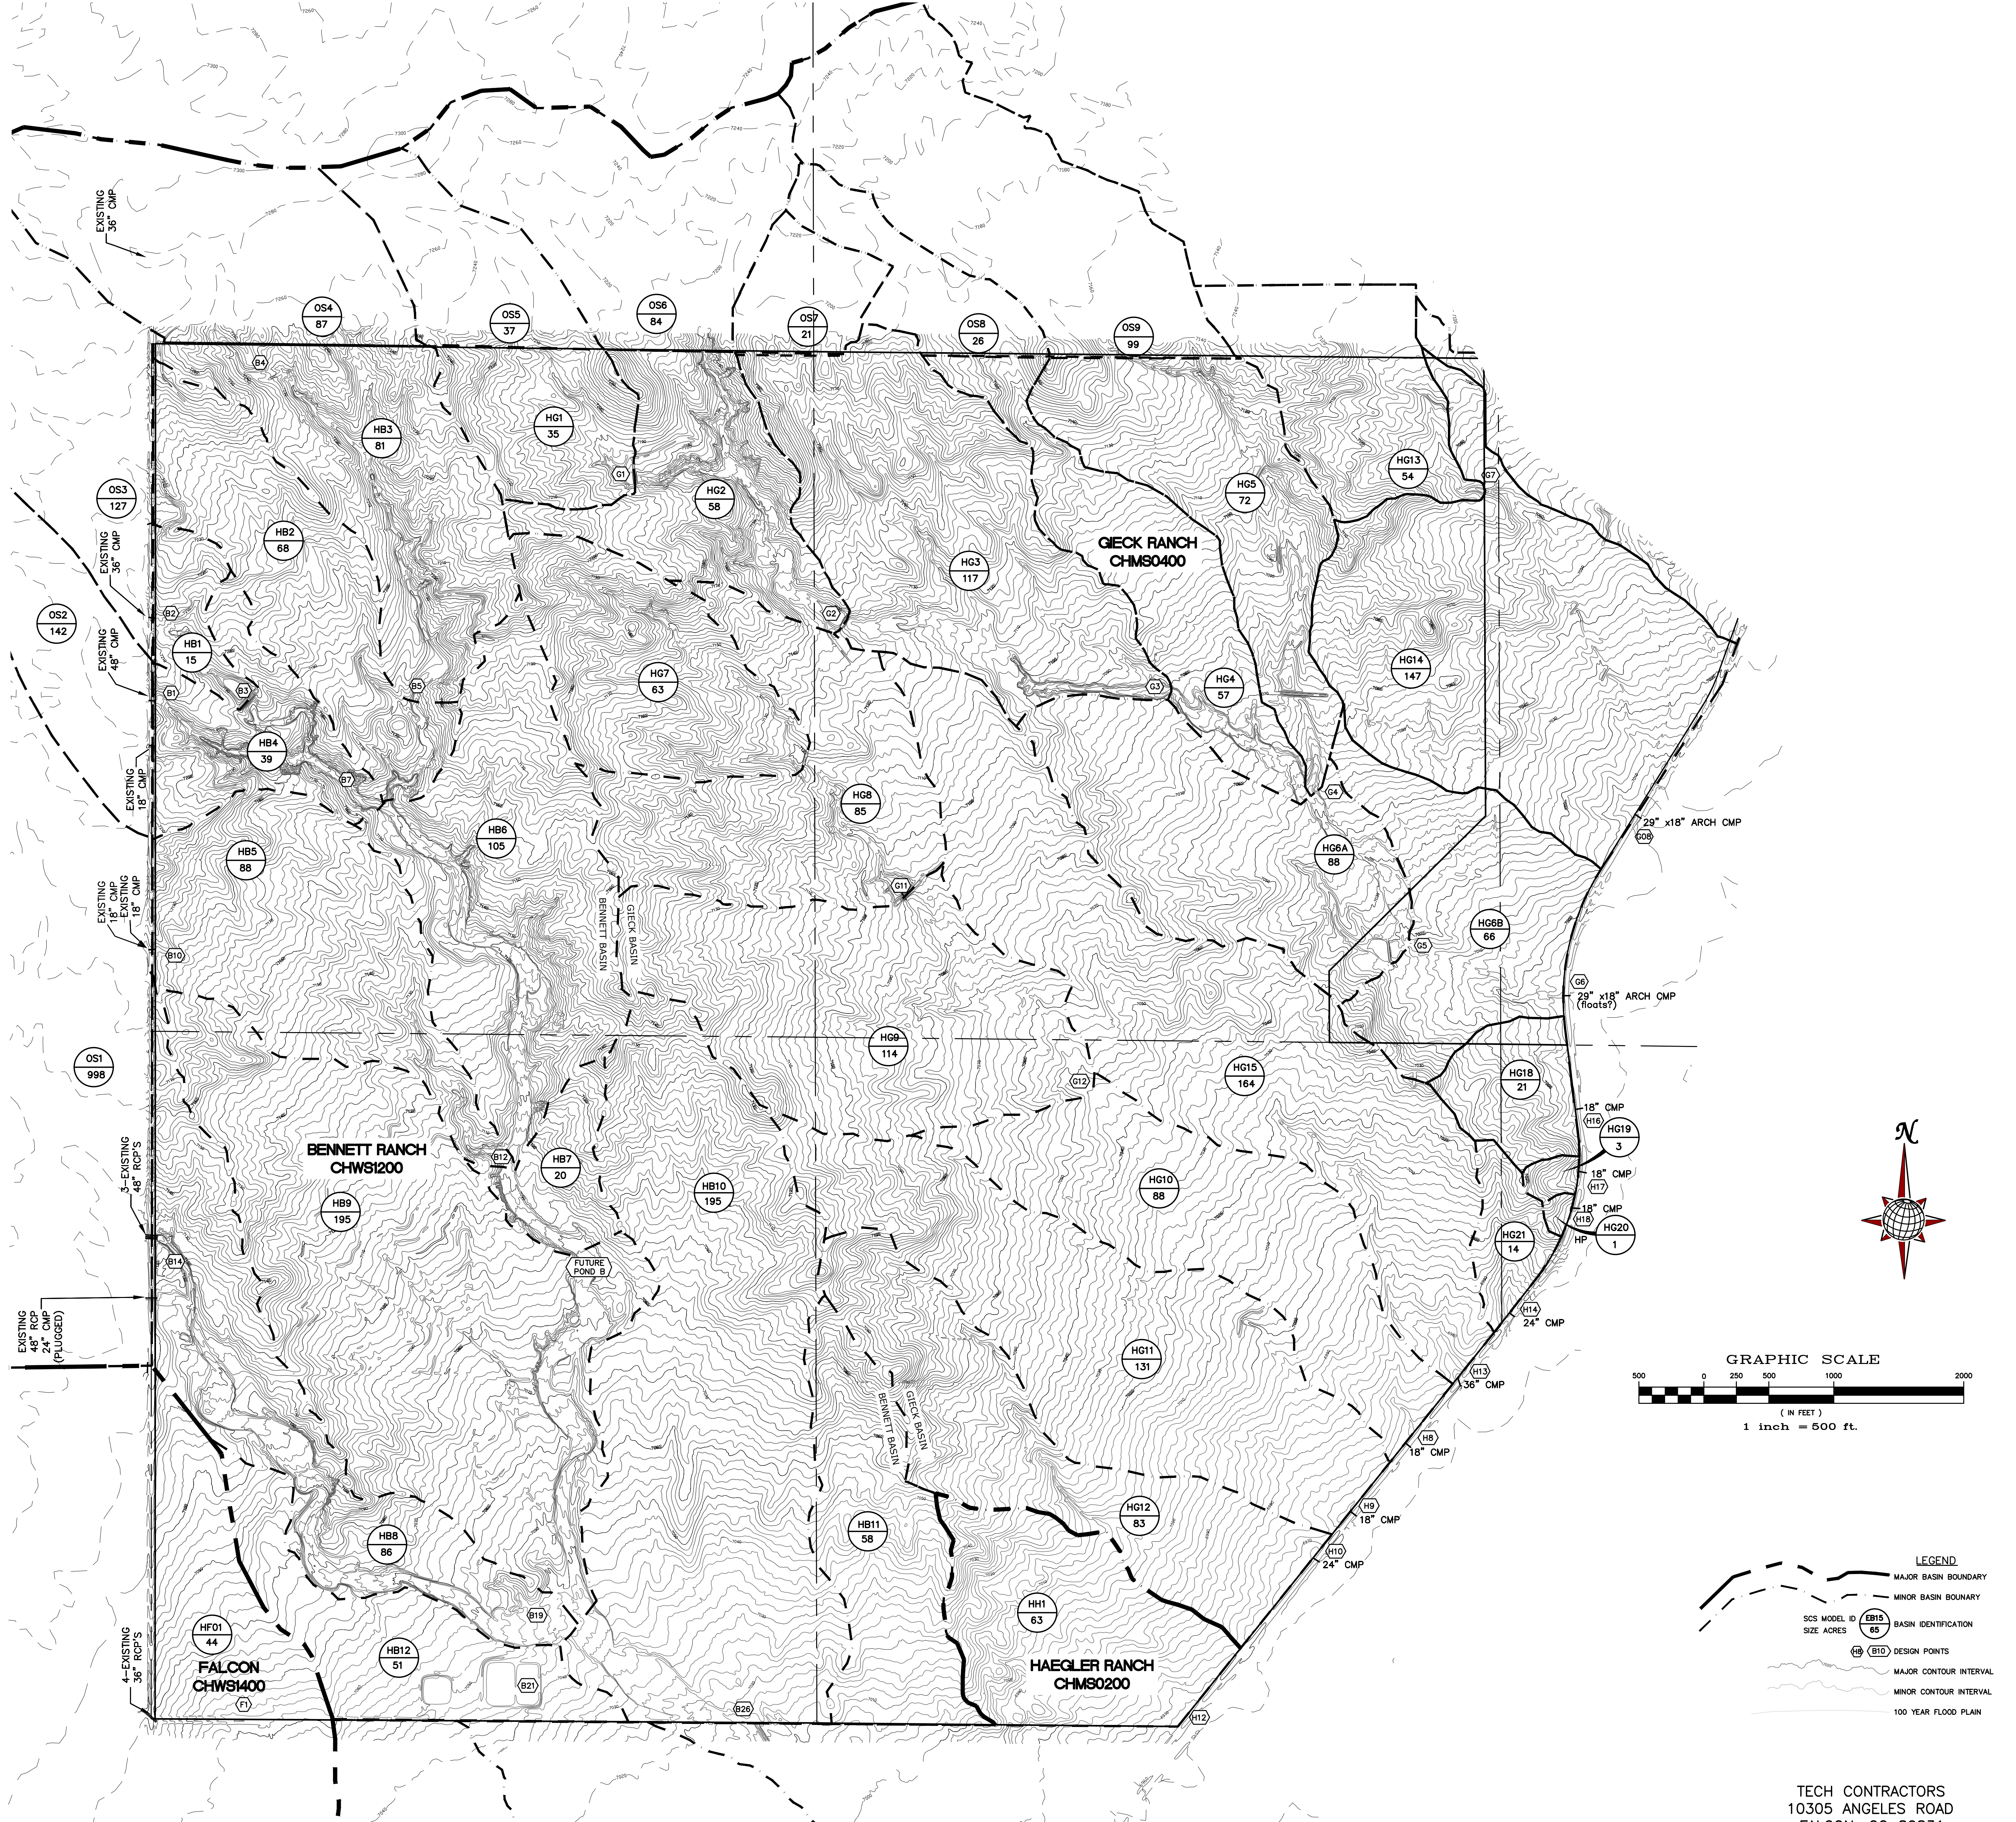

- LEGEND**
- MAJOR BASIN BOUNDARY
 - MINOR BASIN BOUNDARY
 - SCS MODEL ID (E815) / SIZE ACRES (65) BASIN IDENTIFICATION
 - (H8) (B10) DESIGN POINTS
 - MAJOR CONTOUR INTERVAL
 - MINOR CONTOUR INTERVAL
 - 100 YEAR FLOOD PLAIN


TECH CONTRACTORS
10305 ANGELES ROAD
FALCON, CO 80831
TELEPHONE: 719.495.7444
FAX: 719.495.7608

HISTORIC CONDITIONS - SCS MAP

JUNE 2017

FIGURE 4

MASTER DEVELOPMENT DRAINAGE PLAN MERIDIAN RANCH

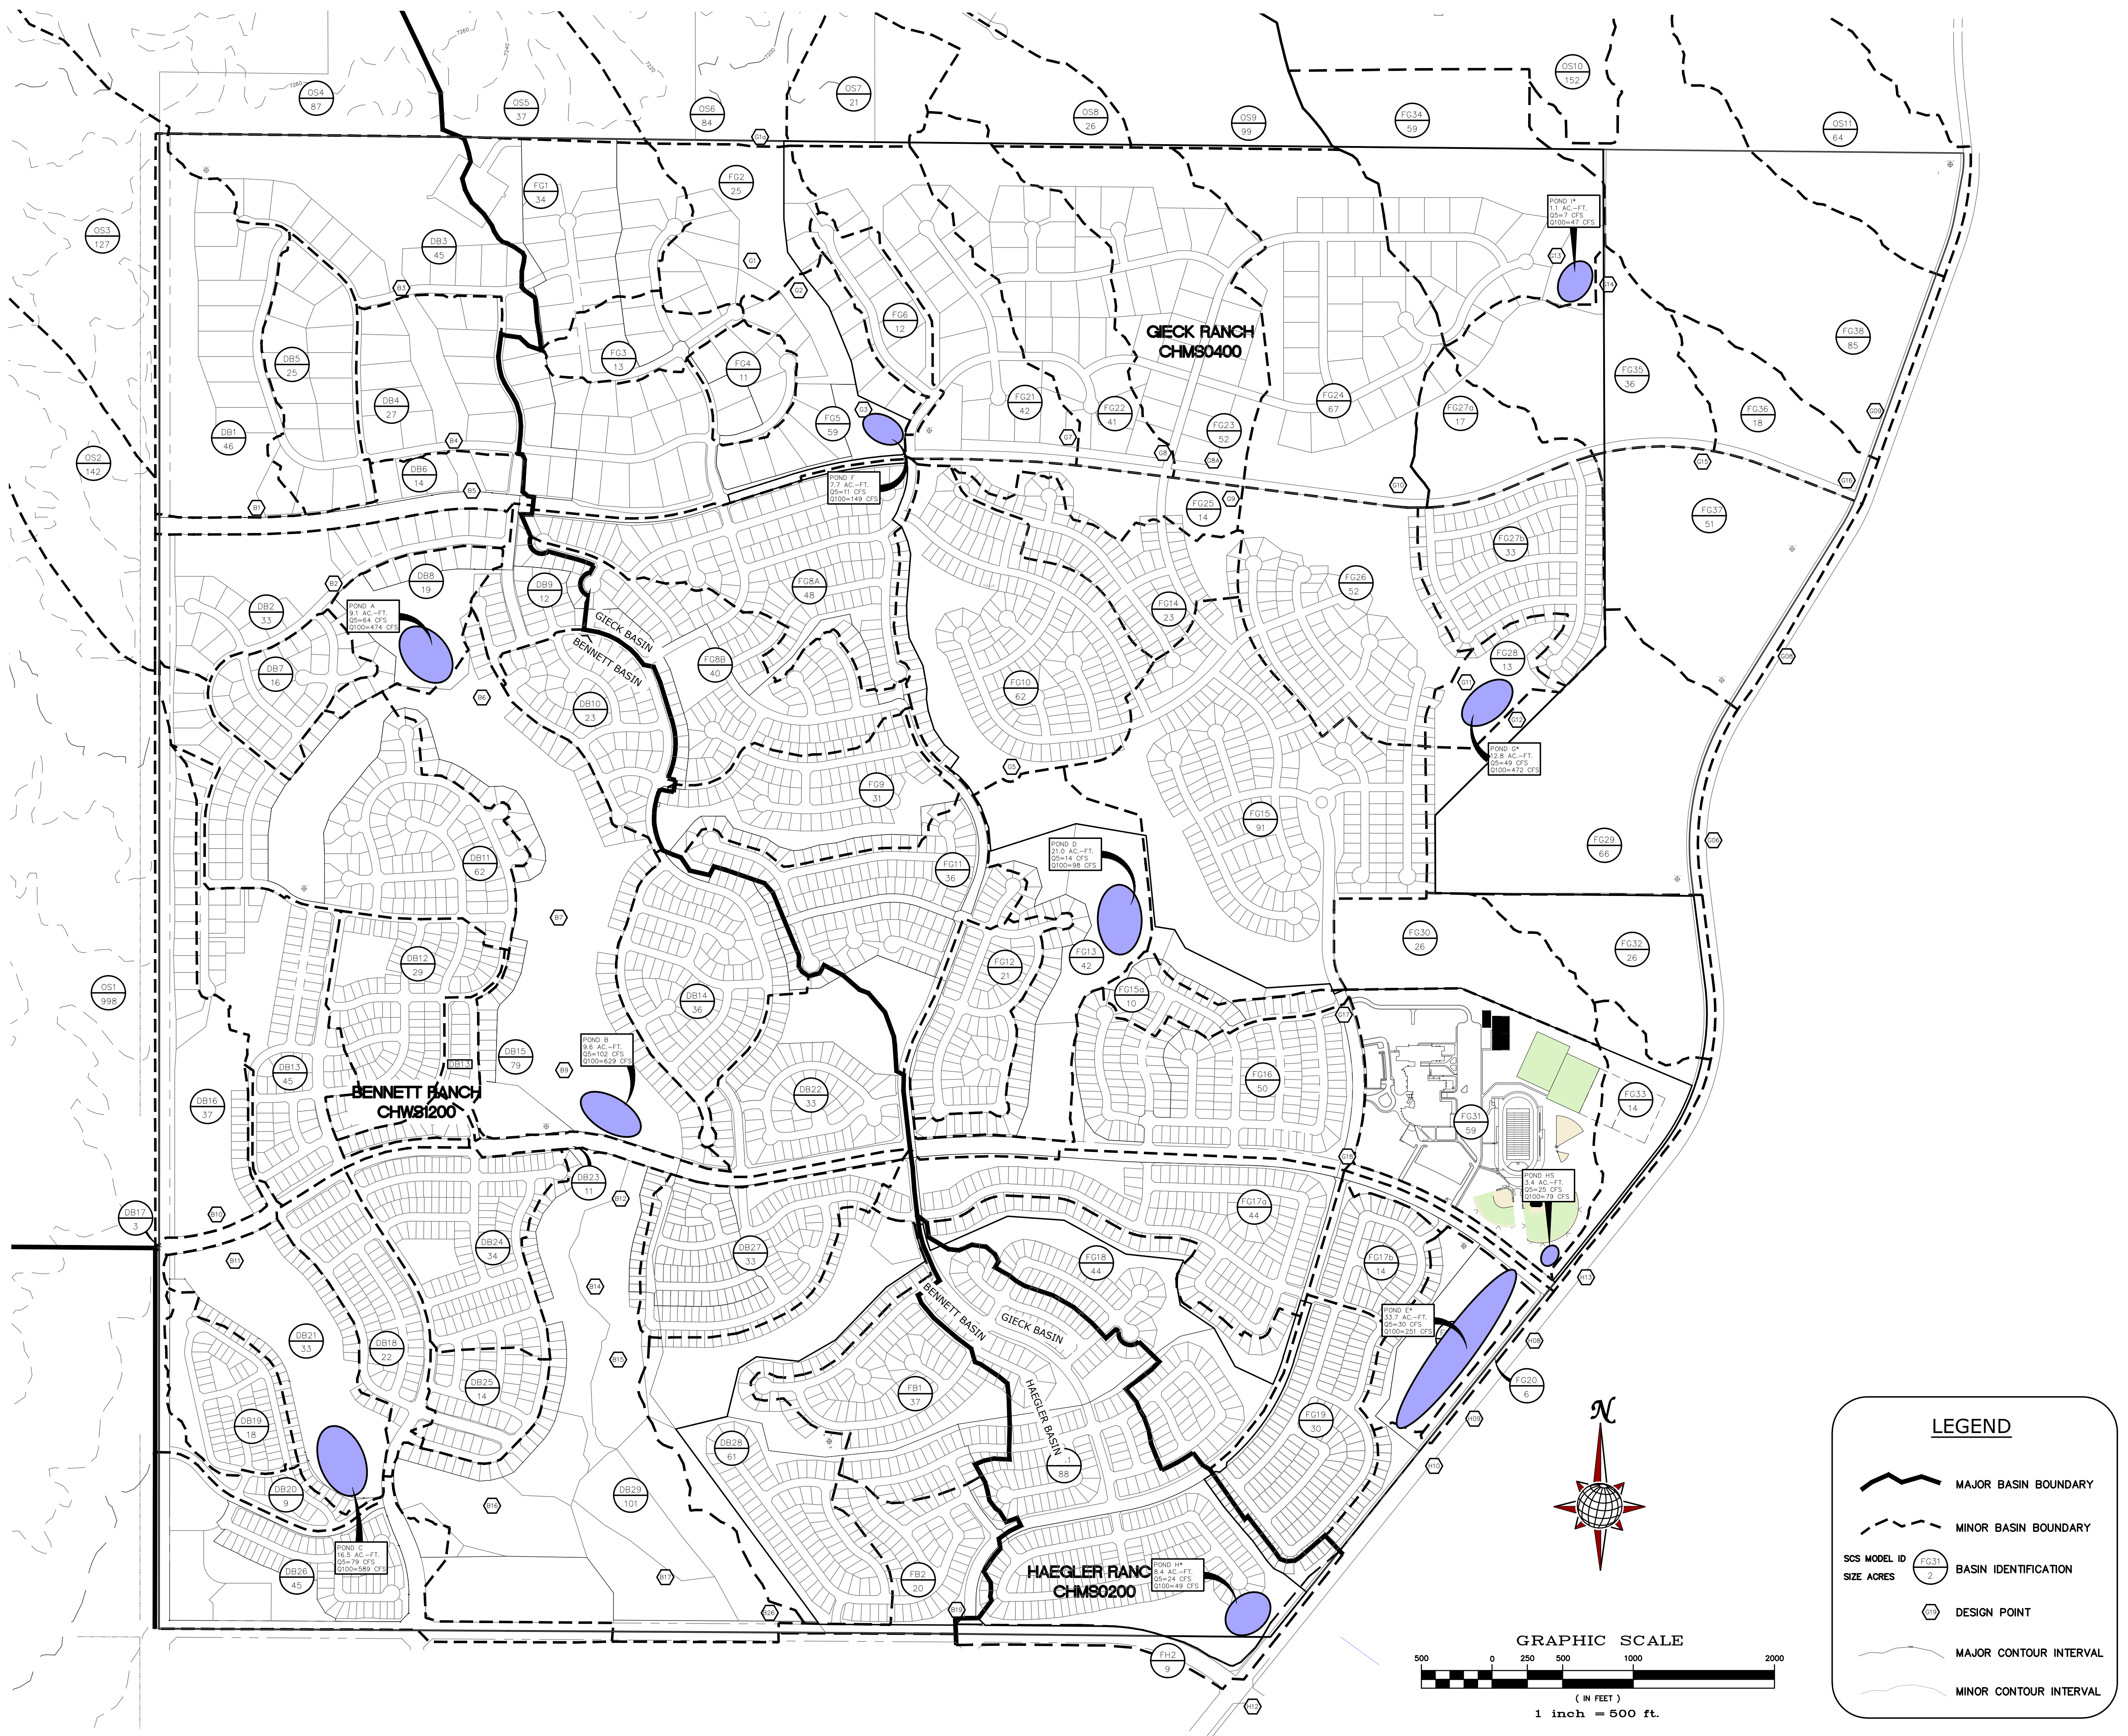

*NOTE: PRELIMINARY STORAGE VOLUMES AND OUTFLOW QUANTITIES HAVE BEEN PROVIDED FOR EACH OF THE FUTURE DETENTION FACILITIES LOCATED WITHIN THE DEVELOPMENT. THE ACTUAL STORAGE VOLUMES AND DISCHARGE RATES WILL BE DETERMINED UPON A COMPLETE ANALYSIS FOR EACH DETENTION FACILITY PRIOR TO CONSTRUCTION. THE VALUES GIVEN FOR DISCHARGE AND VOLUME ARE ESTIMATES FOR PLANNING PURPOSES ONLY.

DEVELOPED CONDITIONS - SCS MAP

TECH CONTRACTORS
10305 ANGELES ROAD
FALCON, CO 80831
TELEPHONE: 719.495.7444
FAX: 719.495.7608

JUNE 2017

FIGURE 5

Markup Summary

dsdlaforce (6)




Subject: Cloud+
Page Label: 7
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdlaforce
Date: 7/24/2017 4:18:56 PM
Color: ■
Label:

Revise. The calculations seem to be designed to release at historic rate.
Revise statement and note 90% of predevelopment per current Full Spectrum Detention criteria.



Subject: Callout
Page Label: 26
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdlaforce
Date: 7/24/2017 4:19:14 PM
Color: ■
Label:

Revise. Per UDFCD DCM regarding Full Spectrum "The maximum allowable 100-yr release rate should not exceed 90% of the approved predevelopment release rate..."



Subject: Cloud+
Page Label: 26
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdlaforce
Date: 7/24/2017 2:06:12 PM
Color: ■
Label:

Values do not match the Drainage Map



Subject: Text Box
Page Label: 29
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdlaforce
Date: 7/27/2017 2:31:38 PM
Color: ■
Label:

Analyze and provide a narrative regarding the impact to downstream development moving forward with the design change to 90% release.



Subject: Cloud+
Page Label: 33
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdlaforce
Date: 7/24/2017 1:57:05 PM
Color: ■
Label:

Add the schematic diagram in the appendix.

Include a disc with the HEC-HMS modeling.

Subject: Text Box
Page Label: 33
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdlaforce
Date: 7/24/2017 1:57:55 PM
Color: ■
Label:

Include a disc with the HEC-HMS modeling.