

Job No. 180910

May 18, 2022

Landhuis Company  
212 N. Wahsatch Ave. Ste 301  
Colorado Springs, CO

Re: Cement Treated Subgrade Test Results (Set 9)  
Windermere  
El Paso County, Colorado

Dear Landhuis Company:

RMG – Rocky Mountain Group sampled cement treated subgrade (CTS) soils during placement and compaction during construction of the streets in the above referenced subdivision. Our sampling and testing consisted of preparation of four (4) CTS “pucks” for each sample location. Pucks were prepared by compacting sampled CTS materials in the Standard Proctor mold utilizing Standard Proctor compactive effort (ASTM D-698). The puck below was extruded from the mold and moist-cured in the laboratory five (5) days prior to testing for compressive strength. The remaining pucks will be tested at seven (7) days after preparation.

The compressive strength for the puck below was determined at five (5) days after placement to verify that the minimum required compressive strength of 125 psi was obtained prior to placement of hot-mix bituminous pavements. The results of our testing are presented in the table below:


Sample Location	Date Prepared	Puck #	5-Day Compressive Strength	
			Tested Strength, psi	Average 5-Day Compressive Strength, psi
170' S from SE Corner of Borrowdale Ln, and Antelope Ridge, Turn Lane	5-13-2022	9A	400	400

Based upon our test results, the cement treated subgrade that was placed and compacted at the locations tested on May 13, 2022 met the minimum design strength requirements as recommended in *RMG's Addendum to Pavement Design Report, Job No. 180910, dated April 6, 2022.*

I hope this provides the information you have requested. Should you have questions, please feel free to contact our office.

Cordially,

RMG – Rocky Mountain Group

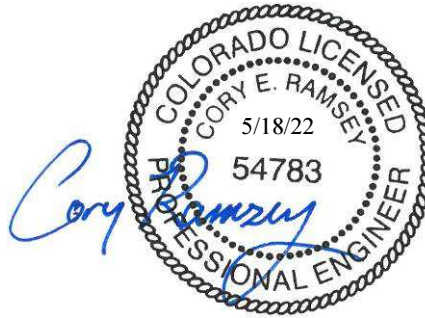

Cory Ramsey, P.E.  
Geotechnical Project Manager