

DRAINAGE LETTER REPORT

for


**CATHEDRAL ROCK CHURCH
846 STRUTHERS RANCH ROAD
TRACT A, STRUTHERS RANCH SUBDIVISION FILING NO. 2**

Prepared for:

Hammers Construction, Inc.
1411 Woolsey Heights
Colorado Springs, CO 80915

September 20, 2024
Revised February 17, 2025

Prepared by:

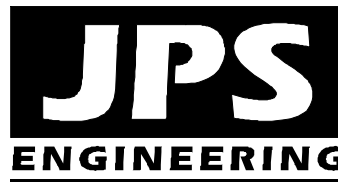

**19 E. Willamette Ave.
Colorado Springs, CO 80903
(719)-477-9429
www.jpsengr.com**

**JPS Project No. 082401
PCD Filing No. PPR2436**

**CATHEDRAL ROCK CHURCH
DRAINAGE LETTER REPORT
TABLE OF CONTENTS**

	<u>PAGE</u>
DRAINAGE STATEMENT	i
I. INTRODUCTION	1
II. EXISTING / PROPOSED DRAINAGE CONDITIONS	2
III. DRAINAGE PLANNING FOUR STEP PROCESS.....	6
IV. FLOODPLAIN IMPACTS.....	7
V. STORMWATER DETENTION AND WATER QUALITY	7
VI. PUBLIC IMPROVEMENTS / DRAINAGE BASIN FEES	8
VII. SUMMARY	8

APPENDICES

APPENDIX A	Excerpts from Subdivision Drainage Report
APPENDIX B	Hydrologic Calculations
APPENDIX C	Hydraulic Calculations
APPENDIX D	Rain Garden Calculations
APPENDIX E	Rain Garden Cost Estimate
APPENDIX F	Figures
Figure FIRM	Floodplain Map
Sheet D1	Struthers Ranch Subdivision - Developed Drainage Plan
Sheet EX1	Cathedral Rock Church – Existing Conditions Drainage Plan
Sheet D1.1	Cathedral Rock Church - Developed Drainage Plan

DRAINAGE STATEMENT

Engineer's Statement:

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the master plan of the drainage basin. I accept responsibility for liability caused by negligent acts, errors or omissions on my part in preparing this report.

John P. Schwab, P.E. #29891

Developer's Statement:

I, the developer have read and will comply with all of the requirements specified in this drainage report and plan.

By:

Date

Hammers Construction, Inc.
1411 Woolsey Heights, Colorado Springs, CO 80915

El Paso County's Statement

Filed in accordance with the requirements of the El Paso County Land Development Code, Drainage Criteria Manual, Volumes 1 and 2, and Engineering Criteria Manual as amended.

Joshua Palmer, P.E.
County Engineer / ECM Administrator

Date

Conditions:

I. INTRODUCTION

A. Property Location and Description

Cathedral Rock Church is planning to construct a new church building on the vacant 5.1-acre property at the northeast corner of Struthers Road and Struthers Ranch Road in northern El Paso County, Colorado. The property is described as Tract A, Struthers Ranch Subdivision Filing No. 2 (El Paso County Assessor's Parcel Number 71363-01-013).

The project consists of a new 11,375 square-foot Church Building with associated parking and site improvements. Future phases of site development are anticipated to include a 10,050 square-foot building addition on the southwest side of the Phase 1 building and expanded parking areas. Additionally, the Church plans to process a minor subdivision to create a separate 1-acre lot reserved for future development in the southwest corner of the site.

The property is bounded by Struthers Road on the southwest side and Struthers Ranch Road on the southeast side. Struthers Road is a fully improved, asphalt-paved arterial public street, and Struthers Ranch Road is a fully improved local public street. Existing platted residential lots are located along the northeast boundary of the parcel (Struthers Ranch Filing No. 2). The north boundary of the site adjoins a vacant, unplatted 6.5-acre property (zoned R-4).

The property is zoned Planned Unit Development (PUD), and the proposed site development is fully consistent with the existing zoning of the site. Access to the site will be provided by the existing private driveway connection to Struthers Ranch Road along the southeast boundary of the site.

The site is located in the Black Forest Creek Drainage Basin, and surface drainage from this site sheet flows southwesterly to an existing public storm sewer system in Struthers Ranch Road, flowing to the existing Struthers Ranch stormwater detention pond on the west side of Struthers Road.

This report is intended to meet the requirements of a site-specific "Letter Type" drainage report in accordance with El Paso County subdivision drainage criteria.

B. References

JPS Engineering, Inc., "Preliminary & Final Drainage Report for Cathedral Rock Commons Commercial," revised March 8, 2023 (approved by El Paso County 3/29/23).

JPS Engineering, Inc., "Final Drainage Report for Struthers Ranch Filing No. 2," revised October 14, 2004 (approved by El Paso County 10/20/04).

JPS Engineering, Inc., “Drainage Letter Report for Struthers Ranch Polaris, Lots 1-2, Struthers Ranch Subdivision Filing No. 4,” revised April 7, 2023 (approved by El Paso County 5/4/23).

C. Drainage Analysis Methods and Criteria

ITEM	DESCRIPTION	REFERENCE
Design Storm (initial/major)	5-year/100-year	CS/EPC DCM
Storm Runoff	Rational Method (Area<100acres)	CS/EPC DCM
Major Drainage Basin	Black Forest Creek	
Floodplain Impacts	Parcel is located outside any delineated FEMA floodplains	FIRM
Existing Downstream Facilities	Existing storm sewer system on east side of Struthers Road; Existing detention pond on west side of Struthers Road	

CS/EPC DCM = City of Colorado Springs & El Paso County Drainage Criteria Manual

II. EXISTING / PROPOSED DRAINAGE CONDITIONS

Subdivision Drainage Report

Drainage planning for this site was previously master planned during original development of the Struthers Ranch Subdivision, as detailed in the “Final Drainage Report (FDR) for Struthers Ranch Filing No. 2” by JPS Engineering, dated October 14, 2004 (see excerpts in Appendix A). The project area at the northeast corner of Struthers Road and Struthers Ranch Road was identified as a future commercial development area in the original planning of the subdivision.

According to the original FDR, Basins C (4.75 acres) and E1 (1.5 acres) comprise the future commercial development areas on the north side of Struthers Ranch Road. The previously approved subdivision drainage planning assumed full commercial development within all of Basins C and E1, with runoff coefficients of $C_5 = 0.90$ and $C_{100} = 0.90$, and impervious areas of 95 percent for the entirety of these basins. According to the Rational Method calculations in the original subdivision drainage report, developed peak flows from Basin C were calculated as $Q_5 = 22.2$ cfs and $Q_{100} = 38.5$ cfs, and peak flows from Basins OE1 and E1 (FDR DP#5) were calculated as $Q_5 = 4.6$ cfs and $Q_{100} = 8.9$ cfs (see Appendix A).

As shown on the enclosed Struthers Ranch Subdivision Drainage Plan (Figure D1, Appendix F), the proposed Church building and parking areas lie entirely within Basin C as delineated in the approved “Final Drainage Report for Struthers Ranch Filing No. 2.”

The site slopes downward to the southwest, with average grades of 1-4 percent. On-site soils are classified by SCS as type 71, “Pring” series coarse sandy loam soils. These soils have moderately rapid permeability and slow to medium surface runoff characteristics. The soils are classified as hydrologic soils group B.

Developed drainage from this Church site will sheet flow southwesterly into an on-site Rain Garden and then connect to an existing 24” storm sewer lateral prior to continuing downstream in the 42” public storm sewer system in Struthers Ranch Road. An existing 10-foot Type R public storm inlet collects street drainage at the northeast corner of Struthers Ranch Road and Struthers Road, and an existing 24” RCP storm sewer was stubbed north from the inlet during initial subdivision development. The existing 42” storm sewer in Struthers Ranch Road flows south along the east side of Struthers Road to a catch basin, where double 48-inch culverts convey developed flows across Struthers Road and into the existing detention pond. The previously approved drainage report for Struthers Ranch Filing No. 2 assumed full commercial development for this basin, which is consistent with the proposed site development. The existing detention pond was sized to account for fully developed flows from this commercial area.

As requested by the U.S. Air Force Academy design review during the original subdivision process, the existing Struthers Ranch Regional Detention Pond was designed to provide stormwater detention for the full range of 2-year through 100-year design storms, as detailed in the 2004 “Final Drainage Report (FDR) for Struthers Ranch Filing No. 2.” The Struthers Ranch Detention Pond discharges through a 48-inch outlet pipe into Black Forest Creek, which flows southwesterly and crosses I-25 in a double 10’x10’ box culvert, ultimately flowing into Monument Creek.

The impervious area for the proposed Cathedral Rock Church development (delineated as Basins A1-A4 within this report, which correlates with Basin C in the FDR) amounts to approximately 65.8 percent of the site (as tabulated on Sh. D1.1 and Appendix B), which is well below the impervious area of 95 percent assumed for full commercial development in the previously approved subdivision drainage report (see Appendix A).

Based on the previous construction of drainage improvements for the Struthers Ranch Subdivision, no significant impact on downstream drainage facilities is anticipated from this site development and replat. Proper erosion control measures will be required for development of the site, including silt fence along downstream property boundaries to minimize off-site transport of construction sediment.

Existing Drainage Conditions

As shown on the enclosed Existing Conditions Drainage Plan (Figure EX1, Appendix F), the site has been delineated as two on-site drainage basins. The majority of the project area has been delineated as Basin A, and the north edge of the site has been delineated as Basin B. The site is impacted by small off-site basin areas (delineated as Basins OA1 and OB1) consisting of the rear sides of the adjoining single-family residential lots (platted as part of Struthers Ranch Filing No 2) along the northeast boundary of the site.

Surface drainage from off-site Basin OA1 (back sides of adjoining developed single-family residential lots along northeast boundary of project site) sheet flows into Basin A, and Basin A sheet flows southwesterly across the property to the existing public storm

inlet (10' Type R) on the north side of Struthers Ranch Road. Flows from Basin OA1 combine with Basin A at Design Point #1, with existing peak flows calculated as $Q_5 = 1.4$ cfs and $Q_{100} = 8.5$ cfs.

Drainage from off-site Basin OB1 (back sides of adjoining developed single-family residential lots along northeast boundary of project site) sheet flows southwesterly into Basin B, and Basin B flows southwesterly to the existing curb and gutter along the east side of Struthers Road, ultimately flowing north into the existing public culvert crossing Struthers Road at the southeast corner of Spanish Bit Drive and Struthers Road. Flows from Basins OB1 and B combine at Design Point #2, with existing peak flows calculated as $Q_5 = 0.7$ cfs and $Q_{100} = 4.1$ cfs.

Developed Drainage Plan

Developed flows have been calculated based on the impervious areas associated with the proposed building and parking improvements. Surface drainage swales and a private storm sewer system will convey developed flows to the proposed Rain Garden A along the south boundary of the site. Site grades will slope to storm inlets and curb openings at selected locations, collecting surface drainage and conveying stormwater to Rain Garden A. The proposed building pads will be graded with protective slopes to provide positive drainage away from the buildings, and the curb, gutter, drainage swales, and private storm sewer system will convey developed flows southwesterly into Rain Garden A.

Basin A

The proposed Church building and the majority of the central parking lot area have been delineated as Basin A1 (2.29-acres), which drains by sheet flow and curb and gutter to a private storm sewer system conveying flows to Rain Garden A. Building roof drains will be intercepted by 8" PVC roof drain collection lines along the north and south sides of the building, and Private Storm Sewer A1.0 (12" HDPE) will convey the combined roof drain flows south into Inlet A1.1 near the southeast corner of the building.

Private Storm Inlet A1.1 (5' Type R) will intercept surface drainage from the north side of the parking lot, and Private Storm Sewer A1.1 (12" HDPE) will convey this flow southwest to Private Storm Inlet A1.2. Storm Inlet A1.2 will intercept surface drainage from the south side of the parking lot, and Private Storm Sewer A1.2 (18" HDPE) will convey the combined flows southeasterly to Private Storm Inlet A2 in the southeast access drive.

Developed peak flows for Basin A1 are calculated as $Q_5 = 7.9$ cfs and $Q_{100} = 15.6$ cfs. Off-site flows from Basin OA1 combine with Basin A1 at Design Point A1.1, with developed peak flows calculated as $Q_5 = 5.6$ cfs and $Q_{100} = 11.2$ cfs.

The southeast access drive and southeast corner of the parking lot have been delineated as Basin A2 (0.86-acre), which drains southwesterly by sheet flow and curb and gutter to the proposed Private Storm Inlet A2 (5' Type R) at the southwest corner of the new access

drive. Private Storm Sewer A2 (18" HDPE) will convey the combined flows southwesterly into the forebay at the east end of Rain Garden A.

Developed peak flows for Basin A2 are calculated as $Q_5 = 2.6$ cfs and $Q_{100} = 5.3$ cfs. Off-site flows from Basin OA2 combine with Basin A2 at Design Point A2.1, with developed peak flows calculated as $Q_5 = 2.3$ cfs and $Q_{100} = 5.2$ cfs. Off-site flows from Basins OA1-OA2 combine with Basins A1-A2 at Design Point A2.2, with developed peak flows calculated as $Q_5 = 8.1$ cfs and $Q_{100} = 16.7$ cfs.

The future development area in the southwest corner of the property has been delineated as Basin A3 (0.96-acre). The Church has plans to process a subdivision to create a separate 1-acre lot in this area for potential future sale and commercial development. Runoff calculations for Basin A3 have assumed an impervious area of 85 percent for future commercial development of this area, with Basin A3 developed peak flows calculated as $Q_5 = 3.6$ cfs and $Q_{100} = 6.7$ cfs.

The proposed Rain Garden A area along the south boundary of the property has been delineated as Basin A4 (0.23-acre), and developed peak flows for Basin A4 are calculated as $Q_5 = 0.1$ cfs and $Q_{100} = 0.7$ cfs.

The 24" RCP discharge pipe from Rain Garden A (along with overflows from the pond spillway) will drain into the existing public storm inlet along the north side of Struthers Ranch Road, flowing into the existing 42-inch RCP public storm sewer in Struthers Ranch Road. The existing public storm sewer system flows south to the existing double 48-inch RCP storm sewer which crosses Struthers Road, draining southwesterly into the existing regional Struthers Ranch Detention Pond ("Detention Pond 11" per Black Forest Creek DBPS).

Combined Flows and Comparison to Subdivision FDR

Developed flows from Basins OA1-OA2, and A1-A4 combine at Design Point #1, with peak flows calculated as $Q_5 = 10.6$ cfs and $Q_{100} = 21.8$ cfs. For comparison with the original Struthers Ranch Subdivision FDR, the developed flows from FDR Basin C (equivalent to Design Point #1 in this report) were calculated as $Q_5 = 22.2$ cfs and $Q_{100} = 38.5$ cfs (significantly higher than the current developed flow calculations). As such, the proposed developed flows are well below the previously master planned developed flows entering the regional detention pond.

Hydrologic and hydraulic calculations for the site are detailed in the appendices (Appendix B and C), and peak flows are identified on Figure D1.1 (Appendix F).

Basin B

The proposed site development plan will minimize developed drainage impacts within Basin B along the north boundary of the site, as developed flows from the church building and parking areas will be conveyed southwesterly to Rain Garden A. Developed

peak flows for Basin B are calculated as $Q_5 = 0.3$ cfs and $Q_{100} = 2.3$ cfs. Developed flows from Basins OB1 and B will continue to combine at Design Point #2, with peak flows calculated as $Q_5 = 0.4$ cfs and $Q_{100} = 1.9$ cfs (lower than existing conditions).

Drainage from Design Point #2 flows north along the east side of Struthers Road into an existing box culvert at the southwest corner of Struthers Road and Spanish Bit Drive, which flows southwesterly across I-25 and ultimately drains into Monument Creek.

III. DRAINAGE PLANNING FOUR STEP PROCESS

El Paso County Drainage Criteria require drainage planning to include a Four Step Process for receiving water protection that focuses on reducing runoff volumes, treating the water quality capture volume (WQCV), stabilizing drainageways, and implementing long-term source controls.

As stated in ECM Appendix I.7., the Four Step Process is applicable to all new and re-development projects with construction activities that disturb 1 acre or greater or that disturb less than 1 acre but are part of a larger common plan of development. The Four Step Process has been implemented as follows in the planning of this project:

Step 1: Employ Runoff Reduction Practices

- Rain Garden: The majority of developed flows will be routed through the on-site Rain Garden water quality facility, which will be vegetated to encourage stormwater infiltration.

Step 2: Stabilize Drainageways

- There are no drainageways directly adjacent to this project site. Implementation of the on-site drainage improvements and Rain Garden will minimize downstream drainage impacts from this site.
- Drainage basin fees were previously paid during recording of the subdivision plat, and these fees provided the applicable cost contribution towards regional drainage improvements.

Step 3: Provide Water Quality Capture Volume (WQCV)

- RG: The majority of the developed site will drain through an on-site Private Rain Garden (RG) along the south boundary of the property. The Rain Garden will capture and slowly release the WQCV over an extended release period.

Step 4: Consider Need for Industrial and Commercial BMPs

- No industrial uses are proposed for this site.
- The property owner will implement a Stormwater Management Plan including proper housekeeping practices and spill containment procedures.
- On-site developed drainage will be routed through the Rain Garden to minimize introduction of contaminants to the County's public drainage system.

IV. FLOODPLAIN IMPACTS

According to the FEMA floodplain map for this area, El Paso County FIRM Panel No. 08041C0287G, dated December 7, 2018, the site is located beyond the limits of any delineated floodplains.

V. STORMWATER DETENTION AND WATER QUALITY

Stormwater detention for this site is provided in the existing regional stormwater detention pond constructed during initial development of the Struthers Ranch Subdivision. The Struthers Ranch Homeowners Association is the owner of the existing Struthers Ranch Detention Pond located within Tract C, Struthers Ranch Filing No. 2. There currently appears to be a need for removal of excess vegetation within the pond to ensure proper operation of the detention facilities. The Struthers Ranch HOA is responsible for proper maintenance of the existing regional detention pond.

An on-site private Rain Garden will be constructed to meet stormwater quality requirements for this site in accordance with current El Paso County drainage criteria. As detailed in the Rain Garden calculations in Appendix D, the required Water Quality Capture Volume (WQCV) has been calculated as 0.13 acre-feet. The water quality capture volume has been calculated based on the actual impervious area of the proposed church site development within Basins A1-A2, along with the typical single-family residential impervious area of 40% within the adjoining developed Basins OA1-OA2, and a conservative estimated impervious area of 85% for the anticipated future commercial development within Basin A3. Water quality calculations have also accounted for future building improvements and future parking expansion areas within Basins A1-A2 as noted on the Developed Drainage Plan.

The proposed Rain Garden A has been designed utilizing the Denver Mile High Flood District's "SCM-Design-v4.00" and "MHFD-Detention_v4.06" software packages. Calculations and details for the proposed Rain Garden are enclosed in Appendix D, and design parameters for the Rain Garden are summarized as follows:

Water Quality Facility (RG)	Tributary Drainage Basins	Tributary Area (ac)	Impervious Percentage	Min. WQCV (cf)	Design Volume (af)
A	A1-A4	4.79	65.8	3,579	3,817

The proposed on-site Rain Garden A provides a storage volume of 3,817 cubic feet, which meets the required WQCV volume.

The proposed Rain Garden will include a concrete forebay for erosion control at the entry. The outlet structure has been designed with a water quality orifice plate to maintain a 12-hour release of the WQCV. The Rain Garden will have a vegetated bottom to encourage infiltration of stormwater prior to discharging into the downstream public drainage system.

The new on-site Rain Garden will be privately owned and maintained by the property owner, and maintenance access will be provided from the access drive at the southeast corner of the site.

VI. PUBLIC IMPROVEMENTS / DRAINAGE BASIN FEES

No public drainage improvements are required or proposed for this project. As detailed in Appendix E, the proposed private Rain Garden A has an estimated cost of approximately \$19,267.

The site lies completely within the Black Forest Creek Drainage Basin. Applicable drainage basin fees were paid at the time of original platting of Struthers Ranch Filing No. 2, so no drainage basin fees or bridge fees are applicable at this time.

VII. SUMMARY

The developed drainage patterns for the proposed Cathedral Rock Church site development on Tract A, Struthers Ranch Filing No. 2 will remain consistent with the established drainage plan for this subdivision. The grading and drainage plan for the proposed church site development fully conforms to the approved drainage plan for Struthers Ranch Filing No. 2.

Developed flows from the site will drain through a Private Rain Garden water quality facility along the south boundary of the property prior to discharging into the existing downstream public storm sewer system. Stormwater detention is provided by the existing Struthers Ranch Detention Pond which was designed to accept fully developed flows from the commercial area encompassing this site. The proposed on-site Rain Garden will meet current stormwater quality requirements for this site. Construction and proper maintenance of the on-site drainage facilities and Rain Garden, in conjunction with proper erosion control practices, will ensure that this developed site has no significant adverse drainage impact on downstream or surrounding areas.

APPENDIX A

EXCERPTS FROM SUBDIVISION DRAINAGE REPORT


FINAL DRAINAGE REPORT
for
STRUTHERS RANCH FILING NO. 2

Prepared for:

WL Homes LLC
8610 Explorer Drive, Suite 300
Colorado Springs, CO 80920

November 6, 2003
Revised April 12, 2004
Revised May 7, 2004
Revised May 25, 2004
Revised September 3, 2004
Revised October 14, 2004

Prepared by:

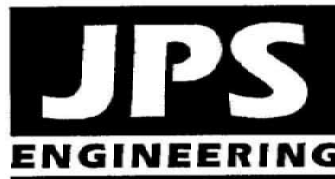

19 E. Willamette Avenue
Colorado Springs, CO 80903
(719)-477-9429
(719)-471-0766 FAX

JPS Project No. 080006

11 15 2004

2959

2. Developed Drainage Conditions

The developed drainage basins and projected flows are shown in Figure D1, and preliminary hydrologic calculations are enclosed in Appendix B. The developed site has been divided into five major basins (A-E) and five design points (DP1-DP5), as shown on the enclosed Drainage Plan (Sheets D1 and D1.02). Hydrologic flow schematics and calculations are enclosed in Appendix B.

Struthers Ranch Filing No. 2 is located within parts of Basins C-F at the northwest corner of the site. The majority of developed areas ultimately flow to the proposed detention pond at Design Point No. 4. The internal road gutters of sub-basins D1-D10 will be graded to drain southwesterly through the interior road system. Storm inlets will be constructed in the interior roads as required to intercept developed flows exceeding the allowable street capacity. Storm sewer outfalls will be extended to the proposed detention pond.

To minimize the impacts of developed drainage from Struthers Ranch, flows from Basins C, D, and F will be routed through the proposed detention pond. Off-site Basins OC1 and OD1 will combine with flows from on-site Sub-basins D1-D10, C, E2, E3, and F at the proposed detention pond (Design Point #4), with developed flows of $Q_5 = 66$ cfs and $Q_{100} = 191$ cfs (SCS Method). The detention pond will discharge historic flows to the existing swale at the southerly site boundary, flowing into the existing 48-inch culvert crossing I-25. The proposed 48-inch RCP discharge pipe from the detention pond will be released to a riprap apron, flowing to an existing stable grass-lined swale across a parcel owned by the U.S Air Force Academy, ultimately crossing I-25 through the existing 48-inch CMP culvert.

The proposed site layout will significantly reduce the amount of developed flow reaching the existing 3.5'x2' culvert (Structure #11) at the westerly site boundary (Design Point #3). Flows from Sub-basin E4 ($Q_5 = 1.9$ cfs and $Q_{100} = 3.7$ cfs) represent the westerly side of the proposed Struthers Road draining to the existing culvert crossing I-25.

Basin E1 represents the small developed area at the northwest corner of the site, draining to the existing 4'x4' box culvert at Design Point #5. The proposed grading scheme for the commercial area north of Struthers Ranch Road will direct the majority of developed flows into Basin C, ultimately flowing to the proposed detention pond. As a result, developed flow impacts to the Jackson Creek Basin at the northwest corner of the site will be minimized. Estimated developed peak flows of $Q_5 = 4.6$ cfs and $Q_{100} = 8.9$ cfs at Design Point #5 remain within the capacity of the existing culvert.

C. Comparison of Developed to Historic Discharges

Based on the hydrologic calculations in Appendix B, the total undetained developed flow from the site will exceed historic flow from the parcel. Projected increases in developed flows will be mitigated by routing flows through a proposed on-site stormwater detention pond. The comparison of developed to historic discharges at key design points is summarized as follows:

Design Point	Historic Flow			Developed Flow			Comparison of Developed to Historic Flow (Q ₅ %/Q ₁₀₀ %)
	Area (ac)	Q ₅ (cfs)	Q ₁₀₀ (cfs)	Area (ac)	Q ₅ (cfs)	Q ₁₀₀ (cfs)	
1 (SCS)	1,266	473	1,281	1,274	464	1,263	98% / 99% (decrease)
2	15.1	9.3	22.4	1.4	1.7	3.6	18% / 16% (decrease)
3	16.0	9.9	24.0	0.6	1.9	3.7	19% / 15% (decrease)
4 (SCS)	133.6	50	148	155.4	66	191	132% / 129% (increase)
5	6.8	8	9.2	4.0	4.6	8.9	121% / 99% (increase)

D. Detention Ponds

The total developed storm runoff downstream of Struthers Ranch will be maintained at historic levels by routing flows through the proposed on-site detention pond located at the westerly boundary of the Struthers Ranch property (equivalent to "Detention Pond #11" as identified in the DBPS). The proposed detention facility will be sized to attenuate peak flows through the pond, based on the difference between outflow and inflow hydrographs. Flows from Basins C and D will be routed through the proposed detention pond at Design Point #4. The pond will be designed to "over-detain" to account for release of developed flows from Basins A and B, ensuring that the net discharge from the overall site will be maintained below historic levels.

As depicted on Sheet C1.02 (Appendix A), the proposed interim access connection from the I-25 Frontage Road to Struthers Road will bisect the pond, providing for a forebay at the upstream end of the pond. Once the interim access to the frontage road is abandoned, the maintenance access road will remain, and the forebay will continue to serve as a water quality enhancement feature. A detailed pond routing analysis utilizing the "Intelisolve Hydraflow" software package is enclosed in Appendix C1, resulting in the following pond design parameters:


Pond	Pond Inflow (Q ₅ / Q ₁₀₀ , cfs)	Pond Outflow (Q ₅ / Q ₁₀₀ , cfs)	Pond Volume (ac-ft)
DP4 ("Pond #11")	35 / 191	19.3 / 138.4	4.7

STRUTHERS RANCH SUBDIVISION


DEVELOPED DRAINAGE PLAN

LEGEND

- FILING LIMITS
- MAJOR BASIN BOUNDARY
- MINOR BASIN BOUNDARY
- EXISTING CONTOUR
- FLOWLINE
- PROPOSED FLOW DIRECTION ARROW
- PROPOSED DROP STRUCTURE
- ▲ DESIGN POINT
- ▲ Q_s (cfs)
- ▲ Q_{max} (cfs)
- BASIN DESIGNATION
- BASIN AREA (ACRES)

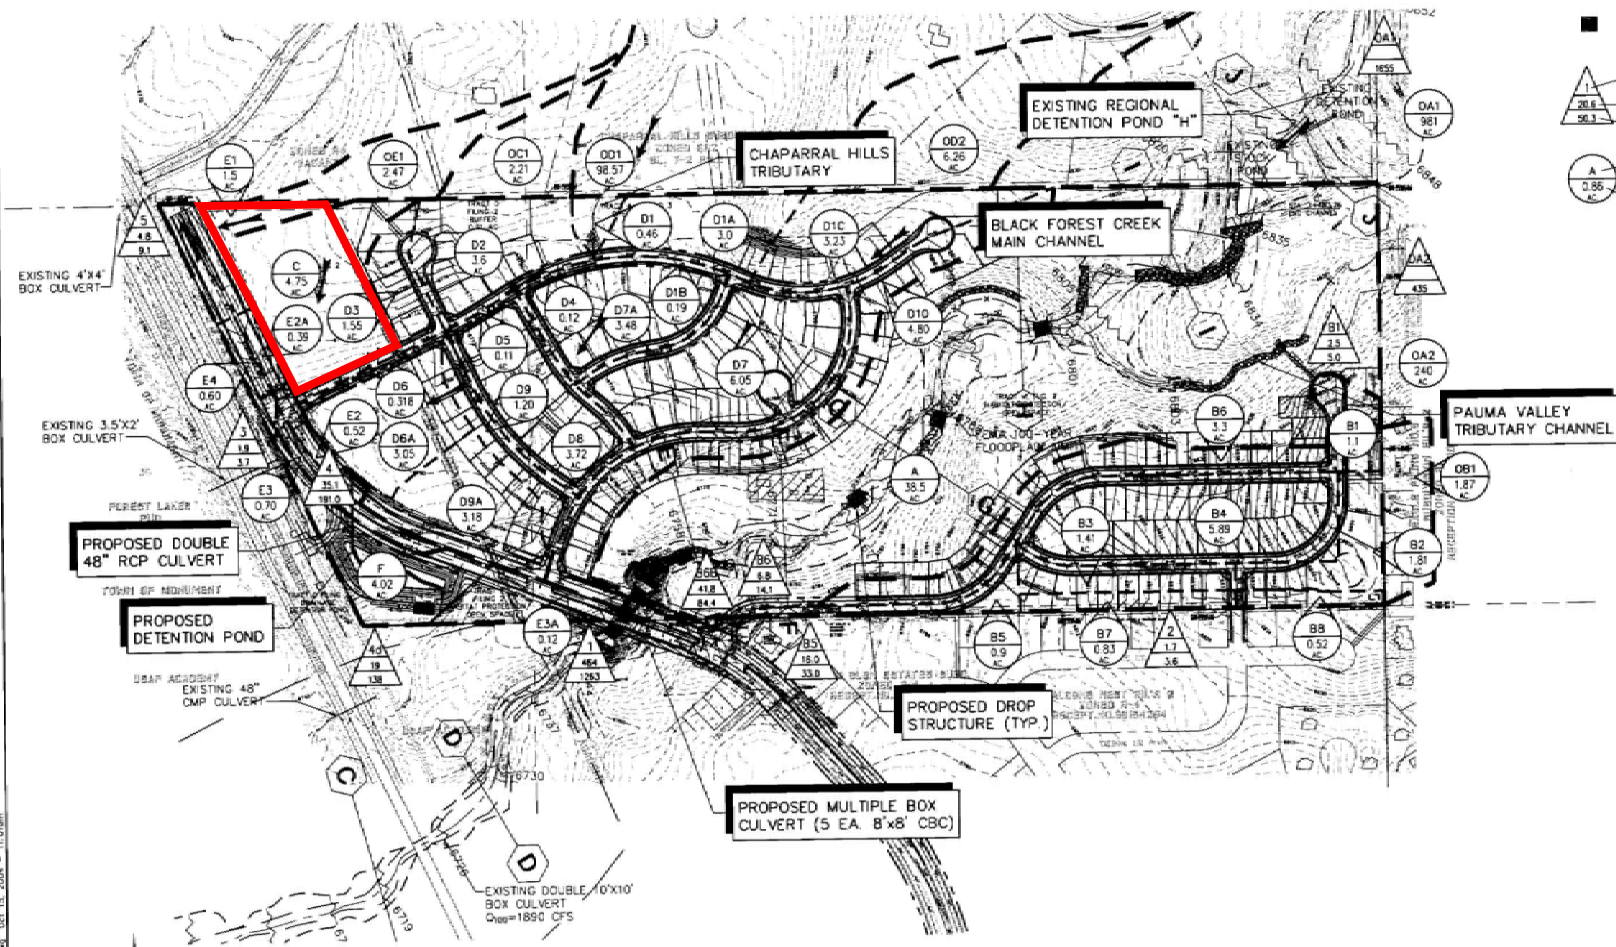

- NOTES:**
1. DEVELOPMENT SHALL FOLLOW ALL REQUIREMENTS OF THE APPROVED HABITAT CONSERVATION PLAN (HCP) AND ASSOCIATED ENVIRONMENTAL PERMITS.
 2. PERIMETER DRAINS SHALL BE REQUIRED FOR ALL HOMES WITH BASEMENTS.



NO.	REVISION	DATE	BY
1	EPC COMMENTS	4/8/04	JPS
2	EPC COMMENTS	5/7/04	JPS
3	EPC COMMENTS	5/25/04	JPS
4	EPC COMMENTS	9/2/04	JPS
5	RE-SUBMITTAL TO EPC	9/30/04	JPS

PROJECT NO.	880006	DRAWN	MJP
DATE	8/11/00	DESIGNED	N/A
PROJECT NAME	STRUTHERS RANCH	CHECKED	JPS
PROJECT NO.	880006	LAST MODIFIED	10/15/04
PROJECT NAME	STRUTHERS RANCH	MODIFIED BY	MJP

J:\projects\880006\struthers\dwg\struthers\drainage\developed.dwg, Oct 15, 2004 - 11:01am

TABLE 5-1

RECOMMENDED AVERAGE RUNOFF COEFFICIENTS AND PERCENT IMPERVIOUS

LAND USE OR SURFACE CHARACTERISTICS	PERCENT IMPERVIOUS	"C" FREQUENCY			
		10		100	
		A&B*	C&D*	A&B*	C&D*
Business					
Commercial Areas	95	0.90	0.90	0.90	0.90
Neighborhood Areas	70	0.75	0.75	0.80	0.80
Residential					
1/8 Acre or less	65	0.60	0.70	0.70	0.80
1/4 Acre	40	0.50	0.60	0.60	0.70
1/3 Acre	30	0.40	0.50	0.55	0.60
1/2 Acre	25	0.35	0.45	0.45	0.55
1 Acre	20	0.30	0.40	0.40	0.50
Industrial					
Light Areas	80	0.70	0.70	0.80	0.80
Heavy Areas	90	0.80	0.80	0.90	0.90
Parks and Cemeteries	7	0.30	0.35	0.55	0.60
Playgrounds	13	0.30	0.35	0.60	0.65
Railroad Yard Areas	40	0.50	0.55	0.60	0.65
Undeveloped Areas					
Historic Flow Analysis- Greenbelts, Agricultural	2	0.15	0.25	0.20	0.30
Pasture/Meadow	0	0.25	0.30	0.35	0.45
Forest	0	0.10	0.15	0.15	0.20
Exposed Rock	100	0.90	0.90	0.95	0.95
Offsite Flow Analysis (when land use not defined)	45	0.55	0.60	0.65	0.70
Streets					
Paved	100	0.90	0.90	0.95	0.95
Gravel	80	0.80	0.80	0.85	0.85
Drive and Walks	100	0.90	0.90	0.95	0.95
Roofs	90	0.90	0.90	0.95	0.95
Lawns	0	0.25	0.30	0.35	0.45

* Hydrologic Soil Group

9/30/90

(EPC-DCM)

STRUTHERS RANCH
COMPOSITE RUNOFF COEFFICIENTS

DEVELOPED CONDITIONS												
5-YEAR C VALUES												
BASIN	TOTAL AREA (AC)	SOIL TYPE	(AC)	SUB-AREA 1 DEVELOPMENT/ COVER	C	AREA (AC)	SUB-AREA 2 DEVELOPMENT/ COVER	C	(AC)	SUB-AREA 3 DEVELOPMENT/ COVER	C	WEIGHTED C VALUE
OA1	981	B	981	0.25-AC LOTS	0.5							0.500
OA2	240	B	240	0.25-AC LOTS	0.5							0.500
OA1,OA2	1221											0.500
B1	1.1	B	1.1	0.25-AC LOTS	0.5							0.500
A	38.5	B	38.5	OPEN SPACE	0.25							0.250
OA1,OA2,B1,A	1260.6											0.492
OB1	1.87	B	1.87	0.25-AC LOTS	0.5							0.500
B2	1.81	B	1.81	0.25-AC LOTS	0.5							0.500
B3	1.4	B	1.41	0.25-AC LOTS	0.5							0.500
B4	5.8	B	5.8	0.25-AC LOTS	0.5							0.500
OB1,B2-B4	10.9											0.500
B5	0.9	B	0.9	0.25-AC LOTS	0.5							0.500
OB1,B2-B5	11.8											0.500
B6	3.3	B	3.3	0.25-AC LOTS	0.5							0.500
OB1,B2-B6	15.1											0.500
OA1,OA2,A,B1-B6	1275.7											0.492
B7	0.83	B	0.83	0.25-AC LOTS	0.5							0.500
B8	0.52	B	0.52	0.25-AC LOTS	0.5							0.500
B7,B8	1.4											0.500
E4	0.6	B	0.34	PAVED	0.9	0.3	LANDSCAPE	0.25				0.618
OD1	98.57	B	98.57	5-AC LOTS	0.3							0.300
D1	0.46	B	0.46	MEADOW	0.25							0.250
OD1,D1	99.03											0.300

OD2	6.26	B	6.26	5-AC LOTS	0.3						0.300
D1C	3.23	B	1.5	0.25-AC LOTS	0.5	1.7	OPEN SPACE	0.25			0.366
OD2,D1C	9.49										0.322
D1A	3.00	B	0.8	0.25-AC LOTS	0.5	2.2	PARK / OS	0.25			0.317
OD2,D1C,D1A	12.49										0.321
D1B	0.19	B	0.19	ROADWAY	0.9						0.900
OD1,D1,D1A,D1B	111.71										0.303
D4	0.12	B	0.12	ROADWAY	0.9						0.900
OD1,D1,D1A,D1B,D4	111.83										0.304
D5	0.11	B	0.11	ROADWAY	0.9						0.900
OD1,D1,D1A,D1B,D4,D5	111.94										0.304
D6	0.32	B	0.318	ROADWAY	0.9						0.900
OD1,D1,D1A,D1B,D4-D6	112.26										0.306
OC1	2.21	B	2.21	5-AC LOTS	0.3						0.300
D2	3.60	B	3.6	0.25-AC LOTS	0.5						0.500
OC1,D2	5.81										0.424
E2A	0.39	B	0.3	PAVED	0.9	0.1	LANDSCAPE	0.25			0.750
D3	1.55	B	1.55	0.25-AC LOTS	0.5						0.500
C	4.75	B	4.75	COMMERCIAL	0.9						0.900
D3,C	6.30										0.802
OD1,OC1,C,E2A,D1-D6	124.76										0.338
E2	0.52	B	0.4	PAVED	0.9	0.1	LANDSCAPE	0.25			0.750
D6A	3.00	B	3	COMMERCIAL	0.9						0.900
OD1,OC1,C,D1-D6A	128.28										0.350
D7A	3.48	B	3.48	0.25-AC LOTS	0.5						0.500
D7	6.05	B	6.05	0.25-AC LOTS	0.5						0.500
D7A,D7	9.53										0.500
D8	3.72	B	3.72	0.25-AC LOTS	0.5						0.500
D7A,D7,D8	13.25										0.500
D9	1.20	B	1.2	0.25-AC LOTS	0.5						0.500
D7A-D9	14.45										0.500
E3A	0.12	B	0.12	MEDIAN	0.25						0.250
D10	4.80	B	4.8	0.25-AC LOTS	0.5						0.500
D7A-D10,E3A	19.37										0.498
D9A	3.18	B	3.18	COMMERCIAL	0.9						0.900
D7A-D10,E3A	22.55										0.555
E3	0.70	B	0.5	PAVED	0.9	0.2	LANDSCAPE	0.25			0.714
F	4.02	B	4.02	OPEN SPACE	0.25						0.250
OD1,C,D1-D10,E2-E3,F	155.55	B									0.379
OE1	2.47	B	2.47	5-AC LOTS	0.3						0.300
E1	1.5	B	1.5	COMMERCIAL	0.9						0.900
OE1,E1	4.0										0.527

STRUTHERS RANCH
COMPOSITE RUNOFF COEFFICIENTS

DEVELOPED CONDITIONS												
100-YEAR C VALUES												
BASIN	TOTAL AREA (AC)	SOIL TYPE	(AC)	SUB-AREA 1 DEVELOPMENT/COVER	C	AREA (AC)	SUB-AREA 2 DEVELOPMENT/COVER	C	(AC)	SUB-AREA 3 DEVELOPMENT/COVER	C	WEIGHTED C VALUE
OA1	981	B	981	0.25-AC LOTS	0.6							0.600
OA2	240	B	240	0.25-AC LOTS	0.6							0.600
OA1,OA2	1221											0.600
B1	1.1	B	1.1	0.25-AC LOTS	0.6							0.600
A	38.5	B	38.5	OPEN SPACE	0.35							0.350
OA1,OA2,B1,A	1260.6											0.592
OB1	1.87	B	1.87	0.25-AC LOTS	0.6							0.600
B2	1.81	B	1.81	0.25-AC LOTS	0.6							0.600
B3	1.4	B	1.41	0.25-AC LOTS	0.6							0.600
B4	5.8	B	5.8	0.25-AC LOTS	0.6							0.600
OB1,B2-B4	10.9											0.600
B5	0.9	B	0.9	0.25-AC LOTS	0.6							0.600
OB1,B2-B5	11.8											0.600
B6	3.3	B	3.3	0.25-AC LOTS	0.6							0.600
OB1,B2-B6	15.1											0.600
OA1,OA2,A,B1-B6	1275.7											0.592
B7	0.83	B	0.83	0.25-AC LOTS	0.6							0.600
B8	0.52	B	0.52	0.25-AC LOTS	0.6							0.600
B7,B8	1.4											0.600
E4	0.6	B	0.34	PAVED	0.95	0.3	LANDSCAPE	0.35				0.690
OD1	98.57	B	98.57	5-AC LOTS	0.4							0.400
D1	0.46	B	0.46	MEADOW	0.35							0.350
OD1,D1	99.03											0.400

OD2	6.26	B	6.26	5-AC LOTS	0.4						0.400
D1C	3.23	B	1.5	0.25-AC LOTS	0.6	1.7	OPEN SPACE	0.35			0.466
OD2,D1C	9.49										0.422
D1A	3.00	B	0.8	0.25-AC LOTS	0.6	2.2	PARK / OS	0.35			0.417
OD2,D1C,D1A	12.49										0.421
D1B	0.19	B	0.19	ROADWAY	0.95						0.950
OD1,D1,D1A,D1B	111.71										0.403
D4	0.12	B	0.12	ROADWAY	0.95						0.950
OD1,D1,D1A,D1B,D4	111.83										0.404
D5	0.11	B	0.11	ROADWAY	0.95						0.950
OD1,D1,D1A,D1B,D4,D5	111.94										0.404
D6	0.32	B	0.318	ROADWAY	0.95						0.950
OD1,D1,D1A,D1B,D4-D6	112.26										0.406
OC1	2.21	B	2.21	5-AC LOTS	0.4						0.400
D2	3.60	B	3.6	0.25-AC LOTS	0.6						0.600
OC1,D2	5.81										0.524
E2A	0.39	B	0.3	PAVED	0.95	0.1	LANDSCAPE	0.35			0.812
D3	1.55	B	1.55	0.25-AC LOTS	0.6						0.600
C	4.75	B	4.75	COMMERCIAL	0.9						0.900
D3,C	6.30										0.826
OD1,OC1,C,E2A,D1-D6	124.76										0.434
E2	0.52	B	0.4	PAVED	0.95	0.1	LANDSCAPE	0.35			0.812
D6A	3.00	B	3	COMMERCIAL	0.9						0.900
OD1,OC1,C,D1-D6A	128.28										0.443
D7A	3.48	B	3.48	0.25-AC LOTS	0.6						0.600
D7	6.05	B	6.05	0.25-AC LOTS	0.6						0.600
D7A,D7	9.53										0.600
D8	3.72	B	3.72	0.25-AC LOTS	0.6						0.600
D7A,D7,D8	13.25										0.600
D9	1.20	B	1.2	0.25-AC LOTS	0.6						0.600
D7A-D9	14.45										0.600
E3A	0.12	B	0.12	MEDIAN	0.35						0.350
D10	4.80	B	4.8	0.25-AC LOTS	0.6						0.600
D7A-D10,E3A	19.37										0.598
D9A	3.18	B	3.18	COMMERCIAL	0.9						0.900
D7A-D10,E3A	22.55										0.641
E3	0.70	B	0.5	PAVED	0.95	0.2	LANDSCAPE	0.35			0.779
F	4.02	B	4.02	OPEN SPACE	0.35						0.350
OD1,C,D1-D10,E2-E3,F	155.55	B									0.471
OE1	2.47	B	2.47	5-AC LOTS	0.4						0.400
E1	1.5	B	1.5	COMMERCIAL	0.9						0.900
OE1,E1	4.0										0.589

STRUTHERS RANCH
RATIONAL METHOD - DRAINAGE CALCULATIONS

DEVELOPED FLOWS

BASIN	DESIGN POINT	AREA (AC)	C		OVERLAND LENGTH (FT)	SLOPE (%)	T _{co} ⁽¹⁾ (MIN)	CHANNEL LENGTH (FT)	CONVEYANCE COEFFICIENT K	SLOPE (%)	SCS ⁽²⁾ VELOCITY (FT/S)	T _t ⁽³⁾ (MIN)	TOTAL T _c ⁽⁴⁾ (MIN)	INTENSITY ⁽⁵⁾		PEAK FLOW	
			5-YEAR ⁽⁷⁾	100-YEAR ⁽⁷⁾										5-YR (IN/HR)	100-YR (IN/HR)	Q5 ⁽⁶⁾ (CFS)	Q100 ⁽⁶⁾ (CFS)
OA1		981.00	0.500	0.600	300	5.4	10.7	11900	1.50	5.4	3.49	56.9	67.6	1.50	2.65	735.75	1559.79
OA2		240.00	0.500	0.600	300	5.5	10.6	620	1.50	5.5	3.52	2.9	13.5	3.60	6.10	432.00	878.40
OA1, OA2	OA1	1221.00	0.500	0.600									67.6	1.50	2.65	915.75	1941.39
B1	B1	1.10	0.500	0.600	250	12.8	7.3	0				0.0	7.3	4.50	7.60	2.48	5.02
A		38.50	0.250	0.350	0		0.0	2730	1.50	3.2	2.68	17.0	17.0	3.20	5.50	30.80	74.11
OA1, OA2, B1, A		1260.60	0.492	0.592									84.5	1.50	2.65	930.32	1977.63
B2		1.81	0.500	0.600	150	5.3	7.6	450	2.00	4.9	4.43	1.7	9.3	4.10	7.10	3.71	7.71
B3		1.41	0.500	0.600	0		0.0	700	2.00	3	3.46	3.4	3.4	5.20	9.00	3.67	7.61
B4		5.89	0.500	0.600	0		0.0	1180	2.00	3.7	3.85	5.1	5.1	5.20	9.00	15.31	31.81
OB1, B2, B3, B4	B3	9.11	0.500	0.600									12.7	3.70	6.20	16.85	33.89
B5		0.90	0.500	0.600	0		0.0	1000	2.00	3.3	3.63	4.6	4.6	5.20	9.00	2.34	4.86
OB1, B2, B5	B5	10.01	0.500	0.600									17.2	3.20	5.50	16.02	33.03
B6	B6	3.30	0.500	0.600	0		0.0	2100	2.00	3.7	3.85	9.1	9.1	4.10	7.10	6.77	14.06
OB1, B2, B6	B6A	13.31	0.500	0.600									17.2	3.20	5.50	21.30	43.92
B6A	B6B															41.80	84.40
OA1, OA2, A, B1, B6	1	1273.9	0.492	0.592									84.5	1.50	2.65	940.15	1998.51
B7		0.83	0.500	0.600	150	4.0	8.3	0				0.0	8.3	4.25	7.50	1.76	3.74
B8		0.52	0.500	0.600	850	5.5	17.8	0				0.0	17.8	3.10	5.20	0.81	1.62
B7, B8	2	1.35	0.500	0.600									26.2	2.50	4.40	1.69	3.56
E4	3	0.60	0.618	0.690	0		0.0	450	1.50	5.5	3.52	2.1	2.1	5.20	9.00	1.93	3.73
OD1		98.57	0.300	0.400	1000	10.0	21.2	3300	1.50	3.9	2.96	18.6	39.7	1.90	3.40	56.18	134.06
D1		0.46	0.250	0.350	0		0.0	180	1.50	2.5	2.37	1.3	1.3				
OD1, D1	D1	99.03	0.300	0.400									41.0	1.90	3.40	56.45	134.68
OD2		6.26	0.300	0.400	1000	3.5	30.0	0				0.0	30.0	2.35	4.10	4.41	10.27
D1C		3.23	0.366	0.466	0		0.0	700	2.00	3.4	3.69	3.2	3.2				
OD2, D1C	D1C	9.49	0.322	0.422									33.2	2.20	3.85	6.72	15.42
D1A		3.00	0.317	0.417	0		0.0	370	2.00	2.7	3.29	1.9	1.9				
OD2, D1C, D1A	D1A	12.49	0.321	0.421									35.0	2.10	3.75	8.42	19.72
D1B	D1B	0.19	0.900	0.950	0		0.0	420	2.00	1.6	2.53	2.8	2.8	5.20	9.00	0.89	1.62
OD1, D1, D1A, D1B	D1A1	111.71	0.303	0.403									41.0	1.90	3.40	64.31	153.07
D4	D4	0.12	0.900	0.950	0		0.0	700	2.00	1.56	2.50	4.7	4.7	5.20	9.00	0.56	1.03
OD1, D1, D1A, D1B, D4	D4A	111.83	0.304	0.404									45.7	1.75	3.20	64.87	154.09
D5	D5	0.11	0.900	0.950	0		0.0	250	2.00	3.27	3.62	1.2	1.2	5.20	9.00	0.51	0.94
OD1, D1, D1A, D1B, D4, D5	D5A	111.94	0.304	0.404									46.8	1.70	3.15	65.39	155.03
D6	D6	0.32	0.900	0.950	0		0.0	480	2.00	4.44	4.21	1.9	1.9	5.20	9.00	1.49	2.72
OD1, D1, D1A, D1B, D4, D6	D6A1	112.26	0.306	0.406									48.7	1.70	3.00	66.88	157.75

BASIN	DESIGN POINT	AREA (AC)	C		OVERLAND LENGTH (FT)	SLOPE (%)	T _{CO} ⁽¹⁾ (MIN)	CHANNEL LENGTH (FT)	CONVEYANCE COEFFICIENT K	SLOPE (%)	SCS ⁽²⁾ VELOCITY (FT/S)	T _T ⁽³⁾ (MIN)	TOTAL T _C ⁽⁴⁾ (MIN)	INTENSITY ⁽⁵⁾		PEAK FLOW	
			5-YEAR ⁽⁷⁾	100-YEAR ⁽⁷⁾										5-YR (IN/HR)	100-YR (IN/HR)	Q ₅ ⁽⁶⁾ (CFS)	Q ₁₀₀ ⁽⁶⁾ (CFS)
OC1		2.21	0.300	0.400	550	3.3	22.7					0.0	22.7	2.70	4.70	1.79	4.15
D2		3.60	0.500	0.600	0		0.0	600	2.00	3.6	3.79	2.6	2.6				
OC1,D2	D2	5.81	0.424	0.524									25.3	2.60	4.50	6.40	13.70
E2A	E2A	0.39	0.750	0.812	0		0.0	300	1.50	4	3.00	1.7	1.7	5.20	9.00	1.52	2.85
D3		1.55	0.500	0.600	0		0.0	580	2.00	4.3	4.15	2.3	2.3	5.20	9.00	4.03	8.37
C		4.75	0.900	0.900	0		0.0	750	2.00	3.3	3.63	3.4	3.4	5.20	9.00	22.23	38.48
D3,C	C	6.30	0.802	0.826									5.8	5.00	8.50	25.26	44.23
OD1,OC1,E2A,C,D1-D6	C1	124.76	0.338	0.434									48.7	1.70	3.00	71.69	162.43
E2		0.52	0.750	0.812	0		0.0	300	1.50	4	3.00	1.7	1.7	5.20	9.00	2.03	3.80
D6A	D6A	3.00	0.900	0.900	0		0.0	470	2.00	3.4	3.69	2.1	2.1	5.20	9.00	14.04	24.30
OD1,OC1,C,D1-D6A	D6A2	128.28	0.350	0.443									50.8	1.60	2.90	71.84	164.80
D7A	D7A	3.48	0.500	0.600	0		0.0	950	2.00	1.68	2.59	6.1	6.1	5.00	8.50	8.70	17.75
D7		6.05	0.500	0.600	0		0.0	1244	2.00	2.17	2.95	7.0	7.0	4.60	8.00	13.92	29.04
D7A,D7	D7	9.53	0.500	0.600									7.0	4.60	8.00	21.92	45.74
D8	D8	3.72	0.500	0.600	0		0.0	225	2.00	3.4	3.69	1.0	1.0	5.20	9.00	9.67	20.09
D7A-D8	D8A	13.25	0.500	0.600									8.1	4.40	7.50	29.15	59.63
D9	D9	1.20	0.500	0.600	0		0.0	210	2.00	3.4	3.69	0.9	0.9	5.20	9.00	3.12	6.48
D7A-D9	D9A	14.45	0.500	0.600									9.0	4.20	7.20	30.35	62.42
E3A	E3A	0.12	0.250	0.350	0		0.0	220	1.50	4.3	3.11	1.2	1.2	5.20	9.00	0.16	0.38
D10	D10	4.80	0.500	0.600	300	4.0	11.8	1820	2.00	3	3.46	8.8	20.5	2.95	5.05	7.08	14.54
D10A	D10A	0.23	0.500	0.600	0		0.0	200	1.50	0.5	1.06	3.1	3.1	5.20	9.00	0.60	1.24
D7A-D10,E3A	D10B	19.37	0.498	0.598									20.5	2.95	5.05	28.46	58.50
D9A		3.18	0.900	0.900	0		0.0	620	1.50	0.5	1.06	9.7	9.7	5.20	9.00	14.88	25.76
D7A-D10,E3A	D9B	22.55	0.555	0.641									30.3	2.30	4.05	28.79	58.54
E3	E3	0.70	0.714	0.779	0		0.0	620	1.50	0.8	1.34	7.7	7.7	4.40	7.50	2.20	4.09
F		4.02	0.250	0.350	0		0.0	570	1.50	1.0	1.50	6.3	6.3	5.00	8.50	5.03	11.96
OD1,OC1,C,D1-D10,E2-E3,F	4	155.55	0.379	0.471									50.8	1.60	2.90	94.32	212.46
OE1		2.47	0.300	0.400	850	2.8	29.8	0				0.0	29.8	2.35	4.10	1.74	4.05
E1		1.50	0.900	0.900	0		0.0	700	2.00	2.3	3.03	3.8	3.8	5.20	9.00	7.02	12.15
OE1,E1	5	3.97	0.527	0.589									33.6	2.20	3.80	4.60	8.89

1) OVERLAND FLOW T_{CO} = (1.87 * (1.1 - RUNOFF COEFFICIENT) * (OVERLAND FLOW LENGTH^{0.5}) / (SLOPE^{0.333}))

2) SCS VELOCITY = K * ((SLOPE(%))^{0.5})

K = 0.70 FOR MEADOW / FOREST

K = 1.0 FOR BARE SOIL

K = 1.5 FOR GRASS CHANNEL

K = 2.0 FOR PAVEMENT

3) GUTTER/SWALE FLOW, TRAVEL TIME, T_T = (CHANNEL LENGTH / SCS VELOCITY) / 60 SEC

4) T_C = T_{CO} + T_T

*** IF TOTAL TIME OF CONCENTRATION IS LESS THAN 5 MINUTES, THEN 5 MINUTES IS USED

5) INTENSITY BASED ON I-D-F CURVE IN EL PASO COUNTY DRAINAGE CRITERIA MANUAL

6) Q = C_IA


7) WEIGHTED AVERAGE C VALUES FOR COMBINED BASINS

APPENDIX B
HYDROLOGIC CALCULATIONS

Hydrologic Soil Group—El Paso County Area, Colorado
(Cathedral Rock Church)



Map Scale: 1:1,530 if printed on A landscape (11" x 8.5") sheet.



Map projection: Web Mercator Corner coordinates: WGS84 Edge ticks: UTM Zone 13N WGS84

Hydrologic Soil Group—El Paso County Area, Colorado
(Cathedral Rock Church)


MAP LEGEND

Area of Interest (AOI)









 Area of Interest (AOI)

Soils

Soil Rating Polygons





-  A
-  A/D
-  B
-  B/D
-  C
-  C/D
-  D
-  Not rated or not available

Soil Rating Lines


-  A
-  A/D
-  B
-  B/D
-  C
-  C/D
-  D
-  Not rated or not available

Soil Rating Points






-  A
-  A/D
-  B
-  B/D

-  C
-  C/D
-  D
-  Not rated or not available

Water Features

 Streams and Canals

Transportation

-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
Web Soil Survey URL:
Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado
Survey Area Data: Version 21, Aug 24, 2023

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Jun 9, 2021—Jun 12, 2021

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
68	Peyton-Pring complex, 3 to 8 percent slopes	B	1.3	25.1%
71	Pring coarse sandy loam, 3 to 8 percent slopes	B	3.9	74.9%
Totals for Area of Interest			5.2	100.0%

Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

Rating Options

Aggregation Method: Dominant Condition

Component Percent Cutoff: None Specified

Tie-break Rule: Higher

Table 6-6. Runoff Coefficients for Rational Method
(Source: UDFCD 2001)

Land Use or Surface Characteristics	Percent Impervious	Runoff Coefficients											
		2-year		5-year		10-year		25-year		50-year		100-year	
		HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D
Business													
Commercial Areas	95	0.79	0.80	0.81	0.82	0.83	0.84	0.85	0.87	0.87	0.88	0.88	0.89
Neighborhood Areas	70	0.45	0.49	0.49	0.53	0.53	0.57	0.58	0.62	0.60	0.65	0.62	0.68
Residential													
1/8 Acre or less	65	0.41	0.45	0.45	0.49	0.49	0.54	0.54	0.59	0.57	0.62	0.59	0.65
1/4 Acre	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
1/3 Acre	30	0.18	0.22	0.25	0.30	0.32	0.38	0.39	0.47	0.43	0.52	0.47	0.57
1/2 Acre	25	0.15	0.20	0.22	0.28	0.30	0.36	0.37	0.46	0.41	0.51	0.46	0.56
1 Acre	20	0.12	0.17	0.20	0.26	0.27	0.34	0.35	0.44	0.40	0.50	0.44	0.55
Industrial													
Light Areas	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Heavy Areas	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Parks and Cemeteries	7	0.05	0.09	0.12	0.19	0.20	0.29	0.30	0.40	0.34	0.46	0.39	0.52
Playgrounds	13	0.07	0.13	0.16	0.23	0.24	0.31	0.32	0.42	0.37	0.48	0.41	0.54
Railroad Yard Areas	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
Undeveloped Areas													
Historic Flow Analysis-- Greenbelts, Agriculture	2	0.03	0.05	0.09	0.16	0.17	0.26	0.26	0.38	0.31	0.45	0.36	0.51
Pasture/Meadow	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Forest	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Exposed Rock	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Offsite Flow Analysis (when landuse is undefined)	45	0.26	0.31	0.32	0.37	0.38	0.44	0.44	0.51	0.48	0.55	0.51	0.59
Streets													
Paved	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Gravel	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Drive and Walks	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Roofs	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Lawns	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50

3.2 Time of Concentration

One of the basic assumptions underlying the Rational Method is that runoff is a function of the average rainfall rate during the time required for water to flow from the hydraulically most remote part of the drainage area under consideration to the design point. However, in practice, the time of concentration can be an empirical value that results in reasonable and acceptable peak flow calculations.

For urban areas, the time of concentration (t_c) consists of an initial time or overland flow time (t_i) plus the travel time (t_r) in the storm sewer, paved gutter, roadside drainage ditch, or drainage channel. For non-urban areas, the time of concentration consists of an overland flow time (t_i) plus the time of travel in a concentrated form, such as a swale or drainageway. The travel portion (t_r) of the time of concentration can be estimated from the hydraulic properties of the storm sewer, gutter, swale, ditch, or drainageway. Initial time, on the other hand, will vary with surface slope, depression storage, surface cover, antecedent rainfall, and infiltration capacity of the soil, as well as distance of surface flow. The time of concentration is represented by Equation 6-7 for both urban and non-urban areas.

$$t_c = t_i + t_t \quad (\text{Eq. 6-7})$$

Where:

t_c = time of concentration (min)

t_i = overland (initial) flow time (min)

t_t = travel time in the ditch, channel, gutter, storm sewer, etc. (min)

3.2.1 Overland (Initial) Flow Time

The overland flow time, t_i , may be calculated using Equation 6-8.

$$t_i = \frac{0.395(1.1 - C_5)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

t_i = overland (initial) flow time (min)

C_5 = runoff coefficient for 5-year frequency (see Table 6-6)

L = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

S = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time, t_t , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time, t_t , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

V = velocity (ft/s)

C_v = conveyance coefficient (from Table 6-7)

S_w = watercourse slope (ft/ft)

Table 6-7. Conveyance Coefficient, C_v

Type of Land Surface	C_v
Heavy meadow	2.5
Tillage/field	5
Riprap (not buried)*	6.5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

* For buried riprap, select C_v value based on type of vegetative cover.

The travel time is calculated by dividing the flow distance (in feet) by the velocity calculated using Equation 6-9 and converting units to minutes.

The time of concentration (t_c) is then the sum of the overland flow time (t_i) and the travel time (t_t) per Equation 6-7.

3.2.3 First Design Point Time of Concentration in Urban Catchments

Using this procedure, the time of concentration at the first design point (typically the first inlet in the system) in an urbanized catchment should not exceed the time of concentration calculated using Equation 6-10. The first design point is defined as the point where runoff first enters the storm sewer system.

$$t_c = \frac{L}{180} + 10 \quad (\text{Eq. 6-10})$$

Where:

t_c = maximum time of concentration at the first design point in an urban watershed (min)

L = waterway length (ft)

Equation 6-10 was developed using the rainfall-runoff data collected in the Denver region and, in essence, represents regional “calibration” of the Rational Method. Normally, Equation 6-10 will result in a lesser time of concentration at the first design point and will govern in an urbanized watershed. For subsequent design points, the time of concentration is calculated by accumulating the travel times in downstream drainageway reaches.


3.2.4 Minimum Time of Concentration

If the calculations result in a t_c of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum t_c for urbanized areas is 5 minutes.

3.2.5 Post-Development Time of Concentration

As Equation 6-8 indicates, the time of concentration is a function of the 5-year runoff coefficient for a drainage basin. Typically, higher levels of imperviousness (higher 5-year runoff coefficients) correspond to shorter times of concentration, and lower levels of imperviousness correspond to longer times of

Figure 6-5. Colorado Springs Rainfall Intensity Duration Frequency

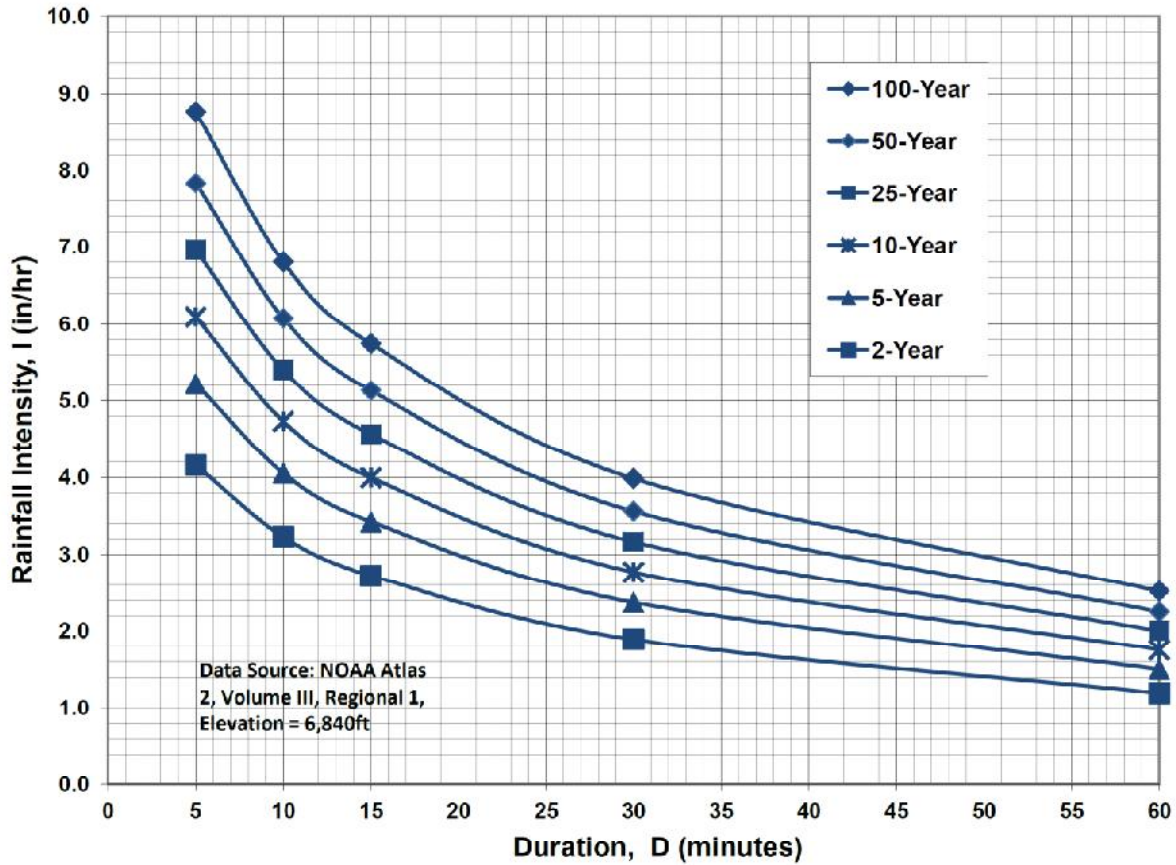

IDF Equations

$$I_{100} = -2.52 \ln(D) + 12.735$$

$$I_{50} = -2.25 \ln(D) + 11.375$$

$$I_{25} = -2.00 \ln(D) + 10.111$$

$$I_{10} = -1.75 \ln(D) + 8.847$$

$$I_5 = -1.50 \ln(D) + 7.583$$

$$I_2 = -1.19 \ln(D) + 6.035$$

Note: Values calculated by equations may not precisely duplicate values read from figure.

CATHEDRAL ROCK CHURCH
COMPOSITE RUNOFF COEFFICIENTS

DEVELOPED CONDITIONS											
5-YEAR C VALUES											
BASIN	TOTAL AREA (AC)	(AC)	SUB-AREA 1 DEVELOPMENT/ COVER	C	AREA (AC)	SUB-AREA 2 DEVELOPMENT/ COVER	C	(AC)	SUB-AREA 3 DEVELOPMENT/ COVER	C	WEIGHTED C VALUE
OA1	0.05	0.00	SF RESIDENTIAL	0.3							0.300
A1	2.29	1.632	PAVED/IMPERVIOUS	0.9	0.66	LANDSCAPED	0.08				0.664
OA1,A1	2.34										0.657
OA2	0.40	0.00	SF RESIDENTIAL	0.3							0.300
A2	0.86	0.523	PAVED/IMPERVIOUS	0.9	0.34	LANDSCAPED	0.08				0.579
OA2,A2	1.26										0.490
OA1-OA2,A1-A2	3.60										0.598
A3	0.96	0.82	PAVED/IMPERVIOUS	0.9	0.14	LANDSCAPED	0.08				0.777
A1-A3	4.56										0.636
A4	0.23	0.00	PAVED/IMPERVIOUS	100	0.23	LANDSCAPED	0.08				0.080
A1-A4	4.79										0.609
OB1	0.13	0.00	SF RESIDENTIAL	0.3							0.300
B	0.74	0.00	PAVED/IMPERVIOUS	0.9	0.74	LANDSCAPED	0.08				0.080
OB1,B	0.87										0.113
100-YEAR C VALUES											
BASIN	TOTAL AREA (AC)	(AC)	SUB-AREA 1 DEVELOPMENT/ COVER	C	AREA (AC)	SUB-AREA 2 DEVELOPMENT/ COVER	C	(AC)	SUB-AREA 3 DEVELOPMENT/ COVER	C	WEIGHTED C VALUE
OA1	0.05	0.00	SF RESIDENTIAL	0.5							0.500
A1	2.29	1.632	PAVED/IMPERVIOUS	0.96	0.66	LANDSCAPED	0.35				0.785
OA1,A1	2.34										0.779
OA2	0.40	0.00	SF RESIDENTIAL	0.5							0.500
A2	0.86	0.523	PAVED/IMPERVIOUS	0.96	0.34	LANDSCAPED	0.35				0.721
OA2,A2	1.26										0.651
OA1-OA2,A1-A2	3.60										0.734
A3	0.96	0.82	PAVED/IMPERVIOUS	0.96	0.14	LANDSCAPED	0.35				0.869
A1-A3	4.56										0.762
A4	0.23	0.00	PAVED/IMPERVIOUS	100	0.23	LANDSCAPED	0.35				0.350
A1-A4	4.79										0.742
OB1	0.13	0.00	SF RESIDENTIAL	0.5							0.500
B	0.74	0.00	PAVED/IMPERVIOUS	0.96	0.74	LANDSCAPED	0.35				0.350
OB1,B	0.87										0.372

CATHEDRAL ROCK CHURCH
RATIONAL METHOD

EXISTING CONDITIONS

BASIN	DESIGN POINT	AREA (AC)	C		Overland Flow			Channel flow					TOTAL Tc ⁽⁴⁾ (MIN)	TOTAL Tc ⁽⁴⁾ (MIN)	INTENSITY ⁽⁵⁾		PEAK FLOW		
			5-YEAR	100-YEAR	LENGTH (FT)	SLOPE (FT/FT)	Tco ⁽¹⁾ (MIN)	CHANNEL LENGTH (FT)	CONVEYANCE COEFFICIENT C	SLOPE (FT/FT)	SCS ⁽²⁾ VELOCITY (FT/S)	Tt ⁽³⁾ (MIN)			5-YR (IN/HR)	100-YR (IN/HR)	Q5 ⁽⁶⁾ (CFS)	Q100 ⁽⁶⁾ (CFS)	
			OA1		0.40	0.300	0.500	100	0.020	11.6							0.0	11.6	11.6
Tt OA1 to DP1												2.0							
A		3.36	0.080	0.350	100	0.070	9.8	430	15	0.056	3.55	2.2	12.0	12.0	3.86	6.48	1.04	7.62	
OA1,A	1	3.76	0.103	0.366				430	15	0.047	3.25		13.6	13.6	3.66	6.15	1.42	8.46	
OB1		0.18	0.300	0.500	100	0.020	11.6	30	15	0.02	2.12	0.2	11.9	11.9	3.87	6.50	0.21	0.59	
B		1.72	0.080	0.350			0.0	535	15	0.034	2.77	3.2	3.2	5.0	5.17	8.68	0.71	5.22	
OB1,B	2	1.90	0.101	0.364									15.1	15.1	3.51	5.90	0.67	4.08	

DEVELOPED CONDITIONS

BASIN	DESIGN POINT	AREA (AC)	C		Overland Flow			Channel flow					TOTAL Tc ⁽⁴⁾ (MIN)	TOTAL Tc ⁽⁴⁾ (MIN)	INTENSITY ⁽⁵⁾		PEAK FLOW		
			5-YEAR	100-YEAR	LENGTH (FT)	SLOPE (FT/FT)	Tco ⁽¹⁾ (MIN)	CHANNEL LENGTH (FT)	CONVEYANCE COEFFICIENT C	SLOPE (FT/FT)	SCS ⁽²⁾ VELOCITY (FT/S)	Tt ⁽³⁾ (MIN)			5-YR (IN/HR)	100-YR (IN/HR)	Q5 ⁽⁶⁾ (CFS)	Q100 ⁽⁶⁾ (CFS)	
			OA1		0.05	0.300	0.500	60	0.020	9.0							0.0	9.0	9.0
A1		2.29	0.664	0.785	40	0.050	3.0	400	20	0.032	3.58	1.9	4.8	5.0	5.17	8.68	7.86	15.60	
Tt DP-A1 to A2.2								250	20	0.041	4.05	1.0							
OA1,A1	A1.1	2.34	0.657	0.779									13.8	13.8	3.64	6.12	5.60	11.15	
OA2		0.40	0.300	0.500	100	0.020	11.6					0.0	11.6	11.6	3.90	6.55	0.47	1.31	
Tt OA2 to A2.1								340	20	0.065	5.10	1.1							
A2		0.86	0.579	0.721	90	0.100	4.2	255	20	0.051	4.52	0.9	5.1	5.1	5.13	8.61	2.55	5.34	
OA2,A2	A2.1	1.26	0.490	0.651									12.7	12.7	3.77	6.32	2.33	5.19	
OA1-OA2,A1-A2	A2.2	3.60	0.598	0.734									12.7	12.7	3.77	6.32	8.11	16.71	
A3		0.96	0.777	0.869	100	0.010	5.9	160	20	0.069	5.25	0.5	6.4	6.4	4.79	8.05	3.58	6.71	
OA1-OA2,A1-A3	A3.1	4.56	0.636	0.762									6.4	6.4	4.79	8.05	13.90	27.97	
A4		0.23	0.080	0.350			0.0	185	20	0.022	2.97	1.0	1.0	5.0	5.17	8.68	0.10	0.70	
OA1-OA2,A1-A4	1	4.79	0.609	0.742									13.8	13.8	3.65	6.13	10.64	21.77	
OB1		0.13	0.300	0.500	100	0.020	11.6	30	15	0.02	2.12	0.2	11.9	11.9	3.87	6.50	0.15	0.42	
B		0.74	0.080	0.350			0.0	535	15	0.034	2.77	3.2	3.2	5.0	5.17	8.68	0.31	2.25	
OB1,B	2	0.87	0.113	0.372									15.1	15.1	3.51	5.90	0.35	1.91	

1) OVERLAND FLOW Tco = (0.395*(1.1-RUNOFF COEFFICIENT)^(OVERLAND FLOW LENGTH^(0.5)/(SLOPE^(0.333)))

2) SCS VELOCITY = C * ((SLOPE/FT/FT)^0.5)

C = 2.5 FOR HEAVY MEADOW

C = 5 FOR TILLAGE/FIELD

C = 7 FOR SHORT PASTURE AND LAWNS

C = 10 FOR NEARLY BARE GROUND

C = 15 FOR GRASSED WATERWAY

C = 20 FOR PAVED AREAS AND SHALLOW PAVED SWALES

3) MANNING'S CHANNEL TRAVEL TIME = L/V (WHEN CHANNEL VELOCITY IS KNOWN)

4) Tc = Tco + Tt

*** IF TOTAL TIME OF CONCENTRATION IS LESS THAN 5 MINUTES, THEN 5 MINUTES IS USED

5) INTENSITY BASED ON I-D-F EQUATIONS IN CITY OF COLORADO SPRINGS DRAINAGE CRITERIA MANUAL

I₅ = -1.5 * ln(Tc) + 7.583

I₁₀₀ = -2.52 * ln(Tc) + 12.735

6) Q = CiA

APPENDIX C
HYDRAULIC CALCULATIONS

**CATHEDRAL ROCK CHURCH
STORM INLET SIZING SUMMARY**

INLET	BASIN FLOW			INLET FLOW			INLET CONDITION / TYPE	INLET SIZE (FT)	INLET CAPACITY (CFS)
	DP	Q5 FLOW (CFS)	Q100 FLOW (CFS)	INLET FLOW % OF BASIN	Q5 FLOW (CFS)	Q100 FLOW (CFS)			
A1.0 (RD)	A1	7.9	15.6	15	1.2	2.3	ROOF DRAINS		
A1.1	A1	7.9	15.6	25	2.0	3.9	SUMP TYPE R	5'	10.1
A1.2	A1	7.9	15.6	60	4.7	9.4	SUMP TYPE R	5'	11.0
A2	A2	2.6	5.3	100	2.6	5.3	SUMP TYPE R	5'	11.7

Hydraulic Analysis Report

Project Data

Project Title: Project - Cathedral Rock Church - Drainage Chases

Designer: JPS

Project Date: Thursday, October 31, 2024

Project Units: U.S. Customary Units

Notes:

Channel Analysis: Channel Analysis - Curb Chase A1.2A-A1.2C

Notes:

Input Parameters

Channel Type: Rectangular

Channel Width: 2.0000 ft

Longitudinal Slope: 0.0100 ft/ft

Manning's n: 0.0130

Flow: 9.4000 cfs

Result Parameters

Depth: 0.7305 ft

Area of Flow: 1.4609 ft²

Wetted Perimeter: 3.4609 ft

Hydraulic Radius: 0.4221 ft

Average Velocity: 6.4344 ft/s

Top Width: 2.0000 ft

Froude Number: 1.3267

Critical Depth: 0.8820 ft

Critical Velocity: 5.3291 ft/s

Critical Slope: 0.0060 ft/ft

Critical Top Width: 2.00 ft

Calculated Max Shear Stress: 0.4558 lb/ft²

Calculated Avg Shear Stress: 0.2634 lb/ft²

INLET MANAGEMENT

Worksheet Protected

INLET NAME	Inlet A1.1	Inlet A1.2	Inlet A2
Site Type (Urban or Rural)	URBAN	URBAN	URBAN
Inlet Application (Street or Area)	STREET	STREET	STREET
Hydraulic Condition	In Sump	In Sump	In Sump
Inlet Type	CDOT Type R Curb Opening	CDOT Type R Curb Opening	CDOT Type R Curb Opening

USER-DEFINED INPUT


User-Defined Design Flows			
Minor Q_{Known} (cfs)	2.0	4.7	2.6
Major Q_{Known} (cfs)	3.9	9.4	5.3
Bypass (Carry-Over) Flow from Upstream Inlets must be organized from upstream (left) to downstream (right) in order for bypass flows to be linked.			
Receive Bypass Flow from:	No Bypass Flow Received	No Bypass Flow Received	No Bypass Flow Received
Minor Bypass Flow Received, Q_b (cfs)	0.0	0.0	0.0
Major Bypass Flow Received, Q_b (cfs)	0.0	0.0	0.0
Watershed Characteristics			
Subcatchment Area (acres)			
Percent Impervious			
NRCS Soil Type			
Watershed Profile			
Overland Slope (ft/ft)			
Overland Length (ft)			
Channel Slope (ft/ft)			
Channel Length (ft)			
Minor Storm Rainfall Input			
Design Storm Return Period, T_r (years)			
One-Hour Precipitation, P_1 (inches)			
Major Storm Rainfall Input			
Design Storm Return Period, T_r (years)			
One-Hour Precipitation, P_1 (inches)			

CALCULATED OUTPUT

Minor Total Design Peak Flow, Q (cfs)	2.0	4.7	2.6
Major Total Design Peak Flow, Q (cfs)	3.9	9.4	5.3
Minor Flow Bypassed Downstream, Q_b (cfs)	N/A	N/A	N/A
Major Flow Bypassed Downstream, Q_b (cfs)	N/A	N/A	N/A

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)
 (Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)


Project: Cathedral Rock Church
 Inlet ID: Inlet A1.1

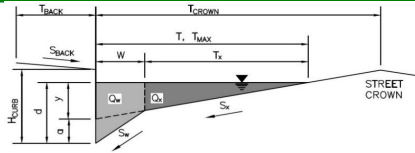

Gutter Geometry:					
Maximum Allowable Width for Spread Behind Curb	$T_{BACK} = 4.0$ ft				
Side Slope Behind Curb (leave blank for no conveyance credit behind curb)	$S_{BACK} = 0.020$ ft/ft				
Manning's Roughness Behind Curb (typically between 0.012 and 0.020)	$n_{BACK} = 0.013$				
Height of Curb at Gutter Flow Line	$H_{CURB} = 6.00$ inches				
Distance from Curb Face to Street Crown	$T_{CROWN} = 24.0$ ft				
Gutter Width	$W = 2.00$ ft				
Street Transverse Slope	$S_x = 0.025$ ft/ft				
Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)	$S_w = 0.083$ ft/ft				
Street Longitudinal Slope - Enter 0 for sump condition	$S_o = 0.000$ ft/ft				
Manning's Roughness for Street Section (typically between 0.012 and 0.020)	$n_{STREET} = 0.016$				
Max. Allowable Spread for Minor & Major Storm	$T_{MAX} = \begin{matrix} \text{Minor Storm} & \text{Major Storm} \\ 24.0 & 24.0 \end{matrix}$ ft				
Max. Allowable Depth at Gutter Flowline for Minor & Major Storm	$d_{MAX} = \begin{matrix} \text{Minor Storm} & \text{Major Storm} \\ 6.0 & 12.0 \end{matrix}$ inches				
Check boxes are not applicable in SUMP conditions	<input type="checkbox"/> <input type="checkbox"/>				
MINOR STORM Allowable Capacity is not applicable to Sump Condition					
MAJOR STORM Allowable Capacity is not applicable to Sump Condition					
Q_{allow}	Q_{allow} = <table border="1"> <tr> <td>Minor Storm</td> <td>Major Storm</td> </tr> <tr> <td>SUMP</td> <td>SUMP</td> </tr> </table> cfs	Minor Storm	Major Storm	SUMP	SUMP
Minor Storm	Major Storm				
SUMP	SUMP				

INLET IN A SUMP OR SAG LOCATION

MHFD-Inlet, Version 5.03 (August 2023)

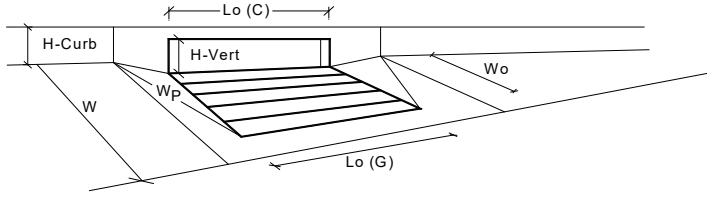


Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from above)	3.00	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)	1	1	
Water Depth at Flowline (outside of local depression)	6.0	8.6	inches
Grate Information	MINOR	MAJOR	<input type="checkbox"/> Override Depths
Length of a Unit Grate	N/A	N/A	feet
Width of a Unit Grate	N/A	N/A	feet
Open Area Ratio for a Grate (typical values 0.15-0.90)	N/A	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	N/A	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)	N/A	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)	N/A	N/A	
Curb Opening Information	MINOR	MAJOR	
Length of a Unit Curb Opening	5.00	5.00	feet
Height of Vertical Curb Opening in Inches	6.00	6.00	inches
Height of Curb Orifice Throat in Inches	6.00	6.00	inches
Angle of Throat	63.40	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)	2.00	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)	0.10	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)	3.60	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	0.67	0.67	
Low Head Performance Reduction (Calculated)	MINOR	MAJOR	
Depth for Grate Midwidth	N/A	N/A	ft
Depth for Curb Opening Weir Equation	0.33	0.55	ft
Grated Inlet Performance Reduction Factor for Long Inlets	N/A	N/A	
Curb Opening Performance Reduction Factor for Long Inlets	1.00	1.00	
Combination Inlet Performance Reduction Factor for Long Inlets	N/A	N/A	
Total Inlet Interception Capacity (assumes clogged condition)	5.4	10.1	cfs
Inlet Capacity IS GOOD for Minor and Major Storms (>Q Peak)	2.0	3.9	cfs

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project: Cathedral Rock Church
Inlet ID: Inlet A1.2

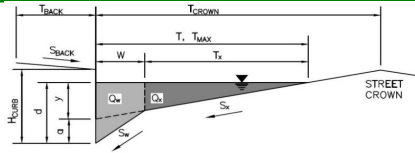

Gutter Geometry:

Maximum Allowable Width for Spread Behind Curb
 Side Slope Behind Curb (leave blank for no conveyance credit behind curb)
 Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

T_{BACK}	=	4.0	ft
S_{BACK}	=	0.020	ft/ft
n_{BACK}	=	0.020	

Height of Curb at Gutter Flow Line
 Distance from Curb Face to Street Crown
 Gutter Width
 Street Transverse Slope
 Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)
 Street Longitudinal Slope - Enter 0 for sump condition
 Manning's Roughness for Street Section (typically between 0.012 and 0.020)

H_{CURB}	=	6.00	inches
T_{CROWN}	=	60.0	ft
W	=	2.00	ft
S_X	=	0.011	ft/ft
S_W	=	0.083	ft/ft
S_0	=	0.000	ft/ft
n_{STREET}	=	0.016	

Max. Allowable Spread for Minor & Major Storm
 Max. Allowable Depth at Gutter Flowline for Minor & Major Storm
 Check boxes are not applicable in SUMP conditions


		Minor Storm	Major Storm	
T_{MAX}	=	60.0	60.0	ft
d_{MAX}	=	6.0	12.0	inches
		<input type="checkbox"/>	<input type="checkbox"/>	

MINOR STORM Allowable Capacity is not applicable to Sump Condition
 MAJOR STORM Allowable Capacity is not applicable to Sump Condition

		Minor Storm	Major Storm	
Q_{allow}	=	SUMP	SUMP	cfs

INLET IN A SUMP OR SAG LOCATION

MHFD-Inlet, Version 5.03 (August 2023)

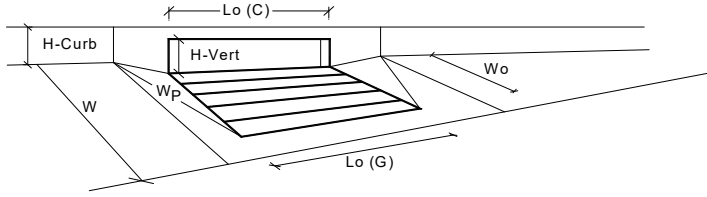


Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from above)	3.00	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)	1	1	
Water Depth at Flowline (outside of local depression)	6.0	9.6	inches
<u>Grate Information</u>	MINOR	MAJOR	<input type="checkbox"/> Override Depths
Length of a Unit Grate	N/A	N/A	feet
Width of a Unit Grate	N/A	N/A	feet
Open Area Ratio for a Grate (typical values 0.15-0.90)	N/A	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	N/A	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)	N/A	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)	N/A	N/A	
<u>Curb Opening Information</u>	MINOR	MAJOR	
Length of a Unit Curb Opening	5.00	5.00	feet
Height of Vertical Curb Opening in Inches	6.00	6.00	inches
Height of Curb Orifice Throat in Inches	6.00	6.00	inches
Angle of Throat	63.40	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)	2.00	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)	0.10	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)	3.60	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	0.67	0.67	
<u>Low Head Performance Reduction (Calculated)</u>	MINOR	MAJOR	
Depth for Grate Midwidth	N/A	N/A	ft
Depth for Curb Opening Weir Equation	0.33	0.64	ft
Grated Inlet Performance Reduction Factor for Long Inlets	N/A	N/A	
Curb Opening Performance Reduction Factor for Long Inlets	1.00	1.00	
Combination Inlet Performance Reduction Factor for Long Inlets	N/A	N/A	
Total Inlet Interception Capacity (assumes clogged condition)	5.4	11.0	cfs
Inlet Capacity IS GOOD for Minor and Major Storms (>Q Peak)	4.7	9.4	cfs

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project: Cathedral Rock Church


Inlet ID: Inlet A2

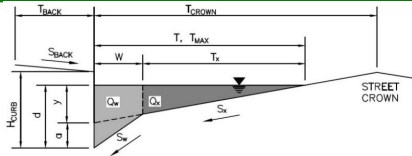

Gutter Geometry:						
Maximum Allowable Width for Spread Behind Curb	$T_{BACK} = 4.0$ ft					
Side Slope Behind Curb (leave blank for no conveyance credit behind curb)	$S_{BACK} = 0.020$ ft/ft					
Manning's Roughness Behind Curb (typically between 0.012 and 0.020)	$n_{BACK} = 0.020$					
Height of Curb at Gutter Flow Line	$H_{CURB} = 6.00$ inches					
Distance from Curb Face to Street Crown	$T_{CROWN} = 36.0$ ft					
Gutter Width	$W = 2.00$ ft					
Street Transverse Slope	$S_X = 0.022$ ft/ft					
Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)	$S_W = 0.083$ ft/ft					
Street Longitudinal Slope - Enter 0 for sump condition	$S_O = 0.000$ ft/ft					
Manning's Roughness for Street Section (typically between 0.012 and 0.020)	$n_{STREET} = 0.016$					
Max. Allowable Spread for Minor & Major Storm	<table border="1" style="display: inline-table; border-collapse: collapse;"> <tr> <td style="text-align: center;">Minor Storm</td> <td style="text-align: center;">Major Storm</td> <td rowspan="2" style="text-align: right;">ft</td> </tr> <tr> <td style="text-align: center;">$T_{MAX} = 36.0$</td> <td style="text-align: center;">36.0</td> </tr> </table>	Minor Storm	Major Storm	ft	$T_{MAX} = 36.0$	36.0
Minor Storm	Major Storm	ft				
$T_{MAX} = 36.0$	36.0					
Max. Allowable Depth at Gutter Flowline for Minor & Major Storm	<table border="1" style="display: inline-table; border-collapse: collapse;"> <tr> <td style="text-align: center;">Minor Storm</td> <td style="text-align: center;">Major Storm</td> <td rowspan="2" style="text-align: right;">inches</td> </tr> <tr> <td style="text-align: center;">$d_{MAX} = 6.0$</td> <td style="text-align: center;">12.0</td> </tr> </table>	Minor Storm	Major Storm	inches	$d_{MAX} = 6.0$	12.0
Minor Storm	Major Storm	inches				
$d_{MAX} = 6.0$	12.0					
Check boxes are not applicable in SUMP conditions	<input type="checkbox"/> <input type="checkbox"/>					
MINOR STORM Allowable Capacity is not applicable to Sump Condition						
MAJOR STORM Allowable Capacity is not applicable to Sump Condition						
Q_{allow} =	<table border="1" style="display: inline-table; border-collapse: collapse;"> <tr> <td style="text-align: center;">Minor Storm</td> <td style="text-align: center;">Major Storm</td> <td rowspan="2" style="text-align: right;">cfs</td> </tr> <tr> <td style="text-align: center;">SUMP</td> <td style="text-align: center;">SUMP</td> </tr> </table>	Minor Storm	Major Storm	cfs	SUMP	SUMP
Minor Storm	Major Storm	cfs				
SUMP	SUMP					

INLET IN A SUMP OR SAG LOCATION

MHFD-Inlet, Version 5.03 (August 2023)

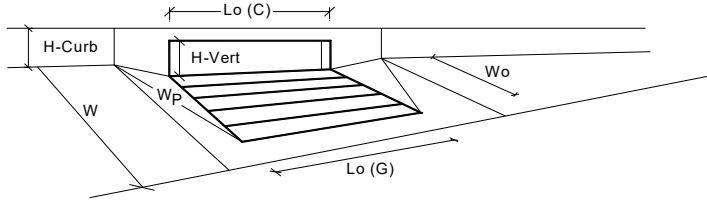

Design Information (Input)	MINOR MAJOR	
Type of Inlet	CDOT Type R Curb Opening	
Local Depression (additional to continuous gutter depression 'a' from above)	3.00	3.00
Number of Unit Inlets (Grate or Curb Opening)	1	1
Water Depth at Flowline (outside of local depression)	6.0	11.0
Grate Information	MINOR	MAJOR
Length of a Unit Grate	N/A	N/A
Width of a Unit Grate	N/A	N/A
Open Area Ratio for a Grate (typical values 0.15-0.90)	N/A	N/A
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	N/A	N/A
Grate Weir Coefficient (typical value 2.15 - 3.60)	N/A	N/A
Grate Orifice Coefficient (typical value 0.60 - 0.80)	N/A	N/A
Curb Opening Information	MINOR	MAJOR
Length of a Unit Curb Opening	5.00	5.00
Height of Vertical Curb Opening in Inches	6.00	6.00
Height of Curb Orifice Throat in Inches	6.00	6.00
Angle of Throat	63.40	63.40
Side Width for Depression Pan (typically the gutter width of 2 feet)	2.00	2.00
Clogging Factor for a Single Curb Opening (typical value 0.10)	0.10	0.10
Curb Opening Weir Coefficient (typical value 2.3-3.7)	3.60	3.60
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	0.67	0.67
Low Head Performance Reduction (Calculated)	MINOR	MAJOR
Depth for Grate Midwidth	N/A	N/A
Depth for Curb Opening Weir Equation	0.33	0.75
Grated Inlet Performance Reduction Factor for Long Inlets	N/A	N/A
Curb Opening Performance Reduction Factor for Long Inlets	1.00	1.00
Combination Inlet Performance Reduction Factor for Long Inlets	N/A	N/A
Total Inlet Interception Capacity (assumes clogged condition)	5.4	11.7
Inlet Capacity IS GOOD for Minor and Major Storms (>Q Peak)	2.6	5.3

**CATHEDRAL ROCK CHURCH
STORM SEWER SIZING SUMMARY**

PIPE FLOW				PIPE CAPACITY		
PIPE	DESIGN POINT	Q5 FLOW (CFS)	Q100 FLOW (CFS)	PIPE SIZE	MIN. PIPE SLOPE	PIPE CAPACITY (CFS)
A1.0	A1.0	1.2	2.3	12	1.0%	3.6
A1.1	A1.0-A1.1	3.2	6.2	12	3.0%	6.2
A1.2	A1.0-A1.2	7.9	15.6	18	2.3%	15.9
A2	A1.0-A2	10.5	20.9	18	4.0%	21.0

ASSUMPTIONS:

1. STORM DRAIN PIPE ASSUMED TO BE RCP OR HDPE

Hydraulic Analysis Report

Project Data

Project Title: Project - Cathedral Rock Church
Designer: JPS
Project Date: Monday, September 16, 2024
Project Units: U.S. Customary Units
Notes:

Channel Analysis: SD-A1.0

Notes:

Input Parameters

Channel Type: Circular
Pipe Diameter: 1.0000 ft
Longitudinal Slope: 0.0100 ft/ft
Manning's n: 0.0130
Depth: 1.0000 ft

Result Parameters

Flow: 3.5628 cfs
Area of Flow: 0.7854 ft²
Wetted Perimeter: 3.1416 ft
Hydraulic Radius: 0.2500 ft
Average Velocity: 4.5363 ft/s
Top Width: 0.0000 ft
Froude Number: 0.0000
Critical Depth: 0.8057 ft
Critical Velocity: 5.2542 ft/s
Critical Slope: 0.0103 ft/ft
Critical Top Width: 0.79 ft
Calculated Max Shear Stress: 0.6240 lb/ft²
Calculated Avg Shear Stress: 0.1560 lb/ft²

Channel Analysis: SD-A1.1

Notes:

Input Parameters

Channel Type: Circular
Pipe Diameter: 1.0000 ft
Longitudinal Slope: 0.0300 ft/ft
Manning's n: 0.0130
Depth: 1.0000 ft

Result Parameters

Flow: 6.1710 cfs
Area of Flow: 0.7854 ft²
Wetted Perimeter: 3.1416 ft
Hydraulic Radius: 0.2500 ft
Average Velocity: 7.8571 ft/s
Top Width: 0.0000 ft
Froude Number: 0.0000
Critical Depth: 0.9597 ft
Critical Velocity: 7.9651 ft/s
Critical Slope: 0.0261 ft/ft
Critical Top Width: 0.39 ft
Calculated Max Shear Stress: 1.8720 lb/ft²
Calculated Avg Shear Stress: 0.4680 lb/ft²

Channel Analysis: SD-A1.2

Notes:

Input Parameters

Channel Type: Circular
Pipe Diameter: 1.5000 ft
Longitudinal Slope: 0.0230 ft/ft
Manning's n: 0.0130
Depth: 1.5000 ft

Result Parameters

Flow: 15.9306 cfs
Area of Flow: 1.7671 ft²
Wetted Perimeter: 4.7124 ft
Hydraulic Radius: 0.3750 ft
Average Velocity: 9.0149 ft/s
Top Width: 0.0000 ft
Froude Number: 0.0000
Critical Depth: 1.4235 ft
Critical Velocity: 9.1920 ft/s
Critical Slope: 0.0199 ft/ft
Critical Top Width: 0.66 ft
Calculated Max Shear Stress: 2.1528 lb/ft²
Calculated Avg Shear Stress: 0.5382 lb/ft²

Channel Analysis: SD-A2

Notes:

Input Parameters

Channel Type: Circular
Pipe Diameter: 1.5000 ft
Longitudinal Slope: 0.0400 ft/ft
Manning's n: 0.0130
Depth: 1.5000 ft

Result Parameters

Flow: 21.0087 cfs
Area of Flow: 1.7671 ft²
Wetted Perimeter: 4.7124 ft
Hydraulic Radius: 0.3750 ft
Average Velocity: 11.8885 ft/s
Top Width: 0.0000 ft
Froude Number: 0.0000
Critical Depth: 1.4731 ft
Critical Velocity: 11.9369 ft/s
Critical Slope: 0.0360 ft/ft
Critical Top Width: 0.40 ft
Calculated Max Shear Stress: 3.7440 lb/ft²
Calculated Avg Shear Stress: 0.9360 lb/ft²

APPENDIX D
RAIN GARDEN CALCULATIONS

CATHEDRAL ROCK CHURCH COMPOSITE IMPERVIOUS AREAS											
IMPERVIOUS AREAS											
BASIN	TOTAL AREA (AC)	(AC)	SUB-AREA 1 DEVELOPMENT/ COVER	PERCENT IMPERVIOUS	AREA (AC)	SUB-AREA 2 DEVELOPMENT/ COVER	PERCENT IMPERVIOUS	(AC)	SUB-AREA 3 DEVELOPMENT/ COVER	PERCENT IMPERVIOUS	WEIGHTED % IMP
OA1	0.05	0.00	SF RESIDENTIAL	40							40.000
A1	2.29	1.632	PAVED/IMPERVIOUS	100	0.66	LANDSCAPED	0.00				71.266
OA1,A1	2.34										70.598
OA2	0.40	0.00	SF RESIDENTIAL	40							40.000
A2	0.86	0.523	PAVED/IMPERVIOUS	100	0.34	LANDSCAPED	0.00				60.814
OA2,A2	1.26										54.206
OA1-OA2,A1-A2	3.60										64.861
A3	0.96	0.82	PAVED/IMPERVIOUS	100	0.14	LANDSCAPED	0.00				85.000
A1-A3	4.56										69.101
A4	0.23	0.00	PAVED/IMPERVIOUS	100	0.23	LANDSCAPED	0.00				0.000
A1-A4	4.79										65.783
OB1	0.13	0.00	SF RESIDENTIAL	40							40.000
B	0.74	0.00	PAVED/IMPERVIOUS	100	0.74	LANDSCAPED	0.00				0.000
OB1,B	0.87										5.977

Site Assessment

SCM Design, Version 4.00 (April 2024)

Designer: JPS
Company: JPS
Date: October 30, 2024
Project: Cathedral Rock Church - Rain Garden A
Location: Tract A, Struthers Ranch Filing No. 2

1. Physical Site Characteristics

- A) Total Site Area
- B) Describe any upstream offsite areas that drain onto site and downstream conveyance systems or overland flow paths.
- C) Describe any floodplain/floodway mapping, fluvial hazard zones, or geomorphic/geotechnical instabilities that may impact the site.
- D) Is the watershed anticipated to be in a phased development state for a number of years moving forward or are highly erosive soils present? Explain.
- E) List any vegetation assessments that have been conducted including wetland and aquatic resources delineations.
- F) List any assessments of habitat for threatened or endangered species and other regulated species.
- G) Describe any existing and/or proposed utility mapping for subsurface and/or above-ground utilities that may impact SCMs.
- H) Are there receiving water quality concerns such as TMDLs, 303(d) listings, or other pollutant reduction targets? Explain.
- I) Describe how community values including context, scale, materials, and user experience will be incorporated on site. See Chapter 4 for additional guidance.
- J) Will attenuation of the EURV and/or flood storage (e.g. FSD) be provided onsite?

Area = acres ft²

Site Assessment

SCM Design, Version 4.00 (April 2024)

Designer: JPS
Company: JPS
Date: October 30, 2024
Project: Cathedral Rock Church - Rain Garden A
Location: Tract A, Struthers Ranch Filing No. 2

<p>2. Opportunities for Step 1: Runoff Reduction</p> <p>A) Describe opportunities for runoff reduction measures that can be used on this site to potentially reduce WQCV requirements?</p> <p><u>Conserve Existing Amenities:</u> Identify portions of site that should be protected including mature trees, stream corridors, wetlands, and Type A/B soils with high infiltration potential.</p> <p><u>Minimize Impacts:</u> Creative site layout and constructing to minimum widths can reduce the extent of paved areas. Concentrate new impervious areas over Type C/D soils. Maintain natural drainage patterns and promote sheet flow.</p> <p><u>Minimize Directly Connected Impervious Areas (MDCIA):</u> Allow runoff from impervious areas to sheet flow through vegetation which slows runoff, promotes infiltration, reduces pollutant loads and helps mimic predevelopment hydrology.</p>	<p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p>							
<p>3. Suitability for Infiltration-Based SCMs</p> <p>A) What are the dominant Hydrologic Soil Groups (HSG) for the site?</p> <p>B) Provide a description of topsoil texture, agronomic properties, and geotechnical soil characterizations.</p> <p>C) Identify Site Constraints</p> <p style="margin-left: 20px;">i) Is subgrade depth to bedrock < 3 feet?</p> <p style="margin-left: 20px;">ii) Is subgrade depth to seasonal high groundwater table < 3 feet?</p> <p>D) Identify Site Risks</p> <p style="margin-left: 20px;">i) Are expansive/collapsible soils present?</p> <p style="margin-left: 20px;">ii) Are highly concentrated pollutant sources present (hotspot)?</p> <p style="margin-left: 20px;">iii) Is site located above contaminated soils or groundwater?</p> <p style="margin-left: 20px;">iv) Are steep slopes present in proposed SCM locations? (> 3H:1V)</p> <p style="margin-left: 20px;">v) Are there other concerns that indicate high risk for infiltration?</p> <p>E) Describe Exploratory Borings/Pits and Laboratory Tests (Sec. 4.2)</p> <p style="margin-left: 20px;">i) How many borings/pits were drilled/excavated?</p> <p style="margin-left: 20px;">ii) Depth of borings/pits below SCM (or proposed grade) surface?</p> <p style="margin-left: 40px;">iii) Describe laboratory tests performed on soil samples:</p> <p>F) Preliminary Infiltration System Recommendation</p> <p style="color: blue; font-style: italic; margin-top: 10px;"><i>This is a preliminary recommendation. Consult with a qualified geotechnical engineer when planning an infiltration-based SCM.</i></p>	<p style="text-align: right;">Type A and B Soils <i>Soils suitable for full infiltration</i></p> <p>_____</p> <p>_____</p> <p>_____</p> <table style="margin-left: auto; margin-right: auto;"><tr><td style="text-align: center; border: 1px solid black;">NO</td></tr><tr><td style="text-align: center; border: 1px solid black;">NO</td></tr></table> <table style="margin-left: auto; margin-right: auto;"><tr><td style="text-align: center; border: 1px solid black;">NO</td></tr><tr><td style="text-align: center; border: 1px solid black;">NO</td></tr><tr><td style="text-align: center; border: 1px solid black;">NO</td></tr><tr><td style="text-align: center; border: 1px solid black;">NO</td></tr><tr><td style="text-align: center; border: 1px solid black;">NO</td></tr></table> <p style="margin-left: 20px;">N_{Borings/Pits} = _____</p> <p style="margin-left: 20px;">D_{Borings/Pits} = _____ ft</p> <p>_____</p> <p>_____</p> <p style="text-align: right;">Full Infiltration Suitable Soils and Low Risk, must verify adequate subgrade infiltration rates.</p>	NO	NO	NO	NO	NO	NO	NO
NO								
NO								
NO								
NO								
NO								
NO								
NO								

Site Layout

SCM Design, Version 4.00 (April 2024)

Designer: JPS

Company: JPS

Date: October 30, 2024

Project: Cathedral Rock Church - Rain Garden A

Location: Tract A, Struthers Ranch Filing No. 2

SITE LAYOUT INFO (User Input in Blue Cells)

Water Quality Event (WQE) inches

Outfall ID	DP1											
Total Tributary Area (ft ²)	208,652											
Imperviousness (%)	65.8%											
MS4 Design Standard	WQCV											
SCM Type	BR											

Notes:

OUTFALL RESULTS

SCM Worksheet Name	BR_DP1											
Untreated Area (ft ³)	0											
Default WQCV (ft ³)	3,579											
WQCV Reduction (ft ³)	0											
Remaining WQCV (ft ³)	3,579											
WQCV Reduction (%)	0%											
Design WQCV of SCM (ft ³)	0											
Pollutant Removal (ft ³)	0											
Untreated WQCV (ft ³)	3,579											

TOTAL SITE RESULTS (Sums results from all Outfalls)

Total Site Area	208,652	ft ²	4.79	acres
Treated Area	208,652	ft ²	4.79	acres
Untreated Area	0	ft ²	0.00	acres
Total Site Imperviousness	65.8%	%		
Default WQCV	3,579	ft ³	0.082	acre-feet
Remaining WQCV	3,579	ft ³	0.082	acre-feet
WQCV Reduction	0%	%		
Design WQCV	0	ft ³	0.000	acre-feet
Untreated WQCV	3,579	ft ³	0.082	acre-feet

Bioretention System (BR)

SCM Design, Version 4.00 (April 2024)

Designer: JPS
Company: JPS
Date: October 30, 2024
Project: Cathedral Rock Church - Rain Garden A
Location: Tract A, Struthers Ranch Filing No. 2
Outfall ID: DP1

1. Subsurface Exploration and Infiltration System Selection

A) Identify Site Constraints

- i) Is subgrade depth to bedrock < 3 feet?
- ii) Is subgrade depth to seasonal high groundwater table < 3 feet?

B) Identify Site Risks

- i) Are expansive/collapsible soils present?
- ii) Are highly concentrated pollutant sources present (hotspot)?
- iii) Is site located above contaminated soils or groundwater?
- iv) Is SCM located at top of steep slope? (> 3H:1V)
- v) Is SCM located adjacent to building, hardscape, or pavement?
- vi) Is SCM located above building foundation wall backfill?
- vii) Are there other concerns that indicate high risk for infiltration?

Provide protective measures

C) Preliminary Infiltration/Percolation Tests of underlying soils

- i) Were preliminary infiltration/percolation tests conducted?
- ii) Preliminary estimate of infiltration rate

$F_{prelim} =$ in/hr

D) Final Design Infiltrometer Test

- i) Were infiltrometer tests conducted?
- ii) Select type of infiltrometer test performed:
- iii) How many locations were tested?
- iv) Describe test locations relative to borings/pits

$N_{tests} =$

- v) What was the maximum infiltration rate tested?
- vi) What was the minimum infiltration rate tested?
- vii) Design Infiltration Rate

$F_{Max} =$ in/hr
 $F_{Min} =$ in/hr
 $F_{Design} =$ in/hr

E) Recommended Infiltration System

Please provide estimated infiltration rates to get a recommended infiltration system.

F) Select Infiltration System to use for Design

Bioretention System (BR)

SCM Design, Version 4.00 (April 2024)

Designer: JPS
Company: JPS
Date: October 30, 2024
Project: Cathedral Rock Church - Rain Garden A
Location: Tract A, Struthers Ranch Filing No. 2
Outfall ID: DP1

2. Inlet Design and Pretreatment

A) Is RPA (GB/GS) used for Runoff Reduction upstream of SCM?

NO

Define inflow points for all areas tributary to the SCM below.

B) Inflow Points contributing to SCM (max 8)

Inflow Design Point ID	A4						
Tributary Area to Inflow Point (ft ²)	208,652						
Imperviousness above Inflow Point (%)	65.8%						
Default WQCV for Inflow Point (ft ³)	3,579						
WQCV Reduction above Inflow Point (ft ³)	0						
Remaining WQCV at Inflow Point (ft ³)	3,579						
Will pretreatment be provided with a Sedimentation MTD (HDS)	NO						
Paired Pretreatment HDS Worksheet Name	--						
Sheet or Concentrated Flow	Conc						

C) Sheet Flow

Select sheet flow inflow feature	--						
Is Concrete Edger used?	--						
Spacing between slots, recommend ≤ 2 ft on center (ft)	--						
Slot Opening Length, recommend 1.5 (in)	--						
Select type of blind swale used to distribute flow	--						
Select energy dissipation method for level spreader	--						
Height of drop, recommend 2 to 3 (in)	--						
Is concrete mowing strip provided to facilitate maintenance?	--						

D) Concentrated Flow

Select concentrated flow inflow feature	Pipe						
Is downspout extension needed to bridge backfill zone?	--						
Depth of gutter flow line depression for curb opening, recommend 3 (in)	--						
Curb opening inlet width (ft)	--						
Height of drop to sediment pad/forebay, recommend ≥ 1 (in)	--						
Select energy dissipation method for downspouts and/or curb openings.	--						
Select energy dissipation method for swales, channels, and piped outfalls	Other						

v) Forebay

Impervious area tributary to concentrated inflow location (ft ²)	137,293						
Forebay Type (Concrete Sediment Pad sufficient for Imp Area ≤ 2 acre)	Forebay						
Minimum Forebay Volume (ft ³)	36						
Design Forebay Volume (ft ³)	96						
Maximum Forebay Depth (in)	15.00						
Design Forebay Depth (in)	12.00						
Rectangular Weir Notch Width to Empty Forebay in 5-minutes (in)	1.10						
Design Notch Width (in)	1.10						
Forebay Drain Time (minutes)	5.0						

Provide pretreatment to remove coarse sediment, trash and debris. This is especially critical for roadway runoff to bioretention systems.

PROPOSED FOREBAY
 VOLUME:
 = (12'L x 8'W x 12" DEEP)
 = 96 CF = 0.0022 AF

Bioretention System (BR)

SCM Design, Version 4.00 (April 2024)

Designer: JPS
Company: JPS
Date: October 30, 2024
Project: Cathedral Rock Church - Rain Garden A
Location: Tract A, Struthers Ranch Filing No. 2
Outfall ID: DP1

<p>3. Design Storage Volume</p> <p>A) Contributing Watershed Area (including bioretention area)</p> <p>B) Imperviousness of Tributary Area</p> <p>C) Default WQCV</p> <p>D) WQCV Reduction resulting from Upstream RPA (GB/GS)</p> <p>E) Remaining WQCV</p>	<p style="text-align: center; color: blue;">Inflow Points above should be fully defined before proceeding below</p> <p>Area = <input style="width: 100px;" type="text" value="208,652"/> ft²</p> <p>i = <input style="width: 100px;" type="text" value="65.8%"/> %</p> <p>V_{WQCV Default} = <input style="width: 100px;" type="text" value="3,579"/> ft³</p> <p>WQCV Reduction = <input style="width: 100px;" type="text" value="0"/> ft³</p> <p>V_{WQCV Remaining} = <input style="width: 100px;" type="text" value="3,579"/> ft³</p>
<p>4. Bioretention System Basin Geometry</p> <p>A) Mimimum Filter Media Surface Area</p> <p>B) Design Filter Media Surface Area</p> <p>C) WQCV Ponding Depth (recommend max. 12-inch)</p> <p>D) Media Surface Slope (typically flat or mild slope < 0.01 ft/ft)</p> <p>E) Max. Side Slope (Z = 4:1 or flatter, horiz. dist per unit vertical) (Use "0" if bioretention has vertical walls)</p> <p>F) Media Surface Length-to-Width Ratio</p> <p>G) Calculated WQCV (based on A_{F Design}, D_{WQCV}, and Z)</p> <p>H) Design WQCV (based on actual design geometry)</p> <p>I) If basin geometry is irregular, design volume differs, or media pore space is being utilized, please provide description.</p>	<p>A_{F Min} = <input style="width: 100px;" type="text" value="2,746"/> ft²</p> <p>A_{F Design} = <input style="width: 100px;" type="text" value="2,829"/> ft²</p> <p>D_{WQCV} = <input style="width: 100px;" type="text" value="12.00"/> in</p> <p>S_{Surface} = <input style="width: 100px;" type="text" value="0.000"/> ft / ft</p> <p>Z = <input style="width: 100px;" type="text" value="4.00"/> ft / ft</p> <p>R_{LW} = <input style="width: 100px;" type="text" value="15"/></p> <p>V_{WQCV Calculated} = <input style="width: 100px;" type="text" value="3,740"/> ft³</p> <p>V_{WQCV Design} = <input style="width: 100px;" type="text" value="3,817"/> ft³</p> <p style="text-align: right; color: blue;">Explain difference from Calculated WQCV</p> <p>_____</p> <p>_____</p> <p>_____</p>

Bioretention System (BR)

SCM Design, Version 4.00 (April 2024)

Designer: JPS
Company: JPS
Date: October 30, 2024
Project: Cathedral Rock Church - Rain Garden A
Location: Tract A, Struthers Ranch Filing No. 2
Outfall ID: DP1

5. Underdrain System, Impermeable Liner, and Geotextile

A) Are underdrains provided?

YES

B) Is a Drain Trench provided consistent with Figure 4-2?

YES

- Trench Bottom Width \geq 12 inches, Trench Depth \geq 15 inches
- Drain gravel satisfies gradation specifications for AASHTO M 43 No. 8 coarse aggregate
- Filter sand above drain gravel satisfies gradation specifications for AASHTO M 43 fine aggregate
- Filter sand depth above drain trench \geq 6 inches
- Filter sand extends \geq 12 inches beyond trench top width

C) Select Factory-Slotted Pipe Size and Material

4-inch (ID), Sch 40 PVC

D) Does the specified pipe material meet the specifications for slot configurations shown in Table 4-6 and Figure 4-3.

YES

E) Are cleanouts provided for inspection and maintenance?

YES

F) Is an impermeable geomembrane liner provided?

NO

G) Are details provided regarding sealing at underdrain penetrations similar to Figure 4-6?

H) Are geomembrane connections to vertical concrete surfaces consistent with Figure 4-7?

I) Do the plans specify thermal welding and air lance testing of joints?

6. Bioretention Media

A) Depth of Media (18-inch minimum, 36-inch when trees planted)

$D_{Media} = 24.00$ in

B) Do construction documents specify media testing requirements?

YES

Analyze gradation and nutrient content of media after delivery to the site and preferably, prior to placement.

Bioretention System (BR)

SCM Design, Version 4.00 (April 2024)

Designer: JPS
Company: JPS
Date: October 30, 2024
Project: Cathedral Rock Church - Rain Garden A
Location: Tract A, Struthers Ranch Filing No. 2
Outfall ID: DP1


<p>7. Vegetation</p> <p>A) Select the method of vegetation planting (pull-down list). Consult with vegetation specialist to consider shade, heat island effects, application of deicers in the watershed, and other site-specific factors.</p> <p><i>Table BR-4 provides suggested Native Seed Mix</i></p> <p>B) Has a landscape/vegetation management plan been developed?</p> <p>C) Describe vegetation/landscaping considerations:</p> <ul style="list-style-type: none"> - Stability issues (steep slopes, high erosion potential)? - Topsoil management (assessment, stockpiling, and placement)? - Community benefits with place-making approach? - Biodiversity of the site including pollinator species? - Environmental stewardship through conservation? - Inundation frequency and depth impacts on vegetation? - Required maintenance activities and intervals? 	<div style="border: 1px solid black; padding: 2px; display: inline-block; margin-bottom: 10px;">Sod-forming native grasses from seed</div> <p style="color: blue; font-size: small;"><i>Typically costs less than container grown plants but more susceptible to being washed away during establishment.</i></p> <hr/> <hr/> <hr/> <hr/> <div style="border: 1px solid black; display: inline-block; padding: 2px 10px; margin: 10px 0;">YES</div> <p>Per Landscape Plans</p> <hr/> <hr/> <hr/> <hr/>
<p>8. Irrigation</p> <p>A) How will irrigation be provided for vegetation establishment?</p> <p><i>Place temporary irrigation on top of the bioretention media surface. Remove irrigation pipes once vegetation is established to avoid it being buried over time.</i></p>	<div style="border: 1px solid black; display: inline-block; padding: 2px 10px; margin-bottom: 10px;">Temporary</div> <hr/> <hr/> <hr/>
<p>9. Outlet</p> <p>A) Underdrain Orifice Diameter for 12-hour drain time</p> <p>i) Underdrain Orifice Invert Depth (distance from filter media surface to orifice invert)</p> <p>ii) Calculated Underdrain Orifice Diameter Simplified Equation (when not using MHFD-Detention) MHFD-Detention Calculation (if used)</p> <p>iii) Underdrain Orifice Diameter specified on construction plans</p> <p>B) Describe Underdrain Orifice Outlet Configuration. <i>Consider adding Internal Water Storage (IWS) zone as described in the upfront section of Chapter 4. This can reduce nutrient loading from outflows.</i></p> <p>C) Describe Outlet Structure(s) for events larger than WQCV. (full-spectrum detention, overflow spillway, etc.)</p>	<p>y = 24.0 in</p> <p>Dia. Simplified = 1.43 in Dia. MHFD-Detention = 1.42 in</p> <p>Orifice Dia. Design = 1.42 in</p> <hr/> <hr/> <hr/> <hr/> <p>Overflow Spillway (Buried Riprap)</p> <hr/> <hr/> <hr/>
<p>Notes: _____</p> <hr/> <hr/> <hr/>	

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD- Detention, Version 4.06 (July 2022)

Project: Cathedral Rock Church

Basin ID: Rain Garden A

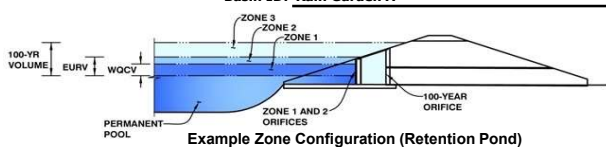

Watershed Information

Selected BMP Type =	RG
Watershed Area =	4.79 acres
Watershed Length =	750 ft
Watershed Length to Centroid =	325 ft
Watershed Slope =	0.035 ft/ft
Watershed Imperviousness =	65.80% percent
Percentage Hydrologic Soil Group A =	0.0% percent
Percentage Hydrologic Soil Group B =	100.0% percent
Percentage Hydrologic Soil Groups C/D =	0.0% percent
Target WQCV Drain Time =	12.0 hours
Location for 1-hr Rainfall Depths =	User Input

After providing required inputs above including 1-hour rainfall depths, click 'Run CUHP' to generate runoff hydrographs using the embedded Colorado Urban Hydrograph Procedure.

Water Quality Capture Volume (WQCV) =	0.082	acre-feet	Optional User Overrides	
Excess Urban Runoff Volume (EURV) =	0.344	acre-feet		
2-yr Runoff Volume (P1 = 1.19 in.) =	0.300	acre-feet	1.19	inches
5-yr Runoff Volume (P1 = 1.5 in.) =	0.409	acre-feet	1.50	inches
10-yr Runoff Volume (P1 = 1.75 in.) =	0.501	acre-feet	1.75	inches
25-yr Runoff Volume (P1 = 2 in.) =	0.613	acre-feet	2.00	inches
50-yr Runoff Volume (P1 = 2.25 in.) =	0.710	acre-feet	2.25	inches
100-yr Runoff Volume (P1 = 2.52 in.) =	0.828	acre-feet	2.52	inches
500-yr Runoff Volume (P1 = 3.14 in.) =	1.075	acre-feet	3.14	inches
Approximate 2-yr Detention Volume =	0.267	acre-feet		
Approximate 5-yr Detention Volume =	0.358	acre-feet		
Approximate 10-yr Detention Volume =	0.456	acre-feet		
Approximate 25-yr Detention Volume =	0.491	acre-feet		
Approximate 50-yr Detention Volume =	0.511	acre-feet		
Approximate 100-yr Detention Volume =	0.552	acre-feet		

Define Zones and Basin Geometry

Zone 1 Volume (WQCV) =	0.082	acre-feet
Select Zone 2 Storage Volume (Optional) =		acre-feet
Select Zone 3 Storage Volume (Optional) =		acre-feet
Total Detention Basin Volume =	0.082	acre-feet


Total detention volume is less than 100-year volume.

Stage - Storage Description	Stage (ft)	Optional Override Stage (ft)	Length (ft)	Width (ft)	Area (ft ²)	Optional Override Area (ft ²)	Area (acre)	Volume (ft ³)	Volume (ac-ft)
Media Surface	--	0.00	--	--	--	2,829	0.065		
RG WSL=6758.0	--	1.00	--	--	--	4,804	0.110	3,816	0.088
Top EL=6760.0	--	2.00	--	--	--	6,779	0.156	9,608	0.221
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				
	--		--	--	--				

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.06 (July 2022)

Project: Cathedral Rock Church
Basin ID: Rain Garden A

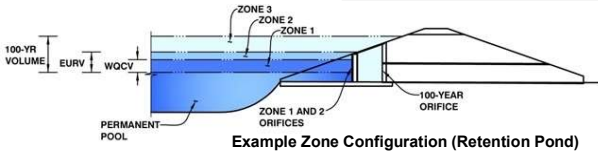

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	0.95	0.082	Filtration Media
Zone 2			
Zone 3			
Total (all zones)		0.082	

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth = 2.00 ft (distance below the filtration media surface)
 Underdrain Orifice Diameter = 1.42 inches

Calculated Parameters for Underdrain
 Underdrain Orifice Area = 0.0 ft²
 Underdrain Orifice Centroid = 0.06 feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Centroid of Lowest Orifice = _____ ft (relative to basin bottom at Stage = 0 ft)
 Depth at top of Zone using Orifice Plate = _____ ft (relative to basin bottom at Stage = 0 ft)
 Orifice Plate: Orifice Vertical Spacing = _____ inches
 Orifice Plate: Orifice Area per Row = _____ sq. inches

Calculated Parameters for Plate
 WQ Orifice Area per Row = N/A ft²
 Elliptical Half-Width = N/A feet
 Elliptical Slot Centroid = N/A feet
 Elliptical Slot Area = N/A ft²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (optional)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								
	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

Invert of Vertical Orifice = Not Selected Not Selected ft (relative to basin bottom at Stage = 0 ft)
 Depth at top of Zone using Vertical Orifice = _____ ft (relative to basin bottom at Stage = 0 ft)
 Vertical Orifice Diameter = _____ inches

Calculated Parameters for Vertical Orifice
 Vertical Orifice Area = Not Selected Not Selected ft²
 Vertical Orifice Centroid = _____ feet

User Input: Overflow Weir (Dropbox with Flat or Sloped Grate and Outlet Pipe OR Rectangular/Trapezoidal Weir and No Outlet Pipe)

Overflow Weir Front Edge Height, H_o = Not Selected Not Selected ft (relative to basin bottom at Stage = 0 ft)
 Overflow Weir Front Edge Length = 4.00 feet
 Overflow Weir Grate Slope = 0.00 H:V
 Horiz. Length of Weir Sides = 2.50 feet
 Overflow Grate Type = Type C Grate
 Debris Clogging % = 50% %

Calculated Parameters for Overflow Weir
 Height of Grate Upper Edge, H_u = 1.00 feet
 Overflow Weir Slope Length = 2.50 feet
 Grate Open Area / 100-yr Orifice Area = 2.22
 Overflow Grate Open Area w/o Debris = 6.96 ft²
 Overflow Grate Open Area w/ Debris = 3.48 ft²

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

Depth to Invert of Outlet Pipe = 2.10 ft (distance below basin bottom at Stage = 0 ft)
 Circular Orifice Diameter = 24.00 inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate
 Outlet Orifice Area = 3.14 ft²
 Outlet Orifice Centroid = 1.00 feet
 Half-Central Angle of Restrictor Plate on Pipe = N/A radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage = 1.20 ft (relative to basin bottom at Stage = 0 ft)
 Spillway Crest Length = 5.00 feet
 Spillway End Slopes = 4.00 H:V
 Freeboard above Max Water Surface = 0.00 feet

Calculated Parameters for Spillway
 Spillway Design Flow Depth = 0.77 feet
 Stage at Top of Freeboard = 1.97 feet
 Basin Area at Top of Freeboard = 0.15 acres
 Basin Volume at Top of Freeboard = 0.22 acre-ft




Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	3.14
One-Hour Rainfall Depth (in)	N/A	N/A	0.300	0.409	0.501	0.613	0.710	0.828	1.075
CUHP Runoff Volume (acre-ft)	0.082	0.344	0.300	0.409	0.501	0.613	0.710	0.828	1.075
Inflow Hydrograph Volume (acre-ft)	N/A	N/A	0.300	0.409	0.501	0.613	0.710	0.828	1.075
CUHP Predevelopment Peak Q (cfs)	N/A	N/A	0.6	1.6	2.4	4.2	5.3	6.6	9.2
OPTIONAL Override Predevelopment Peak Q (cfs)	N/A	N/A							
Predevelopment Unit Peak Flow, q (cfs/acre)	N/A	N/A	0.12	0.33	0.49	0.88	1.10	1.37	1.91
Peak Inflow Q (cfs)	N/A	N/A	5.6	7.6	9.0	11.2	13.0	15.4	19.8
Peak Outflow Q (cfs)	0.1	34.4	3.6	5.8	7.3	10.6	12.4	14.7	19.4
Ratio Peak Outflow to Predevelopment Q	N/A	N/A	N/A	3.7	3.1	2.5	2.4	2.2	2.1
Structure Controlling Flow	Filtration Media	Overflow Weir 1	Spillway	Spillway	Spillway	Spillway	Spillway	Spillway	Spillway
Max Velocity through Grate 1 (fps)	N/A	0.16	0.45	0.6	0.8	1.1	1.2	1.4	1.8
Max Velocity through Grate 2 (fps)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours)	12	12	14	14	13	13	12	12	11
Time to Drain 99% of Inflow Volume (hours)	12	13	15	15	15	15	15	14	14
Maximum Ponding Depth (ft)	0.95	1.14	1.28	1.36	1.41	1.50	1.55	1.60	1.70
Area at Maximum Ponding Depth (acres)	0.11	0.12	0.12	0.13	0.13	0.13	0.13	0.14	0.14
Maximum Volume Stored (acre-ft)	0.082	0.102	0.119	0.130	0.137	0.148	0.154	0.162	0.175

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.06 (July 2022)

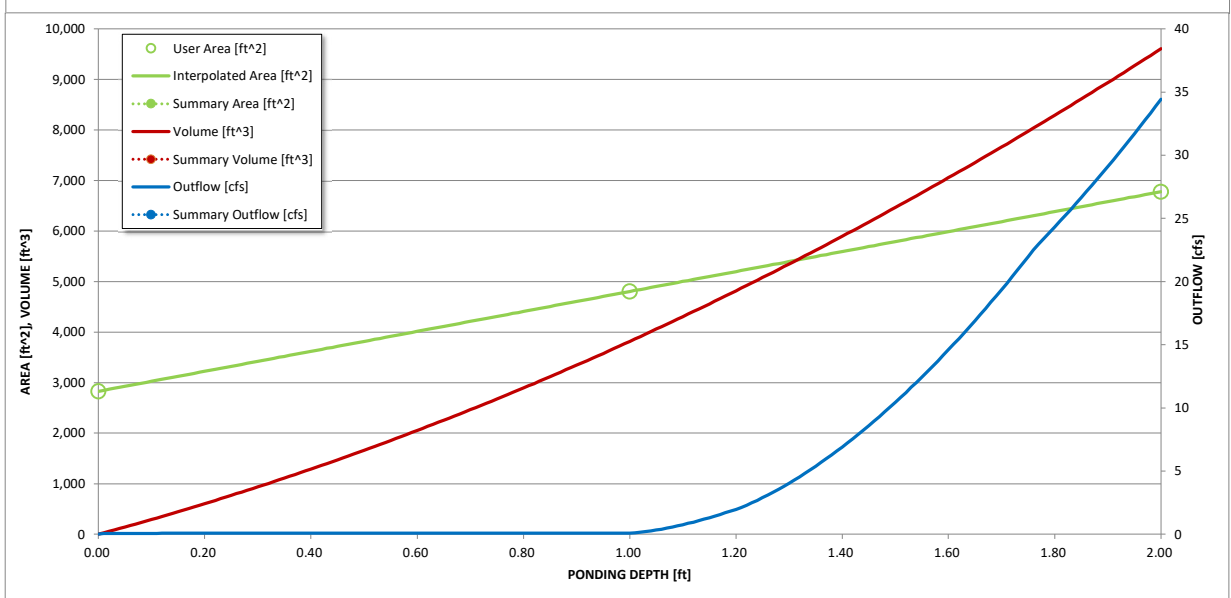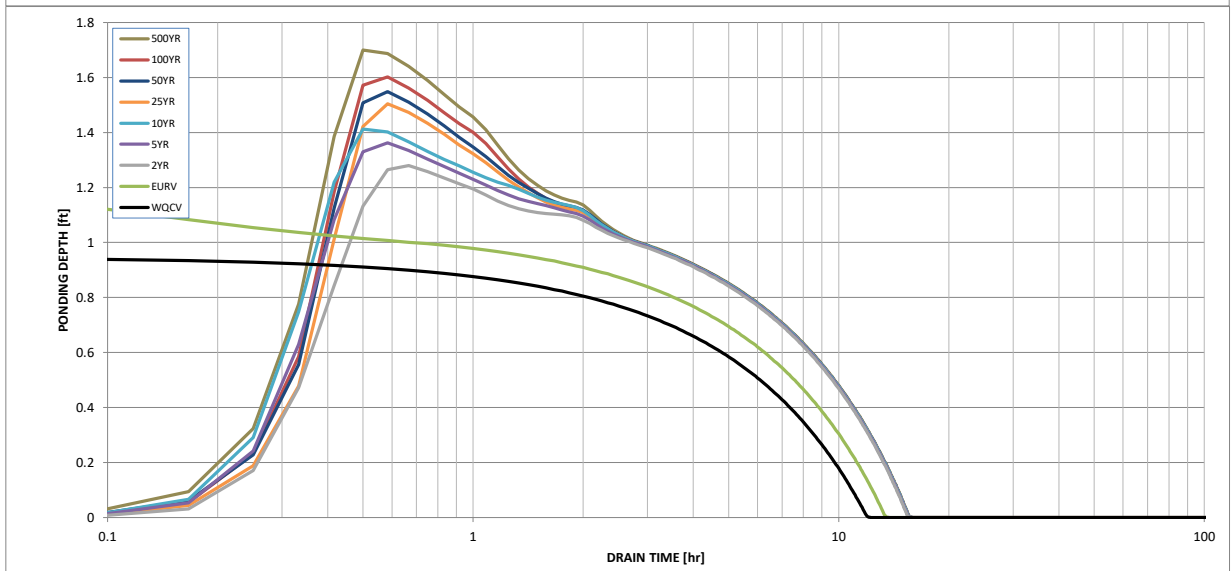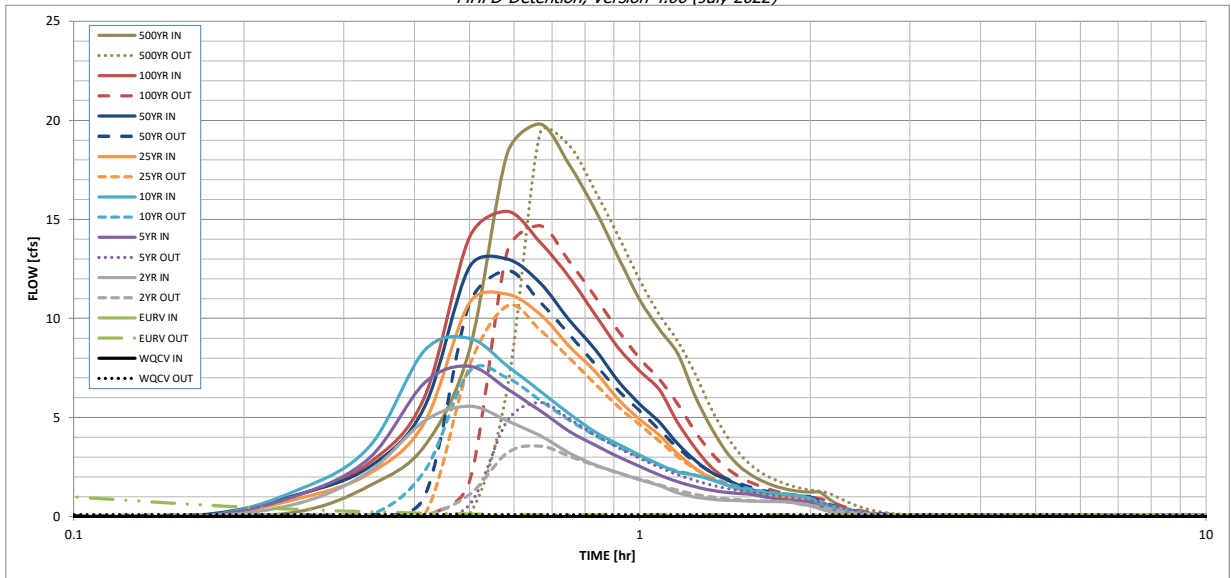

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename: _____

Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

Time Interval	SOURCE	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP
	TIME	WQCV [cfs]	EURV [cfs]	2 Year [cfs]	5 Year [cfs]	10 Year [cfs]	25 Year [cfs]	50 Year [cfs]	100 Year [cfs]	500 Year [cfs]
5.00 min	0:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.08	0.01
	0:15:00	0.00	0.00	0.67	1.10	1.36	0.91	1.13	1.11	1.55
	0:20:00	0.00	0.00	2.29	2.97	3.54	2.18	2.52	2.72	3.55
	0:25:00	0.00	0.00	4.83	6.74	8.38	4.74	5.52	6.01	8.41
	0:30:00	0.00	0.00	5.57	7.58	9.00	10.79	12.60	14.10	18.32
	0:35:00	0.00	0.00	4.83	6.44	7.61	11.22	12.99	15.40	19.81
	0:40:00	0.00	0.00	4.08	5.33	6.32	10.21	11.79	13.84	17.78
	0:45:00	0.00	0.00	3.22	4.31	5.19	8.60	9.93	12.10	15.50
	0:50:00	0.00	0.00	2.61	3.61	4.27	7.32	8.45	10.20	13.08
	0:55:00	0.00	0.00	2.20	3.02	3.64	5.91	6.83	8.52	10.94
	1:00:00	0.00	0.00	1.86	2.53	3.10	4.89	5.67	7.34	9.44
	1:05:00	0.00	0.00	1.55	2.10	2.62	4.10	4.76	6.38	8.21
	1:10:00	0.00	0.00	1.20	1.76	2.25	3.16	3.67	4.73	6.12
	1:15:00	0.00	0.00	0.99	1.51	2.09	2.45	2.85	3.48	4.56
	1:20:00	0.00	0.00	0.88	1.34	1.87	1.94	2.25	2.53	3.32
	1:25:00	0.00	0.00	0.82	1.23	1.60	1.62	1.89	1.93	2.54
	1:30:00	0.00	0.00	0.79	1.16	1.42	1.35	1.56	1.56	2.05
	1:35:00	0.00	0.00	0.77	1.11	1.29	1.17	1.34	1.31	1.72
	1:40:00	0.00	0.00	0.76	0.98	1.21	1.06	1.21	1.15	1.50
	1:45:00	0.00	0.00	0.75	0.89	1.14	0.98	1.11	1.04	1.35
	1:50:00	0.00	0.00	0.74	0.82	1.10	0.93	1.05	0.97	1.26
	1:55:00	0.00	0.00	0.63	0.77	1.03	0.90	1.02	0.95	1.23
	2:00:00	0.00	0.00	0.55	0.72	0.92	0.88	0.99	0.94	1.22
	2:05:00	0.00	0.00	0.38	0.49	0.63	0.61	0.68	0.65	0.84
	2:10:00	0.00	0.00	0.25	0.33	0.43	0.41	0.46	0.45	0.58
	2:15:00	0.00	0.00	0.17	0.22	0.29	0.28	0.31	0.30	0.39
	2:20:00	0.00	0.00	0.11	0.14	0.19	0.18	0.20	0.19	0.25
	2:25:00	0.00	0.00	0.07	0.09	0.12	0.12	0.13	0.12	0.16
	2:30:00	0.00	0.00	0.04	0.05	0.07	0.07	0.08	0.08	0.10
	2:35:00	0.00	0.00	0.02	0.03	0.03	0.04	0.04	0.04	0.05
	2:40:00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.02
	2:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
6:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	

Cathedral Rock Church Rain Garden A Spillway

Figure 13-12c. Emergency Spillway Protection


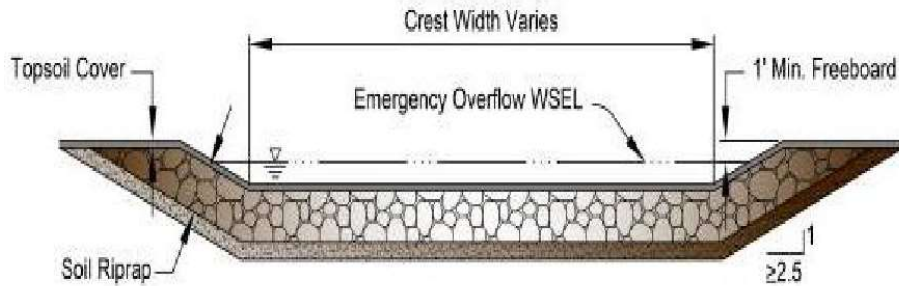


Figure 13-12d. Riprap Types for Emergency Spillway Protection

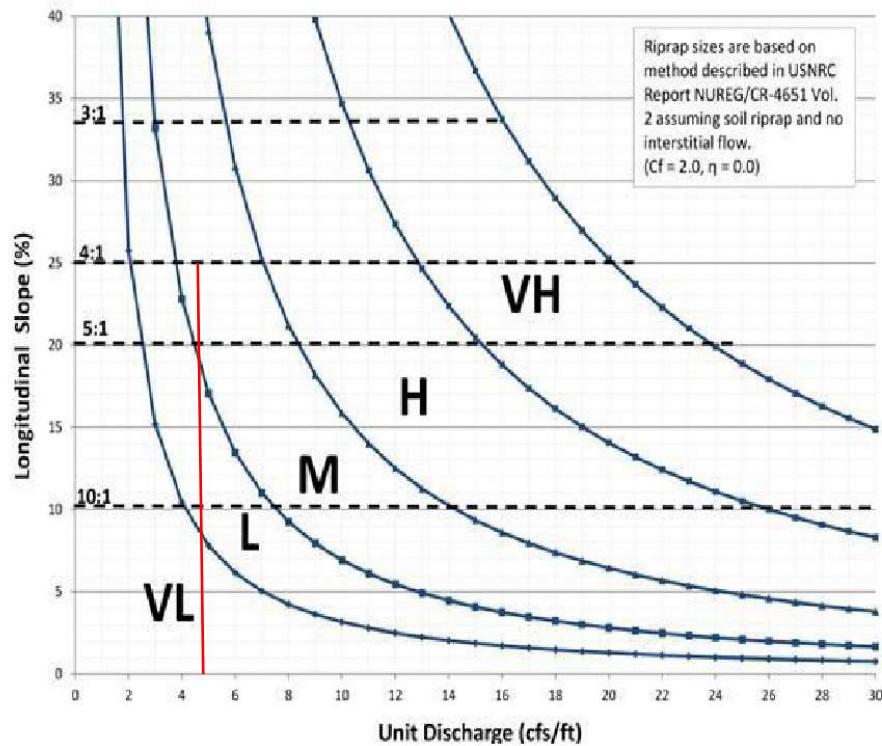

Spillway Q100 = 21.8 cfs (Undetained DP1)
 Unit Discharge = (21.8 cfs / 5 ft) = 4.4

Use Type M Riprap

APPENDIX E

RAIN GARDEN COST ESTIMATE

**CATHEDRAL ROCK CHURCH
TRACT A, STRUTHERS RANCH FILING NO. 2
ENGINEER'S COST ESTIMATE
DRAINAGE IMPROVEMENTS - WATER QUALITY RAIN GARDEN**

Item No.	Description	Quantity	Unit	Unit Cost (\$\$)	Total Cost (\$\$)
PRIVATE DRAINAGE FACILITIES (NON-REIMBURSABLE)					
	Earthwork	150	CY	\$5	\$750
	Aggregate Base Course (Access Ramp)	15	CY	\$66	\$990
	Rain Garden Infiltration Media	355	CY	\$20	\$7,100
	Concrete Forebay	1	LS	\$1,800	\$1,800
	24" RCP Outlet Pipe	5	LF	\$98	\$490
	Outlet Structure	1	LS	\$5,000	\$5,000
	Buried Soil Riprap Spillway	6	TN	\$104	\$624
	SUBTOTAL				\$16,754
	Engineering @ 10%				\$1,675
	Contingency @ 5%				\$838
	TOTAL (NON-REIMBURSABLE)				\$19,267
Note: This estimate does not include costs for street improvements and general civil costs (curb & gutter, crosspans, retaining walls, etc.)					

The cost estimate submitted herein is based on time-honored practices within the construction industry. As such the engineer does not control the cost of labor, materials, equipment or a contractor's method of determining prices and competitive bidding practices or market conditions. The estimate represents our best judgement as design professionals using current information available at the time of the preparation. The engineer cannot guarantee that proposals, bids and/or construction costs will not vary from this cost estimate.

APPENDIX F

FIGURES

National Flood Hazard Layer FIRMMette



104°50'52"W 39°2'56"N



Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

- | | | |
|------------------------------------|--|--|
| SPECIAL FLOOD HAZARD AREAS | | Without Base Flood Elevation (BFE)
<i>Zone A, V, A99</i> |
| | | With BFE or Depth <i>Zone AE, AO, AH, VE, AR</i> |
| | | Regulatory Floodway |
| OTHER AREAS OF FLOOD HAZARD | | 0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile <i>Zone X</i> |
| | | Future Conditions 1% Annual Chance Flood Hazard <i>Zone X</i> |
| | | Area with Reduced Flood Risk due to Levee. See Notes. <i>Zone X</i> |
| | | Area with Flood Risk due to Levee <i>Zone D</i> |
| OTHER AREAS | | NO SCREEN Area of Minimal Flood Hazard <i>Zone X</i> |
| | | Effective LOMRs |
| GENERAL STRUCTURES | | Area of Undetermined Flood Hazard <i>Zone D</i> |
| | | Channel, Culvert, or Storm Sewer |
| | | Levee, Dike, or Floodwall |
| OTHER FEATURES | | 20.2 Cross Sections with 1% Annual Chance Water Surface Elevation |
| | | 17.5 Water Surface Elevation |
| | | Coastal Transect |
| | | Base Flood Elevation Line (BFE) |
| | | Limit of Study |
| MAP PANELS | | Jurisdiction Boundary |
| | | Coastal Transect Baseline |
| | | Profile Baseline |
| | | Hydrographic Feature |
| | | Digital Data Available |
| | | No Digital Data Available |
| | | Unmapped |




The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on 9/20/2024 at 2:03 PM and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.




1:6,000

104°50'15"W 39°2'28"N

Basemap Imagery Source: USGS National Map 2023

LEGEND

- FILING LIMITS
- MAJOR BASIN BOUNDARY
- MINOR BASIN BOUNDARY
- 6520 --- EXISTING CONTOUR
- FLOWLINE
- ← PROPOSED FLOW DIRECTION ARROW
- PROPOSED DROP STRUCTURE
- ▲ DESIGN POINT
- ▲ Q_s (cfs)
▲ Q₁₀₀(cfs)
- BASIN DESIGNATION
- BASIN AREA (ACRES)


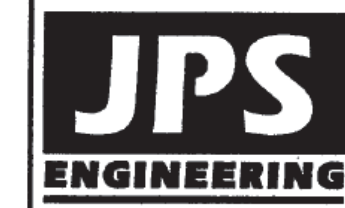


19 E. Willamette Ave.
Colorado Springs, CO
80903
PH: 719-477-9429
FAX: 719-471-0766

STRUTHERS RANCH SUBDIVISION

DEVELOPED DRAINAGE PLAN

NO.	REVISION	BY	DATE
1	EPC COMMENTS	JPS	4/8/04
2	EPC COMMENTS	JPS	5/7/04
3	EPC COMMENTS	JPS	5/25/04
4	EPC COMMENTS	JPS	9/2/04
5	RE-SUBMITTAL TO EPC	JPS	9/30/04

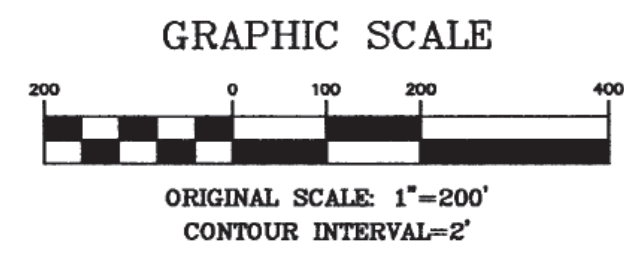
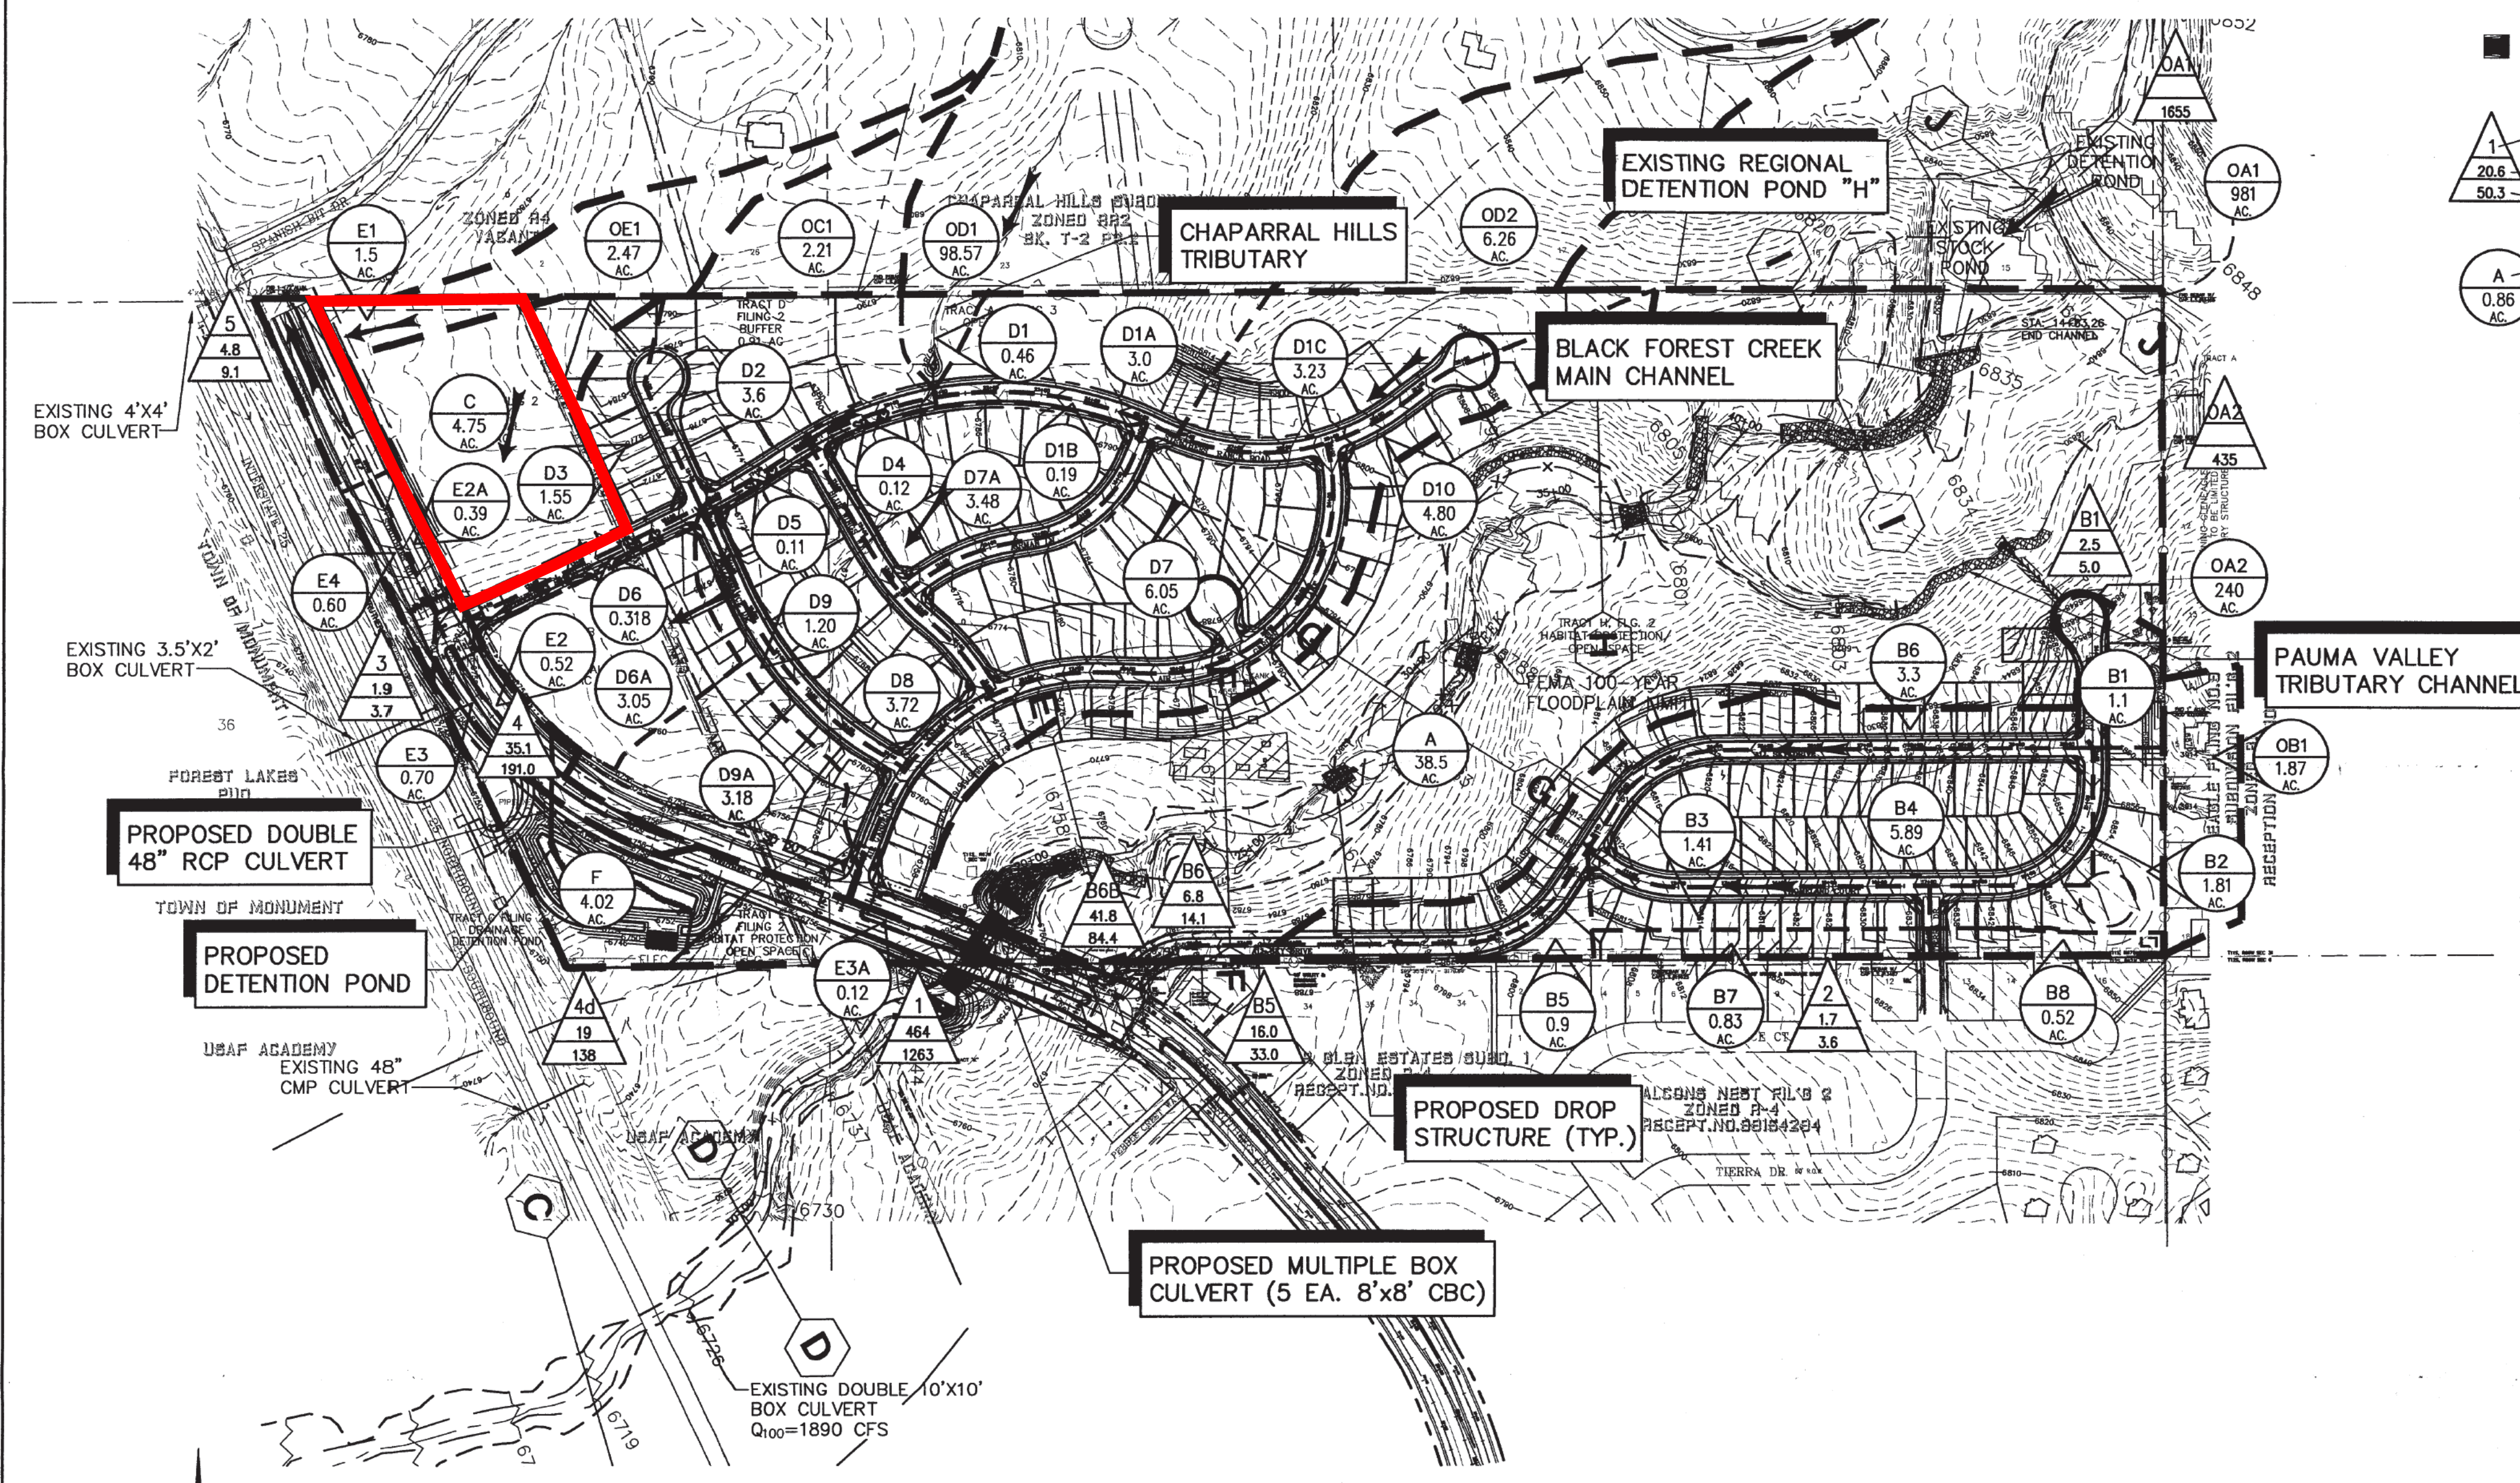


- NOTES:
- DEVELOPMENT SHALL FOLLOW ALL REQUIREMENTS OF THE APPROVED HABITAT CONSERVATION PLAN (HCP) AND ASSOCIATED ENVIRONMENTAL PERMITS.
 - PERIMETER DRAINS SHALL BE REQUIRED FOR ALL HOMES WITH BASEMENTS.

HORIZ. SCALE: 1"=200'	DRAWN: MJP
VERT. SCALE: N/A	DESIGNED: JPS
SURVEYED: PINNACLE	CHECKED: JPS
CREATED: 9/11/00	LAST MODIFIED: 10/15/04
PROJECT NO: 080006	MODIFIED BY: MJP

D1

J:\projects\080006\struthers\dwg\civil\01.dwg Oct 15, 2004 -- 12:12pm

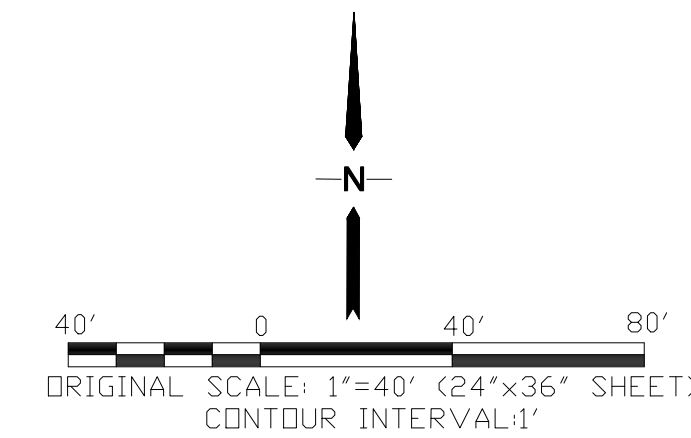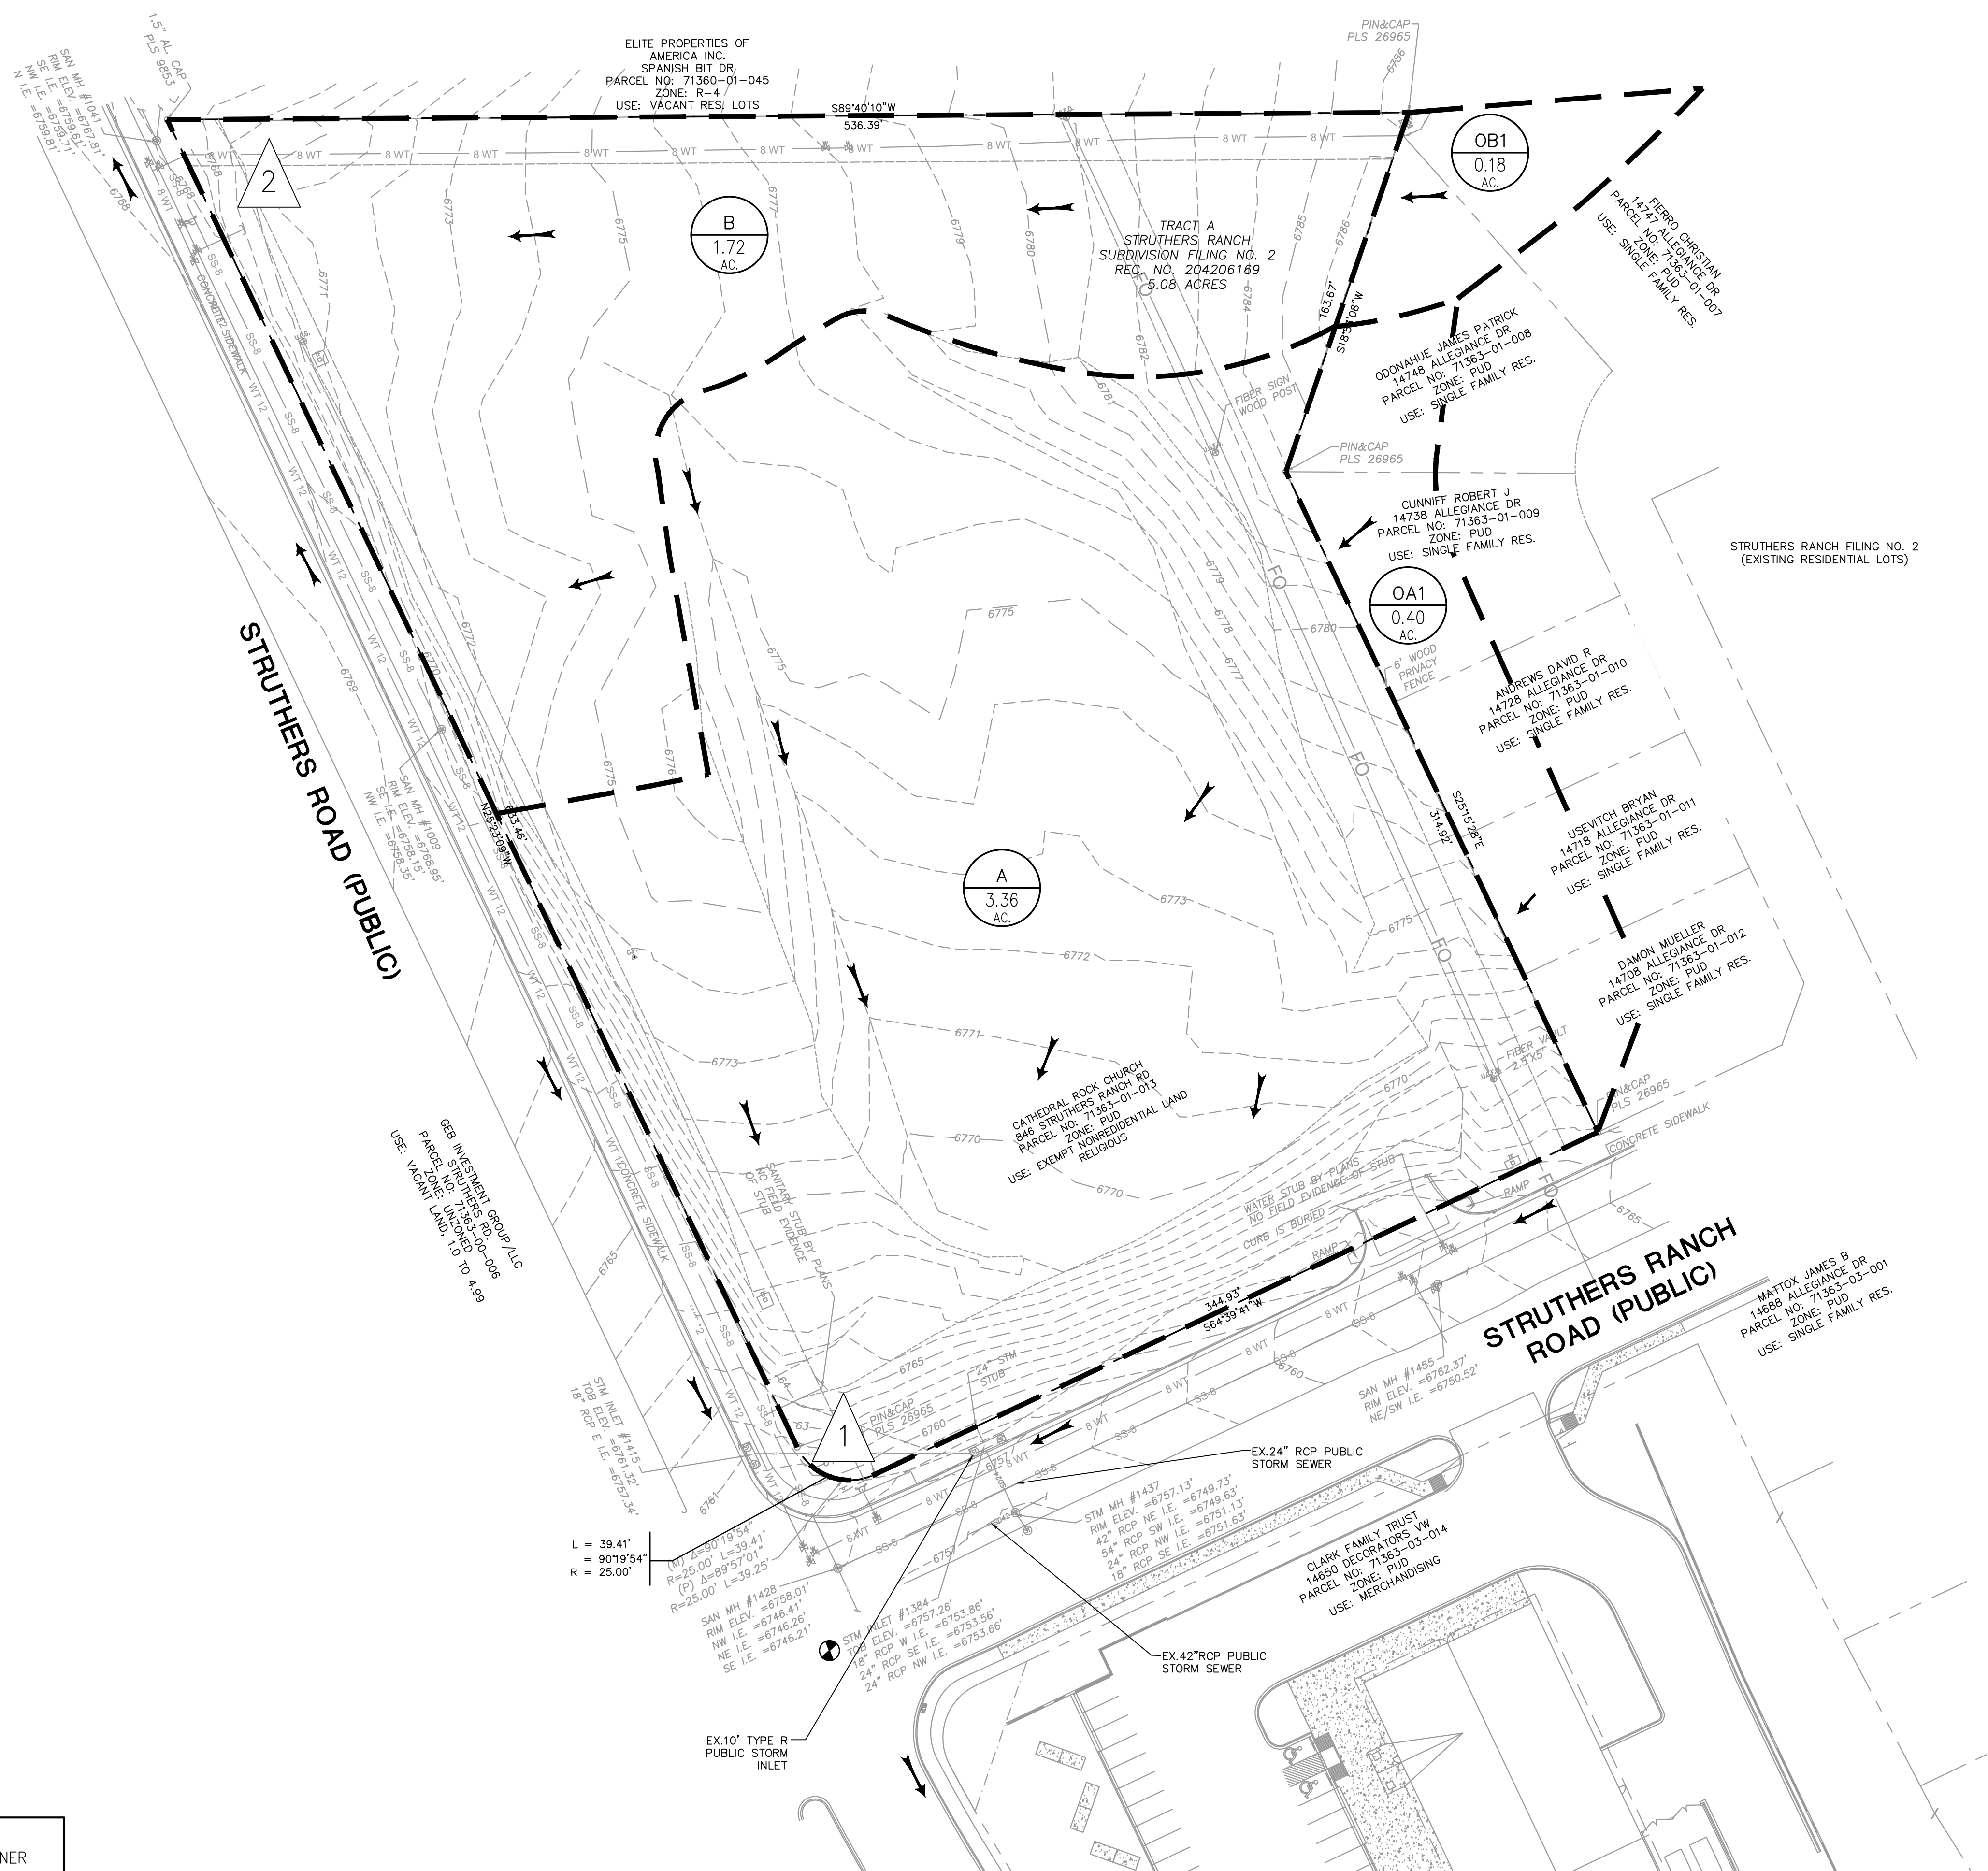

LEGEND

- PROPERTY LINE
- DRAINAGE BASIN BOUNDARY
- 6760 PROPOSED CONTOUR
- 6760 EXISTING CONTOUR
- FLOWLINE
- FLOW DIRECTION ARROW
- DESIGN POINT
- BASIN DESIGNATION
- BASIN AREA (ACRES)

BASIN SUMMARY TABLE

BASIN	Q5 (CFS)	Q100 (CFS)
OA1	0.5	1.3
A	1.0	7.6
OB1	0.2	0.6
B	0.7	5.2

SUMMARY HYDROLOGY TABLE

DESIGN POINT	Q5 (CFS)	Q100 (CFS)
1	1.4	8.5
2	0.7	4.1

**CATHEDRAL ROCK CHURCH
TRACT A, STRUTHERS RANCH FILING NO. 2**

**EXISTING CONDITIONS
DRAINAGE PLAN**

No.	REVISION	DATE

CALL UTILITY NOTIFICATION
CENTER OF COLORADO
1-800-922-1987
CALL 2-BUSINESS DAYS IN ADVANCE
BEFORE YOU DIG, GRADE, OR EXCAVATE
FOR THE MARKING OF UNDERGROUND
MEMBER UTILITIES.

JPS ENGINEERING
19 E. Willamette Ave.
Colorado Springs, CO
80903
PH: 719-477-9429
FAX: 719-471-0766
www.jpsegr.com

BENCHMARK:
STORM INLET NEAR SW CORNER
OF SITE TOB EL=6757.26
(DATUM: NGVD 1929)

HORZ. SCALE: 1"=40'	DRAWN: PV
VERT. SCALE: N/A	DESIGNED: JPS
SURVEYED: RIDGELINE	CHECKED: JPS
CREATED: 05/27/20	LAST MODIFIED: 09/24/24
PROJECT NO: 082401	MODIFIED BY: PV

EX1




CALL UTILITY NOTIFICATION
CENTER OF COLORADO
1-800-922-1987
CALL 2-BUSINESS DAYS IN ADVANCE
BEFORE YOU DIG, GRADE, OR EXCAVATE
FOR THE MARKING OF UNDERGROUND
MEMBER UTILITIES.

NO.	DATE	BY	REVISION

**DEVELOPED
DRAINAGE PLAN**

**CATHEDRAL ROCK CHURCH
TRACT A, STRUTHERS RANCH FILING NO. 2**

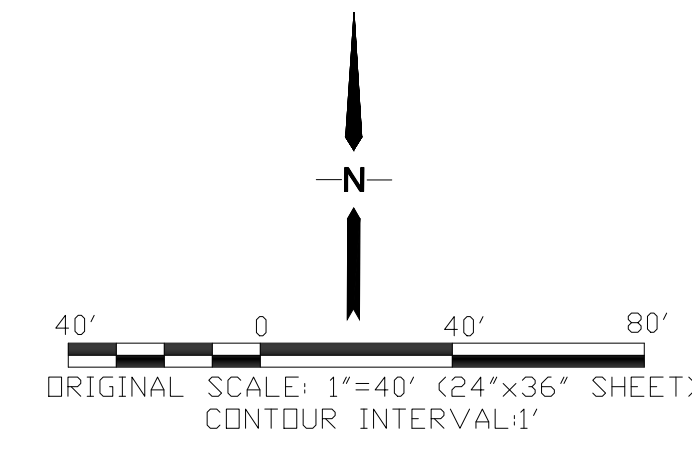

BASIN SUMMARY TABLE

DESIGN BASIN	Q5 (CFS)	Q100 (CFS)
OA1	0.1	0.2
OA2	0.5	1.3
A1	7.9	15.6
A2	2.6	5.3
A3	3.6	6.7
A4	0.1	0.7
OB1	0.2	0.4
B	0.3	2.3

**DEVELOPED CONDITIONS
SUMMARY HYDROLOGY TABLE**

DESIGN POINT	Q5 (CFS)	Q100 (CFS)
1	10.6	21.8
2	0.4	1.9

**IMPERVIOUS AREA CALCULATIONS:
BASIN A1 AREA = 2.29 AC.**

SURFACE TYPE	AREA
CONC. SIDEWALK	5,071 SF
ASPHALT PAVEMENT	27,048 SF
BUILDING (PH.1)	8,125 SF
BUILDING (FUTURE)	13,250 SF
PAVEMENT (FUTURE)	16,227 SF
TOTAL IMPERVIOUS AREA	71,078 SF = 1.632 AC = 71.3%

**IMPERVIOUS AREA CALCULATIONS:
BASIN A2 AREA = 0.86 AC.**

SURFACE TYPE	AREA
CONC. SIDEWALK	1,691 SF
ASPHALT PAVEMENT	11,876 SF
PAVEMENT (FUTURE)	9,213 SF
TOTAL IMPERVIOUS AREA	22,780 SF = 0.523 AC = 60.8%

**IMPERVIOUS AREA CALCULATIONS:
BASIN A3 AREA = 0.96 AC.**

FUTURE COMMERCIAL DEVELOPMENT ASSUMED IMPERVIOUS AREA = **85%**

**IMPERVIOUS AREA CALCULATIONS:
BASIN A4 AREA = 0.23 AC.**


SURFACE TYPE	AREA
CONC. SIDEWALK	0 SF
ASPHALT PAVEMENT	0 SF
BUILDING (PH.)	0 SF
BUILDING (FUTURE)	0 SF
PAVEMENT (FUTURE)	0 SF
TOTAL IMPERVIOUS AREA	0 SF = 0 AC = 0%

**IMPERVIOUS AREA CALCULATIONS:
BASIN B AREA = 0.74 AC.**

SURFACE TYPE	AREA
CONC. SIDEWALK	0 SF
ASPHALT PAVEMENT	0 SF
BUILDING (PH.)	0 SF
BUILDING (FUTURE)	0 SF
PAVEMENT (FUTURE)	0 SF
TOTAL IMPERVIOUS AREA	0 SF = 0 AC = 0%

HORZ. SCALE: 1"=40'	DRAWN: PV
VERT. SCALE: N/A	DESIGNED: JPS
SURVEYED: RIDGELINE	CHECKED: JPS
CREATED: 05/27/20	LAST MODIFIED: 02/12/25
PROJECT NO: 082401	MODIFIED BY: PV

SHEET: **D1.1**

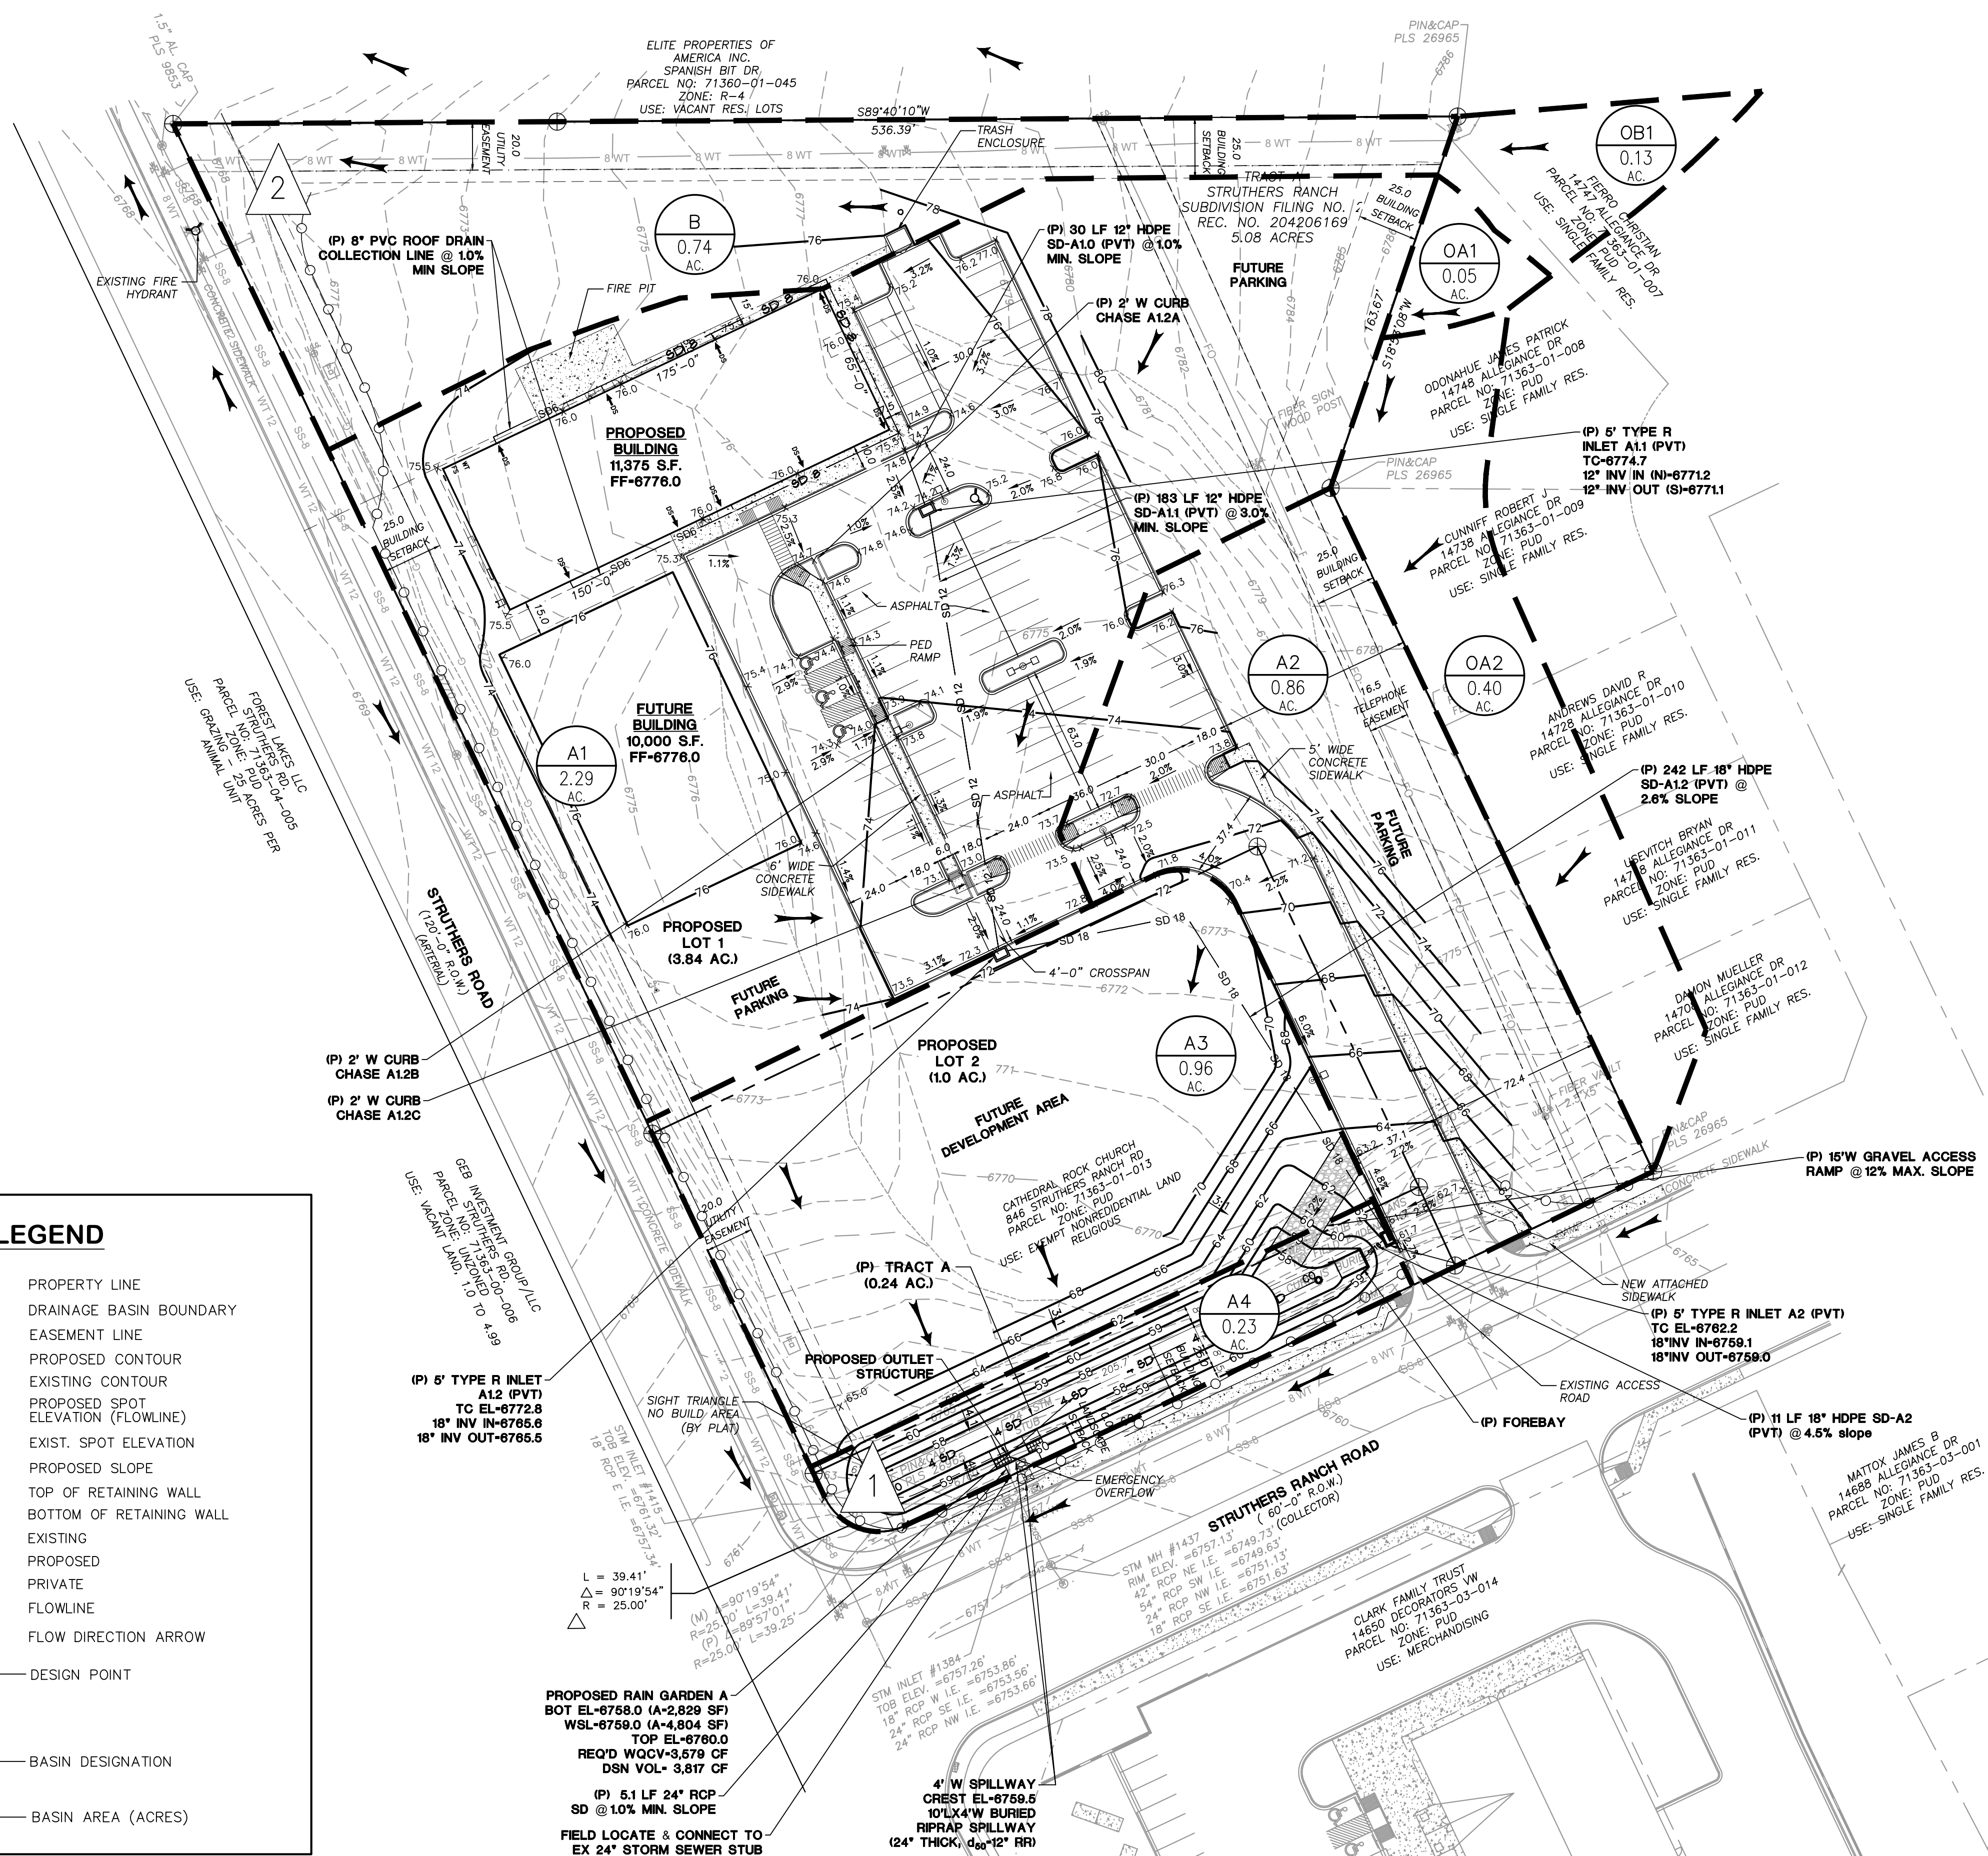

LEGEND

- PROPERTY LINE
- - - DRAINAGE BASIN BOUNDARY
- - - EASEMENT LINE
- - - PROPOSED CONTOUR
- - - EXISTING CONTOUR
- x 49.0 PROPOSED SPOT ELEVATION (FLOWLINE)
- x 74.5 EXIST. SPOT ELEVATION
- 1.0% PROPOSED SLOPE
- TW TOP OF RETAINING WALL
- BW BOTTOM OF RETAINING WALL
- (E) EXISTING
- (P) PROPOSED
- (PVT) PRIVATE
- FLOWLINE
- FLOW DIRECTION ARROW
- 1 DESIGN POINT
- A BASIN DESIGNATION
- XX BASIN AREA (ACRES)

BENCHMARK.
STORM INLET NEAR SW CORNER
OF SITE TOB EL=6757.26
(DATUM: NGVD 1929)