WIDEFIELD WATER AND SANITATION DISTRICT ROLLING HILLS 2MG POTABLE WATER TANK

2019.829.2030

EL PASO COUNTY, COLORADO

CODE STATEMENT

ADDRESS: TBD

19871569515

55000-00-385

MURRAY FOUNTAIN, LLC

EXEMPT 7,620 SF

II-B

N/A

COLORADO SPRINGS, CO 80908 OVERALL PARCEL: 01-15-65

ROAD AND MOCKINGBIRD LANE INTERSECTION WIDEFIELD WATER AND SANITATION DISTRICT

I. APPLICABLE CODES INCLUDE, BUT ARE NOT LIMITED TO THE FOLLOWING:

- INTERNATIONAL BUILDING CODE (2015) Α.
- PIKES PEAK REGIONAL BUILDING CODE (2017) INTERNATIONAL PLUMBING CODE OF THE INTERNATIONAL ASSOCIATION B. С
- OF PLUMBING AND MECHANICAL OFFICIALS (LATEST EDITION)
- INTERNATIONAL PLUMBING CODE (2015) D.
- INTERNATIONAL FIRE CODE (2015) F
- INTERNATIONAL MECHANICAL CODE (2015) Ε. NATIONAL ELECTRICAL CODE (2014) F.
- ICC/ANSI 117.1 (2009) G.
- H. INTERNATIONAL ENERGY CONSERVATION CODE (2015)
- II. CODE ABSTRACT:

A. GENERAL INFORMATION:

LOCATION:

OWNER: TAX ID #: PROPERTY STATUS: TOTAL BUILDING AREA: BUILDING CONSTRUCTION TYPE

EPC SCHEDULE #: PARCEL OWNER:

B. OCCUPANCY TYPE(S): OCCUPANCY TYPE:

C. OCCUPANCY LOAD CALCULATION: N/A - UNOCCUPIED STRUCTURE

PARTICIPANTS

OWNER WIDEFIELD WATER AND SANITATION DISTRICT 8495 FONTAINE BLVD COLORADO SPRINGS, CO 80925 CONTACT: ROBERT BANNISTER, PE PHONE: (719) 955-6118

CONSULTING/DESIGN ENGINEER JDS-HYDRO CONSULTANTS, INC. 5540 TECH CENTER DR, STE 100 COLORADO SPRINGS, CO 80903 CONTACT: GWEN DALL, PE PHONE: (719) 227-0072

TANK SITE: APPROXIMATELY 2168' SOUTHWEST OF DRENNAN

LEGEND


			PP SANITARY SEWER LINE ALIGNMENT
X	- EX FENCE		PP WATER LINE ALIGNMENT
W		5540	PP CONTOURS-MAJOR
SS	- EX SANITARY SEWER LINE		PP CONTOURS-MINOR
OHE	- EX O.H. ELECTRIC	X	PP FENCE
GAS		UGE	PP U.G. ELECTRIC LINE
		·	PP EASEMENT
			PP TEMP. CONSTRUCTION EASEMENT
W	EX WATER MANHOLE	////\SF////\	PP EROSION CONTROL SILT FENCE
G	EX GAS METER	BERM	PP EROSION CONTROL EARTHEN BERM
Ø O	BORE HOLE	••••	PP EROSION CONTROL BALES
•	ELEVATION		PP EROSION CONTROL SOCK
\sim	FLOW ARROW	7777777	PP EROSION CONTROL
		Ŧ	PP WATER LINE FITTING
		Ň	PP WATER VALVE
PCD FILE NO	D. PPR216	Ŷ	PP HYDRANT ASSEMBLY (ISOLATION VALVE INCLUDED)





VICINITY MAP N.T.S.

(719) 227-0072

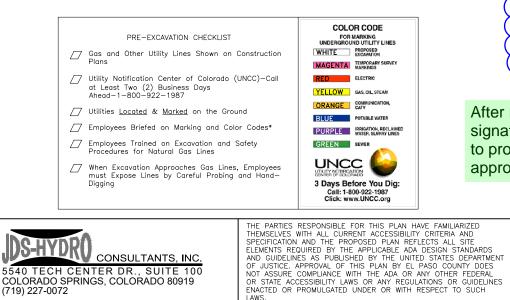

AWS

	SUF	RVEY DATA			
	APHY SURVEY CONDUCTED BY CLARK LAND SULLOWING COORDINATE SYSTEM AND DATUM REC		20). SEE SURVEY FOR ESTABLISHED CONTROL.		
		ORTH AMERICAN DATUM 1	ORDINATE SYSTEM, CENTRAL 983. SCALE FACTOR		
	(3-1/2"	BRASS CAP IN CONCRET "2003"). ELEVATION=58	ON CONTROL POINT #100 'E, "EL PASO CALIBRATION 315.45' (NAVD1988)		
UTILITY COMPRI DO NOT	S SHOWN WITHIN THE SURVEY HAVE BEEN LOC LOCATE MARKINGS. THE SURVEYOR NOR ENGIN SE ALL SUCH UTILITIES IN THE AREA, EITHER I WARRANT THAT THE UNDERGROUND UTILITIES THAT THEY ARE LOCATED AS ACCURATELY AS	EER MAKES NO GUARANT N SERVICE OR ABANDONE SHOWN ARE IN THE EXAM	EE THAT THE UNDERGROUND UTILITIES SHOWN ED. THE SURVEYOR AND ENGINEER FURTHER CT LOCATION INDICATED ALTHOUGH HE DOES		
	SIGNA	TURE BLOC	KS		
	GRADING AND EROSIC	ON CONTROL PLAN A	PPROVALS		
THESE DI PLANS AN COUNTY AND SAID MASTER PARTICUL KNOWLED	ND SPECIFICATIONS HAVE BEEN PREPAR FOR DETAILED ROADWAY, DRAINAGE, GR	RED ACCORDING TO T ADING AND EROSION CONFORMITY WITH API ND SPECIFICATIONS M ARE DESIGNED AND LITY FOR ANY LIABILIT	CONTROL PLANS AND SPECIFICATIONS, PLICABLE MASTER DRAINAGE PLANS AND MEET THE PURPOSES FOR WHICH THE ARE CORRECT TO THE BEST OF MY Y CAUSED BY ANY NEGLIGENT ACTS,		
ENGINEER	OF RECORD SIGNATURE	DATE			
		L COMPLY WITH ALL	THE REQUIREMENTS SPECIFIED IN THES	ε	
OWNER S		PATE			
EL PASO COUNTY COUNTY PLAN REVIEW IS PROVIDED ONLY FOR GENERAL CONFORMANCE WITH COUNTY DESIGN CRITERIA. THE COUNTY IS NOT RESPONSIBLE FOR THE ACCURACY AND ADEQUACY OF THE DESIGN, DIMENSIONS, AND/OR ELEVATIONS WHICH SHALL BE CONFIRMED AT THE JOB SITE. THE COUNTY THROUGH THE APPROVAL OF THIS DOCUMENT ASSUMES NO RESPONSIBILITY FOR COMPLETENESS AND/OR ACCURACY OF THIS DOCUMENT. FILED IN ACCORDANCE WITH THE REQUIREMENTS OF THE EL PASO COUNTY LAND DEVELOPMENT CODE, DRAINAGE CRITERIA MANUAL VOLUMES 1 AND 2, AND ENGINEERING CRITERIA MANUAL, AS AMENDED. IN ACCORDANCE WITH ECM SECTION 1.12, THESE CONSTRUCTION DOCUMENTS WILL BE VALID FOR CONSTRUCTION FOR A PERIOD OF 2 YEARS FROM THE DATE SIGNED BY THE EL PASO COUNTY ENGINEER. IF CONSTRUCTION HAS NOT STARTED WITHIN THOSE 2 YEARS, THE PLANS WILL NEED TO BE RESUBMITTED FOR APPROVAL, INCLUDING PAYMENT OF REVIEW FEES AT THE PLANNING AND COMMUNITY DEVELOPMENT DIRECTOR'S DISCRETION. JENNIFER IRVINE, P.E. COUNTY ENGINEER/ECM ADMINISTRATOR DATE					
	INVINE, F.E. COUNTY ENGINEER/ COM	ADMINISTRATOR	DATE	2	
		ON PLAN APPROVALS		Ž	
THE WID	APPROVALS EFIELD WATER AND SANITATION DISTRICT RECOO THE WIDEFIELD WATER AND SANITATION DISTRIC	GNIZES THE DESIGN ENGI	NEER AS HAVING RESPONSIBILITY FOR THE		
11	ng County Engineer	ROVAL	Unresolved. Please		
	ock, leave space blank		remove this signature		
ovide room for PCD Director		block as the site plan			
	oval stamp. — is approved by the				
DEFINED	OF ERRORS OR OMISSIONS WITH THE WATER IN THE "RULES AND REGULATIONS FOR INSTAL 180 DAYS FROM DESIGN APPROVAL.				
	NEER'S STATEMENT:				
THESE DETAILED PLANS AND SPECIFICATIONS WERE PREPARED UNDER MY DIRECTION AND SUPERVISION. SAID DETAILS AND SPECIFICATIONS HAVE BEEN PREPARED ACCORDING TO THE CRITERIA ESTABLISHED BY THE APPLICABLE GOVERNING AGENCIES.					
r 📕					
			102.121	1	

Afte sign to pr appr

GWEN DALL, P.E. #5181 JDS-HYDRO CONSULTAN

		102.121
10 NTS, INC.	DATE	PROJECT NO.

- ALL UTILITY CONSTRUCTION TO BE CONDUCTED IN CONFORMANCE WITH THE CURRENT WIDEFIELD WATER AND SANITATION DISTRICT SPECIFICATIONS. COMPACTION REQUIREMENTS SHALL BE 95% STANDARD PROCTOR AS DETERMINED BY ASTM D698, UNLESS OTHERWISE APPROVED BY THE WIDEFIELD WATER AND SANITATION DISTRICT OR A HIGHER STANDARD IS IMPOSED BY ANOTHER AGENCY HAVING RIGHT-OF-WAY JURISDICTION. CONTRACTOR IS ALSO REQUIRED TO COMPLY WITH THE REQUIREMENTS OF THE EL PASO COUNTY ENGINEERING CRITERIA MANUAL.
- 2. ALL MATERIALS AND WORKMANSHIP SHALL BE SUBJECT TO INSPECTION BY THE WIDEFIELD WATER AND SANITATION DISTRICT. THE WIDEFIELD WATER AND SANITATION DISTRICT RESERVES THE RIGHT TO ACCEPT OR REJECT ANY SUCH MATERIALS AND WORKMANSHIP THAT DOES NOT CONFORM TO ITS STANDARDS AND SPECIFICATIONS. WIDEFIELD WATER AND SANITATION DISTRICT CONSTRUCTION SPECIFICATIONS MAY BE OBTAINED FROM THEIR WEBSITE: www.wwsdonline.com
- ALL CARBON STEEL AND DUCTILE IRON PIPE, TO INCLUDE FITTINGS, VALVES AND FIRE HYDRANTS WILL BE WRAPPED WITH POLYETHEYLENE TUBING, BONDED AT EACH JOINT AND ELECTRICALLY ISOLATED
- ALL CARBON STEEL AND DUCTILE IRON PIPE AND FITTINGS SHALL HAVE CATHODIC PROTECTION USING NO. 6 WIRE WITH 17 LB. MAGNESIUM ANODES EVERY 400 FEET AND 1 LB. MAGNESIUM ANODES AT EVERY FITTING.
- 5. PVC MAIN LINES SHALL BE INSTALLED WITH COATED NO. 12 TRACER WIRE.
- 6. THE CONTRACTOR IS REQUIRED TO NOTIFY THE WIDEFIELD WATER AND SANITATION DISTRICT A MINIMUM OF 48 HOURS AND A MAXIMUM OF 96 HOURS PRIOR TO THE START OF CONSTRUCTION. THE CONTRACTOR SHALL ALSO NOTIFY WWSD A WEEK IN ADVANCE OF ANY REQUIRED BASIN OR UTILITY SHUTDOWNS
- 7. THE LOCATION OF ALL UTILITIES AS SHOWN ON THESE DRAWINGS ARE APPROXIMATE ONLY. THE LOCATION OF ALL UTILITIES SHALL BE VERIFIED PRIOR TO CONSTRUCTION BY THE CONTRACTOR.
- THE CONTRACTOR SHALL FIELD EXCAVATE AND VERIFY THE VERTICAL AND HORIZONTAL LOCATION 8. OF ALL TIE-INS. CONTRACTOR SHALL NOTIFY THE WIDEFIELD WATER AND SANITATION DISTRICT AND THE ENGINEER OF THE FIELD VERIFIED INFORMATION PRIOR TO CONSTRUCTION.
- 9. ALL BENDS SHALL BE FIELD STAKED PRIOR TO CONSTRUCTION.
- 10. ANY WATER UTILITY MATERIAL REMOVED AND NOT REUSED SHALL BE RETURNED TO THE WIDEFIELD WATER AND SANITATION DISTRICT IF THE DISTRICT SO REQUESTS.
- 11. THE CONTRACTOR SHALL AT HIS EXPENSE SUPPORT AND PROTECT ALL UTILITY MAINS SO THAT THEY WILL FUNCTION CONTINUOUSLY DURING CONSTRUCTION. SHOULD A UTILITY MAIN FAIL AS A RESULT OF THE CONTRACTOR'S OPERATION, IT WILL BE REPLACED IMMEDIATELY BY EITHER THE CONTRACTOR OR THE WIDEFIELD WATER AND SANITATION DISTRICT AT FULL COST OF LABOR AND MATERIALS TO THE CONTRACTOR.
- 12, CONTRACTOR IS RESPONSIBLE FOR ALL DEWATERING EFFORTS, ANY PUMPING OR BYPASS OPERATIONS MUST BE REVIEWED AND APPROVED PRIOR TO EXECUTION BY BOTH THE WIDEFIELD WATER AND SANITATION DISTRICT AND THE ENGINEER.
- 13. CONTRACTOR MUST REPLACE OR REPAIR ANY DAMAGE TO ALL SURFACE IMPROVEMENTS, INCLUDING BUT NOT LIMITED TO FENCES, CURB AND GUTTER AND/OR ASPHALT THAT MAY BE CAUSED DURING CONSTRUCTION.
- 14. ALL SITE UTILITIES AND IMPROVEMENTS SHALL HAVE AS "AS-BUILT" PLANS PREPARED AND APPROVED PRIOR TO FINAL ACCEPTANCE BY THE WIDEFIELD WATER AND SANITATION DISTRICT.
- 15. PRIOR TO CONSTRUCTION, A <u>PRE-CONSTRUCTION CONFERENCE IS REQUIRED</u> A MINIMUM OF 72 HOURS IN ADVANCE OF COMMENCEMENT OF WORK.
- 16. EL PASO COUNTY STORMWATER AND/OR EROSION CONTROL PERMITS, CDPHE STORMWATER CONSTRUCTION ACTIVITY AND DEWATERING PERMITS, AND CITY OF COLORADO SPRINGS WORK IN THE R.O.W. PERMIT WILL BE THE RESPONSIBILITY OF THE CONTRACTOR TO OBTAIN PRIOR TO CONSTRUCTION
- 17. ALL MAIN LINES (PVC AND DUCTILE IRON) SHALL BE INSTALLED WITH COATED NO. 12 TRACER WIRE WITH TEST STATIONS EVERY 500 FT.
- 18. AERIAL BASEMAP IMAGERY, IF DEPICTED HEREIN, IS NOT TO SCALE AND IS SHOWN FOR CONCEPTUAL REFERENCE ONLY
- 19 SEE WIDEFIELD WATER AND WASTEWATER SYSTEM STANDARD SPECIFICATIONS FOR ALL GENERAL AND DESIGN STANDARDS/CIVIL DRAWINGS DETAILS.
- 20. WATER MAIN INSTALLATION:

THE UNIT PRICE SHALL INCLUDE ALL PIPE, PIPE INSTALLATION, TRENCHING, STABILIZATION, AND BEDDING AS SHOWN ON THE TYPICAL DETAIL, DEWATERING, BACKFILL, TRACER WIRE, COMPACTION, CLEAN-UP, REVEGETATION, FLUSHING, TESTING, GRADING AND ALL WORK INCIDENTAL THERTO TO COMPLETE THE WORK AS SHOWN ON THE DRAWINGS AND SPECIFIED HERFIN

- 21. CONTRACTOR IS TO COORDINATE WITH THE RANCHER WHO RUNS CATTLE ON THE PROPERTY TO ENSURE NO CATTLE ARE HARMED DURING CONSTRUCTION
- 22. NO WATER FACILITY SHALL BE PLACED IN SERVICE UNTIL AFTER COMPLETION OF ALL PRESSURE TESTING, DISINFECTION, AND COMPACTION TESTING.
- 23. SUBSURFACE UTILITY ENGINEERING

GENERAL NOTES

- 23.1. UTILITIES ARE DEPICITED ON THESE PLANS IN ACCORDANCE WITH THEIR ACHIEVED "QUALITY LEVELS" AS DEFINED IN THE AMERICAN SOCIETY OF CIVIL ENGINEER'S DOCUMENT ASCE 38. "STANDARD GUIDELINE FOR THE COLLECTION AND DEPICTION OF EXISTING SUBSURFACE UTILITY DATA."
- 23.2. RELIANCE UPON THESE DATA FOR RISK MANAGEMENT PURPOSES DURING BIDDING DOES NOT RELIEVE THE EXCAVATOR OR UTILITY OWNER FROM FOLLOWING ALL APPLICABLE UTILITY DAMAGE PREVENTION STATUTES, POLICIES, AND/OR PROCEDURES DURING EXCAVATION. IT IS IMPORTANT THAT THE CONTRACTOR INVESTIGATES AND UNDERSTANDS THE SCOPE OF WORK BETWEEN THE PROJECT OWNER AND THEIR ENGINEER REGARDING THE SCOPE AND LIMITS OF THE UTILITY INVESTIGATIONS LEADING TO THESE UTILITY DEPICTIONS.
- 24 DISINFECTION OF FACILITIES
- 24.1. THE CONTRACTOR SHALL DISINFECT ALL DOMESTIC WATER LINES ACCORDING TO AWWA C651-14 AND TANK ACCORDING TO AWWA C652-11
- 24.2. THE CONTRACTOR SHALL COLLECT SAMPLES FROM THE PIPELINE AND TANK AFTER FINAL FLUSHING AND PRIOR TO PLACING FACILITIES IN SERVICE AND TEST FOR COLIFORM ORGANISMS. THE NUMBER AND FREQUENCY OF SAMPLES SHALL CONFORM WITH THE REQUIREMENTS OF THE PUBLIC HEALTH AGENCY HAVING JURISDICTION.
- 24.3. REPEAT DISINFECTION UNTIL SATISFACTORY SAMPLES HAVE BEEN OBTAINED IF INITIAL OR SUBSEQUENT DISINFECTION FAILS TO PRODUCE SATISFACTORY SAMPLES

DESCRIPTION

SHEET

G2 G3

CIVIL

C1 C2 C3 C4 C5

C6

C7 C8 C9 C10 C11 C12 C13 C14

C15 C16

C17 C18

NUMBER

WWSD

VA PPNC


SHEET INDEX


SHE		DESCRIPTION	
ILE/PROCESS FLOW DIAGRAM N MAP AN NT PLAN RAIN PLAN & PROFILE ILS ILS LAN & SECTION VIEW IVIL DETAILS PLAN & PROFILE CIVIL DETAILS	STRUCTURAL S1 S2 S3 S4 S5 S6 S7 S8 S9 S10 S11	STRUCTURAL NOTES FLOOR APPURTENANCE LAYOUT DOME APPURTENANCE LAYOUT TANK SECTION STRUCTURAL DETAILS STRUCTURAL DETAILS STRUCTURAL DETAILS STRUCTURAL DETAILS STRUCTURAL DETAILS STRUCTURAL DETAILS STRUCTURAL DETAILS	
SION CONTROL PLAN SION CONTROL NOTES SION CONTROL NOTES SION CONTROL DETAILS SION CONTROL DETAILS SION CONTROL DETAILS			STRICT

ABBREVIATIONS


REDUCER


WIDEFIELD WATER AND SANITATION DISTRICT VETERANS AFFAIRS PIKES PEAK NATIONAL CEMETERY ROLLING HILLS BOOSTER PUMP STATION SOUTHERN DELIVERY SYSTEM PROPOSED EXISTING SCHEDULE STATION FEMALE NATIONAL PIPE THREAD MALE NATIONAL PIPE THREAD FLANGE FIRE HYDRANT THRUST BLOCK MECHANICAL JOINT BUTTERFLY VALVE GATE VALVE SIDE OPERATED VALVE




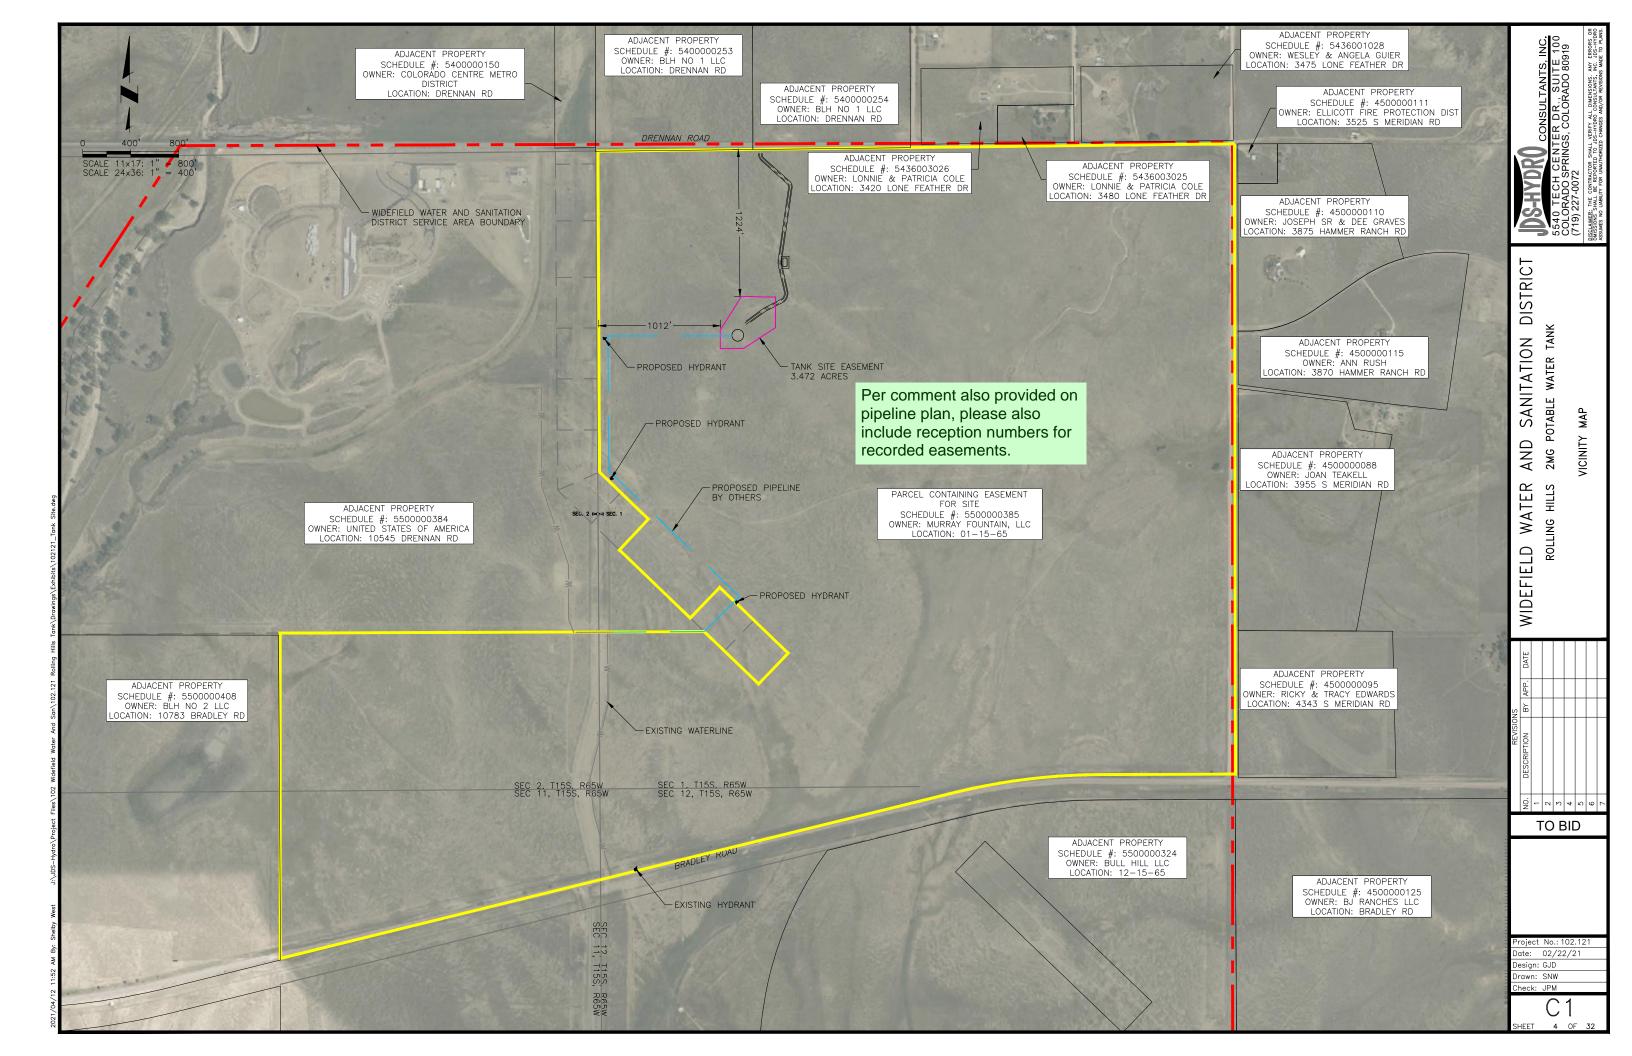




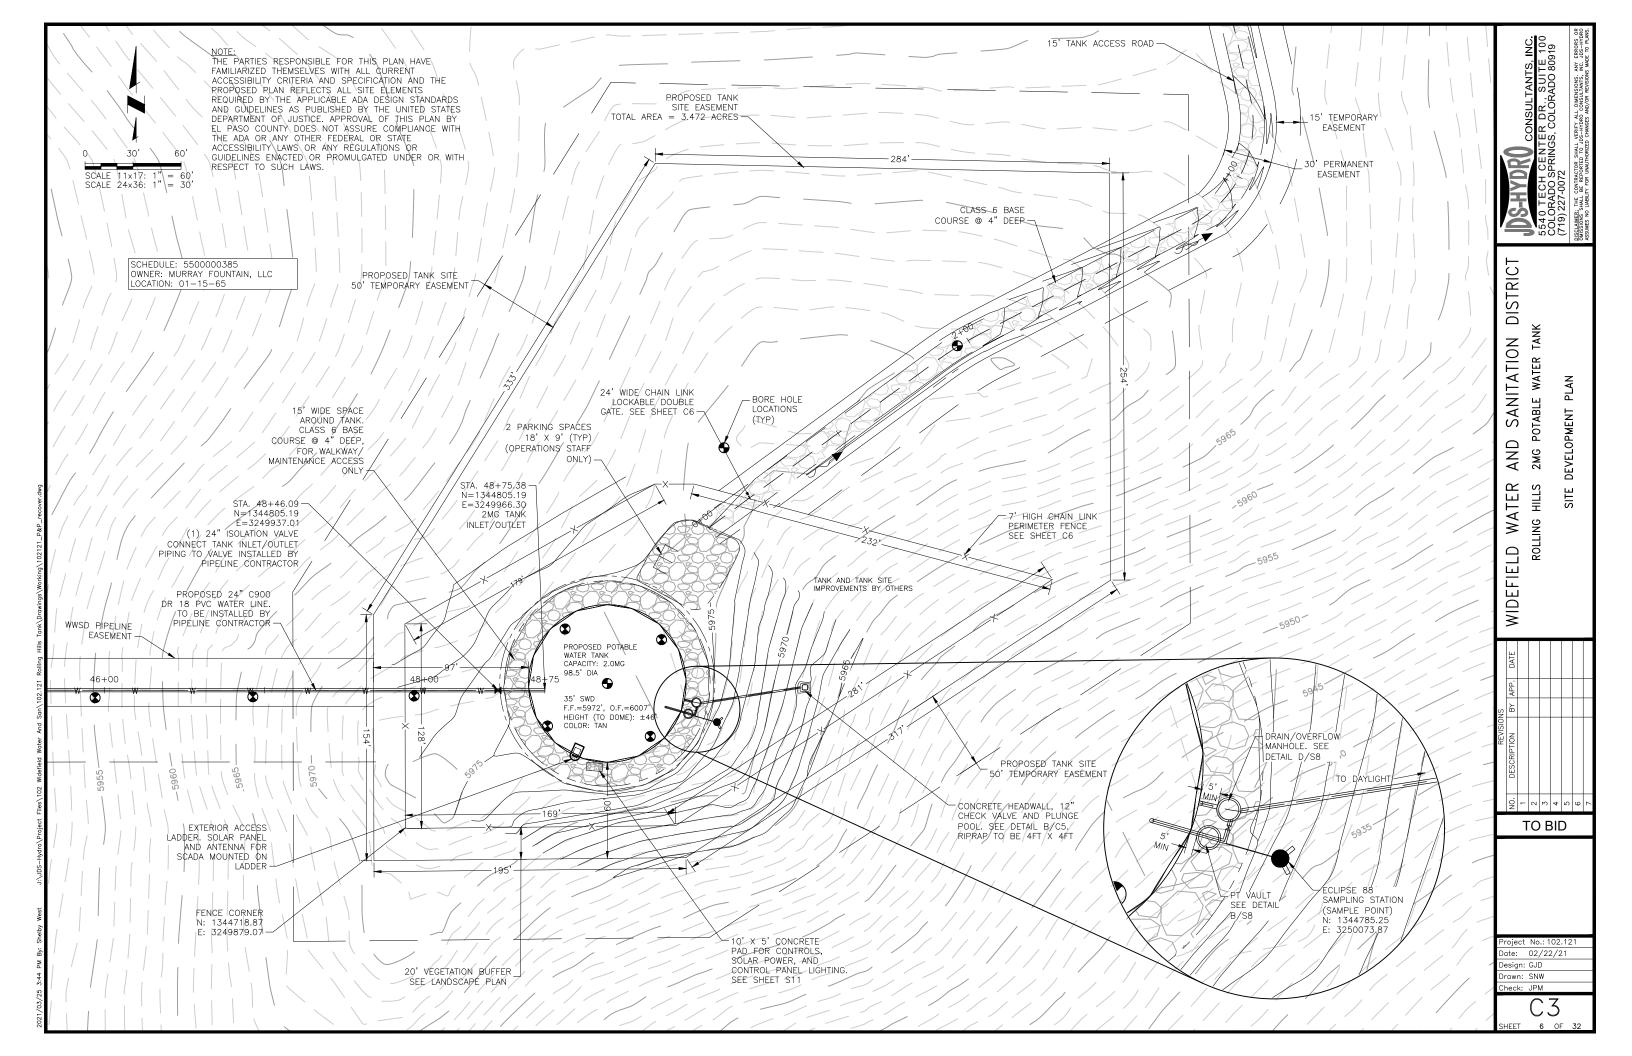

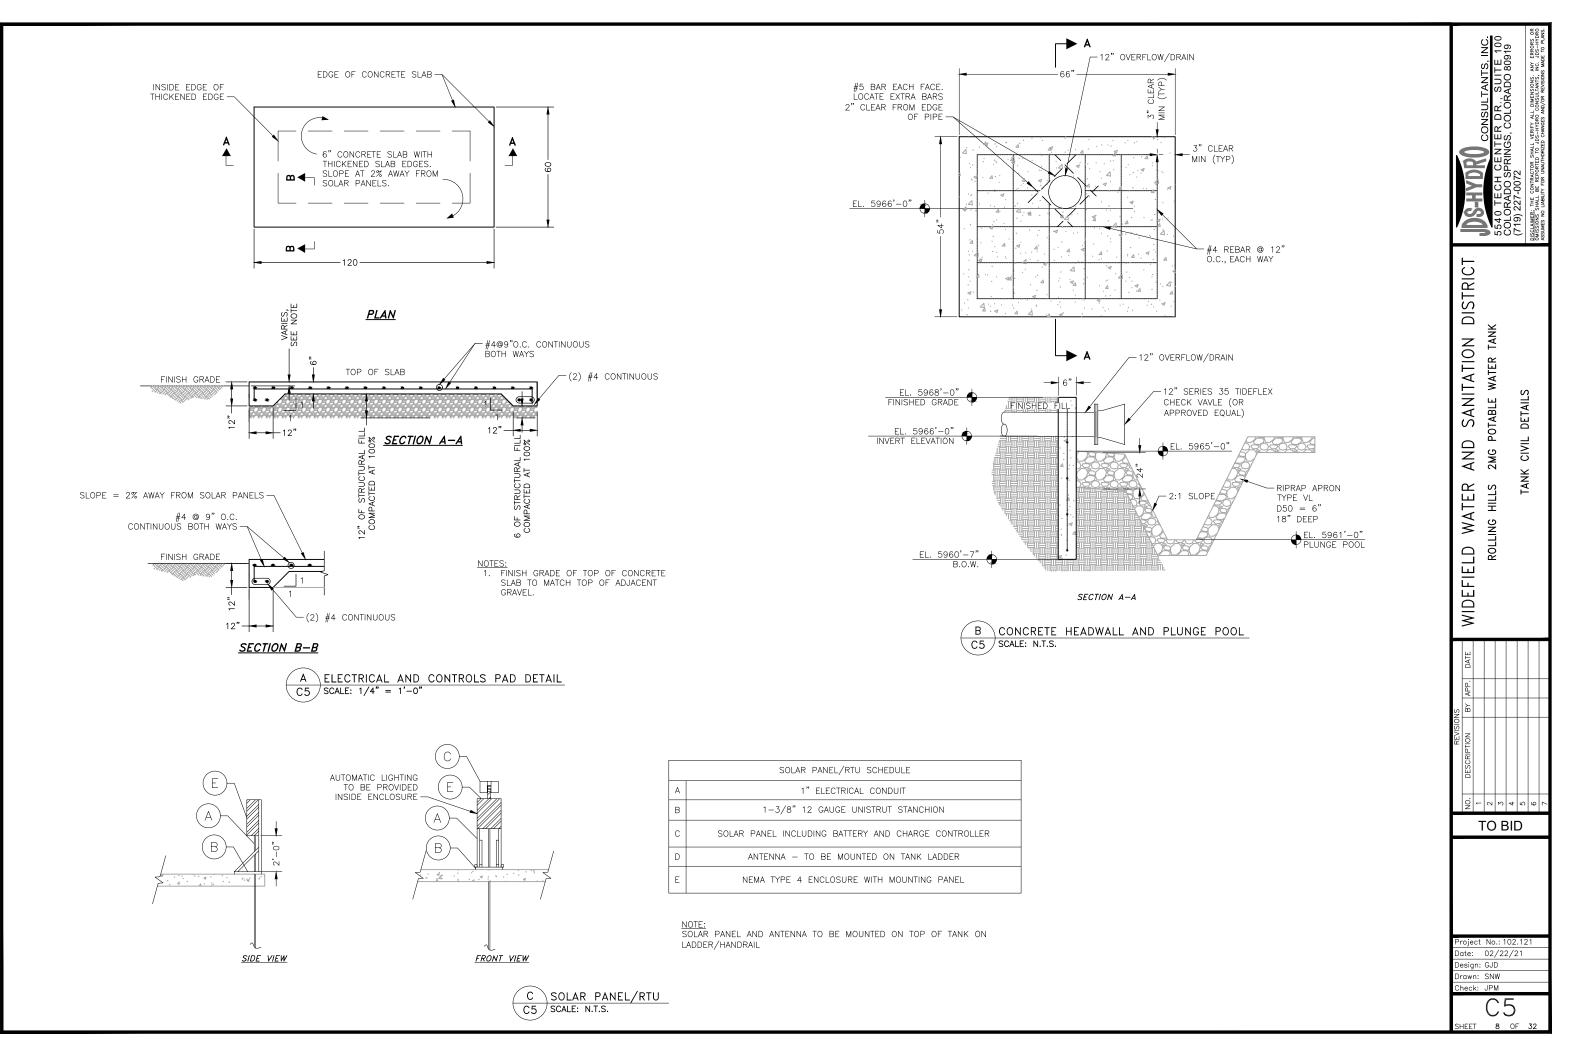

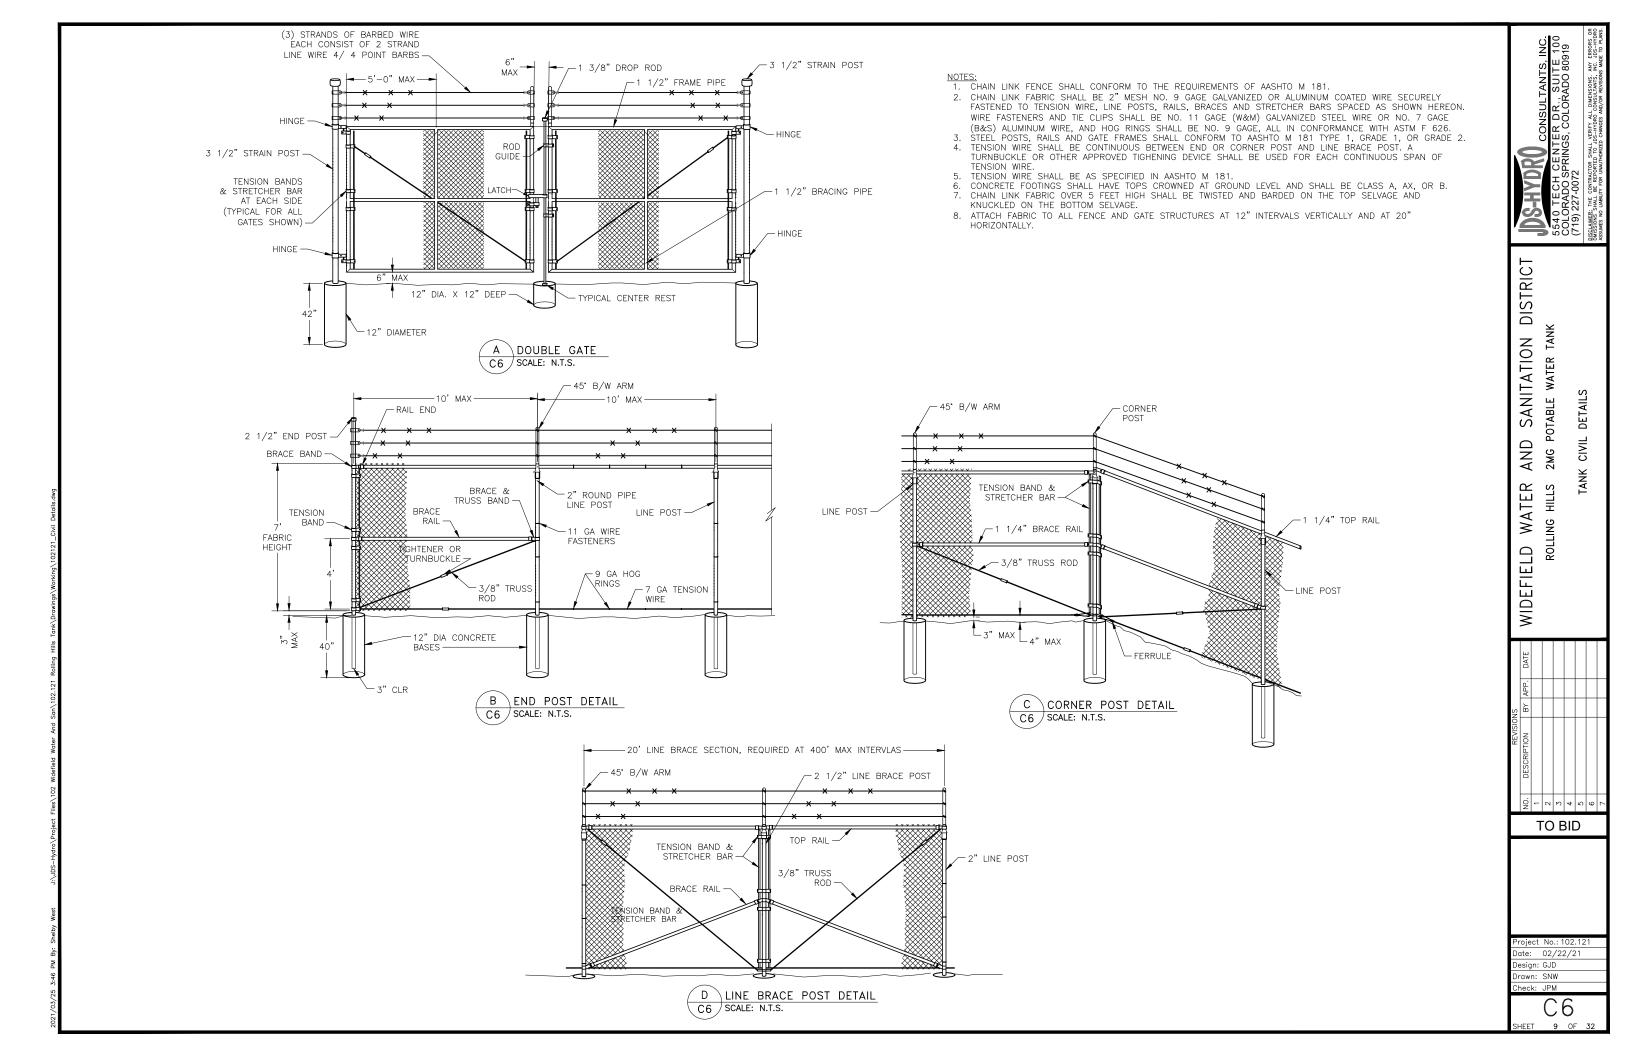

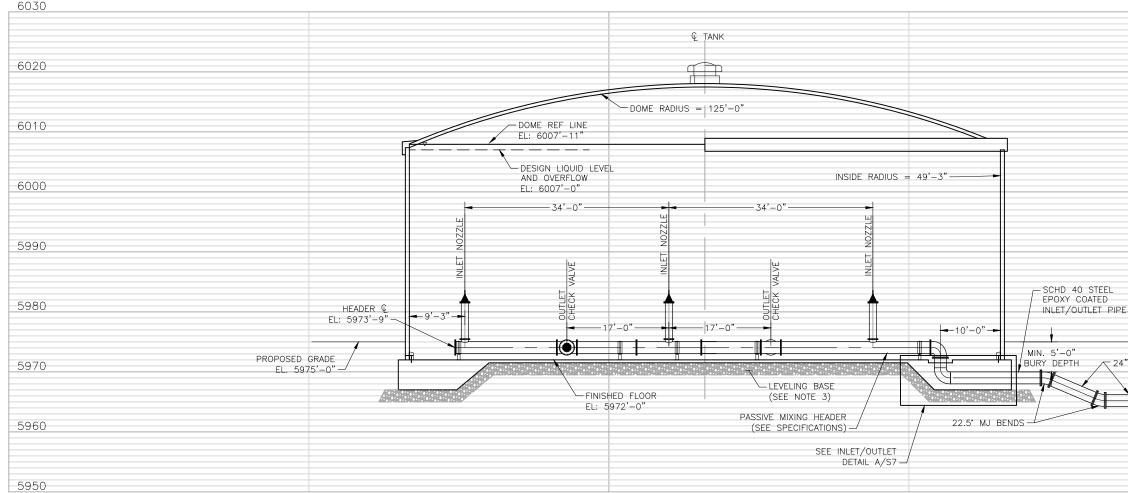



NOTES:

- 1. REFER TO CONTRACT DOCUMENTS FOR INFORMATION CONCERNING TANK BASE PREPARATION, BACKFILLING, AND SITE GRADING.
- 2. GEOTECHNICAL ENGINEER MUST INSPECT AND EVALUATE THE SUB-GRADE PRIOR TO PLACEMENT OF LEVELING BASE TO CONFIRM MINIMUM DESIGN CRITERIA IS BEING MET.
- 3. LEVELING BASE SHALL CONSIST OF 12 INCHES OF IMPORTED, CRUSHED STONE MEETING NO. 57 CONCRETE AGGREGATE PER TABLE 703-1 CDOT STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION, 2019, OR CLASS 5 OR 6 AGGRAGATE BASE COURSE PER TABLE 703-2 CDOT STANDARD SPECIFICATIONS, 2019. LEVELING BASE SHALL EXTEND A MINIMUM OF 48 INCHES BEYOND EDGE OF FOOTINGS.
- 4. REFER TO TANK & PIPING SECTION DRAWINGS IN CIVIL SHEETS AND STRUCTURAL DETAIL SHEETS FOR BURIED PIPE PENETRATIONS.
- 5. REFER TO SPECIFICATIONS FOR HYDRODYNAMIC MIXING SYSTEM INFORMATION.

