

**WATERVIEW EAST
PRELIMINARY DRAINAGE REPORT
EL PASO COUNTY, COLORADO**

PROJECT NO. 181710214



Prepared for:
CPR ENTITLEMENTS
31 N. TEJON, SUITE 500
COLORADO SPRINGS, CO 80903
719.377.0244

Prepared by:
STANTEC CONSULTING, INC
1110 ELKTON DRIVE, SUITE B
COLORADO SPRINGS, CO 80907
719.432.6880


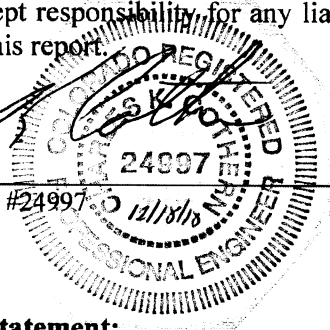
June 26, 2018

PCD File No: SP-17-010

CERTIFICATIONS

Design Engineer's Statement:


The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the applicable master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.


Charles K. Cothorn, P.E. #24997


Seal

Owner/Developer's Statement:

I, the owner/developer have read and will comply with all of the requirements specified in this drainage report and plan.

By (Signature): 

Date: 12/19/2018

By (Printed): Daniel T. Roemer

Title: Authorized Signer

Address: 555 Middle Creek Parkway, Suite 380
Colorado Springs, CO 80921

El Paso County:

Filed in accordance with the requirements of the El Paso County Land Development Code, Drainage Criteria Manual Volumes 1 and 2, and the Engineering Criteria Manual, as amended.

Jennifer Irvine, P.E.,
County Engineer / ECM Administrator

Date

Table of Contents

PURPOSE	5
GENERAL LOCATION & DESCRIPTION	6
DESCRIPTION OF PROPERTY	6
CLIMATE	7
FLOODPLAIN STATEMENT	7
UTILITIES & OTHER ENCUMBRANCES	7
DRAINAGE BASINS AND SUB-BASINS	7
MAJOR BASIN DESCRIPTION	7
SUB-BASIN DESCRIPTION.....	7
<i>Historic Drainage Patterns</i>	7
<i>Off-Site Drainage</i>	8
DRAINAGE DESIGN CRITERIA.....	8
DEVELOPMENT CRITERIA REFERENCE	8
HYDROLOGIC CRITERIA	8
<i>Rational Method</i>	8
<i>Storm Sewer Design</i>	8
<i>Detention Storage Criteria</i>	8
Deviations	9
DRAINAGE BASINS.....	9
OFFSITE BASINS.....	9
EXISTING DRAINAGE ANALYSIS	9
<i>Big Johnson Basin</i>	9
<i>Jimmy Camp Basin</i>	10
PROPOSED DRAINAGE ANALYSIS	10
<i>Big Johnson Basin</i>	10
<i>Jimmy Camp Creek Basin</i>	13
DRAINAGE FACILITY DESIGN	18
GENERAL CONCEPT	18
STORM SEWER SYSTEM	18
ON-SITE WATER QUALITY & DETENTION	18
OFFSITE ANALYSIS	19
FOUR STEP PROCESS	19
DRAINAGE AND BRIDGE FEES	20
DRAINAGE INFRASTRUCTURE COSTS	20
SUMMARY.....	20
REFERENCE MATERIALS	21

List of Figures

Figure 1: Vicinity Map	22
Figure 2: FIRM Map	23
Figure 3: Existing Drainage Map	BACK POCKET
Figure 4: Proposed Drainage Map.....	BACK POCKET

Appendix

Appendix A: NRCS Soil Report
Appendix B: Existing Hydrology Calculations
Appendix C: Proposed Hydrology Calculations
Appendix D: Detention Pond & Water Quality Calculations
Appendix E: Deviation Request

PURPOSE

The purpose of this Preliminary Drainage Report (PDR) is to identify and present on and offsite drainage patterns, locate and identify tributary and downstream drainage features and facilities that impact the proposed site. Runoff quantities and proposed facilities have been calculated using the City of Colorado Springs/El Paso County Drainage Criteria Manual (DCM) revised November 1991; and in accordance with El Paso County ordinance 15-042.

Waterview East is approximately 195.4 acres and is part of the overall Waterview development, which is 721.8 acres within El Paso County. This portion includes the area east of Powers Boulevard and south of Bradley Road. Of the 195.4 acres, 26.1 acres will be commercial/retail and 169.3 acres will be single family residential (713 lots). The site is bordered by Powers Boulevard to the west, Bradley Road to the north and undeveloped areas to the east and south.

GENERAL LOCATION & DESCRIPTION

The Waterview East development site is located within 2 major drainage basins, Big Johnson Reservoir on the west and Jimmy Camp Creek on the east.

Big Johnson Reservoir Drainage Planning Study had originally stated that developed flows would be released into the Big Johnson Reservoir and no detention would be required as long as water quality measures were taken within the basin. However, within recent years, this is no longer the case. Detention will be required within all basins.

There is currently no approved El Paso County Drainage Basin Planning Study (DBPS) for Jimmy Camp. This report may be updated if/when a DBPS is approved.

Design, phasing, responsibility and maintenance of any proposed improvements will be discussed in the final drainage report. Fees will be assessed and paid according to the current rates at the time of platting for each filing.

Description of Property

The project site is 195.4 acres of vegetation, consisting of short grasses and weeds. The average slope of the site is between 3 and 8%, with a minimum slope of 1% along Powers Boulevard and a maximum of 19% through the central area and along the eastern boundary of the site.

The site is composed of several different soil types. From the NRCS report in Appendix A, the site falls into the following soil types:

- 8 - Blakeland loamy sand (1-9%) – Type A Soil
- 52 - Manzanst clay loam (3-8%) – Type C Soil
- 56 - Nelson Tassel fine sandy loam (3-19%) – Nelson Type B Soil, Tassel Type D Soil
- 86 - Stoneham sandy loam (3-8%) – Type B Soil
- 108 - Wiley silt loam (3-9%) – Type B Soil

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

Climate

The climate of the site is typical of a sub-humid to semiarid climate with mild summers and winters. The average temperature is 31 degrees F in the winter and 68.4 degrees in the summer. Total annual precipitation is 15.21 inches.

Floodplain Statement

The Flood Insurance Rate Map (FIRM No. 08041C0768-F dated 3/17/99) indicates that there is no floodplain in the vicinity of the proposed site. See Figure 2: FIRM.

Utilities & Other Encumbrances

The site is currently undeveloped and there are no known utilities on site.

Drainage Basins and Sub-Basins

Major Basin Description

Waterview East development lies within 2 major basins, Big Johnson and Jimmy Camp Creek Drainage Basins. This project is part of the overall Waterview Development and design complies with the Amendment to the Master Drainage and Development Plan (MDDP) dated July 21, 2014 by Springs Engineering.

The western third of the site drains to the Big Johnson Reservoir and will need to be detained prior to crossing under Powers Boulevard. The remainder of the site is within the Jimmy Camp Creek Basin and will also need to be detained prior to exiting the site. All developed runoff will meet El Paso County standards for water quality and discharge rates.

Sub-Basin Description

Historic Drainage Patterns

The historic drainage patterns of the site were analyzed in the Master Development Drainage Plan for Waterview by Merrick and Company. No new historic calculations were done.

Off-Site Drainage

There is one off-site basin within the Jimmy Camp Creek Basin that affects the site drainage. It is shown in the hydrology calculations for existing and proposed basins. Based on the MDDP, this basin will release at existing flow rates and any developments or improvements to the basin will need to address their own water quality and detention needs. Currently twin 42" c/p's carry the flow under Bradley Road on site. These existing structures will tie into the proposed on-site storm system. Flows are shown as being combined with Design Point S in the routing spreadsheet. This offsite flow currently flows into JCD-1 and will stay within these boundaries and is accounted for in the developed basin and storm system design.

DRAINAGE DESIGN CRITERIA

Development Criteria Reference

The City of Colorado Springs Drainage Criteria Manual (DCM), El Paso County Engineering Criteria Manual (ECM) and Urban Storm Drainage Criteria Manual (USDCM) by Urban Drainage & Flood Control District was used in preparation of this report. Additional preliminary and final drainage plans, master development drainage plans and drainage basin planning studies used in the preparation of the report are listed in the References Section.

Hydrologic Criteria

Rational Method

The rational method was used to determine onsite flows, as required by the current City of Colorado Springs Drainage Criteria Manual (DCM). Both the 5-year and 100-year storm events were considered in this analysis. Runoff coefficients appropriate to the existing and proposed land uses were selected for an SCS type "B" soil from Table 6-6 of the DCM. The time of concentration was calculated per DCM requirements. Rational Method results are shown in the Appendix B & C. USDCM spreadsheets were used to design the detention and water quality pond features.

Storm Sewer Design

Storm Sewer systems will be designed to the 100-year storm and checked with the 5-year storm. Inlets will be placed at sump areas and intersections where street flow is larger than street capacity. UDFCD Inlet spreadsheet will be used to determine the size of all at-grade and sump inlets. There will be two systems within the site, one which will release into the West Pond in the Big Johnson Basin and one releasing into the East Pond in the Jimmy Camp Basin. These facilities will be designed as part of the Final Drainage Report (FDR) for the site.

Detention Storage Criteria

This report addresses the preliminary design stage of the 2 detention/water quality features within the proposed development. Ponds and water quality was based on the UDFCD Volume 3 spreadsheet for an Extended Detention Basin.

Preliminary storage volumes and outflows have been calculated for both detention facilities. A copy of these designs have been included in the appendix, as detention was not considered in the original MDDP report for the Big Johnson/Cruz Gulch Basin. Final calculations will be completed at the time of final platting for these facilities.

Deviations

A deviation is being requested for El Paso County ECM_Appendix I Section I.7.1.B: 1st Bullet; Providing Water Quality for Entire Development.

Approximately 4.6% (8.96 acres of 195.25) of the area inside the development boundary will not reach a proposed detention pond and/or proposed water quality facility. Of the area inside the development boundary that will not reach a facility only 1.0% (1.9 acres of 195.25) will be developed property consisting only of exterior boundary open space trail corridor/buffer tracts or anticipated future CDOT r.o.w. for the Bradley Road Powers Boulevard interchange.

The topography of the site will not allow all dedicated trail corridors to drain to proposed detention ponds. These open space/buffer areas consist of only 1.0% (1.9 acres) of the total 195.25 acres of the subject property. The remaining area not proposed for detention consist of a future CDOT tract for the interchange at Bradley Road and Powers Boulevard. The large trail/buffer tracts do not require detention or water quality because of the nature of the use and the fact that the open space will provide good areas for infiltration of rain water into the ground. The future CDOT area will be the responsibility of that entity for addressing water quality for the entire future interchange at the time of design and construction. In the meantime, the future CDOT area will remain open with only natural grasses in place.

DRAINAGE BASINS

Offsite Basins

There is one off site basin (OS-1) which contributes flow to the Jimmy Camp Basin of the development (JCD1) via twin 42" cmp's under Bradley Road (Design Point A). The contributing area of the basin is 12.66 acres, is currently undeveloped and generates 6.26 cfs and 33.54 cfs for the minor and major storm events.

Existing Drainage Analysis

Big Johnson Basin

There are two basins which are in the Big Johnson Basin portion of the development. Both of these basins release under Powers Boulevard via existing culverts to the Big Johnson Reservoir to the west.

- Basin BJD-13 (46.18 acres) is the top two-thirds of the area along Powers Boulevard and accounts for the majority of Basin BJD-13 shown in the MDDP. Flow is directed to an existing low spot located at Powers Boulevard (Design Point BJD-M) where an existing 60 cmp will release the flow into the open space on the west side of Powers and into the Big Johnson Reservoir. Flows for this basin are 19.06 cfs for the 5-year storm and 102.07 cfs for the 100-year storm.
- Basin BJD-13A (10.72 acres) is the remaining portion of the development along the Powers corridor and accounts for the remainder of the MDDP Basin BJD-13. This flow will leave the site at the southwest corner (Design Point B) where it is directed along Powers Boulevard to an existing 48" cmp directly south of the site. The existing culvert will release into the open space on the west side of Powers and reach the Big Johnson Reservoir. This basin generates 4.70 cfs and 25.14 cfs for the 5 and 100-year storms.

Jimmy Camp Basin

There are 3 existing basins which are located within the Jimmy Camp basin for this proposed development. The offsite basin discussed previously, is also located within the Jimmy Camp Basin. The three on site basins are described below.

- Basin JCD-2 (9.25 acres) located at Bradley Road and the northeast corner of the site. Flows in this basin are carried within the roadside ditch and leave the site at Design Point JCD-C (Corresponds to the same design point in the MDDP). Flows for this basin are 4.96 cfs for the 5-year storm and 26.55 cfs for the 100-year storm.
- Basin JCD-1 (120.14 acres) covers the majority of the site in the Jimmy Camp basin between Bradley Road and the south boundary. This Basin accepts flow from basin OS-1 via two existing 42-inch cmp's as described in the Offsite Basin section of this report. Flow is conveyed through natural swales till it exits the site along the eastern boundary at Design Point JCD-B, which corresponds to the same MDDP design point. An existing embankment is located just downstream of this design point. This basin generates 43.23 cfs and 231.52 cfs for the 5 and 100-year storms.
- Basin JCD-1A (20.80 acres) is located along the southern boundary of the site and exits to the south at Design Point C. Flows for this basin are 8.99 cfs for the 5-year storm and 48.16 cfs for the 100-year storm.

Proposed Drainage Analysis

The proposed development lies within two separate basins: Jimmy Camp Creek and the Big Johnson. The eastern two-thirds, which is located in the Jimmy Camp Creek Basin, will all head to the east towards the East Pond, where it will be intercepted prior to exiting the site. The western third of the site is all directed towards the West Pond, located along the Powers Boulevard, where flows will be detained prior to exiting the site and entering the open space/Big Johnson Reservoir on the east side of the roadway. Below is a summary of the Design Points within each of these two basins.

Big Johnson Basin

The area within the Big Johnson Basin is approximately 46.5 acres. This area will include a portion of the commercial area and future ROW Ramp area for Powers Boulevard, both located at the northwest area of the site. Flows will all be directed via curb and gutter to various inlets through the site, where all flows will release into the West Pond, which has been designed to release flows less than historic, as the Big Johnson Reservoir no longer is able to accept any additional flows. Below is a summary of the design points within the Big Johnson Basin.

- Design Point AAA ($Q_5=3.0$, $Q_{100}=8.6$) consists of flow from Basins 102 and 103. Flows are combined at the intersection of Road R and Road O and continue to the south as gutter flow in Road R to DP-AAA.
- Design Point BBB ($Q_5=4.0$, $Q_{100}=11.1$) consists of flow from Basin 104 and DP-AAA. Flows are combined at the intersection of Road R and Road O and continue to the south as gutter flow in Road R to DP-CCC.

- Design Point CCC ($Q_5=9.2$, $Q_{100}=22.2$) consists of flow from Basins 106 and DP-BBB. It is anticipated that an at-grade inlet will be installed to intercept these flows in Road R. Any flow by will continue south in Road R to DP-III.
- Design Point DDD ($Q_5=3.0$, $Q_{100}=8.0$) consists of flow from Basins 113 and 114. Flows are combined at the intersection of Road S and Road V and continue to the south as gutter flow in Road S to DP-DDD.
- Design Point EEE ($Q_5=4.4$, $Q_{100}=11.5$) consists of flow from Basin 115 and DP-DDD. It is anticipated that an at-grade inlet will be installed to intercept these flows. Any flow by will continue to street flow to the south in Road S to DP-FFF.
- Design Point FFF ($Q_5=2.6$, $Q_{100}=9.8$) consists of flow from Basins 116 and 117, along with any bypass flow from the inlet at DP-EEE. Flows are combined at the intersection of Road W and Road S and continue to the south as gutter flow in Road S to DP-GGG.
- Design Point GGG ($Q_5=3.8$, $Q_{100}=13.2$) consists of flow from Basin 118 and DP-FFF. It is anticipated that an at-grade inlet will be needed to intercept these flows. Flow by will continue south in Road S to DP-HHH.
- Design Point HHH ($Q_5=2.4$, $Q_{100}=7.9$) consists of flow from Basin 119 and bypass flow from DP-GGG. Flows will continue as gutter flow in Road R to DP-III.
- Design Point III ($Q_5=6.8$, $Q_{100}=21.2$) consists of flow from Basin 120, DP-HHH and bypass flow from the at-grade inlet at DP-CCC. Flows will continue south as gutter flow in Road R to DP-LLL.
- Design Point JJJ ($Q_5=0.7$, $Q_{100}=2.1$) consists of flow from Basin 105. Flows are combined at the intersection of Road R and Road T and continue to the south as gutter flow in Road R.
- Design Point KKK ($Q_5=4.9$, $Q_{100}=9.9$) consists of flow from Basins 107 and 108 and DP-JJJ. It is anticipated that an at-grade inlet will be used to intercept these flows. Any flow by will continue to the west in Road M to DP-LLL.
- Design Point LLL ($Q_5=2.7$, $Q_{100}=17.1$) consists of flow from Basin 121 and bypass flows from DP-III and DP-KKK. An at-grade inlet will be utilized to intercept these flows. Bypass flows will continue as street flow to the west in Road M to the low point at DP-NNN.
- Design Point MMM ($Q_5=1.1$, $Q_{100}=3.7$) consists of flow from Basin 109. Flows are combined at the intersection of Road R and Road M and continue to the west as gutter flow in Road M to DP-OOO.
- Design Point NNN ($Q_5=4.7$, $Q_{100}=12.8$) consists of flow from Basins 122 and 125 along with bypass flow from DP-LLL. A sump inlet will be installed at this location in Road M to intercept the remaining street flow. This will connect with the storm system which releases into the West Pond along Powers Boulevard.

- Design Point OOO ($Q_5=4.2$, $Q_{100}=5.5$) consists of flow from Basin 123 along with street flow from DP-MMM. A sump inlet will be installed here to intercept the street flow on the west side of Road M. This will connect with the storm system which will release into the West Pond.
- Basin 124 ($Q_5=3.5$, $Q_{100}=4.8$) consists of flow from Basin 124. The flow from this basin will be directed from the back of lots at the southwest corner of the property to a water quality facility (rain garden) which will treat the runoff prior to it leaving the site.
- Design Point PPP ($Q_5=2.6$, $Q_{100}=8.6$) consists of flow from Basin 130. This is a low point in Road L, where a sump inlet will be installed to intercept this flow. The inlet will connect to the main storm system and release into the West Pond.
- Design Point QQQ ($Q_5=1.7$, $Q_{100}=6.0$) consists of flow from Basin 131. This is a low point in Road L, where a sump inlet will be installed to intercept this flow. The inlet will connect to the main storm system and release into the West Pond.
- Design Point RRR ($Q_5=3.1$, $Q_{100}=9.2$) consists of flow from Basins 110, 111 and 126. Flows are combined at the intersection of Road L and Road O and continue to the south as gutter flow in Road L at DP-SSS.
- Design Point SSS ($Q_5=4.7$, $Q_{100}=11.7$) consists of flow from Basins 112 and 127 along with street flow from DP-RRR. It is anticipated that an ag-grade inlet will be installed to intercept the combined street flow. Flow by will continue south in Road L to DP-TTT.
- Design Point TTT ($Q_5=5.9$, $Q_{100}=16.4$) consists of flow from Basin 128 and bypass flow from DP-SSS. This is a low point in Road L, where a sump inlet will be installed to intercept this flow. The inlet will connect to the main storm system and release into the West Pond.
- Design Point UUU ($Q_5=5.7$, $Q_{100}=13.7$) consists of flow from Basin 129 and flow by from the inlet at DP-100. This is a low point in Road L, where a sump inlet will be installed to intercept this flow. The inlet will connect to the main storm system and release into the West Pond.
- Design Point VVV ($Q_5=2.5$, $Q_{100}=7.2$) consists of flow from Basin 200a. This basin is the back portion of lots along Road L and a buffer area just north of the West Pond. Flows will be directed towards the pond via a swale.
- Design Point West Pond ($Q_5=69.8$, $Q_{100}=128.8$) consists of all of the flow from the Big Johnson portion of the site. This design point corresponds to Design Point BJD-M in the Waterview MDDP. Based on the detention pond spreadsheet, the release rate of the pond at this location is 1.1 cfs and 40.3 cfs for the 5 and 100-year events. The current pipes located under the roadway will be replaced with the new pipe/outlet for the pond. Existing flows were 19.1 cfs and 102.1 cfs. With the decrease in flows, there are no anticipated impacts to downstream facilities.
- Design Point DP-B is located at the southwest corner of the site and corresponds with Basin 202. Flows are released into Powers Boulevard ROW, where they are intercepted by an existing 48" CMP. Flows from this basin are 9.2 cfs and 10.3 cfs for the 5 and 100-year storm events.

- Basin 200 runs along Powers Boulevard and encompasses flows within the existing right-of-way for Powers. Flows are directed through an existing roadside ditch along the roadway to the south, where an existing 60-inch cross culvert intercept flow and directs it west under Powers Boulevard. This Basin also accepts flow from Basin 150. This basin generates 16.76 cfs for the 5-year storm and 17.87 cfs for the 100-year storm.
- Basin 150 is the western portion of the commercial development, this area is anticipated to be future CDOT r.o.w. The proposed overlot grading (and existing conditions) indicates flows will be directed towards the west, to the existing roadside ditch in Powers Boulevard. Development within the commercial area will need to design for their own water quality/detention; at this point that design is anticipated to be completed by CDOT as part of the future interchange design. This basin generates 28.60 cfs for the 5-year storm and 30.50 cfs for the 100-year storm.
- Basin 202 runs along Powers Boulevard and encompasses flows from the existing road right-of-way. Flows are directed through an existing roadside ditch along the roadway to the north, where an existing 60-inch cross culvert intercept flow and directs it west under Powers Boulevard. This Basin also accepts flow from Basin 150. This basin generates 9.21 cfs for the 5-year storm and 10.33 cfs for the 100-year storm.

Jimmy Camp Creek Basin

The area within the Jimmy Camp Creek Basin is approximately 147.0 acres. This area will include a portion of the commercial area along with residential. Flows will all be directed via curb and gutter to various inlets through the site, where the majority of all flows will release into the East Pond, which has been designed to release flows less than historic, into an existing drainageway east of the development. Below is a summary of the design points within the Jimmy Camp Creek Basin.

- Design Point A ($Q_5=32.3$, $Q_{100}=56.3$) consists of flow from Basin 3 along with bypass flow from the at-grade inlet in Basin 4. A sump inlet will be installed at this location in Road K to intercept the remaining street flow. This will connect with the storm system which releases into the East Pond.
- Design Point B ($Q_5=3.6$, $Q_{100}=10.3$) consists of flow from Basins 6 and 7. A sump inlet will be installed here to intercept the street flow on the east side of Road K. This will connect with the storm system which will release into the East Pond.
- Design Point C ($Q_5=2.8$, $Q_{100}=8.0$) consists of flow from Basins 9 and 10. Flows are combined at the intersection of Road U and Road P and continue to the south as gutter flow in Road P to DP-D.
- Design Point D ($Q_5=3.6$, $Q_{100}=10.1$) consists of flow from Basins 8 and 11 and street flow from DP-C. Flows are combined at the southwest intersection of Road U and Road P and continue to the south as gutter flow in Road P to DP-E.
- Design Point E ($Q_5=7.3$, $Q_{100}=19.6$) consists of flow from Basins 12 and 13 with street flow from DP-E. Flows are combined at the intersection of Road P and Road O and continue to the south as gutter flow in Road P to DP-F.

- Design Point F ($Q_5=8.7$, $Q_{100}=23.3$) consists of flow from Basin 14 and DP-E. Flows are combined at the intersection of Road P and Road O and continue to the south as gutter flow in Road P to DP-G.
- Design Point G ($Q_5=12.2$, $Q_{100}=22.4$) consists of flow from Basin 16. It is anticipated that an at-grade inlet will be needed to intercept these flows. Flow by will continue south in Road T to DP-H.
- Design Point H ($Q_5=7.8$, $Q_{100}=18.3$) consists of flow from Basin 15 and flow by from DP-G. It is anticipated that an at-grade inlet will be needed to intercept these flows. Flow by will continue south in Road M to DP-I.
- Design Point I ($Q_5=5.2$, $Q_{100}=14.7$) consists of flow from Basins 23 and 24 along with flow by from DP-H. Flows are combined at the intersection of Road Q and Road M and continue to the east as gutter flow in Road M to DP-J.
- Design Point J ($Q_5=6.7$, $Q_{100}=17.1$) consists of flow from Basin 28 and street flow from DP-I. Flows are combined at the intersection of Road Q and Road M and continue to the east as gutter flow in Road M to DP-K.
- Design Point K ($Q_5=9.9$, $Q_{100}=22.3$) consists of flow from Basins 29 and 30 with street flow from DP-J. It is anticipated that an at-grade inlet will be needed to intercept these flows. Flow by will continue east in Road M to DP-L.
- Design Point L ($Q_5=4.1$, $Q_{100}=14.0$) consists of flow from Basin 34 and by pass flow from DP-K. It is anticipated that an at-grade inlet will be needed to intercept these flows. Flow by will continue east in Road M to DP-M.
- Design Point M ($Q_5=1.4$, $Q_{100}=8.4$) consists of flow from Basins 35 and 36 along with by-pass flow from DP-L. Flows are combined at the intersection of Road Z and Road M and continue to the east as gutter flow in Road M to DP-N.
- Design Point N ($Q_5=3.8$, $Q_{100}=9.6$) consists of flow from Basin 37 and DP-M. Flows are combined at the intersection of Road Z and Road M and continue to the east as gutter flow in Road M to DP-O.
- Design Point RR ($Q_5=9.5$, $Q_{100}=25.5$) consists of flow from Basins 32, 32 and 33 at the intersection of Road X with Road N. It is anticipated that an at-grade inlet will be needed to intercept these flows at the southwest corner of the intersection. Flow by will continue south in Road N to DP-O.
- Design Point O ($Q_5=5.4$, $Q_{100}=17.0$) consists of flow from Basins 38 and 39, along with street flow from DP-N and by pass flow DP-RR. It is anticipated that an at-grade inlet will be needed to intercept these flows at the northwest corner of Road N and Road M. Flow by will continue east in Road M to DP-SS.
- Design Point P ($Q_5=10.8$, $Q_{100}=27.1$) consists of flow from Basin 21 and DP-F with by-pass flow from a proposed at-grade inlet in Basin 22. It is anticipated that an at-grade inlet will be needed,

at the southwest corner of Road Q and Road P to intercept these flows. Flow by will continue south in Road P to DP-Q.

- Design Point Q ($Q_5=3.8$, $Q_{100}=17.3$) consists of flow from Basin 27 and by pass flow from DP-P. It is anticipated that an at-grade inlet will be needed to intercept these flows at the southeast corner of the Road Q and Road P intersection. Flow by will continue south in Road P to DP-R.
- Design Point R ($Q_5=0.7$, $Q_{100}=6.63$) consists of flow from Basin 26 and flow by from the at-grade inlet at DP-Q. It is anticipated that an at-grade inlet will be needed at the southwest corner of Road N and Road P to intercept these flows. Flow by will continue south in Road P to DP-QQ.
- Design Point S ($Q_5=14.6$, $Q_{100}=32.4$) consists of flow from Basins 5, 52, 54 and 55 at the intersection of Road A and Road K. It is anticipated that an at-grade inlet will be needed to intercept these flows. Flow by will continue south in Road A to DP-T. At this location, flows from the twin existing 42" CMP's from the offsite basin OS-1, will be combined with the proposed storm system for total flows of 51.5 cfs and 110.7 cfs for the minor and major storms.
- Design Point Z ($Q_5=9.7$, $Q_{100}=22.2$) consists of flow from Basins 53, 64 and 65. Flows are combined at the intersection of Road E and Road D and continue to the south as gutter flow in Road E to DP-AA.
- Design Point AA ($Q_5=12.6$, $Q_{100}=28.0$) consists of flow from Basins 67 and 68 with street flow from DP-Z. It is anticipated that an at-grade inlet will be needed to intercept these flows at the southwest corner of the Road E and Road C intersection. Flow by will continue south in Road E to DP-LL.
- Design Point LL ($Q_5=8.4$, $Q_{100}=25.5$) consists of flow from Basin 77 and flow by from DP-AA. It is anticipated that an at-grade inlet, at the northeast corner of the Road E and Road H intersection, will be needed to intercept these flows. Flow by will continue south in Road E to DP-T.
- Design Point T ($Q_5=3.7$, $Q_{100}=22.6$) consists of flow from Basin 79, bypass flow from Basin 51, DP-S and DP-LL. A sump inlet will be installed at this location in Road A to intercept the remaining street flow. This will connect with the storm system which releases into the East Pond.
- Design Point U ($Q_5=4.7$, $Q_{100}=11.5$) consists of flow from Basins 19 and 43. Flows are combined at the intersection of Road A and Road O and continue to the south as gutter flow in Road A to DP-V.
- Design Point V ($Q_5=5.2$, $Q_{100}=12.6$) consists of flow from Basin 20 and DP-U. Flows are combined at the intersection of Road A and Road O and continue to the south as gutter flow in Road A to DP-W.
- Design Point W ($Q_5=8.6$, $Q_{100}=19.2$) consists of flow from Basin 44 and DP-V. It is anticipated that an at-grade inlet will be needed at the southwest corner of Road O and Road A to intercept these flows. Flow by will continue south in Road A to DP-X.

- Design Point X ($Q_5=2.0$, $Q_{100}=9.6$) consists of flow from Basin 50 and bypass flow from DP-W. A sump inlet will be installed at this location in Road A to intercept the remaining street flow. This will connect with the storm system which releases into the East Pond.
- Design Point Y ($Q_5=5.0$, $Q_{100}=11.6$) consists of flow from Basins 62 and 63. It is anticipated that an at-grade inlet will be needed to intercept these flows at the northeast corner of Road B and Road D. Flow by will continue east and then south in Road E to DP-MM.
- Design Point BB ($Q_5=10.3$, $Q_{100}=24.8$) consists of flow from Basin 56. A sump inlet will be installed at this location in Road H to intercept the street flow. This will connect with the storm system which releases into the East Pond.
- Design Point CC ($Q_5=3.5$, $Q_{100}=9.2$) consists of flow from Basins 68 and 69. Flows are combined at the northwest intersection of Road I and Road G and continue to the south as gutter flow in Road G to DP-DD.
- Design Point DD ($Q_5=4.8$, $Q_{100}=12.4$) consists of flow from Basin 70 and DP-CC. Flows are combined at the southwest intersection of Road I and Road G and continue to the south as gutter flow in Road G to DP-EE.
- Design Point EE ($Q_5=8.0$, $Q_{100}=20.0$) consists of flow from Basins 71 and 84 with street flow from DP-DD. Flows are combined at the intersection of Road J and Road G and continue to the south as gutter flow in Road G to DP-FF.
- Design Point FF ($Q_5=9.2$, $Q_{100}=22.8$) consists of flow from Basin 72 and DP-EE. It is anticipated that an at-grade inlet, at the southwest corner of Road J and Road G will be needed to intercept these flows. Flow by will continue south in Road G to DP-GG.
- Design Point GG ($Q_5=8.9$, $Q_{100}=28.0$) consists of flow from Basins 73 and 85 with flow by from DP-FF. It is anticipated that an at-grade inlet, at the northwest corner of Road G and Road F will be needed to intercept these flows. Flow by will continue south in Road G to DP-HH.
- Design Point HH ($Q_5=8.1$, $Q_{100}=30.5$) consists of flow from Basins 58 and 59 with bypass flow from DP-GG. It is anticipated that an at-grade inlet, at the southwest corner of Road G and Road F will be needed to intercept these flows. Flow by will continue south in Road G to DP-II.
- Design Point KK ($Q_5=8.0$, $Q_{100}=19.2$) consists of flow from Basins 57 and 76. A sump inlet will be installed at this location in Road H to intercept the remaining street flow. This will connect with the storm system which releases into the East Pond.
- Design Point II ($Q_5=1.0$, $Q_{100}=14.9$) consists of flow from Basin 74 along with street flow from DP-KK and bypass flow from DP-HH. A sump inlet will be installed here, on the west side of Road G to intercept the street flow. This will connect with the storm system which will release into the East Pond.
- Design Point JJ ($Q_5=7.1$, $Q_{100}=17.3$) consists of flow from Basin 75. A sump inlet will be installed at this location in Road G to intercept the east side of the street flow. This will connect with the storm system which releases into the East Pond.

- Design Point MM ($Q_5=12.1$, $Q_{100}=20.3$) consists of flow from Basin 78 along with bypass flow from DP-Y. A sump inlet will be installed here to intercept the street flow on the northeast corner of Road A and Road E. This will connect with the storm system which will release into the East Pond.
- Design Point VV ($Q_5=5.4$, $Q_{100}=13.5$) consists of flow from Basins 18 and 25. Flows are combined at the intersection of Road P and Road N and continue to the south as gutter flow in Road P to DP-NN.
- Design Point NN ($Q_5=6.3$, $Q_{100}=15.5$) consists of flow from Basins 45 and 46 with street flow from DP-NN. It is anticipated that an at-grade inlet will be needed to intercept these flows at the northeast corner of the intersection. Flow by will continue south in Road P to DP-OO.
- Design Point OO ($Q_5=3.3$, $Q_{100}=10.4$) consists of flow from Basins 47 and 80 with flow by from DP-NN. It is anticipated that an at-grade inlet will be needed at the north corner of the intersection of Roads P and E, to intercept these flows. Flow by will continue south in Road P to DP-PP.
- Design Point PP ($Q_5=3.0$, $Q_{100}=10.6$) consists of flow from Basin 81 and bypass flow from DP-OO. It is anticipated that an at-grade inlet will be needed to intercept these flows. Flow by will continue south in Road P to DP-QQ.
- Design Point QQ ($Q_5=4.3$, $Q_{100}=17.6$) consists of flow from Basins 48 and 82 along with flow by from DP-R and DP-PP. A sump inlet will be installed here to intercept all the remaining street flow in Road P. This will connect with the storm system which will release into the north side of the East Pond.
- Design Point SS ($Q_5=3.5$, $Q_{100}=10.1$) consists of flow from Basin 40 and flow by from DP-O. Flows are combined at the intersection of Road N and Road M and continue to the east as gutter flow in Road M to DP-UU.
- Design Point TT ($Q_5=3.6$, $Q_{100}=9.0$) consists of flow from Basin 17. It is anticipated that an at-grade inlet will be needed to intercept these flows at the southeast corner of the Road M and N intersection. Flow by will continue east in Road M to DP-UU.
- Design Point UU ($Q_5=13.5$, $Q_{100}=25.5$) consists of flow from Basins 42 and 86 along with street flow from DP-SS and bypass flow from DP-TT. A sump inlet will be installed here to intercept the remaining street flow in Road M. This will connect with the storm system which will release into the south side of the East Pond.
- Design Point WW ($Q_5=5.5$, $Q_{100}=9.9$) consists of flow from Basins 17a, 42a and 86a. The flow from these basins will be directed through proposed swales along the property boundary to a water quality facility (rain garden) which will treat the runoff prior to it leaving the site.
- Design Point East Pond ($Q_5=92.9$, $Q_{100}=148.3$) consists of all of the flow from the Jimmy Camp Creek portion of the site. Based on the detention pond spreadsheet, the release rate of the pond at this location is 1.1 cfs and 130.1 cfs for the 5 and 100-year events, which are well below the

existing flows at this location. The pond will release into an existing drainageway prior to exiting the development site and continue along the same flow path as shown under existing conditions.

- Design Point JCD-B is at the southeast corner of the site in the Jimmy Camp Creek Basin. Under proposed conditions, this design point combines Design Point WW with the East Pond Discharge. These basins combined with the East Pond Discharge result in a developed flow at Design Point JCD-B of 10.1 cfs 5-year and 145.3 cfs 100-year. This developed Design Point corresponds to Design Point JCD-B historic flow which has 170 cfs and 335 cfs for the existing minor and major storms in the Waterview MDDP Amendment. Flows are less than existing flows noted in the MDDP.
- Design Point JCD-C is the location on the east side of the project where flows exit the site along Bradley Road. This includes Basins 60 and 61, which flow east in existing roadside ditch on the south side of Bradley Road, until improvements are made to the roadway. Flows at this location are 11.0 and 15.9 cfs for the minor and major storms. Existing flows are 5.0 cfs and 26.6 cfs. Even though there is a small increase in the 5-year storm, due to the over detention with the East Pond, overall discharge in the Jimmy Camp Creek Basin will be less than historic and there will be no negative impacts to downstream facilities. Upgraded drainage facilities will be designed with future Bradley Road improvements. During the interim period, a temporary WQ facility (rain garden) will be constructed at the east property line to treat the proposed run off. This facility will treat approximately 0.09 acres of the combined basins, which are an undeveloped trail corridor/buffer area. The existing topo causes the majority of the basins to drain towards Bradley Road row. The proposed temporary facility will treat this runoff, prior to it exiting the site and entering the row.

DRAINAGE FACILITY DESIGN

General Concept

Waterview East is located within the Big Johnson and Jimmy Camp Creek Drainage Basins. Approximately one-third of the site drains towards the west in the Big Johnson Basin and the remaining two-thirds drains towards the east in the Jimmy Camp Basin.

Storm Sewer System

All development is anticipated to be urban and will include storm sewer and street inlets. Storm sewers collect storm water runoff and convey the runoff to water quality/detention facilities prior to discharging to historic drainages.

As commercial and residential development continues in this area, there will be a need for storm system design. Final Plat submittals will include details concerning inlet location, storm sewer sizing and locations as part of the Final Drainage Report for each submittal.

On-Site Water Quality & Detention

There are two proposed water quality/detention ponds on site that will provide water quality and detention for proposed improvements. These facilities are private and will be maintained by Waterview II Metropolitan District. All flows will pass through the outlet structures of one of the two proposed ponds except for the small areas as discussed in this report. The outlet structures of the ponds will be

designed to detain onsite flows and release at 90% of predevelopment flows plus any contributing offsite flows. Pond sizing calculations are provided in Appendix D.

The WQCV is treated through two proposed extended detention basins, East Pond and West Pond. There are no proposed major drainageways for the site that would need to be stabilized. The West Pond will treat the Big Johnson Basin. The overall area in this basin is 60.16 acres, 17.76 acres is right-of-way along Powers and is not treated through the pond. The overall area being treated by the WQ pond is 44.3 acres. The East Pond will treat the Jimmy Camp Creek Basin. Overall area in this basin is 150.26 acres. Basins which release directly offsite are 11.28 acres, leaving 138.98 acres left to be treated by the WQ facility.

Some site specific source control BMPs that will be implemented include, but are not limited to, silt fencing placed around downstream areas of disturbance, construction vehicle tracking pads at the entrances, designated concrete truck washout basin, designated vehicle fueling areas, covered storage areas, spill containment and control, etc.

Upon construction, a Non-Jurisdictional Water Impoundment Structure application to the Colorado State Engineer will be required. A copy of this application will be provided to El Paso County Planning & Community Development Department, when submitted to the state.

The Extended Detention Basins are shown on the Proposed Drainage Plan and the accompanying Pre-Development Grading and Erosion Control Plan in the final configuration. Outlet structures, fore bays, trickle channels, etc. will be constructed when final construction drawings are approved with Final Plat submittal. Temporary Sediment Basins shown of the Pre-Development Grading Plan will remain in place until full construction of the Extended Detention Basins and final stabilization.

Offsite Analysis

During Final Plat submittal and submittal and approval of final construction drawings for the Extended Detention Basins the Engineer of Record will need to include analysis offsite downstream of the EDB. Analysis of the West Pond is anticipated to be minimal with Powers Boulevard providing significant control of the West Pond discharge. The East Pond offsite downstream analysis will be more involved because of the existence of an existing Pond embankment a few hundred feet downstream and an FMIC ditch crossing of the receiving drainage swale. This analysis will be required as part of Final Drainage Report submittal.

Four Step Process

In accordance with the El Paso County Engineering Criteria Manual, Appendix I, this site has implemented the four step process to minimize adverse impacts of urbanization and helps with the management of smaller, frequently occurring events. The four step process includes reducing runoff volumes, treating and slowly releasing the water quality capture volume (WQCV), stabilizing drainageways, and implementing long-term source controls.

In order to reduce runoff volume, the new impervious area for the site was minimized. Existing features will be preserved as all of the offsite basins which are undeveloped open space will continue to be so, and all developable areas will be required to release existing flows and handle their own detention and water quality needs. Existing drainage paths have been maintained as much as possible to also help reduce overall impacts from the site.

The WQCV is treated through extended detention basins. The outlet structures for both ponds have been designed according to the FSD spreadsheet by UDFCD to ensure the release times of the facilities meet the requirements.

There are no proposed major drainageways for the site that would need to be stabilized. Downstream of the project, all flows enter into existing storm swales, which are adequate to handle existing release flows, which will be the case as both ponds are designed to release less than existing flows. Therefore, those downstream channel/facilities would also, not see any increase or adverse effects to their functionality.

Some site-specific source control BMPs that will be implemented include, but are not limited to, silt fencing placed around downstream areas of disturbance, construction vehicle tracking pads at the entrances, sediment ponds, designated concrete truck washout basin, designated vehicle fueling areas, covered storage areas, spill containment and control, etc.

Drainage and Bridge Fees

Both the Big Johnson and Jimmy Camp Creek Drainage Basins are part of the El Paso County drainage basin fee program. All applicable fees will be presented in the Final Drainage Report.

Drainage Infrastructure Costs

A presentation of accurate, complete and current estimated of cost proposed facilities will be presented with the Final Drainage Report.

SUMMARY

Development within the site is to be commercial/retail and residential. Approximately 1/3 of the site is within the Big Johnson Basin. There is one proposed crossing under Powers Boulevard. This crossing will have a detention pond just upstream to ensure that flows are being released at historic rates, as the Big Johnson Reservoir is not able to accept developed flows.

The Jimmy Camp Basins will have one location where flows are being released. This location will have a detention pond to ensure only historic flows are being released offsite.

REFERENCE MATERIALS

1. "City of Colorado Springs Drainage Criteria Manual Volume 1" May 2014.
2. Master Development Drainage Plan for Waterview, May 2006. Prepared by Merrick & Co.
3. "Big Johnson Reservoir/Crews Gulch Drainage Basin Planning Study", Kiowa Engineering Corporation, September 1991.
4. Soils Survey of El Paso County Area, Natural Resources Conservation Services of Colorado.
5. Flood Insurance Rate Study for El Paso County, Colorado and Incorporated Areas. Federal Emergency Management Agency, Revised March 17, 1997.
6. "City of Colorado Springs Drainage Criteria Manual, Volume 2: Stormwater Quality Policies, Procedures and Best Management Practices (BMPs)" May 2014.
7. "Engineering Criteria Manual El Paso County" January 9, 2006, Revised July 29, 2015.
8. "Urban Storm Drainage Criteria Manual, Volume 1: Management, Hydrology & Hydraulics" Original September 1969, Updated January 2016.
9. "Urban Storm Drainage Criteria Manual, Volume 2: Structures, Storage & Recreation" Original September 1969, Updated January 2016.
10. "Urban Storm Drainage Criteria Manual, Volume 3: Stormwater Quality" Original September 1992, Updated November 2010.
11. "Amendment to Waterview Master Drainage Development Plan" July 21, 2014. Prepared by Springs Engineering.

Figure 1: Vicinity Map

Figure 2: FIRM Map

Figure 3: Existing Drainage Map

Figure 4: Proposed Drainage Map

Appendix A: NRCS Soil Report

Appendix B: Existing Hydrology Calculations


Appendix C: Proposed Hydrology Calculations

Appendix D: Detention Pond & Water Quality Calculations


Appendix E: Deviation Request

Figure 1: Vicinity Map

V:\1817\ACTIVE\181710214\REPORTS\DRAINAGE\EXHIBITS\FIG01&02&03-VMAP&SOILS&FIRM.DWG
8/16/2017 3:37 PM

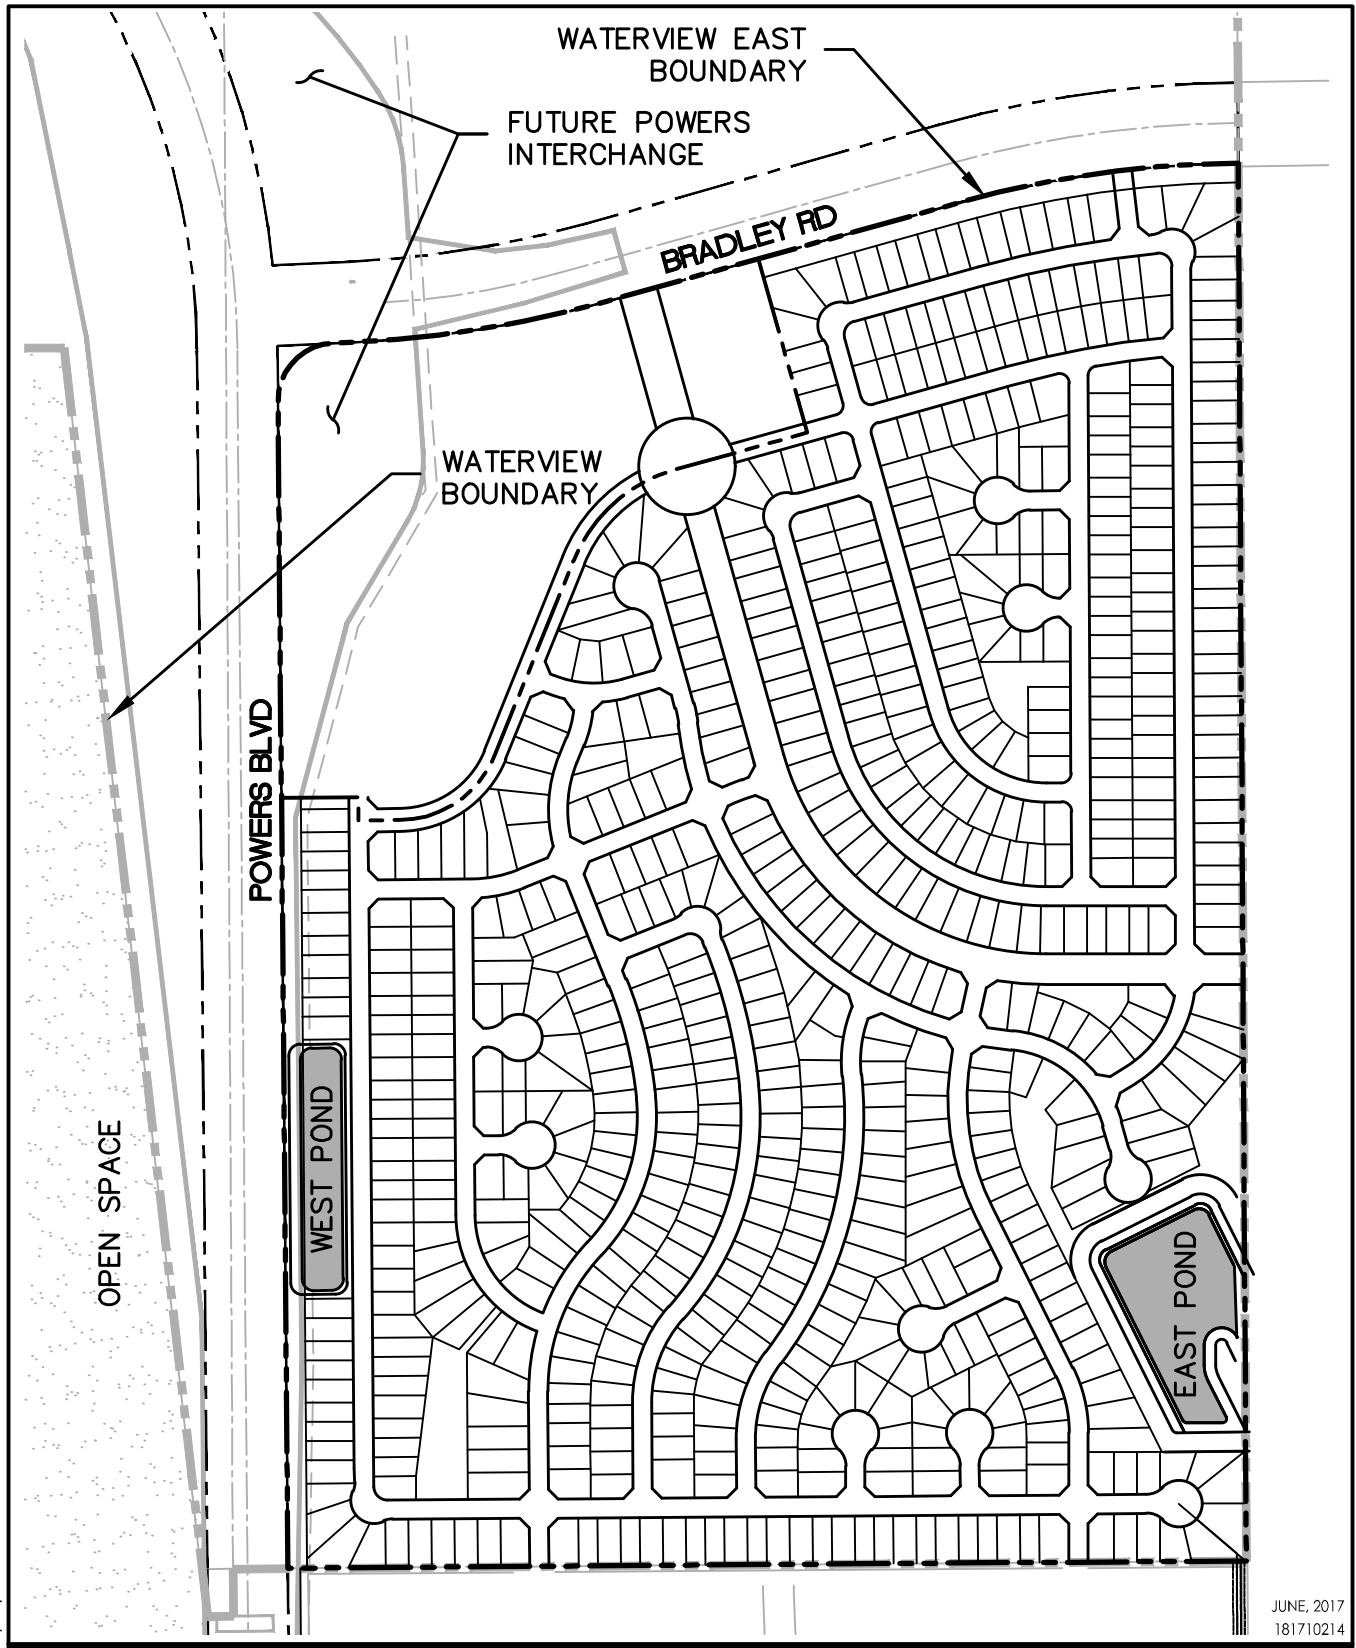

JUNE, 2017
181710214



1110 ELKTON DRIVE, SUITE B
COLORADO SPRINGS, CO 80907
www.stantec.com

Client/Project
CPR ENTITLEMENTS, LLC
WATERVIEW EAST

Figure No.
1.0

Title
VICINITY MAP

Figure 2: FIRM Map



APPROXIMATE SCALE IN FEET

500 0 500

NEW

CORPORATE LIMITS

EL PASO COUNTY
UNINCORPORATED AREAS
080059

9

8

CITY OF COLORADO SPRINGS
080060

NOTE: MAP AREA SHOWN ON THIS PANEL IS LOCATED WITHIN
TOWNSHIP 15 SOUTH, RANGE 65 WEST AND TOWNSHIP 14 SOUTH,
RANGE 65 WEST.

ZONE X

16

17

ZONE A

38°45'00"
104°41'15"

JOINS PANEL 0956

NATIONAL FLOOD INSURANCE PROGRAM

FIRM

FLOOD INSURANCE RATE MAP

EL PASO COUNTY,
COLORADO AND
INCORPORATED AREAS

PANEL 768 OF 1300

(SEE MAP INDEX FOR PANELS NOT PRINTED)

CONTAINS:
COMMUNITY

NUMBER PANEL SUFFIX

COLORADO SPRINGS, CITY OF
EL PASO COUNTY
UNINCORPORATED AREAS

080060 0768 F
080059 0768 F

MAP NUMBER
08041C0768 F

EFFECTIVE DATE:
MARCH 17, 1997



Federal Emergency Management Agency

This is an official copy of a portion of the above referenced flood map. It was extracted using F-MIT On-Line. This map does not reflect changes or amendments which may have been made subsequent to the date on the title block. For the latest product information about National Flood Insurance Program flood maps check the FEMA Flood Map Store at www.nsc.fema.gov

Appendix A: NRCS Soil Report



United States
Department of
Agriculture

NRCS

Natural
Resources
Conservation
Service

A product of the National
Cooperative Soil Survey,
a joint effort of the United
States Department of
Agriculture and other
Federal agencies, State
agencies including the
Agricultural Experiment
Stations, and local
participants

Custom Soil Resource Report for El Paso County Area, Colorado



June 21, 2017

Preface

Soil surveys contain information that affects land use planning in survey areas. They highlight soil limitations that affect various land uses and provide information about the properties of the soils in the survey areas. Soil surveys are designed for many different users, including farmers, ranchers, foresters, agronomists, urban planners, community officials, engineers, developers, builders, and home buyers. Also, conservationists, teachers, students, and specialists in recreation, waste disposal, and pollution control can use the surveys to help them understand, protect, or enhance the environment.

Various land use regulations of Federal, State, and local governments may impose special restrictions on land use or land treatment. Soil surveys identify soil properties that are used in making various land use or land treatment decisions. The information is intended to help the land users identify and reduce the effects of soil limitations on various land uses. The landowner or user is responsible for identifying and complying with existing laws and regulations.

Although soil survey information can be used for general farm, local, and wider area planning, onsite investigation is needed to supplement this information in some cases. Examples include soil quality assessments (<http://www.nrcs.usda.gov/wps/portal/nrcs/main/soils/health/>) and certain conservation and engineering applications. For more detailed information, contact your local USDA Service Center (<https://offices.sc.egov.usda.gov/locator/app?agency=nrcs>) or your NRCS State Soil Scientist (http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2_053951).

Great differences in soil properties can occur within short distances. Some soils are seasonally wet or subject to flooding. Some are too unstable to be used as a foundation for buildings or roads. Clayey or wet soils are poorly suited to use as septic tank absorption fields. A high water table makes a soil poorly suited to basements or underground installations.

The National Cooperative Soil Survey is a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local agencies. The Natural Resources Conservation Service (NRCS) has leadership for the Federal part of the National Cooperative Soil Survey.

Information about soils is updated periodically. Updated information is available through the NRCS Web Soil Survey, the site for official soil survey information.

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or a part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require

alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W., Washington, D.C. 20250-9410 or call (800) 795-3272 (voice) or (202) 720-6382 (TDD). USDA is an equal opportunity provider and employer.

Contents

Preface	2
Soil Map	5
Soil Map.....	6
Legend.....	7
Map Unit Legend.....	8
Map Unit Descriptions.....	8
El Paso County Area, Colorado.....	10
8—Blakeland loamy sand, 1 to 9 percent slopes.....	10
31—Fort Collins loam, 3 to 8 percent slopes.....	11
52—Manzanst clay loam, 0 to 3 percent slopes.....	12
56—Nelson-Tassel fine sandy loams, 3 to 18 percent slopes.....	13
86—Stoneham sandy loam, 3 to 8 percent slopes.....	15
108—Wiley silt loam, 3 to 9 percent slopes.....	17
References	19

Soil Map

The soil map section includes the soil map for the defined area of interest, a list of soil map units on the map and extent of each map unit, and cartographic symbols displayed on the map. Also presented are various metadata about data used to produce the map, and a description of each soil map unit.

Custom Soil Resource Report Soil Map



MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)

Soils

 Soil Map Unit Polygons

 Soil Map Unit Lines

 Soil Map Unit Points

Special Point Features

 Blowout

 Borrow Pit

 Clay Spot

 Closed Depression

 Gravel Pit

 Gravelly Spot

 Landfill

 Lava Flow

 Marsh or swamp

 Mine or Quarry

 Miscellaneous Water

 Perennial Water

 Rock Outcrop

 Saline Spot

 Sandy Spot

 Severely Eroded Spot


 Sinkhole

 Slide or Slip

 Sodic Spot

 Spoil Area

 Stony Spot

 Very Stony Spot

 Wet Spot

 Other

 Special Line Features

Water Features

 Streams and Canals

Transportation

 Rails

 Interstate Highways

 US Routes

 Major Roads

 Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
Web Soil Survey URL:
Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado
Survey Area Data: Version 14, Sep 23, 2016

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Apr 15, 2011—Sep 22, 2011

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

El Paso County Area, Colorado (CO625)			
Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
8	Blakeland loamy sand, 1 to 9 percent slopes	17.1	8.3%
31	Fort Collins loam, 3 to 8 percent slopes	0.0	0.0%
52	Manzanst clay loam, 0 to 3 percent slopes	21.0	10.2%
56	Nelson-Tassel fine sandy loams, 3 to 18 percent slopes	137.8	67.0%
86	Stoneham sandy loam, 3 to 8 percent slopes	5.7	2.8%
108	Wiley silt loam, 3 to 9 percent slopes	24.3	11.8%
Totals for Area of Interest		205.8	100.0%

Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not

mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however, onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

El Paso County Area, Colorado

8—Blakeland loamy sand, 1 to 9 percent slopes

Map Unit Setting

National map unit symbol: 369v
Elevation: 4,600 to 5,800 feet
Mean annual precipitation: 14 to 16 inches
Mean annual air temperature: 46 to 48 degrees F
Frost-free period: 125 to 145 days
Farmland classification: Not prime farmland

Map Unit Composition

Blakeland and similar soils: 85 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Blakeland

Setting

Landform: Flats, hills
Landform position (three-dimensional): Side slope, tal
Down-slope shape: Linear
Across-slope shape: Linear
Parent material: Alluvium derived from sedimentary rock and/or eolian deposits
derived from sedimentary rock

Typical profile

A - 0 to 11 inches: loamy sand
AC - 11 to 27 inches: loamy sand
C - 27 to 60 inches: sand

Properties and qualities

Slope: 1 to 9 percent
Depth to restrictive feature: More than 80 inches
Natural drainage class: Somewhat excessively drained
Runoff class: Low
Capacity of the most limiting layer to transmit water (Ksat): High to very high (5.95 to 19.98 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum in profile: 5 percent
Available water storage in profile: Low (about 4.5 inches)

Interpretive groups

Land capability classification (irrigated): 3e
Land capability classification (nonirrigated): 6e
Hydrologic Soil Group: A
Ecological site: Sandy Foothill (R049BY210CO)
Hydric soil rating: No

Minor Components

Other soils

Percent of map unit:
Hydric soil rating: No

Pleasant

Percent of map unit:

Landform: Depressions

Hydric soil rating: Yes

31—Fort Collins loam, 3 to 8 percent slopes

Map Unit Setting

National map unit symbol: 3684

Elevation: 5,200 to 6,500 feet

Mean annual precipitation: 14 to 16 inches

Mean annual air temperature: 48 to 52 degrees F

Farmland classification: Not prime farmland

Map Unit Composition

Fort collins and similar soils: 85 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Fort Collins

Setting

Landform: Hills

Landform position (three-dimensional): Side slope

Down-slope shape: Linear

Across-slope shape: Linear

Parent material: Loamy alluvium

Typical profile

A - 0 to 9 inches: loam

Bt - 9 to 16 inches: clay loam

Bk - 16 to 21 inches: clay loam

Ck - 21 to 60 inches: loam

Properties and qualities

Slope: 3 to 8 percent

Depth to restrictive feature: More than 80 inches

Natural drainage class: Well drained

Runoff class: Medium

Capacity of the most limiting layer to transmit water (Ksat): Moderately high to high (0.57 to 2.00 in/hr)

Depth to water table: More than 80 inches

Frequency of flooding: None

Frequency of ponding: None

Calcium carbonate, maximum in profile: 15 percent

Salinity, maximum in profile: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)

Available water storage in profile: High (about 10.1 inches)

Interpretive groups

Land capability classification (irrigated): None specified

Custom Soil Resource Report

Land capability classification (nonirrigated): 6e
Hydrologic Soil Group: B
Ecological site: Loamy Plains (R067BY002CO)
Other vegetative classification: LOAMY PLAINS (069AY006CO)
Hydric soil rating: No

Minor Components

Pleasant

Percent of map unit:
Landform: Depressions
Hydric soil rating: Yes

Other soils

Percent of map unit:
Hydric soil rating: No

52—Manzanst clay loam, 0 to 3 percent slopes

Map Unit Setting

National map unit symbol: 2w4nr
Elevation: 4,060 to 6,660 feet
Mean annual precipitation: 14 to 16 inches
Mean annual air temperature: 50 to 54 degrees F
Frost-free period: 130 to 170 days
Farmland classification: Prime farmland if irrigated

Map Unit Composition

Manzanst and similar soils: 85 percent
Minor components: 15 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Manzanst

Setting

Landform: Terraces, drainageways
Landform position (three-dimensional): Tread
Down-slope shape: Linear
Across-slope shape: Linear, concave
Parent material: Clayey alluvium derived from shale

Typical profile

A - 0 to 3 inches: clay loam
Bt - 3 to 12 inches: clay
Btk - 12 to 37 inches: clay
Bk1 - 37 to 52 inches: clay
Bk2 - 52 to 79 inches: clay

Properties and qualities

Slope: 0 to 3 percent
Depth to restrictive feature: More than 80 inches

Custom Soil Resource Report

Natural drainage class: Well drained
Capacity of the most limiting layer to transmit water (Ksat): Moderately low to moderately high (0.06 to 0.20 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum in profile: 15 percent
Gypsum, maximum in profile: 3 percent
Salinity, maximum in profile: Slightly saline (4.0 to 7.0 mmhos/cm)
Sodium adsorption ratio, maximum in profile: 10.0
Available water storage in profile: High (about 9.0 inches)

Interpretive groups

Land capability classification (irrigated): 3e
Land capability classification (nonirrigated): 4c
Hydrologic Soil Group: C
Ecological site: Saline Overflow (R067BY037CO)
Hydric soil rating: No

Minor Components

Ritoazul

Percent of map unit: 7 percent
Landform: Drainageways, interfluves
Landform position (three-dimensional): Rise
Down-slope shape: Linear
Across-slope shape: Linear
Ecological site: Clayey Plains (R067BY042CO)
Hydric soil rating: No

Arvada

Percent of map unit: 6 percent
Landform: Drainageways, interfluves
Down-slope shape: Linear
Across-slope shape: Linear
Ecological site: Salt Flat (R067XY033CO)
Hydric soil rating: No

Wiley

Percent of map unit: 2 percent
Landform: Interfluves
Down-slope shape: Linear
Across-slope shape: Linear
Ecological site: Loamy Plains (R067BY002CO)
Hydric soil rating: No

56—Nelson-Tassel fine sandy loams, 3 to 18 percent slopes

Map Unit Setting

National map unit symbol: 3690
Elevation: 5,600 to 6,400 feet

Custom Soil Resource Report

Mean annual precipitation: 12 to 14 inches
Mean annual air temperature: 48 to 52 degrees F
Frost-free period: 135 to 155 days
Farmland classification: Not prime farmland

Map Unit Composition

Nelson and similar soils: 45 percent
Tassel and similar soils: 30 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Nelson

Setting

Landform: Hills
Landform position (three-dimensional): Crest, side slope
Down-slope shape: Linear
Across-slope shape: Linear
Parent material: Calcareous residuum weathered from interbedded sedimentary rock

Typical profile

A - 0 to 5 inches: fine sandy loam
Ck - 5 to 23 inches: fine sandy loam
Cr - 23 to 27 inches: weathered bedrock

Properties and qualities

Slope: 3 to 12 percent
Depth to restrictive feature: 20 to 40 inches to paralithic bedrock
Natural drainage class: Well drained
Runoff class: Medium
Capacity of the most limiting layer to transmit water (Ksat): Moderately low to high (0.06 to 2.00 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum in profile: 10 percent
Salinity, maximum in profile: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)
Available water storage in profile: Very low (about 2.8 inches)

Interpretive groups

Land capability classification (irrigated): 4e
Land capability classification (nonirrigated): 6e
Hydrologic Soil Group: B
Ecological site: Shaly Plains (R067BY045CO)
Other vegetative classification: SHALY PLAINS (069AY046CO)
Hydric soil rating: No

Description of Tassel

Setting

Landform: Hills
Landform position (three-dimensional): Crest, side slope
Down-slope shape: Linear
Across-slope shape: Linear
Parent material: Calcareous slope alluvium over residuum weathered from sandstone

Typical profile

A - 0 to 4 inches: fine sandy loam
C - 4 to 10 inches: fine sandy loam
Cr - 10 to 14 inches: weathered bedrock

Properties and qualities

Slope: 3 to 18 percent
Depth to restrictive feature: 6 to 20 inches to paralithic bedrock
Natural drainage class: Well drained
Runoff class: Medium
Capacity of the most limiting layer to transmit water (Ksat): Moderately high (0.20 to 0.60 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum in profile: 10 percent
Available water storage in profile: Very low (about 1.2 inches)

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 6s
Hydrologic Soil Group: D
Ecological site: Shaly Plains (R067BY045CO)
Other vegetative classification: SHALY PLAINS (069AY046CO)
Hydric soil rating: No

Minor Components

Other soils

Percent of map unit:
Hydric soil rating: No

Pleasant

Percent of map unit:
Landform: Depressions
Hydric soil rating: Yes

86—Stoneham sandy loam, 3 to 8 percent slopes

Map Unit Setting

National map unit symbol: 36b2
Elevation: 5,100 to 6,500 feet
Mean annual precipitation: 13 to 15 inches
Mean annual air temperature: 48 to 52 degrees F
Frost-free period: 135 to 155 days
Farmland classification: Not prime farmland

Map Unit Composition

Stoneham and similar soils: 85 percent

Custom Soil Resource Report

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Stoneham

Setting

Landform: Hills
Landform position (three-dimensional): Side slope
Down-slope shape: Linear
Across-slope shape: Linear
Parent material: Calcareous loamy alluvium

Typical profile

A - 0 to 4 inches: sandy loam
Bt - 4 to 8 inches: sandy clay loam
Btk - 8 to 11 inches: sandy clay loam
Ck - 11 to 60 inches: loam

Properties and qualities

Slope: 3 to 8 percent
Depth to restrictive feature: More than 80 inches
Natural drainage class: Well drained
Runoff class: Medium
Capacity of the most limiting layer to transmit water (Ksat): Moderately high to high (0.60 to 2.00 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum in profile: 15 percent
Salinity, maximum in profile: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)
Available water storage in profile: High (about 9.5 inches)

Interpretive groups

Land capability classification (irrigated): 3e
Land capability classification (nonirrigated): 4e
Hydrologic Soil Group: B
Ecological site: Sandy Plains (R067BY024CO)
Other vegetative classification: SANDY PLAINS (069AY026CO)
Hydric soil rating: No

Minor Components

Pleasant

Percent of map unit:
Landform: Depressions
Hydric soil rating: Yes

Other soils

Percent of map unit:
Hydric soil rating: No

108—Wiley silt loam, 3 to 9 percent slopes

Map Unit Setting

National map unit symbol: 367b
Elevation: 5,200 to 6,200 feet
Mean annual precipitation: 12 to 14 inches
Mean annual air temperature: 48 to 52 degrees F
Frost-free period: 135 to 155 days
Farmland classification: Not prime farmland

Map Unit Composition

Wiley and similar soils: 85 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Wiley

Setting

Landform: Hills
Landform position (three-dimensional): Side slope
Down-slope shape: Linear
Across-slope shape: Linear
Parent material: Calcareous silty eolian deposits

Typical profile

A - 0 to 4 inches: silt loam
Bt - 4 to 16 inches: silt loam
Bk - 16 to 60 inches: silt loam

Properties and qualities

Slope: 3 to 9 percent
Depth to restrictive feature: More than 80 inches
Natural drainage class: Well drained
Runoff class: Medium
Capacity of the most limiting layer to transmit water (Ksat): Moderately high to high (0.60 to 2.00 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum in profile: 15 percent
Salinity, maximum in profile: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)
Available water storage in profile: High (about 11.5 inches)

Interpretive groups

Land capability classification (irrigated): 4e
Land capability classification (nonirrigated): 6e
Hydrologic Soil Group: B
Ecological site: Loamy Plains (R067BY002CO)
Other vegetative classification: LOAMY PLAINS (069AY006CO)
Hydric soil rating: No

Minor Components

Pleasant

Percent of map unit:

Landform: Depressions

Hydric soil rating: Yes

Other soils

Percent of map unit:

Hydric soil rating: No

Appendix B: Existing Hydrology Calculations

Standard Form SF-2 . Storm Drainage System Design (Rational Method Procedure)

Project:
Section:

Waterview East
Existing Conditions

Created by: CMD Date: 1/13/2017
Checked by: CKC Date:

P = 1.50 in

Design Storm: 5-yr

LOCATION	DESIGN POINT	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS
		AREA DESIGN (3)	AREA (A) (4)	RUNOFF COEFF (C) (5)	t _r (MIN) (6)	C.A. (AC) (7)	I (IN / HR) (8)	Q (CFS) (9)	t _r (MIN) (10)	SUM (C+A) (11)	I (IN / HR) (12)	Q (CFS) (13)	SLOPE (%) (14)	STREET FLOW (CFS) (15)	DESIGN FLOW (CFS) (16)	SLOPE (%) (17)	PIPE SIZE (INCHES) (18)	LENGTH (FT) (19)	VELOCITY (FPS) (20)	t _t (MIN) (21)	
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	(17)	(18)	(19)	(20)	(21)	(22)
Offsite Basin North of Bradley Rd	A	OS-1	12.66	0.16	18.26	2.02	3.09	6.26													
Part of Basin BJD-13 in MDDP	BJD-M	BJD-13	46.18	0.16	25.60	7.39	2.58	19.06													
Part of Basin BJD-13 in MDDP	B	BJD-13A	10.72	0.16	23.00	1.71	2.74	4.70													
Basin JCD-2 in MDDP	JCD-C	JCD-2	9.25	0.16	15.53	1.48	3.35	4.96													
Part of Basin JCD-1 in MDDP		JCD-1	120.14	0.16	32.37	19.22	2.25	43.23													
Combine JCD-1 & OS-1	JCD-B		132.79	0.16	32.37	21.25	2.25	47.79													
Part of Basin JCD-1 in MDDP	C	JCD-1A	20.80	0.16	23.56	3.33	2.70	8.99													

Standard Form SF-2 . Storm Drainage System Design (Rational Method Procedure)

Project: Waterview East
 Section: Existing Conditions
 Design Storm: 100-yr P = 2.52 in
 Created by: CMD Date: 1/13/2017
 Checked by: CKC Date:

LOCATION	DESIGN POINT	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE		TRAVEL TIME			REMARKS	
		BASIN ID	AREA (A)	RUNOFF COEFF (C)	t _c (MIN)	C.A. (AC)	I (IN / HR)	Q (CFS)	t _c (MIN)	SUM (C+A) (AC)	I (IN / HR)	Q (CFS)	SLOPE (%)	STREET FLOW (CFS)	DESIGN FLOW (CFS)	SLOPE (%)	PIPE SIZE (INCHES)	LENGTH (FT)	VELOCITY (FPS)		t (MIN)
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	(17)	(18)	(19)	(20)	(21)	(22)
Offsite Basin North of Bradley Rd	A	OS-1	12.66	0.51	18.26	6.45	5.20	33.54													
Part of Basin BJD-13 in MDDP	BJD-M	BJD-13	46.18	0.51	25.60	23.55	4.33	102.07													
Part of Basin BJD-13 in MDDP	B	BJD-13A	10.72	0.51	23.00	5.47	4.60	25.14													
Basin JCD-2 in MDDP	JCD-C	JCD-2	9.25	0.51	15.53	4.72	5.63	26.55													
Part of Basin JCD-1 in MDDP		JCD-1	120.14	0.51	32.37	61.27	3.78	231.52													
Combine JCD-1 & OS-1	JCD-B		132.79	0.51	32.37	67.72	3.78	255.91													
Part of Basin JCD-1 in MDDP	C	JCD-1A	20.80	0.51	23.56	10.61	4.54	48.16													

All Equations follow UDFCD Rational Method

- (1) Basin Description linked to C-Value Sheet
 (2) Basin Design Point
 (3) Enter the Basin Name from C-Value Sheet
 (4) Basin Area linked to C-Value Sheet
 (5) Composite C linked to C-Value Sheet
 (6) Time of Concentration linked to SF-1 Sheet
 (7) =Column 4 x Column 5
 (8) = $28.5^P / (10 + \text{Column } 6)^{0.786}$
 (9) =Column 7 x Column 8
 (10) =Column 6 + Column 21
 (11) Add the C.A. Values Column 7 to get the cumulative C.A. Values
 (12) = $28.5^P / (10 + \text{Column } 10)^{0.786}$
 (13) Sum of Qs
 (14) Additional Street Longitudinal Slope
 (15) Additional Street Overland Flow
 (16) Additional Pipe Design Flow
 (17) Additional Pipe Slope
 (18) Additional Pipe Size
 (19) Additional Flow Length
 (20) Street or Pipe Velocity
 (21) =Column 15 OR Column 16 OR Column 20 / 60

Appendix C: Proposed Hydrology Calculations

Standard Form SF-1 . Time of Concentration

Project: Waterview East
Section: Proposed Conditions

Urban TOC_{min} = 5 min
Rural TOC_{min} = 10 min

Created by: CMD
Checked by: CKC

Date: 1/23/2017
Date:

SUB-BASIN DATA				INITIAL/OVERLAND FLOW				TRAVEL TIME (t _t)						Tc CHECK (Urbanized basins)				FINAL Tc (min)	
Basin ID	Description	C _s	Area (ac)	Length, L (ft)	Slope, s (%)	t _i (min) (1)	(t _t)					t _t Travel Time (min) (4)	t _c = t _i + t _t (min)	Urban (Yes /No)	Length (ft)	T _c max (min) (5)	T _c max > t _c		
OS-1	Offsite - Fut Commercial	0.81	12.73	100	1.0%	5.24	885	5.0%	6	Paved areas and shallow paved swales	20.00	4.47	3.30	8.53	YES	985.00	15.47	Check	8.5
JIMMY CAMP CREEK BASIN																			
3	Fut Commercial	0.82	6.94	100	4.5%	3.10	955	3.0%	6	Paved areas and shallow paved swales	20.00	3.46	4.59	7.69	YES	1055.00	15.86	Check	7.7
4	Fut Commercial	0.82	4.93	100	7.0%	2.64	670	3.9%	6	Paved areas and shallow paved swales	20.00	3.95	2.83	5.47	YES	770.00	14.28	Check	5.5
5	Fut Commercial	0.83	3.72	100	10.0%	2.32	425	6.4%	6	Paved areas and shallow paved swales	20.00	5.06	1.40	3.72	YES	525.00	12.92	Check	5.0
6	Residential & Road "K"	0.57	0.36	13	2.0%	2.76	125	4.9%	6	Paved areas and shallow paved swales	20.00	4.43	0.47	3.23	YES	138.00	10.77	Check	5.0
7	Residential & Road "K"	0.60	1.37	30	2.0%	3.91	540	3.0%	6	Paved areas and shallow paved swales	20.00	3.46	2.60	6.51	YES	570.00	13.17	Check	6.5
8	Residential & Road "U"	0.65	0.16	10	2.0%	2.04	105	2.0%	6	Paved areas and shallow paved swales	20.00	2.83	0.62	2.66	YES	115.00	10.64	Check	5.0
9	Residential & Road "U"	0.51	0.87	45	2.0%	5.68	290	5.4%	6	Paved areas and shallow paved swales	20.00	4.65	1.04	6.72	YES	335.00	11.86	Check	6.7
10	Residential & Road "P"	0.70	0.50	55	2.0%	4.22	28	3.2%	6	Paved areas and shallow paved swales	20.00	3.58	0.13	4.35	YES	83.00	10.46	Check	5.0
11	Residential & Road "U"	0.77	0.18	60	2.0%	3.66	140	5.4%	6	Paved areas and shallow paved swales	20.00	4.65	0.50	4.16	YES	200.00	11.11	Check	5.0
12	Residential & Road "P"	0.46	1.33	40	2.0%	5.83	255	6.0%	6	Paved areas and shallow paved swales	20.00	4.90	0.87	6.70	YES	295.00	11.64	Check	6.7
13	Residential & Road "O"	0.51	0.86	50	2.0%	5.98	270	6.0%	6	Paved areas and shallow paved swales	20.00	4.90	0.92	6.90	YES	320.00	11.78	Check	6.9
14	Residential & Road "O"	0.52	0.79	50	2.0%	5.86	270	6.0%	6	Paved areas and shallow paved swales	20.00	4.90	0.92	6.78	YES	320.00	11.78	Check	6.8
15	Residential & Road "T"	0.60	2.75	65	2.0%	5.84	1760	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	14.67	20.51	YES	1825.00	20.14	Check	20.5
16	Residential & Road "T"	0.49	7.10	65	2.0%	7.02	1695	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	14.13	21.15	YES	1760.00	19.78	Check	21.1
17	Residential & Road "M"	0.63	1.63	50	2.0%	4.77	1210	6.0%	6	Paved areas and shallow paved swales	20.00	4.90	4.12	8.89	YES	1260.00	17.00	Check	8.9
17a	Residential	0.38	2.58	55	2.0%	7.68	160	7.0%	3	Short pasture and lawns	7.00	1.85	1.44	9.12	YES	215.00	11.19	Check	9.1
18	Residential & Road "P"	0.57	1.07	50	2.0%	5.37	665	3.2%	6	Paved areas and shallow paved swales	20.00	3.58	3.10	8.47	YES	715.00	13.97	Check	8.5
19	Residential & Road "O"	0.72	0.16	50	2.0%	3.87	85	8.5%	6	Paved areas and shallow paved swales	20.00	5.83	0.24	4.11	YES	135.00	10.75	Check	5.0

SUB-BASIN DATA					INITIAL/OVERLAND FLOW					TRAVEL TIME					TC CHECK				FINAL Tc
Basin ID	Description	Cs	Area (ac)	Length, L (ft)	Slope, s (%)	ti (min)	(ti)				(ti)				(Urbanized basins)				(min)
							Length	Sw (%)	Code	Description	Convey Coef (C _c) (z)	Velocity (V) (ft/s) (3)	ti Travel Time (min) (4)	TOTAL	Urban (Yes/No)	Length (ft)	Tcmax (min) (5)	Tcmax > ti	
20	Residential & Road "O"	0.90	0.18	50	2.0%	2.03	85	8.5%	6	Paved areas and shallow paved swales	20.00	5.83	0.24	2.27	YES	135.00	10.75	Check	5.0
21	Residential & Road "P"	0.54	0.83	40	2.0%	5.08	595	5.0%	6	Paved areas and shallow paved swales	20.00	4.47	2.22	7.30	YES	635.00	13.53	Check	7.3
22	Residential & Road "Q"	0.43	4.84	55	2.0%	7.12	795	3.5%	6	Paved areas and shallow paved swales	20.00	3.74	3.54	10.66	YES	850.00	14.72	Check	10.7
23	Residential & Road "Q"	0.44	2.67	50	2.0%	6.69	515	1.3%	6	Paved areas and shallow paved swales	20.00	2.24	3.84	10.52	YES	585.00	13.14	Check	10.5
24	Residential & Road "M"	0.59	0.37	70	2.0%	6.18	140	5.8%	6	Paved areas and shallow paved swales	20.00	4.82	0.48	6.67	YES	210.00	11.17	Check	6.7
25	Residential & Road "P"	0.54	1.74	80	2.0%	7.23	785	5.0%	6	Paved areas and shallow paved swales	20.00	4.47	2.93	10.15	YES	865.00	14.81	Check	10.2
26	Residential & Road "P"	0.65	0.29	45	2.0%	4.36	180	5.0%	6	Paved areas and shallow paved swales	20.00	4.47	0.67	5.03	YES	225.00	11.25	Check	5.0
27	Residential & Road "Q"	0.60	1.13	100	2.0%	7.14	800	3.5%	6	Paved areas and shallow paved swales	20.00	3.74	3.56	10.71	YES	900.00	15.00	Check	10.7
28	Residential & Road "Q"	0.61	0.70	100	2.0%	7.03	490	1.3%	6	Paved areas and shallow paved swales	20.00	2.24	3.65	10.68	YES	590.00	13.28	Check	10.7
29	Residential & Road "M"	0.69	0.26	90	2.0%	5.59	140	6.0%	6	Paved areas and shallow paved swales	20.00	4.90	0.48	6.07	YES	230.00	11.28	Check	6.1
30	Residential & Road "Y"	0.44	1.71	100	2.0%	9.46	250	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	2.08	11.55	YES	350.00	11.94	Check	11.5
31	Residential & Road "N"	0.43	3.71	45	2.0%	6.42	600	2.0%	6	Paved areas and shallow paved swales	20.00	2.83	3.54	9.95	YES	645.00	13.58	Check	10.0
32	Residential & Road "X"	0.48	1.36	100	2.0%	8.94	345	6.0%	6	Paved areas and shallow paved swales	20.00	4.90	1.17	10.11	YES	445.00	12.47	Check	10.1
33	Residential & Road "X"	0.54	0.86	100	2.0%	8.06	345	6.0%	6	Paved areas and shallow paved swales	20.00	4.90	1.17	9.24	YES	445.00	12.47	Check	9.2
34	Residential & Road "Y"	0.63	0.42	100	2.0%	6.77	250	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	2.08	8.85	YES	350.00	11.94	Check	8.9
35	Residential & Road "M"	0.67	0.30	70	2.0%	5.22	170	5.0%	6	Paved areas and shallow paved swales	20.00	4.47	0.63	5.86	YES	240.00	11.33	Check	5.9
36	Residential & Road "Z"	0.45	1.58	100	2.0%	9.37	250	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	2.08	11.45	YES	350.00	11.94	Check	11.5
37	Residential & Road "Z"	0.67	0.37	100	2.0%	6.22	250	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	2.08	8.30	YES	350.00	11.94	Check	8.3
38	Residential & Road "M"	0.64	0.31	55	2.0%	4.94	170	5.0%	6	Paved areas and shallow paved swales	20.00	4.47	0.63	5.57	YES	225.00	11.25	Check	5.6
39	Residential & Road "N"	0.45	2.58	30	2.0%	5.12	530	1.9%	6	Paved areas and shallow paved swales	20.00	2.72	3.25	8.37	YES	560.00	13.11	Check	8.4
40	Residential & Road "N"	0.61	1.65	45	2.0%	4.71	1190	1.9%	6	Paved areas and shallow paved swales	20.00	2.72	7.29	12.00	YES	1235.00	16.86	Check	12.0
41	Park	0.32	2.97	25	1.0%	7.08	400	5.0%	3	Short pasture and lawns	7.00	1.57	4.26	11.34	YES	425.00	12.36	Check	11.3
42	Residential & Road "M"	0.55	0.65	75	2.0%	6.79	200	2.7%	6	Paved areas and shallow paved swales	20.00	3.26	1.02	7.81	YES	275.00	11.53	Check	7.8
42a	Residential	0.38	0.22	16	50.0%	1.43	170	4.7%	3	Short pasture and lawns	7.00	1.52	1.87	3.30	YES	186.00	11.03	Check	5.0
43	Residential & Road "A"	0.58	2.09	55	2.0%	5.53	730	2.0%	6	Paved areas and shallow paved swales	20.00	2.83	4.30	9.84	YES	785.00	14.36	Check	9.8

SUB-BASIN DATA				INITIAL/OVERLAND FLOW				TRAVEL TIME (t _t)						Tc CHECK (Urbanized basins)		FINAL Tc (min)					
Basin ID	Description	C _s	Area (ac)	(t _i)			Length, L (ft)	S _w (%)	Type of Land Surface			Convey Coef (C _c) (z)	Velocity (V) (ft/s) (3)	t _i Travel Time (min) (4)	TOTAL	t _c = t _i + t _t (min)	Urban (Yes /No)	Length (ft)	T _{c max} (min) (5)	T _{c max} > t _c	
				Slope, s (%)	t _i (min) (1)				Code	Description											
44	Residential & Road "A"	0.60	1.59	70	2.0%	5.96	650	4.0%	6	Paved areas and shallow paved swales	20.00	4.00	2.71	8.67	YES	720.00	14.00	Check	8.7		
45	Residential & Road "N"	0.67	0.18	20	2.0%	2.77	110	2.0%	6	shallow paved swales	20.00	2.83	0.65	3.41	YES	130.00	10.72	Check	5.0		
46	Residential & Road "N"	0.91	0.17	20	2.0%	1.23	110	2.0%	6	Paved areas and shallow paved swales	20.00	2.83	0.65	1.88	YES	130.00	10.72	Check	5.0		
47	Residential & Road "P"	0.48	1.12	65	2.0%	7.13	285	2.5%	6	shallow paved swales	20.00	3.16	1.50	8.63	YES	350.00	11.94	Check	8.6		
48	Residential & Road "P"	0.48	1.73	55	2.0%	6.57	605	2.5%	6	Paved areas and shallow paved swales	20.00	3.16	3.19	9.75	YES	660.00	13.67	Check	9.8		
50	Residential & Road "A" & Park	0.57	0.82	40	2.0%	4.83	325	1.0%	6	shallow paved swales	20.00	2.00	2.71	7.54	YES	365.00	12.03	Check	7.5		
51	Residential & Road "A"	0.72	3.01	65	2.0%	4.40	1560	2.0%	6	Paved areas and shallow paved swales	20.00	2.83	9.19	13.59	YES	1625.00	19.03	Check	13.6		
52	Residential & Road "D"	0.44	1.72	100	2.0%	9.50	290	3.0%	6	Paved areas and shallow paved swales	20.00	3.46	1.40	10.89	YES	390.00	12.17	Check	10.9		
53	Residential & Road "D"	0.57	0.38	55	2.0%	5.63	170	3.0%	6	Paved areas and shallow paved swales	20.00	3.46	0.82	6.44	YES	225.00	11.25	Check	6.4		
54	Residential & Road "C"	0.81	0.45	30	2.0%	2.25	370	1.7%	6	shallow paved swales	20.00	2.61	2.36	4.61	YES	400.00	12.22	Check	5.0		
55	Residential & Road "C"	0.90	0.29	30	2.0%	1.55	365	1.7%	6	Paved areas and shallow paved swales	20.00	2.61	2.33	3.89	YES	395.00	12.19	Check	5.0		
56	Residential & Road "H"	0.48	6.15	60	2.0%	6.89	1510	5.0%	6	Paved areas and shallow paved swales	20.00	4.47	5.63	12.52	YES	1570.00	18.72	Check	12.5		
57	Residential & Road "H"	0.50	4.17	65	2.0%	6.98	1375	5.0%	6	Paved areas and shallow paved swales	20.00	4.47	5.12	12.11	YES	1440.00	18.00	Check	12.1		
58	Residential & Road "F"	0.66	0.17	40	2.0%	4.02	75	3.0%	6	Paved areas and shallow paved swales	20.00	3.46	0.36	4.39	YES	115.00	10.64	Check	5.0		
59	Residential & Road "F"	0.48	3.22	90	2.0%	8.44	925	5.0%	6	Paved areas and shallow paved swales	20.00	4.47	3.45	11.89	YES	1015.00	15.64	Check	11.9		
60	Bradley Road & Road "B"	0.38	5.55	40	50.0%	2.26	990	3.0%	5	Grassed waterway	15.00	2.60	6.35	8.61	YES	1030.00	15.72	Check	8.6		
61	Bradley Road & Road "B"	0.38	1.34	100	2.0%	10.34	195	3.5%	5	Grassed waterway	15.00	2.81	1.16	11.50	YES	295.00	11.64	Check	11.5		
62	Residential & Road "D" & Road "B"	0.49	2.59	100	2.0%	8.76	790	2.0%	6	Paved areas and shallow paved swales	20.00	2.83	4.66	13.42	YES	890.00	14.94	Check	13.4		
63	Residential & Road "B"	0.52	0.31	35	2.0%	4.92	115	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	0.96	5.88	YES	150.00	10.83	Check	5.9		
64	Residential & Road "D" & Road "E"	0.50	2.77	30	2.0%	4.71	1060	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	8.83	13.54	YES	1090.00	16.06	Check	13.5		
65	Residential & Road "C"	0.49	2.42	65	2.0%	7.12	735	2.5%	6	shallow paved swales	20.00	3.16	3.87	10.99	YES	800.00	14.44	Check	11.0		
66	Residential & Road "C"	0.54	1.07	75	2.0%	6.96	455	2.5%	6	Paved areas and shallow paved swales	20.00	3.16	2.40	9.36	YES	530.00	12.94	Check	9.4		
67	Residential & Road "C"	0.58	0.39	60	2.0%	5.80	160	3.8%	6	shallow paved swales	20.00	3.87	0.69	6.49	YES	220.00	11.22	Check	6.5		
68	Residential & Road "G"	0.59	0.48	55	2.0%	5.39	240	2.5%	6	Paved areas and shallow paved swales	20.00	3.16	1.26	6.66	YES	295.00	11.64	Check	6.7		
69	Residential & Road "I"	0.45	1.61	100	2.0%	9.40	240	4.5%	6	Paved areas and shallow paved swales	20.00	4.24	0.94	10.34	YES	340.00	11.89	Check	10.3		

SUB-BASIN DATA				INITIAL/OVERLAND FLOW				TRAVEL TIME (t _t)							T _c CHECK (Urbanized basins)				FINAL T _c (min)			
Basin ID	Description	C _s	Area (ac)	Length, L (ft)	Slope, s (%)	t _i (min)	(t _t)		Length (ft)	S _w (%)	Code	Type of Land Surface		Convey Coef (C _c) (2)	Velocity (V) (ft/s) (3)	t _t Travel Time (min) (4)	TOTAL	Urban (Yes /No)	Length (ft)	T _c max (min) (5)	T _c max > t _c	
												Description										
70	Residential & Road "I"	0.56	0.69	100	2.0%	7.83			275	4.5%	6	Paved areas and shallow paved swales		20.00	4.24	1.08	8.91	YES	375.00	12.08	Check	8.9
71	Residential & Road "J"	0.44	1.50	100	2.0%	9.51			170	5.0%	6	Paved areas and shallow paved swales		20.00	4.47	0.63	10.14	YES	270.00	11.50	Check	10.1
72	Residential & Road "J"	0.49	0.68	100	2.0%	8.72			190	5.0%	6	Paved areas and shallow paved swales		20.00	4.47	0.71	9.43	YES	290.00	11.61	Check	9.4
73	Residential & Road "G" & Park	0.38	1.77	30	2.0%	5.63			405	2.5%	6	Paved areas and shallow paved swales		20.00	3.16	2.13	7.76	YES	435.00	12.42	Check	7.8
74	Residential & Road "G"	0.56	0.41	55	2.0%	5.71			165	2.9%	6	Paved areas and shallow paved swales		20.00	3.41	0.81	6.52	YES	220.00	11.22	Check	6.5
75	Residential & Road "G"	0.48	4.27	35	2.0%	5.30			1315	2.5%	6	Paved areas and shallow paved swales		20.00	3.16	6.93	12.23	YES	1350.00	17.50	Check	12.2
76	Residential & Road "H"	0.58	0.39	40	2.0%	4.74			180	3.0%	6	Paved areas and shallow paved swales		20.00	3.46	0.87	5.60	YES	220.00	11.22	Check	5.6
77	Residential & Road "E"	0.49	3.74	30	2.0%	4.77			1350	1.0%	6	Paved areas and shallow paved swales		20.00	2.00	11.25	16.02	YES	1380.00	17.67	Check	16.0
78	Residential & Road "E"	0.47	7.31	25	2.0%	4.49			1960	1.0%	6	Paved areas and shallow paved swales		20.00	2.00	16.33	20.82	YES	1985.00	21.03	Check	20.8
79	Residential & Road "E"	0.67	0.18	35	2.0%	3.64			100	4.0%	6	Paved areas and shallow paved swales		20.00	4.00	0.42	4.05	YES	135.00	10.75	Check	5.0
80	Residential & Road "E"	0.54	0.74	60	2.0%	6.22			275	5.0%	6	Paved areas and shallow paved swales		20.00	4.47	1.02	7.24	YES	335.00	11.86	Check	7.2
81	Residential & Road "E"	0.49	1.74	80	2.0%	7.83			500	5.0%	6	Paved areas and shallow paved swales		20.00	4.47	1.86	9.69	YES	580.00	13.22	Check	9.7
82	Residential & Road "P"	0.53	0.76	40	2.0%	5.15			245	2.5%	6	Paved areas and shallow paved swales		20.00	3.16	1.29	6.44	YES	285.00	11.58	Check	6.4
83	Residential & Park	0.38	0.89	45	2.0%	6.94			225	5.0%	3	Short pasture and lawns		7.00	1.57	2.40	9.33	YES	270.00	11.50	Check	9.3
84	Residential & Road "G"	0.56	0.45	60	2.0%	6.04			165	5.0%	6	Paved areas and shallow paved swales		20.00	4.47	0.61	6.65	YES	225.00	11.25	Check	6.7
85	Residential & Road "F"	0.53	2.48	45	2.0%	5.52			1090	5.4%	6	Paved areas and shallow paved swales		20.00	4.65	3.91	9.43	YES	1135.00	16.31	Check	9.4
86	Residential & Road "M"	0.84	0.40	60	2.0%	2.87			325	2.7%	6	Paved areas and shallow paved swales		20.00	3.29	1.65	4.52	YES	385.00	12.14	Check	5.0
86a	Residential	0.38	1.37	150	2.0%	12.67			225	4.0%	3	Short pasture and lawns		7.00	1.40	2.68	15.34	YES	375.00	12.08	Check	15.3
87	Pond	0.12	5.71	60	2.0%	10.90					3	Short pasture and lawns		7.00	0.00	0.00	10.90	YES	60.00	10.33	Check	10.9
BIG JOHNSON BASIN																						
100	Fut Commercial & Road "K"	0.47	4.78	100	2.0%	8.98			400	2.5%	6	Paved areas and shallow paved swales		20.00	3.16	2.11	11.09	YES	500.00	12.78	Check	11.1
101	Residential & Road "R"	0.48	0.50	20	2.0%	3.96			38	1.6%	6	Paved areas and shallow paved swales		20.00	2.53	0.25	4.21	YES	58.00	10.32	Check	5.0
102	Residential & Road "R"	0.51	0.76	30	2.0%	4.68			385	1.6%	6	Paved areas and shallow paved swales		20.00	2.53	2.54	7.22	YES	415.00	12.31	Check	7.2
103	Residential & Road "O"	0.61	0.79	35	2.0%	4.15			90	4.0%	6	Paved areas and shallow paved swales		20.00	4.00	0.38	4.53	YES	125.00	10.69	Check	5.0

SUB-BASIN DATA					INITIAL/OVERLAND FLOW				TRAVEL TIME (t _t)						T _c CHECK (Urbanized basins)				FINAL T _c (min)	
Basin ID	Description	C _s	Area (ac)	Length, L (ft)	Slope, s (%)	t _i (min)	(t _t)			S _w (%)	Type of Land Surface		Convey Coef (C _c) (z)	Velocity (V) (ft/s) (3)	t _t Travel Time (min) (4)	t _c = t _i + t _t (min)	Urban (Yes /No)	Length (ft)	T _{c,max} (min) (5)	T _{c,max} > t _c
											Code	Description								
104	Residential & Road "O"	0.68	0.42	35	2.0%	3.59			90	4.0%	6	Paved areas and shallow paved swales	20.00	4.00	0.38	3.96	YES	125.00	10.69	Check
105	Residential & Road "R"	0.49	0.42	55	2.0%	6.50			160	1.5%	6	Paved areas and shallow paved swales	20.00	2.45	1.09	7.59	YES	215.00	11.19	Check
106	Residential & Road "R"	0.41	3.60	35	2.0%	5.85			1210	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	10.08	15.94	YES	1245.00	16.92	Check
107	Residential & Road "R"	0.42	2.35	50	2.0%	6.91			1430	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	11.92	18.83	YES	1480.00	18.22	Check
108	Residential & Road "M"		0.66	15	2.0%	2.43			155	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	1.29	3.72	YES	170.00	10.94	Check
109	Residential & Road "M & Road "R"		0.51	20	2.0%	3.80			155	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	1.29	5.09	YES	175.00	10.97	Check
110	Residential & Road "K"		0.59	30	2.0%	4.01			490	2.4%	6	Paved areas and shallow paved swales	20.00	3.10	2.64	6.64	YES	520.00	12.89	Check
111	Residential & Road "O"		0.48	30	2.0%	4.86			370	2.6%	6	Paved areas and shallow paved swales	20.00	3.22	1.91	6.77	YES	400.00	12.22	Check
112	Residential & Road "O"		1.51	25	2.0%	-2.95			140	4.0%	6	Paved areas and shallow paved swales	20.00	4.00	0.58	-2.37	YES	165.00	10.92	Check
113	Residential & Road "S"		0.49	35	2.0%	5.23			300	2.3%	6	Paved areas and shallow paved swales	20.00	3.03	1.65	6.87	YES	335.00	11.86	Check
114	Residential & Road "V"		0.52	100	2.0%	8.38			180	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	1.50	9.88	YES	280.00	11.56	Check
115	Residential & Road "V"		0.49	100	2.0%	8.71			185	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	1.54	10.26	YES	285.00	11.58	Check
116	Residential & Road "S"		0.56	40	2.0%	4.93			190	2.3%	6	Paved areas and shallow paved swales	20.00	3.03	1.04	5.97	YES	230.00	11.28	Check
117	Residential & Road "W"		0.49	100	2.0%	8.73			220	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	1.83	10.57	YES	320.00	11.78	Check
118	Residential & Road "W"		0.55	100	2.0%	7.84			260	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	2.17	10.01	YES	360.00	12.00	Check
119	Residential & Road "S"		0.50	35	2.0%	5.10			445	1.5%	6	Paved areas and shallow paved swales	20.00	2.45	3.03	8.13	YES	480.00	12.67	Check
120	Residential & Road "S"		0.60	45	2.0%	4.82			1135	1.5%	6	Paved areas and shallow paved swales	20.00	2.45	7.72	12.55	YES	1180.00	16.56	Check
121	Residential & Road "R"		0.41	60	2.0%	7.69			360	4.0%	6	Paved areas and shallow paved swales	20.00	4.00	1.50	9.19	YES	420.00	12.33	Check
122	Residential & Road "M" & Park		0.51	15	2.0%	3.30			405	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	3.38	6.68	YES	420.00	12.33	Check
123	Residential, Road "L" & Road "M"		0.51	15	2.0%	3.30			490	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	4.08	7.38	YES	505.00	12.81	Check
124	Back of Lots/Buffer SW Corner		0.44	100	2.0%	9.51			325	2.2%	6	Paved areas and shallow paved swales	20.00	2.97	1.83	11.33	YES	425.00	12.36	Check
125	Residential & Road "L" & Park		0.38	100	2.0%	10.37			300	2.2%	6	Paved areas and shallow paved swales	20.00	2.97	1.69	12.06	YES	400.00	12.22	Check
126	Residential & Road "L"		0.66	25	2.0%	3.13			100	5.4%	6	Paved areas and shallow paved swales	20.00	4.65	0.36	3.49	YES	125.00	10.69	Check
127	Residential & Road "O"		0.56	50	2.0%	5.45			145	2.6%	6	Paved areas and shallow paved swales	20.00	3.22	0.75	6.20	YES	195.00	11.08	Check
128	Residential & Road "L"		0.45	40	2.0%	5.93			620	5.4%	6	Paved areas and shallow paved swales	20.00	4.65	2.22	8.15	YES	660.00	13.67	Check

SUB-BASIN DATA				INITIAL/OVERLAND FLOW				TRAVEL TIME						Tc CHECK				FINAL Tc		
Basin ID	Description	C ₅	Area (ac)	(t _i)				(t _c)						(Urbanized basins)				(min)		
				Length, L (ft)	Slope, s (%)	t _i (min)	t _i (1)	Length (ft)	S _w (%)	Code	Description	Convey Coef (C _u) (2)	Velocity (V) (ft/s) (3)	t _i Travel Time (min) (4)	t _c = t _i + t _i (min)	Urban (Yes/No)	Length (ft)		T _c ^{max} (min) (5)	T _c ^{max} > t _c
129	Residential & Road "L" & Pond	0.32	2.88	100	2.0%	11.23		795	5.4%	6	Paved areas and shallow paved swales	20.00	4.65	2.85	14.08	YES	895.00	14.97	Check	14.1
130	Residential & Road "L"	0.43	1.70	25	2.0%	4.80		160	1.0%	6	Paved areas and shallow paved swales	20.00	2.00	1.33	6.13	YES	185.00	11.03	Check	6.1
131	Residential & Road "L" & Pond	0.30	1.64	55	2.0%	8.48		135	0.8%	6	Paved areas and shallow paved swales	20.00	1.73	1.30	9.78	YES	190.00	11.06	Check	9.8
200a	Back of Lots/Buffer along Powers	0.38	1.89	90	3.0%	8.58		470	6.6%	5	Grassed waterway	15.00	3.85	2.03	10.61	YES	560.00	13.11	Check	10.6
150	ROW Fut Powers Ramp	0.90	7.06	100	5.8%	2.02		935	2.0%	6	Paved areas and shallow paved swales	20.00	2.83	5.51	7.53	YES	1035.00	15.75	Check	7.5
200	Powers ROW	0.90	5.74	100	2.0%	2.87		1790	2.1%	5	Grassed waterway	15.00	2.17	13.72	16.60	YES	1890.00	20.50	Check	16.6
202	Powers ROW	0.95	2.01	70	2.0%	1.84		790	2.0%	5	Grassed waterway	15.00	2.12	6.21	8.05	YES	860.00	14.78	Check	8.1

UDFCD Table RO-2			Land Surface Coefficients	
Code	Description	Cv		
1	Heavy meadow	2.5		
2	Tillage/field	5		
3	Short pasture and lawns	7		
4	Nearly bare ground	10		
5	Grassed waterway	15		
6	Paved areas and shallow paved swales	20		
*7	Riprap (not buried)	7.0		

Notes:

All Equations are from UDFCD Drainage Criteria Manual/Runoff

(1) $t_t = (0.395 * (1 + C_s) * (L / 0.5)) / (S * 0.33)$, from UDFCD Equation RO-3

(2) Cv from UDFCD Table RO-2

(3) Velocity from $V = C_s * S_w^{0.5}$, from UDFCD Equation RO-4

(4) $t_t = L / 60V$

(5) $t_{t, max} = 10 * L / 180$, from UDFCD Eqn RO-5

* determined for the project based on UDFCD equations (Equation RO-4)

Standard Form SF-2 . Storm Drainage System Design (Rational Method Procedure)

Project: Waterview East
 Section: Proposed Conditions

Created by: CMD Date: 1/23/2017
 Checked by: CKC Date:

Design Storm: 5-yr P = 1.50 in

LOCATION	DESIGN POINT	DIRECT RUNOFF						TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS		
		AREA (A)	RUNOFF (C)	t _c (MIN)	C.A. (AC)	I (IN / HR)	Q (CFS)	t _c (MIN)	SUM (C+A)	I (IN / HR)	Q (CFS)	SLOPE (%)	STREET FLOW (CFS)	DESIGN FLOW (CFS)	SLOPE (%)	PIPE SIZE (INCHES)	LENGTH (FT)	VELOCITY (FPS)	t _t (MIN)			
	(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	(17)	(18)	(19)	(20)	(21)	(22)
			OS-1	12.73	0.81	8.53	10.31	4.31	44.41													
	JIMMY CAMP CREEK BASIN																					
			3	6.94	0.82	7.69	5.68	4.47	25.39													
			4	4.93	0.82	5.47	4.05	4.97	20.11													
			5	3.72	0.83	5.00	3.07	5.09	15.63													
			6	0.36	0.57	5.00	0.21	5.09	1.05													
			7	1.37	0.60	6.51	0.82	4.72	3.89													
			8	0.16	0.65	5.00	0.10	5.09	0.51	6.72	0.55	4.67	2.55									
			9	0.87	0.51	6.72	0.44	4.67	2.08													
			10	0.50	0.70	5.00	0.35	5.09	1.77													
			11	0.18	0.77	5.00	0.14	5.09	0.70													
			12	1.33	0.46	6.70	0.61	4.68	2.84													
			13	0.86	0.51	6.90	0.44	4.63	2.04													
			14	0.79	0.52	6.78	0.41	4.66	1.92	21.15	3.92	2.86	37.14									
			15	2.75	0.60	20.51	1.63	2.91	4.76				28.76									
			16	7.10	0.49	21.15	3.50	2.86	10.04													
			17	1.63	0.63	8.89	1.03	4.24	4.36													
			17a	2.58	0.38	9.12	0.98	4.20	4.12													
			18	1.07	0.57	8.47	0.61	4.32	2.64													
			19	0.16	0.72	5.00	0.12	5.09	0.60													
			20	0.18	0.90	5.00	0.16	5.09	0.82													

LOCATION	DESIGN POINT	DIRECT RUNOFF						TOTAL RUNOFF				STREET		PIPE		TRAVEL TIME			REMARKS		
		AREA DESIGN	AREA (A)	RUNOFF COEFF (C)	t _r (MIN)	C.A. (AC)	I (IN / HR)	Q (CFS)	t _r (MIN)	SUM (C+A) (AC)	I (IN / HR)	Q (CFS)	SLOPE (%)	STREET FLOW (CFS)	DESIGN FLOW (CFS)	SLOPE (%)	PIPE SIZE (INCHES)	LENGTH (FT)		VELOCITY (FPS)	t _t (MIN)
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	(17)	(18)	(19)	(20)	(21)	(22)
Residential & Road "P"		21	0.83	0.54	7.30	0.45	4.55	2.05													
Residential & Road "Q"		22	4.84	0.43	10.66	2.09	3.96	8.26													
Residential & Road "Q"		23	2.67	0.44	10.52	1.18	3.98	4.69													
Residential & Road "M"		24	0.37	0.59	6.67	0.22	4.68	1.03													
Residential & Road "P"		25	1.74	0.54	10.15	0.93	4.03	3.76													
Residential & Road "P"		26	0.29	0.65	5.03	0.19	5.08	0.97	10.71	0.87	3.95	3.44									
Residential & Road "Q"		27	1.13	0.60	10.71	0.68	3.95	2.69													
Residential & Road "Q"		28	0.70	0.61	10.68	0.43	3.95	1.69													
Residential & Road "M"		29	0.26	0.69	6.07	0.18	4.82	0.87													
Residential & Road "Y"		30	1.71	0.44	11.55	0.75	3.83	2.89													
Residential & Road "N"		31	3.71	0.43	9.95	1.61	4.07	6.54													
Residential & Road "X"		32	1.36	0.48	10.11	0.65	4.04	2.62													
Residential & Road "X"		33	0.86	0.54	9.24	0.46	4.18	1.94													
Residential & Road "Y"		34	0.42	0.63	8.85	0.27	4.25	1.13													
Residential & Road "M"		35	0.30	0.67	5.86	0.20	4.87	0.97													
Residential & Road "Z"		36	1.58	0.45	11.45	0.71	3.84	2.71													
Residential & Road "Z"		37	0.37	0.67	8.30	0.24	4.35	1.06													
Residential & Road "M"		38	0.31	0.64	5.57	0.20	4.94	0.99													
Residential & Road "N"		39	2.58	0.45	8.37	1.16	4.34	5.03													
Residential & Road "N"		40	1.65	0.61	12.00	1.01	3.77	3.80													
Park		41	2.97	0.32	11.34	0.94	3.86	3.62													
Residential & Road "M"		42	0.65	0.55	7.81	0.36	4.44	1.60													
Residential		42a	0.22	0.38	5.00	0.08	5.09	0.42													

LOCATION		DESIGN POINT	DIRECT RUNOFF						TOTAL RUNOFF				STREET		PIPE		TRAVEL TIME			REMARKS		
			AREA DESIGN	AREA (A)	RUNOFF COEFF (C)	t _r (MIN)	C.A. (AC)	I (IN / HR)	Q (CFS)	t _r (MIN)	SUM (C.A)	I (IN / HR)	Q (CFS)	SLOPE (%)	STREET FLOW (CFS)	DESIGN FLOW (CFS)	SLOPE (%)	PIPE SIZE (INCHES)	LENGTH (FT)		VELOCITY (FPS)	t _t (MIN)
	(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	(17)	(18)	(19)	(20)	(21)	(22)
	Residential & Road "A"		43	2.09	0.58	9.84	1.21	4.08	4.96													
	Residential & Road "A"		44	1.59	0.60	8.67	0.96	4.28	4.12													
	Residential & Road "N"		45	0.18	0.67	5.00	0.12	5.09	0.61													
	Residential & Road "N"		46	0.17	0.91	5.00	0.16	5.09	0.80													
	Residential & Road "P"		47	1.12	0.48	8.63	0.55	4.29	2.34													
	Residential & Road "P"		48	1.73	0.48	9.75	0.84	4.10	3.43													
	Residential & Road "A" & Park		50	0.82	0.57	7.54	0.47	4.50	2.11													
	Residential & Road "A"		51	3.01	0.72	13.59	2.17	3.56	7.73													
	Residential & Road "D"		52	1.72	0.44	10.89	0.75	3.92	2.95													
	Residential & Road "D"		53	0.38	0.57	6.44	0.21	4.73	1.02													
	Residential & Road "C"		54	0.45	0.81	5.00	0.36	5.09	1.85													
	Residential & Road "C"		55	0.29	0.90	5.00	0.26	5.09	1.33													
	Residential & Road "H"		56	6.15	0.48	12.52	2.95	3.70	10.92													
	Residential & Road "H"		57	4.17	0.50	12.11	2.07	3.75	7.78													
	Residential & Road "F"		58	0.17	0.66	5.00	0.11	5.09	0.55													
	Residential & Road "F"		59	3.22	0.48	11.89	1.55	3.78	5.85													
	Bradley Road & Road "B"		60	5.55	0.38	8.61	2.11	4.29	9.06													
	Bradley Road & Road "B"		61	1.34	0.38	11.50	0.51	3.83	1.95													
	Residential & Road "D" & Road "B"		62	2.59	0.49	13.42	1.27	3.59	4.56													
	Residential & Road "B"		63	0.31	0.52	5.88	0.16	4.86	0.79													
	Residential & Road "D" & Road "E"		64	2.77	0.50	13.54	1.39	3.57	4.96													
	Residential & Road "C"		65	2.42	0.49	10.99	1.17	3.91	4.58													
	Residential & Road "C"		66	1.07	0.54	9.36	0.58	4.16	2.41													

LOCATION	DESIGN POINT	DIRECT RUNOFF						TOTAL RUNOFF				STREET		PIPE		TRAVEL TIME			REMARKS		
		AREA DESIGN	AREA (A)	RUNOFF COEFF (C)	t _r (MIN)	C.A. (AC)	I (IN / HR)	Q (CFS)	t _r (MIN)	SUM (C.A)	I (IN / HR)	Q (CFS)	SLOPE (%)	STREET FLOW (CFS)	DESIGN FLOW (CFS)	SLOPE (%)	PIPE SIZE (INCHES)	LENGTH (FT)		VELOCITY (FPS)	t _t (MIN)
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	(17)	(18)	(19)	(20)	(21)	(22)
		67	0.39	0.58	6.49	0.22	4.72	1.05													
		68	0.48	0.59	6.66	0.28	4.69	1.33													
		69	1.61	0.45	10.34	0.72	4.00	2.88													
		70	0.69	0.56	8.91	0.38	4.24	1.62													
		71	1.50	0.44	10.14	0.66	4.04	2.65													
		72	0.68	0.49	9.43	0.34	4.15	1.39													
		73	1.77	0.38	7.76	0.68	4.45	3.03													
		74	0.41	0.56	6.52	0.23	4.72	1.10													
		75	4.27	0.48	12.23	2.04	3.73	7.61													
		76	0.39	0.58	5.60	0.22	4.93	1.11													
		77	3.74	0.49	16.02	1.84	3.30	6.08													
		78	7.31	0.47	20.82	3.47	2.89	10.02													
		79	0.18	0.67	5.00	0.12	5.09	0.61													
		80	0.74	0.54	7.24	0.40	4.56	1.83													
		81	1.74	0.49	9.69	0.86	4.11	3.52													
		82	0.76	0.53	6.44	0.40	4.73	1.91													
		83	0.89	0.38	9.33	0.34	4.17	1.40													
		84	0.45	0.56	6.65	0.25	4.69	1.18													
		85	2.48	0.53	9.43	1.31	4.15	5.43													
		86	0.40	0.84	5.00	0.34	5.09	1.71													
		86a	1.37	0.38	15.34	0.52	3.37	1.75													
		87	5.71	0.12	10.90	0.69	3.92	2.69													

LOCATION		DESIGN POINT	DIRECT RUNOFF								TOTAL RUNOFF			STREET		PIPE			TRAVEL TIME			REMARKS
			AREA DESIGN	AREA (A)	RUNOFF COEFF (C)	t _r (MIN)	C.A. (AC)	I (IN / HR)	Q (CFS)	t _r (MIN)	SUM (C+A)	I (IN / HR)	Q (CFS)	SLOPE (%)	STREET FLOW (CFS)	DESIGN FLOW (CFS)	SLOPE (%)	PIPE SIZE (INCHES)	LENGTH (FT)	VELOCITY (FPS)	t _t (MIN)	
	(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	(17)	(18)	(19)	(20)	(21)	(22)
	Residential & Road "W" & Park		122	0.62	0.51	6.68	0.31	4.68	1.46													
	Residential, Road "L" & Road "W"		123	1.73	0.51	7.38	0.88	4.53	3.97													
	Back of Lots/Buffer SW Corner		124	2.08	0.44	11.33	0.91	3.86	3.52													
	Residential & Road "L" & Park		125	2.74	0.38	12.06	1.03	3.76	3.89													
	Residential & Road "L"		126	0.17	0.66	5.00	0.12	5.09	0.59													
	Residential & Road "O"		127	0.42	0.56	6.20	0.24	4.79	1.13													
	Residential & Road "L"		128	3.75	0.45	8.15	1.68	4.38	7.36													
	Residential & Road "L" & Pond		129	2.88	0.32	14.08	0.92	3.51	3.21													
	Residential & Road "L"		130	1.70	0.43	6.13	0.74	4.81	3.54													
	Residential & Road "L" & Pond		131	1.64	0.30	9.78	0.50	4.09	2.03													
	Back of Lots/Buffer along Powers		200a	1.89	0.38	10.61	0.72	3.96	2.85													
	ROW Fut Powers Ramp		150	7.06	0.90	7.53	6.35	4.50	28.60													
	Powers ROW		200	5.74	0.90	16.60	5.17	3.24	16.76													
	Powers ROW		202	2.01	0.95	8.05	1.90	4.40	8.37													

LOCATION	DESIGN POINT	DIRECT RUNOFF						TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS		
		AREA DESIGN	AREA (A)	RUNOFF COEFF (C)	t_c (MIN)	C.A. (AC)	I (IN / HR)	Q (CFS)	t_c (MIN)	SUM (C*A) (AC)	I (IN / HR)	Q (CFS)	SLOPE (%)	STREET FLOW (CFS)	DESIGN FLOW (CFS)	SLOPE (%)	PIPE SIZE (INCHES)	LENGTH (FT)	VELOCITY (FPS)		t_t (MIN)	
(1)		(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	(17)	(18)	(19)	(20)	(21)	(22)

Design Storm: 100-yr P = 2.52 in

Offsite - Fut Commercial		OS-1	12.73	0.88	8.53	11.20	4.31	48.25													
JIMMY CAMP CREEK BASIN																					
Fut Commercial		3	6.94	0.89	7.69	6.16	4.47	27.53													
Fut Commercial		4	4.93	0.89	5.47	4.39	4.97	21.79													
Fut Commercial		5	3.72	0.89	5.00	3.33	5.09	16.92													
Residential & Road "K"		6	0.36	0.69	5.00	0.25	5.09	1.27													
Residential & Road "K"		7	1.37	0.73	6.51	0.99	4.72	4.68													
Residential & Road "U"		8	0.16	0.76	5.00	0.12	5.09	0.60	6.72	0.69	4.67	3.21									
Residential & Road "U"		9	0.87	0.65	6.72	0.57	4.67	2.65													
Residential & Road "P"		10	0.50	0.81	5.00	0.40	5.09	2.04													
Residential & Road "U"		11	0.18	0.86	5.00	0.15	5.09	0.77													
Residential & Road "P"		12	1.33	0.61	6.70	0.81	4.68	3.80													
Residential & Road "O"		13	0.86	0.65	6.90	0.56	4.63	2.60													
Residential & Road "O"		14	0.79	0.66	6.78	0.52	4.66	2.43	21.15	5.06	2.86	40.94									
Residential & Road "T"		15	2.75	0.72	20.51	1.98	2.91	5.76				29.76									
Residential & Road "T"		16	7.10	0.64	21.15	4.54	2.86	13.01													
Residential & Road "M"		17	1.63	0.75	8.89	1.22	4.24	5.17													
Residential		17a	2.58	0.55	9.12	1.42	4.20	5.97													
Residential & Road "P"		18	1.07	0.70	8.47	0.75	4.32	3.23													
Residential & Road "O"		19	0.16	0.82	5.00	0.13	5.09	0.68													
Residential & Road "O"		20	0.18	0.96	5.00	0.17	5.09	0.88													
Residential & Road "P"		21	0.83	0.69	7.30	0.57	4.55	2.61													
Residential & Road "Q"		22	4.84	0.59	10.66	2.86	3.96	11.31													

LOCATION		DESIGN POINT	DIRECT RUNOFF						TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS	
			AREA DESIGN	AREA (A)	RUNOFF COEFF (C)	t _r (MIN)	C.A. (AC)	I (IN / HR)	Q (CFS)	t _r (MIN)	SUM (C+A) (AC)	I (IN / HR)	Q (CFS)	SLOPE (%)	STREET FLOW (CFS)	DESIGN FLOW (CFS)	SLOPE (%)	PIPE SIZE (INCHES)	LENGTH (FT)	VELOCITY (FPS)		t _t (MIN)
	(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	(17)	(18)	(19)	(20)	(21)	(22)
	Residential & Road "Q"		23	2.67	0.60	10.52	1.60	3.98	6.36													
	Residential & Road "M"		24	0.37	0.71	6.67	0.27	4.68	1.25													
	Residential & Road "P"		25	1.74	0.67	10.15	1.17	4.03	4.72													
	Residential & Road "P"		26	0.29	0.76	5.03	0.22	5.08	1.14	10.71	1.04	3.95	4.12									
	Residential & Road "Q"		27	1.13	0.73	10.71	0.82	3.95	3.24													
	Residential & Road "Q"		28	0.70	0.73	10.68	0.51	3.95	2.03													
	Residential & Road "M"		29	0.26	0.79	6.07	0.21	4.82	1.00													
	Residential & Road "Y"		30	1.71	0.60	11.55	1.02	3.83	3.91													
	Residential & Road "N"		31	3.71	0.59	9.95	2.20	4.07	8.93													
	Residential & Road "X"		32	1.36	0.63	10.11	0.85	4.04	3.44													
	Residential & Road "X"		33	0.86	0.68	9.24	0.58	4.18	2.43													
	Residential & Road "Y"		34	0.42	0.75	8.85	0.31	4.25	1.34													
	Residential & Road "M"		35	0.30	0.77	5.86	0.23	4.87	1.13													
	Residential & Road "Z"		36	1.58	0.60	11.45	0.95	3.84	3.65													
	Residential & Road "Z"		37	0.37	0.78	8.30	0.28	4.35	1.23													
	Residential & Road "M"		38	0.31	0.75	5.57	0.24	4.94	1.17													
	Residential & Road "N"		39	2.58	0.60	8.37	1.56	4.34	6.77													
	Residential & Road "N"		40	1.65	0.73	12.00	1.21	3.77	4.55													
	Park		41	2.97	0.51	11.34	1.52	3.86	5.85													
	Residential & Road "M"		42	0.65	0.69	7.81	0.45	4.44	1.99													
	Residential		42a	0.22	0.55	5.00	0.12	5.09	0.60													
	Residential & Road "A"		43	2.09	0.71	9.84	1.48	4.08	6.05													
	Residential & Road "A"		44	1.59	0.73	8.67	1.16	4.28	4.96													

LOCATION	DESIGN POINT	DIRECT RUNOFF						TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS		
		AREA DESIGN	AREA (A)	RUNOFF COEFF (C)	t _r (MIN)	C.A. (AC)	I (IN / HR)	Q (CFS)	t _r (MIN)	SUM (C+A) (AC)	I (IN / HR)	Q (CFS)	SLOPE (%)	STREET FLOW (CFS)	DESIGN FLOW (CFS)	SLOPE (%)	PIPE SIZE (INCHES)	LENGTH (FT)	VELOCITY (FPS)		t _t (MIN)	
	(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	(17)	(18)	(19)	(20)	(21)	(22)
	Residential & Road "N"		45	0.18	0.78	5.00	0.14	5.09	0.71													
	Residential & Road "N"		46	0.17	0.97	5.00	0.17	5.09	0.85													
	Residential & Road "P"		47	1.12	0.63	8.63	0.71	4.29	3.05													
	Residential & Road "P"		48	1.73	0.64	9.75	1.10	4.10	4.52													
	Residential & Road "A" & Park		50	0.82	0.72	7.54	0.59	4.50	2.66													
	Residential & Road "A"		51	3.01	0.82	13.59	2.46	3.56	8.78													
	Residential & Road "D"		52	1.72	0.60	10.89	1.02	3.92	4.01													
	Residential & Road "D"		53	0.38	0.70	6.44	0.26	4.73	1.25													
	Residential & Road "C"		54	0.45	0.89	5.00	0.40	5.09	2.03													
	Residential & Road "C"		55	0.29	0.96	5.00	0.28	5.09	1.41													
	Residential & Road "H"		56	6.15	0.63	12.52	3.87	3.70	14.30													
	Residential & Road "H"		57	4.17	0.64	12.11	2.68	3.75	10.05													
	Residential & Road "F"		58	0.17	0.77	5.00	0.13	5.09	0.65													
	Residential & Road "F"		59	3.22	0.63	11.89	2.03	3.78	7.67													
	Bradley Road & Road "B"		60	5.55	0.55	8.61	3.05	4.29	13.11													
	Bradley Road & Road "B"		61	1.34	0.55	11.50	0.74	3.83	2.83													
	Residential & Road "D" & Road "B"		62	2.59	0.64	13.42	1.65	3.59	5.92													
	Residential & Road "B"		63	0.31	0.66	5.88	0.21	4.86	1.01													
	Residential & Road "D" & Road "E"		64	2.77	0.65	13.54	1.79	3.57	6.39													
	Residential & Road "C"		65	2.42	0.63	10.99	1.53	3.91	5.98													
	Residential & Road "C"		66	1.07	0.68	9.36	0.72	4.16	3.02													
	Residential & Road "C"		67	0.39	0.71	6.49	0.27	4.72	1.29													
	Residential & Road "G"		68	0.48	0.72	6.66	0.34	4.69	1.61													

LOCATION		DESIGN POINT	DIRECT RUNOFF						TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS	
			AREA DESIGN	AREA (A)	RUNOFF COEFF (C)	t _r (MIN)	C.A. (AC)	I (IN / HR)	Q (CFS)	t _r (MIN)	SUM (C.A)	I (IN / HR)	Q (CFS)	SLOPE (%)	STREET FLOW (CFS)	DESIGN FLOW (CFS)	SLOPE (%)	PIPE SIZE (INCHES)	LENGTH (FT)	VELOCITY (FPS)		t _r (MIN)
	(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	(17)	(18)	(19)	(20)	(21)	(22)
	Residential & Road "I"		69	1.61	0.60	10.34	0.97	4.00	3.88													
	Residential & Road "I"		70	0.69	0.69	8.91	0.47	4.24	2.00													
	Residential & Road "J"		71	1.50	0.60	10.14	0.89	4.04	3.60													
	Residential & Road "J"		72	0.68	0.64	9.43	0.44	4.15	1.82													
	Residential & Road "G" & Park		73	1.77	0.57	7.76	1.00	4.45	4.46													
	Residential & Road "G"		74	0.41	0.70	6.52	0.29	4.72	1.35													
	Residential & Road "G"		75	4.27	0.63	12.23	2.68	3.73	9.99													
	Residential & Road "H"		76	0.39	0.71	5.60	0.27	4.93	1.35													
	Residential & Road "E"		77	3.74	0.64	16.02	2.39	3.30	7.88													
	Residential & Road "E"		78	7.31	0.62	20.82	4.57	2.89	13.19													
	Residential & Road "E"		79	0.18	0.78	5.00	0.14	5.09	0.70													
	Residential & Road "E"		80	0.74	0.68	7.24	0.50	4.56	2.29													
	Residential & Road "E"		81	1.74	0.64	9.69	1.11	4.11	4.57													
	Residential & Road "P"		82	0.76	0.67	6.44	0.51	4.73	2.40													
	Residential & Park		83	0.89	0.55	9.33	0.49	4.17	2.03													
	Residential & Road "G"		84	0.45	0.69	6.65	0.31	4.69	1.45													
	Residential & Road "F"		85	2.48	0.67	9.43	1.65	4.15	6.86													
	Residential & Road "M"		86	0.40	0.91	5.00	0.37	5.09	1.86													
	Residential		86a	1.37	0.55	15.34	0.75	3.37	2.53													
	Pond		87	5.71	0.39	10.90	2.23	3.92	8.73													
BIG JOHNSON BASIN																						
	Fut Commercial & Road "K"		100	4.78	0.62	11.09	2.99	3.89	11.63													

LOCATION		DESIGN POINT	DIRECT RUNOFF						TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS	
			AREA DESIGN	AREA (A)	RUNOFF COEFF (C)	t _r (MIN)	C.A. (AC)	I (IN / HR)	Q (CFS)	t _r (MIN)	SUM (C.A)	I (IN / HR)	Q (CFS)	SLOPE (%)	STREET FLOW (CFS)	DESIGN FLOW (CFS)	SLOPE (%)	PIPE SIZE (INCHES)	LENGTH (FT)	VELOCITY (FPS)		t _t (MIN)
	(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	(17)	(18)	(19)	(20)	(21)	(22)
	Residential & Road "R"		101	0.50	0.63	5.00	0.32	5.09	1.61													
	Residential & Road "R"		102	0.76	0.65	7.22	0.49	4.57	2.25													
	Residential & Road "O"		103	0.79	0.73	5.00	0.58	5.09	2.96													
	Residential & Road "O"		104	0.42	0.79	5.00	0.33	5.09	1.66													
	Residential & Road "R"		105	0.42	0.64	7.59	0.27	4.49	1.19													
	Residential & Road "R"		106	3.60	0.57	15.94	2.07	3.31	6.84													
	Residential & Road "R"		107	2.35	0.58	18.83	1.36	3.04	4.15													
	Residential & Road "M"		108	0.33	0.77	5.00	0.25	5.09	1.28													
	Residential & Road "M & Road "R"		109	0.62	0.65	5.09	0.41	5.06	2.05													
	Residential & Road "K"		110	0.45	0.72	6.64	0.32	4.69	1.52													
	Residential & Road "O"		111	1.05	0.63	6.77	0.66	4.66	3.08													
	Residential & Road "O"		112	0.14	1.44	5.00	0.20	5.09	1.04													
	Residential & Road "S"		113	1.07	0.63	6.87	0.68	4.64	3.15													
	Residential & Road "V"		114	0.68	0.66	9.88	0.44	4.08	1.81													
	Residential & Road "V"		115	0.81	0.64	10.26	0.52	4.02	2.09													
	Residential & Road "S"		116	0.45	0.69	5.97	0.31	4.84	1.50													
	Residential & Road "W"		117	0.85	0.64	10.57	0.54	3.97	2.16													
	Residential & Road "W"		118	0.62	0.69	10.01	0.42	4.06	1.72													
	Residential & Road "S"		119	1.34	0.64	8.13	0.87	4.38	3.80													
	Residential & Road "S"		120	1.68	0.72	12.55	1.21	3.69	4.49													
	Residential & Road "R"		121	1.52	0.58	9.19	0.89	4.19	3.73													
	Residential & Road "M" & Park		122	0.62	0.67	6.68	0.41	4.68	1.93													
	Residential, Road "L" & Road "M"		123	1.73	0.65	7.38	1.12	4.53	5.09													

LOCATION		DESIGN POINT	DIRECT RUNOFF						TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS	
			AREA DESIGN	AREA (A)	RUNOFF COEFF (C)	t _r (MIN)	C.A. (AC)	I (IN / HR)	Q (CFS)	t _r (MIN)	SUM (C+A) (AC)	I (IN / HR)	Q (CFS)	SLOPE (%)	STREET FLOW (CFS)	DESIGN FLOW (CFS)	SLOPE (%)	PIPE SIZE (INCHES)	LENGTH (FT)	VELOCITY (FPS)		t _t (MIN)
	(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	(17)	(18)	(19)	(20)	(21)	(22)
	Back of Lots/Buffer SW Corner		124	2.08	0.60	11.33	1.24	3.86	4.78													
	Residential & Road "L" & Park		125	2.74	0.56	12.06	1.52	3.76	5.73													
	Residential & Road "L"		126	0.17	0.77	5.00	0.14	5.09	0.69													
	Residential & Road "O"		127	0.42	0.69	6.20	0.29	4.79	1.39													
	Residential & Road "L"		128	3.75	0.60	8.15	2.27	4.38	9.92													
	Residential & Road "L" & Pond		129	2.88	0.53	14.08	1.53	3.51	5.36													
	Residential & Road "L"		130	1.70	0.59	6.13	1.01	4.81	4.84													
	Residential & Road "L" & Pond		131	1.64	0.51	9.78	0.84	4.09	3.43													
	Back of Lots/Buffer along Powers		200a	1.89	0.55	10.61	1.04	3.96	4.12													
	ROW Fut Powers Ramp		150	7.06	0.96	7.53	6.78	4.50	30.50													
	Powers ROW		200	5.74	0.96	16.60	5.51	3.24	17.87													
	Powers ROW		202	2.01	1.00	8.05	2.00	4.40	8.81													

All Equations follow UDFCD Rational Method

- (1) Basin Description linked to C-Value Sheet
(2) Basin Design Point
(3) Enter the Basin Name from C-Value Sheet
(4) Basin Area linked to C-Value Sheet
(5) Composite C linked to C-Value Sheet
(6) Time of Concentration linked to SF-1 Sheet
- (7) =Column 4 x Column 5
(8) =28.5*P/(10+Column 6)*0.786
(9) =Column 7 x Column 8
(10) =Column 6 + Column 21
(11) Add the C.A. Values Column 7 to get the cumulative C.A. Values
(12) =28.5*P/(10+Column 10)*0.786
- (13) Sum of Qs
(14) Additional Street Longitudinal Slope
(15) Additional Street Overland Flow
(16) Additional Pipe Design Flow
(17) Additional Pipe Slope
(18) Additional Pipe Size
(19) Additional Flow Length
(20) Street or Pipe Velocity
(21) =Column 15 OR Column 16 OR Column 20 / 60

WATERVIEW EAST SURFACE ROUTING - NO INLETS

DESIGN POINT	CONTRIBUTING BASINS	CA(equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS	
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
Jimmy Camp Creek Basin								
A	3 4	5.68	6.16	7.7	4.5	7.8	43.7	82.7
		4.05	4.39	TRAVEL TIME				
		9.73	10.55	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
						3.5	0.0	7.7
B	6 7	0.21	0.25	6.5	3.5	8.3	3.6	10.3
		0.82	0.99	TRAVEL TIME				
		1.03	1.24	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
					270	4.4	1.0	7.5
C	9 10	0.44	0.57	6.7	3.5	8.2	2.8	8.0
		0.35	0.40	TRAVEL TIME				
		0.79	0.97	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	3.6	0.2	6.9
D	8 11 DP C	0.10	0.12	6.9	3.5	8.2	3.6	10.1
		0.14	0.15	TRAVEL TIME				
		0.79	0.97	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
		1.03	1.24	Street	300	2.8	1.8	8.7
E	12 13 DP D	0.61	0.81	8.7	3.5	7.5	7.3	19.6
		0.44	0.56	TRAVEL TIME				
		1.03	1.24	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
		2.08	2.61	Street	40	4.9	0.1	8.8
F	14 DP E	0.41	0.52	8.8	3.5	7.4	8.7	23.3
		2.08	2.61	TRAVEL TIME				
		2.49	3.14	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	590	4.9	2.0	10.8
G	16	3.50	4.54	21.1	3.5	4.9	12.2	22.4
				TRAVEL TIME				
		3.50	4.54	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	2.0	0.3	21.5
H	15 DP G	1.63	1.98	20.5	3.5	5.0	17.9	32.7
		3.50	4.54	TRAVEL TIME				
		5.14	6.52	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	175	2.0	1.5	22.0
I	23 24 DP H	1.18	1.60	22.0	3.5	4.8	22.8	40.6
		0.22	0.27	TRAVEL TIME				
		5.14	6.52	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
		6.54	8.39	Street	40	2.2	0.3	22.3
J	28 DP I	0.43	0.51	22.3	3.5	4.8	24.3	42.7
		6.54	8.39	TRAVEL TIME				
		6.97	8.90	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	175	2.2	1.3	23.6

SURFACE ROUTING - NO INLETS

DESIGN POINT	CONTRIBUTING BASINS	CA (equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS	
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
K	29 30 DP I	0.18	0.21	23.6	3.5	4.7	27.6	47.1
		0.75	1.02					
		6.97	8.90					
		7.90	10.13	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
L	34 DP K	0.27	0.31	23.9	3.5	4.6	28.5	48.2
		7.90	10.13					
		8.17	10.44	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	2.0	0.3	23.9
M	35 36 DP L	0.20	0.23	25.4	3.5	4.5	29.9	51.9
		0.20	0.95					
		8.17	10.44	TRAVEL TIME				
		8.56	11.62	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	2.0	0.3	25.7
N	37 DP M	0.71	0.28	25.7	3.5	4.4	32.4	52.8
		8.56	11.62					
		9.27	11.91	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	175	2.0	1.5	27.2
RR	31 32 33	1.61	2.20	10.1	3.5	7.0	9.5	25.5
		0.65	0.85					
		0.46	0.58	TRAVEL TIME				
		2.72	3.63	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	580	2.8	3.5	13.6
O	38 39 DP N DP-RR	0.24	0.24	27.2	3.5	4.3	33.9	58.8
		0.20	1.56					
		9.27	11.91	TRAVEL TIME				
		2.72	3.63					
		9.71	13.70	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
P	21 22 DP F	0.45	0.57	10.8	3.5	6.8	17.6	44.9
		2.09	2.86					
		2.49	3.14	TRAVEL TIME				
		5.03	6.57	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	3.7	0.2	11.0
Q	27 DP P	0.68	0.82	11.0	3.5	6.8	19.9	50.2
		5.03	6.57					
		5.71	7.39	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	175	3.7	0.8	11.8
R	26 DP Q	0.19	0.22	11.8	3.5	6.6	20.6	50.1
		5.71	7.39					
		5.90	7.61	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	175	4.5	0.6	12.5
S	5 52 54 55 OS-1	3.07	3.33	10.9	3.5	6.8	51.5	110.7
		0.75	1.02					
		0.36	0.40					
		0.26	0.28	TRAVEL TIME				
		10.31	11.20					
		14.76	16.22	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	1590	2.6	10.2	21.1

SURFACE ROUTING - NO INLETS

DESIGN POINT	CONTRIBUTING BASINS	CA (equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS	
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
Z	53 64 65	0.21	0.26	13.5	3.5	6.2	9.7	22.2
		1.39	1.79					
		1.17	1.53					
		2.78	3.58	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
AA	66 67 DP Z	0.58	0.72	13.9	3.5	6.1	12.5	28.0
		0.22	0.27					
		2.78	3.58					
		3.58	4.58	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
LL	77 DP AA	1.84	2.39	16.0	3.5	5.7	18.9	39.8
		3.58	4.58					
		5.42	6.97	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	100	2.0	0.8	16.9
T	51 79 DP S DP LL	2.17	2.46	21.1	3.5	4.9	78.4	127.6
		0.12	0.14					
		14.76	16.22					
		5.42	6.97	TRAVEL TIME				
		22.47	25.80	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
U	19 43	0.12	0.13	9.8	3.5	7.1	4.7	11.5
		1.21	1.48					
		1.33	1.62	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	2.8	0.2	10.1
V	20 DP U	0.16	0.17	10.1	3.5	7.1	5.2	12.6
		1.33	1.62					
		1.49	1.79	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	700	5.8	2.0	12.1
W	44 DP V	0.96	1.16	12.1	3.5	6.5	8.6	19.2
		1.49	1.79					
		2.46	2.94	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	250	4.0	1.0	13.1
X	50 DP W	0.47	0.59	13.1	3.5	6.3	10.2	22.2
		2.46	2.94					
		2.92	3.54	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	250	2.0	2.1	15.2
Y	62 63	1.27	1.65	13.4	3.5	6.2	5.0	11.6
		0.16	0.21					
		1.43	1.86	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	2000	2.0	16.7	30.1
BB	56	2.95	3.87	12.5	3.5	6.4	10.3	24.8
		2.95	3.87	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street		4.5	0.0	12.5
CC	68 69	0.28	0.34	10.3	3.5	7.0	3.5	9.2
		0.72	0.97					
		1.00	1.31	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	3.2	0.2	10.5

SURFACE ROUTING - NO INLETS

DESIGN POINT	CONTRIBUTING BASINS	CA(equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS	
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
DD	70 DP CC	0.38	0.47	10.5	3.5	6.9	4.8	12.4
		1.00	1.31	TRAVEL TIME				
		1.38	1.79	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	200	4.2	0.8	11.3
EE	71 84 DP DD	0.66	0.89	11.3	3.5	6.7	8.0	20.0
		0.25	0.31	TRAVEL TIME				
		1.38	1.79	TRAVEL TIME				
		2.29	2.99	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	4.5	0.1	11.5
FF	72 DP EE	0.34	0.44	11.5	3.5	6.7	9.2	22.8
		2.29	2.99	TRAVEL TIME				
		2.63	3.43	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	200	4.5	0.7	12.2
GG	73 85 DP FF	0.68	1.00	12.2	3.5	6.5	16.1	39.4
		1.31	1.65	TRAVEL TIME				
		2.63	3.43	TRAVEL TIME				
		4.61	6.08	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	3.2	0.2	12.4
HH	58 59 DP GG	0.11	0.13	12.4	3.5	6.4	21.9	53.0
		1.55	2.03	TRAVEL TIME				
		4.61	6.08	TRAVEL TIME				
		6.27	8.24	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	150	3.5	0.7	13.2
KK	57 76	2.07	2.68	12.1	3.5	6.5	8.0	19.2
		0.22	0.27	TRAVEL TIME				
		2.30	2.95	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	100	3.5	0.5	12.6
II	74 DP HH DP KK	0.23	0.29	13.2	3.5	6.3	30.7	72.0
		6.27	8.24	TRAVEL TIME				
		2.30	2.95	TRAVEL TIME				
		8.80	11.48	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	150	3.4	0.7	13.9
JJ	75	2.04	2.68	12.2	3.5	6.5	7.1	17.3
				TRAVEL TIME				
		2.04	2.68	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street		3.2	0.0	12.2
MM	78 DP Y	3.47	4.57	30.1	3.5	4.0	17.1	26.0
		1.43	1.86	TRAVEL TIME				
		4.91	6.43	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	200	2.0	1.7	31.7
VV	18 25	0.61	0.75	10.2	3.5	7.0	5.4	13.5
		0.93	1.17	TRAVEL TIME				
		1.54	1.92	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	3.6	0.2	10.3
NN	45 46 DP VV	0.12	0.14	10.3	3.5	7.0	6.3	15.5
		0.16	0.17	TRAVEL TIME				
		1.54	1.92	TRAVEL TIME				
		1.82	2.22	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	335	2.8	2.0	12.3

SURFACE ROUTING - NO INLETS

DESIGN POINT	CONTRIBUTING BASINS	CA(equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS	
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
OO	47 80 DP NN	0.55	0.71	12.3	3.5	6.5	9.7	22.2
		0.40	0.50					
		1.82	2.22	TRAVEL TIME				
		2.77	3.44	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	3.2	0.2	12.5
PP	81 DP OO	0.86	1.11	12.5	3.5	6.4	12.6	29.2
		2.77	3.44	TRAVEL TIME				
		3.62	4.55	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	200	4.5	0.7	13.3
QQ	48 82 DP R DP PP	0.84	1.10	12.5	3.5	6.4	37.6	88.6
		0.40	0.51					
		5.90	7.61					
		3.62	4.55	TRAVEL TIME				
		10.76	13.77	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street		3.2	0.0	12.5
SS	40 DP O	1.01	1.21	27.4	3.5	4.3	37.4	63.7
		9.71	13.70	TRAVEL TIME				
		10.72	14.91	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	200	2.7	1.2	28.7
TT	17	1.03	1.22	8.9	3.5	7.4	3.6	9.0
				TRAVEL TIME				
		1.03	1.22	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	200	4.9	0.7	9.6
UU	42 86 DP SS DP TT	0.36	0.45	28.7	3.5	4.2	47.4	77.6
		1.48	2.07					
		10.72	14.91					
		1.03	1.22	TRAVEL TIME				
		13.59	18.65	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	3.3	0.2	28.9
EAST POND	41 83 87 DP QQ DP UU	0.94	1.52	28.9	3.5	4.1	92.9	148.3
		0.34	0.49					
		0.98	1.36					
		10.76	13.77	TRAVEL TIME				
		13.59	18.65	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
		26.61	35.79			1.6	0.0	28.9
WW	17a 42a 86a	0.98	1.42	15.3	3.5	5.8	5.5	13.3
		0.08	0.12					
		0.52	0.75	TRAVEL TIME				
		1.58	2.29	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
						2.8	0.0	15.3
JCD-B	East Pond DP WW	26.61	35.79	28.9	3.5	4.1	98.4	157.8
		1.58	2.29	TRAVEL TIME				
		28.19	38.07	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	200	2.7	1.2	30.1
Big Johnson Basin								
AAA	102 103	0.38	0.49	7.2	3.5	8.0	3.0	8.6
		0.49	0.58	TRAVEL TIME				
		0.87	1.08	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)

SURFACE ROUTING - NO INLETS

DESIGN POINT	CONTRIBUTING BASINS	CA (equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS	
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
				Street	40	2.5	0.3	7.5
BBB	104 DP AAA	0.28	0.33	7.5	3.5	7.9	4.0	11.1
		0.87	1.08	TRAVEL TIME				
		1.15	1.40	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	1200	4.0	5.0	12.5
CCC	106 DP BBB	1.48	2.07	12.5	3.5	6.4	9.2	22.3
		1.15	1.40	TRAVEL TIME				
		2.63	3.47	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	2.0	0.3	12.8

SURFACE ROUTING - NO INLETS

DESIGN POINT	CONTRIBUTING BASINS	CA (equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS	
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
DDD	113 114	0.52	0.68	9.9	3.5	7.1	3.0	8.0
		0.35	0.44	TRAVEL TIME				
		0.87	1.12	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	2.0	0.3	10.2
EEE	115 DP DDD	0.40	0.52	10.3	3.5	7.0	4.4	11.5
		0.87	1.12	TRAVEL TIME				
		1.27	1.64	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	250	2.0	2.1	12.3
FFF	116 117 DP EEE	0.25	0.31	12.3	3.5	6.5	6.8	16.1
		0.42	0.54	TRAVEL TIME				
		1.27	1.64	TRAVEL TIME				
		1.94	2.50	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
GGG	118 DP FFF	0.34	0.54	12.7	3.5	6.4	8.0	19.4
		1.94	2.50	TRAVEL TIME				
		2.28	3.04	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	400	2.0	3.3	16.0
HHH	119 DP GGG	0.67	0.42	16.0	3.5	5.7	10.3	19.8
		2.28	3.04	TRAVEL TIME				
		2.95	3.46	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	2.5	0.3	16.3
III	120 DP CCC DP HHH	1.01	0.87	16.3	3.5	5.7	23.0	44.1
		2.63	3.47	TRAVEL TIME				
		2.95	3.46	TRAVEL TIME				
		6.59	7.80	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
JJJ	105			Street	400	2.5	2.7	18.9
		0.20	0.27	7.6	3.5	7.9	0.7	2.1
		TRAVEL TIME						
		0.20	0.27	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
KKK	107 108 DP JJJ			Street	40	2.5	0.3	7.9
		0.98	1.36	18.8	3.5	5.3	4.9	9.9
		0.22	0.25	TRAVEL TIME				
		0.20	0.27	TRAVEL TIME				
LLL	121 DP III DP KKK	1.40	1.88	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	2.0	0.3	19.2
		0.62	1.21	19.2	3.5	5.2	30.1	56.7
		6.59	7.80	TRAVEL TIME				
MMM	109	1.40	1.88	TRAVEL TIME				
		8.62	10.89	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	425	4.0	1.8	20.9
		0.32	0.41	5.1	3.5	9.0	1.1	3.7
NNN	122 125 DP LLL	TRAVEL TIME						
		0.32	0.41	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	450	2.0	3.8	8.8
		0.31	0.89	20.9	3.5	5.0	34.8	64.7
		1.03	1.24	TRAVEL TIME				
		8.62	10.89	TRAVEL TIME				
		9.96	13.02	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street		2.0	0.0	20.9

SURFACE ROUTING - NO INLETS

DESIGN POINT	CONTRIBUTING BASINS	CA (equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS	
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
OOO	123 124 DP MMM	0.88	0.41	11.3	3.5	6.7	7.3	13.0
		0.91	1.12					
		0.32	0.41					
		2.10	1.94					
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
PPP	130			Street		2.0	0.0	11.3
		0.74	1.01	6.1	3.5	8.5	2.6	8.6
		0.74	1.01					
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
QQQ	131			Street		2.0	0.0	6.1
		0.50	0.84	9.8	3.5	7.1	1.7	6.0
		0.50	0.84					
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
RRR	110 111 126			Street		1.7	0.0	9.8
		0.27	0.32	6.8	3.5	8.2	3.1	9.2
		0.51	0.66					
		0.12	0.14					
		0.89	1.12					
SSS	112 127 DP RRR			Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
		0.21	0.20	Street	500	3.1	2.7	9.5
		0.24	0.29					
		0.89	1.12					
		1.34	1.62					
TTT	128 DP SSS			Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
		1.68	2.27	Street	600	3.2	3.1	12.6
		1.34	1.62					
		3.02	3.88					
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
UUU	100 129			Street		4.7	0.0	12.6
		2.27	2.99	14.1	3.5	6.1	11.1	27.4
		0.92	1.53					
		3.19	4.51					
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
VVV	200a			Street		3.2	0.0	14.1
		0.72	1.04	10.6	3.5	6.9	2.5	7.2
		0.72	1.04					
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
WEST POND	DP NNN DP OOO DP PPP DP QQQ DP TTT DP VVV DP UUU					1.7	0.0	10.6
		9.96	13.02	20.9	3.5	5.0	70.6	130.3
		2.10	1.94					
		0.74	1.01					
		0.50	0.84					
		3.02	3.88					
		0.72	1.04					
		3.19	4.51					
		20.22	26.24					
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	600	1.7	5.9	26.8

WATERVIEW EAST

SURFACE ROUTING - INLET DESIGN

DESIGN POINT	CONTRIBUTING BASINS	CA (equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS		
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)	
Jimmy Camp Creek Basin									
A	3 4 (Bypass from Inlet)	5.68	6.16	7.7	4.5	7.8	32.3	56.3	
		1.51	1.02	TRAVEL TIME					
		7.20	7.18	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
						3.5	0.0	7.7	
B	6 7	0.21	0.25	6.5	3.5	8.3	3.6	10.3	
		0.82	0.99	TRAVEL TIME					
		1.03	1.24	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
					270	4.4	1.0	7.5	
C	9 10	0.44	0.57	6.7	3.5	8.2	2.8	8.0	
		0.35	0.40	TRAVEL TIME					
		0.79	0.97	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				Street	40	3.6	0.2	6.9	
D	8 11 DP C	0.10	0.12	6.9	3.5	8.2	3.6	10.1	
		0.14	0.15	TRAVEL TIME					
		0.79	0.97	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
		1.03	1.24	Street	300	2.8	1.8	8.7	
E	12 13 DP D	0.61	0.81	8.7	3.5	7.5	7.3	19.6	
		0.44	0.56	TRAVEL TIME					
		1.03	1.24	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
		2.08	2.61	Street	40	4.9	0.1	8.8	
F	14 DP E	0.41	0.52	8.8	3.5	7.4	8.7	23.3	
		2.08	2.61	TRAVEL TIME					
		2.49	3.14	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				Street	590	4.9	2.0	10.8	
G	16	3.50	4.54	21.1	3.5	4.9	12.2	22.4	
				TRAVEL TIME					
		3.50	4.54	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				Street	40	2.0	0.3	21.5	
H	15 DP G (Bypass)	1.63	1.98	20.5	3.5	5.0	7.8	18.3	
		0.60	1.67	TRAVEL TIME					
		2.24	3.65	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				Street	175	2.0	1.5	22.0	
I	23 24 DP H (Bypass)	1.18	1.60	22.0	3.5	4.8	5.2	14.7	
		0.22	0.27	TRAVEL TIME					
		0.09	1.18	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
		1.48	3.04	Street	40	2.2	0.3	22.3	
J	28 DP I	0.43	0.51	22.3	3.5	4.8	6.7	17.1	
		1.48	3.04	TRAVEL TIME					
		1.91	3.56	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				Street	175	2.2	1.3	23.6	

SURFACE ROUTING - INLET DESIGN

DESIGN POINT	CONTRIBUTING BASINS	CA (equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS	
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
K	29 30 DP I	0.18	0.21	23.6	3.5	4.7	9.9	22.3
		0.75	1.02					
		1.91	3.56					
		2.85	4.79					
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
L	34 DP K (Bypass)	0.27	0.31	23.9	3.5	4.6	4.1	14.0
		0.92	2.71					
		1.18	3.02					
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	2.0	0.3	23.9
M	35 36 DP L (Bypass)	0.20	0.23	25.4	3.5	4.5	1.4	8.4
		0.20	0.95					
		0.00	0.69					
		0.40	1.88					
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
N	37 DP M	0.71	0.28	25.7	3.5	4.4	3.8	9.6
		0.40	1.88					
		1.10	2.16					
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	175	2.0	1.5	27.2
RR	31 32 33	1.61	2.20	10.1	3.5	7.0	9.5	25.5
		0.65	0.85					
		0.46	0.58					
		2.72	3.63					
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
O	38 39 DP N DP-RR (Bypass)	0.24	0.24	27.2	3.5	4.3	5.4	17.0
		0.20	1.56					
		1.10	2.16					
		0.26	2.47					
		1.55	3.96					
P	21 22 (Bypass) DP F	0.45	0.57	10.8	3.5	6.8	10.8	27.1
		0.14	0.25					
		2.49	3.14					
		3.08	3.96					
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
Q	27 DP P (Bypass)	0.68	0.82	11.0	3.5	6.8	3.8	17.3
		0.40	1.72					
		1.08	2.54					
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	175	3.7	0.8	11.8
R	26 DP Q (Bypass)	0.19	0.22	11.8	3.5	6.6	0.7	6.6
		0.00	0.77					
		0.19	1.00					
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	175	4.5	0.6	12.5
S	5 52 54 55 OS-1	3.07	3.33	10.9	3.5	6.8	51.5	110.7
		0.75	1.02					
		0.36	0.40					
		0.26	0.28					
		10.31	11.20					
		14.76	16.22					
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	1590	2.6	10.2	21.1

SURFACE ROUTING - INLET DESIGN

DESIGN POINT	CONTRIBUTING BASINS	CA (equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS	
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
Z	53	0.21	0.26	13.5	3.5	6.2	9.7	22.2
	64	1.39	1.79					
	65	1.17	1.53					
		2.78	3.58					
				TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	2.0	0.3	13.9
AA	66	0.58	0.72	13.9	3.5	6.1	12.5	28.0
	67	0.22	0.27					
	DP Z	2.78	3.58					
		3.58	4.58					
				TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	3.2	0.2	14.1
LL	77	1.84	2.39	16.0	3.5	5.7	8.4	25.5
	DP AA (Bypass)	0.57	2.09					
		2.42	4.48					
				TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	100	2.0	0.8	16.9
T	51 (Bypass)	0.06	0.10	21.1	3.5	4.9	3.7	22.6
	79	0.12	0.14					
	DP S (Bypass)	0.89	3.07					
	DP LL (Bypass)	0.00	1.25					
		1.06	4.57					
				TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street		2.8	0.0	21.1
U	19	0.12	0.13	9.8	3.5	7.1	4.7	11.5
	43	1.21	1.48					
		1.33	1.62					
				TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	2.8	0.2	10.1
V	20	0.16	0.17	10.1	3.5	7.1	5.2	12.6
	DP U	1.33	1.62					
		1.49	1.79					
				TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	700	5.8	2.0	12.1
W	44	0.96	1.16	12.1	3.5	6.5	8.6	19.2
	DP V	1.49	1.79					
		2.46	2.94					
				TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	250	4.0	1.0	13.1
X	50	0.47	0.59	13.1	3.5	6.3	2.0	9.6
	DP W (Bypass)	0.11	0.94					
		0.58	1.53					
				TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street		2.0	0.0	13.1
Y	62	1.27	1.65	13.4	3.5	6.2	5.0	11.6
	63	0.16	0.21					
		1.43	1.86					
				TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	2000	2.0	16.7	30.1
BB	56	2.95	3.87	12.5	3.5	6.4	10.3	24.8
		2.95	3.87					
				TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street		4.5	0.0	12.5
CC	68	0.28	0.34	10.3	3.5	7.0	3.5	9.2
	69	0.72	0.97					
		1.00	1.31					
				TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	3.2	0.2	10.5

SURFACE ROUTING - INLET DESIGN

DESIGN POINT	CONTRIBUTING BASINS	CA (equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS	
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
DD	70 DP CC	0.38	0.47	10.5	3.5	6.9	4.8	12.4
		1.00	1.31	TRAVEL TIME				
		1.38	1.79	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	200	4.2	0.8	11.3
EE	71 84 DP DD	0.66	0.89	11.3	3.5	6.7	8.0	20.0
		0.25	0.31	TRAVEL TIME				
		1.38	1.79	TRAVEL TIME				
		2.29	2.99	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	4.5	0.1	11.5
FF	72 DP EE	0.34	0.44	11.5	3.5	6.7	9.2	22.8
		2.29	2.99	TRAVEL TIME				
		2.63	3.43	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	200	4.5	0.7	12.2
GG	73 85 DP FF (Bypass)	0.68	1.00	12.2	3.5	6.5	8.9	27.9
		1.31	1.65	TRAVEL TIME				
		0.57	1.65	TRAVEL TIME				
		2.56	4.31	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	3.2	0.2	12.4
HH	58 59 DP GG (Bypass)	0.11	0.13	12.4	3.5	6.4	8.1	30.5
		1.55	2.03	TRAVEL TIME				
		0.66	2.58	TRAVEL TIME				
		2.32	4.74	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	150	3.5	0.7	13.2
KK	57 76	2.07	2.68	12.1	3.5	6.5	8.0	19.2
		0.22	0.27	TRAVEL TIME				
		2.30	2.95	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	100	3.5	0.5	12.6
II	74 DP HH (Bypass) DP KK	0.23	0.29	13.2	3.5	6.3	1.0	14.9
		0.06	2.09	TRAVEL TIME				
		0.00	0.00	TRAVEL TIME				
		0.29	2.38	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	150	3.4	0.7	13.9
JJ	75	2.04	2.68	12.2	3.5	6.5	7.1	17.3
				TRAVEL TIME				
		2.04	2.68	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street		3.2	0.0	12.2
MM	78 DP Y (Bypass)	3.47	4.57	30.1	3.5	4.0	12.1	20.3
		0.00	0.45	TRAVEL TIME				
		3.47	5.01	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	200	2.0	1.7	31.7
VV	18 25	0.61	0.75	10.2	3.5	7.0	5.4	13.5
		0.93	1.17	TRAVEL TIME				
		1.54	1.92	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	3.6	0.2	10.3
NN	45 46 DP VV	0.12	0.14	10.3	3.5	7.0	6.3	15.5
		0.16	0.17	TRAVEL TIME				
		1.54	1.92	TRAVEL TIME				
		1.82	2.22	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	335	2.8	2.0	12.3

SURFACE ROUTING - INLET DESIGN

DESIGN POINT	CONTRIBUTING BASINS	CA (equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS		
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)	
OO	47 80 DP NN (Bypass)	0.55	0.71	12.3	3.5	6.5	3.3	10.4	
		0.40	0.50						
		0.00	0.40	TRAVEL TIME					
		0.95	1.62	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				Street	40	3.2	0.2	12.5	
PP	81 DP OO (Bypass)	0.86	1.11	12.5	3.5	6.4	3.0	10.6	
		0.00	0.55	TRAVEL TIME					
		0.86	1.66	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				Street	200	4.5	0.7	13.3	
QQ	48 82 DP R (Bypass) DP PP (Bypass)	0.84	1.10	12.5	3.5	6.4	4.3	17.6	
		0.40	0.51						
		0.00	0.56						
		0.00	0.58	TRAVEL TIME					
		1.24	2.74	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
		Street		3.2	0.0	12.5			
SS	40 DP O (Bypass)	1.01	1.21	27.4	3.5	4.3	3.5	10.1	
		0.00	1.15	TRAVEL TIME					
		1.01	2.36	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				Street	200	2.7	1.2	28.7	
TT	17	1.03	1.22	8.9	3.5	7.4	3.6	9.0	
				TRAVEL TIME					
		1.03	1.22	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				Street	200	4.9	0.7	9.6	
UU	42 86 DP SS DP TT	0.36	0.45	28.7	3.5	4.2	13.5	25.3	
		1.48	2.07						
		1.01	2.36						
		1.03	1.22	TRAVEL TIME					
		3.88	6.09	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
		Street	40	3.3	0.2	28.9			
EAST POND	41 83 87 DP QQ DP UU	0.94	1.52	28.9	3.5	4.1	25.7	50.5	
		0.34	0.49						
		0.98	1.36						
		1.24	2.74	TRAVEL TIME					
		3.88	6.09	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
		Street		1.6	0.0	28.9			
WW	17a 42a 86a	0.98	0.82	15.3	3.5	5.8	5.5	9.9	
		0.08	0.12						
		0.52	0.75	TRAVEL TIME					
		1.58	1.69	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				Street	40	3.2	0.2	15.6	
JCD-B	EAST POND DP WW	1.32	33.38	28.9	3.5	4.1	10.1	145.3	
		1.58	1.69	TRAVEL TIME					
		2.90	35.07	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				Street		2.7	0.0	28.9	
Big Johnson Basin									
AAA	102 103	0.38	0.49	7.2	3.5	8.0	3.0	8.6	
		0.49	0.58	TRAVEL TIME					
		0.87	1.08	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				Street	40	2.5	0.3	7.5	

SURFACE ROUTING - INLET DESIGN

DESIGN POINT	CONTRIBUTING BASINS	CA (equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS	
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
BBB	104 DP AAA	0.28	0.33	7.5	3.5	7.9	4.0	11.1
		0.87	1.08	TRAVEL TIME				
		1.15	1.40	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	1200	4.0	5.0	12.5
CCC	106 DP BBB	1.48	2.07	12.5	3.5	6.4	9.2	22.3
		1.15	1.40	TRAVEL TIME				
		2.63	3.47	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	2.0	0.3	12.8

SURFACE ROUTING - INLET DESIGN

DESIGN POINT	CONTRIBUTING BASINS	CA (equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS	
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
DDD	113 114	0.52	0.68	9.9	3.5	7.1	3.0	8.0
		0.35	0.44	TRAVEL TIME				
		0.87	1.12	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	2.0	0.3	10.2
EEE	115 DP DDD	0.40	0.52	10.3	3.5	7.0	4.4	11.5
		0.87	1.12	TRAVEL TIME				
		1.27	1.64	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	250	2.0	2.1	12.3
FFF	116 117 DP EEE (Bypass)	0.25	0.31	12.3	3.5	6.5	2.6	9.8
		0.42	0.54	TRAVEL TIME				
		0.09	0.67	TRAVEL TIME				
		0.76	1.52	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
GGG	118 DP FFF	0.34	0.54	12.7	3.5	6.4	3.8	13.2
		0.76	1.52	TRAVEL TIME				
		1.10	2.06	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	400	2.0	3.3	16.0
HHH	119 DP GGG (Bypass)	0.67	0.42	16.0	3.5	5.7	2.4	7.9
		0.03	0.96	TRAVEL TIME				
		0.70	1.39	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	2.5	0.3	16.3
III	120 DP CCC (Bypass) DP HHH	1.01	0.87	16.3	3.5	5.7	6.8	21.2
		0.23	1.48	TRAVEL TIME				
		0.70	1.39	TRAVEL TIME				
		1.94	3.74	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
JJJ	105	0.20	0.27	7.6	3.5	7.9	0.7	2.1
				TRAVEL TIME				
		0.20	0.27	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	40	2.5	0.3	7.9
KKK	107 108 DP JJJ	0.98	1.36	18.8	3.5	5.3	4.9	9.9
		0.22	0.25	TRAVEL TIME				
		0.20	0.27	TRAVEL TIME				
		1.40	1.88	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
LLL	121 DP III (Bypass) DP KKK (Bypass)	0.62	1.21	19.2	3.5	5.2	2.7	17.1
		0.03	1.46	TRAVEL TIME				
		0.11	0.61	TRAVEL TIME				
		0.77	3.29	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
MMM	109	0.32	0.41	5.1	3.5	9.0	1.1	3.7
				TRAVEL TIME				
		0.32	0.41	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	450	2.0	3.8	8.8
NNN	122 125 DP LLL (Bypass)	0.31	0.89	20.9	3.5	5.0	4.7	15.6
		1.03	1.24	TRAVEL TIME				
		0.00	1.01	TRAVEL TIME				
		1.35	3.14	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street		2.0	0.0	20.9

SURFACE ROUTING - INLET DESIGN

DESIGN POINT	CONTRIBUTING BASINS	CA (equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS	
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
OOO	123 DP MMM	0.88	0.41	11.3	3.5	6.7	4.2	5.5
		0.32	0.41	TRAVEL TIME				
		1.19	0.82	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street		2.0	0.0	11.3
PPP	130	0.74	1.01	6.1	3.5	8.5	2.6	8.6
		0.74	1.01	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street		2.0	0.0	6.1
QQQ	131	0.50	0.84	9.8	3.5	7.1	1.7	6.0
		0.50	0.84	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street		1.7	0.0	9.8
RRR	110 111 126	0.27	0.32	6.8	3.5	8.2	3.1	9.2
		0.51	0.66	TRAVEL TIME				
		0.12	0.14	TRAVEL TIME				
		0.89	1.12	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
SSS	112 127 DP RRR	0.21	0.20	9.5	3.5	7.2	4.7	11.7
		0.24	0.29	TRAVEL TIME				
		0.89	1.12	TRAVEL TIME				
		1.34	1.62	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
TTT	128 DP SSS (Bypass)	1.68	2.27	12.6	3.5	6.4	5.9	16.4
		0.00	0.30	TRAVEL TIME				
		1.68	2.56	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street		4.7	0.0	12.6
UUU	100 (Bypass) 129	0.72	0.72	14.1	3.5	6.1	5.7	13.7
		0.92	1.53	TRAVEL TIME				
		1.63	2.25	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street		3.2	0.0	14.1
VVV	200a	0.72	1.04	10.6	3.5	6.9	2.5	7.2
		0.72	1.04	TRAVEL TIME				
				Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street		1.7	0.0	10.6
WEST POND	DP NNN DP OOO DP PPP DP QQQ DP TTT DP VVV DP UUU	1.35	3.14	20.9	3.5	5.0	27.2	57.9
		1.19	0.82	TRAVEL TIME				
		0.74	1.01	TRAVEL TIME				
		0.50	0.84	TRAVEL TIME				
		1.68	2.56	TRAVEL TIME				
		0.72	1.04	TRAVEL TIME				
		1.63	2.25	TRAVEL TIME				
		7.80	11.65	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)
				Street	600	1.7	5.9	26.8


Appendix D: Detention Pond & Water Quality Calculations

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

UD-Detention, Version 3.07 (February 2017)

Project: Waterview East

Basin ID: Jimmy Camp Creek Basin (East Pond)



Required Volume Calculation

Selected BMP Type =	EDB
Watershed Area =	138.98 acres
Watershed Length =	3.925 ft
Watershed Slope =	0.035 ft/ft
Watershed Imperviousness =	69.00% percent
Percentage Hydrologic Soil Group A =	0.0% percent
Percentage Hydrologic Soil Group B =	86.0% percent
Percentage Hydrologic Soil Groups C/D =	14.0% percent
Desired WQCV Drain Time =	40.0 hours
Location for 1-hr Rainfall Depth =	Denver - Capitol Building
Water Quality Capture Volume (WQCV) =	3.134 acre-feet
Excess Urban Runoff Volume (EURV) =	10.350 acre-feet
2-yr Runoff Volume ($P1 = 1.19$) =	8.778 acre-feet
5-yr Runoff Volume ($P1 = 1.75$) =	11.769 acre-feet
10-yr Runoff Volume ($P1 = 1.75$) =	14.860 acre-feet
25-yr Runoff Volume ($P1 = 2$) =	18.790 acre-feet
50-yr Runoff Volume ($P1 = 2.25$) =	21.730 acre-feet
100-yr Runoff Volume ($P1 = 2.52$) =	25.567 acre-feet
50-yr Runoff Volume ($P1 + 3.14$) =	33.627 acre-feet
Approximate 2-yr Detention Volume =	8.229 acre-feet
Approximate 5-yr Detention Volume =	11.054 acre-feet
Approximate 10-yr Detention Volume =	13.784 acre-feet
Approximate 25-yr Detention Volume =	14.799 acre-feet
Approximate 50-yr Detention Volume =	15.371 acre-feet
Approximate 100-yr Detention Volume =	16.514 acre-feet

Water Quality Capture Volume (WQCV) =	3.134	acre-feet	Optional User Override
Excess Urban Runoff Volume (EURV) =	10.350	acre-feet	1-hr Precipitation
2-yr Runoff Volume (P1 = 1.19 in.) =	8.778	acre-feet	1.19 inches
5-yr Runoff Volume (P1 = 1.5 in.) =	11.759	acre-feet	1.50 inches
10-yr Runoff Volume (P1 = 1.75 in.) =	14.860	acre-feet	1.75 inches
25-yr Runoff Volume (P1 = 2 in.) =	18.799	acre-feet	2.00 inches
50-yr Runoff Volume (P1 = 2.25 in.) =	21.739	acre-feet	2.25 inches
100-yr Runoff Volume (P1 = 2.52 in.) =	25.567	acre-feet	2.52 inches
500-yr Runoff Volume (P1 = 3.14 in.) =	33.627	acre-feet	inches


Stage-Storage Calculation

Zone 1 Volume ($WOCV_1$)	3.134	acre-feet
Zone 2 Volume ($EURV_2$, Zone 1) =	7.216	acre-feet
Zone 3 Volume (100-Year Zones 1 & 2) =	6.164	acre-feet
Total Detention Basin Volume =	16.514	acre-feet
Initial Surge Volume (ISV) =	user	ft ³
Initial Surge Depth (ISD) =	user	ft
Total Available Detention Depth (H_{det}) =	user	ft
Depth of Trickle Channel (H_{TC}) =	user	ft
Slope of Detention Channel (S_{DC}) =	user	ft
Slopes of Main Basin Sides (S_{basin}) =	user	ft/V
Basin Length-to-Width Ratio (R_{basin}) =	user	
Initial Surge Area (A_{ISV}) =	user	ft ²
Surge Volume Length (L_{ISV}) =	user	ft
Surge Volume Width (W_{ISV}) =	user	ft
Depth of Basin Floor (H_{100yr}) =	user	ft
Length of Basin Floor (L_{100yr}) =	user	ft
Width of Basin Floor (W_{100yr}) =	user	ft
Area of Basin Floor (A_{100yr}) =	user	ft ²
Volume of Basin Floor (V_{100yr}) =	user	ft ³
Depth of Main Basin (H_{main}) =	user	ft
Length of Main Basin (L_{main}) =	user	ft
Width of Main Basin (W_{main}) =	user	ft
Area of Main Basin (A_{main}) =	user	ft ²
Volume of Main Basin (V_{main}) =	user	ft ³
Calculated Total Basin Volume (V_{total}) =	user	acre-feet

[illegible]

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

UD-Detention, Version 3.07 (February 2017)

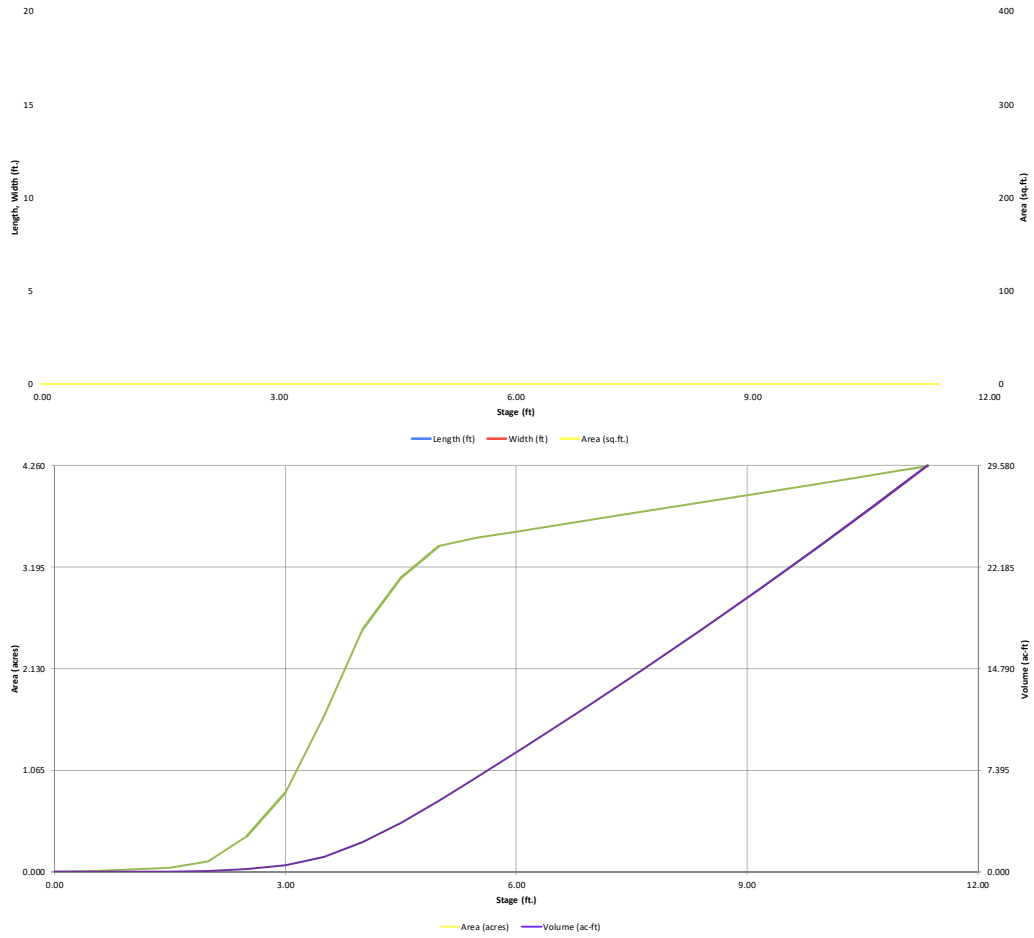


Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

Project: Waterview East

Basin ID: Jimmy Camp Creek Basin (East Pond)

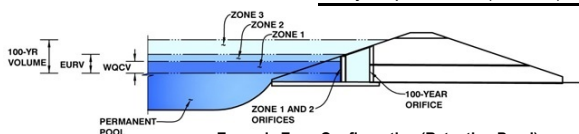

Example Zone Configuration (Retention Pond)

	Stage (ft)	Zone Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	4.36	3.134	Orifice Plate
Zone 2 (EURV)	6.47	7.216	Rectangular Orifice
Zone 3 (100-year)	8.12	6.164	Weir&Pipe (Restrict)
		16.514	Total

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth = ft (distance below the filtration media surface)
Underdrain Orifice Diameter = inches

Calculated Parameters for Underdrain

Underdrain Orifice Area = ft²
Underdrain Orifice Centroid = feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice = ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Orifice Plate = ft (relative to basin bottom at Stage = 0 ft)
Orifice Plate: Orifice Vertical Spacing = inches
Orifice Plate: Orifice Area per Row = sq. inches (use rectangular openings)

Calculated Parameters for Plate

WQ Orifice Area per Row = ft²
Elliptical Half-Width = feet
Elliptical Slot Centroid = feet
Elliptical Slot Area = ft²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	1.47	2.93					
Orifice Area (sq. inches)	7.06	7.06	7.06					

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

	Zone 2 Rectangular	Not Selected	
Invert of Vertical Orifice =	4.40	N/A	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice =	6.47	N/A	ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Height =	2.00	N/A	inches
Vertical Orifice Width =	30.00		inches

Calculated Parameters for Vertical Orifice

	Zone 2 Rectangular	Not Selected	
Vertical Orifice Area =	0.42	N/A	ft ²
Vertical Orifice Centroid =	0.08	N/A	feet

User Input: Overflow Weir (Dropbox) and Grate (Flat or Sloped)

	Zone 3 Weir	Not Selected	
Overflow Weir Front Edge Height, Ho =	6.90	N/A	ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length =	20.00	N/A	feet
Overflow Weir Slope =	0.00	N/A	H:V (enter zero for flat grate)
Horiz. Length of Weir Sides =	20.00	N/A	feet
Overflow Grate Open Area % =	70%	N/A	%, grate open area/total area
Debris Clogging % =	50%	N/A	%

Calculated Parameters for Overflow Weir

	Zone 3 Weir	Not Selected	
Height of Grate Upper Edge, H ₁ =	6.90	N/A	feet
Overflow Weir Slope Length =	20.00	N/A	feet
Grate Open Area / 100-yr Orifice Area =	29.10	N/A	should be ≥ 4
Overflow Grate Open Area w/o Debris =	280.00	N/A	ft ²
Overflow Grate Open Area w/ Debris =	140.00	N/A	ft ²

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

	Zone 3 Restrictor	Not Selected	
Depth to Invert of Outlet Pipe =	2.50	N/A	ft (distance below basin bottom at Stage = 0 ft)
Outlet Pipe Diameter =	42.00	N/A	inches
Restrictor Plate Height Above Pipe Invert =	42.00		inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

	Zone 3 Restrictor	Not Selected	
Outlet Orifice Area =	9.62	N/A	ft ²
Outlet Orifice Centroid =	1.75	N/A	feet
Half-Central Angle of Restrictor Plate on Pipe =	3.14	N/A	radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage = ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length = feet
Spillway End Slopes = H:V
Freeboard above Max Water Surface = feet

Calculated Parameters for Spillway


Spillway Design Flow Depth = feet
Stage at Top of Freeboard = feet
Basin Area at Top of Freeboard = acres

Routed Hydrograph Results

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =									
One-Hour Rainfall Depth (in) =	0.53	1.07	1.19	1.50	1.75	2.00	2.25	2.52	3.14
Calculated Runoff Volume (acre-ft) =	3.134	10.350	8.778	11.759	14.860	18.799	21.739	25.567	33.627
OPTIONAL Override Runoff Volume (acre-ft) =									
Inflow Hydrograph Volume (acre-ft) =	3.136	10.357	8.784	11.767	14.868	18.809	21.754	25.582	33.650
Predevelopment Unit Peak Flow, q (cfs/acre) =	0.00	0.00	0.01	0.04	0.22	0.69	0.94	1.26	1.86
Predevelopment Peak Q (cfs) =	0.0	0.0	1.8	4.9	30.8	95.5	131.2	175.6	258.7
Peak Inflow Q (cfs) =	51.5	165.2	140.9	186.9	234.0	293.4	337.1	392.9	507.1
Peak Outflow Q (cfs) =	1.2	4.2	3.8	4.6	31.2	90.8	133.6	138.3	226.1
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	0.9	1.0	1.0	1.0	0.8	0.9
Structure Controlling Flow =	Plate	Vertical Orifice 1	Vertical Orifice 1	Vertical Orifice 1	Overflow Grate 1	Overflow Grate 1	Outlet Plate 1	Outlet Plate 1	Spillway
Max Velocity through Grate 1 (fps) =	N/A	N/A	N/A	N/A	0.1	0.3	0.5	0.5	0.5
Max Velocity through Grate 2 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours) =	39	66	62	69	70	68	67	65	62
Time to Drain 99% of Inflow Volume (hours) =	41	70	66	73	75	75	74	74	72
Maximum Ponding Depth (ft) =	4.29	6.30	5.88	6.68	7.19	7.53	7.72	8.16	8.95
Area at Maximum Ponding Depth (acres) =	2.85	3.60	3.55	3.65	3.72	3.76	3.78	3.84	3.94
Maximum Volume Stored (acre-ft) =	2.934	9.752	8.250	11.094	12.973	14.244	14.998	16.637	19.710

Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

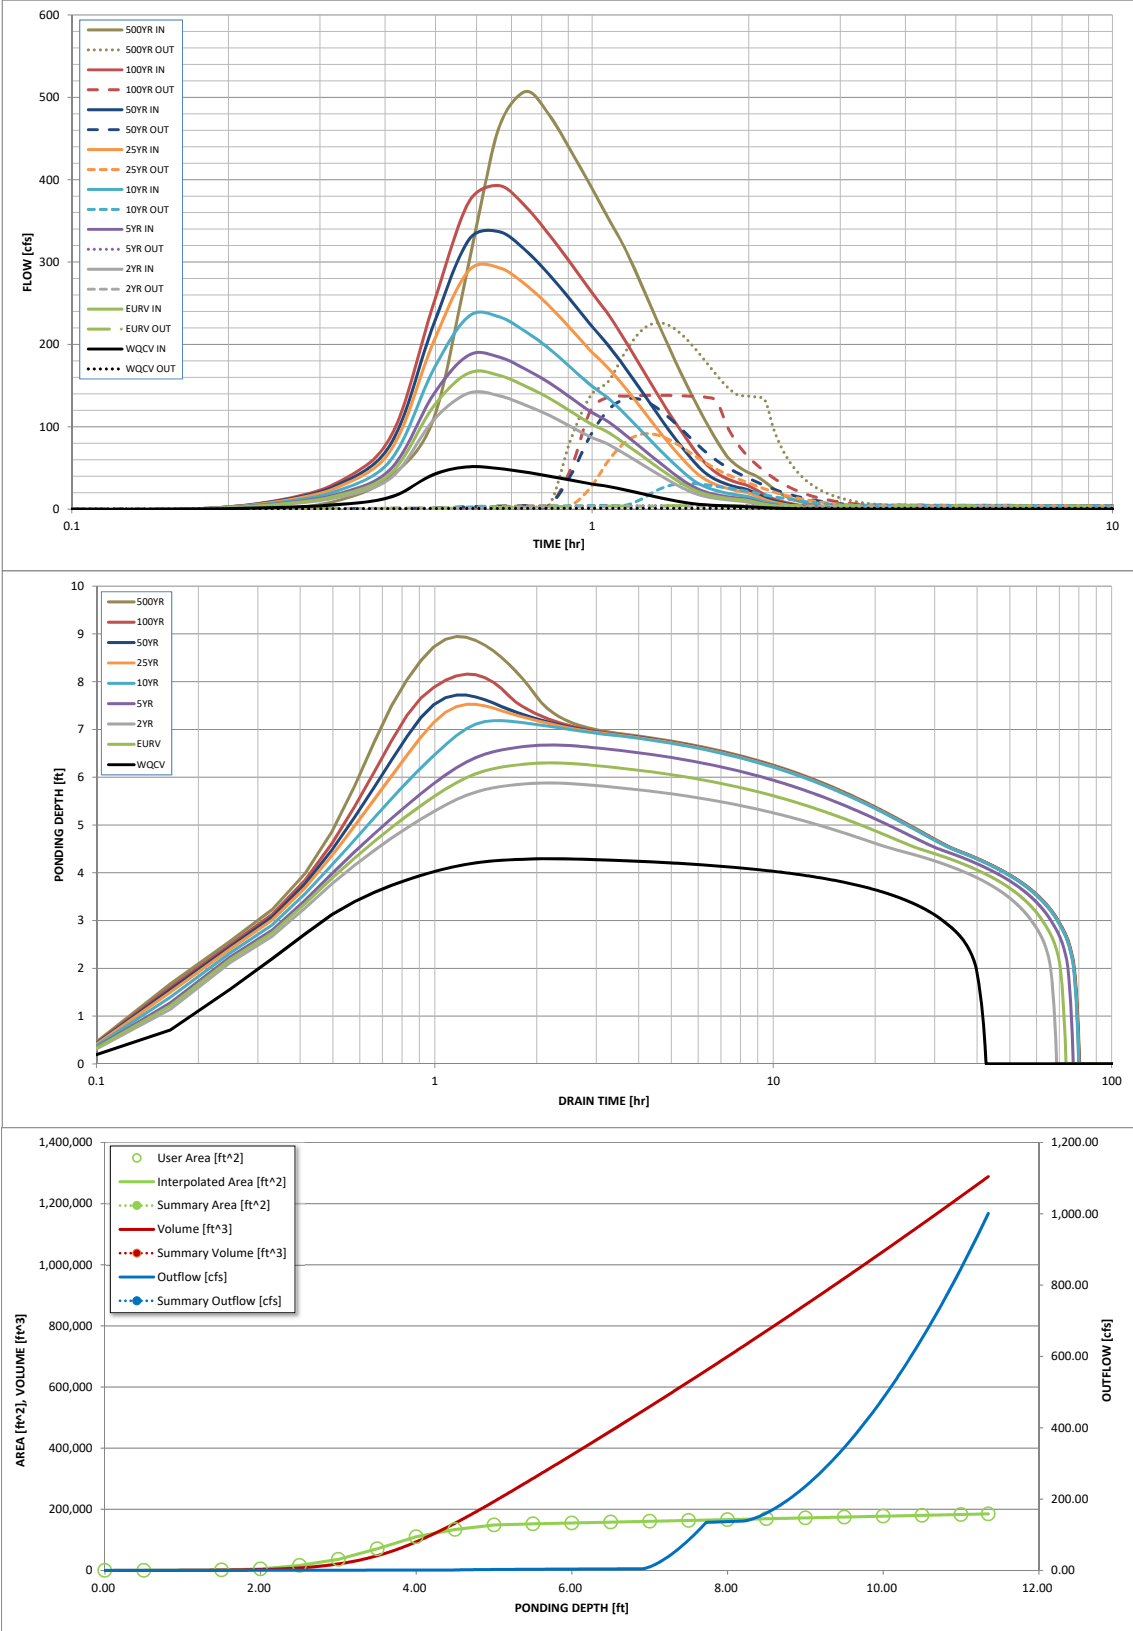

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

Design Procedure Form: Extended Detention Basin (EDB)

UD-BMP (Version 3.06, November 2016)

Sheet 1 of 4

Designer: Charlene Durham
 Company: Stantec
 Date: May 14, 2018
 Project: Waterview East
 Location: Jimmy Camp Basin - East Pond

1. Basin Storage Volume

- A) Effective Imperviousness of Tributary Area, I_a
- B) Tributary Area's Imperviousness Ratio ($i = I_a / 100$)
- C) Contributing Watershed Area
- D) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm
- E) Design Concept
(Select EURV when also designing for flood control)
- F) Design Volume (WQCV) Based on 40-hour Drain Time
($V_{DESIGN} = (1.0 * (0.91 * i^3 - 1.19 * i^2 + 0.78 * i)) / 12 * Area$)
- G) For Watersheds Outside of the Denver Region,
Water Quality Capture Volume (WQCV) Design Volume
($V_{WQCV\ OTHER} = (d_6 * (V_{DESIGN} / 0.43))$)
- H) User Input of Water Quality Capture Volume (WQCV) Design Volume
(Only if a different WQCV Design Volume is desired)
- I) Predominant Watershed NRCS Soil Group
- J) Excess Urban Runoff Volume (EURV) Design Volume
 For HSG A: $EURV_A = 1.68 * i^{1.28}$
 For HSG B: $EURV_B = 1.36 * i^{1.08}$
 For HSG C/D: $EURV_{C/D} = 1.20 * i^{1.08}$

$I_a =$ 69.0 %

$i =$ 0.690

Area = 138.980 ac

$d_6 =$ _____ in

Choose One

- ☐ Water Quality Capture Volume (WQCV)
☒ Excess Urban Runoff Volume (EURV)

$V_{DESIGN} =$ 3.134 ac-ft

$V_{DESIGN\ OTHER} =$ _____ ac-ft

$V_{DESIGN\ USER} =$ _____ ac-ft

Choose One

- ☐ A
☒ B
☐ C / D

EURV = 10.550 ac-ft

2. Basin Shape: Length to Width Ratio

(A basin length to width ratio of at least 2:1 will improve TSS reduction.)

$L : W =$ 2.0 : 1

3. Basin Side Slopes

- A) Basin Maximum Side Slopes
(Horizontal distance per unit vertical, 4:1 or flatter preferred)

$Z =$ 3.00 ft / ft
DIFFICULT TO MAINTAIN, INCREASE WHERE POSSIBLE

4. Inlet

- A) Describe means of providing energy dissipation at concentrated inflow locations:

Design Procedure Form: Extended Detention Basin (EDB)

Sheet 2 of 4

Designer: Charlene Durham
Company: Stantec
Date: May 14, 2018
Project: Waterview East
Location: Jimmy Camp Basin - East Pond

<p>5. Forebay</p> <p>A) Minimum Forebay Volume ($V_{FMIN} = \underline{\quad 3\% \quad}$ of the WQCV)</p> <p>B) Actual Forebay Volume</p> <p>C) Forebay Depth ($D_F = \underline{\quad 30 \quad}$ inch maximum)</p> <p>D) Forebay Discharge</p> <p>i) Undetained 100-year Peak Discharge</p> <p>ii) Forebay Discharge Design Flow ($Q_F = 0.02 * Q_{100}$)</p> <p>E) Forebay Discharge Design</p> <p>F) Discharge Pipe Size (minimum 8-inches)</p> <p>G) Rectangular Notch Width</p>	<p>$V_{FMIN} = \underline{\quad 0.094 \quad}$ ac-ft</p> <p>$V_F = \underline{\hspace{2cm}}$ ac-ft</p> <p>$D_F = \underline{\quad 24.0 \quad}$ in</p> <p>$Q_{100} = \underline{\quad 392.90 \quad}$ cfs</p> <p>$Q_F = \underline{\quad 7.86 \quad}$ cfs</p> <div style="border: 1px solid black; padding: 5px;"> <p>Choose One</p> <p><input type="radio"/> Berm With Pipe</p> <p><input checked="" type="radio"/> Wall with Rect. Notch</p> <p><input type="radio"/> Wall with V-Notch Weir</p> </div> <p>Calculated $D_P = \underline{\hspace{2cm}}$ in</p> <p>Calculated $W_N = \underline{\quad 14.8 \quad}$ in</p>
<p>6. Trickle Channel</p> <p>A) Type of Trickle Channel</p> <p>F) Slope of Trickle Channel</p>	<div style="border: 1px solid black; padding: 5px;"> <p>Choose One</p> <p><input checked="" type="radio"/> Concrete</p> <p><input type="radio"/> Soft Bottom</p> </div> <p>$S = \underline{\quad 0.0050 \quad}$ ft / ft</p>
<p>7. Micropool and Outlet Structure</p> <p>A) Depth of Micropool (2.5-feet minimum)</p> <p>B) Surface Area of Micropool (10 ft² minimum)</p> <p>C) Outlet Type</p> <p>D) Smallest Dimension of Orifice Opening Based on Hydrograph Routing (Use UD-Detention)</p> <p>E) Total Outlet Area</p>	<p>$D_M = \underline{\quad 2.5 \quad}$ ft</p> <p>$A_M = \underline{\quad 10 \quad}$ sq ft</p> <div style="border: 1px solid black; padding: 5px;"> <p>Choose One</p> <p><input checked="" type="radio"/> Orifice Plate</p> <p><input type="radio"/> Other (Describe):</p> </div> <p>$D_{orifice} = \underline{\quad 2.00 \quad}$ inches</p> <p>$A_{ot} = \underline{\quad 27.00 \quad}$ square inches</p>

Design Procedure Form: Extended Detention Basin (EDB)

Sheet 3 of 4

Designer: Charlene Durham
 Company: Stantec
 Date: May 14, 2018
 Project: Waterview East
 Location: Jimmy Camp Basin - East Pond

<p>8. Initial Surge Volume</p> <p>A) Depth of Initial Surge Volume (Minimum recommended depth is 4 inches)</p> <p>B) Minimum Initial Surge Volume (Minimum volume of 0.3% of the WQCV)</p> <p>C) Initial Surge Provided Above Micropool</p>	<p>$D_{IS} =$ <u>6</u> in</p> <p>$V_{IS} =$ <u>409.5</u> cu ft</p> <p>$V_s =$ <u>5.0</u> cu ft</p>
<p>9. Trash Rack</p> <p>A) Water Quality Screen Open Area: $A_t = A_{xt} * 38.5 * (e^{-0.095D})$</p> <p>B) Type of Screen (If specifying an alternative to the materials recommended in the USDCM, indicate "other" and enter the ratio of the total open area to the total screen area for the material specified.)</p> <p>Other (Y/N): <u>N</u></p> <p>C) Ratio of Total Open Area to Total Area (only for type 'Other')</p> <p>D) Total Water Quality Screen Area (based on screen type)</p> <p>E) Depth of Design Volume (EURV or WQCV) (Based on design concept chosen under 1E)</p> <p>F) Height of Water Quality Screen (H_{TR})</p> <p>G) Width of Water Quality Screen Opening ($W_{opening}$) (Minimum of 12 inches is recommended)</p>	<p>$A_t =$ <u>860</u> square inches</p> <p><u>Aluminum Amico-Klemp SR Series with Cross Rods 2" O.C.</u></p> <p>_____</p> <p>_____</p> <p>User Ratio =</p> <p>$A_{total} =$ <u>1211</u> sq. in.</p> <p>$H =$ <u>5.64</u> feet</p> <p>$H_{TR} =$ <u>95.68</u> inches</p> <p>$W_{opening} =$ <u>12.7</u> inches</p>

Design Procedure Form: Extended Detention Basin (EDB)

Sheet 4 of 4

Designer: Charlene Durham
Company: Stantec
Date: May 14, 2018
Project: Waterview East
Location: Jimmy Camp Basin - East Pond


<p>10. Overflow Embankment</p> <p>A) Describe embankment protection for 100-year and greater overtopping:</p> <p>B) Slope of Overflow Embankment (Horizontal distance per unit vertical, 4:1 or flatter preferred)</p>	<p>_____</p> <p>_____</p> <p>_____</p>
<p>11. Vegetation</p>	<p>Choose One</p> <p><input type="radio"/> Irrigated</p> <p><input type="radio"/> Not Irrigated</p>
<p>12. Access</p> <p>A) Describe Sediment Removal Procedures</p>	<p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p>
<p>Notes: _____</p> <p>_____</p> <p>_____</p> <p>_____</p>	

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

UD-Detention, Version 3.07 (February 2017)

Project: Waterview East

Basin ID: Big Johnson Basin (West Pond)



Example Zone Configuration (Retention Pond)

Required Volume Calculation

Selected BMP Type =	EDB	
Watershed Area =	44.30	acres
Watershed Length =	1,670	ft
Watershed Slope =	0.039	%ft
Watershed Imperviousness =	67.00%	percent
Percentage Hydrologic Soil Group A =	28.5%	percent
Percentage Hydrologic Soil Group B =	71.5%	percent
Percentage Hydrologic Soil Groups C/D =	0.0%	percent
Desired QWQ Drain Time =	40.0	hours
Location for 1-hr Rainfall Depth =	Castle Pines -	City Office
Water Quality Capture Volume (WQCV) =	0.968	acre-feet
Excess Urban Runoff Volume (EURV) =	3.381	acre-feet
2-yr Runoff Volume ($P1 = 1.19\%$) =	2.655	acre-feet
5-yr Runoff Volume ($P1 = 2.33\%$) =	3.392	acre-feet
10-yr Runoff Volume ($P1 = 1.75\%$) =	4.441	acre-feet
25-yr Runoff Volume ($P1 = 2.1\%$) =	5.590	acre-feet
50-yr Runoff Volume ($P1 = 2.25\%$) =	6.515	acre-feet
100-yr Runoff Volume ($P1 = 2.52\%$) =	7.692	acre-feet
500-yr Runoff Volume ($P1 = 3.07\%$) =	9.994	acre-feet
Approximate 2-yr Detention Volume =	2.406	acre-feet
Approximate 5-yr Detention Volume =	3.317	acre-feet
Approximate 10-yr Detention Volume =	4.152	acre-feet
Approximate 25-yr Detention Volume =	4.603	acre-feet
Approximate 50-yr Detention Volume =	4.868	acre-feet
Approximate 100-yr Detention Volume =	5.267	acre-feet

Water Quality Capture Volume (WQCV) =	0.968	acre-feet	Optional User Override 1-hr Precipitation
Excess Urban Runoff Volume (EURV) =	3.381	acre-feet	
2-yr Runoff Volume (P1 = 1.19 in.) =	2.656	acre-feet	1.19 inches
5-yr Runoff Volume (P1 = 1.5 in.) =	3.522	acre-feet	1.50 inches
10-yr Runoff Volume (P1 = 1.75 in.) =	4.441	acre-feet	1.75 inches
25-yr Runoff Volume (P1 = 2 in.) =	5.590	acre-feet	2.00 inches
50-yr Runoff Volume (P1 = 2.25 in.) =	6.515	acre-feet	2.25 inches
100-yr Runoff Volume (P1 = 2.52 in.) =	7.692	acre-feet	2.52 inches
500-yr Runoff Volume (P1 = 3.07 in.) =	9.994	acre-feet	inches


Stage-Storage Calculation

Zone 1 Volume ($WOCV$) =	0.968	acre-feet
Zone 2 Volume ($EURV$ - Zone 1) =	2.414	acre-feet
Zone 3 Volume (100-year - Zones 1 & 2) =	1.866	acre-feet
Total Detention Between Volume 1 =	5.267	acre-feet
Initial Surge Volume (ISV) =	user	ft ³
Initial Surge Depth (ISD) =	user	ft
Total Available Detention Depth ($H_{(AVD)}$) =	user	ft
Depth of Trickle Channel ($H_{(TC)}$) =	user	ft
Slope of Trickle Channel ($S_{(TC)}$) =	user	ft/ft
Slopes of Main Basin Sides ($S_{(MB)}$) =	user	ft/V
Basin Length-to-Width Ratio ($R_{(LW)}$) =	user	
Initial Surge Area ($A_{(ISU)}$) =	user	ft ²
Surge Volume Length ($L_{(SVL)}$) =	user	ft
Surge Volume Width ($W_{(SVW)}$) =	user	ft
Depth of Basin Floor ($H_{(LOOF)}$) =	user	ft
Width of Basin Floor ($W_{(LOOF)}$) =	user	ft
Length of Basin Floor ($L_{(LOOF)}$) =	user	ft
Volume of Basin Floor ($V_{(LOOF)}$) =	user	ft ³
Area of Basin Floor ($A_{(LOOF)}$) =	user	ft ²
Depth of Main Basin ($H_{(MMB)}$) =	user	ft
Length of Main Basin ($L_{(MMB)}$) =	user	ft
Width of Main Basin ($W_{(MMB)}$) =	user	ft
Area of Main Basin ($A_{(MMB)}$) =	user	ft ²
Volume of Main Basin ($V_{(MMB)}$) =	user	ft ³
Calculated Total Basin Volume ($V_{(TMB)}$) =	user	acre-feet

[illegible]

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

UD-Detention, Version 3.07 (February 2017)

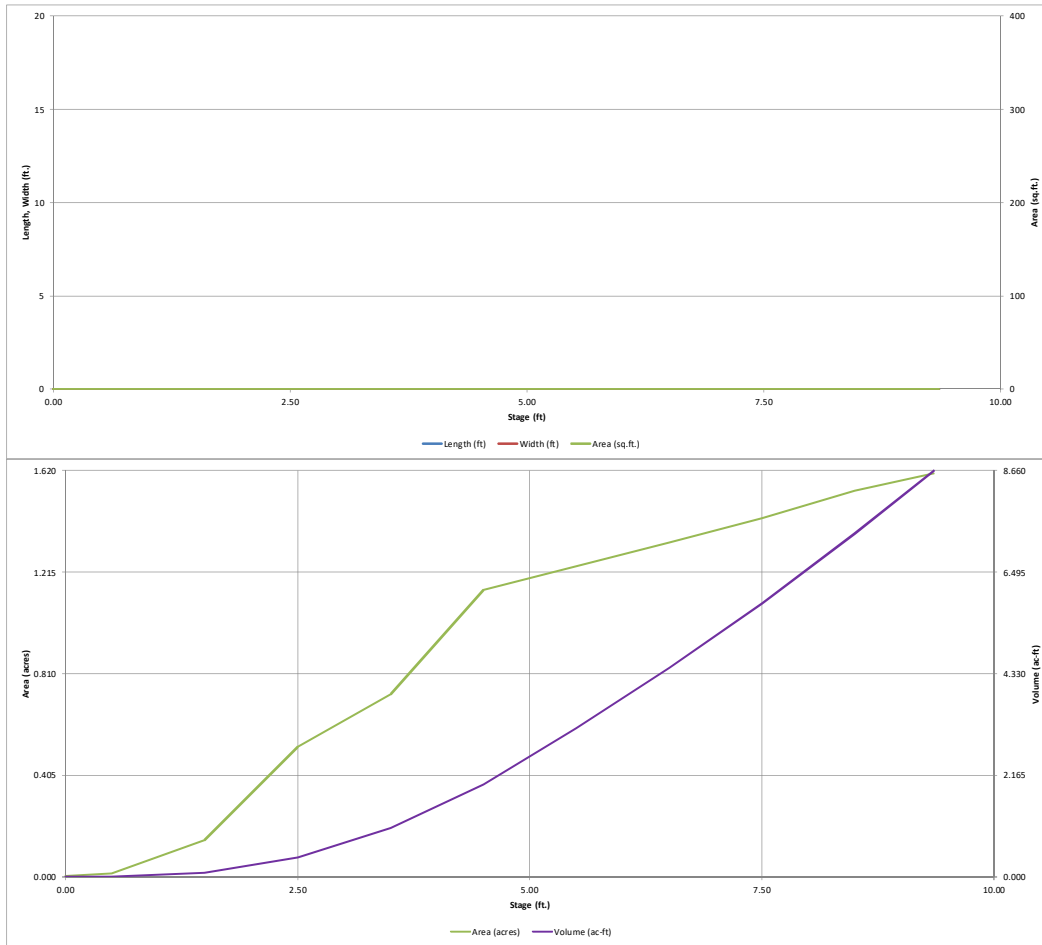


Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

Project: _____

Basin ID: _____

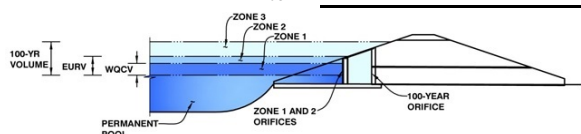

Example Zone Configuration (Retention Pond)

	Stage (ft)	Zone Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	3.40	0.968	Orifice Plate
Zone 2 (EURV)	5.68	2.414	Rectangular Orifice
Zone 3 (100-year)	7.11	1.886	Weir&Pipe (Restrict)
		5.267	Total

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth = ft (distance below the filtration media surface)

Underdrain Orifice Diameter = inches

Calculated Parameters for Underdrain

Underdrain Orifice Area = ft²

Underdrain Orifice Centroid = feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice = ft (relative to basin bottom at Stage = 0 ft)

Depth at top of Zone using Orifice Plate = ft (relative to basin bottom at Stage = 0 ft)

Orifice Plate: Orifice Vertical Spacing = inches

Orifice Plate: Orifice Area per Row = sq. inches (diameter = 1-3/4 inches)

Calculated Parameters for Plate

WQ Orifice Area per Row = ft²

Elliptical Half-Width = feet

Elliptical Slot Centroid = feet

Elliptical Slot Area = ft²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	1.00	2.00	3.00				
Orifice Area (sq. inches)	2.50	2.50	2.50	2.50				

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

	Zone 2 Rectangular	Not Selected	
Invert of Vertical Orifice =	<input type="text" value="3.25"/>		ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice =	<input type="text" value="5.56"/>		ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Height =	<input type="text" value="2.00"/>		inches
Vertical Orifice Width =	<input type="text" value="4.00"/>		inches

Calculated Parameters for Vertical Orifice

	Zone 2 Rectangular	Not Selected	
Vertical Orifice Area =	<input type="text" value="0.06"/>		ft ²
Vertical Orifice Centroid =	<input type="text" value="0.08"/>		feet

User Input: Overflow Weir (Dropbox) and Grate (Flat or Sloped)

	Zone 3 Weir	Not Selected	
Overflow Weir Front Edge Height, Ho =	<input type="text" value="6.00"/>	<input type="text" value="N/A"/>	ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length =	<input type="text" value="8.00"/>	<input type="text" value="N/A"/>	feet
Overflow Weir Slope =	<input type="text" value="0.00"/>	<input type="text" value="N/A"/>	H:V (enter zero for flat grate)
Horiz. Length of Weir Sides =	<input type="text" value="8.00"/>	<input type="text" value="N/A"/>	feet
Overflow Grate Open Area % =	<input type="text" value="70%"/>	<input type="text" value="N/A"/>	%, grate open area/total area
Debris Clogging % =	<input type="text" value="50%"/>	<input type="text" value="N/A"/>	%

Calculated Parameters for Overflow Weir

	Zone 3 Weir	Not Selected	
Height of Grate Upper Edge, H ₁ =	<input type="text" value="6.00"/>	<input type="text" value="N/A"/>	feet
Overflow Weir Slope Length =	<input type="text" value="8.00"/>	<input type="text" value="N/A"/>	feet
Grate Open Area / 100-yr Orifice Area =	<input type="text" value="16.07"/>	<input type="text" value="N/A"/>	should be ≥ 4
Overflow Grate Open Area w/o Debris =	<input type="text" value="44.80"/>	<input type="text" value="N/A"/>	ft ²
Overflow Grate Open Area w/ Debris =	<input type="text" value="22.40"/>	<input type="text" value="N/A"/>	ft ²

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

	Zone 3 Restrictor	Not Selected	
Depth to Invert of Outlet Pipe =	<input type="text" value="2.50"/>	<input type="text" value="N/A"/>	ft (distance below basin bottom at Stage = 0 ft)
Outlet Pipe Diameter =	<input type="text" value="36.00"/>	<input type="text" value="N/A"/>	inches
Restrictor Plate Height Above Pipe Invert =	<input type="text" value="15.00"/>		inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

	Zone 3 Restrictor	Not Selected	
Outlet Orifice Area =	<input type="text" value="2.79"/>	<input type="text" value="N/A"/>	ft ²
Outlet Orifice Centroid =	<input type="text" value="0.73"/>	<input type="text" value="N/A"/>	feet
Half-Central Angle of Restrictor Plate on Pipe =	<input type="text" value="1.40"/>	<input type="text" value="N/A"/>	radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage = ft (relative to basin bottom at Stage = 0 ft)

Spillway Crest Length = feet

Spillway End Slopes = H:V

Freeboard above Max Water Surface = feet

Calculated Parameters for Spillway

Spillway Design Flow Depth = feet

Stage at Top of Freeboard = feet




Basin Area at Top of Freeboard = acres

Routed Hydrograph Results

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =	0.53	1.07	1.19	1.50	1.75	2.00	2.25	2.52	3.07
One-Hour Rainfall Depth (in) =	0.968	3.381	2.656	3.522	4.441	5.590	6.515	7.692	9.994
OPTIONAL Override Runoff Volume (acre-ft) =									
Inflow Hydrograph Volume (acre-ft) =	0.968	3.384	2.658	3.525	4.445	5.587	6.518	7.697	9.999
Predevelopment Unit Peak Flow, q (cfs/acre) =	0.00	0.00	0.01	0.02	0.20	0.61	0.91	1.29	1.98
Predevelopment Peak Q (cfs) =	0.0	0.0	0.5	0.9	8.6	27.2	40.2	57.1	87.8
Peak Inflow Q (cfs) =	19.5	66.9	52.8	69.7	87.5	109.4	127.2	149.5	192.7
Peak Outflow Q (cfs) =	0.4	1.1	1.0	1.1	7.1	27.1	39.2	40.3	80.8
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	1.2	0.8	1.0	1.0	0.7	0.9
Structure Controlling Flow =	Vertical Orifice 1	Vertical Orifice 1	Vertical Orifice 1	Vertical Orifice 1	Overflow Grate 1	Overflow Grate 1	Outlet Plate 1	Outlet Plate 1	Spillway
Max Velocity through Grate 1 (fps) =	N/A	N/A	N/A	N/A	0.1	0.6	0.8	0.9	0.9
Max Velocity through Grate 2 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours) =	42	71	64	72	75	73	72	70	66
Time to Drain 99% of Inflow Volume (hours) =	45	76	69	78	82	81	80	80	78
Maximum Ponding Depth (ft) =	3.32	5.57	4.98	5.68	6.20	6.52	6.75	7.23	7.90
Area at Maximum Ponding Depth (acres) =	0.69	1.24	1.19	1.25	1.30	1.33	1.36	1.40	1.47
Maximum Volume Stored (acre-ft) =	0.913	3.239	2.534	3.376	4.041	4.476	4.772	5.433	6.410

Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

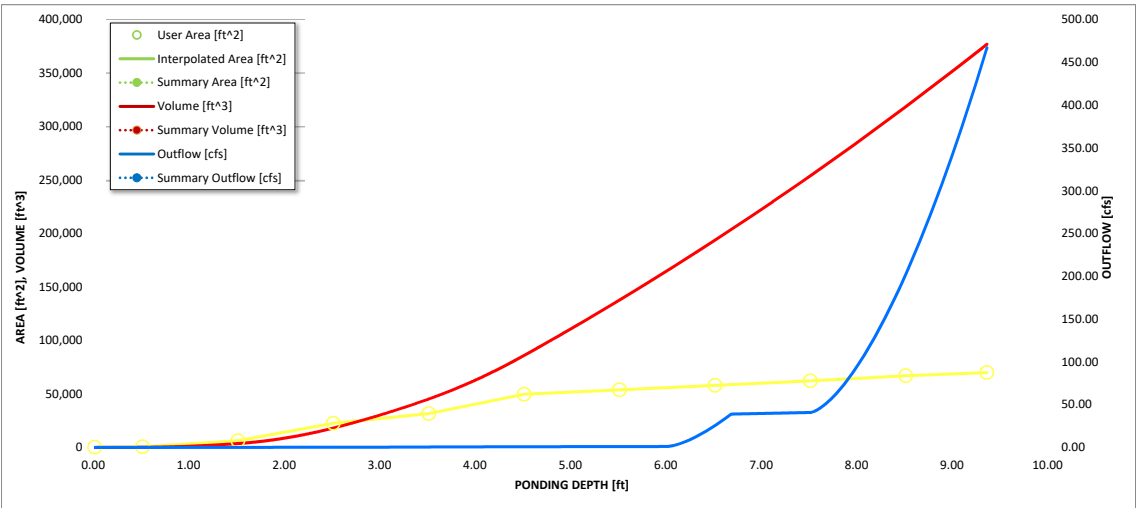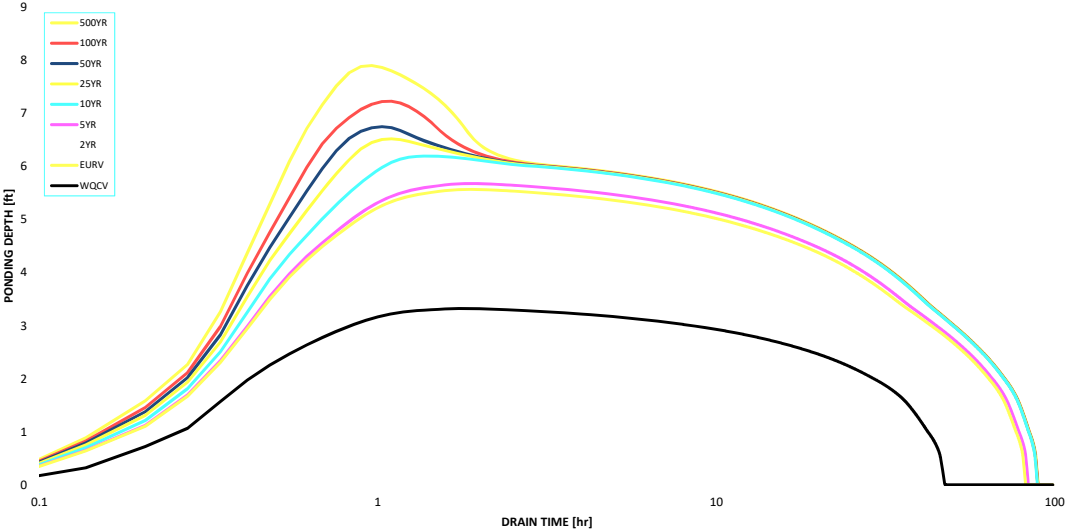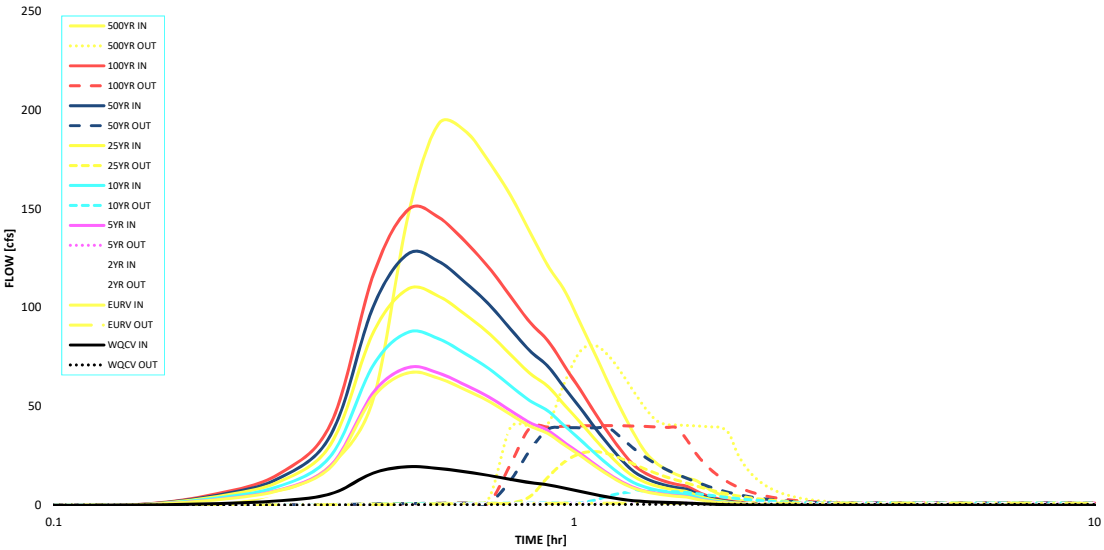

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

Design Procedure Form: Extended Detention Basin (EDB)

UD-BMP (Version 3.06, November 2016)

Sheet 1 of 4

Designer: Charlene Durham
 Company: Stantec
 Date: September 30, 2018
 Project: Waterview East
 Location: Big Johnson Basin - West Pond

<p>1. Basin Storage Volume</p> <p>A) Effective Imperviousness of Tributary Area, I_a</p> <p>B) Tributary Area's Imperviousness Ratio ($i = I_a / 100$)</p> <p>C) Contributing Watershed Area</p> <p>D) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm</p> <p>E) Design Concept (Select EURV when also designing for flood control)</p> <p>F) Design Volume (WQCV) Based on 40-hour Drain Time ($V_{DESIGN} = (1.0 * (0.91 * i^3 - 1.19 * i^2 + 0.78 * i)) / 12 * Area$)</p> <p>G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume ($V_{WQCV\ OTHER} = (d_6 * (V_{DESIGN} / 0.43))$)</p> <p>H) User Input of Water Quality Capture Volume (WQCV) Design Volume (Only if a different WQCV Design Volume is desired)</p> <p>I) Predominant Watershed NRCS Soil Group</p> <p>J) Excess Urban Runoff Volume (EURV) Design Volume For HSG A: $EURV_A = 1.68 * i^{1.28}$ For HSG B: $EURV_B = 1.36 * i^{1.08}$ For HSG C/D: $EURV_{C/D} = 1.20 * i^{1.08}$</p>	<p>$I_a =$ <u>67.0</u> %</p> <p>$i =$ <u>0.670</u></p> <p>Area = <u>44.300</u> ac</p> <p>$d_6 =$ _____ in</p> <div style="border: 1px solid black; padding: 5px;"> <p>Choose One</p> <p><input type="radio"/> Water Quality Capture Volume (WQCV)</p> <p><input checked="" type="radio"/> Excess Urban Runoff Volume (EURV)</p> </div> <p>$V_{DESIGN} =$ <u>0.968</u> ac-ft</p> <p>$V_{DESIGN\ OTHER} =$ _____ ac-ft</p> <p>$V_{DESIGN\ USER} =$ _____ ac-ft</p> <div style="border: 1px solid black; padding: 5px;"> <p>Choose One</p> <p><input type="radio"/> A</p> <p><input checked="" type="radio"/> B</p> <p><input type="radio"/> C / D</p> </div> <p>EURV = <u>3.258</u> ac-ft</p>
<p>2. Basin Shape: Length to Width Ratio (A basin length to width ratio of at least 2:1 will improve TSS reduction.)</p>	<p>L : W = <u>7.0</u> : 1</p>
<p>3. Basin Side Slopes</p> <p>A) Basin Maximum Side Slopes (Horizontal distance per unit vertical, 4:1 or flatter preferred)</p>	<p>Z = <u>3.00</u> ft / ft DIFFICULT TO MAINTAIN, INCREASE WHERE POSSIBLE</p>
<p>4. Inlet</p> <p>A) Describe means of providing energy dissipation at concentrated inflow locations:</p>	<p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p>

Design Procedure Form: Extended Detention Basin (EDB)

Sheet 2 of 4

Designer: Charlene Durham
Company: Stantec
Date: September 30, 2018
Project: Waterview East
Location: Big Johnson Basin - West Pond

<p>5. Forebay</p> <p>A) Minimum Forebay Volume ($V_{FMIN} = \underline{\quad 3\% \quad}$ of the WQCV)</p> <p>B) Actual Forebay Volume</p> <p>C) Forebay Depth ($D_F = \underline{\quad 30 \quad}$ inch maximum)</p> <p>D) Forebay Discharge</p> <p>i) Undetained 100-year Peak Discharge</p> <p>ii) Forebay Discharge Design Flow ($Q_F = 0.02 * Q_{100}$)</p> <p>E) Forebay Discharge Design</p> <p>F) Discharge Pipe Size (minimum 8-inches)</p> <p>G) Rectangular Notch Width</p>	<p>$V_{FMIN} = \underline{\quad 0.029 \quad}$ ac-ft</p> <p>$V_F = \underline{\hspace{2cm}}$ ac-ft</p> <p>$D_F = \underline{\quad 12.0 \quad}$ in</p> <p>$Q_{100} = \underline{\quad 141.40 \quad}$ cfs</p> <p>$Q_F = \underline{\quad 2.83 \quad}$ cfs</p> <div style="border: 1px solid black; padding: 5px;"> <p>Choose One</p> <p><input type="radio"/> Berm With Pipe</p> <p><input checked="" type="radio"/> Wall with Rect. Notch</p> <p><input type="radio"/> Wall with V-Notch Weir</p> </div> <p>Calculated $D_P = \underline{\hspace{2cm}}$ in</p> <p>Calculated $W_N = \underline{\quad 12.6 \quad}$ in</p>
<p>6. Trickle Channel</p> <p>A) Type of Trickle Channel</p> <p>F) Slope of Trickle Channel</p>	<div style="border: 1px solid black; padding: 5px;"> <p>Choose One</p> <p><input checked="" type="radio"/> Concrete</p> <p><input type="radio"/> Soft Bottom</p> </div> <p>$S = \underline{\quad 0.0050 \quad}$ ft / ft</p>
<p>7. Micropool and Outlet Structure</p> <p>A) Depth of Micropool (2.5-feet minimum)</p> <p>B) Surface Area of Micropool (10 ft² minimum)</p> <p>C) Outlet Type</p> <p>D) Smallest Dimension of Orifice Opening Based on Hydrograph Routing (Use UD-Detention)</p> <p>E) Total Outlet Area</p>	<p>$D_M = \underline{\quad 2.5 \quad}$ ft</p> <p>$A_M = \underline{\quad 10 \quad}$ sq ft</p> <div style="border: 1px solid black; padding: 5px;"> <p>Choose One</p> <p><input checked="" type="radio"/> Orifice Plate</p> <p><input type="radio"/> Other (Describe):</p> </div> <p>$D_{orifice} = \underline{\quad 1.75 \quad}$ inches</p> <p>$A_{ot} = \underline{\quad 10.00 \quad}$ square inches</p>

Design Procedure Form: Extended Detention Basin (EDB)

Sheet 3 of 4

Designer: Charlene Durham
 Company: Stantec
 Date: September 30, 2018
 Project: Waterview East
 Location: Big Johnson Basin - West Pond

<p>8. Initial Surge Volume</p> <p>A) Depth of Initial Surge Volume (Minimum recommended depth is 4 inches)</p> <p>B) Minimum Initial Surge Volume (Minimum volume of 0.3% of the WQCV)</p> <p>C) Initial Surge Provided Above Micropool</p>	<p>$D_{IS} =$ <u>6</u> in</p> <p>$V_{IS} =$ <u>126.4</u> cu ft</p> <p>$V_s =$ <u>5.0</u> cu ft</p>
<p>9. Trash Rack</p> <p>A) Water Quality Screen Open Area: $A_t = A_{st} * 38.5 * (e^{-0.095D})$</p> <p>B) Type of Screen (If specifying an alternative to the materials recommended in the USDCM, indicate "other" and enter the ratio of the total open area to the total screen area for the material specified.)</p> <p>Other (Y/N): <u>N</u></p> <p>C) Ratio of Total Open Area to Total Area (only for type 'Other')</p> <p>D) Total Water Quality Screen Area (based on screen type)</p> <p>E) Depth of Design Volume (EURV or WQCV) (Based on design concept chosen under 1E)</p> <p>F) Height of Water Quality Screen (H_{TR})</p> <p>G) Width of Water Quality Screen Opening ($W_{opening}$) (Minimum of 12 inches is recommended)</p>	<p>$A_t =$ <u>326</u> square inches</p> <p><u>Aluminum Amico-Klemp SR Series with Cross Rods 2" O.C.</u></p> <p>_____</p> <p>_____</p> <p>User Ratio =</p> <p>$A_{total} =$ <u>459</u> sq. in.</p> <p>$H =$ <u>5.56</u> feet</p> <p>$H_{TR} =$ <u>94.72</u> inches</p> <p>$W_{opening} =$ <u>12.0</u> inches</p>

Design Procedure Form: Extended Detention Basin (EDB)


Sheet 4 of 4

Designer: Charlene Durham
Company: Stantec
Date: September 30, 2018
Project: Waterview East
Location: Big Johnson Basin - West Pond

<p>10. Overflow Embankment</p> <p>A) Describe embankment protection for 100-year and greater overtopping:</p> <p>B) Slope of Overflow Embankment (Horizontal distance per unit vertical, 4:1 or flatter preferred)</p>	<hr/> <hr/> <hr/> <hr/>
<p>11. Vegetation</p>	<div style="border: 1px solid black; padding: 5px;"> <p>Choose One</p> <p><input type="radio"/> Irrigated</p> <p><input type="radio"/> Not Irrigated</p> </div>
<p>12. Access</p> <p>A) Describe Sediment Removal Procedures</p>	<hr/> <hr/> <hr/> <hr/> <hr/> <hr/>
<p>Notes: <hr/><hr/><hr/><hr/></p>	

UD-Detention, Version 3.07 (February 2017)

Basin ID: WQ Pond 1



Selected BMP Type =

Optional User Override
1-hr Precipitation

1.19	inches
1.50	inches
1.75	inches
2.00	inches
2.25	inches
2.52	inches
	inches

Zone 1 Volume (WQCV) =	0.036	acre-feet
Select Zone 2 Storage Volume (Optional) =		acre-feet
Select Zone 3 Storage Volume (Optional) =		acre-feet
Total Detention Basin Volume =	0.036	acre-feet
Initial Surge Volume (ISV) =		ft ³
Initial Surge Depth (ISD) =	N/A	ft
Total Available Detention Depth (H_{total}) =	user	ft
Depth of Trickle Channel (H_{TC}) =	N/A	ft
Slope of Trickle Channel (S_{TC}) =	N/A	ft/ft
Slopes of Main Basin Sides (S_{main}) =	user	ft/V
Basin Length-to-Width Ratio ($R_{L/W}$) =	user	

Total detention volume is less than 100-year volume.


Depth Increment =

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

UD-Detention, Version 3.07 (February 2017)

Project: Waterview East

Basin ID: WQ Pond 2



Example Zone Configuration (Retention Pond)

Required Volume Calculation

Selected BMP Type =	RG	
Watershed Area =	4.17	acres
Watershed Length =	385	ft
Watershed Slope =	0.040	ft/ft
Watershed Imperviousness =	67.00%	percent
Percentage Hydrologic Soil Group A =	28.5%	percent
Percentage Hydrologic Soil Group B =	71.5%	percent
Percentage Hydrologic Soil Groups C/D =	0.0%	percent
Desired WQCV Drain Time =	12.0	hours
Location for 1-hr Rainfall Depths =	User Input	
Water Quality Capture Volume (WQCV) =	0.073	acre-feet
Excess Urban Runoff Volume (EURV) =	0.318	acre-feet
2-yr Runoff Volume ($P_1 = 1.19$ in.) =	0.250	acre-feet
5-yr Runoff Volume ($P_1 = 1.75$ in.) =	0.332	acre-feet
100-yr Runoff Volume ($P_1 = 1.75$ in.) =	0.418	acre-feet
25-yr Runoff Volume ($P_1 = 2$ in.) =	0.526	acre-feet
50-yr Runoff Volume ($P_1 = 2.25$ in.) =	0.613	acre-feet
100-yr Runoff Volume ($P_1 = 2.52$ in.) =	0.724	acre-feet
500-yr Runoff Volume ($P_1 = 0$ in.) =	0.000	acre-feet
Approximate 2-yr Detention Volume =	0.235	acre-feet
Approximate 5-yr Detention Volume =	0.312	acre-feet
Approximate 10-yr Detention Volume =	0.391	acre-feet
Approximate 25-yr Detention Volume =	0.433	acre-feet
Approximate 50-yr Detention Volume =	0.458	acre-feet
Approximate 100-yr Detention Volume =	0.496	acre-feet

Watershed Area =	4.17	acres	Note: L / W Ratio < 1 L / W Ratio = 0.8
Watershed Length =	385	ft	

Water Quality Capture Volume (WQCV) =	0.073	acre-feet	Optional User Override 1-hr Precipitation
Excess Urban Runoff Volume (EURV) =	0.318	acre-feet	

2-yr Runoff Volume (P1 = 1.19 in.) =	0.250	acre-feet	1.19	inches
5-yr Runoff Volume (P1 = 1.5 in.) =	0.332	acre-feet	1.50	inches
10-yr Runoff Volume (P1 = 1.75 in.) =	0.418	acre-feet	1.75	inches
25-yr Runoff Volume (P1 = 2 in.) =	0.526	acre-feet	2.00	inches
50-yr Runoff Volume (P1 = 2.25 in.) =	0.613	acre-feet	2.25	inches
100-yr Runoff Volume (P1 = 2.52 in.) =	0.724	acre-feet	2.52	inches
500-yr Runoff Volume (P1 = 0 in.) =	0.000	acre-feet		inches

Stage-Storage Calculation

Zone 1 Volume (V_{QCV1})	0.073	acre-feet
Select Zone 2 Storage Volume (Optional)		acre-feet
Select Zone 3 Storage Volume (Optional)		acre-feet
Total Detention Basin Volume	0.073	acre-feet
Initial Surcharge Volume (ISV)	N/A	ft ³
Initial Surcharge Depth (ISD)	user	ft
Total Available Detention Depth (H_{DAV})	user	ft
Depth of Trickle Channel (H_{TC})	user	ft
Slope of Trickle Channel (S_{TC})	N/A	ft/ft
Slopes of Main Basin Sides (S_{MAIN})	user	ft/ft
Basin Length-to-Width Ratio ($R_{L/W}$)	user	
Initial Surcharge Area (A_{IS})	user	ft ²
Surcharge Volume Length (L_{SV})	user	ft
Surcharge Volume Width (W_{SV})	user	ft
Depth of Basin Floor ($H_{1,100}$)	user	ft
Length of Basin Floor ($L_{1,100}$)	user	ft
Width of Basin Floor ($W_{1,100}$)	user	ft
Area of Basin Floor ($A_{1,100}$)	user	ft ²
Volume of Basin Floor ($V_{1,100}$)	user	ft ³
Depth of Main Basin (H_{MAIN})	user	ft
Length of Main Basin (L_{MAIN})	user	ft
Width of Main Basin (W_{MAIN})	user	ft
Area of Main Basin (A_{MAIN})	user	ft ²
Volume of Main Basin (V_{MAIN})	user	ft ³
Calculated Total Basin Volume (V_{DAV})	user	acre-feet

Select Zone 2 Storage Volume (Optional) =		acre-feet	Total detention volume is less than 100-year volume.
Select Zone 3 Storage Volume (Optional) =		acre-feet	
Total Detention Basin Volume =	0.073	acre-feet	


[illegible]

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

UD-Detention, Version 3.07 (February 2017)

Basin ID: WQ Pond 3

ZONE 3



Required Volume Calculation

Selected BMP Type = **RG**

Watershed Area =	6.89	acres
Watershed Length =	1.185	ft
Watershed Slope =	0.030	ft/ft
Watershed Imperviousness =	67.00%	percent
Percentage Hydrologic Soil Group A =	28.5%	percent
Percentage Hydrologic Soil Group B =	71.5%	percent
Percentage Hydrologic Soil Groups C/D =	0.0%	percent
Desired WQCV Drain Time =	12.0	hours
Location for 1-hr Rainfall Depths =	User Input	
Water Quality Capture Volume (WQCV)	0.120	acre-feet
Excess Urban Runoff Volume (EURV)	0.526	acre-feet
2-yr Runoff Volume (P1 = 1.19 in.)	0.413	acre-feet
5-yr Runoff Volume (P1 = 1.5 in.)	0.548	acre-feet
10-yr Runoff Volume (P1 = 1.75 in.)	0.691	acre-feet
25-yr Runoff Volume (P1 = 2 in.)	0.869	acre-feet
50-yr Runoff Volume (P1 = 2.25 in.)	1.013	acre-feet
100-yr Runoff Volume (P1 = 2.52 in.)	1.196	acre-feet
500-yr Runoff Volume (P1 = 0 in.)	0.000	acre-feet
Approximate 2-yr Detention Volume =	0.388	acre-feet
Approximate 25-yr Detention Volume =	0.516	acre-feet
Approximate 10-yr Detention Volume =	0.646	acre-feet
Approximate 25-yr Detention Volume =	0.716	acre-feet
Approximate 50-yr Detention Volume =	0.757	acre-feet
Approximate 100-yr Detention Volume =	0.819	acre-feet

Water Quality Capture Volume (WQCV) =	0.120	acre-feet	Optional User Override 1-hr Precipitation
Excess Urban Runoff Volume (EURV) =	0.526	acre-feet	
2-yr Runoff Volume (P1 = 1.19 in.) =	0.413	acre-feet	1.19 inches
5-yr Runoff Volume (P1 = 1.5 in.) =	0.548	acre-feet	1.50 inches
10-yr Runoff Volume (P1 = 1.75 in.) =	0.691	acre-feet	1.75 inches
25-yr Runoff Volume (P1 = 2 in.) =	0.869	acre-feet	2.00 inches
50-yr Runoff Volume (P1 = 2.25 in.) =	1.013	acre-feet	2.25 inches
100-yr Runoff Volume (P1 = 2.52 in.) =	1.196	acre-feet	2.52 inches
500-yr Runoff Volume (P1 = 0 in.) =	0.000	acre-feet	inches

Zone 1 Volume (WQCV) = 0.120 acre-feet

Select Zone 2 Storage Volume (Optional)		acre-feet
Select Zone 3 Storage Volume (Optional)		acre-feet
Total Detention Basin Volume =	0.120	acre-feet
Initial Surcharge Volume (ISV)	N/A	ft ³
Initial Surcharge Depth (ISD)	N/A	ft
Total Available Detention Depth ($H_{(det)}$)	user	ft
Depth of Trickle Channel (H_{TC})	N/A	ft
Slope of Trickle Channel (S_{TC})	N/A	ft/ft
Slopes of Main Basin Sides ($S_{(MB)}$)	user	ftV
Basin Length-to-Width Ratio ($R_{(LW)}$)	user	
Initial Surcharge Area ($A_{(ISV)}$)	user	ft ²
Surcharge Volume Length ($L_{(SV)}$)	user	ft
Surcharge Volume Width ($W_{(SV)}$)	user	ft
Depth of Basin Floor ($H_{(fcb)}$)	user	ft
Length of Basin Floor ($L_{(fcb)}$)	user	ft
Width of Basin Floor ($W_{(fcb)}$)	user	ft
Area of Basin Floor ($A_{(fcb)}$)	user	ft ²
Volume of Basin Floor ($V_{(fcb)}$)	user	ft ³
Depth of Main Basin ($H_{(MB)}$)	user	ft
Length of Main Basin ($L_{(MB)}$)	user	ft
Width of Main Basin ($W_{(MB)}$)	user	ft
Area of Main Basin ($A_{(MB)}$)	user	ft ²
Volume of Main Basin ($V_{(MB)}$)	user	ft ³
Calculated Total Basin Volume ($V_{(TB)}$)	user	acre-feet

Select Zone 2 Storage Volume (Optional) =		acre-feet	Total detention volume is less than 100-year volume.
Select Zone 3 Storage Volume (Optional) =		acre-feet	
Total Detention Basin Volume =	0.120	acre-feet	

[illegible]

Appendix E: Deviation Request

Procedures Manual

Subject: DEVIATION REVIEW AND DECISION FORM

Page 1 of 6

Date Issued: 12/31/07
Revision Issued: N/A
Rescinded: N/A

1.1. PURPOSE

The purpose of this resource is to provide a form for documenting the findings and decision by the ECM Administrator concerning a deviation request.

1.2. BACKGROUND

A deviation is a critical aspect of the review process and needs to be documented to ensure that the deviations granted are applied to a specific development application in conformance with the criteria for approval and that the action is documented as such requests can point to potential needed revisions to the ECM.

1.3. APPLICABLE STATUTES AND REGULATIONS

Section 5.9 of the ECM establishes a mechanism whereby an engineering design standard can be modified when if strictly adhered to, would cause unnecessary hardship or unsafe design because of topographical or other conditions particular to the site, and that a departure may be made without destroying the intent of such provision.

1.4. APPLICABILITY

All provisions of the ECM are subject to deviation by the ECM Administrator provided that one of the following conditions is met:

- The ECM standard is inapplicable to a particular situation.
- Topography, right-of-way, or other geographical conditions or impediments impose an undue hardship on the applicant, and an equivalent alternative that can accomplish the same design objective is available and does not compromise public safety or accessibility.
- A change to a standard is required to address a specific design or construction problem, and if not modified, the standard will impose an undue hardship on the applicant with little or no material benefit to the public.

1.5. TECHNICAL GUIDANCE

The review shall ensure all criteria for approval are adequately considered and that justification for the deviation is properly documented.

1.6. RELATED PROCEDURES

1.6.1. Governing Procedures

P-AR-063-07 Deviation

1.6.2. Other Related Procedures

P-AR-012-07 Administrative Relief

1.7. RESOURCE

Attached is the Deviation Review and Decision Form that is used by the applicant/engineer for requesting and justifying a deviation. The form is reviewed by the ECM Administrator and approved or denied. The form is used to document the review and decision concerning a requested deviation. The request and decision concerning each deviation from a specific section of the ECM shall be recorded on a separate form.



Development Services Department
2880 International Circle
Colorado Springs, Colorado 80910

Phone: 719.520.6300
Fax: 719.520.6695
Website www.elpasoco.com

DEVIATION REVIEW AND DECISION FORM

Procedure # R-FM-051-07
Issue Date: 12/31/07
Revision Issued: 00/00/00

DSD FILE NO.:

--	--	--	--	--	--	--	--

General Property Information:

Address of Subject Property (Street Number/Name):

Tax Schedule ID(s) #: 5500000135

Legal Description of Property: _See attached_____

Subdivision or Project Name: Waterview
East Preliminary Plan

Section of ECM from Which Deviation is Sought: _Appendix I Section I.7.1.B_____
Specific Criteria from Which a Deviation is Sought: _1st Bullet; Providing Water Quality for Entire Development_____

Proposed Nature and Extent of Deviation: _Approximately 4.1% (7.96 acres of 195.25) of the area inside the development boundary will not reach a proposed detention pond and/or proposed water quality facility. Of the area inside the development boundary that will not reach a facility only 0.5% (0.9 acres of 195.25) will be undeveloped property consisting only of exterior boundary open space trail corridor/buffer tracts (portions of basins 60 and 61); the remaining 7.06 acres is anticipated future CDOT r.o.w. for the Bradley Road Powers Boulevard interchange (basin 150). The anticipated CDOT area will remain undeveloped until, as anticipated, CDOT will improve the intersection and address water quality at that time._

Applicant Information:

Applicant: _CPR Entitlements, LLC_____ Email Address: _HLI.PAK7@gmail.com_____
Applicant is: _____ Owner ☒ Consultant _____ Contractor
Mailing Address: _31 N. Tejon Street, Suite 500_____ State: CO_____ Postal Code: 80903_____
Telephone Number: _719-377-0244_____ Fax Number: _719-227-7392_____

Engineer Information:

Engineer: _Charles K. Cothorn, P.E._____ Email Address: charlescothorn@springseng.com_____
Company Name: _Dakota Springs Engineering, LLC_____ State: CO_____ Postal Code: 80903_____
Mailing Address: 31 N. Tejon, Suite 500_____ State of Registration: CO_____
Registration Number: _24997_____ Fax Number: _719-227-7392_____
Telephone Number: _719-227-7388_____

Explanation of Request (Attached diagrams, figures, and other documentation to clarify request):

Section of ECM from Which Deviation is Sought: _Appendix I Section I.7.1.B_____
Specific Criteria from Which a Deviation is Sought: _1st Bullet, Providing Water Quality for Entire Development_____

Proposed Nature and Extent of Deviation: Approximately 4.1% (7.96 acres of 195.25) of the area inside the development boundary will not reach a proposed detention pond and/or proposed water quality facility. Of the area inside the development boundary that will not reach a facility only 0.5% (0.9 acres of 195.25) will be undeveloped property consisting only of exterior boundary open space trail corridor/buffer tracts (portions of basins 60 and 61); the remaining 7.06 acres is anticipated future CDOT r.o.w. for the Bradley Road Powers Boulevard interchange (basin 150). The anticipated CDOT area will remain undeveloped until, as anticipated, CDOT will improve the intersection and address water quality at that time._ _

El Paso County Procedures Manual
Procedure # R-FM-051-07
Issue Date: 12/31/07
Revision Issued: 00/00/00

Reason for the Requested Deviation: The topography of the site will not allow all dedicated trail corridors to drain to proposed detention ponds. These open space/buffer areas consist of only 0.5% (0.9 acres; portions of basin 60 and 61) of the total 195.25 acres of the subject property. The remaining area not proposed for water quality consist of a future CDOT tract for the interchange at Bradley Road and Powers Boulevard (Basin 150). The large trail/buffer tracts do not require detention or water quality because of the nature of the use and the fact that the open space will provide good areas for infiltration of rain water into the ground. The future CDOT area will be the responsibility of that entity for addressing water quality for the entire future interchange at the time of design and construction. In the meantime, the future CDOT area will remain open with only natural grasses in place.

Comparison of Proposed Deviation to ECM Standard: The areas of trail/buffer tracts that do not drain to detention ponds will be accommodated in the discharge of the detention ponds for developed to historic discharge. Trails do not require detention or water quality. Open space/buffer areas do not require detention or water quality. CDOT will address water quality and /or detention for the future CDOT parcel at the time of design and construction.

Applicable Regional or National Standards used as Basis: CDPS General Permit CORO90000 (MSA Permit) Part I Section E.4.iv, (A), page 29 of 63. Which generally States that up to 20% of a developed property, not to exceed 1 acre, can bypass water quality

Application Consideration:

CHECK IF APPLICATION MEETS CRITERIA FOR CONSIDERATION

JUSTIFICATION

☐ The ECM standard is inapplicable to a particular situation.

☒ Topography, right-of-way, or other geographical conditions or impediments impose an undue hardship on the applicant, and an equivalent alternative that can accomplish the same design objective is available and does not compromise public safety or accessibility.

The topography of the site does not allow all trail/buffer areas to be conveyed to detention. The trail buffer areas that cannot be detained only consist of 0.5% (0.9 acres) of the total 195.25-acre development. The remaining acreage not conveyed to water quality consist of 7.06 acres of future CDOT r.o.w. and interchange that will be addressed to meet water quality/detention requirements by CDOT at the time of design of the interchange.

☐ A change to a standard is required to address a specific design or construction problem, and if not modified, the standard will impose an undue hardship on the applicant with little or no material benefit to the public.

If at least one of the criteria listed above is not met, this application for deviation cannot be considered.

Criteria for Approval:

PLEASE EXPLAIN HOW EACH OF THE FOLLOWING CRITERIA HAVE BEEN SATISFIED BY THIS REQUEST

The request for a deviation is not based exclusively on financial considerations.

This request has little or no relationship to financial considerations. The largest parcel not being detained will have water quality and/or detention provided by CDOT when the future interchange is constructed. Another 0.9 acres of land that is not being detained or have water quality features is being dedicated by the applicant for trails, open space and development buffering. If these areas were not being dedicated as trails, etc. and instead developed into lots it is more likely that these areas would be captured for detention and water quality treatment.

comparable or superior design
and quality of improvement.

buffering parcels will provide water quality inherent to natural infiltration of storm
water into the ground.

The deviation will not adversely
affect safety or operations.

There will be no negative effects related to safety or operations. _____

The deviation will not adversely
affect maintenance and its
associated cost.

The CDOT parcel will be addressed by CDOT later. Any costs associated with the
Trail Corridor/Open Space/ Buffer will be borne by the Waterview II Metropolitan
District who will own and maintain those parcels. _____

The deviation will not adversely
affect aesthetic appearance.

No negative affect to aesthetic appearance. The future CDOT parcel will be
addressed by CDOT. The Trail Corridor/Buffer will enhance the aesthetics of the
area and development. _____

Owner, Applicant and Engineer Declaration:

To the best of my knowledge, the information on this application and all additional or supplemental documentation is true, factual and complete. I am fully aware that any misrepresentation of any information on this application may be grounds for denial. I have familiarized myself with the rules, regulations and procedures with respect to preparing and filing this application. I also understand that an incorrect submittal will be cause to have the project removed from the agenda of the Planning Commission, Board of County Commissioners and/or Board of Adjustment or delay review, and that any approval of this application is based on the representations made in the application and may be revoked on any breach of representation or condition(s) of approval.

Signature of owner (or authorized representative)

Date

9/26/18

Signature of applicant (if different from owner)

Date

9/27/18

Signature of Engineer

Date

Engineer's Seal

Review and Recommendation:

APPROVED by the ECM Administrator

Date

This request has been determined to have met the criteria for approval. A deviation from Section
_____ of ECM is hereby granted based on the justification provided. Comments:

_____. Additional comments or information are attached.


DENIED by the ECM Administrator

Date

This request has been determined not to have met criteria for approval. A deviation from Section _____ of ECM is hereby denied. Comments:

_____. Additional comments or information are attached.

V:\1817\ACTIVE\181710214\REPORTS\DRAINAGE\EXHIBITS\DEVIATION EXHIBIT.DWG
12/10/2018 8:59 AM

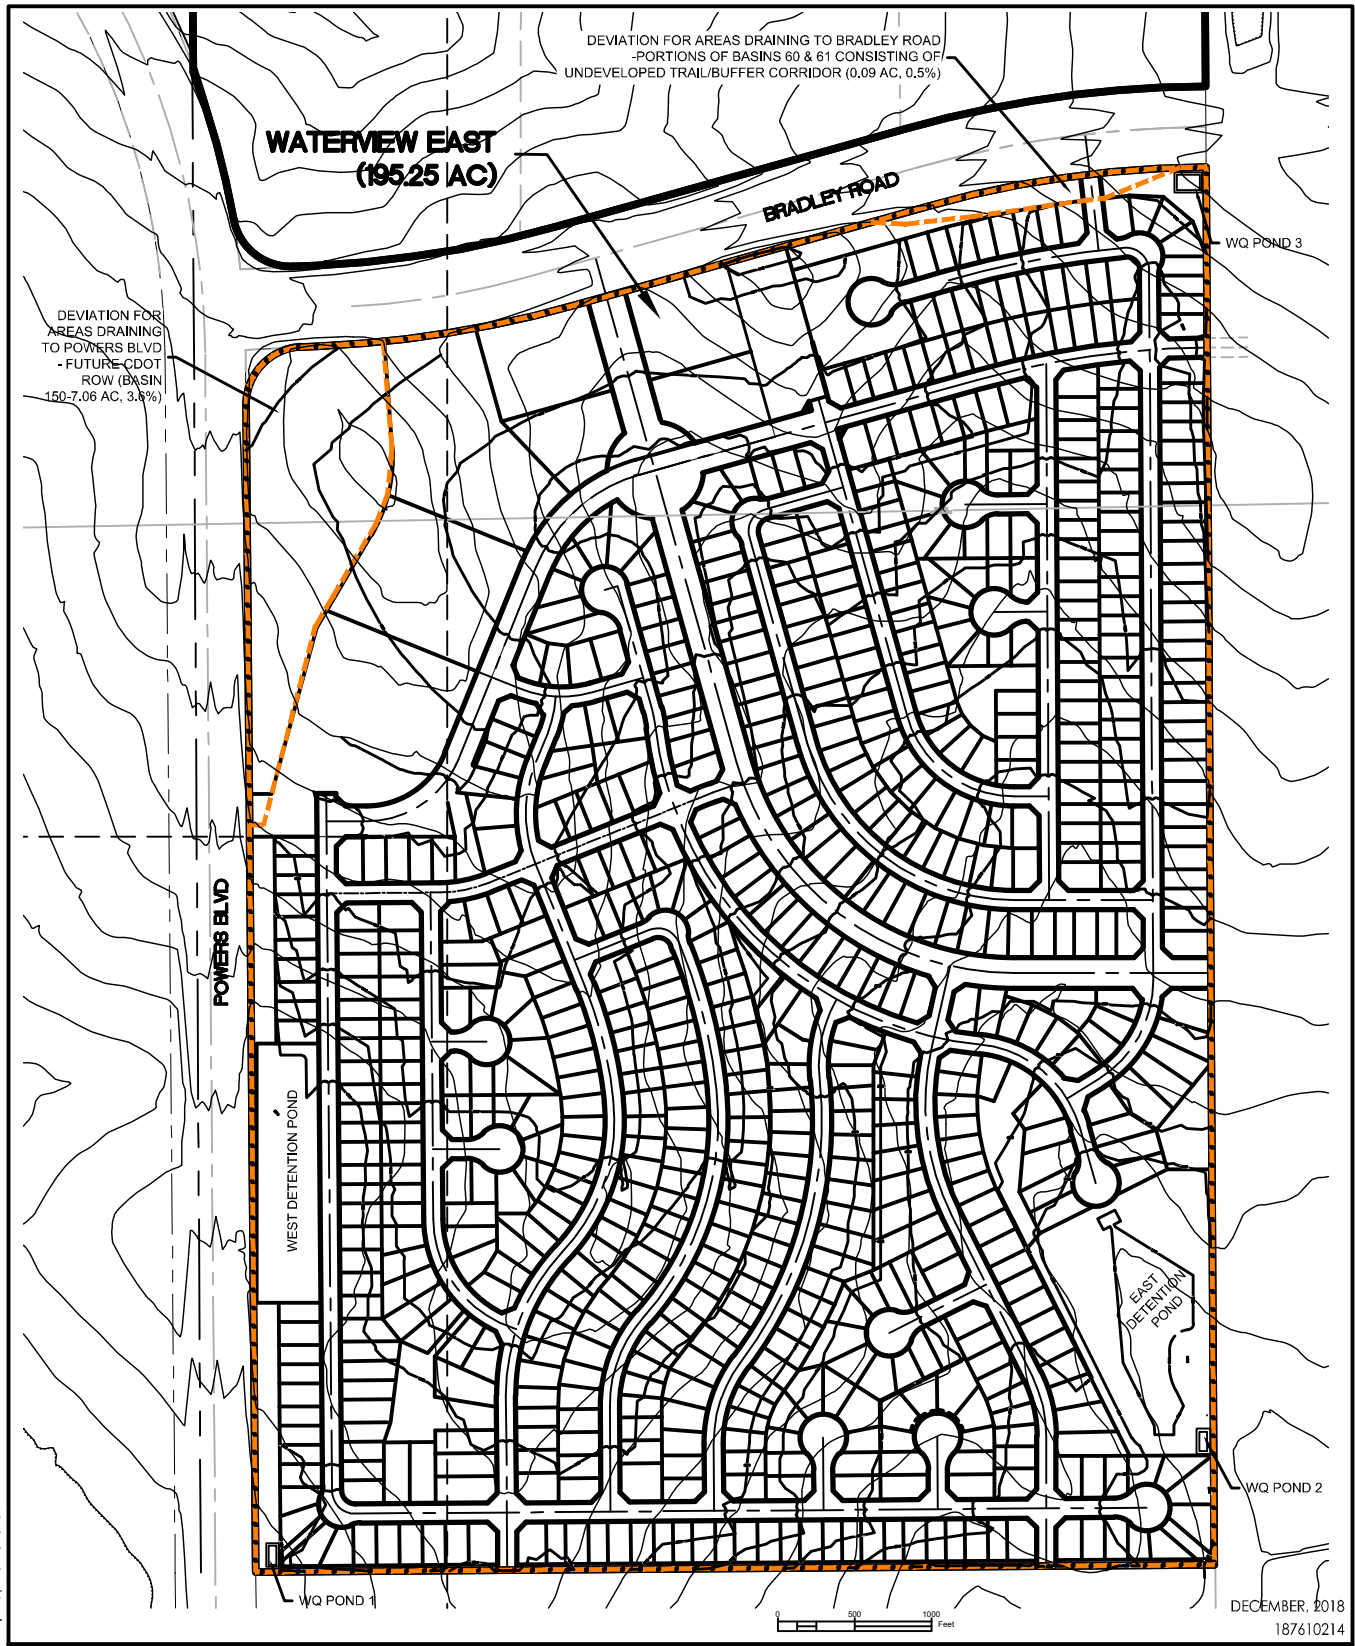

5725 MARK DABLING BLVD, SUITE 190
COLORADO SPRINGS, CO 80919
www.stantec.com

Client/Project

WATERVIEW INVESTMENTS, LLC
WATERVIEW EAST




Figure No.

1.0

Title

EXHIBIT - DEVIATION REQUEST

Figure 3: Existing Drainage Map

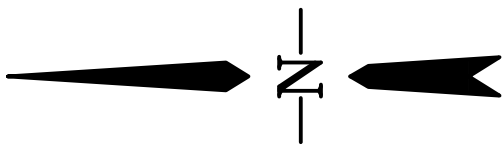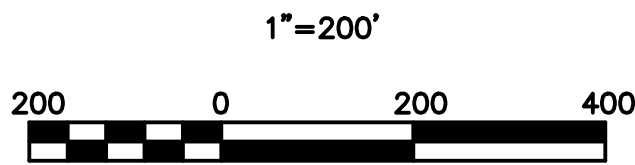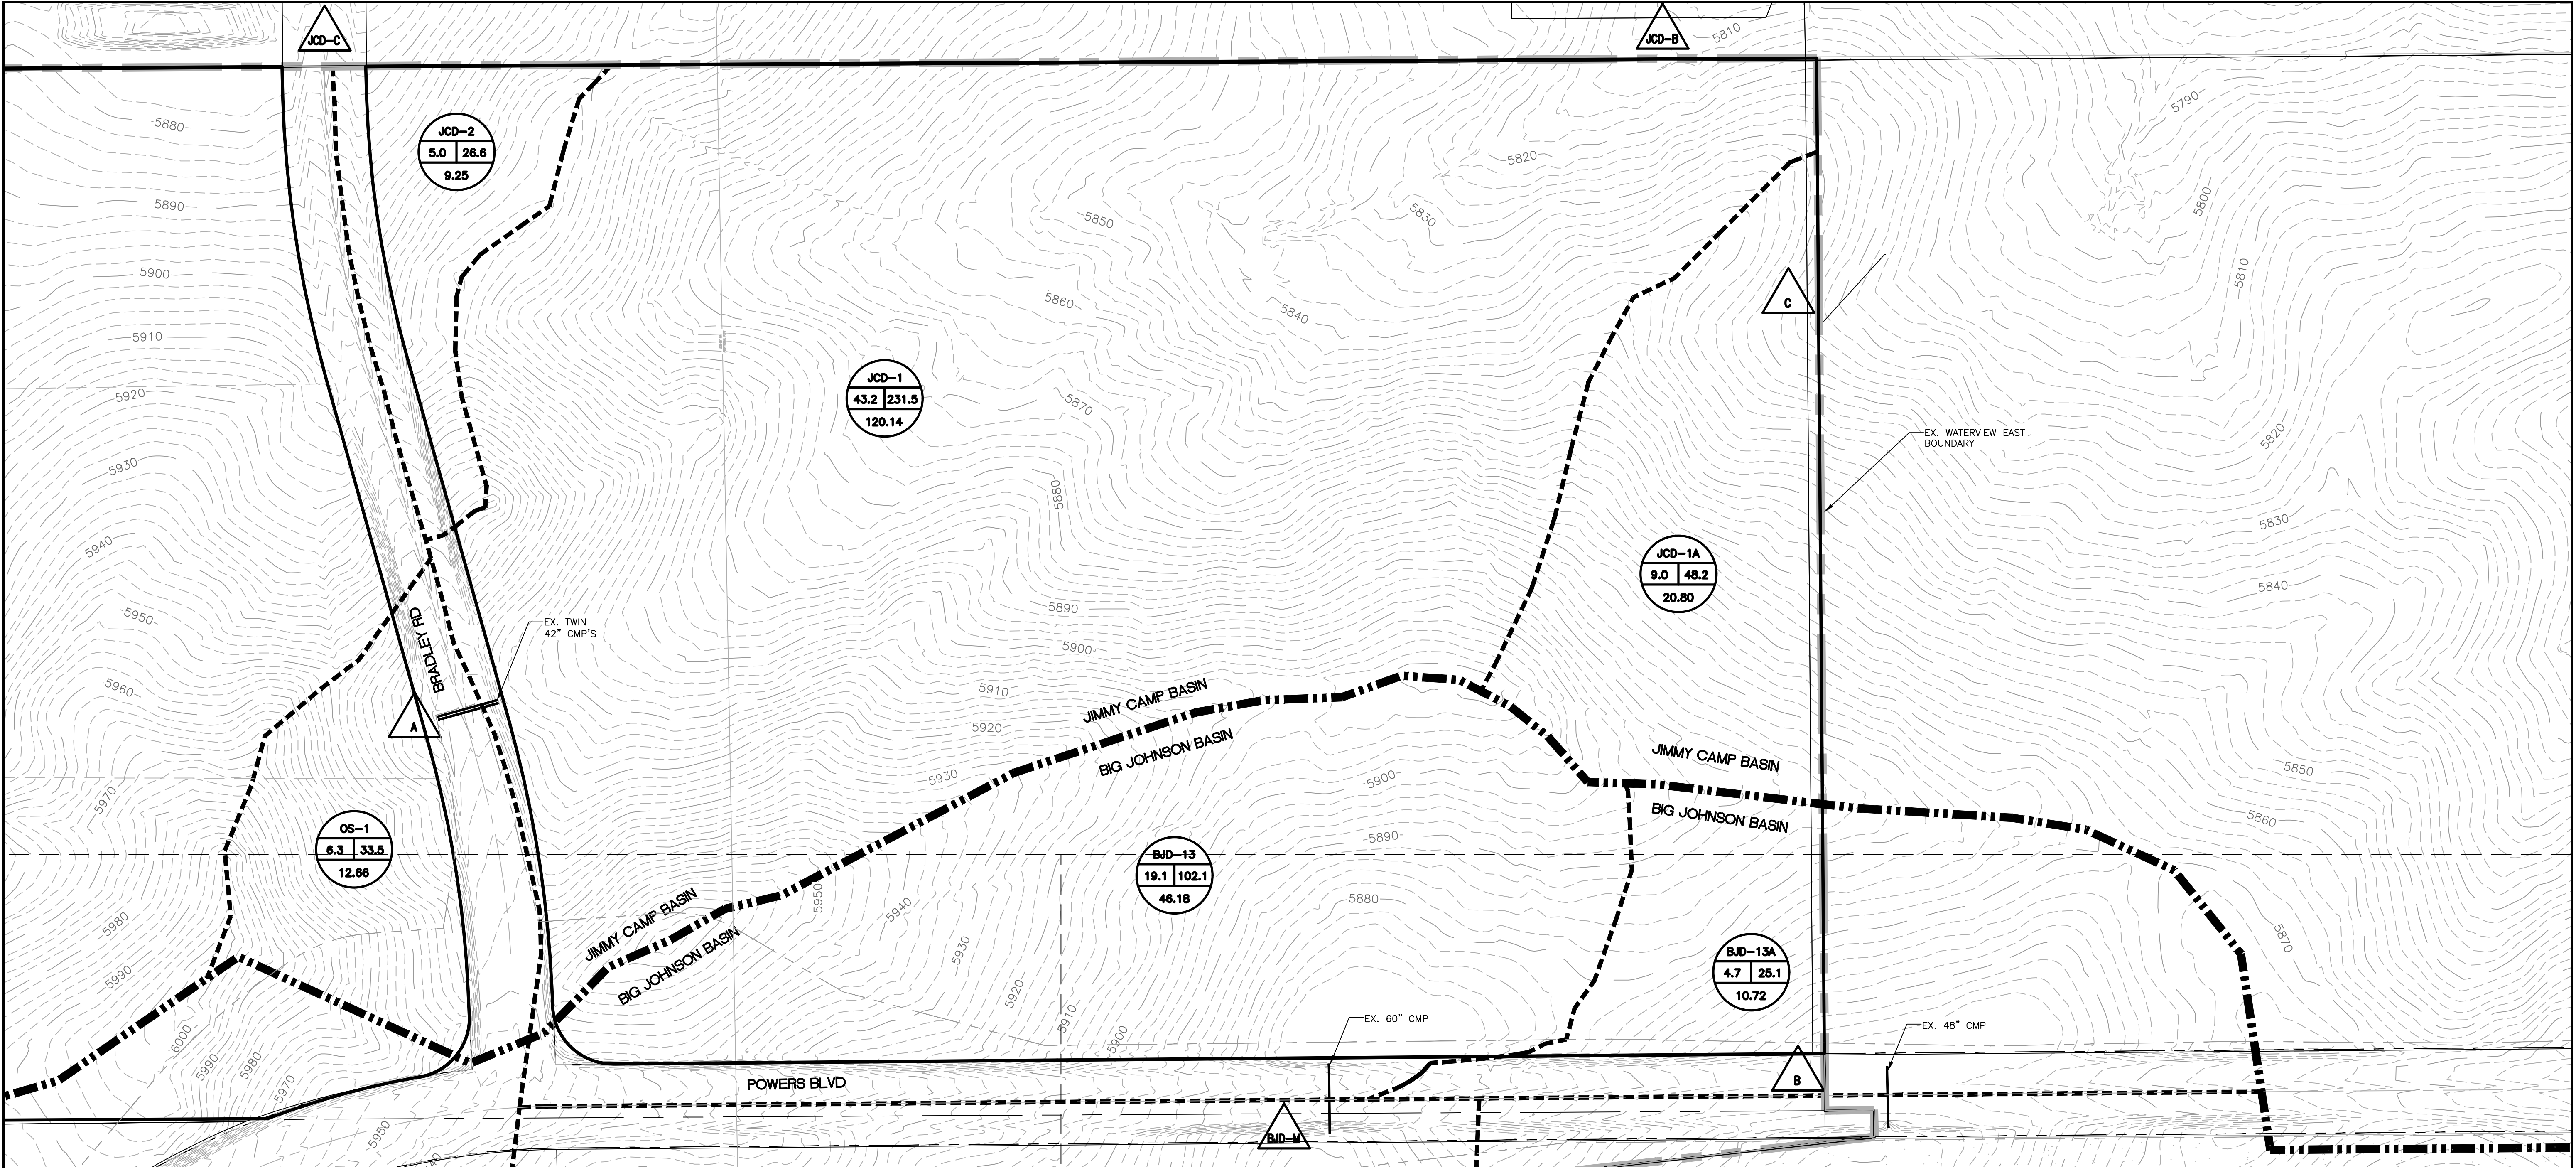

DESIGN POINT	Q5	Q100
A	6.26	33.54
BJD-M	19.06	102.07
B	4.70	25.14
JCD-C	4.96	26.55
JCD-B	47.79	255.91
C	8.99	48.16

LEGEND

- EXISTING 2' CONTOUR
- EXISTING 10' CONTOUR
- WATerview BOUNDARY
- MAJOR DRAINAGE BASIN BOUNDARY
- DRAINAGE BASIN BOUNDARY
- DESIGN POINT
- BASIN LABEL

Computer File Information		
Creation Date:	6-5-17	Initials: CMD
Last Modification Date:	6-6-17	Initials: BG
Full Path & Drawing File Name: V:\1817\active\181710214\Reports\Drainage\Exhibits\Ex BASIN Exhibits COS.dwg		
Acad Ver.	2014	Scale: see plan Units: Feet

Index of Revisions		

EL PASO

COUNTY

COLORADO

Stantec

Stantec Consulting Inc.
1110 Elton Drive
Suite B
Colorado Springs, CO 80907
Tel. (719) 432-6889
Fax.
www.stantec.com

--

WATerview EAST EX. DRAINAGE PLAN		
Designer:	BG	Structure
Detailer:	PF	Numbers
Sheet Subset:		


Project No./Code
181710214
Sheet Number 1 of 1

Figure 4: Proposed Drainage Map



DESIGN POINT	Q(5)	Q(100)
A	32.3	56.3
B	4.1	10.3
C	4.1	6.0
D	3.6	10.1
E	7.3	19.6
F	8.7	23.3
G	12.2	22.4
H	7.8	18.3
I	5.2	14.7
J	6.7	17.1
K	9.9	22.3
L	4.1	14.0
M	1.4	8.4
N	3.8	9.6
O	5.4	17.0
P	10.8	27.1
Q	3.8	17.3
R	0.7	6.6
S	51.5	110.7
T	3.7	22.6
U	4.7	11.5
V	5.2	12.6
W	8.6	19.2
X	2.0	9.6
Y	5.0	11.6
Z	9.7	22.2
AA	12.5	28.0
BB	10.3	24.8
CC	3.5	9.2
DD	4.8	12.4
EE	8.0	20.0
FF	9.2	22.8
GG	8.9	27.9
HH	8.1	30.5
II	1.0	14.9
JJ	7.1	17.3
KK	8.0	19.2
LL	8.4	25.5
MM	12.1	20.3
NN	6.3	15.5
OO	3.3	10.4
PP	3.0	10.6
QQ	4.3	17.6
RR	9.5	25.5
SS	3.5	10.1
TT	3.6	9.0
UU	13.5	25.3
VV	5.4	13.5
WW	5.5	9.9
AAA	3.0	8.6
BBB	4.0	11.1
CCC	9.2	22.3
DDD	3.0	8.0
EEE	4.4	11.5
FFF	2.6	9.8
GGG	3.8	13.2
HHH	2.4	7.9
III	6.8	21.2
JJJ	0.7	2.1
KKK	4.9	9.5
LLL	2.7	17.1
MMM	1.1	3.7
NNN	4.7	12.8
OOO	4.2	5.5
PPP	2.6	8.6
QQQ	1.7	6.0
RRR	3.1	9.2
SSS	4.7	11.7
TTT	5.9	16.4
UUU	5.7	13.7
VVV	2.5	7.2
EAST POND	25.7	50.5
WEST POND	27.2	57.9
JCD-B	10.1	145.3
JCD-C	2.8	13.1

MATCH LINE SEE SH 2

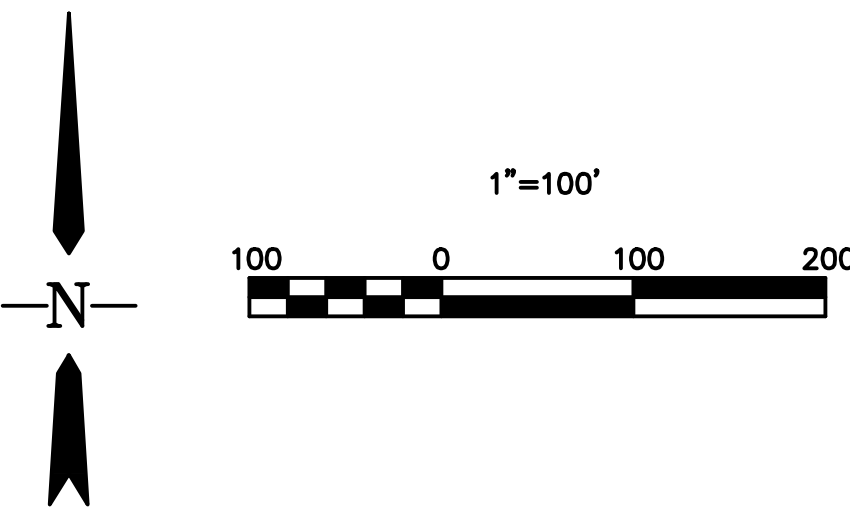

LEGEND

EXISTING 2' CONTOUR

EXISTING 10' CONTOUR

WATERVIEW BOUNDARY

MAJOR DRAINAGE BASIN BOUNDARY

DRAINAGE BASIN BOUNDARY

PROPOSED 2' CONTOUR

PROPOSED 10' CONTOUR


PROPOSED STORM DRAIN

DESIGN POINT

BASIN LABEL

Computer File Information			Index of Revisions			WATERVIEW EAST PROPOSED DRAINAGE PLAN			Project No./Code	
Creation Date: 12-16-16	Initials: CMD					Stantec Stantec Consulting Inc. 1110 Elkon Drive Suite B Colorado Springs, CO 80907 Tel. (719) 432-6889 Fax. www.stantec.com			181710214	
Last Modification Date: 12-16-16	Initials: BG									
Full Path & Drawing File Name: V:\52876\active\187608731\Reports\Drainage\Exhibits Pr Basin Exhibit										
Acad Ver. 2014	Scale: see plan	Units: Feet				Designer: CMD	Structure Numbers		Sheet Number 1 of 3	
						Detailer: BG				
						Sheet Subset:				

MATCH LINE SEE SH 3

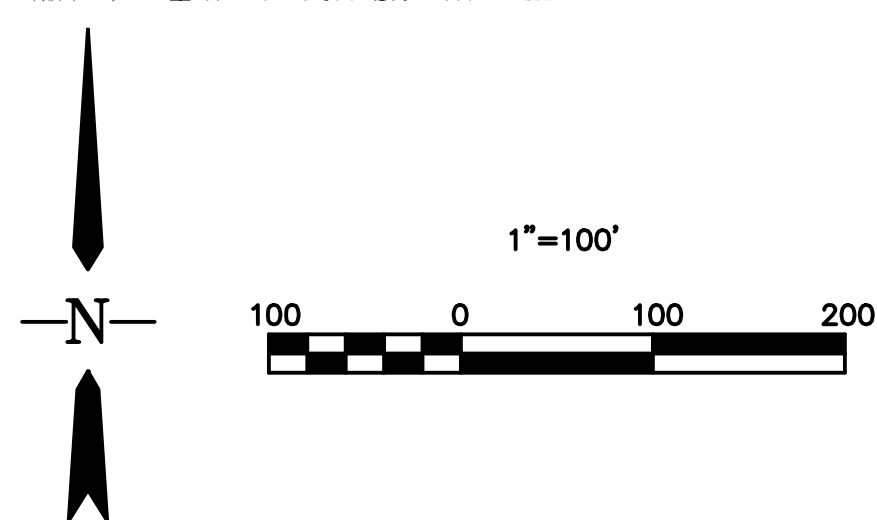


LEGEND


- EXISTING 2' CONTOUR
- EXISTING 10' CONTOUR
- WATERVIEW BOUNDARY
- MAJOR DRAINAGE BASIN BOUND
- DRAINAGE BASIN BOUNDARY
- PROPOSED 2' CONTOUR
- PROPOSED 10' CONTOUR
- PROPOSED STORM DRAIN
- DESIGN POINT
- BASIN LABEL

Computer File Information		Index of Revisions		<div>Stantec</div> <div>Stantec Consulting Inc. 1110 Elkton Drive Suite B Colorado Springs, CO 80907 Tel. (719) 432-6889 Fax. www.stantec.com</div>	WATERVIEW EAST PROPOSED DRAINAGE PLAN		Project No./Code	
Creation Date: 12-16-16	Initials: CMD	<input type="checkbox"/>				181710214		
Last Modification Date: 12-16-16	Initials: BG	<input type="checkbox"/>						
Full Path & Drawing File Name: V:\52876\active\187608731\Reports\Drainage\Exhibits Pr Basin Exhibit		<input type="checkbox"/>				Designer: CMD	Structure Numbers	
Acad Ver. 2014	Scale: see plan	Units: Feet	<input type="checkbox"/>			Detailer: BG		
			<input type="checkbox"/>			Sheet Subset:		Sheet Number 2 of 3

MATCH LINE SEE SH 3

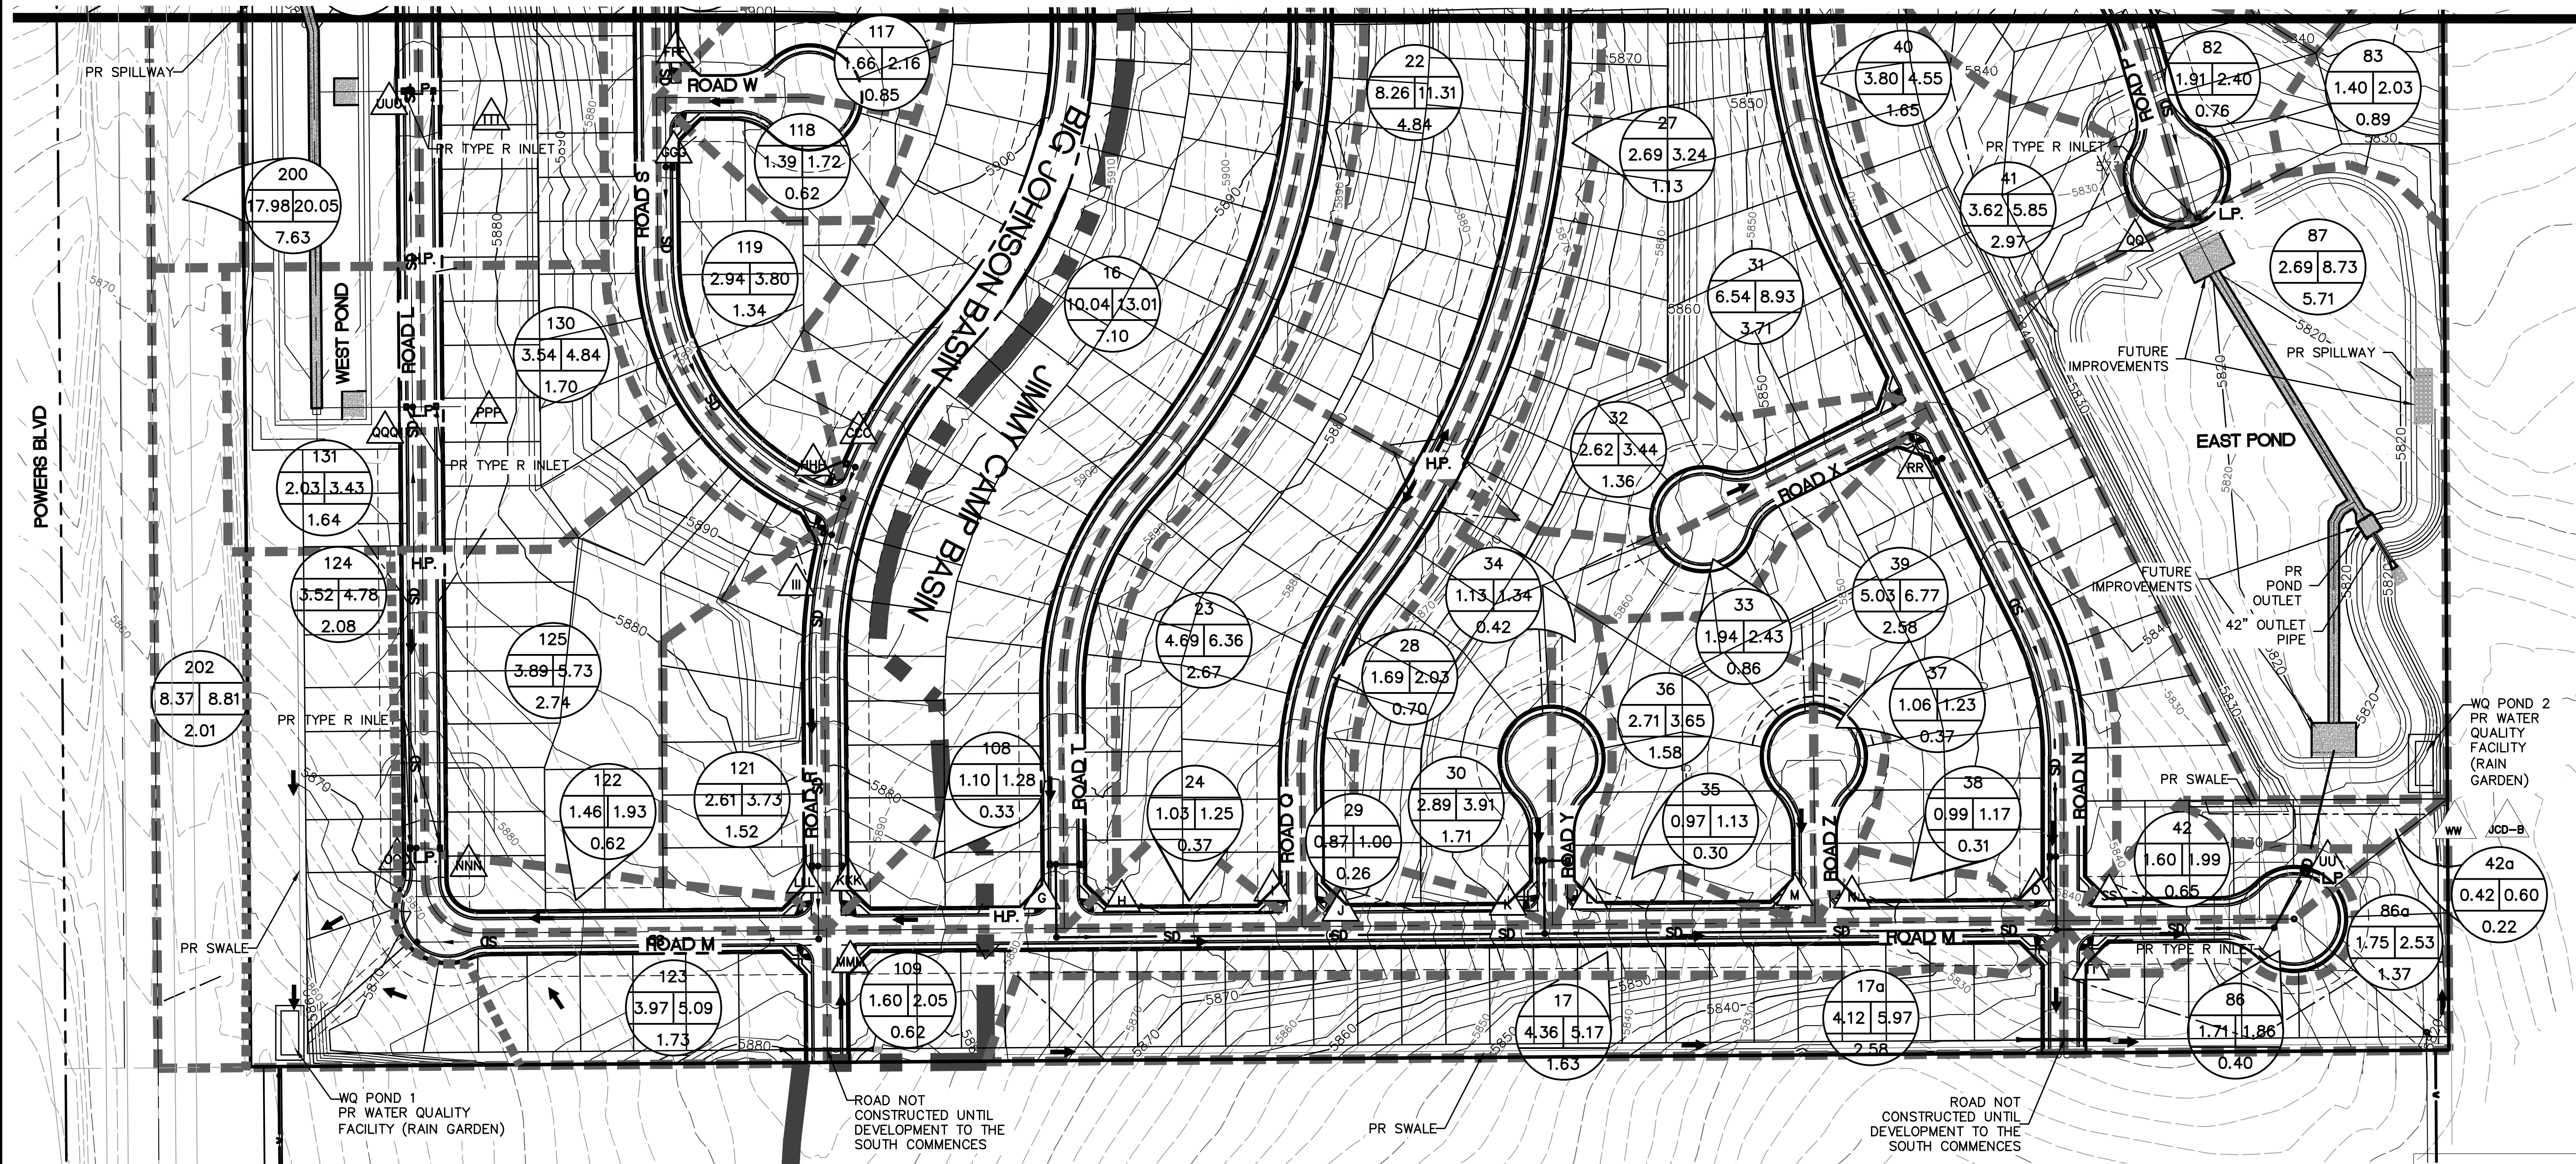

DESIGN POINT	Q(5)	Q(100)
A	32.3	56.3
B	3.6	10.3
C	4.1	6.0
D	3.6	10.1
E	7.3	19.6
F	8.7	23.3
G	12.2	22.4
H	7.8	18.3
I	5.2	14.7
J	6.7	17.1
K	9.9	22.3
L	4.1	14.0
M	1.4	8.4
N	3.8	9.6
O	5.4	17.0
P	10.8	27.1
Q	3.8	17.3
R	0.7	6.6
S	51.5	110.7
T	3.7	22.6
U	4.7	11.5
V	5.2	12.6
W	8.6	19.2
X	2.0	9.6
Y	5.0	11.6
Z	9.7	22.2
AA	12.5	28.0
BB	10.3	24.8
CC	3.5	9.2
DD	4.8	12.4
EE	8.0	20.0
FF	9.2	22.8
GG	8.9	27.9
HH	8.1	30.5
II	7.1	14.9
JJ	1.1	17.3
KK	8.0	19.2
LL	8.4	25.5
MM	12.1	20.3
NN	3.3	10.5
OO	3.3	10.4
PP	6.0	15.6
QQ	4.3	17.6
RR	9.5	25.5
SS	3.5	10.1
TT	3.6	9.0
UU	15.5	25.3
VV	5.4	13.5
WW	3.5	9.9
AAA	3.0	8.6
BBB	4.0	11.1
CCC	9.2	22.3
DDD	3.0	8.0
EEE	4.4	11.5
FFF	2.6	9.8
GGG	3.8	13.2
HHH	2.4	7.9
III	6.8	21.2
JJJ	0.7	2.1
KKK	4.9	9.9
LLL	2.7	17.1
MMM	1.1	3.7
NNN	4.7	12.8
OOO	4.2	5.5
PPP	2.6	8.6
QQQ	1.7	6.0
RRR	3.1	9.2
SSS	4.7	11.7
TTT	5.9	16.4
UUU	5.7	13.7
VVV	2.5	7.2
EAST POND	25.7	50.5
WEST POND	27.2	52.9
JCD-B	10.1	145.3
JCD-C	2.8	13.1

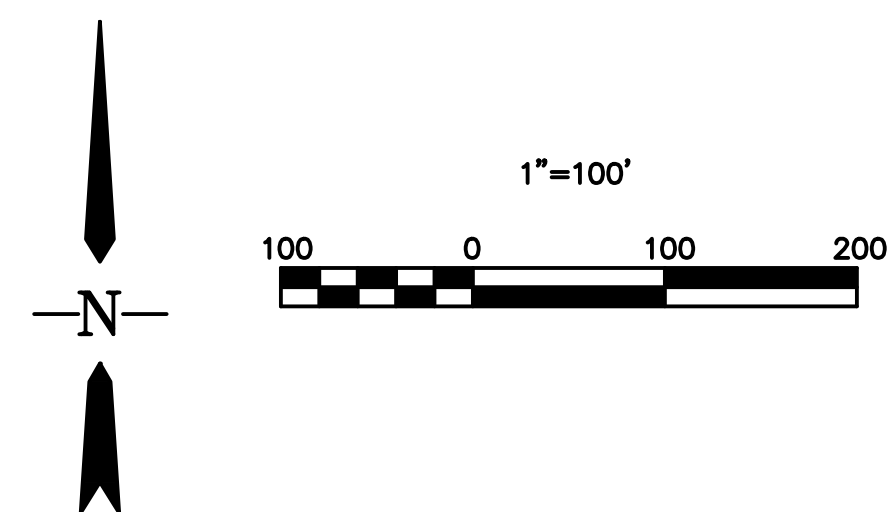

WEST POND SUMMARY TABLE


STORM EVENT	VOLUME (ac-ft)	PEAK OUTFLOW (cfs)	100-YR PONDING DEPTH (ft)
WQ	0.97	0.4	3.32
EURV	3.38	1.1	5.57
100-YR	5.27	40.3	7.23

EAST POND SUMMARY TABLE

STORM EVENT	VOLUME (ac-ft)	PEAK OUTFLOW (cfs)	100-YR PONDING DEPTH (ft)
WQ	3.13	1.2	4.29
EURV	10.35	4.2	6.30
100-YR	16.51	138.3	8.16

WQ POND'S SUMMARY TABLE

FACILITY	VOLUME	PEAK OUTFLOW	PONDING DEPTH (ft)
	(ac-ft)	(cfs)	
WQ 1	0.036	0.0	1.02
WQ 2	0.073	0.1	1.79
WQ 3	0.120	0.1	1.19

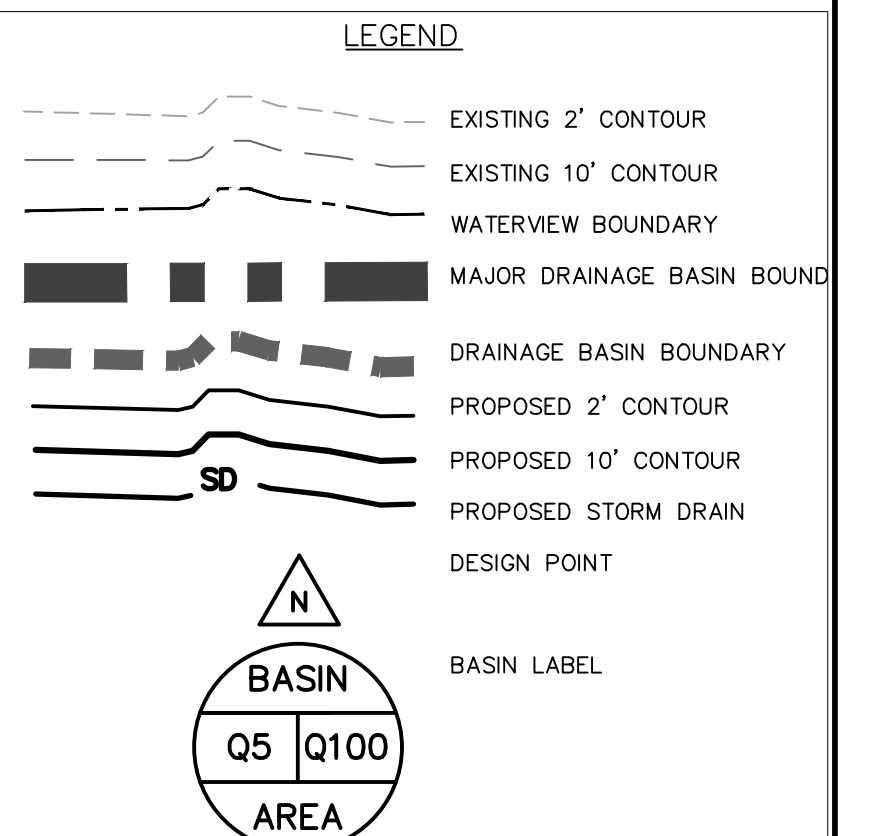

Computer File Information		<div><div></div><div></div><div></div><div></div><div></div></div>	Index of Revisions		<div><div></div><div>Stantec</div><div>Stantec Consulting Inc. 1110 Elkton Drive Suite B Colorado Springs, CO 80907 Tel. (719) 432-6889 Fax. www.stantec.com</div></div>	WATERVIEW EAST PROPOSED DRAINAGE PLAN		Project No./Code	
Creation Date: 12-16-16 Initials: CMD						181710214			
Last Modification Date: 12-16-16 Initials: BG									
Full Path & Drawing File Name: V:\52876\active\187608731\Reports\Drainage\Exhibits Pr Basin Exhibit						Designer: CMD Structure Numbers			
Acad Ver. 2014 Scale: see plan Units: Feet						Detailer: BG Sheet Subset:			
						Sheet Number 3 of 3			