

**MASTER DEVELOPMENT DRAINAGE PLAN
AND PRELIMINARY DRAINAGE REPORT FOR
WATERBURY FILINGS NO. 1 & 2
EL PASO COUNTY, COLORADO**

**PCD FILE NO:
PUDSP-21-005**

MARCH 2022

Prepared For:

Prepared for:
4-WAY RANCH JOINT VENTURE
P.O. BOX 50223
COLORADO SPRINGS, CO 80949
Contact: Peter Martz

Prepared By:

TERRA NOVA ENGINEERING, INC.
721 S. 23rd ST.
Colorado Springs, CO 80904

Job No. 1715.00

**MASTER DEVELOPMENT DRAINAGE PLAN
AND PRELIMINARY DRAINAGE REPORT FOR
WATERBURY FILINGS NO. 1 & 2
EL PASO COUNTY, COLORADO**

TABLE OF CONTENTS

ENGINEER'S STATEMENT	PAGE 3
INTRODUCTION	PAGE 4
PROJECT CHARACTERISTICS	PAGE 5
FLOODPLAINS STATEMENT	PAGE 6
HYDROLOGIC ANALYSIS FOR MDDP	PAGE 6
Existing Condition Analysis for MDDP	PAGE 7
Early Grading Analysis for MDDP	PAGE 9
Proposed Condition Analysis for MDDP	PAGE 11
HYDRAULIC ANALYSIS FOR MDDP	PAGE 26
HYDROLOGIC ANALYSIS FOR FILING 1 FDR	PAGE 29
DRAINAGE FEES	PAGE 33
SUMMARY	PAGE 33
BIBLIOGRAPHY	PAGE 34

REQUIRED MAPS AND DRAWINGS

VICINITY MAP

S.C.S. SOILS MAP

FEMA FIRM MAP

HYDROLOGIC CALCULATIONS

HYDRUALIC CALCULATIONS

FULL SPECTRUM & WATER QUALITY CALCULATIONS

HEC-RAS ANALYSIS

DRAINAGE MAPS

**MASTER DEVELOPMENT DRAINAGE PLAN
AND PRELIMINARY DRAINAGE REPORT FOR
WATERBURY FILINGS NO. 1 & 2
EL PASO COUNTY, COLORADO**

DESIGN ENGINEER'S STATEMENT:

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the applicable master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.

Quentin Armijo, P.E. 37170
On behalf of Terra Nova Engineering, Inc.

Date

OWNER/DEVELOPER'S STATEMENT:

I, the owner/developer have read and will comply with all of the requirements specified in this drainage report and plan.

Authorized Signature

Date

Printed Name, Title

Business Name

Address

EL PASO COUNTY:

Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 and 2, El Paso County Engineering Criteria Manual and Land Development Code as amended.

Jennifer Irvine, P.E.
County Engineer / ECM Administrator
Conditions:

Date

**MASTER DEVELOPMENT DRAINAGE PLAN
AND PRELIMINARY DRAINAGE REPORT FOR
WATERBURY FILINGS NO. 1 & 2
EL PASO COUNTY, COLORADO**

INTRODUCTION

PURPOSE

The purpose of this Master Development Drainage Plan is to identify and analyze the proposed drainage patterns, determine proposed runoff quantities, size drainage structures for conveyance of developed runoff based upon the overall development of single-family homes along with all the supporting infrastructure, while following the guidelines of the 4-step process.

This site was previously submitted as Waterbury Phase 1 Preliminary Plan with 3 separate filings by Classic Consulting Engineers & Surveyors, LLC. The Final Drainage Report for Filing 1 along with the construction drawings were approved in September of 2016 by EL Paso County Development Services and the Final Drainage Report for Filing 2 along with the construction drawings were submitted for review in September of 2017 and comments given back in September of 2017. Filing 3 had been preliminary designed but nothing submitted to EL Paso County. Since this time the owner has revised the lot layout and removed the alleys shown in Filings 1 & 2. All the public roadways have remained the same with the exception of the ROW for Saybrook Road from Stapleton to Bayshore Way, where it changed from 65' to 89'. With these changes El Paso County Development Services has requested that we submit a new Preliminary Plan and the associated MDDP for these revisions. The site will now be developed in 2 Filings, Filing 1 & Filing 2. A Final Drainage Report will be submitted with the Final Plat and Construction drawings. With the Preliminary Plan submittal an Early Grading Permit is also being submitted. The overall proposed drainage patterns do not differ much and follow the previous studies closely.

DBPS

The Waterbury site lies within the Geick Ranch and the Haegler Drainage Basins, storm runoff drains southerly via 2 existing natural waterways, one bordering the site on the west (Haegler Drainage Basin) and one on the east (Geick Ranch Drainage Basin). The "Haegler Drainage Basin Planning Study" was prepared by URS and approved in June of 2009. Drexel Barrel & Co prepared the "Geick Ranch Drainage Basin Planning Study" submitted for approval February 2008 but it has yet to be

approved by El Paso County, and therefore there are no drainage fees in this basin. In the Haegler DBPS it is noted that “a portion of the Haegler Ranch as delineated by the County map was found to be part of the Geick Ranch Drainage Basin at Judge Orr Road, due to a lack of a roadway culvert at the crossing. This is excluded from the Haegler Ranch DBPS and is included as part of the Geick Ranch DBPS, per the County.” These 2 channels eventually drain to Black Squirrel Creek and ultimately the Arkansas River.

PROJECT CHARACTERISTICS

Waterbury Filings 1 & 2 consists of 61.88 acres and is part of a larger development of 322.0 acres to be developed over time and in multiple filings. A PUD Development Plan, Zoning and Conceptual plans have all been previously processed and approved with El Paso County. Filing 1 is 29.44 acres with 115 single family units, while Filing 2 is 32.44 acres 83 single family lots.

The site is in the SW 1/4 of Sections 28, SE ¼ 29 & NW 1/4 33, Township 12 South, Range 64 West of the 6th Principal Meridian within El Paso County, Colorado. The site is bounded to the west by natural channel and 4-Way Ranch Filing No. 1. To the south by Stapleton Drive. To the north by unplatted land consisting of future Waterbury Filings, and to the west by a natural channel unplatted land consisting of future Waterbury Filings (See vicinity map, Appendix A).

The site consists of 100% Columbine Gravelly (19) per the USDA, NRCS web soil survey. The hydrologic soil group “A” was used to represent the soil types and determine the onsite basin overland flow. (See map in appendix)

The study area consists of undeveloped land that has existing vegetation consisting of established native grasses. A ridge running north to south splits the site with the west 1/3 draining southwest with average slopes of 0% to 3% and the remaining 2/3 drains southwest with average slopes of 0% to 3%. There are no existing on-site improvements.

The site has been analyzed in several approved studies including the following “Revision to the MDDP for Meridian Ranch, EL Paso County, Colorado”, approved October 2005, and prepared by PBS&J. “Final Drainage Report for 4-Way Ranch Phase 1” by JR Engineering Dated March 2006.

The “Geick Ranch Drainage Basin Planning Study” dated February 2008, and prepared by Drexel Barrel & Co. The “Preliminary/Final Drainage Report for Meridian Ranch filing No. 3” by Tech Contractors, November 2011. The “Master Development Drainage Plan, 4-Way Ranch – Phase 1” by Advanced Design Professionals, Inc. dated January 2012. The “Preliminary Drainage Report for Waterbury (Phase 1 Preliminary Plan) dated June 2013 by Classic Consulting analyzes this area in more detail and then Classic followed up with the “Final Drainage Report for Waterbury Filing No. 1” dated September 2016 which studied a portion of the area now being developed. Kiowa Engineering also prepared a 2004 LOMR (04-08-0012).

As-built field survey data is the basis for the design of the drainage basins.

FLOODPLAIN STATEMENT

A portion of this site along the western edge is within a designated F.E.M.A. floodplain, as determined by Flood Insurance Rate Map No. 08041C0552G December 7, 2018 (see appendix). The floodplain is shown on the proposed Drainage Map in the appendix along with the FEMA Firmette. Lots from Filings 1 & 2 abut the channel with rear lots lines, but are set to be outside of the floodplain. As mentioned in the previously approved “Final Drainage Report for Waterbury Filing 1” dated September 2016 prepared by Classic Consulting Engineering & Surveying the floodplain was determined by Kiowa Engineering in a 2004 LOMR (04-08-0012) using a HEC-RAS analysis modeling developed flows along the channel from the 3-42” culverts under Eastonville Road south to the existing stock pond (Design Point 13) south of Stapleton Drive with proposed and existing improvements such as the proposed 42” dual culverts located at the Gilbert Road crossing and existing dual 4’ x 8’ box culverts at Stapleton Drive (see appendix for HEC-RAS model). At the time of Final Platting the Base Floodplain Elevations are required to be shown on the Final Plat.

HYDROLOGIC ANALYSIS FOR MDDP

MAJOR DRAINAGE BASIN

The Waterbury Filing 1 & 2 site lies within the Geick Ranch and Haegler Drainage Basin, storm runoff drains southerly to Black Squirrel Creek via a public piped system and then into Fountain Creek. “Geick Ranch Drainage Basin Planning Study” dated February 2008, and prepared by Drexel Barrel & Co. has been drafted but not yet approved by El Paso County. The Haegler Ranch DBPS,

the Drainage Basin Planning Study on file for this basin was prepared by URS and approved in June of 2009. Drainage and Bridge fees for the part of the site that lies with Haegler Ranch Basin will not need to pay fees at the time of Final Plat

METHODOLOGY

The El Paso County Drainage Criteria Manual (EPCDCM), dated May 1994 was the resource used in this analysis with the exception for calculating the 5-year and 100-year design storm events. Chapter 6 of the City of Colorado Springs Drainage Criteria Manual (CSDCM) was referenced in determining rainfall and runoff for the proposed drainage system per the EPC DCM1 Update resolution. Runoff was calculated using the Rational Method for developed conditions (see appendix). Runoff coefficients were calculated using weighted impervious values for each specific basin base upon Table 6.6 of the CSDCM. Table 6.5 was used for calculating intensity (see appendix).

EXISTING MAJOR SUBBASIN DESCRIPTION (FOR MDDP)

In the existing condition runoff from Filing 2 sheet flows south onto Filing 1 and from here the runoff is directed southwest and southeast overland to the existing channels on the west and east side of the site. Below is a description of the existing condition's Design Points, Basins and site runoff.

There are 4 offsite basins that drain existing runoff onto the site from the north under Eastonville Road through culverts. There is also unplatted open space just north of the proposed Waterbury Filing No. 1 & 2.

At Design Point 10A 3-42" RCP that routes runoff from a temporary sediment pond south onto the property (Basin OS-5). The "Preliminary/Final Drainage Report for Meridian Ranch Filing No. 3" and shows flows of $Q_5 = 28$ cfs, $Q_{100} = 153$ cfs while the Meridian Ranch MDDP shows a 100-year flow of 185 cfs. This larger flow of 185 cfs is used in the HEC-RAS model for downstream channel analysis and culvert design. As mentioned above in the Floodplain Statement section the natural channel along the west side of the site is a recognized FEMA floodplain. This channel in the Haegler Creek Basin drains south to Stapleton Drive where dual 4' high x 8' wide concrete box culverts route the water south in its natural path.

Design Point EX1 consist of onsite Basin EXA's 9.62 acres and offsite Basin OS-5's 6.74 acres, which both consist of undeveloped open space prairie and the FEMA flood channel and the runoff from Design Point EX10A mentioned above travel in the channel south to the southern boundary of our site. The combined flow from these upstream basins and our onsite basins that contribute to the flow is $Q_5 = 38$ cfs, $Q_{100} = 219$ cfs. This report does not analyze the flow coming from the adjacent Subdivision as the culverts were previously sized and installed in the approved Classic Consulting "Final Drainage Report for Waterbury Filing No. 1" dated September 2016.

Design Point EX2 is a point at the southern boundary of Filing 1 where runoff ($Q_5 = 1$ cfs, $Q_{100} = 9$ cfs) from Basin EXB's 4.09 acres of undeveloped prairie flow into Stapleton Road.

Design Point EX3 consists of a shallow swale that leave the site at the south east boundary. Runoff ($Q_5 = 0$ cfs, $Q_{100} = 1$ cfs) from Basin OS-4's 0.29 acres is directed south onto Basin EXC. The runoff ($Q_5 = 7$ cfs, $Q_{100} = 45$ cfs) from Basin EXC's 24.80 acres is combined with the Basin's OS-4. The combined runoff ($Q_5 = 7$ cfs, $Q_{100} = 45$ cfs) is directed offsite and shortly later in the existing channel in the Geick Ranch Basin.

Design Point EX4 is a point at the eastern boundary of Filing 1 where runoff ($Q_5 = 0$ cfs, $Q_{100} = 2$ cfs) from Basin OS-3's 1.11 acres of undeveloped prairie flows south onto Basin EXD's 15.87 acres ($Q_5 = 5$ cfs, $Q_{100} = 31$ cfs). The combined flow ($Q_5 = 5$ cfs, $Q_{100} = 33$ cfs) travels south and drains into the existing channel along the eastern boundary.

At Design Point EX10 a 36" CMP culvert (corresponds to DP10 in the MDDP) that drains from north to south under Eastonville Road (Basin OS-8) onto the undeveloped open space north (Basin OS-2) of the proposed Filing 2 layout. The Meridian Ranch MDDP states the runoff is $Q_5 = 5$ cfs, $Q_{100} = 11$ cfs.

Design Point EX5 consists of a swale that leave the site at the south east boundary. Runoff ($Q_5 = 3$ cfs, $Q_{100} = 22$ cfs) from Basin OS-2's 11.40 acres and Design Point EX10 is directed south onto Basin EXE. The runoff ($Q_5 = 2$ cfs, $Q_{100} = 14$ cfs) from Basin EXE's 5.83 acres is combined with Basin's OS-2 & Design Point EX10. The combined runoff ($Q_5 = 10$ cfs, $Q_{100} = 44$ cfs) of the 3 basins is

directed offsite and into the existing channel in the Geick Ranch Basin.

At Design Point EX9 (Basin OS-9) is another 36" DOME culvert (corresponds to DP9 in the MDDP) that routes the runoff ($Q_5 = 8$ cfs, $Q_{100} = 19$ cfs) under Eastonville Road and onto the open space in Basin OS-1. The runoff ($Q_5 = 13$ cfs, $Q_{100} = 85$ cfs) from Basin OS-1's 45.02 acres is routed south via the existing channel located in the Geick Ranch Basin. An analysis found that this drainage channel is a jurisdictional waters of the U.S. with associated jurisdictional wetland habitat. Basin EXF's 1.62 acres is a small area consisting of open space prairies located at the north east corner of the site. Runoff ($Q_5 = 1$ cfs, $Q_{100} = 4$ cfs) from Basin EXF is directed onto Basin OS-1 along the eastern boundary at Design Point EX6.

Design Point EX7 is a point in the channel that corresponds to the proposed Design Point 30. The combined flow of Basin OS-1, Design Points EX5, EX6, & EX9 at DP EX7 is $Q_5 = 31$ cfs, $Q_{100} = 151$ cfs).

EARLY GRADING PERMIT SUBBASIN DESCRIPTION

The developer/owner is applying for an Early Grading Permit with the PUD and Final Plat submittal. Per El Paso County Standards, the site must be analyzed for this step in the process. All the flow will be treated via temporary BMP's. These BMP's include silt fence for areas along the site boundary that cannot be routed to a Temporary Sediment Basin (TSB). The larger open areas being graded will be routed via natural and temporary diversion swales to a TSB. All the diversion swales are trapezoidal swales 2' deep, 2'-4' bottom width with 4:1 side slopes (see appendix for calcs) and will have Sediment Control Logs to help control sediment runoff. The velocities in these swales are less than the 7 fps and therefore will be stable. All TSBs will allow sediment to settle out and runoff will be routed via 6" PVC pipe wrapped in rock or in the bigger storm via the riprap armored weir. Below is a description of the site for the Initial Grading Phase.

Basin PRE-A's 4.61 acres consists of small open space prairie along the western boundary that cannot be routed to a Temporary Sediment Basin, and the existing channel floodplain. Runoff ($Q_5 = 1$ cfs, $Q_{100} = 10$ cfs) will sheet flow to Silt Fence BMPs prior to draining into the channel.

Design Point PRE1 is Temporary Sediment Basin 1 (TSB1) located at the southwestern corner of the site and will become a permanent Full Spectrum Detention Basin (FSD 1) when construction starts. Offsite Basin OS-4's 0.56 acres will sheet flow ($Q_5 = 0$ cfs, $Q_{100} = 1$ cfs) onto Basin PRE-B. Runoff ($Q_5 = 4$ cfs, $Q_{100} = 24$ cfs) from Basin PRE-B's 12.35 acres will combine with the upstream offsite Basin OS-4. The combined flow ($Q_5 = 4$ cfs, $Q_{100} = 25$ cfs) will be routed overland and via temporary diversion swale A-A to TSB where the water will be treated prior to leaving the site. The swale is a 2' wide bottom 2' deep swale with 4:1 side slopes. The 100-Y highwater depth in the swale is 1.00' (See Appendix for calcs).

Design Point PRE2 is Temporary Sediment Basin 2 (TSB2) located at the southeastern corner of the site. Runoff ($Q_5 = 6$ cfs, $Q_{100} = 38$ cfs) from Basin PRE-C's 19.08 acres will be routed overland and via 2 temporary diversion swales B-B to the TSB where the water will be treated prior to leaving the site. It is assumed that the flow is split between the 2 swales. The flows of $Q_5 = 3$ cfs, $Q_{100} = 19$ cfs are used in the swale calculations. The swales are a 2' wide bottom, 2' deep swale with 4:1 side slopes. The 100-Y highwater depth in the swale is 0.94' (See Appendix for calcs).

Design Point PRE3 is Temporary Sediment Basin 3 (TSB3) located on the eastern boundary of the site. Offsite Basin OS-3's 1.11 acres will sheet flow ($Q_5 = 0$ cfs, $Q_{100} = 3$ cfs) onto Basin PRE-D. Runoff ($Q_5 = 5$ cfs, $Q_{100} = 30$ cfs) from Basin PRE-D's 15.52 acres will combine with the upstream offsite Basin OS-3. The combined flow ($Q_5 = 5$ cfs, $Q_{100} = 33$ cfs) will be routed overland and via temporary Diversion Swale C-C that is located along the Boundary between Filing 1 & 2, to the TSB where the water will be treated prior to leaving the site. The swale is a 3' wide bottom, 2' deep swale with 4:1 side slopes. The 100-Y highwater depth in the swale is 1.04' (See Appendix for calcs).

Design Point PRE4 is Temporary Sediment Basin 4 (TSB4) located on the eastern boundary of the site just north of TSB3. Offsite Basin OS-1's 0.75 acres will sheet flow ($Q_5 = 0$ cfs, $Q_{100} = 2$ cfs) onto Basin PRE-E. Runoff ($Q_5 = 2$ cfs, $Q_{100} = 16$ cfs) from Basin PRE-E's 6.33 acres will combine with the upstream offsite Basin OS-1. The combined flow ($Q_5 = 3$ cfs, $Q_{100} = 18$ cfs) will be routed overland and via temporary Diversion Swale D-D to the TSB where the water will be treated prior to leaving the site. The swale is a 2' wide bottom 2' deep swale with 4:1 side slopes. The 100-Y highwater depth in the swale is 0.86' (See Appendix for calcs).

Design Point PRE5 is downstream of an existing stock pond located just north of Filing 2 boundary in a future Waterbury Phase. Offsite Basin OS-8's 2.56 acres flow ($Q_5 = 5$ cfs, $Q_{100} = 11$ cfs) under Eastonville Road via a 36" CMP culvert onto Basin OS-2. Offsite Basin OS-2's 11.15 acres flow ($Q_5 = 8$ cfs, $Q_{100} = 19$ cfs) into the existing stock pond. The combined flow ($Q_5 = 9$ cfs, $Q_{100} = 35$ cfs) of the 2 basins will be routed overland in a proposed Diversion Swale E-E north of the Filing 2 Boundary to the existing channel that runs along the eastern boundary, while keeping it off of the proposed development. The swale is a 4' wide bottom 2' deep swale with 4:1 side slopes. The 100-Y highwater depth in the swale is 0.99' (See Appendix for calcs).

Design Point PRE6 is a point located at the southern boundary of the site in Stapleton Drive. Basin PRE-F's 0.62 acres consists of small open space prairie that cannot be routed to a Temporary Sediment Basin. Runoff ($Q_5 = 0$ cfs, $Q_{100} = 2$ cfs) will sheet flow to Silt Fence BMPs prior to draining offsite in its historic path.

Design Point PRE7 is a point located at the eastern boundary of the site in the existing channel in the Geick Ranch Basin. Basin PRE-G's 2.00 acres consists of small open space prairie next to the channel and wetlands in Filing 1 that cannot be routed to a Temporary Sediment Basin. Runoff ($Q_5 = 1$ cfs, $Q_{100} = 4$ cfs) will sheet flow to Silt Fence BMPs prior to draining offsite in its historic path. Basin PRE-H's 1.33 acres consists of small open space prairie next to the channel and wetlands in Filing 2 that cannot be routed to a Temporary Sediment Basin. Runoff ($Q_5 = 1$ cfs, $Q_{100} = 4$ cfs) will sheet flow to Silt Fence BMPs prior to draining offsite in its historic path. Along with these 2 Basins, runoff discharged from PRE2, PRE3, PRE4, & PRE5 for a combined runoff of $Q_5 = 25$ cfs, $Q_{100} = 147$ cfs that is routed to the existing channel.

PROPOSED MAJOR SUBBASIN DESCRIPTION (FOR MDDP)

The overall site will be developed in several Filings with each filing requiring its own final drainage report. The Proposed Major Basin Descriptions below is for Waterbury Filings 1 & 2 development and the preliminary layout of the future filings to the north tributary to the storm drain system and detention ponds in Filings 1 & 2. This future area is shown as fully developed to analyze the ultimate

storm drain capacity and pond volumes. In the section below labeled Hydrologic Analysis for Filing 1 FDR the interim condition will be discussed and how runoff is captured and routed safely to the proposed private EDB for Filings 1 & 2 construction. See the Proposed MDDP Drainage Map in the appendix for a visual representation of the below Basin descriptions.

Design Point 1 is a proposed public 10' CDOT TYPE R sump inlet located in the west flowline of Saybrook drive just north of the roundabout. Basin A's 3.39 acres consists of roadway and single-family development. Runoff ($Q_5 = 5$ cfs, $Q_{100} = 12$ cfs) sheet flows into street sections and then is routed south via c&g where the inlet captures all the flow.

Design Point 2 is a proposed public 5' CDOT TYPE R sump inlet located in the west flowline of Saybrook drive opposite of DP 1. Basin C's 0.86 acres is comprised of roadway and single-family development. Runoff ($Q_5 = 2$ cfs, $Q_{100} = 4$ cfs) drains overland to the street and then to the inlet where it is fully captured. Pipe run 1 an 18" RCP routes the flow to a junction at DP 1. Pipe Run 2 a public 24" RCP routes the combined flow ($Q_5 = 7$ cfs, $Q_{100} = 15$ cfs) of DP 1 & 2 down Saybrook Road and then down Bayshore Drive over to manhole junction in Sandy Neck Way.

Design Point 3 is a proposed public 5' CDOT TYPE R sump inlet located in the east flowline of Sandy Neck Way. Basin B1's 2.30 acres consists of roadway and single-family development. Runoff ($Q_5 = 4$ cfs, $Q_{100} = 8$ cfs) is directed south to Design Point 3. The 5' CDOT TYPE R sump inlet captures the entire flow. Pipe run 3 an 18" public RCP storm sewer routes the flow west to a manhole junction with Pipe run 4.

Design Point 4 is a proposed public 10' CDOT TYPE R sump inlet located in the west flowline of Sandy Neck Way opposite of DP 3. Basin B2's 3.58 acres consists of roadway and single-family development. Runoff ($Q_5 = 6$ cfs, $Q_{100} = 13$ cfs) is routed to Design Point 4. The 10' CDOT TYPE R sump inlet captures the entire flow. Pipe run 4 a 24" public RCP storm sewer routes the flow west to a manhole junction with Pipe run 3. Pipe run 5 a 24" RCP routes the combined ($Q_5 = 9$ cfs, $Q_{100} = 21$ cfs) flow of Pipe runs 3 & 4 south down Sandy Neck Way to the manhole junction with Pipe run 2. Pipe run 6 a public 36" RCP then routes the combined ($Q_5 = 16$ cfs, $Q_{100} = 35$ cfs) flow of Pipe runs 2 & 5 south down Sandy Neck Way to a junction at Design Point 5.

Design Point 5 is a proposed public 10' CDOT TYPE R sump inlet located in the flowline of Sandy Neck Way cul-de-sac. Runoff ($Q_5 = 4$ cfs, $Q_{100} = 9$ cfs) from Basin F's 2.18 acres consisting of single-family development is directed to the east flow line of Sandy Neck Way and then south to the cul-de-sac bulb low point. Runoff ($Q_5 = 3$ cfs, $Q_{100} = 6$ cfs) from Basin H's 1.46 acres consisting of single-family development is directed to the west flow line of Sandy Neck Way and then south to the cul-de-sac bulb low point. The combined flow ($Q_5 = 7$ cfs, $Q_{100} = 16$ cfs) at DP 5 is captured in the 10' CDOT TYPE R sump inlet and then is routed to the pond along with the flow from Pipe Run 6 via a proposed 36" public RCP storm sewer (Pipe run 7, $Q_5 = 22$ cfs, $Q_{100} = 48$ cfs) to Design Point 8. If this inlet were blocked, runoff would overtop the curb and flow down the storm drain tract and into the proposed FSD Pond 1 (Design Point 8).

Design Point 6 is a proposed public 5' CDOT TYPE R sump inlet located in the west flowline of Saybrook Road. Runoff ($Q_5 = 4$ cfs, $Q_{100} = 8$ cfs) from Basin D's 2.11 acres consisting of single-family development is directed to the low point in Saybrook Road where the entire flow is captured. It is then routed via a proposed 18" public RCP storm sewer (Pipe run 8) to a manhole junction with Pipe run 9.

Design Point 7 is a proposed public 5' CDOT TYPE R sump inlet located opposite of DP 6 in Saybrook Road. Runoff ($Q_5 = 4$ cfs, $Q_{100} = 8$ cfs) from Basin E's 2.18 acres consisting of roadway and single-family lots is directed via side lot line swales and C&G to the proposed inlet. The 5' inlet captures all of the flow and Pipe run 9 a public 18" diameter RCP storm sewer routes the flow to a manhole junction at with Pipe run 8. The combined flows ($Q_5 = 7$ cfs, $Q_{100} = 15$ cfs) of Pipe runs 8 & 9 are routed south down Saybrook Road in Pipe run 10 a public 24' diameter RCP to the proposed FSD Pond 1 Design (Design Point 8).

Design Point 7A is a proposed public 5' CDOT TYPE R at-grade inlet located in the east flowline of Saybrook Road at the south boundary. Runoff ($Q_5 = 1$ cfs, $Q_{100} = 3$ cfs) from Basin G1's 0.53 acres consisting of single-family development is directed to the at-grade inlet. The entire flow is captured. It is then routed via a proposed 15" public RCP storm sewer (Pipe run 10A) to a Design Point 7B.

Design Point 7B is a proposed public 5' CDOT TYPE R at-grade inlet located opposite of DP 7A in Saybrook Road. Runoff ($Q_5 = 2$ cfs, $Q_{100} = 4$ cfs) from Basin G2's 0.69 acres consisting of roadway and single-family lots is directed via side lot line swales and C&G to the proposed inlet. The 5' inlet captures all of the flow and Pipe run 10B a public 18" diameter RCP storm sewer routes the combined flows ($Q_5 = 7$ cfs, $Q_{100} = 15$ cfs) of Pipe runs 10A & Design Point 7B are routed west to the proposed FSD Pond 1 Design (Design Point 8).

Design Point 8 is a proposed private Full Spectrum Detention Basin called FSD Pond 1. Design Points 1-7B are routed to the pond and treated for Water Quality and Detention along with Basin K's 3.06 acres consisting mainly of the EDB area and rear yards. Runoff ($Q_5 = 3$ cfs, $Q_{100} = 11$ cfs) sheet flows into the EDB. The basins tributary to Design Point 8 are Basins A, B1, B2, C, D, E, F, G1, G2, H & K with a total area of 21.12 acres. The 100-year effective impervious area of 55.5% was calculated using UD-BMP Version 3.07 IRF spreadsheet. This information was entered into the UD-Detention_v4.03 spreadsheet and the calculation yielded a required a WQCV of 0.394 ac-ft, a EURV of 0.957 ac-ft and a 100-year total required volume of 2.127 ac-ft. The top of pond is set at 6930.00, with a bottom of pond at 6923.50. The pipes and swales to the pond discharge into 2 concrete forebays (3% WQCV see calcs in appendix) with 18" high walls and a 3" notch to release minor flows into 2' wide concrete trickle channel. The trickle channel directs runoff to the proposed concrete micro-pool at the surcharge elevation of 6923.83. The bottom of the micro-pool is set at 6921.00 and the top set at 6923.50. A proposed 4' x 4' grate set at 6926.90 on top of a concrete outlet box, an outlet plate on the front to meet the 3-orifice requirement and an 18" outlet pipe with a restrictor plate set 12" above the invert will route all runoff from the pond. The metal plate will have 1 column containing 3 rows of 1-15/16" diameter orifice holes spaced 13.80" apart starting at 6923.50. The WQCV release is 0.20 cfs with a ponding elevation of 6925.29 and takes 40 hours to release. The EURV release is 0.5 cfs, with an elevation of 6926.94 and takes 73 hours to release. The 100-year detention release is 14.5 cfs, with an elevation of 6927.60 and takes 74 hours to release. A 30' long riprap emergency spillway set at 6928.00 will allow the 100-year developed peak in flow ($Q_{100} = 60.0$ cfs) with a depth of 0.73' (top of water = 6928.73) to be routed west into the natural channel. 1.00' freeboard is provided (see appendix for all pond calcs). The spillway and downhill slope will be armored with d50= VH 24" riprap. Pipe Run 10C a private 24" RCP will route the pond release into the existing natural channel. (See Pond Calculations in appendix).

Design Point 9 is an existing 36" RCP culvert under Eastonville Road where Offsite Basin OS-9 discharges onto offsite Basin OS-2. Runoff ($Q_5 = 8$ cfs, $Q_{100} = 19$ cfs) from Basin OS-9's 11.80 acres consists of historic flow based upon upstream detention. Further breakdown of this flow will be discussed with analysis of Design Point 29 and the discussion for Tributary flow to the FSD Pond 3.

Design Point 10 is an existing 36" RCP culvert under Eastonville Road south of the existing High School Pond where Offsite Basin OS-8 discharges onto a future Waterbury Filing. Runoff ($Q_5 = 5$ cfs, $Q_{100} = 11$ cfs) from Basin OS-10's 2.56 acres consists of historic flow based upon upstream detention. In the ultimate buildout this flow will be piped west to the existing natural channel along the westside of Waterbury and to Offsite Basin OS-5. Until the future filings are built this flow will follow its natural channel south to the existing channel located along the eastern boundary of Filings 1 & 2. This will be discussed again in the Preliminary Drainage Report section below.

Design Point 10A is where existing 3-42" RCP culverts from the temporary Meridian Ranch Pond cross under Eastonville Road per the "Preliminary/Final Drainage Report for Meridian Ranch Filing No. 3" and shows flows of $Q_5 = 28$ cfs, $Q_{100} = 153$ cfs while the Meridian Ranch MDDP shows a 100-year flow of 185 cfs. The pipes discharge onto Offsite Basin OS-5. Offsite Basin OS-5's 5.64 acres consists of future Waterbury rear lots, open space and the natural channel. Runoff ($Q_5 = 10$ cfs, $Q_{100} = 23$ cfs) from OS-5 sheet flows to the channel. The flow is then routed south to Design Point 11.

Design Point 13 in this report corresponds to Design Point 13 in Classic Consulting's previously approved "Final Drainage Report for Waterbury Filing 1" dated September 2016. Design Point 13 is an existing Stormwater Quality Pond 3 (SWQ Pond 3) that was an existing stock pond south of Stapleton Drive that has been converted to an EDB and treat 40.4 acres of 4-Way Ranch Filing No. 1 from their Basins OS-5, OS-6, D, E, N 40% of L, 50% of O, Q & basins I, J & N of Waterbury Filing No. 1. The EDB was designed using a 4' x 4' outlet set at 6907.50 with an orifice plate with 1 column of 8-1/8" diameter holes spaced 4" apart. The forebay top is set at 6915.00 with the bottom at 6914.75. The required volume was calculated to be 0.66 ac-ft and the design volume shown is 1.20 ac-ft. The release out of the pond was calculated to be $Q_5 = 69$ cfs, $Q_{100} = 396$ cfs (See Classic Consulting

Drainage Map in Appendix). This online EDB is no longer considered a viable solution to treating for WQCV for Waterbury Filing 1 & 2 basins I, J & N.

Design Point 11 is a proposed crossing under the proposed continuation of Gilbert Drive with dual 42" RCP culverts. Basin I's 4.97 acres consists of rear lots and the natural channel. Runoff ($Q_5 = 4$ cfs, $Q_{100} = 14$ cfs) sheet flows to the channel and is directed south to Design Points 11. As mentioned above Kiowas Engineering did a HEC-RAS analysis modeling developed flows along the channel. Tera Nova Engineering has done a new HEC-RAS analysis modeling developed flows. This information can be found under the Hydraulic analysis section below. The combined flow of Design Point 10A along with Basins OS-5 and I is $Q_5 = 34$ cfs, $Q_{100} = 213$ cfs. This flow is routed south under Gilbert drive and onto Basin J. Basin I's runoff as mentioned above was intended to be treated downstream in the existing EDB at Design Point 13. This online EDB is no longer considered a viable solution to treating for WQCV due to new regulations. Therefore, the UD-BMP Version 3.07 Runoff Reduction was used to show that this area can be treated using Runoff Reduction. Due to the Runoff Reduction Spreadsheet only allowing for a maximum 80,000 sq ft per basin in runoff reduction calculations the basin was broken down into 3 smaller subbasins IA, IB & IC. These are not used for anything else but the runoff reduction calculations (see MDDP Proposed Drainage Map). The results show that we have a 100% WQCV reduction for Basin I as the entire acreage consists of Separate Pervious Area. Only developed land in Basin I is the rear 20' of the lot which consists of the rear setback where no structure can be built. A note is being placed on the plat that states *"No lots shall have any impervious improvements constructed within the rear setback (i.e. patios, hardscape, recreational facilities, etc.) for Lots 35-42, 131-137, & 150-162."* These areas will also need be vegetated with the final GEC plan and maintained per the O&M manual. The Preliminary Plan/PUD also places impervious restrictions on the rear yards of lots in this Basin area.

Design Point 12 is a proposed 18" RCP culvert under Gilbert Drive that routes the runoff ($Q_5 = 2$ cfs, $Q_{100} = 4$ cfs) from offsite Basin OS-6's 1.06 acres that is comprised of the eastern half of Thatcher Court located in 4-Way Ranch Filing 1 to the existing natural channel.

Basin J's 1.44 acres is comprised of rear lots and the existing channel along the west boundary. Runoff

($Q_5 = 3$ cfs, $Q_{100} = 6$ cfs) sheet flows into the channel and then is routed south to Design Point 13, an on-line existing stock pond that was converted to an EDB to provide water quality for part of 4-Way Ranch Filing No. 1 and Waterbury Basins I, J & N. As mentioned above this online EDB is no longer considered a viable solution to treating for WQCV. Therefore, the UD-BMP Version 3.07 Runoff Reduction was used to show that this area can be treated using Runoff Reduction. The results show that we have a 100% WQCV reduction for Basin J as the entire acreage consists of Separate Pervious Area. The only developed land in Basin J is the rear 20' of the lot which consists of the rear setback where no structure can be built. A Drainage Easement is being place over these areas and will the area will be vegetated with the final GEC plan. The Preliminary Plan/PUD also places impervious restrictions on the rear yards of lots in this Basin area.

Design Point 11A is a point at the south end of the property used to show the total flow in the west channel. The total runoff ($Q_5 = 37$ cfs, $Q_{100} = 219$ cfs) from Basin J's area and Design Point 11 is used in modeling analysis of the stream in Hydraulic section below.

Basin N's 0.22 acres is comprised of the proposed extension of Gilbert Road form 4-Way Ranch into Waterbury. Runoff ($Q_5 = 1$ cfs, $Q_{100} = 1$ cfs) sheet flows into the channel and then is routed south to Design Point 13, an on-line existing stock pond that is being converted to an EDB to provide water quality for part of 4-Way Ranch Filing No. 1 and Waterbury Basins I, J & N. Once again, this online EDB is no longer considered a viable solution to treating for WQCV. Therefore, the UD-BMP Version 3.07 Runoff Reduction was used to show that this area can be treated using Runoff Reduction. The results show that we have a 100% WQCV reduction for Basin N. The Preliminary Plan/PUD also places impervious restrictions on this Basin area.

In the previously approved "Final Drainage Report for Waterbury Filing No. 1" by Classic Consulting it was stated that there were 3 Stormwater Quality Ponds that needed to be provided for the adjacent 4-Way Ranch per conditions set forth by the Board of County Commissioners at approval of the Waterbury PUD Development Plan. Because there have been no changes to the tributary areas to these 3 Ponds and they have already been designed and constructed. The original approved calculations and results can be found in the appendix of the original report by Classic Consulting along with the Basin Exhibit Map.

Basin M1's 0.99 acres is comprised of the rear yards & open space tract along Stapleton Drive along. Runoff ($Q_5 = 2$ cfs, $Q_{100} = 4$ cfs) sheet flows over the 20' back yard setback and open space tract onto Stapleton Drive and then is routed east via curb & gutter to an existing storm drain system from here it is routed to the eastern channel located in the Geick Ranch Basin. The UD-BMP Version 3.07 Runoff Reduction was used to show that this area has 100% WQCV reduction. The only developed land in Basin M1 is the rear 20' which consists of the rear setback where no structure can be built, as the entire acreage consists of Separate Pervious Area. A Drainage Easement is being place over these areas and will the area will be vegetated with the final GEC plan. The Preliminary Plan/PUD also places impervious restrictions on this Basin area.

Basin M2's 0.35 acres is comprised of the rear yards adjacent to undeveloped land east of the site. Runoff ($Q_5 = 1$ cfs, $Q_{100} = 2$ cfs) sheet flows from the back yard onto the undeveloped. This area is not treated for water quality but is pervious area. The UD-BMP Version 3.07 Runoff Reduction was used to show that this area has 100% WQCV reduction based upon the Unconnected Impervious Area being routed over the Receiving Pervious Area. Only developed land in Basin M2 is the rear 40' which 20' of that consists of the rear setback where no structure can be built. A Drainage Easement is being place over these areas and will the area will be vegetated with the final GEC plan. The Preliminary Plan/PUD also places impervious restrictions on this Basin area.

Basin P's 0.70 acres is comprised of open space Tract I adjacent to undeveloped land east of the site. Runoff ($Q_5 = 0$ cfs, $Q_{100} = 2$ cfs) sheet flows from the open space onto the undeveloped. This area is not treated for water quality but is pervious undeveloped area. The UD-BMP Version 3.07 Runoff Reduction was used to show that this area has 100% WQCV reduction based upon area being Separate Pervious Area.

Design Point 14 is a low point in the knuckle of Beech Creek Drive with a proposed public 10' CDOT TYPE R sump inlet. Runoff ($Q_5 = 6$ cfs, $Q_{100} = 13$ cfs) from Basin L1's 3.79 acres consisting of roadway and single-family lots is directed via side lot line swales and C&G to the proposed inlet. The 10' inlet captures all of the flow and Pipe run 11 a public 24" diameter RCP storm sewer routes the flow to a manhole junction with Pipe run 12.

Design Point 15 is a proposed public 5' CDOT TYPE R sump inlet opposite of DP 14 in Beech Creek Drive. Runoff ($Q_5 = 3$ cfs, $Q_{100} = 7$ cfs) from Basin L2's 2.00 acres consisting of roadway and single-family lots is directed via side lot line swales and C&G to the proposed inlet. The 5' inlet captures all of the flow and Pipe run 12 a public 24" diameter RCP storm sewer routes the flow to a manhole junction with Pipe run 11. Pipe run 13 a 30" RCP routes the combined flow ($Q_5 = 9$ cfs, $Q_{100} = 19$ cfs) of Pipe Runs 11 & 12 north in Beech Creek Drive to a manhole junction with Pipe run 14.

Design Point 16 is a proposed public 10' CDOT TYPE R sump inlet located in the proposed western half of the private street of Beech Creek Drive. Runoff ($Q_5 = 5$ cfs, $Q_{100} = 10$ cfs) from Basin O1's 2.82 acres consisting of roadway and single-family lots is directed via side lot line swales and C&G to the proposed inlet. The 5' inlet captures all of the flow and Pipe run 14 a public 30" diameter RCP storm sewer routes the flow to a manhole junction with Pipe run 13. Pipe run 15 a 30" RCP routes the combined flow ($Q_5 = 13$ cfs, $Q_{100} = 29$ cfs) of Pipe Runs 13 & 14 west to a manhole junction with Pipe run 16.

Design Point 17 is a proposed public 5' CDOT TYPE R sump inlet located opposite of DP 16 in Beech Creek Drive. Runoff ($Q_5 = 1$ cfs, $Q_{100} = 2$ cfs) from Basin O2's 0.71 acres consisting of roadway, parking, roof and landscape area sheet flows to the east flowline of Beech Creek Drive and to the proposed inlet. After all the flow is captured by the inlet Pipe run 16 routes the runoff to a junction with Pipe run 15. Pipe run 17 routes the combined flows ($Q_5 = 15$ cfs, $Q_{100} = 34$ cfs) of Pipe runs 15, 16, 39 & 40 and is routed west offsite via a private 36" diameter RCP to Design Point 18 a proposed private temporary EDB to be in place until future final design of a pond accommodates the new Waterbury development tributary to this pond. This is the FSD Pond 2.

Design Point 33 consists of 4-18" diameter area inlets located at the rear lot line in the downhill side yard swale. A 1' high berm along the back of Lots 46-49 in Basin O3's 0.45 acres will keep runoff ($Q_5 = 1$ cfs, $Q_{100} = 2$ cfs) from back yards and rear lot downspouts from sheet flowing into the existing wetlands untreated. Each area inlet can capture 1.40 cfs based upon a head of 0.25'. Therefore the 4 inlets can capture all of the flow. Pipe run 39 a 15" HDPE will route the captured flow to pipe run 17.

Design Point 34 consists of 3-18" diameter area inlets located at the rear lot line in the downhill side yard swale. A 1' high berm along the back of Lots 43-45 in Basin O4's 0.38 acres will keep runoff ($Q_5 = 1$ cfs, $Q_{100} = 2$ cfs) from back yards and rear lot downspouts from sheet flowing into the existing wetlands untreated. Each area inlet can capture 1.40 cfs based upon a head of 0.25'. Therefore the 3 inlets can capture all of the flow. Pipe run 40 a 15" HDPE will route the captured flow to pipe run 17.

Design Point 18 is a proposed temporary private Full Spectrum Detention Basin called FSD Pond 2. This pond will be replaced and resized when future filings to the east are final designed. There are no set time frames at this time to when the final design of the permanent pond will happen. Design Points 14-17 are routed to the pond and treated for Water Quality and Detention along with the Basin OS-4's 10.90 acres consisting of the EDB area and undeveloped upstream tributary area. Runoff ($Q_5 = 2$ cfs, $Q_{100} = 16$ cfs) from Basin OS-4 sheet flows into the EDB. The basins tributary to Design Point 18 are L1, L2, O1, O2 and OS-4 with a total area of 20.54 acres. The 100-year effective impervious area of 27.2% was calculated using UD-BMP Version 3.07 IRF spreadsheet. This information was entered into the UD-Detention_v4.03 spreadsheet and the calculation yielded a required a WQCV of 0.241 ac-ft, a EURV of 0.278 ac-ft and a 100-year detention total required volume of 1.027 ac-ft. The top of pond is set at 6906.00, with a bottom of pond at 6899.00. The pipes and swales to the pond discharge into a concrete forebay (3% WQCV see calcs in appendix) with 18" high walls and a 3" notch to release minor flows into 2' wide concrete tickle channel. The trickle channel directs runoff to the proposed concrete micro-pool at the surcharge elevation of 6899.33. The bottom of the micro-pool is set at 6896.50 and the top set at 6899.00. A proposed 4' x 4' grate set at 6902.15 on top of a concrete outlet box, an outlet plate on the front to meet the 3-orifice requirement and an 18" outlet pipe with no restrictor plate will route all runoff from the pond. The metal plate will have 1 column containing 3 rows of 1-5/16" diameter orifice holes spaced 12.4" apart starting at 6899.00. The WQCV release is 0.10 cfs with a ponding elevation of 6901.21 and takes 40 hours to release. The EURV release is 0.2 cfs, with an elevation of 6902.09 and takes 59 hours to release. The 100-year detention release is 15.1 cfs, with an elevation of 6902.71 and takes 58 hours to release. A 20' long riprap emergency spillway set at 6904.00 will allow the 100-year developed peak in flow ($Q_{100} = 29.30$ cfs) with a depth of 0.59' (top of water = 6904.59) to be routed west into the natural channel. 1.00' freeboard is provided (see appendix). The spillway and downhill slope will be armored with d50= VH 24" riprap. Pipe Run 17A a private 18" RCP will route the pond release into the

existing natural channel. (See Pond Calculations in appendix). When future filings are developed this temporary Pond 2 will be replaced with a permanent Pond as shown in the “Conceptual Drainage Report for Waterbury PUD Plan” prepared by Classic Consulting and dated November 2012.

For Design Points 19-25 this MDDP assumes the offsite basins upstream are fully developed with future Waterbury Filings.

Design Point 19 is a proposed 10' CDOT TYPE R sump inlet located in the south curb of Muddy Pond Street. Runoff ($Q_5 = 8$ cfs, $Q_{100} = 16$ cfs) from Basin OS-Q1's 4.31 acres consists of future single-family development and will be directed via lot line swales and c&g onto Basin Q1. Runoff ($Q_5 = 3$ cfs, $Q_{100} = 6$ cfs) from Basin Q1's 1.46 acres is directed to the 10' inlet. The combined flow ($Q_5 = 8$ cfs, $Q_{100} = 16$ cfs) is fully captured in the inlet and Pipe run 18 a 24" RCP diameter storm routes the flows to a manhole junction with Pipe run 19.

Design Point 20 is a proposed 5' CDOT TYPE R sump inlet located opposite of DP 19. Runoff ($Q_5 = 2$ cfs, $Q_{100} = 4$ cfs) from Basin OS-Q2's 0.96 acres consists of future single-family development and will be directed via lot line swales and c&g onto Basin Q2. Runoff ($Q_5 = 2$ cfs, $Q_{100} = 5$ cfs) from Basin Q2's 1.10 acres is directed to the 5' inlet. The combined flow ($Q_5 = 3$ cfs, $Q_{100} = 8$ cfs) is fully captured in the inlet and Pipe run 19 an 18" RCP diameter storm routes the flows to a manhole junction with Pipe run 18. Pipe Run 20 a 24" RCP storm routes the combined flow ($Q_5 = 10$ cfs, $Q_{100} = 22$ cfs) of Pipe runs 19 & 20 east down Muddy Pond Street to a manhole junction with Pipe run 21.

Design Point 21 is a proposed 10' CDOT TYPE R at-grade inlet located in the north curb of Muddy Pond Street just east of Masonboro Way intersection. Runoff ($Q_5 = 11$ cfs, $Q_{100} = 24$ cfs) from Basin OS-R's 6.05 acres consists of future single-family development and will be directed via lot line swales and c&g onto Basin R. Runoff ($Q_5 = 2$ cfs, $Q_{100} = 4$ cfs) from Basin R's 1.02 acres is directed to the 10' inlet. The combined flow ($Q_5 = 12$ cfs, $Q_{100} = 28$ cfs) is routed to the inlet at Design Point 21 and $Q_5 = 8$ cfs, $Q_{100} = 14$ cfs is captured by the at-grad inlet. The bypass flow ($Q_5 = 4$ cfs, $Q_{100} = 14$ cfs) at DP 21 travels in the north flow line of Muddy Pond Street to Design Point 22. Pipe run 21 an 18" RCP diameter storm routes the captured flow to a manhole junction with Pipe run 20. Pipe run 22 routes the combined flow ($Q_5 = 18$ cfs, $Q_{100} = 36$ cfs) of Pipe runs 20 & 21 east down Muddy Pond

Street to a manhole junction with Pipe run 25. The bypass flow ($Q_5 = 4$ cfs, $Q_{100} = 14$ cfs) at DP 21 travels in the north flow line of Muddy Pond Street to Design Point 22.

Design Point 22 is a proposed 10' CDOT TYPE R sump inlet located in the west curb of Megansett Wat. Runoff ($Q_5 = 8$ cfs, $Q_{100} = 18$ cfs) from Basin OS-S1's 5.59 acres consists of future single-family development and will be directed via lot line swales and c&g onto Basin S1. Runoff ($Q_5 = 3$ cfs, $Q_{100} = 7$ cfs) from Basin S1's 1.55 acres is directed to the 10' inlet. The combined flow ($Q_5 = 15$ cfs, $Q_{100} = 32$ cfs) of Basins OS-S1, S1 & the bypass flow from DP 21 is routed to the low point.

Design Point 23 is a proposed 10' CDOT TYPE R sump inlet located opposite of DP 22. Runoff ($Q_5 = 0$ cfs, $Q_{100} = 1$ cfs) from Basin OS-S2's 0.17 acres consists of future single-family development and will be directed via lot line swales and c&g onto Basin S2. Runoff ($Q_5 = 0$ cfs, $Q_{100} = 1$ cfs) from Basin S2's 0.13 acres is directed to the 10' inlet. The combined flow at DP 23 is $Q_5 = 1$ cfs, $Q_{100} = 1$ cfs. It is presumed that the combined flow ($Q_5 = 15$ cfs, $Q_{100} = 33$ cfs) at DP 22 & 23 is evenly split between the 2-10' CDOT TYPE R sump inlets. Pipe run 23 a 24" RCP diameter storm routes the flow ($Q_5 = 8$ cfs, $Q_{100} = 17$ cfs) from the inlet at DP 22 to a manhole junction with Pipe run 24. Pipe Run 24 a 24" RCP storm routes the flow ($Q_5 = 8$ cfs, $Q_{100} = 17$ cfs) to the manhole junction with Pipe run 23. Pipe Run 25 a 30" RCP routes the combined flow ($Q_5 = 15$ cfs, $Q_{100} = 33$ cfs) of Pipe runs 23 & 24 south to a manhole junction with Pipe run 22 in Muddy Pond Street. Pipe run 26 a 36" RCP then routes the combined flow ($Q_5 = 31$ cfs, $Q_{100} = 63$ cfs) of Pipe runs 22 & 25 east in Muddy Pond to a manhole junction with Pipe runs 27 & 28.

Design Point 24 is a proposed 5' CDOT TYPE R sump inlet located in the south curb of Muddy Pond Street. Runoff ($Q_5 = 3$ cfs, $Q_{100} = 6$ cfs) from Basin T1's 1.42 acres consists of single-family development and will be directed via lot line swales and c&g to the 5' inlet. Pipe run 27 an 18" RCP diameter storm routes the fully captured flow from the inlet to a manhole junction with Pipe runs 26 & 28.

Design Point 25 is a proposed 5' CDOT TYPE R sump inlet located opposite of DP 24. Runoff ($Q_5 = 1$ cfs, $Q_{100} = 3$ cfs) from Basin OS-T2's 0.76 acres consists of future single-family development and will be directed via lot line swales and c&g onto Basin T2. Runoff ($Q_5 = 2$ cfs, $Q_{100} = 5$ cfs) from

Basin T2's 1.23 acres is directed to the 5' inlet. The combined flow at DP 25 is $Q_5 = 3$ cfs, $Q_{100} = 7$ cfs. Pipe run 28 an 18" RCP diameter storm routes the fully captured flow from the inlet to a manhole junction with Pipe runs 26 & 27. Pipe run 29 a 36" RCP then routes the combined flow ($Q_5 = 36$ cfs, $Q_{100} = 73$ cfs) of Pipe runs 26, 27 & 28 east in Muddy Pond Street and then south down Fish Camp Circle to a manhole junction with Pipe run 30.

Design Point 26 is a proposed 10' CDOT TYPE R sump inlet located in the west curb of Fish Camp Circle near the Knuckle. Runoff ($Q_5 = 7$ cfs, $Q_{100} = 16$ cfs) from Basin U1's 4.38 acres consists of single-family development and will be directed via lot line swales and c&g to the 10' inlet. Pipe run 30 a 24" RCP diameter storm routes the fully captured flow from the inlet to a manhole junction with Pipe run 29. Pipe run 31 a 42" RCP transports the combined flow ($Q_5 = 41$ cfs, $Q_{100} = 86$ cfs) of Pipe runs 29 & 30.

Design Point 27 is a proposed 5' CDOT TYPE R sump inlet located opposite of DP 26. Runoff ($Q_5 = 3$ cfs, $Q_{100} = 7$ cfs) from Basin U2's 1.89 acres consists of future single-family development and will be directed via lot line swales to the 5' inlet. Pipe run 32 an 18" RCP diameter storm routes the fully captured flow from the inlet to a manhole junction with Pipe runs 31.

Design Point 28 are 2 proposed 10' CDOT TYPE R sump inlets located in the north and south curb of Sunken Meadow Road. These inlets are offsite in a future phase and will be built within a proposed drainage easement. The offsite curb and gutter in this area will also need to be built along with some asphalt to direct runoff to the 10' inlet. Runoff ($Q_5 = 8$ cfs, $Q_{100} = 18$ cfs) from Basin W's 5.20 acres is assumed to be evenly split between the 2 inlets and fully captured by them. Pipe run 34 a 24" RCP routes the captured runoff ($Q_5 = 4$ cfs, $Q_{100} = 9$ cfs) from the south inlet to the north inlet. Pipe run 34A a 30" RCP routes the combined flow from Design Points 28 & 32, described below via Pipe run 34A a 30" RCP.

Design Point 31 consists of 3-18" diameter area inlets located at the rear lot line in the downhill side yard swale. A 1' high berm along the back of Lots 90-92 in Basin V's 0.54 acres will keep runoff ($Q_5 = 1$ cfs, $Q_{100} = 3$ cfs) from back yards and rear lot downspouts from sheet flowing into the existing wetlands untreated. Each area inlet can capture 1.40 cfs based upon a head of 0.25'. Therefore the 3

inlets can capture all of the flow. Pipe run 37 a 15" HDPE will route the captured flow to pipe run 33. Pipe run 33 a 42" RCP then routes the combined flow ($Q_5 = 44$ cfs, $Q_{100} = 92$ cfs) of Pipe runs 31, 32 & 37 east through a Drainage Tract to FSD Pond 3.

Design Point 32 consists of 2-18" diameter area inlets located at the rear lot line in the downhill side yard swale. A 1' high berm along the back of Lots 88-89 in Basin X's 0.43 acres will keep runoff ($Q_5 = 1$ cfs, $Q_{100} = 2$ cfs) from back yards and rear lot downspouts from sheet flowing into the existing wetlands untreated. Each area inlet can capture 1.40 cfs based upon a head of 0.25'. Therefore the 2 inlets can capture all of the flow. Pipe run 38 a 15" HDPE will route the fully captured flow to Design point 28. Pipe run 34 a 30" RCP will route the combined flow ($Q_5 = 9$ cfs, $Q_{100} = 20$ cfs) of Design Point 28 and Pipe run 32 to FSD Pond 3.

The following Basins are for future Waterbury Filings to the north and east that will be tributary to FSD Pond 3. All the basin descriptions are the same, they are comprised of future single-family development and will be directed via lot line swales and c&g to future storm drain systems the future drain systems will be routed to FSD Pond 3. The exact routes and design have not been finalized at this time but will be with a future Final Drainage Report at the time of development. Below is the summary of the flow and acreage.

Basin OS-1: 11.81 acres, Runoff ($Q_5 = 18$ cfs, $Q_{100} = 41$ cfs)

Basin OS-2: 11.53 acres Runoff ($Q_5 = 16$ cfs, $Q_{100} = 36$ cfs)

Basin OS-3A: 0.79 acres Runoff ($Q_5 = 1$ cfs, $Q_{100} = 3$ cfs)

Basin OS-3B: 5.66 acres Runoff ($Q_5 = 9$ cfs, $Q_{100} = 20$ cfs)

As mentioned above Design Point 9 is an existing 36" CMP culvert under Eastonville Road where Offsite Basin OS-9 discharges onto Offsite Basin OS-2. Runoff ($Q_5 = 8$ cfs, $Q_{100} = 19$ cfs) from Basin OS-9's 11.80 acres consists of historic flow based upon upstream detention. Runoff will be directed through the future Waterbury filings and into FSD Pond 3.

Design Point 29 is a proposed private Full Spectrum Detention Basin called FSD Pond 3. Design Points 19-28 and Offsite Basins OS-1, OS-2, OS-3A, OS-3B, & OS-9 along with Basin OS-7's 2.82

acres consisting of the EDB area. Runoff ($Q_5 = 1$ cfs, $Q_{100} = 9$ cfs) sheet flows into the EDB with a total area of 82.02 acres routed to the pond and treated for Water Quality and Detention. The 100-year effective impervious area of 49.3% was calculated using UD-BMP Version 3.07 IRF spreadsheet. This information was entered into the UD-Detention_v4.03 spreadsheet and the calculation yielded a required a WQCV of 1.398 ac-ft, a EURV of 3.231 ac-ft and a 100-year total required detention volume of 7.398 ac-ft. The top of pond is set at 6930.00, with a bottom of pond at 6922.00. The pipes and swales to the pond discharge into a concrete forebay (3% WQCV see calcs in appendix) with 18" high walls and a 3" notch to release minor flows into 2' wide concrete tickle channel. The trickle channel directs runoff to the proposed concrete micro-pool at the surcharge elevation of 6922.33. The bottom of the micro-pool is set at 6919.50 and the top set at 6922.00. A proposed 10' x 4' grate set at 6926.84 on top of a concrete outlet box, an outlet plate on the front to meet the 3-orifice requirement and a 36" outlet pipe with a restrictor plate set 26.10" above the invert will route all runoff from the pond. The metal plate will have 1 column containing 3 rows of 2.62" x 2.62" orifice holes spaced 19.4" apart starting at 6922.00. The WQCV release is 0.70 cfs with a ponding elevation of 6925.04 and takes 40 hours to release. The EURV release is 1.2 cfs, with an elevation of 6926.84 and takes 78 hours to release. The 100-year detention release is 58.0 cfs, with an elevation of 6927.93 and takes 79 hours to release. A 80' long riprap emergency spillway set at 6928.10 will allow the 100-year developed peak in flow ($Q_{100} = 247.2$ cfs) with a depth of 0.99' (top of water = 6928.98) to be routed west into the natural channel. 0.91' freeboard is provided (see appendix). The spillway and downhill slope will be armored with d50= VH 24" riprap. Pipe Run 35 a private 36" RCP will route the pond release into the existing natural channel. (See Pond Calculations in appendix).

Design Point 30 is a triple 36" RCP culvert crossing under Sunken Meadow Road. Offsite Basin OS-10's 3.41 acres consists of open space containing the natural channel. Runoff ($Q_5 = 1$ cfs, $Q_{100} = 8$ cfs) is directed south through the wetlands to the culverts. Basin V's 0.54 acres is comprised of open space tracts adjacent to the existing natural channel along the west side of the site to avoid disturbing wetlands. Runoff ($Q_5 = 1$ cfs, $Q_{100} = 3$ cfs) sheet flows from the back yard onto the undeveloped area. This area is not treated for water quality but per the UD-BMP Version 3.07 Runoff Reduction spreadsheet shows that this area has 100% WQCV reduction based upon the Unconnected Impervious Area being routed over the Receiving Pervious Area. The combined flow ($Q_5 = 2$ cfs, $Q_{100} = 9$ cfs)

at DP 30 does not warrant the triple 36" RCP culverts alone but in case of failure in the Pond 3 outlet runoff from the emergency spillway ($Q_{100} = 204$ cfs) will be safely routed through the triple 36" RCP culverts (See appendix).

HYDRAULIC ANALYSIS

MAJOR DRAINAGEWAYS

As mentioned above there are 2 major drainage ways on the east and west side of the site. In the previously approved "Final Drainage Report for Waterbury Filing 1" dated September 2016 prepared by Classic Consulting Engineering & Surveying the floodplain along the west side of the site was determined by Kiowa Engineering in a 2004 LOMR (04-08-0012) using a HEC-RAS analysis modeling developed flows along the channel from the 3-42" culverts under Eastonville Road south to the existing stock pond (Design Point 13) south of Stapleton Drive with proposed and existing improvements such as the proposed 42" dual culverts located at the Gilbert Road crossing and existing dual 4' x 8' box culverts at Stapleton Drive. Terra Nova engineering has done a new HEC-RAS study for the floodplain to establish base flood elevations (see appendix for HEC-RAS model). These channels will be contained in proposed Tracts dedicated to drainage that will allow the 4-Way Ranch Metro District to provide maintenance.

As part of the revised Preliminary Plan submittal for the site revisions an analysis of the eastern channel by ECO Systems found that this drainage channel is a jurisdictional water of the U.S. with associated jurisdictional wetland habitat. Therefore, to comply with Section+ 404 of the Clean Water Act, we must meet the 404(b)(1) project review criteria, which include impact avoidance and minimization. The option the client plan to take is to minimize Project-wide impacts to 0.5-acre or less such that the pre-approved Nationwide Permits (NWP) may be used. No channel grading or redesign is proposed for the channels; with the exception of the Sunken Meadow Crossing where 3-36" culverts are being placed. The rest of the channel is to remain natural.

For the analysis of the channels the Manning's Roughness Coefficients were selected based upon site visits and using tables 10.1 and 10.2 provided in the El Paso County Drainage Criteria Manual Volume 1. Both channels have a very substantial amount of vegetative cover and doesn't show any signs of erosion. With the significant vegetive cover the Retardance Class ranges from Class A to

Class C. Based upon the SCS Retardance Class of Vegetal Retardance Curve See Table 8.9 and eq. 8.32 in appendix the values for allowable shear stress are now Class A: 10.0 lb/sq ft, Class B: 7.64 lb/sq ft and Class C 5.60 lb/sq ft.

A HEC-RAS analysis was done of the east channel using the existing topo and the proposed contours sampled from these AutoCAD files along with the developed 100-year flow of 120 cfs. This flow is the taken from the Preliminary Drainage report calculations shown below and is the biggest flow the channel will see once development starts. This happens after development of Filings 1 & 2 and before there is development upstream in the future phases where onsite storm will route most flows in storm drain to detention/water quality ponds and not in the existing channel. The flow in the future fully developed condition is only 9 cfs (Design Point 30 MDDP Calcs) from cross sections 2010.09 to 1200. While from cross sections 1000 to 400, 67 cfs is the flow (Design Point 30A MDDP Calcs). These may change in the future based upon the final design upstream. The 100-Y-HWL and finished floor lot elevations shown on the HECRAS exhibit are based upon the 120 cfs. The output information shows that the channel velocities are in the range of 0.44 fps to 4.08 fps. This is below the suggested velocities of 5 fps from the DCM Manual Chapter 10 for 100-year event. The Froude # vary from 0.05 to 0.78. The shear stress varies from 0.01 to 3.04 lbs/q ft, which is well under the above-mentioned limits. As mentioned above this is an existing channel that is not being altered with the exception of the road crossing with the 3-36" culverts. This channel also contains wetlands that we should avoid disturbing as the HECRAS results show that the channel is stable as is, with no needed improvements. At Cross-section 1200 just upstream of the culvert crossing is shown as critical flow and but the velocity is 0.48 fps, the Froude number is 0.05 and the shear stress is 0.02 lbs/sq ft, all below the requirements. There is proposed Type M d50=12" riprap with a bury depth of 24" just downstream of the cross section 1200 as shown on the construction drawings and this will help to stabilize the channel in the only on-site cross section shown to be critical. Cross section 400 which is downstream of our site on property owned by someone else is also critical. This area is within a wetland area and on property the owner does not have access to. We have a velocity of 2.62 fps, the Froude # is 0.39 and the shear stress is 1.13 lbs/sq ft, all below the requirements, so we respectfully request that we leave it as is and no stabilization occur for this section. The 4-Way Ranch Metro District will provide maintenance on the channel using access from the end of the Public ROW of Sunken Meadow Road and Muddy Pond Street. There is also access for maintenance end of the

temporary turnaround at the end of Sunken Meadow.

A HEC-RAS analysis was done of the West channel using the existing topo and the proposed contours sampled from these AutoCAD files. The developed 100-year flow of 216 cfs was used for cross sections 2500 to the proposed 42" dual culvert cross section at 1042.5. From cross section 900 to 100, 220 cfs was entered into the program. These flows are based upon the MDDP drainage calculations for Design Points 11 & 11A respectively. The output information shows that the channel velocities are in the range of 0.60 fps to 4.88 fps. This is below the suggested velocities of 5 fps from the DCM Manual Chapter 10 for 100-year event. The Froude # vary from 0.05 to 1.00. There are 2 locations where the Froude # is above the 0.90 maximum. The first one is at the section 1420 just upstream of the drop structure. We are adding selective riprap bank stabilization from section 1500 to section 1380. The second section is at 100, which is the last station in the HECRAS model and is always critical due to not having a downstream station to run the analysis. The shear stress varies from 0.04 to 7.46 lbs/sq ft, which is under the above-mentioned limits for Class B Retardance. The velocity at Cross-section 1200 just upstream of the culvert crossing is 0.52 fps, the Froude # is 0.05 and the shear stress is 0.01 lbs/sq ft. This shows that the crossing is not detrimental to the channel. There are 5 critical water surface sections listed in the HECRAS table, Sections 1500, 1420, 1200, 200, & 100. A drop structure has been added at Section 1400 to shallow out the channel slope. The velocity at section 1500 is 2.05 fps and at section 1420 is 4.00 fps, both below erosive velocities. As mentioned above we are adding selective riprap bank stabilization in these areas. At section 1200 the velocity is 0.60 fps, the Froude # is 0.05 and the shear stress is 0.04 lbs/sq ft. This demonstrates that this section will be stable in the 100-Y event and no alternate stabilization is needed. Section 200 has established cattails that help to keep the channel stabilized, a velocity of 1.99 fps, a shear of 1.03 lbs/sq ft & a Froude # of 0.31 indicating that the channel is stable. Section 100 is the last station which is always critical due to no downstream section to properly run calculations in HECRAS analysis. The 4-Way Ranch Metro District will provide maintenance on the channel using access from the Public ROW of the abutting Thatcher Court, Gilbert Drive and Stapleton Drive. The Hausemen Easement is also being used to gain access from Bandenero Drive

The 100-year high water elevations and limits for the east and west channels were checked against the adjacent proposed lots and the finished grade. All lot grades are set above the adjacent 100-year

highwater elevation by 1 foot on the Preliminary Plan /PUD. The lots along the east and west channel are all set out side of the FEMA Floodplain and the calculated 100-year high water elevations and limits.

HYDROLOGIC ANALYSIS FOR FILING 1 & 2 PDR

PROPOSED BASIN DESCRIPTION (FOR PDR)

The development of the overall Waterbury site will occur in several platting phases. With the design of Waterbury Filings 1 & 2 the site will have an interim condition where the area to the north will be unplatted natural open space with drainage patterns differing from the future full build out analysis in the MDDP section until such time that it is developed. Below is a description of the Design Points and the overall proposed drainage characteristics for the development of only Waterbury Filing 1 & 2. Design Points 1-18 do not have any changes to them from the description above in the MDDP section therefore these basins will not be described below. The following is a description of the Design Points 19-30 altered by the interim state of undeveloped land upstream. In all cases the design flow is less than the ultimate build-out and therefore the inlets and pipes can capture and route the flow safely

Design Point 19 is a proposed 10' CDOT TYPE R sump inlet located in the south curb of Muddy Pond Street. Runoff ($Q_5 = 0$ cfs, $Q_{100} = 1$ cfs) from Basin OS-Q1's 0.33 acres consists of undeveloped land and will sheet flow onto Basin Q1. Runoff ($Q_5 = 3$ cfs, $Q_{100} = 6$ cfs) from Basin Q1's 1.48 acres is directed to the 8' inlet. The combined flow ($Q_5 = 3$ cfs, $Q_{100} = 6$ cfs) is captured in the inlet and Pipe run 18 a 24" RCP diameter storm routes the flows to a manhole junction with Pipe run 19.

Design Point 20 is a proposed 5' CDOT TYPE R sump inlet located opposite of DP 19. Runoff ($Q_5 = 0$ cfs, $Q_{100} = 1$ cfs) from Basin OS-Q2's 0.22 acres consists of undeveloped land and will sheet flow onto Basin Q2. Runoff ($Q_5 = 2$ cfs, $Q_{100} = 4$ cfs) from Basin Q2's 0.96 acres is directed to the 4' inlet. The combined flow ($Q_5 = 2$ cfs, $Q_{100} = 5$ cfs) is fully captured in the inlet and Pipe run 19 an 18" RCP diameter storm routes the flows to a manhole junction with Pipe run 18. Pipe Run 20 a 24" RCP storm routes the combined flow ($Q_5 = 4$ cfs, $Q_{100} = 10$ cfs) of Pipe runs 19 & 20 east down Muddy Pond Street to a manhole junction with Pipe run 21.

Design Point 21 is a proposed 10' CDOT TYPE R at-grade inlet located in the north curb of Muddy Pond Street just east of Masonboro Way intersection. Runoff ($Q_5 = 0$ cfs, $Q_{100} = 2$ cfs) from Basin OS-R's 1.04 acres consists of undeveloped land and will sheet flow onto Basin R. Runoff ($Q_5 = 2$ cfs, $Q_{100} = 4$ cfs) from Basin R's 1.02 acres is directed to the 10' inlet. The combined flow ($Q_5 = 2$ cfs, $Q_{100} = 6$ cfs) is routed to the inlet and the flow is fully captured. Pipe run 21 an 18" RCP diameter storm routes the captured flow to a manhole junction with Pipe run 20. Pipe run 22 routes the combined flow ($Q_5 = 6$ cfs, $Q_{100} = 16$ cfs) of Pipe runs 20 & 21 east down Muddy Pond Street to a manhole junction with Pipe run 25. The bypass flow ($Q_5 = 0$ cfs, $Q_{100} = 1$ cfs) at DP 21 travels in the north flow line of Muddy Pond Street to Design Point 22.

Design Point 22 is a proposed 10' CDOT TYPE R sump inlet located in the west curb of Megansett Way. Runoff ($Q_5 = 0$ cfs, $Q_{100} = 1$ cfs) from Basin OS-S1's 0.31 acres consists of undeveloped land and will sheet flow onto Basin S1. Runoff ($Q_5 = 3$ cfs, $Q_{100} = 7$ cfs) from Basin S1's 1.55 acres is directed to the 10' inlet. The combined flow ($Q_5 = 3$ cfs, $Q_{100} = 7$ cfs) of Basins OS-S1 & S1 is routed via Pipe run 23 to a junction with Pipe run 24.

Design Point 23 is a proposed 10' CDOT TYPE R sump inlet located opposite of DP 22. Runoff ($Q_5 = 0$ cfs, $Q_{100} = 0$ cfs) from Basin OS-S2's 0.13 acres consists of future single-family development and will be directed via lot line swales and c&g onto Basin S2. Runoff ($Q_5 = 0$ cfs, $Q_{100} = 1$ cfs) from Basin S2's 0.13 acres is directed to the 10' inlet. The combined flow at DP 23 is $Q_5 = 0$ cfs, $Q_{100} = 1$ cfs. Pipe run 24 a 24" RCP diameter storm routes the flow ($Q_5 = 0$ cfs, $Q_{100} = 1$ cfs) from the inlet at DP 22 to a manhole junction with Pipe run 23. Pipe Run 25 a 30" RCP routes the combined flow ($Q_5 = 3$ cfs, $Q_{100} = 7$ cfs) of Pipe runs 23 & 24 south to a manhole junction with Pipe run 22 in Muddy Pond Street. Pipe run 26 a 36" RCP then routes the combined flow ($Q_5 = 9$ cfs, $Q_{100} = 23$ cfs) of Pipe runs 22 & 25 east in Muddy Pond to a manhole junction with Pipe runs 27 & 28.

Design Point 24 is a proposed 5' CDOT TYPE R sump inlet located in the south curb of Muddy Pond Street. Runoff ($Q_5 = 3$ cfs, $Q_{100} = 6$ cfs) from Basin T1's 1.42 acres consists of single-family development and will be directed via lot line swales and c&g to the 5' inlet. Pipe run 27 an 18" RCP diameter storm routes the flow from the inlet to a manhole junction with Pipe runs 26 & 28.

Design Point 25 is a proposed 5' CDOT TYPE R sump inlet located opposite of DP 24. Runoff ($Q_5 = 0$ cfs, $Q_{100} = 1$ cfs) from Basin OS-T2's 0.30 acres consists of future single-family development and will be directed via lot line swales and c&g onto Basin T2. Runoff ($Q_5 = 2$ cfs, $Q_{100} = 5$ cfs) from Basin T2's 1.23 acres is directed to the 4' inlet. The combined flow at DP 25 is $Q_5 = 2$ cfs, $Q_{100} = 5$ cfs. Pipe run 28 an 18" RCP diameter storm routes the flow from the inlet to a manhole junction with Pipe runs 27 & 28. Pipe run 29 a 36" RCP then routes the combined flow ($Q_5 = 13$ cfs, $Q_{100} = 34$ cfs) of Pipe runs 26, 27 & 28 east in Muddy Pond Street and then south down Fish Camp Circle to a manhole junction with Pipe run 30.

Design Point 26 is a proposed 10' CDOT TYPE R sump inlet located in the west curb of Fish Camp Circle near the Knuckle. Runoff ($Q_5 = 7$ cfs, $Q_{100} = 16$ cfs) from Basin U1's 4.38 acres consists of single-family development and will be directed via lot line swales and c&g to the 10' inlet. Pipe run 30 a 24" RCP diameter storm routes the flow from the inlet to a manhole junction with Pipe run 29. Pipe run 31 a 42" RCP transports the combined flow ($Q_5 = 20$ cfs, $Q_{100} = 48$ cfs) of Pipe runs 29 & 30.

Design Point 27 is a proposed 5' CDOT TYPE R sump inlet located opposite of DP 26. Runoff ($Q_5 = 3$ cfs, $Q_{100} = 7$ cfs) from Basin U2's 1.89 acres consists of future single-family development and will be directed via lot line swales to the 6' inlet. Pipe run 32 an 18" RCP diameter storm routes the flow from the inlet to a manhole junction with Pipe runs 31. Pipe run 33 a 42" RCP then routes the combined flow ($Q_5 = 24$ cfs, $Q_{100} = 57$ cfs) of Pipe runs 31 & 32 east through a Drainage Tract to FSD Pond 3.

Design Point E-E is a proposed 4' wide swale, 2' deep with 4:1 side slopes. Offsite Basin OS-8's 2.56 acres flow ($Q_5 = 5$ cfs, $Q_{100} = 11$ cfs) under Eastonville Road via a 36" CMP culvert onto Basin OS-2. Offsite Basin OS-2's 12.02 undeveloped acres flow ($Q_5 = 3$ cfs, $Q_{100} = 23$ cfs) south into the existing stock pond. The combined flow ($Q_5 = 8$ cfs, $Q_{100} = 33$ cfs) of the 2 basins will be routed overland in a proposed Diversion Swale E-E north of the Filing 2 Boundary to the existing channel that runs along the eastern boundary, while keeping it from entering the proposed development. The swale is a 8' wide bottom 2' deep swale with 5:1 side slopes set in a proposed Drainage Easement.

This followed the guideline set forth in MHFD chapter 8 design criteria for stabilized swales. The 100-Y highwater depth in the swale is 0.72' (See Appendix for calcs). This swale has velocities of 4.00 fps for a grassed water way. This is below the allowable 5 fps. It is recommended that the swale be Permanently Seeded and mulched once installed in the Initial Phase of grading to establish a dense grass bottom and side slopes. The swale will be maintained the 4-Way Ranch Metro District based upon the recommendations in the Operations and Maintenance Manual. Access to maintain the swale can be made from the temporary turnarounds at the end of Megansett Way and Masonboro Way.

Design Point 30 is a triple 36" RCP culvert crossing under Sunken Meadow Road. Offsite Basin OS-9 discharges onto Offsite Basin OS-1. Runoff ($Q_5 = 8$ cfs, $Q_{100} = 19$ cfs) from Basin OS-9's 11.80 acres consists of historic flow based upon upstream detention. Offsite Basin OS-1's 41.09 acres consists of undeveloped land and open space containing the natural channel. Runoff ($Q_5 = 11$ cfs, $Q_{100} = 73$ cfs) from Basin OS-1 is directed south through the wetlands to the culverts. Basin Y's 0.35 acres is comprised of undeveloped open space Tracts adjacent to the existing natural channel along the east side of the site. Runoff ($Q_5 = 1$ cfs, $Q_{100} = 2$ cfs) from Basin Y sheet flows east into the channel. This area is not treated for water quality but is accounted for using Runoff Reduction as mentioned in the MDDP discussion mentioned above. Also entering the channel is the runoff from Diversion Swale E-E that routes Basin OS-2's mentioned above. The combined flow ($Q_5 = 36$ cfs, $Q_{100} = 120$ cfs) at DP 30 of Basins OS-1, OS-2, OS-8, OS-9, & Y will be safely routed through the triple 36" RCP culverts (See appendix).

The above Design point and Basin description shows that in the interim condition all runoff can be safely routed through the proposed storms drain system.

In an effort to protect receiving water and as part of the "four step process to minimize adverse impacts of urbanization" this site was analyzed in the following manner:

1. Reduce Runoff- The proposed impervious areas on the site are surrounded by landscaping and green space areas. Additionally, the new improvements and impervious areas on the site will be routed to a proposed private Extended Detention Basin. These items will reduce the volume of runoff using ponding and infiltration.
2. Stabilize Drainageways- There are 2 existing drainageways onsite. The westerly channel has

been studied in HEC-RAS model and based upon calculations velocities are within the range for stabilized flow. The easterly channel has wetlands that allow the channel to stay stabilized.

3. Provide Water Quality Capture Volume (WQCV)- The 6 Extended Detention Basin have been sized and designed to sufficiently capture the required WQCV and slowly release it through the three-hole outlet, thereby allowing solids and contaminants to settle out.
4. Consider Need for Industrial and Commercial BMPs- The proposed development is single family site; therefore, no Industrial and Commercial BMPs have been proposed.

DRAINAGE FEES

This site lies within the Haegler Ranch Drainage Basin Diversion and Geick Ranch Basin. There is no approved Drainage Basin Planning study on file done with fees for Geick Ranch Basin. At the time of the Final Drainage Report Basin fee calculations will not need to be paid for the portion in the Haegler Ranch Basin.

SUMMARY

Site runoff and storm drain and appurtenances associated with the development of the Waterbury Filing No. 1 & 2 site will not adversely affect the surrounding and downstream developments. Runoff will be routed to the existing and proposed detention basins and reduce the runoff to be at or below historic rates mentioned above in the report via Full Spectrum Detention while slowly treating the water quality capture volume and in turn helping to stabilize the downstream channel banks. Terra Nova Engineering requests that this report satisfy the submittal requirements for the drainage analysis for Waterbury. This report and findings are in general conformance with all previously approved reports for this site.

PREPARED BY:
TERRA NOVA ENGINEERING, INC.

Quentin N. Armijo, P.E.
Vice President

Jobs/1717.00/drainage/1715.00 MMDP-FDR 1-2

BIBLIOGRAPHY

“City of Colorado Springs Drainage Criteria Manual Volume 1”, approved May 2014 and prepared by City of Colorado Springs

“Drainage Criteria Manual County of El Paso, Colorado Volume 1” approved October 2018 and prepared by El Paso County

“Drainage Criteria Manual County of El Paso, Colorado Volume 2” approved October 2018 and prepared by El Paso County

“Drainage Criteria Manual County of El Paso, Colorado Volume 1 update Chapter 6” approved October 2018 and prepared by El Paso County

“El Paso County Stormwater Drainage Facilities Maintenance Policy” approved October 2018 and prepared by El Paso County

NRCS Soils Map for El Paso County

“Revision to the MDDP for Meridian Ranch, EL Paso County, Colorado”, approved October 2005, and prepared by PBS&J

“Final Drainage Report for 4-Way Ranch Phase 1” approved March 2006 prepared by JR Engineering

The “Geick Ranch Drainage Basin Planning Study” approved February 2008, preprepared by Drexel Barrel & Co

“Preliminary/Final Drainage Report for Meridian Ranch filing No. 3” approved November 2011 prepared by Tech Contractors


“Master Development Drainage Plan, 4-Way Ranch – Phase 1” approved January 2012 prepared by Advanced Design Professionals, Inc.

“Preliminary Drainage Report for Waterbury (Phase 1 Preliminary Plan) approved June 2013 prepared by Classic Consulting


“Final Drainage Report for Waterbury Filing No. 1” approved September 2016 prepared by Classic Consulting

APPENDIX


VICINTY MAP

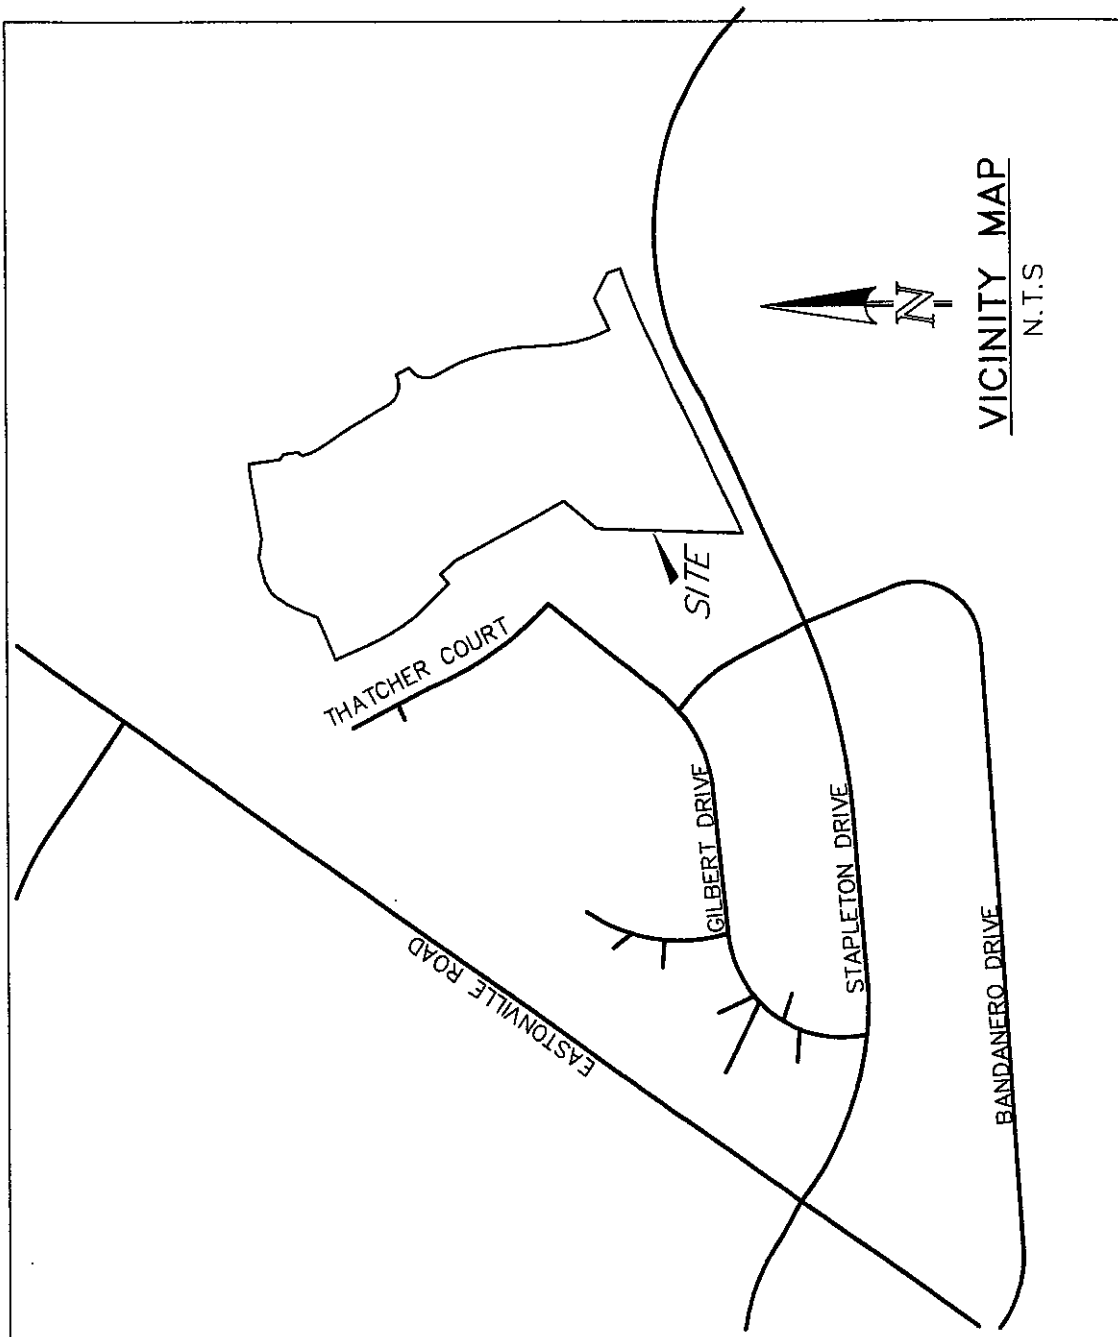


NRCS SOILS MAP

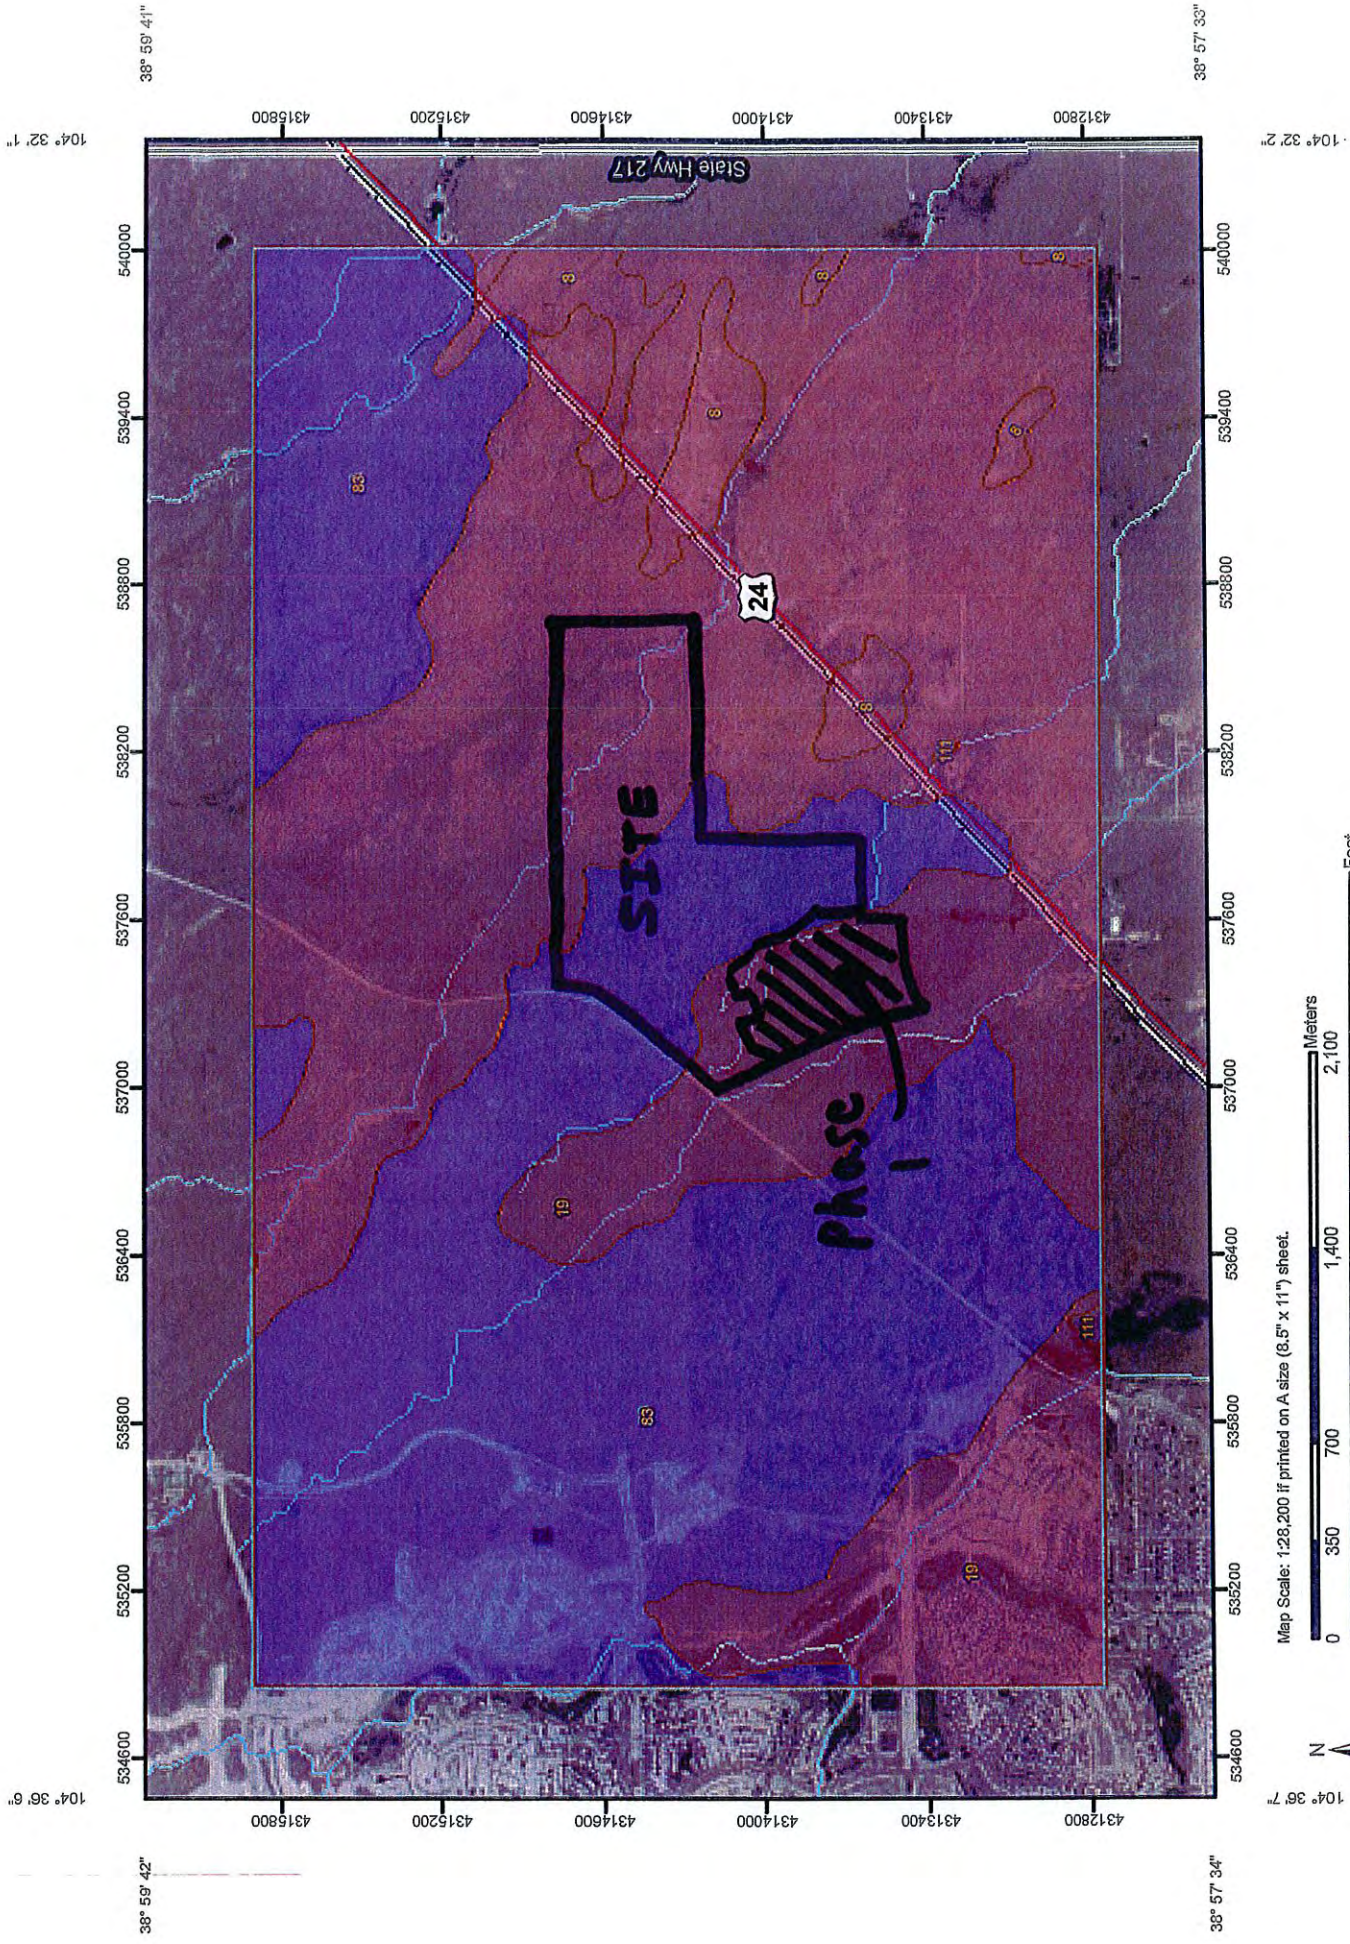

Map Scale: 1:28,200 If printed on A size (8.5" x 11") sheet.



MAP LEGEND

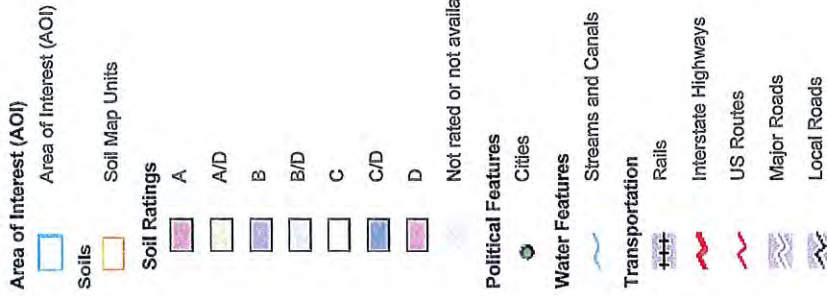

MAP INFORMATION

Map Scale: 1:28,200 if printed on A size (8.5" x 11") sheet.

The soil surveys that comprise your AOI were mapped at 1:24,000. Please rely on the bar scale on each map sheet for accurate map measurements.

Source of Map: Natural Resources Conservation Service
Web Soil Survey URL: <http://websoilsurvey.nrcs.usda.gov>
Coordinate System: UTM Zone 13N NAD83

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado
Survey Area Data: Version 8, Apr 6, 2011

Date(s) aerial images were photographed: 7/29/2005; 8/17/2005; 7/2/2005

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Hydrologic Soil Group

Hydrologic Soil Group— Summary by Map Unit — El Paso County Area, Colorado (CO625)				
Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
8	Blakeland loamy sand, 1 to 9 percent slopes	A	155.7	3.9%
19	Columbine gravelly sandy loam, 0 to 3 percent slopes	A	2,095.1	52.1%
83	Stapleton sandy loam, 3 to 8 percent slopes	B	1,768.2	44.0%
111	Water		3.8	0.1%
Totals for Area of Interest			4,022.9	100.0%

Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.


If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

FEMA FIRM MAP

National Flood Hazard Layer FIRMMette



104°34'31"W 38°58'31"N

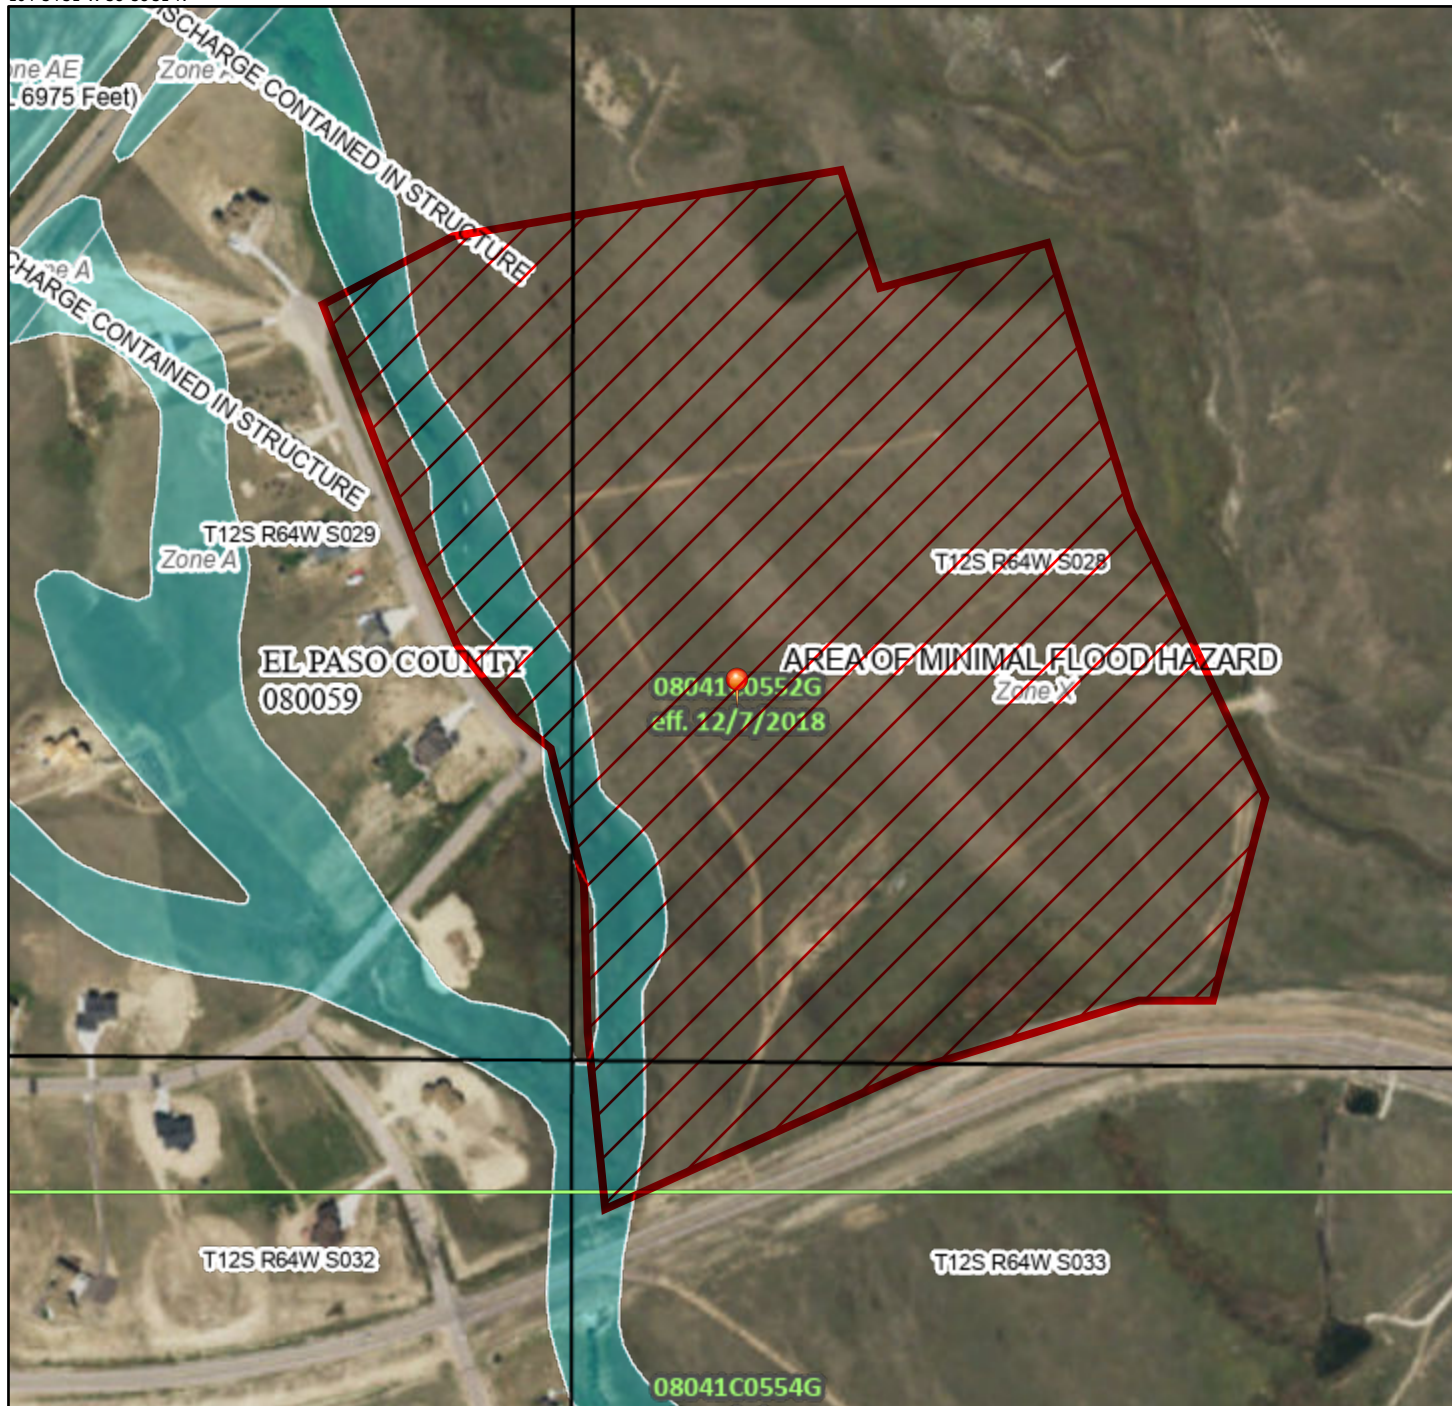

0 250 500 1,000 1,500 2,000 Feet

1:6,000

104°33'53"W 38°58'3"N

Basemap: USGS National Map: Orthoimagery: Data refreshed October, 2020

Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

SPECIAL FLOOD HAZARD AREAS		Without Base Flood Elevation (BFE) Zone A, V, A99
		With BFE or Depth Zone AE, AO, AH, VE, AR
		Regulatory Floodway
OTHER AREAS OF FLOOD HAZARD		0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile Zone X
		Future Conditions 1% Annual Chance Flood Hazard Zone X
		Area with Reduced Flood Risk due to Levee. See Notes. Zone X
		Area with Flood Risk due to Levee Zone D
OTHER AREAS		NO SCREEN Area of Minimal Flood Hazard Zone X
		Effective LOMRs
GENERAL STRUCTURES		Area of Undetermined Flood Hazard Zone D
		Channel, Culvert, or Storm Sewer
		Levee, Dike, or Floodwall
OTHER FEATURES		20.2 Cross Sections with 1% Annual Chance Water Surface Elevation
		17.5 Cross Sections with 1% Annual Chance Water Surface Elevation
		Coastal Transect
		Base Flood Elevation Line (BFE)
		Limit of Study
		Jurisdiction Boundary
MAP PANELS		Coastal Transect Baseline
		Profile Baseline
		Hydrographic Feature
		Digital Data Available
		No Digital Data Available
		Unmapped



The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on **8/27/2021 at 4:44 PM** and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.



Federal Emergency Management Agency

Washington, D.C. 20472

FEB 19 2004

CERTIFIED MAIL
RETURN RECEIPT REQUESTED

The Honorable Chuck Brown
Chairman, El Paso County
Board of Commissioners
27 East Vermijo Avenue
Colorado Springs, CO 80903-2208

IN REPLY REFER TO:

Case No.: 04-08-0012P
Community Name: El Paso County, CO
Community No.: 080059
Effective Date of
This Revision: **MAR 19 2004**

Dear Mr. Brown:

The Flood Insurance Rate Map for your community has been revised by this Letter of Map Revision (LOMR). Please use the enclosed annotated map panel(s) revised by this LOMR for floodplain management purposes and for all flood insurance policies and renewals issued in your community.

Additional documents are enclosed which provide information regarding this LOMR. Please see the List of Enclosures below to determine which documents are included. Other attachments specific to this request may be included as referenced in the Determination Document. If you have any questions regarding floodplain management regulations for your community or the National Flood Insurance Program (NFIP) in general, please contact the Consultation Coordination Officer for your community. If you have any technical questions regarding this LOMR, please contact the Director, Federal Insurance and Mitigation Division of the Department of Homeland Security's Federal Emergency Management Agency (FEMA) in Denver, Colorado, at (303) 235-4830, or the FEMA Map Assistance Center toll free at 1-877-336-2627 (1-877-FEMA MAP). Additional information about the NFIP is available on our website at <http://www.fema.gov/nfip>.

Sincerely,

Kevin C. Long, CFM, Project Engineer
Hazard Identification Section
Mitigation Division
Emergency Preparedness
and Response Directorate

For: Doug Bellomo, P.E., CFM, Acting Chief
Hazard Identification Section
Mitigation Division
Emergency Preparedness
and Response Directorate

List of Enclosures:

Letter of Map Revision Determination Document
Annotated Flood Insurance Rate Map

cc: Mr. Kevin Stilson, P.E., CFM
Floodplain Administrator
Pikes Peak Regional Building Department

Mr. Richard N. Wray, P.E.
Principal
Kiowa Engineering Corporation



Federal Emergency Management Agency

Washington, D.C. 20472

LETTER OF MAP REVISION DETERMINATION DOCUMENT

COMMUNITY AND REVISION INFORMATION		PROJECT DESCRIPTION	BASIS OF REQUEST
COMMUNITY	El Paso County Colorado (Unincorporated Areas)	NO PROJECT	HYDROLOGIC ANALYSIS HYDRAULIC ANALYSIS NEW TOPOGRAPHIC DATA
	COMMUNITY NO.: 080059		
IDENTIFIER	Fourway Ranch Letter of Map Revision	APPROXIMATE LATITUDE & LONGITUDE: 39.974, -104.566 SOURCE: USGS QUADRANGLE DATUM: NAD 83	
FLOODING SOURCE(S) & REVISED REACH(ES)		Haegler Ranch Tributary 1 – from approximately 1,200 feet upstream of the Cadillac and Lake City Railroad to just upstream of Eastonville Road Haegler Ranch Tributary 1A – from the confluence with Haegler Ranch Tributary 1 to just upstream of Eastonville Road Haegler Ranch Tributary 2 – from the confluence with Haegler Ranch Tributary 1 to just upstream of Eastonville Road Geick Ranch Tributary 1 – from approximately 600 feet upstream to approximately 4,000 feet upstream of the Cadillac and Lake City Railroad Geick Ranch Tributary 2 – from approximately 600 feet upstream to approximately 2,600 feet upstream of the Cadillac and Lake City Railroad	
SUMMARY OF REVISIONS			
Effective Flooding: Zone A Revised Flooding: Zone A Increases: YES Decreases: YES			
* BFEs – Base Flood Elevations			
ANNOTATED MAPPING ENCLOSURES		ANNOTATED STUDY ENCLOSURES	
TYPE: FIRM* NO.: 08041C0575 F Date: March 17, 1997		NO REVISION TO THE FLOOD INSURANCE STUDY REPORT	

* FIRM – Flood Insurance Rate Map; ** FBFM – Flood Boundary and Floodway Map; *** FHBM – Flood Hazard Boundary Map

DETERMINATION

This document provides the determination from the Department of Homeland Security's Federal Emergency Management Agency (FEMA) regarding a request for a Letter of Map Revision (LOMR) for the area described above. Using the information submitted, we have determined that a revision to the flood hazards depicted in the Flood Insurance Study (FIS) report and/or National Flood Insurance Program (NFIP) map is warranted. This document revises the effective NFIP map, as indicated in the attached documentation. Please use the enclosed annotated map panels revised by this LOMR for floodplain management purposes and for all flood insurance policies and renewals in your community.

This determination is based on the flood data presently available. The enclosed documents provide additional information regarding this determination. If you have any questions about this document, please contact the FEMA Map Assistance Center toll free at 1-877-336-2677 (1-877-FEMA MAP) or by letter addressed to the LOMR Depot, 3601 Eisenhower Avenue, Alexandria, VA 22304. Additional information about the NFIP is available on our website at <http://www.fema.gov/nfip>.

Doug Bellomo, P.E., CFM, Acting Chief
Hazard Identification Section
Mitigation Division

Emergency Preparedness and Response Directorate

102061 D.A04080012 102IC

**Federal Emergency Management Agency**

Washington, D.C. 20472

**LETTER OF MAP REVISION
DETERMINATION DOCUMENT (CONTINUED)****COMMUNITY INFORMATION****APPLICABLE NFIP REGULATIONS/COMMUNITY OBLIGATION**

We have made this determination pursuant to Section 206 of the Flood Disaster Protection Act of 1973 (P.L. 93-234) and in accordance with the National Flood Insurance Act of 1968, as amended (Title XIII of the Housing and Urban Development Act of 1968, P.L. 90-448), 42 U.S.C. 4001-4128, and 44 CFR Part 65. Pursuant to Section 1361 of the National Flood Insurance Act of 1968, as amended, communities participating in the NFIP are required to adopt and enforce floodplain management regulations that meet or exceed NFIP criteria. These criteria, including adoption of the FIS report and FIRM, and the modifications made by this LOMR, are the minimum requirements for continued NFIP participation and do not supersede more stringent State/Commonwealth or local requirements to which the regulations apply.

COMMUNITY REMINDERS

We based this determination on the 1-percent-annual-chance discharges computed in the submitted hydrologic model. Future development of projects upstream could cause increased discharges, which could cause increased flood hazards. A comprehensive restudy of your community's flood hazards would consider the cumulative effects of development on discharges and could, therefore, indicate that greater flood hazards exist in this area.

Your community must regulate all proposed floodplain development and ensure that permits required by Federal and/or State/Commonwealth law have been obtained. State/Commonwealth or community officials, based on knowledge of local conditions and in the interest of safety, may set higher standards for construction or may limit development in floodplain areas. If your State/Commonwealth or community has adopted more restrictive or comprehensive floodplain management criteria, those criteria take precedence over the minimum NFIP requirements.

We will not print and distribute this LOMR to primary users, such as local insurance agents or mortgage lenders; instead, the community will serve as a repository for the new data. We encourage you to disseminate the information in this LOMR by preparing a news release for publication in your community's newspaper that describes the revision and explains how your community will provide the data and help interpret the NFIP maps. In that way, interested persons, such as property owners, insurance agents, and mortgage lenders, can benefit from the information.

This determination is based on the flood data presently available. The enclosed documents provide additional information regarding this determination. If you have any questions about this document, please contact the FEMA Map Assistance Center toll free at 1-877-336-2677 (1-877-FEMA MAP) or by letter addressed to the LOMR Depot, 3601 Eisenhower Avenue, Alexandria, VA 22304. Additional information about the NFIP is available on our website at <http://www.fema.gov/nfip>.

Doug Bellomo, P.E., CFM, Acting Chief
Hazard Identification Section
Mitigation Division

Emergency Preparedness and Response Directorate

102061 D.A04080012 1021C

**Federal Emergency Management Agency**

Washington, D.C. 20472

**LETTER OF MAP REVISION
DETERMINATION DOCUMENT (CONTINUED)****COMMUNITY INFORMATION (CONTINUED)**

We have designated a Consultation Coordination Officer (CCO) to assist your community. The CCO will be the primary liaison between your community and FEMA. For information regarding your CCO, please contact:

Mr. Steve L. Olsen
Director, Federal Insurance and Mitigation Division
Federal Emergency Management Agency, Region VIII
Denver Federal Center, Building 710
P.O. Box 25267
Denver, CO 80225-0267
(303) 235-4830

STATUS OF THE COMMUNITY NFIP MAPS

We will not physically revise and republish the FIRM and FIS report for your community to reflect the modifications made by this LOMR at this time. When changes to the previously cited FIRM panel and FIS report warrant physical revision and republication in the future, we will incorporate the modifications made by this LOMR at that time.

This determination is based on the flood data presently available. The enclosed documents provide additional information regarding this determination. If you have any questions about this document, please contact the FEMA Map Assistance Center toll free at 1-877-336-2677 (1-877-FEMA MAP) or by letter addressed to the LOMR Depot, 3601 Eisenhower Avenue, Alexandria, VA 22304. Additional information about the NFIP is available on our website at <http://www.fema.gov/nfip>.

Doug Bellomo, P.E., CFM, Acting Chief
Hazard Identification Section
Mitigation Division
Emergency Preparedness and Response Directorate

102061 D.A04080012 1021C



Federal Emergency Management Agency
Washington, D.C. 20472

**LETTER OF MAP REVISION
DETERMINATION DOCUMENT (CONTINUED)**

PUBLIC NOTIFICATION OF REVISION

This revision will become effective 30 days from the date of this letter. Any requests to review or alter this determination should be made within 30 days and must be based on scientific or technical data.

This determination is based on the flood data presently available. The enclosed documents provide additional information regarding this determination. If you have any questions about this document, please contact the FEMA Map Assistance Center toll free at 1-877-338-2677 (1-877-FEMA MAP) or by letter addressed to the LOMR Depot, 3601 Eisenhower Avenue, Alexandria, VA 22304. Additional information about the NFIP is available on our website at <http://www.fema.gov/nfip>.

A handwritten signature in black ink, appearing to read "Doug Bellomo".

Doug Bellomo, P.E., CFM, Acting Chief
Hazard Identification Section
Mitigation Division

Emergency Preparedness and Response Directorate 102061 D.A04080012 1021C

HYDROLOGIC CALCULATIONS

EXISTING CONDITIONS

JOB NAME: WATERBURY MDDP
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

MDDP DRAINAGE REPORT ~ EXISTING BASIN RUNOFF COEFFICIENT SUMMARY

BASIN	TOTAL AREA (AC)	IMPERVIOUS / DEVELOPED AREA			NONIMPERVIOUS / UNDEVELOPED AREA			WEIGHTED		WEIGHTED CA	
		AREA (AC)	C(5)	C(100)	AREA (AC)	C(5)	C(100)	C(5)	C(100)	CA(5)	CA(100)
EXA	9.62	0.00	0.45	0.59	9.62	0.09	0.36	0.09	0.36	0.87	3.46
EXB	4.09	0.00	0.45	0.59	4.09	0.09	0.36	0.09	0.36	0.37	1.47
EXC	24.80	0.00	0.45	0.59	24.80	0.09	0.36	0.09	0.36	2.23	8.93
EXD	15.87	0.00	0.45	0.59	15.87	0.09	0.36	0.09	0.36	1.43	5.71
EXE	5.83	0.00	0.45	0.59	5.83	0.09	0.36	0.09	0.36	0.52	2.10
EXF	1.62	0.00	0.45	0.59	1.62	0.09	0.36	0.09	0.36	0.15	0.58
OS-1	45.02	0.00	0.45	0.59	45.02	0.09	0.36	0.09	0.36	4.05	16.21
OS-2	11.40	0.00	0.45	0.59	11.40	0.09	0.36	0.09	0.36	1.03	4.11
OS-3	1.11	0.00	0.45	0.59	1.11	0.09	0.36	0.09	0.36	0.10	0.40
OS-4	0.29	0.00	0.45	0.59	0.29	0.09	0.36	0.09	0.36	0.03	0.11
OS-5	6.74	0.00	0.45	0.59	6.74	0.09	0.36	0.09	0.36	0.61	2.43
OS-8	2.56	FLOW TAKEN FROM MERIDAIN RANCH MDDP									
OS-9	11.80	FLOW TAKEN FROM MERIDAIN RANCH MDDP									
OS-10A	12.80	FLOW TAKEN FROM MERIDAIN RANCH MDDP									

JOB NAME: WATERBURY MDDP
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALC'D BY: QNA

MDDP ~ EXISTING BASIN RUNOFF SUMMARY

BASIN	WEIGHTED		OVERLAND				STREET / CHANNEL FLOW				Tc	INTENSITY		TOTAL FLOWS	
	CA(5)	CA(100)	C(5)	Length (ft)	Height (ft)	Tc (min)	Length (ft)	Slope (%)	Velocity (fps)	Tc (min)	TOTAL (min)	I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
EXA	0.87	3.46	0.25	100	3	11.1	1193	1.7%	4.5	4.4	15.4	3.43	5.81	3	20
EXB	0.37	1.47	0.25	100	2	12.6	623	2.2%	5.2	2.0	14.6	3.51	5.96	1	9
EXC	2.23	8.93	0.25	100	2.5	11.7	2420	1.7%	4.6	8.9	20.6	3.01	5.01	7	45
EXD	1.43	5.71	0.25	100	2	12.6	1615	2.6%	5.6	4.8	17.4	3.25	5.47	5	31
EXE	0.52	2.10	0.25	100	8	8.0	1063	2.1%	5.0	3.5	11.5	3.86	6.66	2	14
EXF	0.15	0.58	0.25	100	6	8.8	400	2.5%	5.5	1.2	10.0	4.06	7.07	1	4
OS-1	4.05	16.21	0.25	100	6	8.8	3219	2.3%	5.3	10.1	18.9	3.13	5.24	13	85
OS-2	1.03	4.11	0.25	100	2	12.6	1203	1.0%	3.5	5.7	18.4	3.17	5.32	3	22
OS-3	0.10	0.40	0.25	100	2	12.6	330	2.6%	5.6	1.0	13.6	3.61	6.17	0	2
OS-4	0.03	0.11	0.25	100	2	12.6	230	2.6%	5.7	0.7	13.3	3.64	6.23	0	1
OS-5	0.61	2.43	0.25	80	5	7.8	1000	2.5%	5.5	3.0	10.8	3.96	6.85	2	17
OS-8	FLOW TAKEN FROM MERIDAIN RANCH MDDP													5	11
OS-9	FLOW TAKEN FROM MERIDAIN RANCH MDDP													8	19

JOB NAME: WATERBURY MDDP
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

MDDP ~ EXISTING SURFACE ROUTING SUMMARY

Design Point(s)	Contributing Basins	Area (AC)	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Facility Size
						I(5)	I(100)	Q(5)	Q(100)	
EX1	EXA, OS-5, & DP-EX10A	18.92	1.47	5.89	15.4	3.43	5.81	33	219	3-42" CULVERTS
EX2	EXB	4.09	0.37	1.47	14.6	3.51	5.96	1	9	STAPLETON ROAD
EX3	EXC & OS-4	25.10	2.26	9.03	20.6	3.01	5.01	7	45	EAST BOUNDARY
EX4	EXD & OS-3	16.98	1.53	6.11	17.4	3.25	5.47	5	33	EAST BOUNDARY
EX5	EXE, OS-2 & OS-8	17.23	1.55	6.20	18.4	3.17	5.32	10	44	EAST BOUNDARY
EX6	EXF	1.62	0.15	0.58	13.8	3.59	6.12	1	4	EAST BOUNDARY
EX7	EXE, EXF, OS-1, OS-2, OS-8 & OS-9	78.24	5.75	23.00	18.9	3.13	5.24	31	151	DP 30 PROP CONDITION
EX9	OS-9	11.80						8	19	EX 36" RCP Culvert
EX10	OS-8	2.56						5	11	EX 36" RCP Culvert
EX10A	MERIDIAN POND E RELEASE	Meridaian Ranch Filing 3 FDR Calculated Flows						28	185	EX 3-42" RCP Culverts

EARLY GRADING CONDITIONS

JOB NAME: WATERBURY MDDP
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

MDDP DRAINAGE REPORT ~ EARLY GRADING BASIN RUNOFF COEFFICIENT SUMMARY

BASIN	TOTAL AREA (AC)	IMPERVIOUS / DEVELOPED AREA			NONIMPERVIOUS / UNDEVELOPED AREA			WEIGHTED		WEIGHTED CA	
		AREA (AC)	C(5)	C(100)	AREA (AC)	C(5)	C(100)	C(5)	C(100)	CA(5)	CA(100)
PRE-A	4.61	0.00	0.45	0.59	4.61	0.09	0.36	0.09	0.36	0.41	1.66
PRE-B	12.35	0.00	0.45	0.59	12.35	0.09	0.36	0.09	0.36	1.11	4.45
PRE-C	19.08	0.00	0.45	0.59	19.08	0.09	0.36	0.09	0.36	1.72	6.87
PRE-D	15.52	0.00	0.45	0.59	15.52	0.09	0.36	0.09	0.36	1.40	5.59
PRE-E	6.33	0.00	0.45	0.59	6.33	0.09	0.36	0.09	0.36	0.57	2.28
PRE-F	0.62	0.00	0.45	0.59	0.62	0.09	0.36	0.09	0.36	0.06	0.22
PRE-G	2.00	0.00	0.45	0.59	2.00	0.09	0.36	0.09	0.36	0.18	0.72
PRE-H	1.33	0.00	0.45	0.59	1.33	0.09	0.36	0.09	0.36	0.12	0.48
OS-1	0.75	0.00	0.45	0.59	0.75	0.09	0.36	0.09	0.36	0.07	0.27
OS-2	11.15	0.00	0.45	0.59	11.15	0.09	0.36	0.09	0.36	1.00	4.01
OS-3	1.11	0.00	0.45	0.59	1.11	0.09	0.36	0.09	0.36	0.10	0.40
OS-4	0.56	0.00	0.45	0.59	0.56	0.09	0.36	0.09	0.36	0.05	0.20
OS-8	2.56	FLOW TAKEN FROM MERIDAIN RANCH MDDP									

JOB NAME: WATERBURY MDDP
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALC'D BY: QNA

MDDP ~ EARLY GRADING BASIN RUNOFF SUMMARY

BASIN	WEIGHTED		OVERLAND				STREET / CHANNEL FLOW				Tc	INTENSITY		TOTAL FLOWS	
	CA(5)	CA(100)	C(5)	Length (ft)	Height (ft)	Tc (min)	Length (ft)	Slope (%)	Velocity (fps)	Tc (min)	TOTAL (min)	I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
PRE-A	0.41	1.66	0.25	100	2.5	11.7	909	1.4%	4.2	3.6	15.4	3.43	5.82	1	10
PRE-B	1.11	4.45	0.25	100	2.5	11.7	1612	1.3%	4.0	6.7	18.5	3.16	5.31	4	24
PRE-C	1.72	6.87	0.25	100	2.5	11.7	1308	1.3%	4.0	5.5	17.2	3.27	5.50	6	38
PRE-D	1.40	5.59	0.25	100	2	12.6	1297	1.6%	4.5	4.9	17.5	3.24	5.46	5	30
PRE-E	0.57	2.28	0.25	100	8	8.0	752	2.1%	5.1	2.5	10.5	4.00	6.94	2	16
PRE-F	0.06	0.22	0.25	64	2	8.7					8.7	4.26	7.47	0	2
PRE-G	0.18	0.72	0.25	161	5	13.9					13.9	3.58	6.12	1	4
PRE-H	0.12	0.48	0.25	67	2	9.1					9.1	4.21	7.36	1	4
OS-1	0.07	0.27	0.25	85	2	11.0	75	1.3%	4.0	0.3	11.4	3.88	6.70	0	2
OS-2	1.00	4.01	0.25	76	2	10.1	1427	2.1%	5.1	4.7	14.8	3.49	5.94	4	24
OS-3	0.10	0.40	0.25	100	9	7.7	329	2.5%	5.5	1.0	8.7	4.27	7.49	0	3
OS-4	0.05	0.20	0.25	100	2	12.6	127	2.4%	5.4	0.4	13.0	3.68	6.30	0	1
OS-8	FLOW TAKEN FROM MERIDAIN RANCH MDDP													5	11

JOB NAME: WATERBURY MDDP
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

MDDP ~ EARLY GRADING SURFACE ROUTING SUMMARY

Design Point(s)	Contributing Basins	Area (AC)	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Facility Size
						I(5)	I(100)	Q(5)	Q(100)	
PRE1	PRE-B & OS-4	4.65	1.16	4.65	18.5	3.16	5.31	4	25	TSB 1
PRE2	PRE-C	19.08	1.72	6.87	17.2	3.27	5.50	6	38	TSB 2
PRE3	PRE-D & OS-3	16.63	1.50	5.99	17.5	3.24	5.46	5	33	TSB 3
PRE4	PRE-E & OS-1	7.07	0.64	2.55	10.5	4.00	6.94	3	18	TSB 4
PRE5	OS-8 & OS-2	13.71	1.00	4.01	14.8	3.49	5.94	9	35	EASTERN CHANNEL
PRE6	PRE-F	0.62	0.06	0.22	8.7	4.26	7.47	0	2	STAPLETON ROAD
PRE7	PRE-G, PRE-H & DPS PRE2-PRE5	59.82	5.15	20.61	17.5	3.24	5.46	25	147	EX GEICK RANCH CHANNEL
10	OS-8	10.90						2	16	EX 36" RCP Culvert

MDDP CALCULATIONS

JOB NAME: WATERBURY MDDP
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

MDDP DRAINAGE REPORT ~ PROPOSED BASIN RUNOFF COEFFICIENT SUMMARY

BASIN	TOTAL AREA (AC)	IMPERVIOUS / DEVELOPED AREA			NONIMPERVIOUS / UNDEVELOPED AREA			WEIGHTED		WEIGHTED CA	
		AREA (AC)	C(5)	C(100)	AREA (AC)	C(5)	C(100)	C(5)	C(100)	CA(5)	CA(100)
A	3.39	3.39	0.45	0.59	0.00	0.09	0.36	0.45	0.59	1.52	2.00
B1	2.30	2.30	0.45	0.59	0.00	0.09	0.36	0.45	0.59	1.03	1.36
B2	3.58	3.58	0.45	0.59	0.00	0.09	0.36	0.45	0.59	1.61	2.11
C	0.86	0.86	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.39	0.51
D	2.11	2.11	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.95	1.24
E	2.18	2.18	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.98	1.29
F	2.18	2.18	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.98	1.29
G1	0.53	0.53	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.24	0.31
G2	0.69	0.69	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.31	0.41
H	1.46	1.46	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.66	0.86
I	4.97	1.45	0.45	0.59	3.53	0.09	0.36	0.19	0.43	0.97	2.12
J	1.44	1.44	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.65	0.85
K	3.06	1.14	0.45	0.59	1.92	0.09	0.36	0.22	0.45	0.69	1.37
L1	3.79	3.79	0.45	0.59	0.00	0.09	0.36	0.45	0.59	1.71	2.24
L2	2.00	2.00	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.90	1.18
M1	0.99	0.99	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.44	0.58
M2	0.35	0.35	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.16	0.21
N	0.22	0.22	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.10	0.13
O1	2.82	2.82	0.45	0.59	0.00	0.09	0.36	0.45	0.59	1.27	1.66
O2	0.71	0.71	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.32	0.42
O3	0.45	0.45	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.20	0.27
O4	0.38	0.38	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.17	0.23
P	0.70	0.00	0.45	0.59	0.70	0.09	0.36	0.09	0.36	0.06	0.25
Q1	1.48	1.48	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.66	0.87
Q2	0.96	0.96	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.43	0.56

JOB NAME: WATERBURY MDDP
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

MDDP DRAINAGE REPORT ~ PROPOSED BASIN RUNOFF COEFFICIENT SUMMARY

BASIN	TOTAL AREA (AC)	IMPERVIOUS / DEVELOPED AREA			NONIMPERVIOUS / UNDEVELOPED AREA			WEIGHTED		WEIGHTED CA	
		AREA (AC)	C(5)	C(100)	AREA (AC)	C(5)	C(100)	C(5)	C(100)	CA(5)	CA(100)
R	1.02	1.02	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.46	0.60
S1	1.55	1.55	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.70	0.91
S2	0.13	0.13	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.06	0.08
T1	1.42	1.42	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.64	0.84
T2	1.23	1.23	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.55	0.73
U1	4.38	4.38	0.45	0.59	0.00	0.09	0.36	0.45	0.59	1.97	2.58
U2	1.89	1.89	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.85	1.11
V	0.54	0.54	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.24	0.32
W	5.20	5.20	0.45	0.59	0.00	0.09	0.36	0.45	0.59	2.34	3.07
X	0.43	0.43	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.19	0.25
Y	0.35	0.35	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.16	0.21
OS-1	11.81	11.81	0.45	0.59	0.00	0.09	0.36	0.45	0.59	5.31	6.97
OS-2	11.53	11.53	0.45	0.59	0.00	0.09	0.36	0.45	0.59	5.19	6.80
OS-3A	0.79	0.79	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.35	0.47
OS-3B	5.66	5.66	0.45	0.59	0.00	0.09	0.36	0.45	0.59	2.55	3.34
OS-4	10.90	0.00	0.45	0.59	10.90	0.09	0.36	0.09	0.36	0.98	3.92
OS-5	5.64	0.00	0.45	0.59	5.64	0.09	0.36	0.09	0.36	0.51	2.03
OS-6	1.06	1.06	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.48	0.63
OS-7	2.82	0.00	0.45	0.59	2.82	0.09	0.36	0.09	0.36	0.25	1.01
OS-8	2.56	FLOW TAKEN FROM MERIDAIN RANCH MDDP									
OS-9	11.80	FLOW TAKEN FROM MERIDAIN RANCH MDDP									
OS-10	3.41	0.00	0.45	0.59	3.41	0.09	0.36	0.09	0.36	0.31	1.23
OS-Q1	4.31	4.31	0.45	0.59	0.00	0.09	0.36	0.45	0.59	1.94	2.54
OS-Q2	0.94	0.94	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.42	0.55
OS-R	6.05	6.05	0.45	0.59	0.00	0.09	0.36	0.45	0.59	2.72	3.57
OS-S1	5.59	5.59	0.45	0.59	0.00	0.09	0.36	0.45	0.59	2.51	3.30
OS-S2	0.17	0.17	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.08	0.10
OS-T2	0.76	0.76	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.34	0.45

JOB NAME: <u>WATERBURY MDDP</u> JOB NUMBER: <u>1715.00</u> DATE: <u>07/20/22</u> CALC'D BY: <u>QNA</u>															
MDDP ~ PROPOSED BASIN RUNOFF SUMMARY															
BASIN	WEIGHTED		OVERLAND				STREET / CHANNEL FLOW				Tc	INTENSITY		TOTAL FLOWS	
	CA(5)	CA(100)	C(5)	Length (ft)	Height (ft)	Tc (min)	Length (ft)	Slope (%)	Velocity (fps)	Tc (min)	TOTAL (min)	I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
A	1.52	2.00	0.25	100	2	12.6	420	1.5%	4.3	1.6	14.3	3.54	6.03	5	12
B1	1.03	1.36	0.25	100	2	12.6	400	1.5%	4.3	1.6	14.2	3.55	6.05	4	8
B2	1.61	2.11	0.25	100	2	12.6	550	1.5%	4.3	2.1	14.8	3.49	5.93	6	13
C	0.39	0.51	0.25	20	0.5	5.3	500	2.0%	4.9	1.7	6.9	4.58	8.14	2	4
D	0.95	1.24	0.25	80	2	10.5	300	2.5%	5.5	0.9	11.4	3.87	6.69	4	8
E	0.98	1.29	0.25	100	2	12.6	400	2.5%	5.5	1.2	13.8	3.59	6.12	4	8
F	0.98	1.29	0.25	50	2	7.1	620	1.5%	4.3	2.4	9.5	4.14	7.22	4	9
G1	0.24	0.31	0.25								5.0	5.00	9.06	1	3
G2	0.31	0.41	0.25								5.0	5.00	9.06	2	4
H	0.66	0.86	0.25	50	2	7.1	525	1.5%	4.3	2.0	9.2	4.19	7.33	3	6
I	0.97	2.12	0.25	80	4	8.4	250	2.0%	4.9	0.8	9.2	4.18	7.32	4	16
J	0.65	0.85	0.25	90	6	8.1	850	2.0%	4.9	2.9	10.9	3.94	6.81	3	6
K	0.69	1.37	0.25	100	18	6.1	80	1.0%	3.5	0.4	6.5	4.67	8.33	3	11
L1	1.71	2.24	0.25	100	2	12.6	860	1.4%	4.1	3.5	16.1	3.36	5.69	6	13
L2	0.90	1.18	0.25	55	1.1	9.4	860	1.4%	4.1	3.5	12.8	3.70	6.34	3	7
M1	0.44	0.58	0.25	70	1.5	10.3	200	2.0%	4.9	0.7	11.0	3.92	6.79	2	4
M2	0.16	0.21	0.25	65	3	7.7	0	0.0%	0.0	0.0	7.7	4.43	7.83	1	2

JOB NAME: **WATERBURY MDDP**
 JOB NUMBER: **1715.00**
 DATE: **07/20/22**
 CALC'D BY: **QNA**

MDDP ~ PROPOSED BASIN RUNOFF SUMMARY

BASIN	WEIGHTED		OVERLAND				STREET / CHANNEL FLOW				Tc	INTENSITY		TOTAL FLOWS	
	CA(5)	CA(100)	C(5)	Length (ft)	Height (ft)	Tc (min)	Length (ft)	Slope (%)	Velocity (fps)	Tc (min)	TOTAL (min)	I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
N	0.10	0.13	0.25								5.0	5.00	9.06	1	1
O1	1.27	1.66	0.25	100	2.5	11.7	460	1.5%	4.3	1.8	13.5	3.62	6.19	5	10
O2	0.32	0.42	0.25	100	2	12.6	850	2.0%	4.9	2.9	15.5	3.42	5.80	1	2
O3	0.20	0.27	0.25								5.0	5.00	9.06	1	2
O4	0.17	0.23	0.25								5.0	5.00	9.06	1	2
P	0.06	0.25	0.25								5.0	5.00	9.06	0	2
Q1	0.66	0.87	0.25	55	1.3	8.9	445	2.0%	5.0	1.5	10.4	4.01	6.97	3	6
Q2	0.43	0.56	0.25	55	1.3	8.9	445	2.0%	5.0	1.5	10.4	4.01	6.97	2	4
R	0.46	0.60	0.25	100	4	10.1	700	2.0%	4.9	2.4	12.4	3.75	6.44	2	4
S1	0.70	0.91	0.25	100	6	8.8	175	2.0%	4.9	0.6	9.4	4.16	7.26	3	7
S2	0.06	0.08	0.25								5.0	5.00	9.06	0	1
T1	0.64	0.84	0.25	55	1.1	9.4	390	2.0%	4.9	1.3	10.7	3.97	6.88	3	6
T2	0.55	0.73	0.25	100	2	12.6	245	2.0%	5.0	0.8	13.5	3.63	6.20	2	5
U1	1.97	2.58	0.25	100	2	12.6	520	2.3%	5.3	1.6	14.3	3.54	6.03	7	16
U2	0.85	1.11	0.25	100	2	12.6	385	2.3%	5.4	1.2	13.8	3.59	6.12	3	7
V	0.24	0.32	0.25								5.0	5.00	9.06	1	3
W	2.34	3.07	0.25	100	2	12.6	630	1.6%	4.4	2.4	15.0	3.47	5.89	8	18
X	0.19	0.25	0.25								5.0	5.00	9.06	1	2
Y	0.16	0.21	0.25								5.0	5.00	9.06	1	2

JOB NAME: WATERBURY MDDP

JOB NUMBER: 1715.00

DATE: 07/20/22

CALC'D BY: QNA

MDDP ~ PROPOSED BASIN RUNOFF SUMMARY

BASIN	WEIGHTED		OVERLAND				STREET / CHANNEL FLOW				Tc	INTENSITY		TOTAL FLOW	
	CA(5)	CA(100)	C(5)	Length (ft)	Height (ft)	Tc (min)	Length (ft)	Slope (%)	Velocity (fps)	Tc (min)	TOTAL (min)	I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
OS-1	5.31	6.97	0.25	100	2	12.6	690	2.0%	5.0	2.3	15.0	3.47	5.90	18	41
OS-2	5.19	6.80	0.25	100	2	12.6	1700	1.8%	4.6	6.1	18.7	3.14	5.27	16	36
OS-3A	0.35	0.47	0.25	55	1.1	9.4	480	1.3%	3.9	2.0	11.4	3.87	6.68	1	3
OS-3B	2.55	3.34	0.25	100	2	12.6	480	1.3%	3.9	2.0	14.7	3.50	5.95	9	20
OS-4	0.98	3.92	0.25	800	26	30.5					30.5	2.46	4.01	2	16
OS-5	0.51	2.03	0.25	80	5	7.8					7.8	4.42	7.82	2	16
OS-6	0.48	0.63	0.25	30	0.6	6.9	900	1.8%	4.7	3.2	10.1	4.05	7.04	2	4
OS-7	0.25	1.01									5.0	5.00	9.06	1	9
OS-8	FLOW TAKEN FROM MERIDAIN RANCH MDDP													5	11
OS-9	FLOW TAKEN FROM MERIDAIN RANCH MDDP													8	19
OS-10	0.31	1.23	0.25	100	2	12.6	300	2.7%	5.7	0.9	13.5	3.62	6.19	1	8
OS-Q1	1.94	2.54	0.25	200	5	16.6	1500	1.5%	4.3	5.8	22.4	2.88	4.78	6	12
OS-Q2	0.42	0.55	0.25	50	1	8.9	900	1.5%	4.3	3.5	12.4	3.75	6.43	2	4
OS-R	2.72	3.57	0.25	50	1	8.9	850	2.7%	5.8	2.5	11.4	3.87	6.69	11	24
OS-S1	2.51	3.30	0.25	100	2	12.6	920	1.2%	3.8	4.0	16.7	3.32	5.60	8	18
OS-S2	0.08	0.10	0.25	100	2	12.6					12.6	3.72	6.39	0	1
OS-T2	0.34	0.45	0.25	100	2	12.6					12.6	3.72	6.39	1	3

JOB NAME: WATERBURY MDDP
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

MDDP ~ PROPOSED SURFACE ROUTING SUMMARY

Design Point(s)	Contributing Basins	Area (AC)	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Facility Size
						I(5)	I(100)	Q(5)	Q(100)	
1	A	3.39	1.52	2.00	14.3	3.54	6.03	5	12	10' Type R Sump Inlet
2	C	0.86	0.39	0.51	6.9	4.58	8.14	2	4	5' Type R Sump Inlet
3	B1	2.30	1.03	1.36	14.2	3.55	6.05	4	8	5' Type R Sump Inlet
4	B2	3.58	1.61	2.11	14.8	3.49	5.93	6	13	10' Type R Sump Inlet
5	F & H	3.65	1.64	2.15	9.5	4.14	7.22	7	16	10' Type R Sump Inlet
6	D	2.11	0.95	1.24	11.4	3.87	6.69	4	8	5' Type R Sump Inlets
7	E	2.18	0.98	1.29	13.8	3.59	6.12	4	8	5' Type R Sump Inlets
7A	G1	0.53	0.24	0.31	5.0	5.00	9.06	1	3	5' Type R At-grade Inlet
7B	G2	0.69	0.31	0.41	5.0	5.00	9.06	2	4	5' Type R At-grade Inlet
8	DESIGN POINTS 1-7 & K	18.06	8.13	10.66	14.8	3.49	5.93	28	63	FSD Pond 1
9	OS-9	11.80						8	19	EX 36" RCP Culvert
10	OS-8	2.56						5	11	EX 36" RCP Culvert
10A	MERIDIAN POND E RELEASE	Meridaian Ranch Filing 3 FDR Calculated Flows						28	185	EX 3-42" RCP Culverts
11	OS-5, I, DP10A (MERIDIAN POND E RELEASE)	Sum of Basins						34	216	PR 2-42" RCP Culverts
11A	DP 11 & BASIN J	Sum of Basins						37	222	PR 2-42" RCP Culverts

JOB NAME: WATERBURY MDDP
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

MDDP ~ PROPOSED SURFACE ROUTING SUMMARY

Design Point(s)	Contributing Basins	Area (AC)	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Facility Size
						I(5)	I(100)	Q(5)	Q(100)	
12	OS-6	1.06	0.48	0.63	10.1	4.05	7.04	2	4	18" RCP Culvert
13	TOTAL OFFSITE EX. STOCK POND INFLOW	Per "Final Drainage Report for Waterbury Filing No. 1" dated September 2016, by Classic Consulting						69	396	EX STOCK POND
14	L1	3.79	1.71	2.24	16.1	3.36	5.69	6	13	10' Type R Sump Inlet
15	L2	2.00	0.90	1.18	12.8	3.70	6.34	3	7	5' Type R Sump Inlet
16	O1	2.82	1.27	1.66	13.5	3.62	6.19	5	10	10' Type R Sump Inlet
17	O2	0.71	0.32	0.42	15.5	3.42	5.80	1	2	5' Type R Sump Inlet
18	DESIGN POINTS 14-17 & BASIN OS-4	20.23	5.18	5.50	16.1	3.36	5.69	17	31	Interim FSD Pond 2
19	Q1 & OS-Q1	5.78	2.60	3.41	22.4	2.88	4.78	8	16	10' Type R Sump Inlet
20	Q2 & OS-Q2	1.89	0.85	1.12	12.4	3.75	6.43	3	7	5' Type R Sump Inlet
21	R & OS-R	7.06	3.18	4.17	11.4	3.87	6.69	12	28	10' Type R At-grade Inlet
22	S1 & OS-S1 & DP 21 FLOW BY	8.34	4.42	5.64	16.7	3.32	5.60	15	32	10' Type R Sump Inlet
23	S2 & OS-S2	0.31	0.14	0.18	12.6	3.72	6.39	1	1	10' Type R Sump Inlet
22 & 23 SPLIT	S1, OS-S1, S2, OS-S2, & DP 21 FLOW BY	8.65	4.56	5.82	16.7	3.32	5.60	8	16	2-10' Type R Sump Inlets
24	T1	1.42	0.64	0.84	10.7	3.97	6.88	3	6	5' Type R Sump Inlets
25	T2 & OS-T2	1.99	0.90	1.18	13.5	3.63	6.20	3	7	5' Type R Sump Inlets

JOB NAME: WATERBURY MDDP
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

MDDP ~ PROPOSED SURFACE ROUTING SUMMARY

Design Point(s)	Contributing Basins	Area (AC)	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Facility Size
						I(5)	I(100)	Q(5)	Q(100)	
26	U1	4.38	1.97	2.58	14.3	3.54	6.03	7	16	10' Type R Sump Inlets
27	U2	1.89	0.85	1.11	13.8	3.59	6.12	3	7	5' Type R Sump Inlets
28	W	5.20	2.34	3.07	15.0	3.47	5.89	8	18	2-10' Type R Sump Inlets
29	DPS 19-28, 31-32, OFFSITE BASINS OS-1, 2, 3A, 3B, 7, & 9	82.44	36.10	47.71	22.4	2.88	4.78	112	247	FSD POND
30	Y & OS-10	3.76	0.46	1.43	13.5	3.62	6.19	2	9	Triple 36" RCP Culverts
30	FSD POND 3 EMERGCNEY SPILLWAY RELEASE	MHFD DETENTION 100Y PEAK INFLOW							247	Triple 36" RCP Culverts
30A	FSD POND RELEASE & DP 30	MHFD DETENTION 100Y PEAK INFLOW						3	67	EAST CHANNEL
31	V	0.54	0.24	0.32	5.0	5.00	9.06	1	3	18" DIA INLETS
32	X	0.43	0.19	0.25	5.0	5.00	9.06	1	2	18" DIA INLETS
33	O-3	0.45	0.20	0.27	5.0	5.00	9.06	1	2	18" DIA INLETS
34	O-4	0.38	0.17	0.23	5.0	5.00	9.06	1	2	18" DIA INLETS

JOB NAME: WATERBURY MDDP
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

* PIPES ARE LISTED AT MAXIMUM SIZE REQUIRED TO ACCOMMODATE Q100 FLOWS AT MINIMUM GRADE.
 REFER TO INDIVIDUAL PIPE SHEETS FOR HYDRAULIC INFORMATION.

MDDP ~ PIPE ROUTING SUMMARY

Pipe Run	Contributing Design Points/Basins	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Pipe Size*
					I(5)	I(100)	Q(5)	Q(100)	
1	DP 2	0.39	0.51	6.9	4.58	8.14	2	4	18" RCP
2	DP 1 & 2	1.91	2.51	14.3	3.54	6.03	7	15	24" RCP
3	DP 3	1.03	1.36	14.2	3.55	6.05	4	8	18" RCP
4	DP-4	1.61	2.11	14.8	3.49	5.93	6	13	18" RCP
5	DP 3 & 4	2.64	3.47	14.8	3.49	5.93	9	21	24" RCP
6	DP 1-4	4.56	5.97	14.8	3.49	5.93	16	35	36" RCP
7	DP-1-5	6.20	8.12	14.8	3.49	5.93	22	48	36" RCP
8	DP-6	0.95	1.24	11.4	3.87	6.69	4	8	18" RCP
9	DP-7	0.98	1.29	13.8	3.59	6.12	4	8	18" RCP
10	DP-6 & 7	1.97	2.58	13.8	3.59	6.12	7	16	24" RCP
10A	DP-7A	0.24	0.31	5.0	5.00	9.06	1	3	15" RCP
10B	DP-7A & 7B	0.55	0.72	5.0	5.00	9.06	3	7	18" RCP
10C	POND 1 RELEASE	2.95	3.87	13.8	3.59	6.12	0.4	14.5	18" RCP
11	DP-14	1.71	2.24	16.1	3.36	5.69	6	13	24" RCP
12	DP-15	0.90	1.18	12.8	3.70	6.34	3	7	18" RCP

JOB NAME: WATERBURY MDDP
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

* PIPES ARE LISTED AT MAXIMUM SIZE REQUIRED TO ACCOMMODATE Q100 FLOWS AT MINIMUM GRADE.
 REFER TO INDIVIDUAL PIPE SHEETS FOR HYDRAULIC INFORMATION.

MDDP ~ PIPE ROUTING SUMMARY

Pipe Run	Contributing Design Points/Basins	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Pipe Size*
					I(5)	I(100)	Q(5)	Q(100)	
13	DP 14 & 15	2.61	3.42	16.1	3.36	5.69	9	19	30" RCP
14	DP 16	1.27	1.66	13.5	3.62	6.19	5	10	24" RCP
15	DP 14, 15 & 16	3.88	5.08	16.1	3.36	5.69	13	29	36" RCP
16	DP 17	0.32	0.42	15.5	3.42	5.80	1	2	18" RCP
17	DP 14, 15, 16, 17, 33, & 34	4.57	6.00	16.1	3.36	5.69	15	34	36" RCP
17A	POND 2 RELEASE						0.2	15.1	18" RCP
18	DP 19	2.60	3.41	22.4	2.88	4.78	8	16	24" RCP
19	DP 20	0.85	1.12	12.4	3.75	6.43	3	7	18" RCP
20	DP 18 & 19	3.46	4.53	22.4	2.88	4.78	10	22	24" RCP
21	DP 21 PICK UP						8	14	18" RCP
22	DP 19, 20 & 21	6.23	7.46	22.4	2.88	4.78	18	36	30" RCP
23	DP 22	2.28	2.91	16.7	3.32	5.60	8	16	24" RCP
24	DP 23	2.28	2.91	16.7	3.32	5.60	8	16	24" RCP
25	DP 22 & 23	4.56	5.82	16.7	3.32	5.60	15	33	30" RCP
26	DP 19 -23	10.79	13.28	22.4	2.88	4.78	31	63	36" RCP

JOB NAME: WATERBURY MDDP

JOB NUMBER: 1715.00

DATE: 07/20/22

CALCULATED BY: QNA

* PIPES ARE LISTED AT MAXIMUM SIZE REQUIRED TO ACCOMMODATE Q100 FLOWS AT MINIMUM GRADE.
REFER TO INDIVIDUAL PIPE SHEETS FOR HYDRAULIC INFORMATION.

MDDP ~ PIPE ROUTING SUMMARY

Pipe Run	Contributing Design Points/Basins	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Pipe Size*
					I(5)	I(100)	Q(5)	Q(100)	
27	DP 24	0.64	0.84	10.7	3.97	6.88	3	6	18" RCP
28	DP 25	0.90	1.18	13.5	3.63	6.20	3	7	18" RCP
29	DP 19-25	12.32	15.29	22.4	2.88	4.78	36	73	36" RCP
30	DP 26	1.97	2.58	14.3	3.54	6.03	7	16	24" RCP
31	DP 19-26	14.29	17.88	22.4	2.89	4.79	41	86	42" RCP
32	DP 27	0.85	1.11	13.8	3.59	6.12	3	7	18" RCP
33	DP 19-27, & 31	15.38	19.31	22.4	2.88	4.78	44	92	42" RCP
34	DP 28 SPLIT	1.17	1.53	15.0	3.47	5.89	4	9	24" RCP
34A	29 & 32	2.53	3.32	13.84	3.59	6.12	9	20	30" RCP
35	Pond 3 Release	MHFD UD-DETENTION POND RELEASE					1.2	58.0	36" RCP
36	DP 30	FSD POND 3 EMERGCNEY SPILLWAY RELEASE						247.2	TRIPLE 36" RCP
37	DP 31	0.24	0.32	5.00	5.00	9.06	1.2	3	15" HDPE
38	DP 32	0.19	0.25	5.00	5.00	9.06	1.2	2	15" HDPE
39	DP 33	0.20	0.27	5.00	5.00	9.06	1.2	2	15" HDPE
40	DP 34	0.17	0.23	5.00	5.00	9.06	1.2	2	15" HDPE

PDR CALCULATIONS

JOB NAME: WATERBURY FDR
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

PELIMINARY DRAINAGE REPORT ~ BASIN RUNOFF COEFFICIENT SUMMARY

BASIN	TOTAL AREA (AC)	IMPERVIOUS / DEVELOPED AREA			NONIMPERVIOUS / UNDEVELOPED AREA			WEIGHTED		WEIGHTED CA	
		AREA (AC)	C(5)	C(100)	AREA (AC)	C(5)	C(100)	C(5)	C(100)	CA(5)	CA(100)
A	3.39	3.39	0.45	0.59	0.00	0.09	0.36	0.45	0.59	1.52	2.00
B1	2.30	2.30	0.45	0.59	0.00	0.09	0.36	0.45	0.59	1.03	1.36
B2	3.58	3.58	0.45	0.59	0.00	0.09	0.36	0.45	0.59	1.61	2.11
C	0.86	0.86	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.39	0.51
D	2.11	2.11	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.95	1.24
E	2.18	2.18	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.98	1.29
F	2.18	2.18	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.98	1.29
G1	0.53	0.53	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.24	0.31
G2	0.69	0.69	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.31	0.41
H	1.46	1.46	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.66	0.86
I	4.97	1.45	0.45	0.59	3.53	0.09	0.36	0.19	0.43	0.97	2.12
J	1.44	1.44	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.65	0.85
K	3.06	1.14	0.45	0.59	1.92	0.09	0.36	0.22	0.45	0.69	1.37
L1	3.79	3.79	0.45	0.59	0.00	0.09	0.36	0.45	0.59	1.71	2.24
L2	2.00	2.00	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.90	1.18
M1	0.99	0.99	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.44	0.58
M2	0.35	0.35	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.16	0.21
N	0.22	0.22	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.10	0.13
O1	2.82	2.82	0.45	0.59	0.00	0.09	0.36	0.45	0.59	1.27	1.66
O2	0.71	0.71	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.32	0.42
O3	0.45	0.45	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.20	0.27
O4	0.38	0.38	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.17	0.23
P	0.70	0.00	0.45	0.59	0.70	0.09	0.36	0.09	0.36	0.06	0.25
Q1	1.48	1.48	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.66	0.87
Q2	0.96	0.96	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.43	0.56
R	1.02	1.02	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.46	0.60
S1	1.55	1.55	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.70	0.91
S2	0.13	0.13	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.06	0.08
T1	1.42	1.42	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.64	0.84

JOB NAME: WATERBURY FDR
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

PELIMINARY DRAINAGE REPORT ~ BASIN RUNOFF COEFFICIENT SUMMARY

BASIN	TOTAL AREA (AC)	IMPERVIOUS / DEVELOPED AREA			NONIMPERVIOUS / UNDEVELOPED AREA			WEIGHTED		WEIGHTED CA	
		AREA (AC)	C(5)	C(100)	AREA (AC)	C(5)	C(100)	C(5)	C(100)	CA(5)	CA(100)
T2	1.23	1.23	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.55	0.73
U1	4.38	4.38	0.45	0.59	0.00	0.09	0.36	0.45	0.59	1.97	2.58
U2	1.89	1.89	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.85	1.11
V	0.54	0.54	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.24	0.32
W	5.20	5.20	0.45	0.59	0.00	0.09	0.36	0.45	0.59	2.34	3.07
X	0.43	0.43	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.19	0.25
Y	0.35	0.35	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.16	0.21
OS-1*	41.09	0.00	0.45	0.59	41.09	0.09	0.36	0.09	0.36	3.70	14.79
OS-2*	12.02	0.00	0.45	0.59	12.02	0.09	0.36	0.09	0.36	1.08	4.33
OS-4	10.90	0.00	0.45	0.59	10.90	0.09	0.36	0.09	0.36	0.98	3.92
OS-5	5.64	0.00	0.45	0.59	5.64	0.09	0.36	0.09	0.36	0.51	2.03
OS-6	1.06	1.06	0.45	0.59	0.00	0.09	0.36	0.45	0.59	0.48	0.63
OS-7*	2.82	0.00	0.45	0.59	2.82	0.09	0.36	0.09	0.36	0.25	1.01
OS-8	2.56	FLOW TAKEN FROM MERIDAIN RANCH MDDP									
OS-9	11.80	FLOW TAKEN FROM MERIDAIN RANCH MDDP									
OS-Q1*	0.33	0.00	0.45	0.59	0.33	0.09	0.36	0.09	0.36	0.03	0.12
OS-Q2*	0.22	0.00	0.45	0.59	0.22	0.09	0.36	0.09	0.36	0.02	0.08
OS-R*	1.04	0.00	0.45	0.59	1.04	0.09	0.36	0.09	0.36	0.09	0.38
OS-S1*	0.31	0.00	0.45	0.59	0.31	0.09	0.36	0.09	0.36	0.03	0.11
OS-S2*	0.13	0.00	0.45	0.59	0.13	0.09	0.36	0.09	0.36	0.01	0.05
OS-T2*	0.30	0.00	0.45	0.59	0.30	0.09	0.36	0.09	0.36	0.03	0.11

BASIN* = BASIN AREA REVISED FROM MDDP IN PRELIMINARY CONDITION DUE TO UNDEVELOPED UPSTREAM

JOB NAME: WATERBURY FDR
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALC'D BY: QNA

PELIMINARY DRAINAGE REPORT ~ BASIN RUNOFF SUMMARY

BASIN	WEIGHTED		OVERLAND				STREET / CHANNEL FLOW				Tc	INTENSITY		TOTAL FLOWS	
	CA(5)	CA(100)	C(5)	Length (ft)	Height (ft)	Tc (min)	Length (ft)	Slope (%)	Velocity (fps)	Tc (min)	TOTAL (min)	I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
A	1.52	2.00	0.25	100	2	12.6	420	1.5%	4.3	1.6	14.3	3.54	6.03	5	12
B1	1.03	1.36	0.25	100	2	12.6	400	1.5%	4.3	1.6	14.2	3.55	6.05	4	8
B2	1.61	2.11	0.25	100	2	12.6	550	1.5%	4.3	2.1	14.8	3.49	5.93	6	13
C	0.39	0.51	0.25	20	0.5	5.3	500	2.0%	4.9	1.7	6.9	4.58	8.14	2	4
D	0.95	1.24	0.25	80	2	10.5	300	2.5%	5.5	0.9	11.4	3.87	6.69	4	8
E	0.98	1.29	0.25	100	2	12.6	400	2.5%	5.5	1.2	13.8	3.59	6.12	4	8
F	0.98	1.29	0.25	50	2	7.1	620	1.5%	4.3	2.4	9.5	4.14	7.22	4	9
G1	0.24	0.31	0.25								5.0	5.00	9.06	1	3
G2	0.31	0.41	0.25								5.0	5.00	9.06	2	4
H	0.66	0.86	0.25	50	2	7.1	525	1.5%	4.3	2.0	9.2	4.19	7.33	3	6
I	0.97	2.12	0.25	80	4	8.4	250	2.0%	4.9	0.8	9.2	4.18	7.32	4	16
J	0.65	0.85	0.25	90	6	8.1	850	2.0%	4.9	2.9	10.9	3.94	6.81	3	6
K	0.69	1.37	0.25	100	18	6.1	80	1.0%	3.5	0.4	6.5	4.67	8.33	3	11
L1	1.71	2.24	0.25	100	2	12.6	860	1.4%	4.1	3.5	16.1	3.36	5.69	6	13
L2	0.90	1.18	0.25	55	1.1	9.4	860	1.4%	4.1	3.5	12.8	3.70	6.34	3	7
M1	0.44	0.58	0.25	70	1.5	10.3	200	2.0%	4.9	0.7	11.0	3.92	6.79	2	4
M2	0.16	0.21	0.25	65	3	7.7	0	0.0%	0.0	0.0	7.7	4.43	7.83	1	2
N	0.10	0.13	0.25								5.0	5.00	9.06	1	1
O1	1.27	1.66	0.25	100	2.5	11.7	460	1.5%	4.3	1.8	13.5	3.62	6.19	5	10
O2	0.32	0.42	0.25	100	2	12.6	850	2.0%	4.9	2.9	15.5	3.42	5.80	1	2
O3	0.20	0.27	0.25								5.0	5.00	9.06	1	2
O4	0.17	0.23	0.25								5.0	5.00	9.06	1	2
P	0.06	0.25	0.25								5.0	5.00	9.06	0	2
Q1	0.66	0.87	0.25	55	1.3	8.9	445	2.0%	5.0	1.5	10.4	4.01	6.97	3	6

JOB NAME: WATERBURY FDR
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALC'D BY: QNA

PELIMINARY DRAINAGE REPORT ~ BASIN RUNOFF SUMMARY

BASIN	WEIGHTED		OVERLAND				STREET / CHANNEL FLOW				Tc	INTENSITY		TOTAL FLOWS	
	CA(5)	CA(100)	C(5)	Length (ft)	Height (ft)	Tc (min)	Length (ft)	Slope (%)	Velocity (fps)	Tc (min)	TOTAL (min)	I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
Q2	0.43	0.56	0.25	55	1.3	8.9	445	2.0%	5.0	1.5	10.4	4.01	6.97	2	4
R	0.46	0.60	0.25	100	4	10.1	700	2.0%	4.9	2.4	12.4	3.75	6.44	2	4
S1	0.70	0.91	0.25	100	6	8.8	175	2.0%	4.9	0.6	9.4	4.16	7.26	3	7
S2	0.06	0.08	0.25								5.0	5.00	9.06	0	1
T1	0.64	0.84	0.25	55	1.1	9.4	390	2.0%	4.9	1.3	10.7	3.97	6.88	3	6
T2	0.55	0.73	0.25	100	2	12.6	245	2.0%	5.0	0.8	13.5	3.63	6.20	2	5
U1	1.97	2.58	0.25	100	2	12.6	520	2.3%	5.3	1.6	14.3	3.54	6.03	7	16
U2	0.85	1.11	0.25	100	2	12.6	385	2.3%	5.4	1.2	13.8	3.59	6.12	3	7
V	0.24	0.32	0.25								5.0	5.00	9.06	1	3
W	2.34	3.07	0.25	100	2	12.6	630	1.6%	4.4	2.4	15.0	3.47	5.89	8	18
X	0.19	0.25	0.25								5.0	5.00	9.06	1	2
Y	0.16	0.21	0.25								5.0	5.00	9.06	1	2
OS-1*	3.70	14.79	0.25	100	2	12.6	2700	2.3%	5.3	8.5	21.1	2.97	4.94	11	73
OS-2*	1.08	4.33	0.25	100	2	12.6	1203	1.0%	3.5	5.7	18.4	3.17	5.32	3	23
OS-4	0.98	3.92	0.25	800	26	30.5					30.5	2.46	4.01	2	16
OS-5	0.51	2.03	0.25	80	5	7.8					7.8	4.42	7.82	2	16
OS-6	0.48	0.63	0.25	30	0.6	6.9	900	1.8%	4.7	3.2	10.1	4.05	7.04	2	4
OS-7*	0.25	1.01	0.25								5.0	5.00	9.06	1	9
OS-8	FLOW TAKEN FROM MERIDAIN RANCH MDDP													5	11
OS-9	FLOW TAKEN FROM MERIDAIN RANCH MDDP													8	19
OS-Q1*	0.03	0.12	0.25	100	2	12.6	135	1.5%	4.3	0.5	13.2	3.66	6.27	0	1
OS-Q2*	0.02	0.08	0.25	50	1	8.9	135	1.5%	4.3	0.5	9.5	4.14	7.24	0	1
OS-R*	0.09	0.38	0.25	100	2	12.6	50	2.7%	5.8	0.1	12.8	3.70	6.35	0	2
OS-S1*	0.03	0.11	0.25								5.0	5.00	9.06	0	1

JOB NAME:	<i>WATERBURY FDR</i>
JOB NUMBER:	<i>1715.00</i>
DATE:	<i>07/20/22</i>
CALC'D BY:	<i>QNA</i>
PELIMINARY DRAINAGE REPORT ~ BASIN RUNOFF SUMMARY	

BASIN	WEIGHTED		OVERLAND				STREET / CHANNEL FLOW				Tc	INTENSITY		TOTAL FLOWS	
	CA(5)	CA(100)	C(5)	Length (ft)	Height (ft)	Tc (min)	Length (ft)	Slope (%)	Velocity (fps)	Tc (min)	TOTAL (min)	I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
OS-S2*	0.01	0.05	0.25								5.0	5.00	9.06	0	0
OS-T2*	0.03	0.11	0.25								5.0	5.00	9.06	0	1

BASIN* = BASIN AREA REVISED FROM MDDP IN PRELIMINARY CONDITION DUE TO UNDEVELOPED UPSTREAM

JOB NAME: WATERBURY FDR
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

PELIMINARY DRAINAGE REPORT ~ SURFACE ROUTING SUMMARY

Design Point(s)	Contributing Basins	Area (AC)	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Facility Size
						I(5)	I(100)	Q(5)	Q(100)	
1	A	3.39	1.52	2.00	14.3	3.54	6.03	5	12	10' Type R Sump Inlet
2	C	0.86	0.39	0.51	6.9	4.58	8.14	2	4	5' Type R Sump Inlet
3	B1	2.30	1.03	1.36	14.2	3.55	6.05	4	8	5' Type R Sump Inlet
4	B2	3.58	1.61	2.11	14.8	3.49	5.93	6	13	10' Type R Sump Inlet
5	F & H	3.65	1.64	2.15	9.5	4.14	7.22	7	16	10' Type R Sump Inlet
6	D	2.11	0.95	1.24	11.4	3.87	6.69	4	8	5' Type R Sump Inlets
7	E	2.18	0.98	1.29	13.8	3.59	6.12	4	8	5' Type R Sump Inlets
7A	G1	0.53	0.24	0.31	5.0	5.00	9.06	1	3	5' Type R At-grade Inlet
7B	G2	0.69	0.31	0.41	5.0	5.00	9.06	2	4	5' Type R At-grade Inlet
8	DESIGN POINTS 1-7 & K	18.06	8.13	10.66	14.8	3.49	5.93	28	63	FSD Pond 1
9	OS-9	11.80						8	19	EX 36" RCP Culvert
10	OS-8	2.56						5	11	EX 36" RCP Culvert
10A	MERIDIAN POND E RELEASE	Meridaian Ranch Filing 3 FDR Calculated Flows						28	185	EX 3-42" RCP Culverts
11	OS-5, I, OS-& MERIDIAN POND E RELEASE	Sum of Basins						34	216	PR 2-42" RCP Culverts
11A	DP 11 & BASIN J	Sum of Basins						37	222	PR 2-42" RCP Culverts

JOB NAME: WATERBURY FDR
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

PELIMINARY DRAINAGE REPORT ~ SURFACE ROUTING SUMMARY

Design Point(s)	Contributing Basins	Area (AC)	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Facility Size
						I(5)	I(100)	Q(5)	Q(100)	
12	OS-6	1.06	0.48	0.63	10.1	4.05	7.04	2	4	18" RCP Culvert
13	TOTAL OFFSITE EX. STOCK POND INFLOW	Per "Final Drainage Report for Waterbury Filing No. 1" dated September 2016, by Classic Consulting						69	396	EX STOCK POND
14	L1	3.79	1.71	2.24	16.1	3.36	5.69	6	13	10' Type R Sump Inlet
15	L2	2.00	0.90	1.18	16.1	3.36	5.69	3	7	5' Type R Sump Inlet
16	O1	2.82	1.27	1.66	13.5	3.62	6.19	5	10	10' Type R Sump Inlet
17	O2	0.71	0.32	0.42	15.5	3.42	5.80	1	2	5' Type R Sump Inlet
18	DESIGN POINTS 14-17 & BASIN OS-4	20.23	5.18	5.50	16.1	3.36	5.69	17	31	Interim FSD Pond 2
19*	Q1 & OS-Q1	1.81	0.69	0.99	13.2	3.66	6.27	3	6	10' Type R Sump Inlet
20*	Q2 & OS-Q2	1.18	0.45	0.65	9.5	4.14	7.24	2	5	5' Type R Sump Inlet
21*	R & OS-R	2.06	0.55	0.98	12.4	3.75	6.44	2	6	10' Type R At-grade Inlet
22*	S1 & OS-S1	1.86	0.72	1.02	12.4	3.75	6.44	3	7	10' Type R Sump Inlet
23*	S2 & OS-S2	0.27	0.07	0.13	5.0	5.00	9.06	0	1	10' Type R Sump Inlet
24*	T1	1.42	0.64	0.84	10.7	3.97	6.88	3	6	5' Type R Sump Inlets
25*	T2 & OS-T2	1.54	0.58	0.84	13.5	3.63	6.20	2	5	5' Type R Sump Inlets
26*	U1	4.38	1.97	2.58	14.3	3.54	6.03	7	16	5' Type R Sump Inlets

JOB NAME: WATERBURY FDR
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

PELIMINARY DRAINAGE REPORT ~ SURFACE ROUTING SUMMARY

Design Point(s)	Contributing Basins	Area (AC)	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Facility Size
						I(5)	I(100)	Q(5)	Q(100)	
27*	U2	1.89	0.85	1.11	13.8	3.59	6.12	3	7	5' Type R Sump Inlets
28	W	5.20	2.34	3.07	15.0	3.47	5.89	8	18	2-10' Type R Sump Inlets
29*	DESIGN POINTS 19-28 & OS-7	24.41	9.13	13.21	15.0	3.47	5.89	32	78	FSD POND 3
E-E*	OS-2 & OS-8	14.58	2.66	6.20	18.4	3.17	5.32	8	33	DIVERSION SWALE E-E
30*	Y, OS-1, OS-2, OS-8 & OS-9	67.82	9.32	20.34	21.1	2.97	4.94	36	120	Triple 36" RCP Culverts
31	V	0.54	0.24	0.32	5.0	5.00	9.06	1	3	18" DIA INLETS
32	X	0.43	0.19	0.25	5.0	5.00	9.06	1	2	18" DIA INLETS
33	O-3	0.45	0.20	0.27	5.0	5.00	9.06	1	2	18" DIA INLETS
34	O-4	0.38	0.17	0.23	5.0	5.00	9.06	1	2	18" DIA INLETS

DESIGN POINT* = DESIGN POINT REVISED FROM MDDP IN PRELIMINARY CONDITION DUE TO UNDEVELOPED UPSTREAM

JOB NAME: WATERBURY FDR
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

* PIPES ARE LISTED AT MAXIMUM SIZE REQUIRED TO ACCOMMODATE Q100 FLOWS AT MINIMUM GRADE.
 REFER TO INDIVIDUAL PIPE SHEETS FOR HYDRAULIC INFORMATION.

PELIMINARY DRAINAGE REPORT ~ PIPE ROUTING SUMMARY

Pipe Run	Contributing Design Points/Basins	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Pipe Size*
					I(5)	I(100)	Q(5)	Q(100)	
1	DP 2	0.39	0.51	6.9	4.58	8.14	2	4	18" RCP
2	DP 1 & 2	1.91	2.51	14.3	3.54	6.03	7	15	24" RCP
3	DP 3	1.03	1.36	14.2	3.55	6.05	4	8	18" RCP
4	DP-4	1.61	2.11	14.8	3.49	5.93	6	13	18" RCP
5	DP 3 & 4	2.64	3.47	14.8	3.49	5.93	9	21	24" RCP
6	DP 1-4	4.56	5.97	14.8	3.49	5.93	16	35	36" RCP
7	DP-1-5	6.20	8.12	14.8	3.49	5.93	22	48	36" RCP
8	DP-6	0.95	1.24	11.4	3.87	6.69	4	8	18" RCP
9	DP-7	0.98	1.29	13.8	3.59	6.12	4	8	18" RCP
10	DP-6 & 7	1.93	2.53	13.8	3.59	6.12	7	15	24" RCP
10A	DP-7A	0.24	0.31	5.0	5.00	9.06	1	3	15" RCP
10B	DP-7A & 7B	0.55	0.72	5.0	5.00	9.06	3	7	18" RCP
10C	Pond 1 Release						0.4	14.5	18" RCP
11	DP-14	1.71	2.24	16.1	3.36	5.69	6	13	24" RCP

JOB NAME: WATERBURY FDR
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

* PIPES ARE LISTED AT MAXIMUM SIZE REQUIRED TO ACCOMMODATE Q100 FLOWS AT MINIMUM GRADE.
 REFER TO INDIVIDUAL PIPE SHEETS FOR HYDRAULIC INFORMATION.

PELIMINARY DRAINAGE REPORT ~ PIPE ROUTING SUMMARY

Pipe Run	Contributing Design Points/Basins	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Pipe Size*
					I(5)	I(100)	Q(5)	Q(100)	
12	DP-15	0.90	1.18	16.1	3.36	5.69	3	7	18" RCP
13	DP 14 & 15	2.61	3.42	16.1	3.36	5.69	9	19	30" RCP
14	DP 16	1.27	1.66	13.5	3.62	6.19	5	10	24" RCP
15	DP 14, 15 & 16	3.88	5.08	16.1	3.36	5.69	13	29	36" RCP
16	DP 17	0.32	0.42	15.5	3.42	5.80	1	2	18" RCP
17	DP 14, 15, 16, & 17	4.20	5.50	16.1	3.36	5.69	14	31	36" RCP
17A	Pond 2 Release						1.1	2.4	18" RCP
18*	DP 19	0.69	0.99	13.2	3.66	6.27	3	6	24" RCP
19*	DP 20	0.45	0.65	9.5	4.14	7.24	2	5	18" RCP
20*	DP 19 & 20	1.15	1.64	13.2	3.66	6.27	4	10	24" RCP
21*	DP 21 PICK UP						2	6	18" RCP
22*	DP 19, 20 & 21	1.69	2.59	13.2	3.66	6.27	6	16	30" RCP
23*	DP 22	0.72	1.02	12.4	3.75	6.44	3	7	24" RCP
24*	DP 23	0.07	0.13	5.0	5.00	9.06	0	1	24" RCP

JOB NAME: WATERBURY FDR
 JOB NUMBER: 1715.00
 DATE: 07/20/22
 CALCULATED BY: QNA

* PIPES ARE LISTED AT MAXIMUM SIZE REQUIRED TO ACCOMMODATE Q100 FLOWS AT MINIMUM GRADE.
 REFER TO INDIVIDUAL PIPE SHEETS FOR HYDRAULIC INFORMATION.

PELIMINARY DRAINAGE REPORT ~ PIPE ROUTING SUMMARY

Pipe Run	Contributing Design Points/Basins	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Pipe Size*
					I(5)	I(100)	Q(5)	Q(100)	
25*	DP 22 & 23	0.80	1.15	12.4	3.75	6.44	3	7	30" RCP
26*	DP 19 -23	2.49	3.74	13.2	3.66	6.27	9	23	36" RCP
27*	DP 24	0.64	0.84	10.7	3.97	6.88	3	6	18" RCP
28*	DP 25	0.58	0.84	13.5	3.63	6.20	2	5	18" RCP
29*	DP 19-25	3.71	5.42	13.5	3.63	6.20	13	34	36" RCP
30*	DP 26	1.97	2.58	14.3	3.54	6.03	7	16	24" RCP
31*	DP 19-26	5.68	8.00	14.3	3.54	6.03	20	48	42" RCP
32*	DP 27	0.85	1.11	13.8	3.59	6.12	3	7	18" RCP
33*	DP 19-27 & 31	6.77	9.43	14.3	3.54	6.03	24	57	42" RCP
34	DP 28	2.34	3.07	15.03	3.47	5.89	8	18	24" RCP
34A	29 & 32	2.53	3.32	15.0	3.47	5.89	9	20	30" RCP
35	Pond 3 Release	MHFD UD-DETENTION POND RELEASE					1	58	36" RCP
36*	DP 30	SUM OF BASINS					36	120	TRIPLE 36" RCP
37	DP 31	0.24	0.32	5.00	5.00	9.06	1	3	15" HDPE
38	DP 32	0.19	0.25	5.00	5.00	9.06	1	2	15" HDPE
39	DP 33	0.20	0.27	5.00	5.00	9.06	1	2	15" HDPE
40	DP 34	0.17	0.23	5.00	5.00	9.06	1	2	15" HDPE

PIPE RUN* = PIPE RUN REVISED FROM MDDP IN PRELIMINARY CONDITION DUE TO UNDEVELOPED UPSTREAM

HYDRAULIC CALCULATIONS

PRELIMINARY GRADING SWALES

MANNING'S EQUATION for OPEN CHANNEL FLOW

Project: **WATERBURY 1&2 MDP/PDR**

Location: **DP-PRE1 DIVERSIONS SWALE A-A**

By: **QNA**

Date: **3/1/2022**

Chk By:

Date:

version 12-2004

Mannings Formula

$$Q = (1.486/n)AR_h^{2/3}S^{1/2}$$


$$R = A/P$$

A = cross sectional area

P= wetted perimeter

S = slope of channel

n = Manning's roughness coefficient

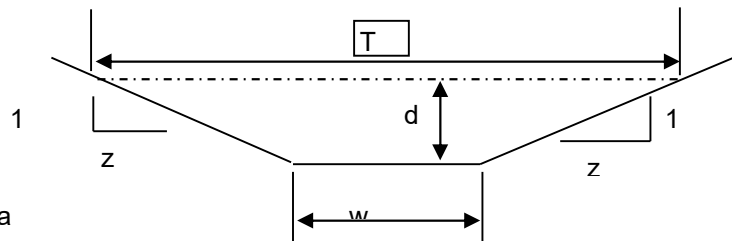

$$V = (1.49/n)R_h^{2/3}S^{1/2}$$

$$Q = V \times A$$

INPUT

z (sideslope)= 4
z (sideslope)= 4
b (btm width, ft)= 2
d (depth, ft)= 1
S (slope, ft/ft) 0.02
n low = 0.02
n high = 0.035

Clear Data
Entry Cells

Depth, ft	Area, sf	Wetted Perimeter, ft	Hydraulic Radius, ft	Low N		High N		T =	Dm =
				Velocity, fps	Flow, cfs	Velocity, fps	Flow, cfs		
1	6.00	10.25	0.59	7.35452611	44.1272	4.202586	25.2155	10	0.600

Sc low = 0.0071 Sc high = 0.0218

s_c = critical slope ft / ft

T = top width of the stream

d_m = a/T = mean depth of flow

.7 Sc	1.3 Sc	.7 Sc	1.3 Sc
0.0050	0.0093	0.0153	0.0284

Created by: Mike O'Shea

MANNING'S EQUATION for OPEN CHANNEL FLOW

Project: **WATERBURY 1&2 MDP/PDR**

Location: **DP-PRE2 DIVERSIONS SWALE B-B**

By: **QNA**

Date: **5/11/2022**

Chk By:

Date:

version 12-2004

Mannings Formula

$$Q = (1.486/n)AR_h^{2/3}S^{1/2}$$


$$R = A/P$$

A = cross sectional area

P= wetted perimeter

S = slope of channel

n = Manning's roughness coefficient

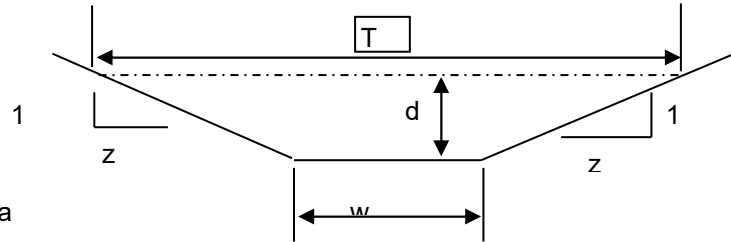

$$V = (1.49/n)R_h^{2/3}S^{1/2}$$

$$Q = V \times A$$

INPUT

z (sideslope)= 4
z (sideslope)= 4
b (btm width, ft)= 2
d (depth, ft)= 0.94
S (slope, ft/ft) 0.02
n low = 0.02
n high = 0.035

Clear Data
Entry Cells

				Low N		High N			
Depth, ft	Area, sf	Wetted Perimeter, ft	Hydraulic Radius, ft	Velocity, fps	Flow, cfs	Velocity, fps	Flow, cfs	T =	
0.94	5.41	9.75	0.56	7.09822442	38.4326	4.056128	21.9615	T =	9.52
								Dm =	0.569
				Sc low =	0.0073	Sc high =	0.0222		
s _c = critical slope ft / ft									
T = top width of the stream				.7 Sc	1.3 Sc	.7 Sc	1.3 Sc		
d _m = a/T = mean depth of flow				0.0051	0.0094	0.0156	0.0289		

s_c = critical slope ft / ft

T = top width of the stream

$d_m = a/T$ = mean depth of flow

Created by: Mike O'Shea

MANNING'S EQUATION for OPEN CHANNEL FLOW

Project: **WATERBURY 1&2 MDP/PDR**

Location: **DP-PRE3 DIVERSIONS SWALE C-C**

By: **QNA**

Date: **3/1/2022**

Chk By:

Date:

version 12-2004

Mannings Formula

$$Q = (1.486/n)AR_h^{2/3}S^{1/2}$$


$$R = A/P$$

A = cross sectional area

P= wetted perimeter

S = slope of channel

n = Manning's roughness coefficient

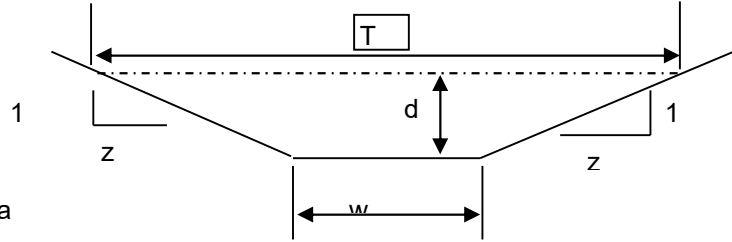

$$V = (1.49/n)R_h^{2/3}S^{1/2}$$

$$Q = V \times A$$

INPUT

z (sideslope)= 4
z (sideslope)= 4
b (btm width, ft)= 3
d (depth, ft)= 1.04
S (slope, ft/ft) 0.02
n low = 0.02
n high = 0.035

Clear Data
Entry Cells

Depth, ft	Area, sf	Wetted Perimeter, ft	Hydraulic Radius, ft	Low N		High N		T =	Dm =
				Velocity, fps	Flow, cfs	Velocity, fps	Flow, cfs		
1.04	7.45	11.58	0.64	7.82986896	58.3043	4.474211	33.3168	11.32	0.658

Sc low = 0.0069 Sc high = 0.0211

s_c = critical slope ft / ft

T = top width of the stream

d_m = a/T = mean depth of flow

.7 Sc	1.3 Sc	.7 Sc	1.3 Sc
0.0048	0.0090	0.0148	0.0275

Created by: Mike O'Shea

MANNING'S EQUATION for OPEN CHANNEL FLOW

Project: **WATERBURY 1&2 MDP/PDR**

Location: **DP-PRE4 DIVERSIONS SWALE D-D**

By: **QNA**

Date: **3/1/2022**

Chk By:

Date:

version 12-2004

Mannings Formula

$$Q = (1.486/n)AR_h^{2/3}S^{1/2}$$


$$R = A/P$$

A = cross sectional area

P= wetted perimeter

S = slope of channel

n = Manning's roughness coefficient

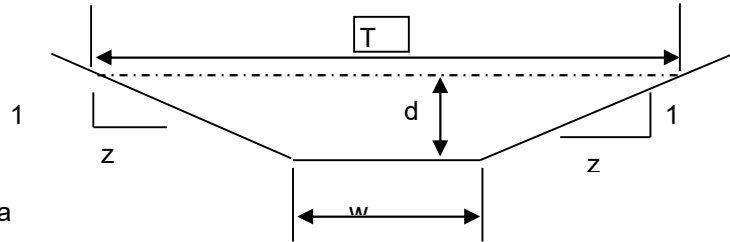

$$V = (1.49/n)R_h^{2/3}S^{1/2}$$

$$Q = V \times A$$

INPUT

z (sideslope)= 4
z (sideslope)= 4
b (btm width, ft)= 2
d (depth, ft)= 0.86
S (slope, ft/ft) 0.02
n low = 0.02
n high = 0.035

Clear Data
Entry Cells

		Low N		High N			
Depth, ft	Area, sf	Wetted Perimeter, ft	Hydraulic Radius, ft	Velocity, fps	Flow, cfs	Velocity, fps	Flow, cfs
0.86	4.68	9.09	0.51	6.74726399	31.5664	3.855579	18.0379
				T =		8.88	
				Dm =		0.527	
				Sc low =		0.0074	
				Sc high =		0.0228	
				.7 Sc		1.3 Sc	
				0.0052		0.0097	
				.7 Sc		1.3 Sc	
				0.0160		0.0296	

s_c = critical slope ft / ft

T = top width of the stream

d_m = a/T = mean depth of flow

Created by: Mike O'Shea

MANNING'S EQUATION for OPEN CHANNEL FLOW

Project: **WATERBURY 1&2 MDP/PDR**

Location: **DP-PRE5 DIVERSIONS SWALE E-E**

By: **QNA**

Date: **3/1/2022**

Chk By:

Date:

version 12-2004

Mannings Formula

$$Q = (1.486/n)AR_h^{2/3}S^{1/2}$$


$$R = A/P$$

A = cross sectional area

P= wetted perimeter

S = slope of channel

n = Manning's roughness coefficient

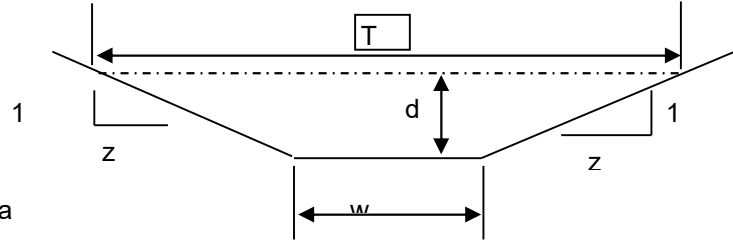

$$V = (1.49/n)R_h^{2/3}S^{1/2}$$

$$Q = V \times A$$


INPUT

z (sideslope)= 4
z (sideslope)= 4
b (btm width, ft)= 4
d (depth, ft)= 0.99
S (slope, ft/ft) 0.02
n low = 0.02
n high = 0.035

Clear Data
Entry Cells

				Low N		High N			
Depth, ft	Area, sf	Wetted Perimeter, ft	Hydraulic Radius, ft	Velocity,		Velocity,		T =	
				fps	Flow, cfs	fps	Flow, cfs		
0.99	7.88	12.16	0.65	7.86716151	61.9964	4.495521	35.4265	Dm =	11.92
				Sc low =		0.0069		Sc high =	
						0.0210			
s _c = critical slope									
T = top width of the stream									
d _m = a/T = mean depth of flow									

MDDP
INLET CALCULATIONS

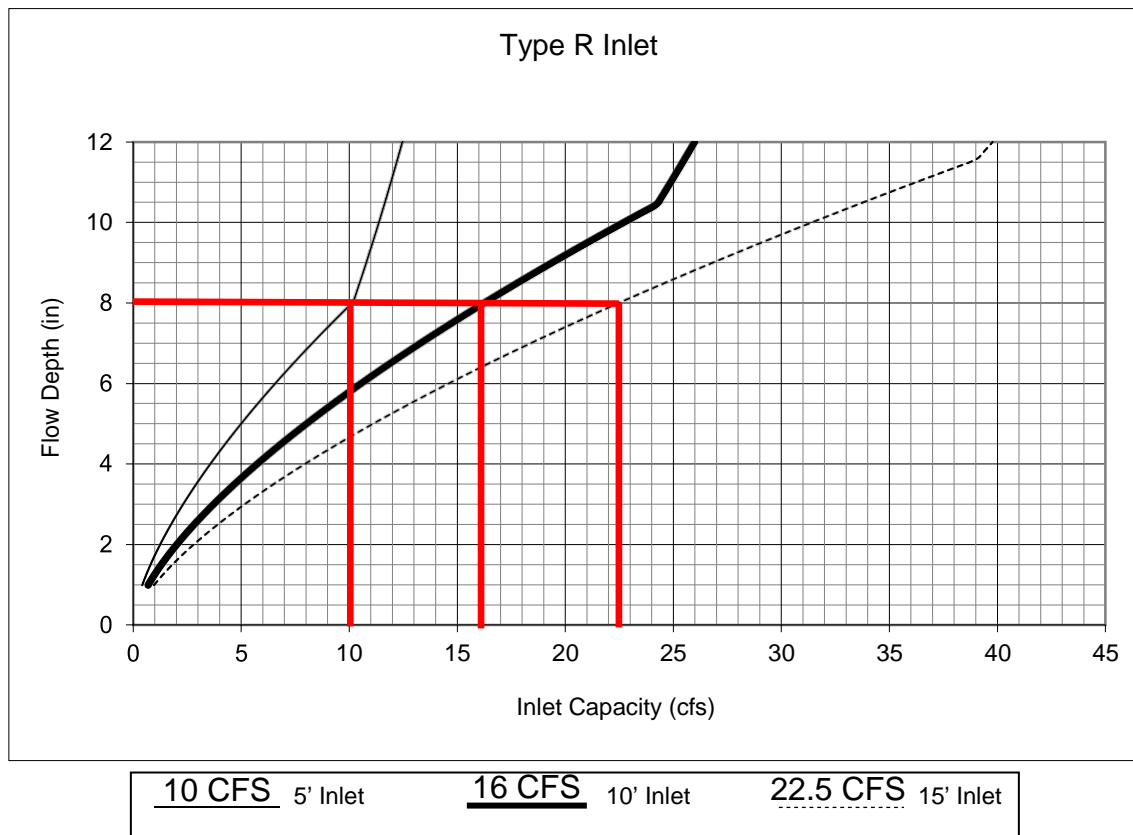Figure 8-11. Inlet Capacity Chart Sump Conditions , Curb Opening (Type R) Inlet

DP1: Q100=12 CFS ---> 10' INLET
 DP2: Q100= 4 CFS ---> 5' INLET
 DP3: Q100= 8 CFS ---> 5' INLET
 DP4: Q100=13 CFS ---> 10' INLET
 DP5: Q100=16 CFS ---> 10' INLET
 DP6: Q100= 8 CFS ---> 5' INLET
 DP7: Q100= 8 CFS ---> 5' INLET
 DP14: Q100=13 CFS ---> 10' INLET
 DP15: Q100= 7 CFS ---> 5' INLET
 DP16: Q100= 10 CFS ---> 10' INLET

DP17: Q100= 2 CFS ---> 10' INLET
 DP19: Q100= 16 CFS ---> 10' INLET
 DP20: Q100= 7 CFS ---> 5' INLET
 DP22: Q100= 16 CFS ---> 10' INLET
 DP23: Q100= 16 CFS ---> 10' INLET
 DP24: Q100= 6 CFS ---> 5' INLET
 DP25: Q100= 7 CFS ---> 5' INLET
 DP26: Q100= 16 CFS ---> 10' INLET
 DP27: Q100= 7 CFS ---> 5' INLET
 DP28: Q100= 18 CFS ---> 2-10' INLETS

Notes:


1. The standard inlet parameters must apply to use this chart.

DP 7A 5' At-Grade Inlet
 $Q_5 = 1 \text{ cfs}$, $Q_{100} = 3 \text{ cfs}$
 Sagbrook Slope = 3.11%


Figure 8-7. Inlet Capacity Chart Continuous Grade Conditions, Residential (Local)
 (Attached and Detached Sidewalk)

Street Section Data: Street Width Flowline to Flowline = 34'
 Type of Curb and Gutter: D-10-R = 8" vertical
 Type 16 = 6" vertical

Minor Storm

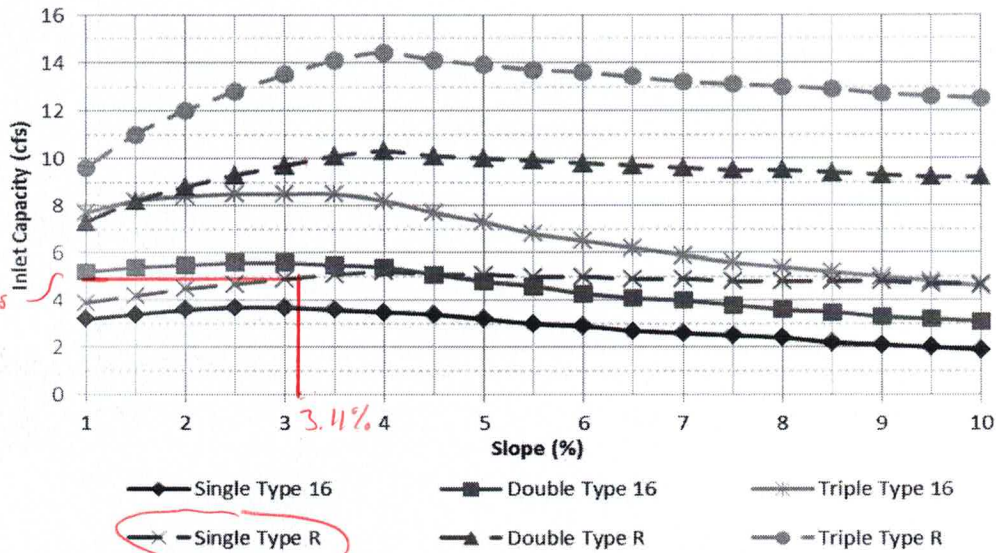

Major Storm

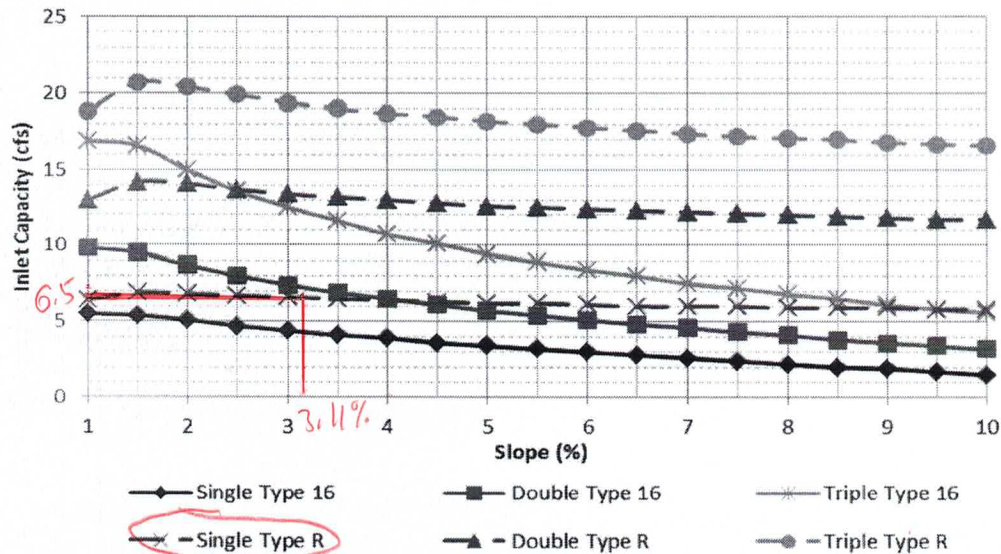


The standard street section parameters as defined in Chapter 7 must apply to use these charts. For non-standard sections, the inlet capacity shall be calculated using the UDFCD spreadsheets. The maximum spread width is limited by the curb height based on no curb overtopping during a minor storm and flow being contained within the public right-of-way during the major storm. Calculations were done using UD-Inlet 3.00.xls, Mar., 2011 with the default clogging factors.

DP 7B 5' At-Grade Inlet
 $Q_5 = 2 \text{ cfs}$, $Q_{100} = 4 \text{ cfs}$
 Daybrook Slope = 2.90%

Figure 8-7. Inlet Capacity Chart Continuous Grade Conditions, Residential (Local)
 (Attached and Detached Sidewalk)

Street Section Data: Street Width Flowline to Flowline = 34'
 Type of Curb and Gutter: D-10-R = 8" vertical
 Type 16 = 6" vertical

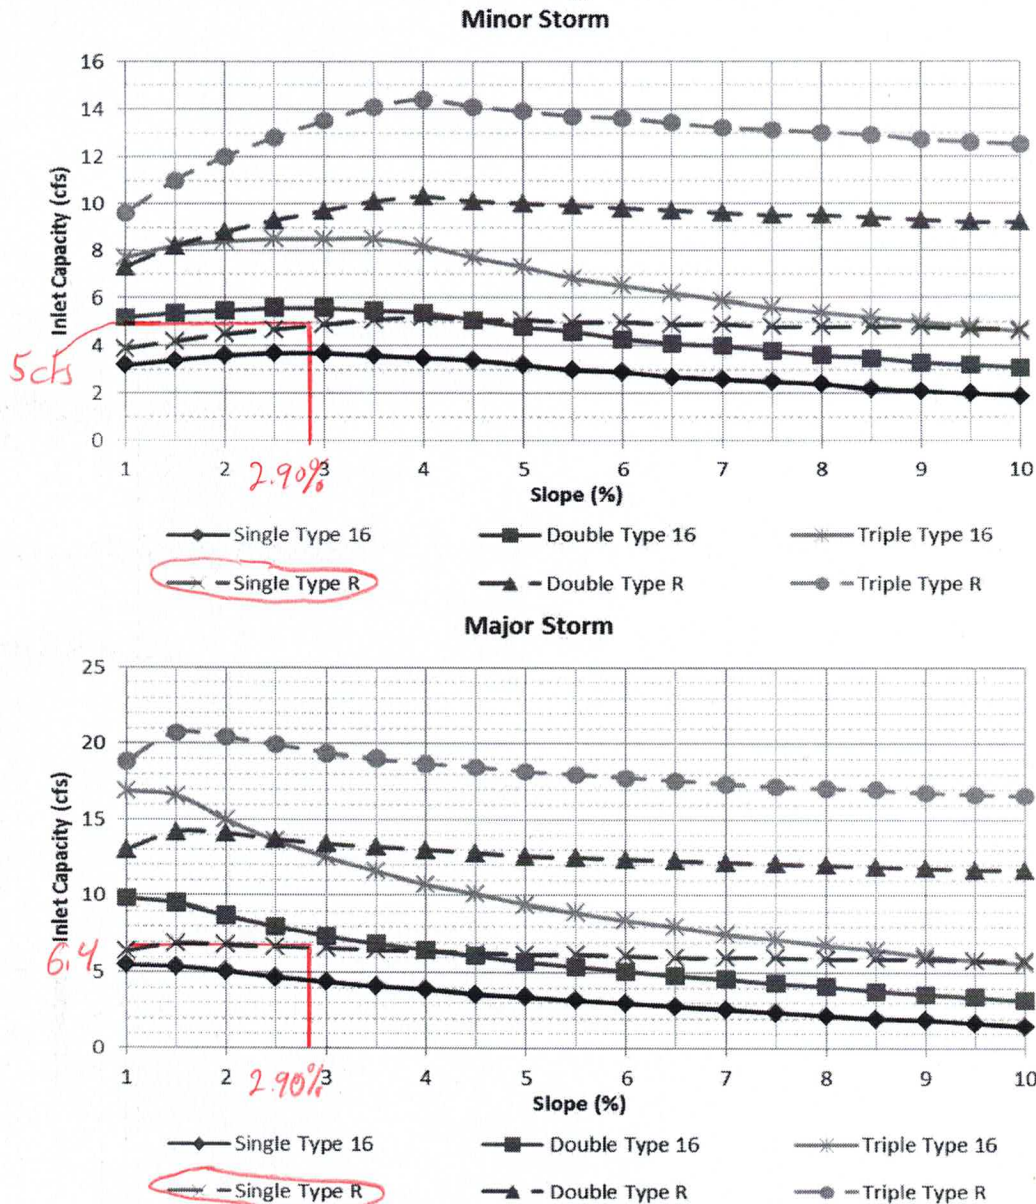

The standard street section parameters as defined in Chapter 7 must apply to use these charts. For non-standard sections, the inlet capacity shall be calculated using the UDFCD spreadsheets. The maximum spread width is limited by the curb height based on no curb overtopping during a minor storm and flow being contained within the public right-of-way during the major storm. Calculations were done using UD-Inlet 3.00.xls, Mar., 2011 with the default clogging factors.


DP-21 10' TYPE R - At Grade

$Q_5 = 12$, $Q_{100} = 28$
Muddy Pond Slope = 1.75%


Figure 8-7. Inlet Capacity Chart Continuous Grade Conditions, Residential (Local)
(Attached and Detached Sidewalk)

Street Section Data: Street Width Flowline to Flowline = 34'
Type of Curb and Gutter: D-10-R = 8" vertical
Type 16 = 6" vertical

Minor Storm

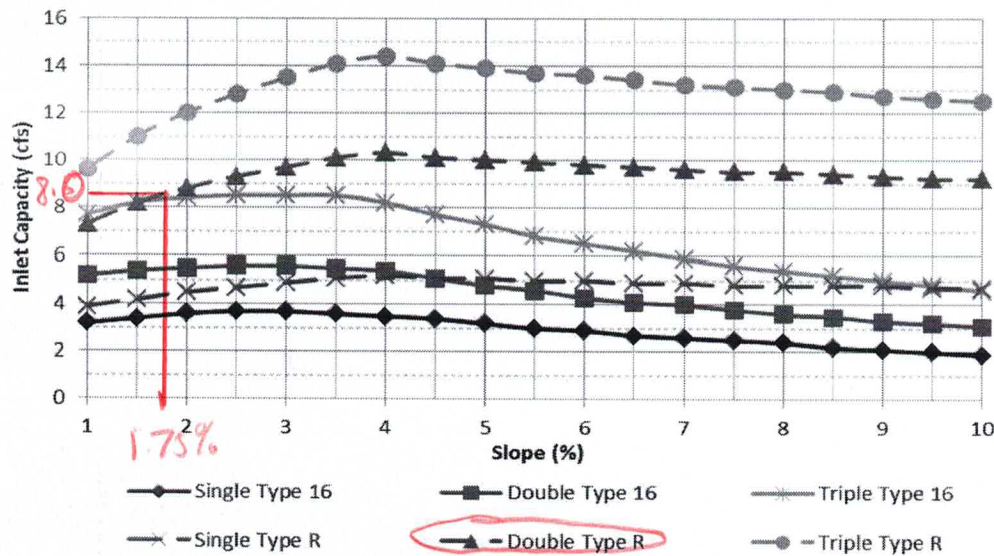


Major Storm

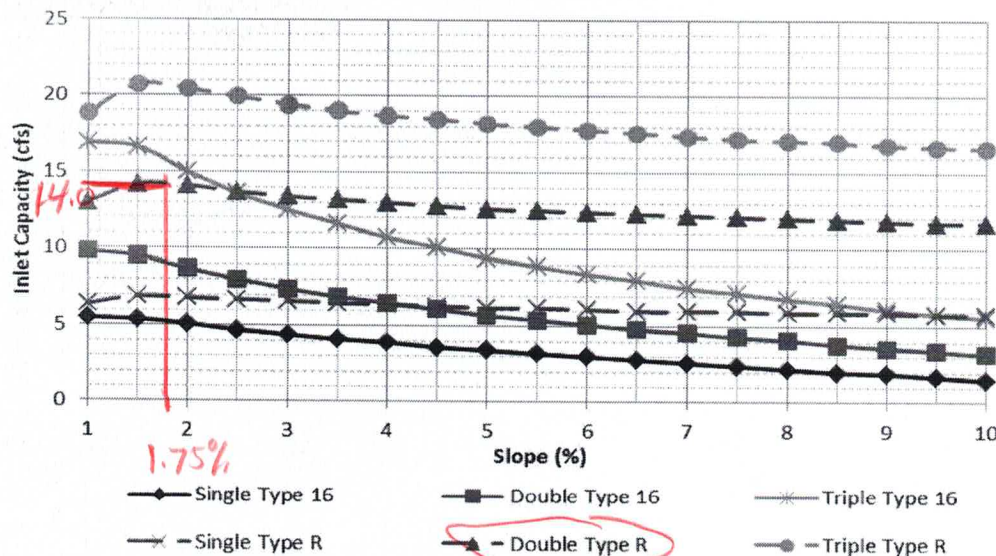

The standard street section parameters as defined in Chapter 7 must apply to use these charts. For non-standard sections, the inlet capacity shall be calculated using the UDFCD spreadsheets. The maximum spread width is limited by the curb height based on no curb overtopping during a minor storm and flow being contained within the public right-of-way during the major storm. Calculations were done using UD-Inlet 3.00.xls, Mar., 2011 with the default clogging factors.

Nyloplast 18" Drop In Grate Inlet Capacity Chart

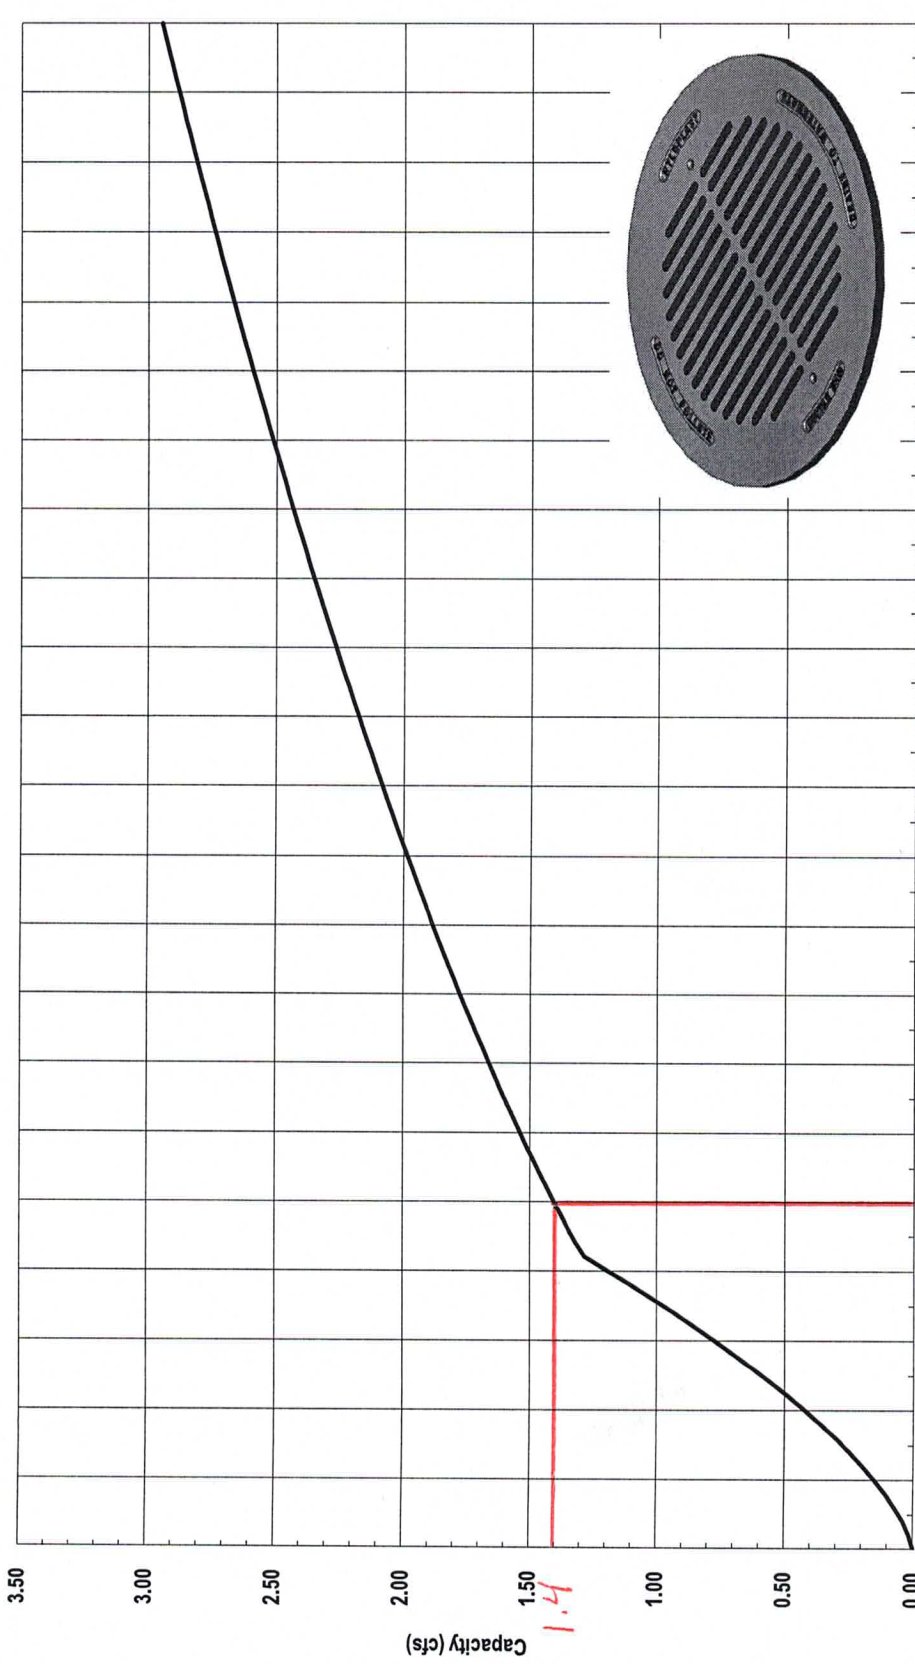

Head (ft)	Capacity (cfs)
0.00	0.00
0.05	0.10
0.10	0.20
0.15	0.30
0.20	0.40
0.25	0.50
0.30	0.60
0.35	0.70
0.40	0.80
0.45	0.90
0.50	1.00
0.55	1.10
0.60	1.20
0.65	1.30
0.70	1.40
0.75	1.50
0.80	1.60
0.85	1.70
0.90	1.80
0.95	1.90
1.00	2.00
1.05	2.10
1.10	2.20



Nyloplast

3130 Verona Avenue • Buford, GA 30518
 (866) 888-8479 / (770) 932-2443 • Fax: (770) 932-2490
 © Nyloplast Inlet Capacity Charts June 2012

MDDP
PIPE CALCULATIONS


Manning Formula Uniform Pipe Flow at Given Slope and Depth

Check out our spreadsheet version of this calculator [Download Spreadsheet](#) [Open Google Sheets version](#) [View All Spreadsheets](#)

Pipe run 1

18" RCP @ 1.00%

Inputs			Results		
Pipe diameter, d ₀	18	in ▾	Flow, Q	4.0349	cfs ▾
Manning roughness, n	.013		Velocity, v	5.5533	ft/sec ▾
Pressure slope (possibly ? equal to pipe slope), S ₀	1	% rise/run ▾	Velocity head, h _v	0.4793	ft H2O ▾
Percent of (or ratio to) full depth (100% or 1 if flowing full)	43	% ▾	Flow area	0.7266	ft^2 ▾
			Wetted perimeter	2.1455	ft ▾
			Hydraulic radius	0.3387	ft ▾
			Top width, T	1.4852	ft ▾
			Froude number, F	1.40	
			Shear stress (tractive force), tau	0.2114	psf ▾



Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 2


24" RCP @ 0.60%

Inputs

Pipe diameter, d ₀	24	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	0.60	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	71.5	%

Results

Flow, Q (See notes)	15.0755	cfs
Velocity, v	6.2725	ft/sec
Velocity head, h _v	0.6115	ft H2O
Flow area	2.4035	ft^2
Wetted perimeter	4.0305	ft
Hydraulic radius	0.5963	ft
Top width, T	1.8056	ft
Froude number, F	0.96	
Average shear stress (tractive force), tau	0.2234	psf



Notes:

This is the flow and depth *inside* the pipe.

Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Check out our spreadsheet version of this calculator [Download Spreadsheet](#) [Open Google Sheets version](#) [View All Spreadsheets](#)

Pipe run 3


18" RCP @ 2.00%

Inputs

Pipe diameter, d_0	18	in	▼
Manning roughness, n	.013		
Pressure slope (possibly ? equal to pipe slope), S_0	2	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	52.3	%	▼

Results

Flow, Q	8.0101	cfs	▼
Velocity, v	8.5644	ft/sec	▼
Velocity head, h_v	1.1400	ft H2O	▼
Flow area	0.9353	ft^2	▼
Wetted perimeter	2.4252	ft	▼
Hydraulic radius	0.3857	ft	▼
Top width, T	1.4984	ft	▼
Froude number, F	1.91		
Shear stress (tractive force), τ	0.4815	psf	▼



Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 4


18" RCP @ 1.9%

Inputs

Pipe diameter, d ₀	18	in ▾
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	1.9	% rise/run ▾
Percent of (or ratio to) full depth (100% or 1 if flowing full)	74.1	% ▾

Results

Flow, Q (See notes)	13.0159	cfs ▾
Velocity, v	9.2707	ft/sec ▾
Velocity head, h _v	1.3357	ft H2O ▾
Flow area	1.4040	ft^2 ▾
Wetted perimeter	3.1106	ft ▾
Hydraulic radius	0.4514	ft ▾
Top width, T	1.3142	ft ▾
Froude number, F	1.58	
Average shear stress (tractive force), tau	0.5354	psf ▾



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 5


24" RCP @ 1.5%

Inputs

Pipe diameter, d ₀	24	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	1.5	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	65.1	%

Results

Flow, Q (See notes)	21.0015	cfs
Velocity, v	9.6986	ft/sec
Velocity head, h _v	1.4619	ft H2O
Flow area	2.1655	ft^2
Wetted perimeter	3.7551	ft
Hydraulic radius	0.5767	ft
Top width, T	1.9066	ft
Froude number, F	1.60	
Average shear stress (tractive force), tau	0.5400	psf



Notes:

This is the flow and depth *inside* the pipe.

Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 6


36" RCP @ 0.7%

Inputs

Pipe diameter, d ₀	36	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	0.7	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	57.5	%

Results

Flow, Q (See notes)	35.0885	cfs
Velocity, v	8.3413	ft/sec
Velocity head, h _v	1.0813	ft H2O
Flow area	4.2068	ft^2
Wetted perimeter	5.1640	ft
Hydraulic radius	0.8146	ft
Top width, T	2.9660	ft
Froude number, F	1.23	
Average shear stress (tractive force), tau	0.3560	psf



Notes:

This is the flow and depth *inside* the pipe.

Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 7


36" RCP @ 0.74%

Inputs

Pipe diameter, d ₀	36	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	0.74	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	70	%

Results

Flow, Q (See notes)	48.0328	cfs
Velocity, v	9.0887	ft/sec
Velocity head, h _v	1.2838	ft H2O
Flow area	5.2851	ft^2
Wetted perimeter	5.9469	ft
Hydraulic radius	0.8887	ft
Top width, T	2.7495	ft
Froude number, F	1.16	
Average shear stress (tractive force), tau	0.4106	psf



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Check out our spreadsheet version of this calculator [Download Spreadsheet](#) [Open Google Sheets version](#) [View All Spreadsheets](#)

Pipe run 8


18" RCP @ 1.00%

Inputs

Pipe diameter, d_0	18	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S_0	1	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	65.4	%	▼

Results

Flow, Q	8.0145	cfs	▼
Velocity, v	6.5452	ft/sec	▼
Velocity head, h_v	0.6658	ft H2O	▼
Flow area	1.2245	ft^2	▼
Wetted perimeter	2.8258	ft	▼
Hydraulic radius	0.4333	ft	▼
Top width, T	1.4271	ft	▼
Froude number, F	1.25		
Shear stress (tractive force), τ	0.2705	psf	▼



Manning Formula Uniform Pipe Flow at Given Slope and Depth

Check out our spreadsheet version of this calculator [Download Spreadsheet](#) [Open Google Sheets version](#) [View All Spreadsheets](#)

Pipe run 9


18" RCP @ 1.00%

Inputs

Pipe diameter, d_0	18	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S_0	1	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	65.4	%	▼

Results

Flow, Q	8.0145	cfs	▼
Velocity, v	6.5452	ft/sec	▼
Velocity head, h_v	0.6658	ft H2O	▼
Flow area	1.2245	ft^2	▼
Wetted perimeter	2.8258	ft	▼
Hydraulic radius	0.4333	ft	▼
Top width, T	1.4271	ft	▼
Froude number, F	1.25		
Shear stress (tractive force), τ	0.2705	psf	▼



Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 10


24" RCP" @ 0.60%

Inputs

Pipe diameter, d ₀	24	in ▾
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	.6	% rise/run ▾
Percent of (or ratio to) full depth (100% or 1 if flowing full)	75.1	% ▾

Results

Flow, Q (See notes)	16.0022	cfs ▾
Velocity, v	6.3230	ft/sec ▾
Velocity head, h _v	0.6214	ft H2O ▾
Flow area	2.5309	ft^2 ▾
Wetted perimeter	4.1934	ft ▾
Hydraulic radius	0.6035	ft ▾
Top width, T	1.7297	ft ▾
Froude number, F	0.92	
Average shear stress (tractive force), tau	0.2261	psf ▾



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 10A


15" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	15	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	1	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	48	%

Results

Flow, Q (See notes)	3.0116	cfs
Velocity, v	5.1715	ft/sec
Velocity head, h _v	0.4157	ft H2O
Flow area	0.5824	ft^2
Wetted perimeter	1.9135	ft
Hydraulic radius	0.3043	ft
Top width, T	1.2490	ft
Froude number, F	1.34	
Average shear stress (tractive force), tau	0.1900	psf



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 10B


18" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	18	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	1	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	60	%	▼

Results

Flow, Q (See notes)	7.0566	cfs	▼
Velocity, v	6.3743	ft/sec	▼
Velocity head, h _v	0.6315	ft H2O	▼
Flow area	1.1071	ft^2	▼
Wetted perimeter	2.6582	ft	▼
Hydraulic radius	0.4165	ft	▼
Top width, T	1.4697	ft	▼
Froude number, F	1.29		
Average shear stress (tractive force), tau	0.2600	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 10C


24" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	24	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	1	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	58.3	%

Results

Flow, Q (See notes)	14.5364	cfs
Velocity, v	7.6459	ft/sec
Velocity head, h _v	0.9086	ft H2O
Flow area	1.9013	ft^2
Wetted perimeter	3.4751	ft
Hydraulic radius	0.5471	ft
Top width, T	1.9722	ft
Froude number, F	1.37	
Average shear stress (tractive force), tau	0.3416	psf



Notes:

This is the flow and depth *inside* the pipe.

Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 11


24" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	24	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	1	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	54.4	%

Results

Flow, Q (See notes)	13.0149	cfs
Velocity, v	7.4519	ft/sec
Velocity head, h _v	0.8631	ft H2O
Flow area	1.7466	ft^2
Wetted perimeter	3.3178	ft
Hydraulic radius	0.5264	ft
Top width, T	1.9922	ft
Froude number, F	1.40	
Average shear stress (tractive force), tau	0.3286	psf



Notes:

This is the flow and depth *inside* the pipe.

Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 12


18" RCP @ 1.00%

Inputs

Pipe diameter, d_0	18	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S_0	1	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	60	%	▼

Results

Flow, Q (See notes)	7.0566	cfs	▼
Velocity, v	6.3743	ft/sec	▼
Velocity head, h_v	0.6315	ft H2O	▼
Flow area	1.1071	ft^2	▼
Wetted perimeter	2.6582	ft	▼
Hydraulic radius	0.4165	ft	▼
Top width, T	1.4697	ft	▼
Froude number, F	1.29		
Average shear stress (tractive force), τ	0.2600	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 13


30" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	30	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	1	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	47.9	%

Results

Flow, Q (See notes)	19.0535	cfs
Velocity, v	8.2018	ft/sec
Velocity head, h _v	1.0455	ft H2O
Flow area	2.3232	ft^2
Wetted perimeter	3.8219	ft
Hydraulic radius	0.6078	ft
Top width, T	2.4978	ft
Froude number, F	1.50	
Average shear stress (tractive force), tau	0.3795	psf



Notes:

This is the flow and depth *inside* the pipe.

Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 14


24" RCP" @ 1.00%

Inputs

Pipe diameter, d ₀	24	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	1	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	46.6	%	▼

Results

Flow, Q (See notes)	10.0183	cfs	▼
Velocity, v	6.9821	ft/sec	▼
Velocity head, h _v	0.7576	ft H2O	▼
Flow area	1.4349	ft^2	▼
Wetted perimeter	3.0055	ft	▼
Hydraulic radius	0.4774	ft	▼
Top width, T	1.9954	ft	▼
Froude number, F	1.45		
Average shear stress (tractive force), tau	0.2981	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 15


36" RCP 1.00%

Inputs

Pipe diameter, d ₀	36	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	1.00	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	48.9	%	▼

Results

Flow, Q (See notes)	32.1044	cfs	▼
Velocity, v	9.3457	ft/sec	▼
Velocity head, h _v	1.3575	ft H2O	▼
Flow area	3.4353	ft^2	▼
Wetted perimeter	4.6463	ft	▼
Hydraulic radius	0.7393	ft	▼
Top width, T	2.9992	ft	▼
Froude number, F	1.54		
Average shear stress (tractive force), tau	0.4616	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.


Manning Formula Uniform Pipe Flow at Given Slope and Depth

Check out our spreadsheet version of this calculator [Download Spreadsheet](#) [Open Google Sheets version](#) [View All Spreadsheets](#)

Pipe run 16

18" RCP @ 17.80%

Inputs			Results		
Pipe diameter, d ₀	18	in ▾	Flow, Q	2.0660	cfs ▾
Manning roughness, n	.013		Velocity, v	12.7995	ft/sec ▾
Pressure slope (possibly ? equal to pipe slope), S ₀	17.8	% rise/run ▾	Velocity head, h _v	2.5462	ft H2O ▾
Percent of (or ratio to) full depth (100% or 1 if flowing full)	14.7	% ▾	Flow area	0.1614	ft^2 ▾
			Wetted perimeter	1.1804	ft ▾
			Hydraulic radius	0.1367	ft ▾
			Top width, T	1.0623	ft ▾
			Froude number, F	5.83	
			Shear stress (tractive force), tau	1.5195	psf ▾



Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 17


36" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	36	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	1	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	50.6	%

Results

Flow, Q (See notes)	34.0263	cfs
Velocity, v	9.4829	ft/sec
Velocity head, h _v	1.3976	ft H2O
Flow area	3.5883	ft^2
Wetted perimeter	4.7483	ft
Hydraulic radius	0.7557	ft
Top width, T	2.9998	ft
Froude number, F	1.53	
Average shear stress (tractive force), tau	0.4718	psf



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 17A


18" RCP @ 1.92%

Inputs

Pipe diameter, d ₀	18	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	1.92	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	85.9	%	▼

Results

Flow, Q (See notes)	15.1111	cfs	▼
Velocity, v	9.3558	ft/sec	▼
Velocity head, h _v	1.3604	ft H2O	▼
Flow area	1.6152	ft^2	▼
Wetted perimeter	3.5575	ft	▼
Hydraulic radius	0.4540	ft	▼
Top width, T	1.0441	ft	▼
Froude number, F	1.33		
Average shear stress (tractive force), tau	0.5442	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 18


24" RCP @ 1.00%

Inputs

Pipe diameter, d_0	24	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S_0	1	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	62.2	%

Results

Flow, Q (See notes)	16.0460	cfs
Velocity, v	7.8127	ft/sec
Velocity head, h_v	0.9486	ft H2O
Flow area	2.0539	ft^2
Wetted perimeter	3.6345	ft
Hydraulic radius	0.5651	ft
Top width, T	1.9395	ft
Froude number, F	1.34	
Average shear stress (tractive force), τ	0.3528	psf



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 19


18" RCP" @ 1.00%

Inputs

Pipe diameter, d ₀	18	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	1.0	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	60	%	▼

Results

Flow, Q (See notes)	7.0566	cfs	▼
Velocity, v	6.3743	ft/sec	▼
Velocity head, h _v	0.6315	ft H2O	▼
Flow area	1.1071	ft^2	▼
Wetted perimeter	2.6582	ft	▼
Hydraulic radius	0.4165	ft	▼
Top width, T	1.4697	ft	▼
Froude number, F	1.29		
Average shear stress (tractive force), tau	0.2600	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 20


24" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	24	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	1	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	80	%

Results

Flow, Q (See notes)	22.1105	cfs
Velocity, v	8.2067	ft/sec
Velocity head, h _v	1.0467	ft H2O
Flow area	2.6943	ft^2
Wetted perimeter	4.4285	ft
Hydraulic radius	0.6084	ft
Top width, T	1.6000	ft
Froude number, F	1.12	
Average shear stress (tractive force), tau	0.3798	psf



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 21


18" RCP" @ 2.00%

Inputs

Pipe diameter, d ₀	18	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	2	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	77.3	%	▼

Results

Flow, Q (See notes)	14.0127	cfs	▼
Velocity, v	9.5603	ft/sec	▼
Velocity head, h _v	1.4205	ft H2O	▼
Flow area	1.4658	ft^2	▼
Wetted perimeter	3.2225	ft	▼
Hydraulic radius	0.4548	ft	▼
Top width, T	1.2567	ft	▼
Froude number, F	1.56		
Average shear stress (tractive force), tau	0.5679	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 22


30" RCP @ 1.85%

Inputs

Pipe diameter, d ₀	30	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	1.85	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	58.5	%

Results

Flow, Q (See notes)	36.0404	cfs
Velocity, v	12.0821	ft/sec
Velocity head, h _v	2.2687	ft H2O
Flow area	2.9831	ft^2
Wetted perimeter	4.3540	ft
Hydraulic radius	0.6851	ft
Top width, T	2.4636	ft
Froude number, F	1.94	
Average shear stress (tractive force), tau	0.7913	psf



Notes:

This is the flow and depth *inside* the pipe.


Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 23

24" RCP" @ 1.00%

Inputs			Results		
Pipe diameter, d ₀	24	in ▾	Flow, Q (See notes)	16.0460	cfs ▾
Manning roughness, n	0.013		Velocity, v	7.8127	ft/sec ▾
Pressure slope (possibly ? equal to pipe slope), S ₀	1.0	% rise/run ▾	Velocity head, h _v	0.9486	ft H2O ▾
Percent of (or ratio to) full depth (100% or 1 if flowing full)	62.2	% ▾	Flow area	2.0539	ft^2 ▾
			Wetted perimeter	3.6345	ft ▾
			Hydraulic radius	0.5651	ft ▾
			Top width, T	1.9395	ft ▾
			Froude number, F	1.34	
			Average shear stress (tractive force), tau	0.3528	psf ▾



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 24


24" RCP" @ 1.00%

Inputs

Pipe diameter, d ₀	24	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	1.0	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	62.2	%	▼

Results

Flow, Q (See notes)	16.0460	cfs	▼
Velocity, v	7.8127	ft/sec	▼
Velocity head, h _v	0.9486	ft H2O	▼
Flow area	2.0539	ft^2	▼
Wetted perimeter	3.6345	ft	▼
Hydraulic radius	0.5651	ft	▼
Top width, T	1.9395	ft	▼
Froude number, F	1.34		
Average shear stress (tractive force), tau	0.3528	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 25


30" RCP" @ 1.00%

Inputs

Pipe diameter, d ₀	30	in ▾
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	1.0	% rise/run ▾
Percent of (or ratio to) full depth (100% or 1 if flowing full)	68	% ▾

Results

Flow, Q (See notes)	33.0363	cfs ▾
Velocity, v	9.2943	ft/sec ▾
Velocity head, h _v	1.3426	ft H2O ▾
Flow area	3.5546	ft^2 ▾
Wetted perimeter	4.8476	ft ▾
Hydraulic radius	0.7332	ft ▾
Top width, T	2.3324	ft ▾
Froude number, F	1.33	
Average shear stress (tractive force), tau	0.4578	psf ▾



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 26


36" RCP @ 1.36%

Inputs

Pipe diameter, d_0	36	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S_0	1.36	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	68.3	%

Results

Flow, Q (See notes)	63.0231	cfs
Velocity, v	12.2528	ft/sec
Velocity head, h_v	2.3333	ft H2O
Flow area	5.1438	ft^2
Wetted perimeter	5.8365	ft
Hydraulic radius	0.8813	ft
Top width, T	2.7918	ft
Froude number, F	1.59	
Average shear stress (tractive force), τ	0.7483	psf



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Check out our spreadsheet version of this calculator [Download Spreadsheet](#) [Open Google Sheets version](#) [View All Spreadsheets](#)

Pipe run 27


18" RCP @ 3.00%

Inputs

Pipe diameter, d_0	18	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S_0	3.00	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	39.8	%	▼

Results

Flow, Q	6.0746	cfs	▼
Velocity, v	9.2649	ft/sec	▼
Velocity head, h_v	1.3341	ft H2O	▼
Flow area	0.6557	ft^2	▼
Wetted perimeter	2.0480	ft	▼
Hydraulic radius	0.3201	ft	▼
Top width, T	1.4684	ft	▼
Froude number, F	2.45		
Shear stress (tractive force), τ	0.5996	psf	▼



Manning Formula Uniform Pipe Flow at Given Slope and Depth

Check out our spreadsheet version of this calculator [Download Spreadsheet](#) [Open Google Sheets version](#) [View All Spreadsheets](#)

Pipe run 28


18" RCP @ 3.00%

Inputs

Pipe diameter, d_0	18	in ▾
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S_0	3.00	% rise/run ▾
Percent of (or ratio to) full depth (100% or 1 if flowing full)	43.1	% ▾

Results

Flow, Q	7.0177	cfs ▾
Velocity, v	9.6292	ft/sec ▾
Velocity head, h_v	1.4411	ft H2O ▾
Flow area	0.7288	ft^2 ▾
Wetted perimeter	2.1485	ft ▾
Hydraulic radius	0.3392	ft ▾
Top width, T	1.4856	ft ▾
Froude number, F	2.42	
Shear stress (tractive force), τ	0.6353	psf ▾



Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 29


36" RCP @ 1.67%

Inputs

Pipe diameter, d ₀	36	in ▾
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	1.67	% rise/run ▾
Percent of (or ratio to) full depth (100% or 1 if flowing full)	70.7	% ▾

Results

Flow, Q (See notes)	73.0952	cfs ▾
Velocity, v	13.6820	ft/sec ▾
Velocity head, h _v	2.9093	ft H2O ▾
Flow area	5.3427	ft^2 ▾
Wetted perimeter	5.9929	ft ▾
Hydraulic radius	0.8915	ft ▾
Top width, T	2.7308	ft ▾
Froude number, F	1.72	
Average shear stress (tractive force), tau	0.9294	psf ▾



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 30


24" RCP" @ 4.26%

Inputs

Pipe diameter, d ₀	24	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	4.26	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	40.4	%	▼

Results

Flow, Q (See notes)	16.0217	cfs	▼
Velocity, v	13.4735	ft/sec	▼
Velocity head, h _v	2.8214	ft H2O	▼
Flow area	1.1892	ft^2	▼
Wetted perimeter	2.7552	ft	▼
Hydraulic radius	0.4316	ft	▼
Top width, T	1.9628	ft	▼
Froude number, F	3.05		
Average shear stress (tractive force), tau	1.1479	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 31


42" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	42	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	1.00	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	71.2	%

Results

Flow, Q (See notes)	86.0951	cfs
Velocity, v	11.7499	ft/sec
Velocity head, h _v	2.1457	ft H2O
Flow area	7.3276	ft^2
Wetted perimeter	7.0302	ft
Hydraulic radius	1.0423	ft
Top width, T	3.1698	ft
Froude number, F	1.36	
Average shear stress (tractive force), tau	0.6507	psf



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 32


18" RCP" @ 11.70%

Inputs

Pipe diameter, d ₀	18	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	11.70	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	30	%	▼

Results

Flow, Q (See notes)	7.0356	cfs	▼
Velocity, v	15.7797	ft/sec	▼
Velocity head, h _v	3.8699	ft H2O	▼
Flow area	0.4459	ft^2	▼
Wetted perimeter	1.7389	ft	▼
Hydraulic radius	0.2564	ft	▼
Top width, T	1.3748	ft	▼
Froude number, F	4.90		
Average shear stress (tractive force), tau	1.8729	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 33


42" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	42	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	1.00	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	75.2	%

Results

Flow, Q (See notes)	92.0184	cfs
Velocity, v	11.8563	ft/sec
Velocity head, h _v	2.1847	ft H2O
Flow area	7.7615	ft^2
Wetted perimeter	7.3465	ft
Hydraulic radius	1.0565	ft
Top width, T	3.0229	ft
Froude number, F	1.30	
Average shear stress (tractive force), tau	0.6595	psf



Notes:

This is the flow and depth *inside* the pipe.

Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 34


24" RCP" @ 0.40%

Inputs

Pipe diameter, d ₀	24	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	0.4	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	57.6	%	▼

Results

Flow, Q (See notes)	9.0211	cfs	▼
Velocity, v	4.8149	ft/sec	▼
Velocity head, h _v	0.3603	ft H2O	▼
Flow area	1.8736	ft^2	▼
Wetted perimeter	3.4467	ft	▼
Hydraulic radius	0.5436	ft	▼
Top width, T	1.9767	ft	▼
Froude number, F	0.87		
Average shear stress (tractive force), tau	0.1357	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 34A


30" RCP" @ 0.40%

Inputs

Pipe diameter, d ₀	30	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	0.4	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	66	%	▼

Results

Flow, Q (See notes)	20.0495	cfs	▼
Velocity, v	5.8336	ft/sec	▼
Velocity head, h _v	0.5289	ft H2O	▼
Flow area	3.4371	ft^2	▼
Wetted perimeter	4.7413	ft	▼
Hydraulic radius	0.7249	ft	▼
Top width, T	2.3685	ft	▼
Froude number, F	0.85		
Average shear stress (tractive force), tau	0.1810	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 35


36" RCP @ 1.34%

Inputs

Pipe diameter, d ₀	36	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	1.34	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	64.7	%

Results

Flow, Q (See notes)	58.0105	cfs
Velocity, v	11.9910	ft/sec
Velocity head, h _v	2.2347	ft H2O
Flow area	4.8380	ft^2
Wetted perimeter	5.6076	ft
Hydraulic radius	0.8627	ft
Top width, T	2.8674	ft
Froude number, F	1.63	
Average shear stress (tractive force), tau	0.7217	psf



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 37


15" HDPE @ 1%

Inputs

Pipe diameter, d_0	15	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S_0	1.00	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	48	%

Results

Flow, Q (See notes)	3.0116	cfs
Velocity, v	5.1715	ft/sec
Velocity head, h_v	0.4157	ft H2O
Flow area	0.5824	ft^2
Wetted perimeter	1.9135	ft
Hydraulic radius	0.3043	ft
Top width, T	1.2490	ft
Froude number, F	1.34	
Average shear stress (tractive force), τ	0.1900	psf



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 38


15" HDPE @ 1%

Inputs

Pipe diameter, d_0	15	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S_0	1.00	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	38.3	%

Results

Flow, Q (See notes)	2.0096	cfs
Velocity, v	4.6470	ft/sec
Velocity head, h_v	0.3356	ft H2O
Flow area	0.4325	ft^2
Wetted perimeter	1.6682	ft
Hydraulic radius	0.2592	ft
Top width, T	1.2153	ft
Froude number, F	1.37	
Average shear stress (tractive force), τ	0.1618	psf



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 39


15" HDPE @ 1%

Inputs

Pipe diameter, d_0	15	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S_0	1.00	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	38.3	%

Results

Flow, Q (See notes)	2.0096	cfs
Velocity, v	4.6470	ft/sec
Velocity head, h_v	0.3356	ft H2O
Flow area	0.4325	ft^2
Wetted perimeter	1.6682	ft
Hydraulic radius	0.2592	ft
Top width, T	1.2153	ft
Froude number, F	1.37	
Average shear stress (tractive force), τ	0.1618	psf



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 40


15" HDPE @ 1%

Inputs

Pipe diameter, d_0	15	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S_0	1.00	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	38.3	%

Results

Flow, Q (See notes)	2.0096	cfs
Velocity, v	4.6470	ft/sec
Velocity head, h_v	0.3356	ft H2O
Flow area	0.4325	ft^2
Wetted perimeter	1.6682	ft
Hydraulic radius	0.2592	ft
Top width, T	1.2153	ft
Froude number, F	1.37	
Average shear stress (tractive force), τ	0.1618	psf




Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

CULVERT STAGE-DISCHARGE SIZING (INLET vs. OUTLET CONTROL WITH TAILWATER EFFECTS)

Project: **WATERBURY FILING 1**
 Basin ID: **Design Point 11- Dual 42" RCP Culverts**
 Status:

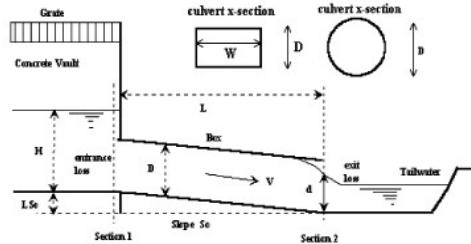

Design Information (Input):

Circular Culvert: Barrel Diameter in Inches
 Inlet Edge Type (choose from pull-down list)

$D =$ inches
 Grooved End Projection

OR:

Box Culvert: Barrel Height (Rise) in Feet
 Barrel Width (Span) in Feet
 Inlet Edge Type (choose from pull-down list)

Height (Rise) =
 Width (Span) =
 Square Edge w/ 90-15 Deg. Headwall

Number of Barrels
 Inlet Elevation at Culvert Invert
 Outlet Elevation at Culvert Invert **OR** Slope of Culvert (ft v./ft h.)
 Culvert Length in Feet
 Manning's Roughness
 Bend Loss Coefficient
 Exit Loss Coefficient

No =
 Inlet Elev = ft. elev.
 Outlet Elev = ft. elev.
 L = ft.
 n =
 $K_b =$
 $K_x =$

Design Information (calculated):

Entrance Loss Coefficient
 Friction Loss Coefficient
 Sum of All Loss Coefficients
 Orifice Inlet Condition Coefficient
 Minimum Energy Condition Coefficient

$K_e =$
 $K_f =$
 $K_s =$
 $C_d =$
 $KE_{bw} =$


Calculations of Culvert Capacity (output):

Water Surface Elevation (ft., linked)	Tailwater Surface Elevation ft	Culvert Inlet-Control Flowrate cfs	Culvert Outlet-Control Flowrate cfs	Controlling Culvert Flowrate cfs (output)	Inlet Equation Used:	Flow Control Used
6939.32		113.80	142.47	113.80	Regression Eqn.	INLET
6939.57		125.60	152.60	125.60	Regression Eqn.	INLET
6939.82		136.80	162.28	136.80	Regression Eqn.	INLET
6940.07		147.20	171.28	147.20	Regression Eqn.	INLET
6940.32		157.00	180.05	157.00	Regression Eqn.	INLET
6940.57		166.20	188.25	166.20	Regression Eqn.	INLET
6940.82		175.00	196.11	175.00	Regression Eqn.	INLET
6941.07		183.20	203.85	183.20	Regression Eqn.	INLET
6941.32		191.00	211.14	191.00	Regression Eqn.	INLET
6941.57		198.60	218.20	198.60	Regression Eqn.	INLET
6941.82		205.80	225.15	205.80	Regression Eqn.	INLET
6942.07		212.60	231.86	212.60	Regression Eqn.	INLET
6942.32		219.40	238.36	219.40	Regression Eqn.	INLET
6942.57		225.80	244.62	225.80	Regression Eqn.	INLET
6942.82		232.00	250.88	232.00	Regression Eqn.	INLET
6943.07		238.20	256.81	238.20	Regression Eqn.	INLET
6943.32		244.20	262.73	244.20	Regression Eqn.	INLET
6943.57		250.00	268.42	250.00	Regression Eqn.	INLET
6943.82		255.60	274.12	255.60	Regression Eqn.	INLET
6944.07		261.20	279.58	261.20	Regression Eqn.	INLET
6944.32		266.60	285.05	266.60	Regression Eqn.	INLET
6944.57		272.00	290.40	272.00	Regression Eqn.	INLET
6944.82		277.20	295.64	277.20	Regression Eqn.	INLET
6945.07		282.40	300.76	282.40	Regression Eqn.	INLET
6945.32		287.40	305.77	287.40	Regression Eqn.	INLET
6945.57		292.40	310.67	292.40	Regression Eqn.	INLET
6945.82		297.40	315.57	297.40	Regression Eqn.	INLET
6946.07		302.20	320.35	302.20	Regression Eqn.	INLET
6946.32		307.00	325.13	307.00	Regression Eqn.	INLET
6946.57		311.40	329.80	311.40	Orifice Eqn.	INLET

Processing Time: 27.79 Seconds

CULVERT STAGE-DISCHARGE SIZING (INLET vs. OUTLET CONTROL WITH TAILWATER EFFECTS)


Project: WATERBURY FILING 1
Basin ID: Design Point 11- Dual 42" RCP Culverts

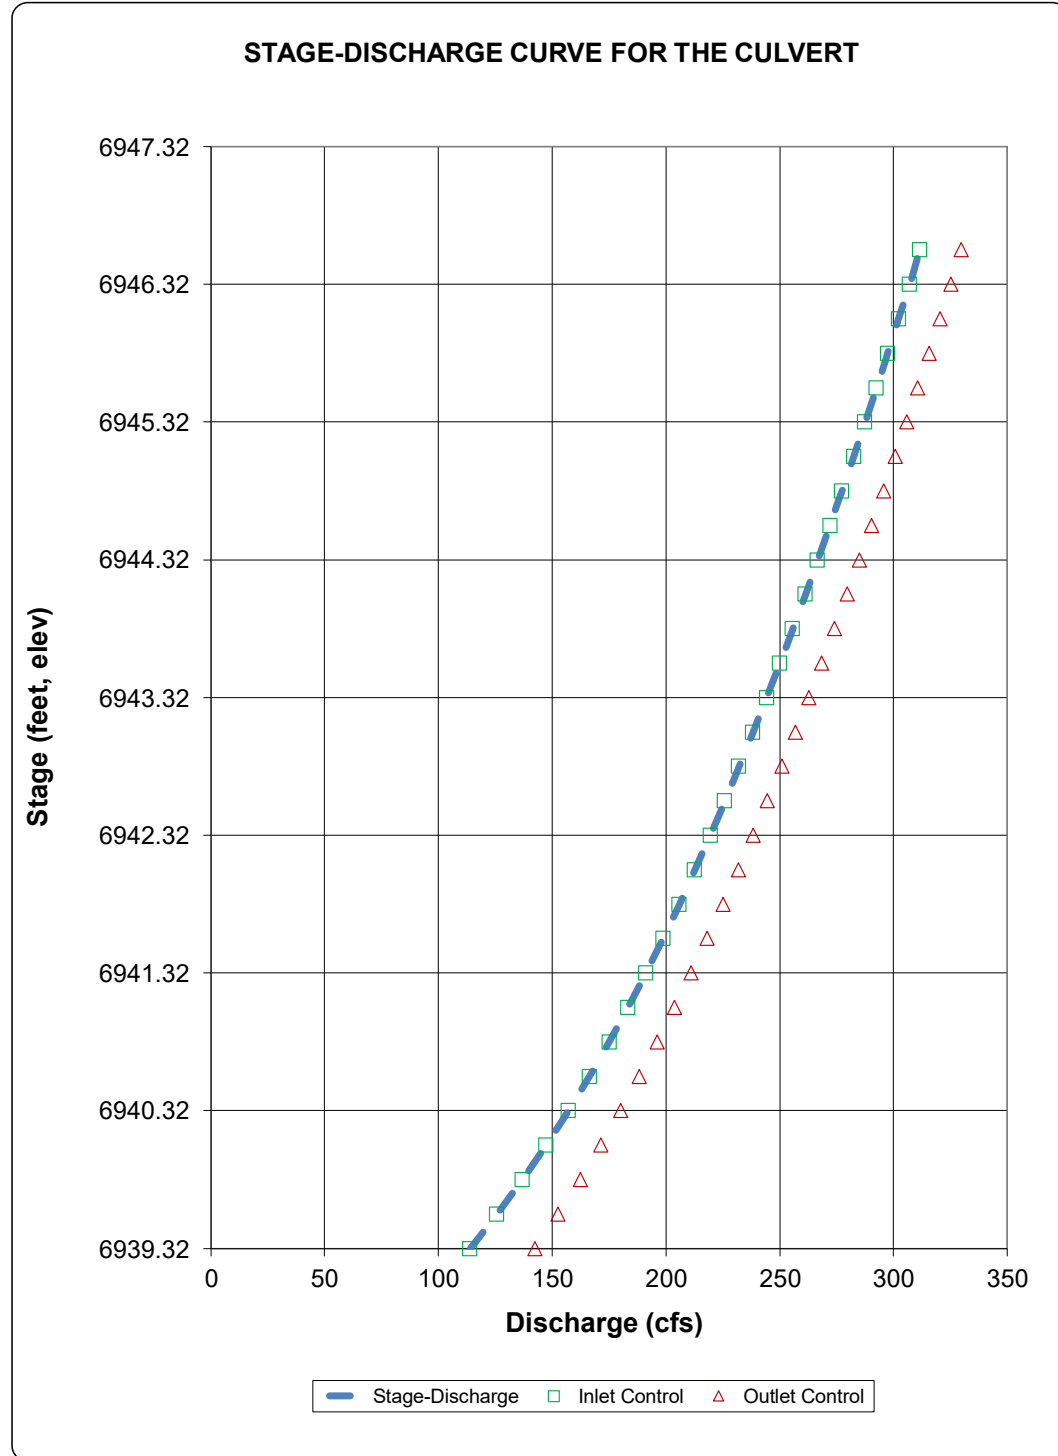

Determination of Culvert Headwater and Outlet Protection

Project: **WATERBURY FILING 1**

Basin ID: **Design Point 11- Dual 42" RCP Culverts**

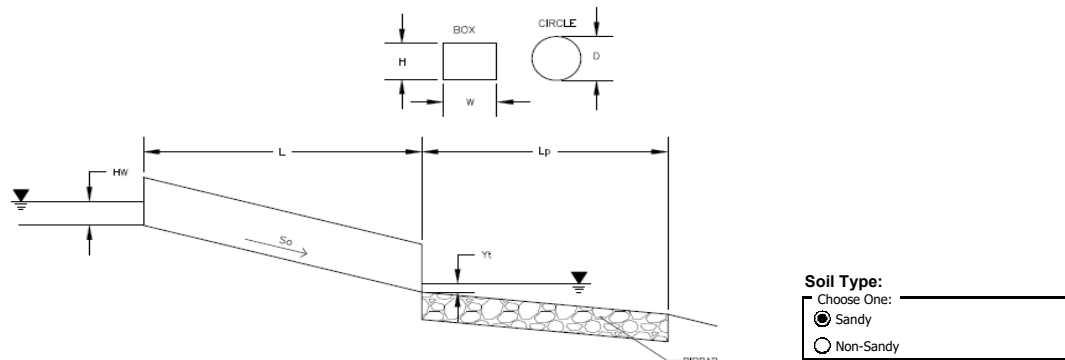

Supercritical Flow! Using D_a to calculate protection type.

Design Information (Input):


Design Discharge	Q = 216 cfs
Circular Culvert:	
Barrel Diameter in Inches	D = 42 inches
Inlet Edge Type (Choose from pull-down list)	Grooved End Projection
Box Culvert:	
Barrel Height (Rise) in Feet	Height (Rise) =
Barrel Width (Span) in Feet	Width (Span) =
Inlet Edge Type (Choose from pull-down list)	
Number of Barrels	No = 2
Inlet Elevation	Elev IN = 6935.82 ft
Outlet Elevation OR Slope	Elev OUT = 6934.18 ft
Culvert Length	L = 128 ft
Manning's Roughness	n = 0.013
Bend Loss Coefficient	k_b = 0
Exit Loss Coefficient	k_x = 1
Tailwater Surface Elevation	Elev Y_t =
Max Allowable Channel Velocity	V = 5 ft/s

Required Protection (Output):

Tailwater Surface Height	Y_t = 1.40 ft
Flow Area at Max Channel Velocity	A_t = 21.64 ft ²
Culvert Cross Sectional Area Available	A = 9.62 ft ²
Entrance Loss Coefficient	k_e = 0.20
Friction Loss Coefficient	k_f = 0.75
Sum of All Losses Coefficients	k_s = 1.95
Culvert Normal Depth	Y_n = 2.72 ft
Culvert Critical Depth	Y_c = 3.15 ft
Tailwater Depth for Design	d = 3.33 ft
Adjusted Diameter OR Adjusted Rise	D_a = 3.11 ft
Expansion Factor	$1/(2 \cdot \tan(\theta))$ = 3.27
Flow/Diameter ^{2.5} OR Flow/(Span * Rise ^{1.5})	$Q/D^{2.5}$ = 4.72 ft ^{0.5} /s
Froude Number	Fr = 1.44 Supercritical!
Tailwater/Adjusted Diameter OR Tailwater/Adjusted Rise	Y_t/D = 0.45
Inlet Control Headwater	HW_i = 6.39 ft
Outlet Control Headwater	HW_o = 5.52 ft
Design Headwater Elevation	HW = 6,942.21 ft
Headwater/Diameter OR Headwater/Rise Ratio	HW/D = 1.83 HW/D > 1.5!
Minimum Theoretical Riprap Size	d_{50} = 14 in
Nominal Riprap Size	d_{50} = 18 in
UDFCD Riprap Type	Type = H
Length of Protection	L_p = 35 ft
Width of Protection	T = 15 ft

CULVERT STAGE-DISCHARGE SIZING (INLET vs. OUTLET CONTROL WITH TAILWATER EFFECTS)

Project: **WATERBURY FILING 1**
 Basin ID: **Design Point 12- 18" RCP Culvert**
 Status:

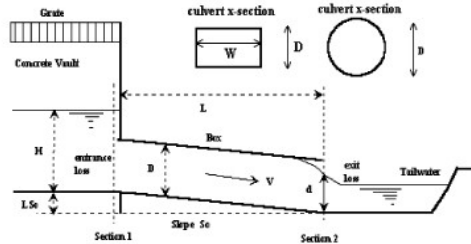

Design Information (Input):

Circular Culvert: Barrel Diameter in Inches
 Inlet Edge Type (choose from pull-down list)

D = inches
 Grooved End Projection

OR:

Box Culvert: Barrel Height (Rise) in Feet
 Barrel Width (Span) in Feet
 Inlet Edge Type (choose from pull-down list)

Height (Rise) =
 Width (Span) =
 Square Edge w/ 90-15 Deg. Headwall

Number of Barrels
 Inlet Elevation at Culvert Invert
 Outlet Elevation at Culvert Invert **OR** Slope of Culvert (ft v./ft h.)
 Culvert Length in Feet
 Manning's Roughness
 Bend Loss Coefficient
 Exit Loss Coefficient

No =
 Inlet Elev = ft. elev.
 Outlet Elev = ft. elev.
 L = ft.
 n =
 K_b =
 K_x =

Design Information (calculated):

Entrance Loss Coefficient
 Friction Loss Coefficient
 Sum of All Loss Coefficients
 Orifice Inlet Condition Coefficient
 Minimum Energy Condition Coefficient

K_e =
 K_f =
 K_s =
 C_d =
 K_{E_{low}} =


Calculations of Culvert Capacity (output):

Water Surface Elevation (ft., linked)	Tailwater Surface Elevation ft	Culvert Inlet-Control Flowrate cfs	Culvert Outlet-Control Flowrate cfs	Controlling Culvert Flowrate cfs (output)	Inlet Equation Used:	Flow Control Used
6942.02		7.20	20.76	7.20	Regression Eqn.	INLET
6942.27		8.70	21.16	8.70	Regression Eqn.	INLET
6942.52		10.10	21.54	10.10	Regression Eqn.	INLET
6942.77		11.20	21.93	11.20	Regression Eqn.	INLET
6943.02		12.30	22.32	12.30	Regression Eqn.	INLET
6943.27		13.20	22.68	13.20	Regression Eqn.	INLET
6943.52		14.10	23.05	14.10	Regression Eqn.	INLET
6943.77		15.00	23.41	15.00	Regression Eqn.	INLET
6944.02		15.80	23.76	15.80	Regression Eqn.	INLET
6944.27		16.50	24.10	16.50	Regression Eqn.	INLET
6944.52		17.20	24.45	17.20	Regression Eqn.	INLET
6944.77		17.90	24.80	17.90	Regression Eqn.	INLET
6945.02		18.60	25.13	18.60	Regression Eqn.	INLET
6945.27		19.30	25.45	19.30	Orifice Eqn.	INLET
6945.52		19.90	25.78	19.90	Orifice Eqn.	INLET
6945.77		20.40	26.10	20.40	Orifice Eqn.	INLET
6946.02		21.00	26.42	21.00	Orifice Eqn.	INLET
6946.27		21.50	26.73	21.50	Orifice Eqn.	INLET
6946.52		22.10	27.05	22.10	Orifice Eqn.	INLET
6946.77		22.60	27.36	22.60	Orifice Eqn.	INLET
6947.02		23.10	27.65	23.10	Orifice Eqn.	INLET
6947.27		23.60	27.96	23.60	Orifice Eqn.	INLET
6947.52		24.10	28.25	24.10	Orifice Eqn.	INLET
6947.77		24.50	28.55	24.50	Orifice Eqn.	INLET
6948.02		25.00	28.84	25.00	Orifice Eqn.	INLET
6948.27		25.50	29.13	25.50	Orifice Eqn.	INLET
6948.52		25.90	29.41	25.90	Orifice Eqn.	INLET
6948.77		26.40	29.69	26.40	Orifice Eqn.	INLET
6949.02		26.80	29.97	26.80	Orifice Eqn.	INLET
6949.27		27.20	30.25	27.20	Orifice Eqn.	INLET

Processing Time: 26.66 Seconds

CULVERT STAGE-DISCHARGE SIZING (INLET vs. OUTLET CONTROL WITH TAILWATER EFFECTS)


Project: WATERBURY FILING 1
Basin ID: Design Point 12- 18" RCP Culvert

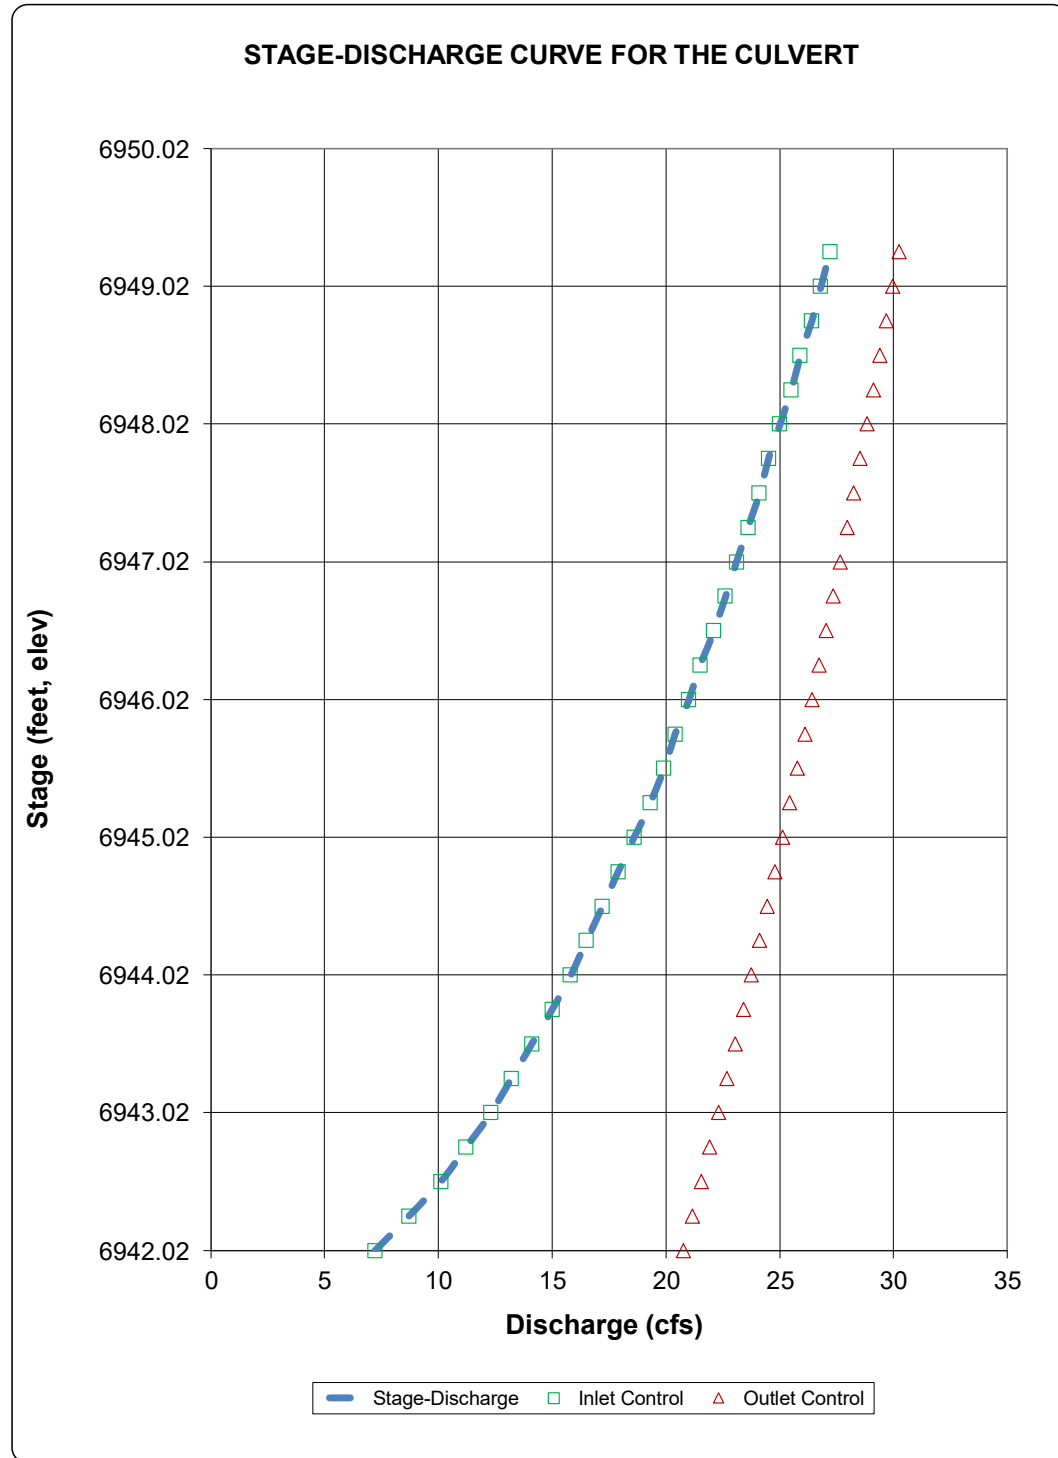

Determination of Culvert Headwater and Outlet Protection

Project: **WATERBURY FILING 1**

Basin ID: **Design Point 12- 18" RCP Culvert**

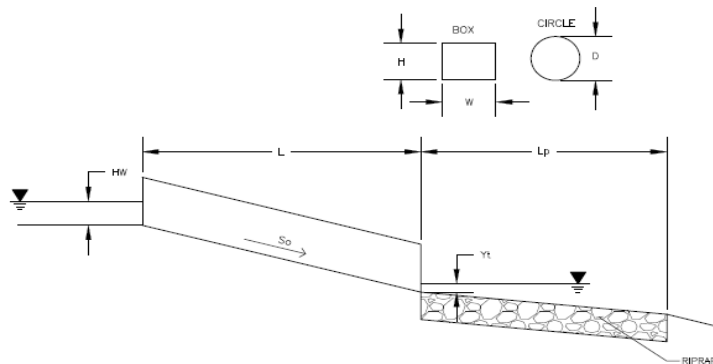

Soil Type:

Choose One:

☒ Sandy

☐ Non-Sandy

Supercritical Flow! Using Da to calculate protection type.

Design Information (Input):

Design Discharge

Q = 4 cfs

Circular Culvert:

Barrel Diameter in Inches

D = 18 inches

Inlet Edge Type (Choose from pull-down list)

Grooved End Projection

Box Culvert:

Barrel Height (Rise) in Feet

Height (Rise) = ft

Barrel Width (Span) in Feet

Width (Span) = ft

Inlet Edge Type (Choose from pull-down list)

Number of Barrels

No = 1

Inlet Elevation

Elev IN = 6940.52 ft

Outlet Elevation OR Slope

Elev OUT = 6934.07 ft

Culvert Length

L = 100 ft

Manning's Roughness

n = 0.013

Bend Loss Coefficient

k_b = 0

Exit Loss Coefficient

k_x = 1

Tailwater Surface Elevation

Elev Y_t = ft

Max Allowable Channel Velocity

V = 5 ft/s

Required Protection (Output):

Tailwater Surface Height

Y_t = 0.60 ft

Flow Area at Max Channel Velocity

A_t = 0.88 ft²

Culvert Cross Sectional Area Available

A = 1.77 ft²

Entrance Loss Coefficient

k_e = 0.20

Friction Loss Coefficient

k_f = 1.81

Sum of All Losses Coefficients

k_s = 3.01

Culvert Normal Depth

Y_n = 0.41 ft

Culvert Critical Depth

Y_c = 0.80 ft

Tailwater Depth for Design

d = 1.15 ft

Adjusted Diameter OR Adjusted Rise

D_a = 0.96 ft

Expansion Factor

$1/(2*\tan(\theta))$ = 6.70

Flow/Diameter^{2.5} OR Flow/(Span * Rise^{1.5})

$Q/D^{2.5}$ = 1.60 ft^{0.5}/s

Froude Number

Fr = 3.63 Supercritical!

Tailwater/Adjusted Diameter OR Tailwater/Adjusted Rise

Y_t/D = 0.63

Inlet Control Headwater

HW_i = 1.11 ft

Outlet Control Headwater

HW_o = -5.01 ft

Design Headwater Elevation

HW = 6,941.63 ft

Headwater/Diameter OR Headwater/Rise Ratio

HW/D = 0.74

Minimum Theoretical Riprap Size

d_{50} = 2 in

Nominal Riprap Size

d_{50} = 6 in

UDFCD Riprap Type

Type = VL

Length of Protection

L_p = 5 ft

Width of Protection


T = 3 ft

CULVERT STAGE-DISCHARGE SIZING (INLET vs. OUTLET CONTROL WITH TAILWATER EFFECTS)

Project: **WATERBURY FILING 1**

Basin ID: **Design Point 30- Triple 36" RCP Culverts**

Status:

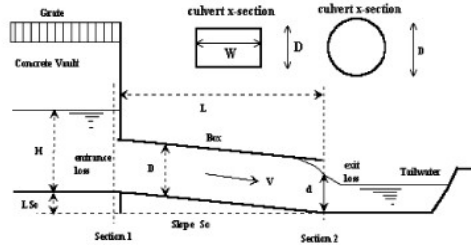

Design Information (Input):

Circular Culvert: Barrel Diameter in Inches

Inlet Edge Type (choose from pull-down list)

D = 36 inches

Grooved End Projection

OR:

Box Culvert: Barrel Height (Rise) in Feet

Barrel Width (Span) in Feet

Inlet Edge Type (choose from pull-down list)

Height (Rise) = ft.

Width (Span) = ft.

Square Edge w/ 90-15 Deg. Headwall

Number of Barrels

Inlet Elevation at Culvert Invert

Outlet Elevation at Culvert Invert OR Slope of Culvert (ft v./ft h.)

Culvert Length in Feet

Manning's Roughness

Bend Loss Coefficient

Exit Loss Coefficient

No = 3

Inlet Elev = 6920 ft. elev.

Outlet Elev = 6919 ft. elev.

L = 130 ft.

n = 0.013

K_b = 0

K_x = 1

Design Information (calculated):

Entrance Loss Coefficient

Friction Loss Coefficient

Sum of All Loss Coefficients

Orifice Inlet Condition Coefficient

Minimum Energy Condition Coefficient

K_e = 0.20

K_f = 0.93

K_s = 2.13

C_d = 0.95

KE_{low} = -0.0132

Calculations of Culvert Capacity (output):


Water Surface Elevation (ft., linked)	Tailwater Surface Elevation ft	Culvert Inlet-Control Flowrate cfs	Culvert Outlet-Control Flowrate cfs	Controlling Culvert Flowrate cfs (output)	Inlet Equation Used:	Flow Control Used
6920.00		0.00	0.00	0.00	No Flow (WS < inlet)	N/A
6920.25		0.90	65.46	0.90	Min. Energy Eqn.	INLET
6920.50		3.60	66.25	3.60	Min. Energy Eqn.	INLET
6920.75		9.90	67.92	9.90	Min. Energy Eqn.	INLET
6921.00		16.80	70.46	16.80	Min. Energy Eqn.	INLET
6921.25		25.80	74.06	25.80	Min. Energy Eqn.	INLET
6921.50		36.00	78.71	36.00	Min. Energy Eqn.	INLET
6921.75		46.50	84.33	46.50	Regression Eqn.	INLET
6922.00		58.50	90.82	58.50	Regression Eqn.	INLET
6922.25		71.70	97.66	71.70	Regression Eqn.	INLET
6922.50		86.10	104.77	86.10	Regression Eqn.	INLET
6922.75		101.10	111.79	101.10	Regression Eqn.	INLET
6923.00		115.80	118.55	115.80	Regression Eqn.	INLET
6923.25		129.90	131.45	129.90	Regression Eqn.	INLET
6923.50		142.80	143.38	142.80	Regression Eqn.	INLET
6923.75		155.10	154.08	154.08	Regression Eqn.	OUTLET
6924.00		166.20	164.79	164.79	Regression Eqn.	OUTLET
6924.25		176.70	174.79	174.79	Regression Eqn.	OUTLET
6924.50		186.60	184.18	184.18	Regression Eqn.	OUTLET
6924.75		195.90	193.22	193.22	Regression Eqn.	OUTLET
6925.00		204.90	201.82	201.82	Regression Eqn.	OUTLET
6925.25		213.30	209.98	209.98	Regression Eqn.	OUTLET
6925.50		221.40	217.97	217.97	Regression Eqn.	OUTLET
6925.75		229.20	225.60	225.60	Regression Eqn.	OUTLET
6926.00		236.70	232.97	232.97	Regression Eqn.	OUTLET
6926.25		243.90	240.17	240.17	Regression Eqn.	OUTLET
6926.50		250.80	247.10	247.10	Regression Eqn.	OUTLET
6926.75		257.70	253.85	253.85	Regression Eqn.	OUTLET
6927.00		264.30	260.52	260.52	Regression Eqn.	OUTLET
6927.25		270.90	266.93	266.93	Regression Eqn.	OUTLET

Processing Time: 00.91 Seconds

CULVERT STAGE-DISCHARGE SIZING (INLET vs. OUTLET CONTROL WITH TAILWATER EFFECTS)

Project: WATERBURY FILING 1


Basin ID: Design Point 30- Triple 36" RCP Culverts

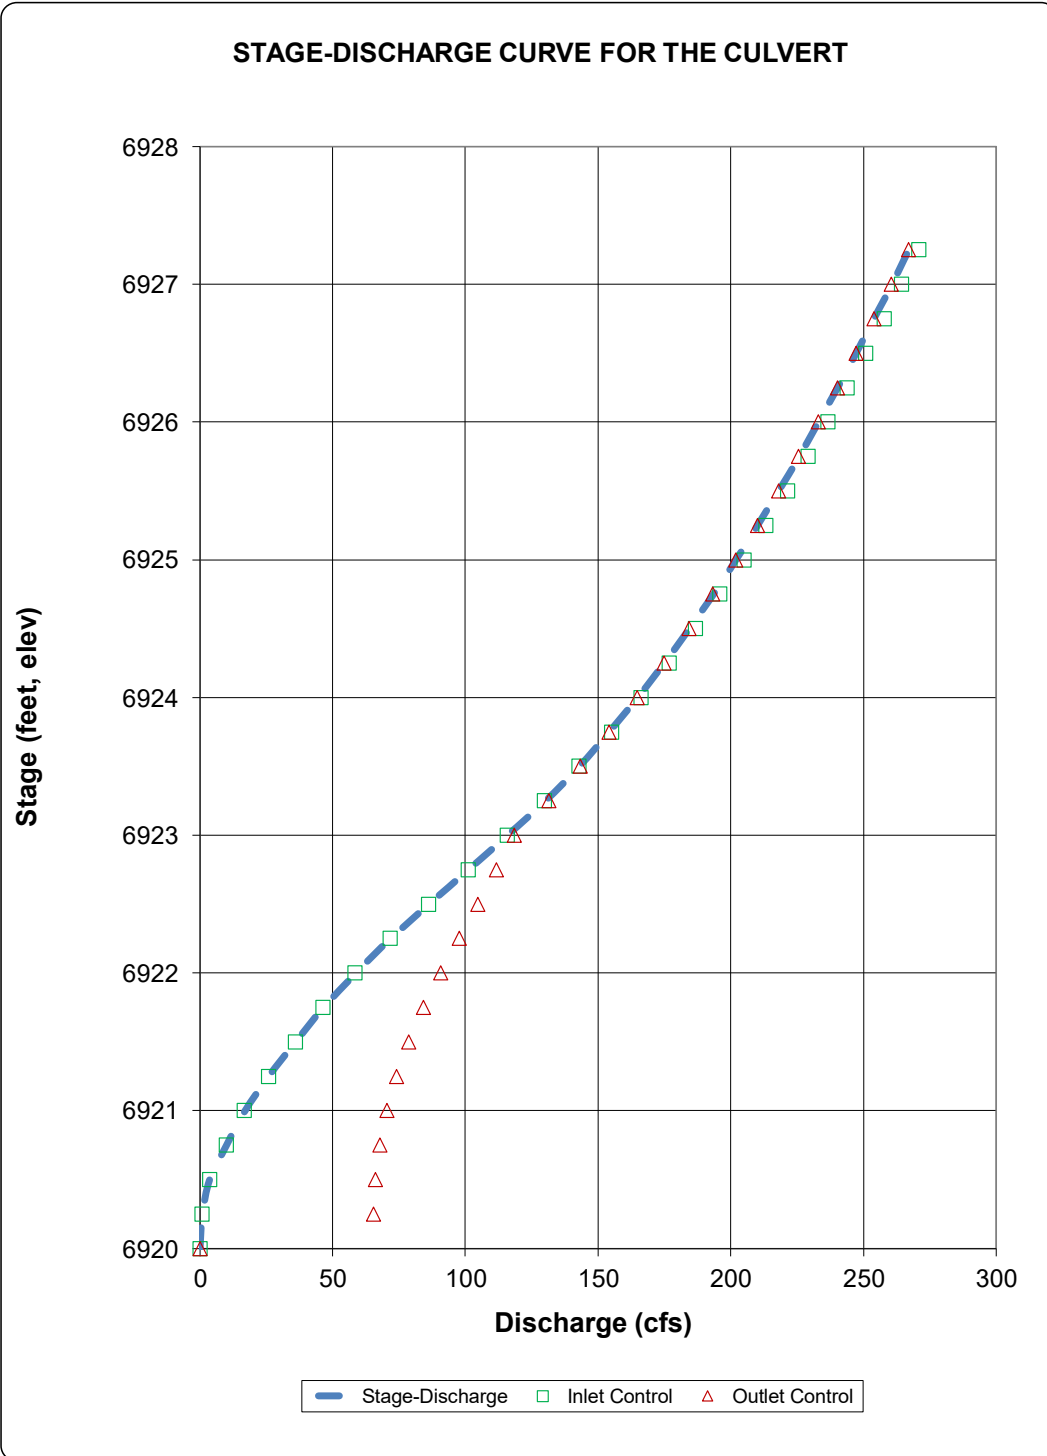

Determination of Culvert Headwater and Outlet Protection

Project: **WATERBURY FILING 1**

Basin ID: **Design Point 30- Triple 36" RCP Culverts**

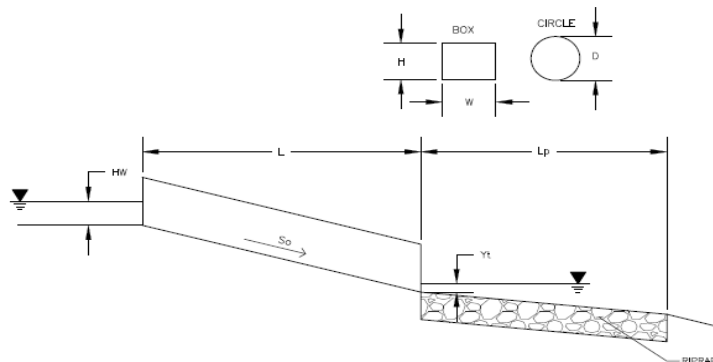

Soil Type:

Choose One:

☒ Sandy

☐ Non-Sandy

Design Information (Input):

Design Discharge

Q = 247 cfs

Circular Culvert:

Barrel Diameter in Inches

D = 36 inches

Inlet Edge Type (Choose from pull-down list)

Grooved End Projection

Box Culvert:

Barrel Height (Rise) in Feet

Height (Rise) = ft

Barrel Width (Span) in Feet

Width (Span) = ft

Inlet Edge Type (Choose from pull-down list)

Number of Barrels

No = 3

Inlet Elevation

Elev IN = 6920 ft

Outlet Elevation OR Slope

Elev OUT = 6919 ft

Culvert Length

L = 133.5 ft

Manning's Roughness

n = 0.013

Bend Loss Coefficient

k_b = 0

Exit Loss Coefficient

k_x = 1

Tailwater Surface Elevation

Elev Y_t = 6920 ft

Max Allowable Channel Velocity

V = 5 ft/s

Required Protection (Output):

Tailwater Surface Height

Y_t = 1.00 ft

Flow Area at Max Channel Velocity

A_t = 16.48 ft²

Culvert Cross Sectional Area Available

A = 7.07 ft²

Entrance Loss Coefficient

k_e = 0.20

Friction Loss Coefficient

k_f = 0.96

Sum of All Losses Coefficients

k_s = 2.16

Culvert Normal Depth

Y_n = 1.64 ft

Culvert Critical Depth

Y_c = 2.79 ft

Tailwater Depth for Design

d = 2.90 ft

Adjusted Diameter OR Adjusted Rise

D_a = - ft

Expansion Factor

1/(2*tan(θ)) = 1.69

Flow/Diameter^{2.5} OR Flow/(Span * Rise^{1.5})

Q/D^{2.5} = 5.29 ft^{0.5}/s

Froude Number

Fr = - Pressure flow!

Tailwater/Adjusted Diameter OR Tailwater/Adjusted Rise

Y_t/D = 0.33

Inlet Control Headwater

HW_i = 6.37 ft

Outlet Control Headwater

HW_o = 6.45 ft

Design Headwater Elevation

HW = 6,926.45 ft

Headwater/Diameter OR Headwater/Rise Ratio

HW/D = 2.15 HW/D > 1.5!

Minimum Theoretical Riprap Size

d₅₀ = 16 in

Nominal Riprap Size

d₅₀ = 18 in

UDFCD Riprap Type

Type = H


Length of Protection

L_p = 23 ft

Width of Protection

T = 17 ft

PDR
INLET CALCULATIONS

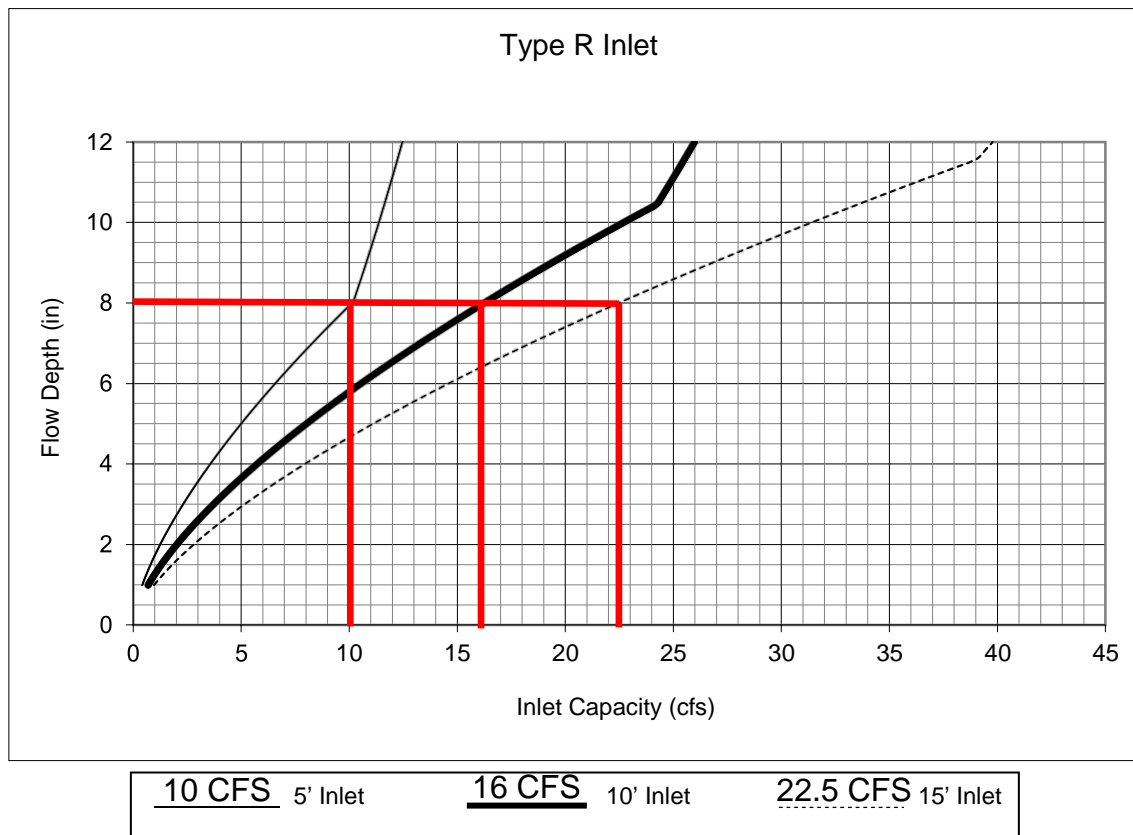Figure 8-11. Inlet Capacity Chart Sump Conditions , Curb Opening (Type R) Inlet

DP19: Q100=6 CFS ---> 10' INLET
 DP20: Q100=5 CFS ---> 5' INLET
 DP22: Q100=7 CFS ---> 5' INLET
 DP23: Q100=1 CFS ---> 10' INLET
 DP24: Q100=6 CFS ---> 10' INLET
 DP25: Q100=5 CFS ---> 5' INLET
 DP26: Q100=16 CFS ---> 10' INLET
 DP27: Q100=7 CFS ---> 10' INLET
 DP28: Q100=18/2 CFS ---> 2-10' INLETS

Notes:


1. The standard inlet parameters must apply to use this chart.

PDR
 DP21 10' Type R At-Grade
 $Q_5 = 2 \text{ cfs}$ $Q_{100} = 6 \text{ cfs}$
 Muddy Pond Slope = 1.75%


Figure 8-7. Inlet Capacity Chart Continuous Grade Conditions, Residential (Local)
 (Attached and Detached Sidewalk)

Street Section Data: Street Width Flowline to Flowline = 34'
 Type of Curb and Gutter: D-10-R = 8" vertical
 Type 16 = 6" vertical

Minor Storm

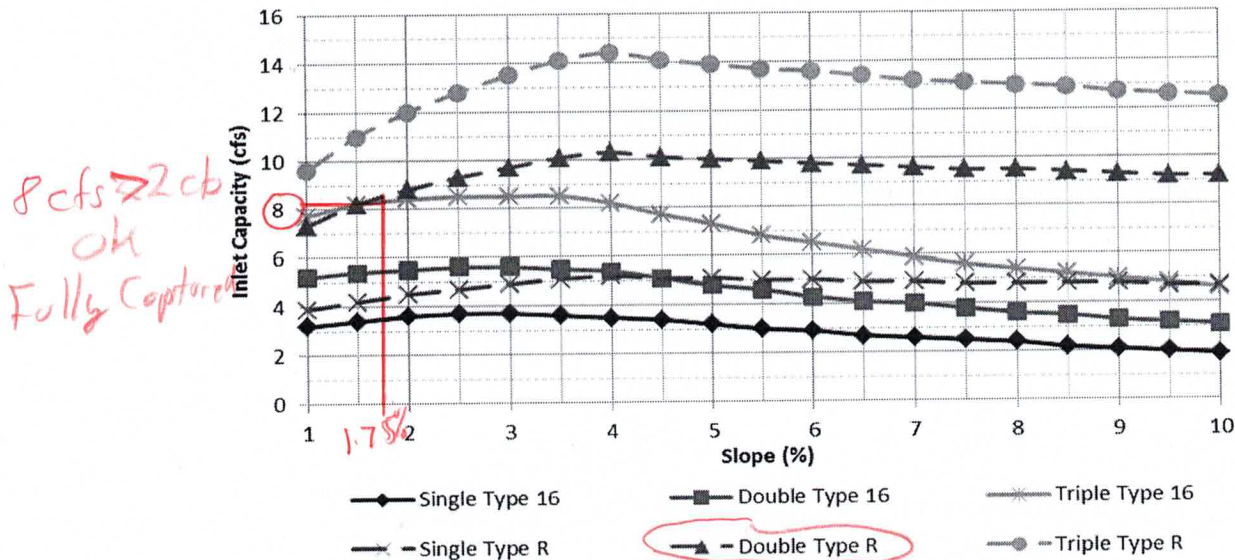

Major Storm

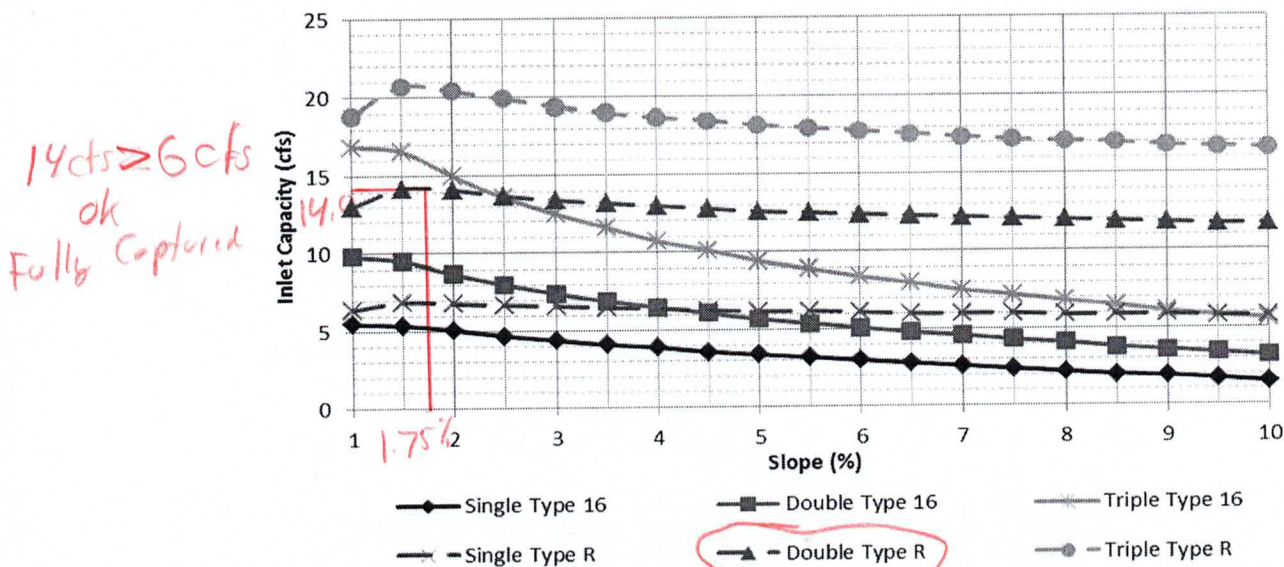

The standard street section parameters as defined in Chapter 7 must apply to use these charts. For non-standard sections, the inlet capacity shall be calculated using the UDFCD spreadsheets. The maximum spread width is limited by the curb height based on no curb overtopping during a minor storm and flow being contained within the public right-of-way during the major storm. Calculations were done using UD-Inlet 3.00.xls, Mar., 2011 with the default clogging factors.

**PDR
PIPE CALCULATIONS**

MANNING'S EQUATION for OPEN CHANNEL FLOW

Project: **WATERBURY 1&2 MDP/PDR**

Location: **DP-PRE5 DIVERSIONS SWALE E-E**

By: **QNA**

Date: **7/14/2022**

Chk By:

Date:

version 12-2004

Mannings Formula

$$Q = (1.486/n)AR_h^{2/3}S^{1/2}$$


$$R = A/P$$

A = cross sectional area

P= wetted perimeter

S = slope of channel

n = Manning's roughness coefficient

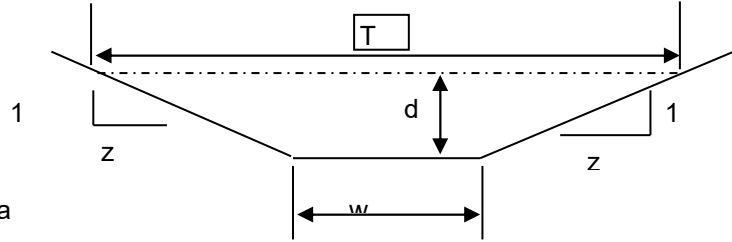

$$V = (1.49/n)R_h^{2/3}S^{1/2}$$

$$Q = V \times A$$

INPUT

z (sideslope)= 5
z (sideslope)= 5
b (btm width, ft)= 8
d (depth, ft)= 0.72
S (slope, ft/ft) 0.02
n low = 0.025
n high = 0.035

Clear Data
Entry Cells

		Low N		High N			
Depth, ft	Area, sf	Wetted Perimeter, ft	Hydraulic Radius, ft	Velocity, fps	Flow, cfs	Velocity, fps	Flow, cfs
0.72	8.35	15.34	0.54	5.60419065	46.8062	4.002993	33.433
				T =		15.2	
				Dm =		0.549	
				Sc low =		0.0112	
				Sc high =		0.0220	
				.7 Sc		1.3 Sc	
				0.0079		0.0146	
				.7 Sc		1.3 Sc	
				0.0154		0.0287	

s_c = critical slope ft / ft

T = top width of the stream

d_m = a/T = mean depth of flow

Created by: Mike O'Shea

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 18 PDR


24" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	24	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	1	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	35.2	%	▼

Results

Flow, Q (See notes)	6.0119	cfs	▼
Velocity, v	6.0879	ft/sec	▼
Velocity head, h _v	0.5760	ft H2O	▼
Flow area	0.9876	ft^2	▼
Wetted perimeter	2.5406	ft	▼
Hydraulic radius	0.3887	ft	▼
Top width, T	1.9104	ft	▼
Froude number, F	1.49		
Average shear stress (tractive force), tau	0.2427	psf	▼



Notes:

This is the flow and depth *inside* the pipe.

Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 19 PDR


18" RCP @ 1.0%

Inputs

Pipe diameter, d ₀	18	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	1.00	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	48.8	%	▼

Results

Flow, Q (See notes)	5.0384	cfs	▼
Velocity, v	5.8822	ft/sec	▼
Velocity head, h _v	0.5378	ft H2O	▼
Flow area	0.8566	ft^2	▼
Wetted perimeter	2.3202	ft	▼
Hydraulic radius	0.3692	ft	▼
Top width, T	1.4996	ft	▼
Froude number, F	1.37		
Average shear stress (tractive force), tau	0.2305	psf	▼



Notes:

This is the flow and depth *inside* the pipe.

Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 20 PDR


24" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	24	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	1	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	46.6	%

Results

Flow, Q (See notes)	10.0183	cfs
Velocity, v	6.9821	ft/sec
Velocity head, h _v	0.7576	ft H2O
Flow area	1.4349	ft^2
Wetted perimeter	3.0055	ft
Hydraulic radius	0.4774	ft
Top width, T	1.9954	ft
Froude number, F	1.45	
Average shear stress (tractive force), tau	0.2981	psf



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 21 PDR


18" RCP @ 2.0%

Inputs

Pipe diameter, d_0	18	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S_0	2.00	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	44.3	%	▼

Results

Flow, Q (See notes)	6.0176	cfs	▼
Velocity, v	7.9643	ft/sec	▼
Velocity head, h_v	0.9858	ft H2O	▼
Flow area	0.7556	ft^2	▼
Wetted perimeter	2.1848	ft	▼
Hydraulic radius	0.3458	ft	▼
Top width, T	1.4902	ft	▼
Froude number, F	1.97		
Average shear stress (tractive force), τ	0.4318	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 22 PDR


30" RCP @ 1.85%

Inputs

Pipe diameter, d_0	30	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S_0	1.85	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	35.5	%

Results

Flow, Q (See notes)	15.0647	cfs
Velocity, v	9.6511	ft/sec
Velocity head, h_v	1.4476	ft H2O
Flow area	1.5610	ft^2
Wetted perimeter	3.1914	ft
Hydraulic radius	0.4891	ft
Top width, T	2.3925	ft
Froude number, F	2.11	
Average shear stress (tractive force), τ	0.5649	psf



Notes:

This is the flow and depth *inside* the pipe.

Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 23 PDR


24" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	24	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	1.00	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	38.3	%	▼

Results

Flow, Q (See notes)	7.0376	cfs	▼
Velocity, v	6.3570	ft/sec	▼
Velocity head, h _v	0.6281	ft H2O	▼
Flow area	1.1071	ft^2	▼
Wetted perimeter	2.6692	ft	▼
Hydraulic radius	0.4148	ft	▼
Top width, T	1.9445	ft	▼
Froude number, F	1.49		
Average shear stress (tractive force), tau	0.2589	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 24 PDR


24" RCP @ 1.00%

Inputs

Pipe diameter, d_0	24	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S_0	1.00	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	14.5	%	▼

Results

Flow, Q (See notes)	1.0252	cfs	▼
Velocity, v	3.6443	ft/sec	▼
Velocity head, h_v	0.2064	ft H2O	▼
Flow area	0.2813	ft^2	▼
Wetted perimeter	1.5626	ft	▼
Hydraulic radius	0.1800	ft	▼
Top width, T	1.4084	ft	▼
Froude number, F	1.44		
Average shear stress (tractive force), τ	0.1124	psf	▼



Notes:

This is the flow and depth *inside* the pipe.

Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 25 PDR


30" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	30	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	1.00	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	28	%	▼

Results

Flow, Q (See notes)	7.0227	cfs	▼
Velocity, v	6.2419	ft/sec	▼
Velocity head, h _v	0.6055	ft H2O	▼
Flow area	1.1251	ft^2	▼
Wetted perimeter	2.7880	ft	▼
Hydraulic radius	0.4036	ft	▼
Top width, T	2.2450	ft	▼
Froude number, F	1.55		
Average shear stress (tractive force), tau	0.2519	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 26 PDR


36" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	36	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	1.00	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	40.6	%

Results

Flow, Q (See notes)	23.0936	cfs
Velocity, v	8.5747	ft/sec
Velocity head, h _v	1.1427	ft H2O
Flow area	2.6933	ft^2
Wetted perimeter	4.1450	ft
Hydraulic radius	0.6498	ft
Top width, T	2.9465	ft
Froude number, F	1.58	
Average shear stress (tractive force), tau	0.4056	psf



Notes:

This is the flow and depth *inside* the pipe.

Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 27 PDR


18" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	18	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	1.00	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	54.2	%	▼

Results

Flow, Q (See notes)	6.0071	cfs	▼
Velocity, v	6.1426	ft/sec	▼
Velocity head, h _v	0.5864	ft H2O	▼
Flow area	0.9780	ft^2	▼
Wetted perimeter	2.4823	ft	▼
Hydraulic radius	0.3940	ft	▼
Top width, T	1.4947	ft	▼
Froude number, F	1.34		
Average shear stress (tractive force), tau	0.2460	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 28 PDR


18" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	18	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	1.00	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	48.7	%	▼

Results

Flow, Q (See notes)	5.0207	cfs	▼
Velocity, v	5.8770	ft/sec	▼
Velocity head, h _v	0.5368	ft H2O	▼
Flow area	0.8543	ft^2	▼
Wetted perimeter	2.3172	ft	▼
Hydraulic radius	0.3687	ft	▼
Top width, T	1.4995	ft	▼
Froude number, F	1.37		
Average shear stress (tractive force), tau	0.2302	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 29 PDR


36" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	36	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	1.00	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	50.6	%	▼

Results

Flow, Q (See notes)	34.0263	cfs	▼
Velocity, v	9.4829	ft/sec	▼
Velocity head, h _v	1.3976	ft H2O	▼
Flow area	3.5883	ft^2	▼
Wetted perimeter	4.7483	ft	▼
Hydraulic radius	0.7557	ft	▼
Top width, T	2.9998	ft	▼
Froude number, F	1.53		
Average shear stress (tractive force), tau	0.4718	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 30 PDR


24" RCP @ 4.26%

Inputs

Pipe diameter, d ₀	24	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	4.26	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	40.4	%	▼

Results

Flow, Q (See notes)	16.0217	cfs	▼
Velocity, v	13.4735	ft/sec	▼
Velocity head, h _v	2.8214	ft H2O	▼
Flow area	1.1892	ft^2	▼
Wetted perimeter	2.7552	ft	▼
Hydraulic radius	0.4316	ft	▼
Top width, T	1.9628	ft	▼
Froude number, F	3.05		
Average shear stress (tractive force), tau	1.1479	psf	▼



Notes:

This is the flow and depth *inside* the pipe.

Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 31 PDR


42" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	42	in
Manning roughness, n	0.013	
Pressure slope (possibly ? equal to pipe slope), S ₀	1.00	% rise/run
Percent of (or ratio to) full depth (100% or 1 if flowing full)	48.7	%

Results

Flow, Q (See notes)	48.0880	cfs
Velocity, v	10.3389	ft/sec
Velocity head, h _v	1.6613	ft H2O
Flow area	4.6514	ft^2
Wetted perimeter	5.4067	ft
Hydraulic radius	0.8603	ft
Top width, T	3.4988	ft
Froude number, F	1.58	
Average shear stress (tractive force), tau	0.5371	psf



Notes:

This is the flow and depth *inside* the pipe.

Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe run 32 PDR


18" RCP @ 11.70%

Inputs

Pipe diameter, d_0	18	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S_0	11.7	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	30	%	▼

Results

Flow, Q (See notes)	7.0356	cfs	▼
Velocity, v	15.7797	ft/sec	▼
Velocity head, h_v	3.8699	ft H2O	▼
Flow area	0.4459	ft^2	▼
Wetted perimeter	1.7389	ft	▼
Hydraulic radius	0.2564	ft	▼
Top width, T	1.3748	ft	▼
Froude number, F	4.90		
Average shear stress (tractive force), τ	1.8729	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

Manning Formula Uniform Pipe Flow at Given Slope and Depth

Pipe Run 33 PDR


42" RCP @ 1.00%

Inputs

Pipe diameter, d ₀	42	in	▼
Manning roughness, n	0.013		
Pressure slope (possibly ? equal to pipe slope), S ₀	1.00	% rise/run	▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	53.9	%	▼

Results

Flow, Q (See notes)	57.0154	cfs	▼
Velocity, v	10.7827	ft/sec	▼
Velocity head, h _v	1.8070	ft H2O	▼
Flow area	5.2879	ft^2	▼
Wetted perimeter	5.7710	ft	▼
Hydraulic radius	0.9163	ft	▼
Top width, T	3.4893	ft	▼
Froude number, F	1.54		
Average shear stress (tractive force), tau	0.5720	psf	▼



Notes:

This is the flow and depth *inside* the pipe.
Getting the flow into the pipe may require significantly higher headwater depth. Add at least 1.5 times the velocity head to get the headwater depth or [see my 2-minute tutorial](#) for standard culvert headwater calculations using HY-8.

MDDP
FULL SPECTRUM DETENTION & WATER QUALITY CALCULATIONS

POND TRIBUTARY AREA

POND 1 TRIB AREA (DP 8)	22.34 AC	BASINS A, B1, B2, C, D, E, F, H, G1, G2, & K	DCIA	5.03
			UIA	6.92
			RPA	2.46
			SPA	7.94
			Total	22.34
POND 2 TRIB AREA (DP 18)	21.06 AC	BASINS L1, L2, O1, O2, O-3, O-4 & OS-4	DCIA	2.34
			UIA	3.23
			RPA	0.94
			SPA	14.55
			Total	21.06
POND 3 TRIB AREA (DP 29)	82.44 AC	BASINS Q1, Q2, R, S1, S2, T1, T2, U1, U2, V, W, X, OS-1, OS-2, OS-3A, OS-3B, OS-Q1, OS-Q2, OS-4, OS-S1, OS-S2, OS-T2, OS-7, & OS-9	DCIA	19.50
			UIA	22.09
			RPA	9.10
			SPA	31.74
			Total	82.44

Site-Level Low Impact Development (LID) Design Effective Impervious Calculator

UD-BMP (Version 3.06, November 2016)

		User Input	
		Calculated cells	
***Design Storm: 1-Hour Rain Depth	WQCV Event	0.43	inches
***Minor Storm: 1-Hour Rain Depth	5-Year Event	1.50	inches
***Major Storm: 1-Hour Rain Depth	100-Year Event	2.52	inches
Optional User Defined Storm		CUHP	
(CUHP) NOAA 1 Hour Rainfall Depth and Frequency for User Defined Storm	100-Year Event		
Intensity for Optional User Defined Storm		0	

Designer:	QNA
Company:	Terra Nova Engineering
Date:	June 16, 2022
Project:	WATERBURY FILING 1 POND 1
Location:	POND 1 Design Point 8 Full Spectrum Detention

SITE INFORMATION (USER-INPUT)

[illegible]

CALCULATED RESULTS (OUTPUT)	
1	2
3	4
5	6
7	8
9	10
11	12
13	14
15	16
17	18
19	20
21	22
23	24
25	26
27	28
29	30
31	32
33	34
35	36
37	38
39	40
41	42
43	44
45	46
47	48
49	50
51	52
53	54
55	56
57	58
59	60
61	62
63	64
65	66
67	68
69	70
71	72
73	74
75	76
77	78
79	80
81	82
83	84
85	86
87	88
89	90
91	92
93	94
95	96
97	98
99	100

[illegible]

LID / EFFECTIVE IMPERVIOUSNESS CREDITS

[illegible]

Total Site Imperviousness:	53.5%
Total Site Effective Imperviousness for WQCV Event:	45.5%
Total Site Effective Imperviousness for 5-Year Event:	51.3%
Total Site Effective Imperviousness for 100-Year Event:	51.9%
Total Site Effective Imperviousness for Optional User Defined Storm CUPP:	

Notes:


* Use Green-Ampt average infiltration rate values from Table 3-3.

** Flood control detention volume credits based on empirical equations from Storage Chapter of USDCM.

*** Method assumes that 1-hour rainfall depth is equivalent to 1-hour intensity for calculation purposes

MHFD-Detention, Version 4.03 (May 2020)

Basin ID: POND 1 DP 8




Initial Surcharge Area (A_{SV})	=	user	ft ²
Surcharge Volume Length (L_{SV})	=	user	ft
Surcharge Volume Width (W_{SV})	=	user	ft
Depth of Basin Floor (H_{BLOOR})	=	user	ft
Length of Basin Floor (L_{BLOOR})	=	user	ft
Width of Basin Floor (W_{BLOOR})	=	user	ft
Area of Basin Floor (A_{BLOOR})	=	user	ft ²
Volume of Basin Floor (V_{BLOOR})	=	user	ft ³
Depth of Main Basin (H_{MAIN})	=	user	ft
Length of Main Basin (L_{MAIN})	=	user	ft
Width of Main Basin (W_{MAIN})	=	user	ft
Area of Main Basin (A_{MAIN})	=	user	ft ²
Volume of Main Basin (V_{MAIN})	=	user	ft ³
Calculated Total Basin Volume (V_{TOTAL})	=	user	acre-feet

[illegible]

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-Detention, Version 4.03 (May 2020)

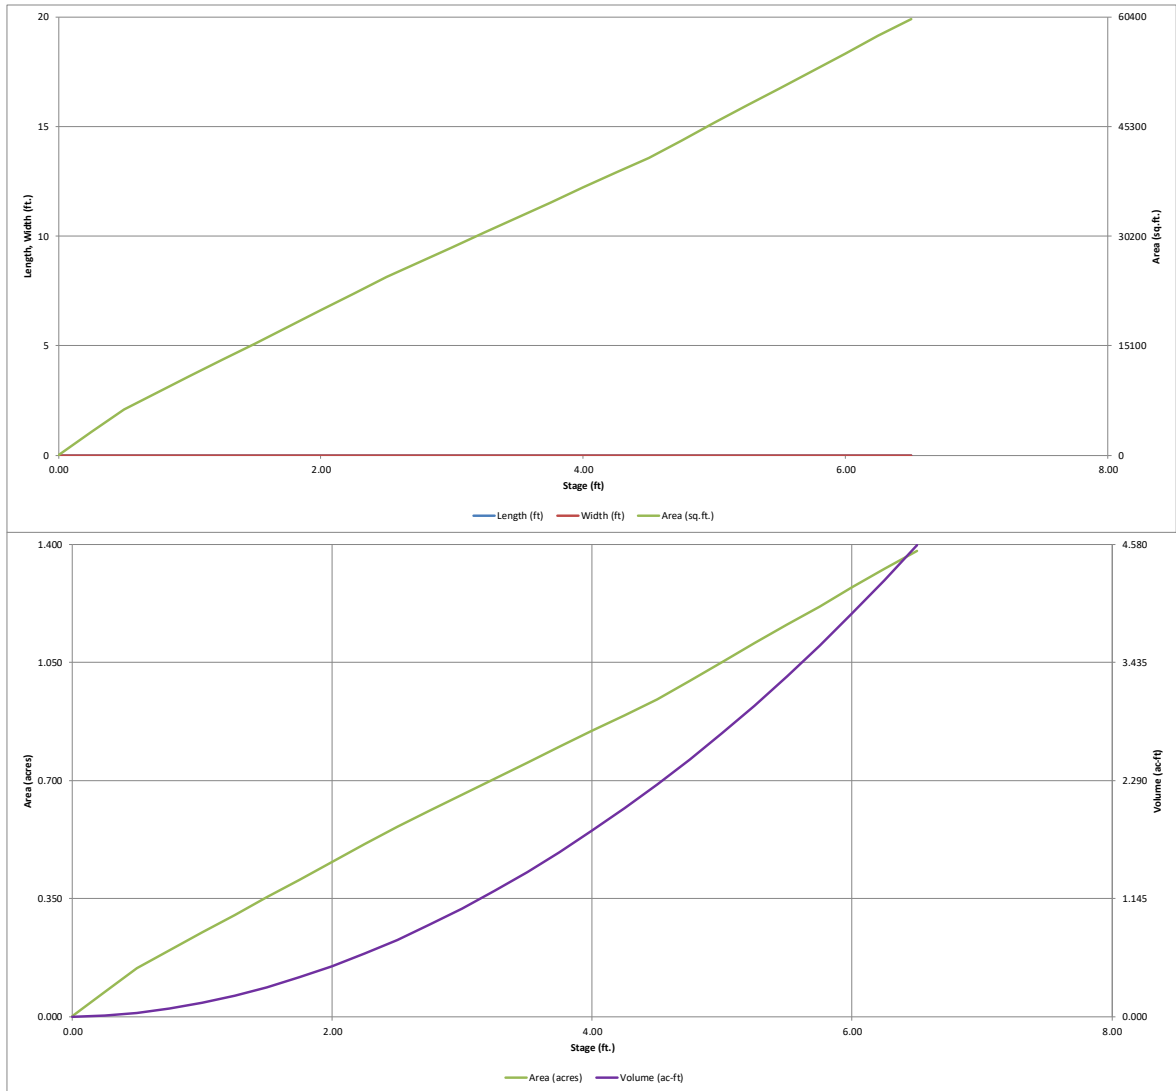


DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.03 (May 2020)

Project: WATERBURY

Basin ID: POND 1 DP 8

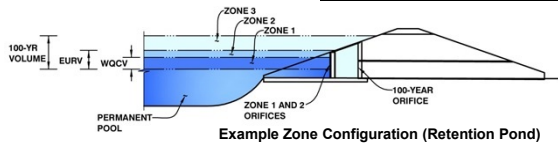

Example Zone Configuration (Retention Pond)

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	1.79	0.394	Orifice Plate
Zone 2 (EURV)	3.44	0.957	Orifice Plate
Zone 3 (100-year)	4.37	0.775	Weir&Pipe (Restrict)
Total (all zones)		2.127	

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth = ft (distance below the filtration media surface)
Underdrain Orifice Diameter = inches

Calculated Parameters for Underdrain
Underdrain Orifice Area = ft²
Underdrain Orifice Centroid = feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice = 0.00 ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Orifice Plate = 3.44 ft (relative to basin bottom at Stage = 0 ft)
Orifice Plate: Orifice Vertical Spacing = 13.80 inches
Orifice Plate: Orifice Area per Row = 3.04 sq. inches (diameter = 1-15/16 inches)

Calculated Parameters for Plate
WQ Orifice Area per Row = 2.111E-02 ft²
Elliptical Half-Width = N/A feet
Elliptical Slot Centroid = N/A feet
Elliptical Slot Area = N/A ft²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	1.15	2.29					
Orifice Area (sq. inches)	3.04	3.04	3.04					

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

Invert of Vertical Orifice = Not Selected Not Selected ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice = N/A N/A ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter = N/A N/A inches

Calculated Parameters for Vertical Orifice
Vertical Orifice Area = Not Selected Not Selected ft²
Vertical Orifice Centroid = N/A N/A feet

User Input: Overflow Weir (Dropbox with Flat or Sloped Grate and Outlet Pipe OR Rectangular/Trapezoidal Weir (and No Outlet Pipe))

Overflow Weir Front Edge Height, H_o = Zone 3 Weir Not Selected ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length = 3.44 N/A feet
Overflow Weir Grate Slope = 4.00 N/A H:V
Horiz. Length of Weir Sides = 0.00 N/A feet
Overflow Grate Open Area % = 4.00 N/A %
Debris Clogging % = 70% N/A %
Debris Clogging % = 50% N/A %

Calculated Parameters for Overflow Weir
Height of Grate Upper Edge, H_u = Zone 3 Weir Not Selected feet
Overflow Weir Slope Length = 3.44 N/A feet
Grate Open Area / 100-yr Orifice Area = 4.00 N/A
Overflow Grate Open Area w/o Debris = 0.00 N/A ft²
Overflow Grate Open Area w/ Debris = 7.13 N/A ft²
Overflow Grate Open Area w/ Debris = 11.20 N/A ft²
Overflow Grate Open Area w/ Debris = 5.60 N/A ft²

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

Depth to Invert of Outlet Pipe = Zone 3 Restrictor Not Selected ft (distance below basin bottom at Stage = 0 ft)
Outlet Pipe Diameter = 0.10 N/A inches
Restrictor Plate Height Above Pipe Invert = 24.00 N/A inches
Restrictor Plate Height Above Pipe Invert = 12.00 N/A inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate
Outlet Orifice Area = Zone 3 Restrictor Not Selected ft²
Outlet Orifice Centroid = 1.57 N/A feet
Half-Central Angle of Restrictor Plate on Pipe = 0.58 N/A radians
Half-Central Angle of Restrictor Plate on Pipe = 1.57 N/A radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage = 4.50 ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length = 30.00 feet
Spillway End Slopes = 3.00 H:V
Freeboard above Max Water Surface = 1.00 feet

Calculated Parameters for Spillway
Spillway Design Flow Depth = 0.73 feet
Stage at Top of Freeboard = 6.23 feet
Basin Area at Top of Freeboard = 1.32 acres
Basin Volume at Top of Freeboard = 4.21 acre-ft




Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	3.00
One-Hour Rainfall Depth (in)	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	3.00
CUHP Runoff Volume (acre-ft)	0.394	1.351	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Inflow Hydrograph Volume (acre-ft)	N/A	N/A	0.974	1.292	1.546	1.939	2.321	2.805	3.607
CUHP Predevelopment Peak Q (cfs)	N/A	N/A	0.0	0.0	0.0	0.0	0.0	0.0	0.0
OPTIONAL Override Predevelopment Peak Q (cfs)	N/A	N/A	0.2	0.4	0.6	0.3	10.4	17.1	27.3
Predevelopment Unit Peak Flow, q (cfs/acre)	N/A	N/A	0.01	0.02	0.03	0.24	0.47	0.77	1.22
Peak Inflow Q (cfs)	N/A	N/A	18.4	24.5	28.9	38.8	47.6	60.0	77.2
Peak Outflow Q (cfs)	0.2	0.5	0.4	0.4	1.7	5.1	10.3	14.5	21.9
Ratio Peak Outflow to Predevelopment Q	N/A	N/A	N/A	1.1	2.8	1.0	1.0	0.8	0.8
Structure Controlling Flow	Plate	Overflow Weir 1	Plate	Plate	Overflow Weir 1	Overflow Weir 1	Overflow Weir 1	Outlet Plate 1	Spillway
Max Velocity through Grate 1 (fps)	N/A	N/A	N/A	N/A	0.1	0.4	0.9	1.2	1.3
Max Velocity through Grate 2 (fps)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours)	38	68	59	67	71	69	67	65	62
Time to Drain 99% of Inflow Volume (hours)	40	73	63	72	76	75	75	74	73
Maximum Ponding Depth (ft)	1.79	3.44	2.80	3.26	3.55	3.70	3.87	4.16	4.67
Area at Maximum Ponding Depth (acres)	0.41	0.74	0.62	0.71	0.76	0.79	0.82	0.88	0.98
Maximum Volume Stored (acre-ft)	0.398	1.358	0.916	1.220	1.433	1.557	1.694	1.940	2.403

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.00 (December 2019)

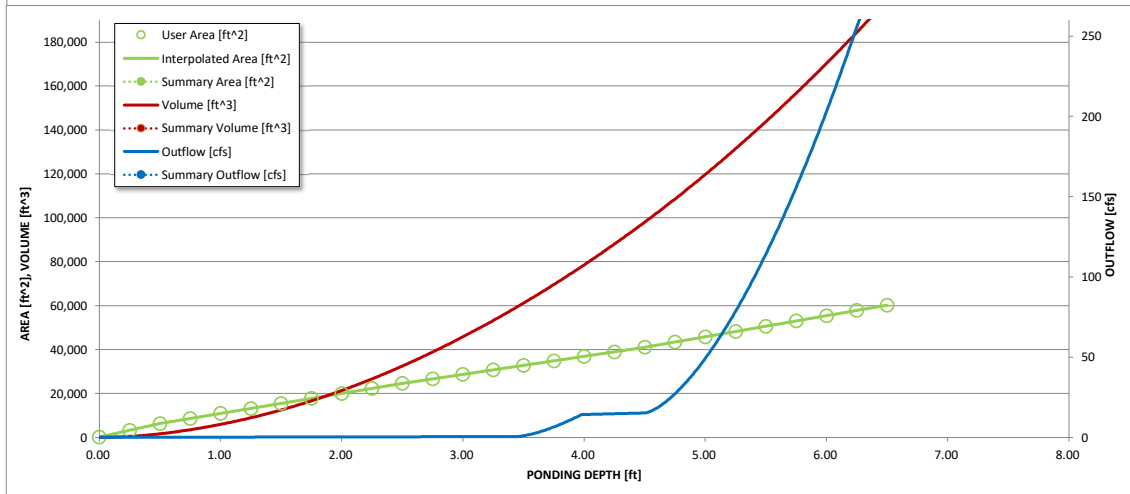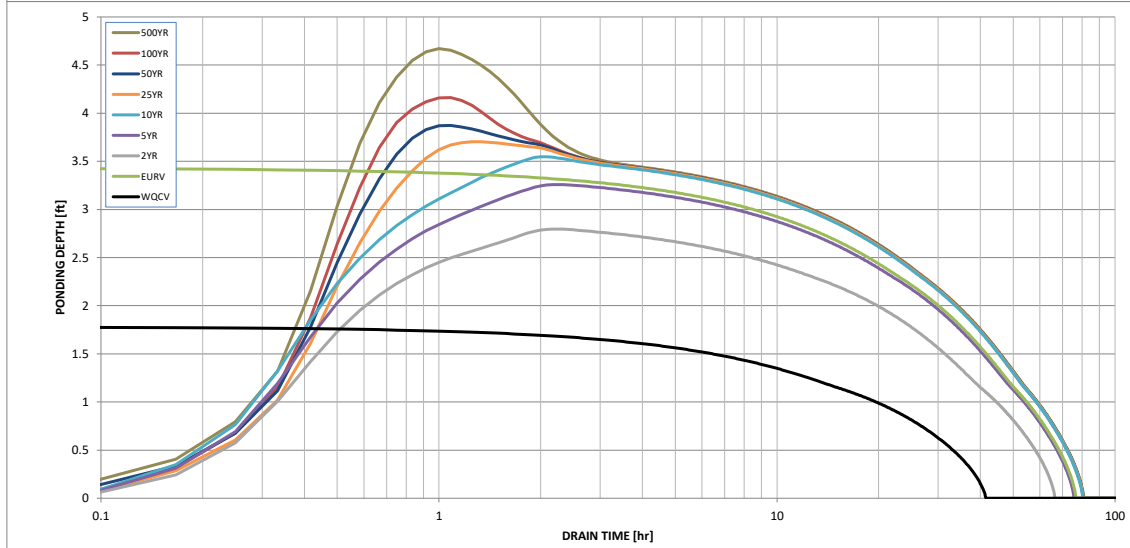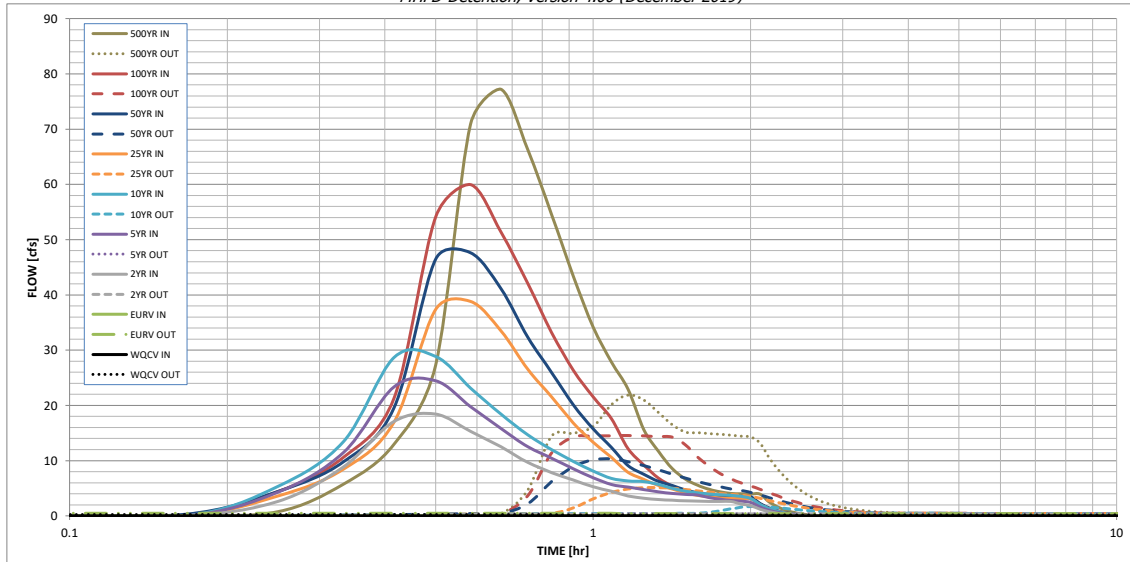

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename: _____

Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

Time Interval	SOURCE	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP
	TIME	WQCV [cfs]	EURV [cfs]	2 Year [cfs]	5 Year [cfs]	10 Year [cfs]	25 Year [cfs]	50 Year [cfs]	100 Year [cfs]	500 Year [cfs]
5.00 min	0:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.30	0.03	0.76
	0:15:00	0.00	0.00	2.64	4.30	5.34	3.60	4.44	4.39	5.74
	0:20:00	0.00	0.00	8.87	11.46	13.44	8.45	9.79	10.59	12.98
	0:25:00	0.00	0.00	17.10	23.36	28.66	16.99	19.58	21.33	27.27
	0:30:00	0.00	0.00	18.41	24.45	28.87	37.34	46.49	54.12	70.90
	0:35:00	0.00	0.00	15.27	19.79	23.15	38.82	47.62	59.97	77.19
	0:40:00	0.00	0.00	12.50	15.81	18.41	33.51	41.16	51.36	66.26
	0:45:00	0.00	0.00	9.68	12.52	14.67	26.53	32.33	42.08	54.59
	0:50:00	0.00	0.00	7.85	10.45	11.98	21.55	25.98	33.20	43.37
	0:55:00	0.00	0.00	6.47	8.52	9.88	16.80	20.08	26.35	34.19
	1:00:00	0.00	0.00	5.29	6.90	8.11	13.33	15.77	21.53	27.87
	1:05:00	0.00	0.00	4.45	5.70	6.79	10.59	12.42	17.63	22.92
	1:10:00	0.00	0.00	3.63	5.20	6.33	7.90	9.10	12.19	15.65
	1:15:00	0.00	0.00	3.21	4.77	6.20	6.60	7.54	9.22	11.69
	1:20:00	0.00	0.00	2.96	4.34	5.69	5.50	6.24	6.86	8.58
	1:25:00	0.00	0.00	2.82	4.06	4.97	4.86	5.49	5.41	6.66
	1:30:00	0.00	0.00	2.73	3.88	4.49	4.16	4.69	4.56	5.55
	1:35:00	0.00	0.00	2.67	3.77	4.17	3.73	4.21	3.99	4.81
	1:40:00	0.00	0.00	2.63	3.31	3.96	3.45	3.89	3.62	4.33
	1:45:00	0.00	0.00	2.61	2.99	3.82	3.27	3.68	3.42	4.07
	1:50:00	0.00	0.00	2.61	2.78	3.72	3.17	3.57	3.35	3.99
	1:55:00	0.00	0.00	2.16	2.65	3.53	3.11	3.50	3.32	3.95
	2:00:00	0.00	0.00	1.86	2.47	3.16	3.08	3.47	3.32	3.95
	2:05:00	0.00	0.00	1.22	1.61	2.07	2.02	2.27	2.17	2.58
	2:10:00	0.00	0.00	0.77	1.02	1.33	1.30	1.46	1.40	1.66
	2:15:00	0.00	0.00	0.48	0.63	0.83	0.82	0.92	0.88	1.04
	2:20:00	0.00	0.00	0.28	0.38	0.50	0.49	0.55	0.52	0.62
	2:25:00	0.00	0.00	0.15	0.23	0.28	0.29	0.33	0.31	0.36
	2:30:00	0.00	0.00	0.06	0.11	0.13	0.14	0.16	0.15	0.18
	2:35:00	0.00	0.00	0.02	0.04	0.04	0.05	0.05	0.05	0.05
	2:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Site-Level Low Impact Development (LID) Design Effective Impervious Calculator

LID Credit by Impervious Reduction Factor (IRF) Method

UD-BMP (Version 3.06, November 2016)

User Input

Calculated cells

***Design Storm: 1-Hour Rain Depth	WQCV Event	0.43	inches
***Minor Storm: 1-Hour Rain Depth	5-Year Event	1.50	inches
***Major Storm: 1-Hour Rain Depth	100-Year Event	2.52	inches
Optional User Defined Storm	CUHP		
(CUHP) NOAA 1 Hour Rainfall Depth and Frequency for User Defined Storm	100-Year Event		

Max Intensity for Optional User Defined Storm

0

Designer: QNA

Company: Terra Nova Engineering

Date: June 16, 2022

Project: WATERBURY FILING 1 POND 2

Location: POND 2 Design Point 18 Full Spectrum Detention

SITE INFORMATION (USER-INPUT)

Sub-basin Identifier	DP 18 FSD																		
Receiving Pervious Area Soil Type	Loamy Sand																		
Total Area (ac., Sum of DCIA, UIA, RPA, & SPA)	21.06																		
Directly Connected Impervious Area (DCIA, acres)	2.34																		
Unconnected Impervious Area (UIA, acres)	3.23																		
Receiving Pervious Area (RPA, acres)	0.94																		
Separate Pervious Area (SPA, acres)	14.55																		
RPA Treatment Type: Conveyance (C), Volume (V), or Permeable Pavement (PP)	C																		

CALCULATED RESULTS (OUTPUT)

Total Calculated Area (ac, check against input)	21.061																		
Directly Connected Impervious Area (DCIA, %)	11.1%																		
Unconnected Impervious Area (UIA, %)	15.3%																		
Receiving Pervious Area (RPA, %)	4.5%																		
Separate Pervious Area (SPA, %)	69.1%																		
A_p (RPA / UIA)	0.290																		
I_p Check	0.770																		
f / I for WQCV Event:	4.5																		
f / I for 5-Year Event:	0.5																		
f / I for 100-Year Event:	0.4																		
f / I for Optional User Defined Storm CUHP:																			
IRF for WQCV Event:	0.76																		
IRF for 5-Year Event:	0.94																		
IRF for 100-Year Event:	0.95																		
IRF for Optional User Defined Storm CUHP:																			
Total Site Imperviousness: I_{total}	26.5%																		
Effective Imperviousness for WQCV Event:	22.8%																		
Effective Imperviousness for 5-Year Event:	25.5%																		
Effective Imperviousness for 100-Year Event:	25.8%																		
Effective Imperviousness for Optional User Defined Storm CUHP:																			

LID / EFFECTIVE IMPERVIOUSNESS CREDITS

WQCV Event CREDIT: Reduce Detention By:	9.5%	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
This line only for 10-Year Event	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
100-Year Event CREDIT**: Reduce Detention By:	2.8%	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
User Defined CUHP CREDIT: Reduce Detention By:																			

Total Site Imperviousness:	26.5%
Total Site Effective Imperviousness for WQCV Event:	22.8%
Total Site Effective Imperviousness for 5-Year Event:	25.5%
Total Site Effective Imperviousness for 100-Year Event:	25.8%
Total Site Effective Imperviousness for Optional User Defined Storm CUHP:	


Notes:

* Use Green-Ampt average infiltration rate values from Table 3-3.

** Flood control detention volume credits based on empirical equations from Storage Chapter of USDCM.

*** Method assumes that 1-hour rainfall depth is equivalent to 1-hour intensity for calculation purposed

MHFD-Detention, Version 4.03 (May 2020)

Basin ID: TEMPORARY POND 2 DP 18

Example Zone Configuration (Retention Pond)

Selected BMP Type =	EDB	
Watershed Area =	21.06	acres
Watershed Length =	1,050	ft
Watershed Length to Centroid =	350	ft
Watershed Slope =	0.019	ft/ft
Watershed Imperviousness =	25.76%	percent
Percentage Hydrologic Soil Group A =	100.0%	percent
Percentage Hydrologic Soil Group B =	0.0%	percent
Percentage Hydrologic Soil Group C/D =	0.0%	percent
Target WQCV Drain Time =	40.0	hours
Location for 1-hr Rainfall Depths = User Input		

Optional User Overrides

Water Quality Capture Volume (WQC)	0.241	acre-feet
Excess Urban Runoff Volume (EUV)	0.519	acre-feet
2-yr Runoff Volume ($P1 = 1.19$ in.)	0.344	acre-feet
5-yr Runoff Volume ($P1 = 1.5$ in.)	0.481	acre-feet
10-yr Runoff Volume ($P1 = 1.75$ in.)	0.601	acre-feet
25-yr Runoff Volume ($P1 = 2.1$ in.)	0.939	acre-feet
50-yr Runoff Volume ($P1 = 2.25$ in.)	1.255	acre-feet
100-yr Runoff Volume ($P1 = 2.52$ in.)	1.681	acre-feet
500-yr Runoff Volume ($P1 = 3$ in.)	2.377	acre-feet
Approximate 2-yr Detention Volume	0.324	acre-feet
Approximate 5-yr Detention Volume	0.435	acre-feet
Approximate 10-yr Detention Volume	0.547	acre-feet
Approximate 25-yr Detention Volume	0.698	acre-feet
Approximate 50-yr Detention Volume	0.818	acre-feet
Approximate 100-yr Detention Volume	1.027	acre-feet

	acre-feet
	acre-feet
1.19	inches
1.50	inches
1.75	inches
2.00	inches
2.25	inches
2.52	inches
3.00	inches


Zone 1 Volume (WQCV) =	0.241	acre-feet
Zone 2 Volume (EURV - Zone 1) =	0.278	acre-feet
Zone 3 Volume (100-year - Zones 1 & 2) =	0.508	acre-feet
Total Detention Basin Volume =	1.027	acre-feet
Initial Surcharge Volume (ISV) =	user	ft. ³
Initial Surcharge Depth (ISD) =	user	ft
Total Available Detention Depth (H_{total}) =	user	ft
Depth of Trickle Channel (H_{TC}) =	user	ft
Slope of Trickle Channel (S_{TC}) =	user	ft/ft
Slopes of Main Basin Sides (S_{MBin}) =	user	H:V
Basin Length-to-Width Ratio ($R_{L/W}$) =	user	

Initial Surcharge Area (A_{SV})	=	user	ft ²
Surcharge Volume Length (L_{SV})	=	user	ft
Surcharge Volume Width (W_{SV})	=	user	ft
Depth of Basin Floor (H_{FLOOR})	=	user	ft
Length of Basin Floor (L_{FLOOR})	=	user	ft
Width of Basin Floor (W_{FLOOR})	=	user	ft
Area of Basin Floor (A_{FLOOR})	=	user	ft ²
Volume of Basin Floor (V_{FLOOR})	=	user	ft ³
Depth of Main Basin (H_{MAIN})	=	user	ft
Length of Main Basin (L_{MAIN})	=	user	ft
Width of Main Basin (W_{MAIN})	=	user	ft
Area of Main Basin (A_{MAIN})	=	user	ft ²
Volume of Main Basin (V_{MAIN})	=	user	ft ³
Calculated Total Basin Volume (V_{TOTAL})	=	user	acre-feet

[illegible]

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-Detention, Version 4.03 (May 2020)

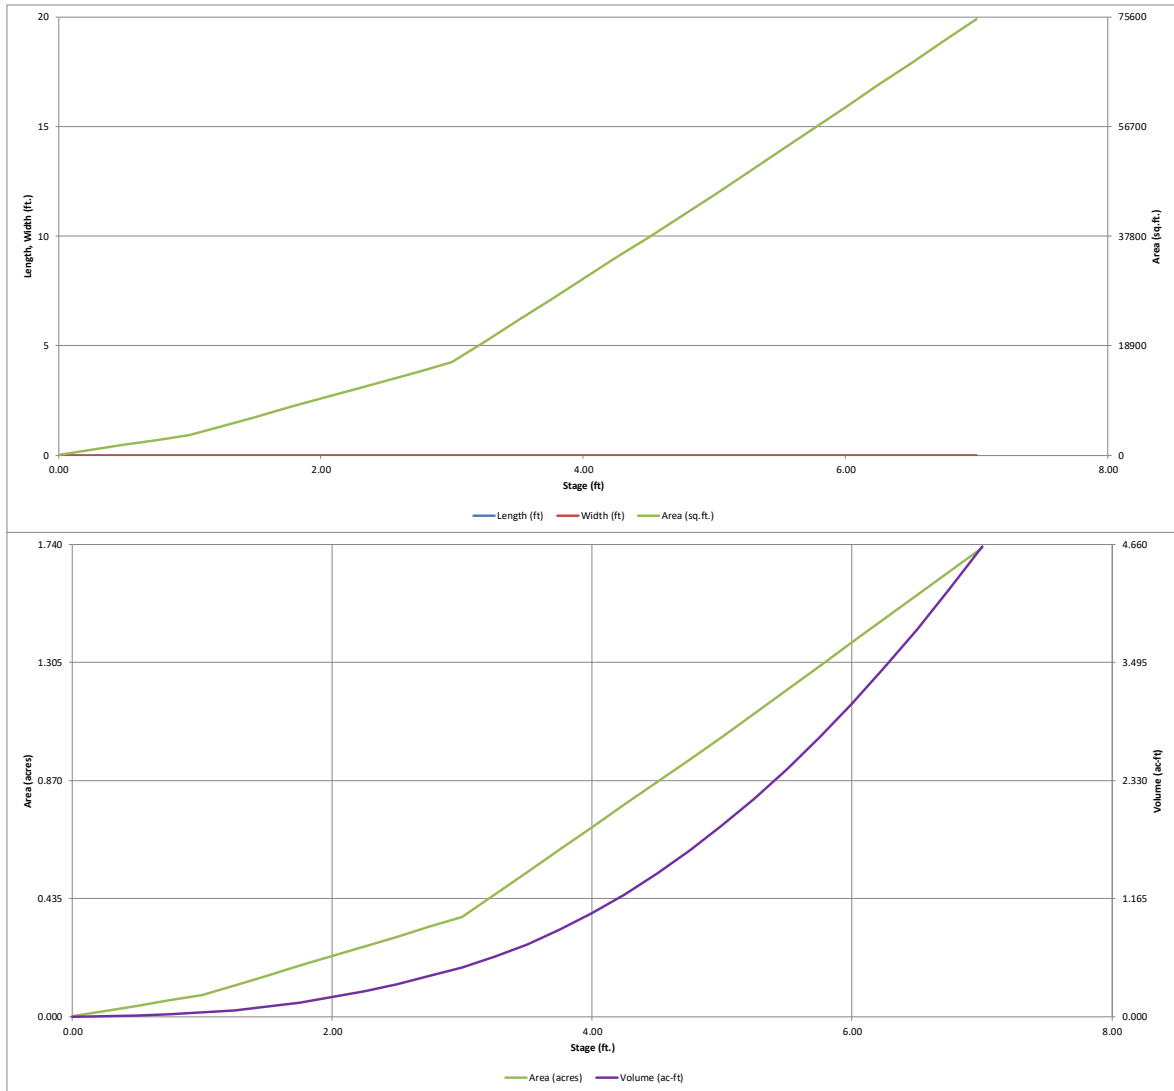


DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.03 (May 2020)

Project: **WATERBURY**

Basin ID: **TEMPORARY POND 2 DP 18**

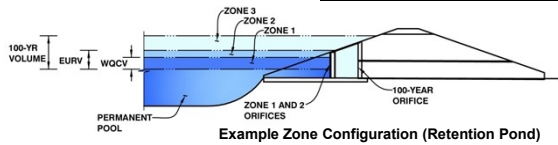

Example Zone Configuration (Retention Pond)

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	2.21	0.241	Orifice Plate
Zone 2 (EURV)	3.09	0.278	Orifice Plate
Zone 3 (100-year)	4.01	0.508	Weir&Pipe (Restrict)
Total (all zones)		1.027	

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth = ft (distance below the filtration media surface)
Underdrain Orifice Diameter = inches

Calculated Parameters for Underdrain
Underdrain Orifice Area = ft²
Underdrain Orifice Centroid = feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice = ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Orifice Plate = ft (relative to basin bottom at Stage = 0 ft)
Orifice Plate: Orifice Vertical Spacing = inches
Orifice Plate: Orifice Area per Row = sq. inches (diameter = 1-5/16 inches)

Calculated Parameters for Plate
WQ Orifice Area per Row = ft²
Elliptical Half-Width = feet
Elliptical Slot Centroid = feet
Elliptical Slot Area = ft²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	1.03	2.06					
Orifice Area (sq. inches)	1.34	1.34	1.34					

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

Invert of Vertical Orifice = ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice = ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter = inches

Calculated Parameters for Vertical Orifice
Vertical Orifice Area = ft²
Vertical Orifice Centroid = feet

User Input: Overflow Weir (Dropbox with Flat or Sloped Grate and Outlet Pipe OR Rectangular/Trapezoidal Weir (and No Outlet Pipe))

Overflow Weir Front Edge Height, H_o = ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length = feet
Overflow Weir Grate Slope = H:V
Horiz. Length of Weir Sides = feet
Overflow Grate Open Area % = %, grate open area/total area
Debris Clogging % = %

Calculated Parameters for Overflow Weir
Height of Grate Upper Edge, H_u = feet
Overflow Weir Slope Length = feet
Grate Open Area / 100-yr Orifice Area =
Overflow Grate Open Area w/o Debris = ft²
Overflow Grate Open Area w/ Debris = ft²

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

Depth to Invert of Outlet Pipe = ft (distance below basin bottom at Stage = 0 ft)
Outlet Pipe Diameter = inches
Restrictor Plate Height Above Pipe Invert = inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate
Outlet Orifice Area = ft²
Outlet Orifice Centroid = feet
Half-Central Angle of Restrictor Plate on Pipe = radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage = ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length = feet
Spillway End Slopes = H:V
Freeboard above Max Water Surface = feet

Calculated Parameters for Spillway
Spillway Design Flow Depth = feet
Stage at Top of Freeboard = feet
Basin Area at Top of Freeboard = acres
Basin Volume at Top of Freeboard = acre-ft




Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	3.00
One-Hour Rainfall Depth (in)	N/A	N/A	0.344	0.481	0.601	0.939	1.255	1.681	2.377
CUHP Runoff Volume (acre-ft)	0.241	0.519	0.344	0.481	0.601	0.939	1.255	1.681	2.377
Inflow Hydrograph Volume (acre-ft)	N/A	N/A	0.344	0.481	0.601	0.939	1.255	1.681	2.377
CUHP Predevelopment Peak Q (cfs)	N/A	N/A	0.2	0.5	0.6	5.6	10.8	17.5	27.9
OPTIONAL: Override Predevelopment Peak Q (cfs)	N/A	N/A							
Predevelopment Unit Peak Flow, q (cfs/acre)	N/A	N/A	0.01	0.02	0.03	0.26	0.51	0.83	1.32
Peak Inflow Q (cfs)	N/A	N/A	5.3	7.7	9.5	15.9	21.7	29.3	40.9
Peak Outflow Q (cfs)	0.1	0.2	0.2	0.2	0.7	5.2	9.8	15.1	16.4
Ratio Peak Outflow to Predevelopment Q	N/A	N/A	N/A	0.4	1.2	0.9	0.9	0.9	0.6
Structure Controlling Flow	Plate	Overflow Weir 1	Plate	Plate	Overflow Weir 1	Overflow Weir 1	Overflow Weir 1	Outlet Plate 1	Outlet Plate 1
Max Velocity through Grate 1 (fps)	N/A	N/A	N/A	N/A	0.0	0.5	0.9	1.3	1.4
Max Velocity through Grate 2 (fps)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours)	38	55	45	54	58	55	52	49	45
Time to Drain 99% of Inflow Volume (hours)	40	59	48	57	62	61	60	58	56
Maximum Ponding Depth (ft)	2.21	3.09	2.49	2.90	3.15	3.37	3.52	3.71	4.25
Area at Maximum Ponding Depth (acres)	0.25	0.40	0.29	0.35	0.42	0.49	0.54	0.60	0.78
Maximum Volume Stored (acre-ft)	0.243	0.522	0.316	0.448	0.547	0.641	0.718	0.826	1.198

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.00 (December 2019)

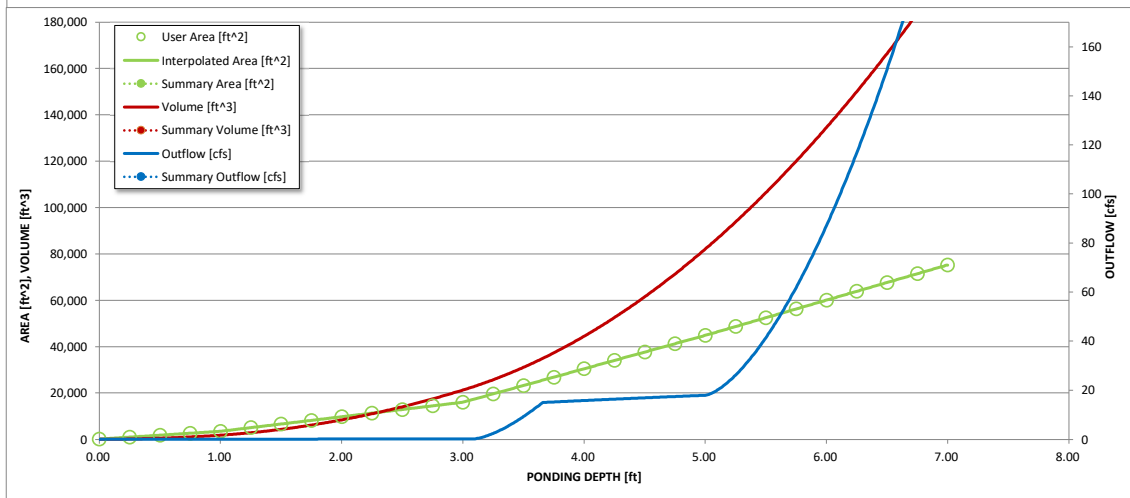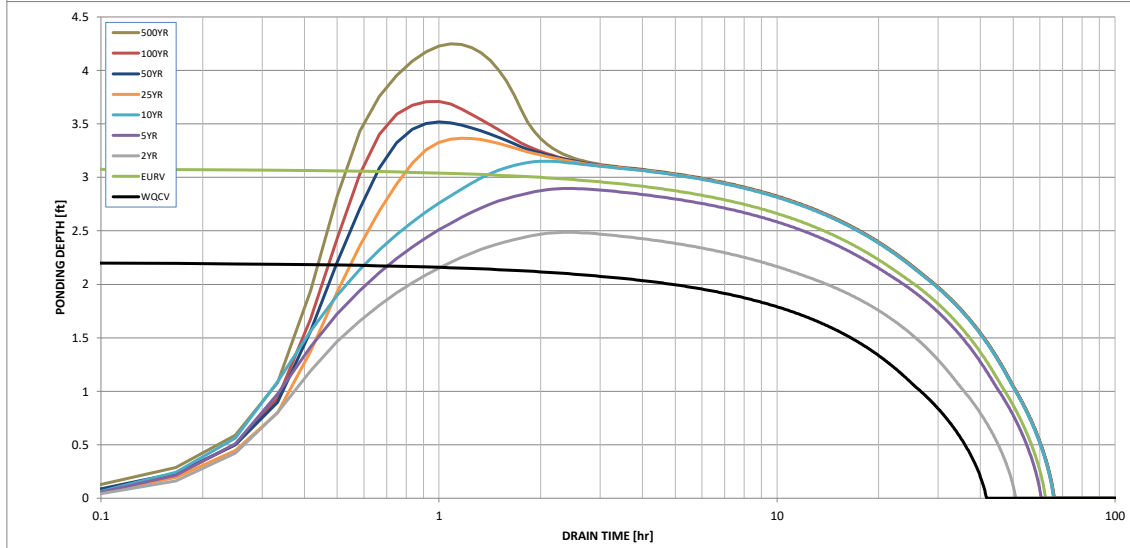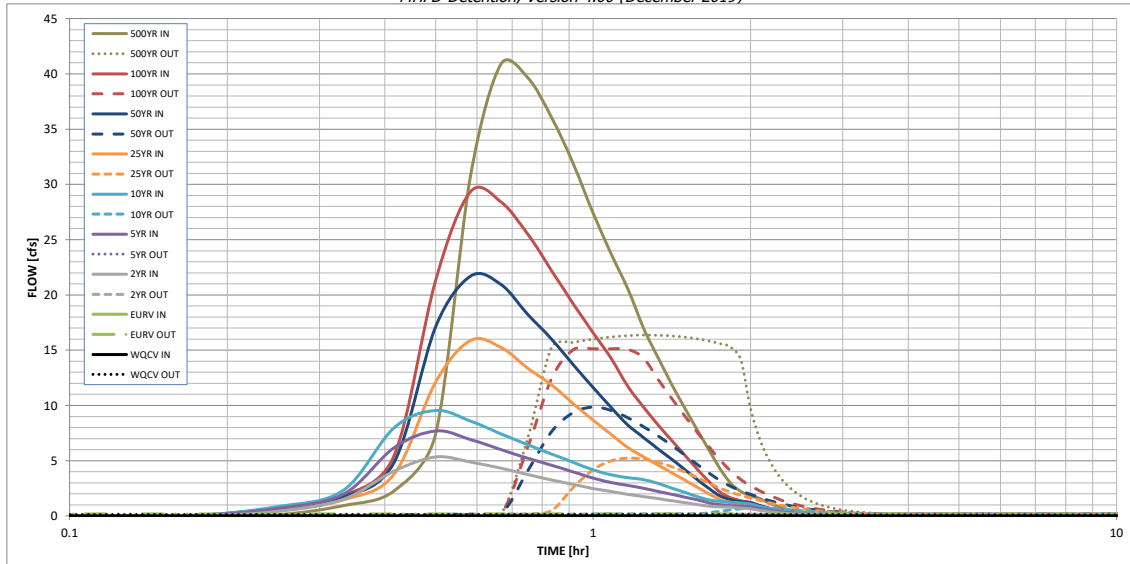

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename: _____

Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

Time Interval	SOURCE	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP
	TIME	WQCV [cfs]	EURV [cfs]	2 Year [cfs]	5 Year [cfs]	10 Year [cfs]	25 Year [cfs]	50 Year [cfs]	100 Year [cfs]	500 Year [cfs]
5.00 min	0:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.05	0.00	0.12
	0:15:00	0.00	0.00	0.42	0.68	0.85	0.57	0.71	0.70	0.94
	0:20:00	0.00	0.00	1.50	1.97	2.32	1.47	1.72	1.84	2.28
	0:25:00	0.00	0.00	4.07	6.19	7.98	3.76	4.83	5.45	7.42
	0:30:00	0.00	0.00	5.34	7.70	9.55	12.10	17.11	21.32	30.78
	0:35:00	0.00	0.00	4.88	6.92	8.59	15.87	21.71	29.34	40.89
	0:40:00	0.00	0.00	4.31	6.01	7.43	15.25	20.95	28.41	39.65
	0:45:00	0.00	0.00	3.74	5.22	6.44	13.37	18.23	25.50	36.05
	0:50:00	0.00	0.00	3.26	4.59	5.61	11.86	16.00	22.20	31.86
	0:55:00	0.00	0.00	2.85	3.98	4.85	10.15	13.68	19.18	27.41
	1:00:00	0.00	0.00	2.48	3.42	4.17	8.66	11.61	16.58	23.68
	1:05:00	0.00	0.00	2.20	3.01	3.72	7.36	9.80	14.23	20.51
	1:10:00	0.00	0.00	1.96	2.75	3.47	6.18	8.21	11.70	16.95
	1:15:00	0.00	0.00	1.75	2.49	3.28	5.33	7.09	9.84	14.26
	1:20:00	0.00	0.00	1.56	2.22	2.92	4.58	6.05	8.21	11.83
	1:25:00	0.00	0.00	1.38	1.95	2.51	3.90	5.09	6.77	9.68
	1:30:00	0.00	0.00	1.20	1.69	2.11	3.22	4.16	5.46	7.75
	1:35:00	0.00	0.00	1.03	1.45	1.75	2.58	3.27	4.22	5.92
	1:40:00	0.00	0.00	0.89	1.18	1.45	1.99	2.46	3.07	4.25
	1:45:00	0.00	0.00	0.82	1.03	1.31	1.49	1.79	2.14	2.94
	1:50:00	0.00	0.00	0.79	0.95	1.24	1.23	1.46	1.64	2.22
	1:55:00	0.00	0.00	0.71	0.89	1.17	1.10	1.28	1.38	1.83
	2:00:00	0.00	0.00	0.63	0.83	1.08	1.03	1.19	1.22	1.57
	2:05:00	0.00	0.00	0.51	0.66	0.86	0.81	0.93	0.93	1.18
	2:10:00	0.00	0.00	0.40	0.52	0.67	0.62	0.71	0.69	0.87
	2:15:00	0.00	0.00	0.31	0.41	0.52	0.48	0.55	0.52	0.63
	2:20:00	0.00	0.00	0.24	0.31	0.40	0.37	0.42	0.38	0.46
	2:25:00	0.00	0.00	0.19	0.24	0.30	0.28	0.32	0.29	0.35
	2:30:00	0.00	0.00	0.14	0.18	0.23	0.21	0.24	0.22	0.26
	2:35:00	0.00	0.00	0.11	0.14	0.17	0.16	0.18	0.17	0.20
	2:40:00	0.00	0.00	0.08	0.10	0.13	0.12	0.13	0.13	0.15
	2:45:00	0.00	0.00	0.06	0.07	0.10	0.09	0.10	0.10	0.11
	2:50:00	0.00	0.00	0.04	0.05	0.07	0.06	0.07	0.07	0.08
	2:55:00	0.00	0.00	0.02	0.03	0.04	0.04	0.05	0.04	0.05
	3:00:00	0.00	0.00	0.01	0.02	0.02	0.03	0.03	0.03	0.03
	3:05:00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01
	3:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Site-Level Low Impact Development (LID) Design Effective Impervious Calculator

LID Credit by Impervious Reduction Factor (IRF) Method

UD-BMP (Version 3.06, November 2016)

User Input

Calculated cells

***Design Storm: 1-Hour Rain Depth	WQCV Event	0.43	inches
***Minor Storm: 1-Hour Rain Depth	5-Year Event	1.50	inches
***Major Storm: 1-Hour Rain Depth	100-Year Event	2.52	inches
Optional User Defined Storm	CUHP		
(CUHP) NOAA 1 Hour Rainfall Depth and Frequency for User Defined Storm	100-Year Event		

Max Intensity for Optional User Defined Storm

0

Designer: QNA

Company: Terra Nova Engineering

Date: June 16, 2022

Project: WATERBURY FILING 1 POND 3

Location: POND 3 Design Point 29 Full Spectrum Detention

SITE INFORMATION (USER-INPUT)

Sub-basin Identifier	DP 29 FSD																		
Receiving Pervious Area Soil Type	Loamy Sand																		
Total Area (ac., Sum of DCIA, UIA, RPA, & SPA)	82.44																		
Directly Connected Impervious Area (DCIA, acres)	19.50																		
Unconnected Impervious Area (UIA, acres)	22.09																		
Receiving Pervious Area (RPA, acres)	9.10																		
Separate Pervious Area (SPA, acres)	31.74																		
RPA Treatment Type: Conveyance (C), Volume (V), or Permeable Pavement (PP)	C																		

CALCULATED RESULTS (OUTPUT)

Total Calculated Area (ac, check against input)	82.435																		
Directly Connected Impervious Area (DCIA, %)	23.7%																		
Unconnected Impervious Area (UIA, %)	26.8%																		
Receiving Pervious Area (RPA, %)	11.0%																		
Separate Pervious Area (SPA, %)	38.5%																		
A_p (RPA / UIA)	0.412																		
I_p Check	0.710																		
f / I for WQCV Event:	4.5																		
f / I for 5-Year Event:	0.5																		
f / I for 100-Year Event:	0.4																		
f / I for Optional User Defined Storm CUHP:																			
IRF for WQCV Event:	0.73																		
IRF for 5-Year Event:	0.93																		
IRF for 100-Year Event:	0.94																		
IRF for Optional User Defined Storm CUHP:																			
Total Site Imperviousness: I_{total}	50.5%																		
Effective Imperviousness for WQCV Event:	43.1%																		
Effective Imperviousness for 5-Year Event:	48.5%																		
Effective Imperviousness for 100-Year Event:	49.0%																		
Effective Imperviousness for Optional User Defined Storm CUHP:																			

LID / EFFECTIVE IMPERVIOUSNESS CREDITS

WQCV Event CREDIT: Reduce Detention By:	9.4%	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
This line only for 10-Year Event	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
100-Year Event CREDIT**: Reduce Detention By:	2.9%	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
User Defined CUHP CREDIT: Reduce Detention By:																			

Total Site Imperviousness:

50.5%

Total Site Effective Imperviousness for WQCV Event:

43.1%

Total Site Effective Imperviousness for 5-Year Event:

48.5%

Total Site Effective Imperviousness for 100-Year Event:

49.0%

Total Site Effective Imperviousness for Optional User Defined Storm CUHP:


Notes:

* Use Green-Ampt average infiltration rate values from Table 3-3.

** Flood control detention volume credits based on empirical equations from Storage Chapter of USDCM.


*** Method assumes that 1-hour rainfall depth is equivalent to 1-hour intensity for calculation purposed

MHFD-Detention, Version 4.03 (May 2020)

Basin ID: POND 3 DP 29[illegible]

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-Detention, Version 4.03 (May 2020)

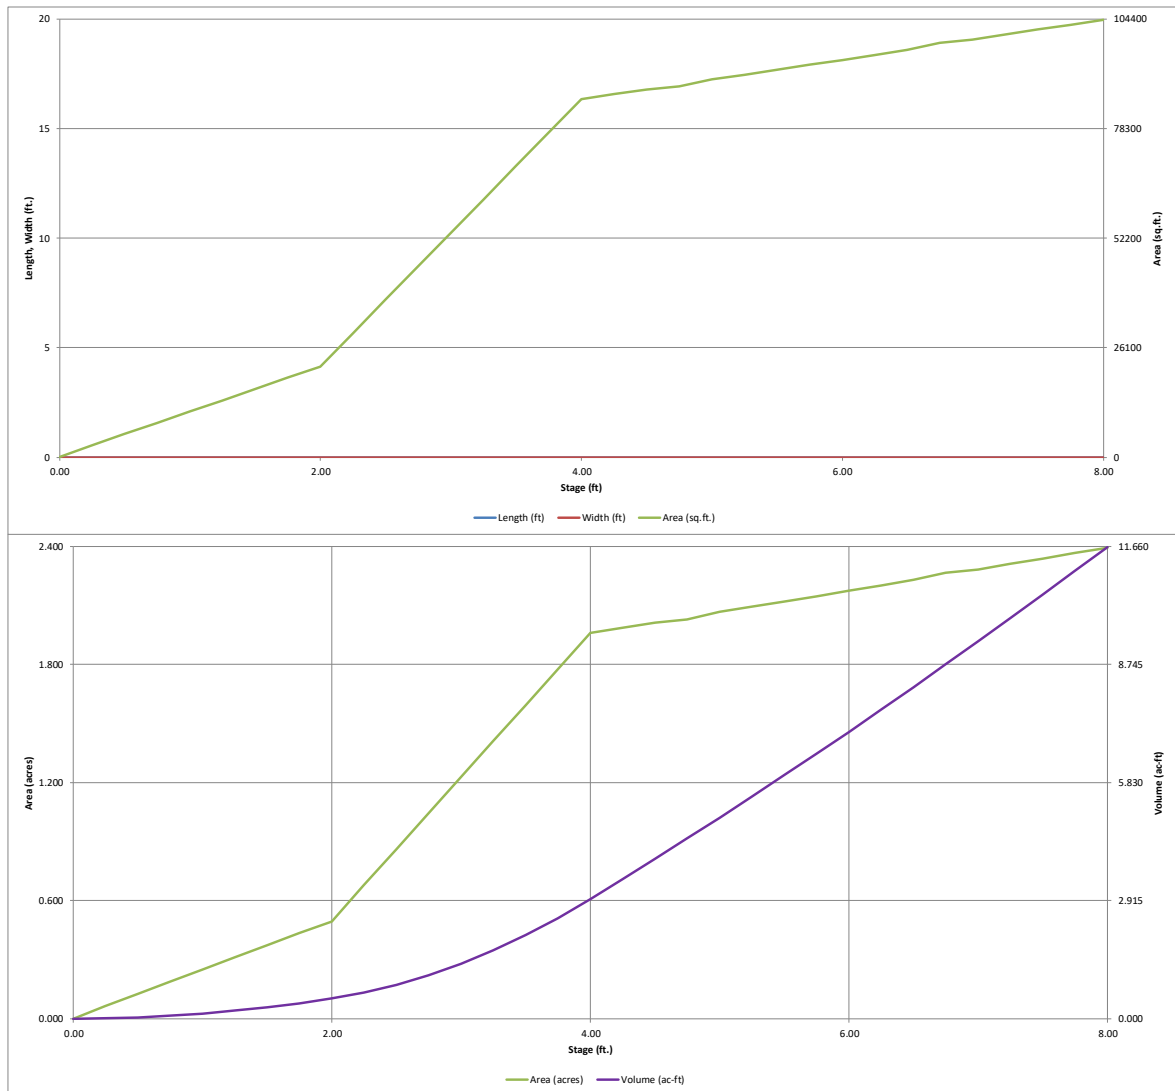


DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.03 (May 2020)

Project: WATERBURY

Basin ID: POND 3 DP 29

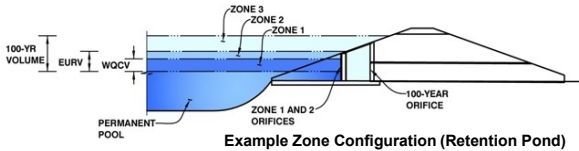

Example Zone Configuration (Retention Pond)

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	3.04	1.398	Orifice Plate
Zone 2 (EURV)	4.84	3.231	Orifice Plate
Zone 3 (100-year)	6.15	2.769	Weir&Pipe (Restrict)
Total (all zones)		7.398	

User Input: Orifice at Underdrain Outlet (typically used to drain WOCV in a Filtration BMP)

Underdrain Orifice Invert Depth = N/A ft (distance below the filtration media surface)
Underdrain Orifice Diameter = N/A inches

Calculated Parameters for Underdrain

Underdrain Orifice Area = N/A ft²
Underdrain Orifice Centroid = N/A feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WOCV and/or EURV in a sedimentation BMP)

Calculated Parameters for Plate

Invert of Lowest Orifice = 0.00 ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Orifice Plate = 4.85 ft (relative to basin bottom at Stage = 0 ft)
Orifice Plate: Orifice Vertical Spacing = 19.40 inches
Orifice Plate: Orifice Area per Row = 6.88 sq. inches (use rectangular openings)

WQ Orifice Area per Row = 4.778E-02 ft²
Elliptical Half-Width = N/A feet
Elliptical Slot Centroid = N/A feet
Elliptical Slot Area = N/A ft²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	1.62	3.23					
Orifice Area (sq. inches)	6.88	6.88	6.88					

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

Calculated Parameters for Vertical Orifice

	Not Selected	Not Selected		Not Selected	Not Selected
Invert of Vertical Orifice =	N/A	N/A	ft (relative to basin bottom at Stage = 0 ft)	Vertical Orifice Area =	N/A ft ²
Depth at top of Zone using Vertical Orifice =	N/A	N/A	ft (relative to basin bottom at Stage = 0 ft)	Vertical Orifice Centroid =	N/A feet
Vertical Orifice Diameter =	N/A	N/A	inches		

User Input: Overflow Weir (Dropbox with Flat or Sloped Gate and Outlet Pipe OR Rectangular/Trapezoidal Weir (and No Outlet Pipe))

Calculated Parameters for Overflow Weir

	Zone 3 Weir	Not Selected		Zone 3 Weir	Not Selected
Overflow Weir Front Edge Height, H _o =	4.85	N/A	ft (relative to basin bottom at Stage = 0 ft)	Height of Gate Upper Edge, H _g =	4.85 feet
Overflow Weir Front Edge Length =	10.00	N/A	feet	Overflow Weir Slope Length =	4.00 feet
Overflow Weir Gate Slope =	0.00	N/A	H:V	Grate Open Area / 100-yr Orifice Area =	5.10 N/A
Horiz. Length of Weir Sides =	4.00	N/A	feet	Overflow Grate Open Area w/o Debris =	28.00 ft ²
Overflow Grate Open Area % =	70%	N/A	%, grate open area/total area	Overflow Grate Open Area w/ Debris =	14.00 ft ²
Debris Clogging % =	50%	N/A	%		

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

	Zone 3 Restrictor	Not Selected		Zone 3 Restrictor	Not Selected
Depth to Invert of Outlet Pipe =	0.10	N/A	ft (distance below basin bottom at Stage = 0 ft)	Outlet Orifice Area =	5.49 ft ²
Outlet Pipe Diameter =	36.00	N/A	inches	Outlet Orifice Centroid =	1.21 feet
Restrictor Plate Height Above Pipe Invert =	26.10		inches	Half-Central Angle of Restrictor Plate on Pipe =	2.04 radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Calculated Parameters for Spillway

Spillway Invert Stage =	6.10	ft (relative to basin bottom at Stage = 0 ft)	Spillway Design Flow Depth =
Spillway Crest Length =	80.00	feet	Stage at Top of Freeboard =
Spillway End Slopes =	3.00	H:V	Basin Area at Top of Freeboard =
Freeboard above Max Water Surface =	0.89	feet	Basin Volume at Top of Freeboard =




Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	3.00
One-Hour Rainfall Depth (in) =	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	3.00
CUHP Runoff Volume (acre-ft) =	1.398	4.629	3.415	4.541	5.445	6.891	8.301	10.096	13.064
Inflow Hydrograph Volume (acre-ft) =	N/A	N/A	3.415	4.541	5.445	6.891	8.301	10.096	13.064
CUHP Predevelopment Peak Q (cfs) =	N/A	N/A	1.1	2.3	3.1	27.2	53.4	86.5	137.6
OPTIONAL Override Predevelopment Peak Q (cfs) =	N/A	N/A							
Predevelopment Unit Peak Flow, q (cfs/acre) =	N/A	N/A	0.01	0.03	0.04	0.33	0.65	1.05	1.67
Peak Inflow Q (cfs) =	N/A	N/A	72.9	99.5	122.8	160.6	202.7	247.2	319.2
Peak Outflow Q (cfs) =	0.7	1.2	1.1	1.2	6.7	17.7	35.1	58.0	116.6
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	0.5	2.2	0.7	0.7	0.7	0.8
Structure Controlling Flow =	Plate	Plate	Plate	Plate	Overflow Weir 1	Overflow Weir 1	Overflow Weir 1	Outlet Plate 1	Spillway
Max Velocity through Gate 1 (fps) =	N/A	N/A	N/A	N/A	0.2	0.6	1.2	2.0	2.1
Max Velocity through Gate 2 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours) =	38	73	62	72	76	74	72	70	67
Time to Drain 99% of Inflow Volume (hours) =	40	78	66	78	82	81	80	79	78
Maximum Ponding Depth (ft) =	3.04	4.84	4.16	4.71	5.05	5.27	5.53	5.93	6.47
Area at Maximum Ponding Depth (acres) =	1.26	2.04	1.98	2.03	2.07	2.10	2.12	2.17	2.23
Maximum Volume Stored (acre-ft) =	1.409	4.634	3.247	4.349	5.066	5.524	6.051	6.930	8.116

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.00 (December 2019)

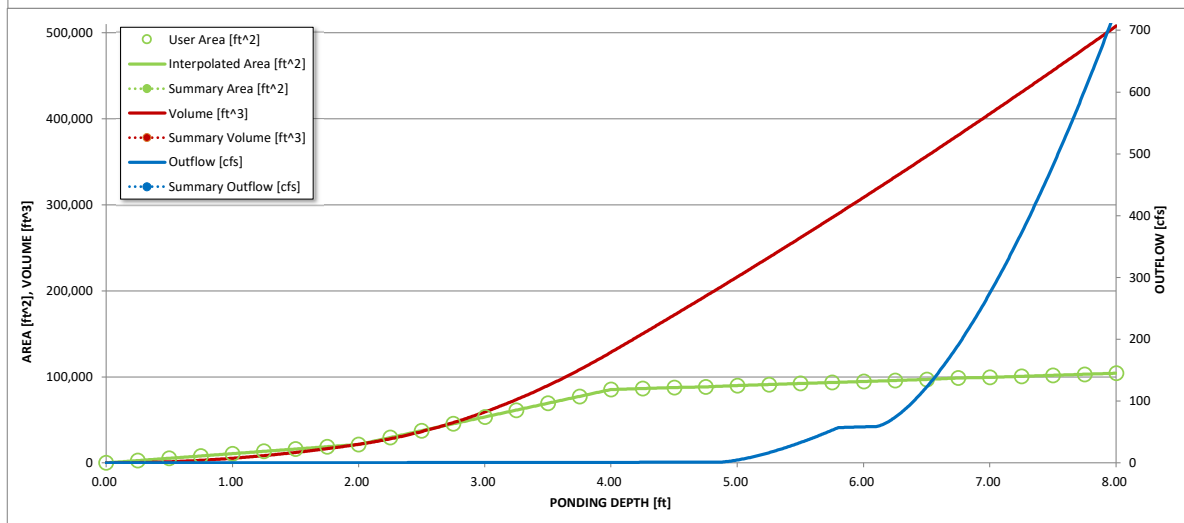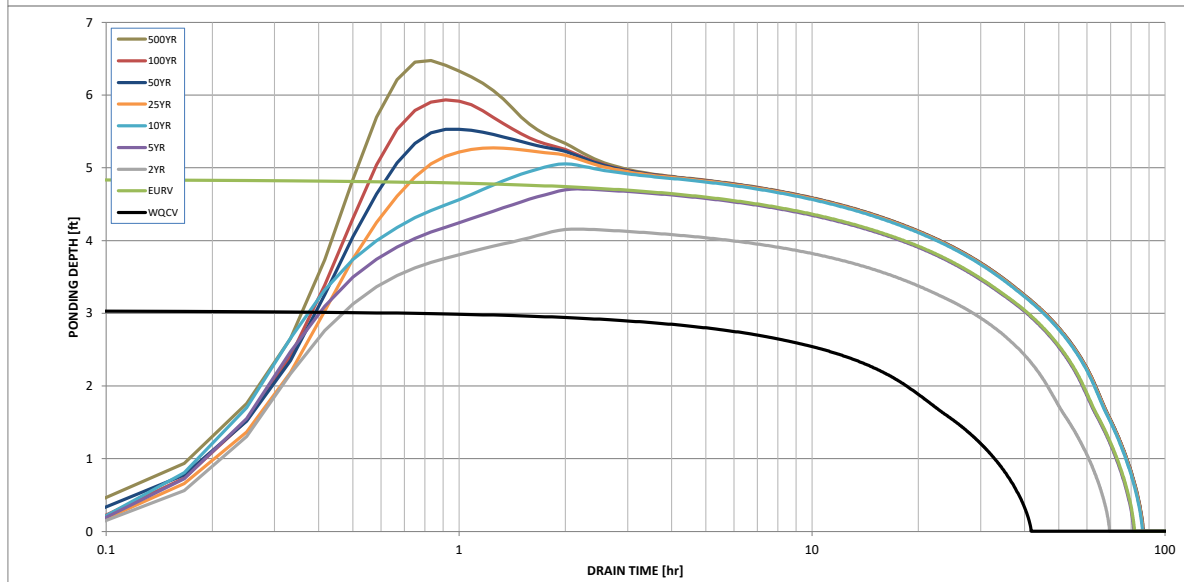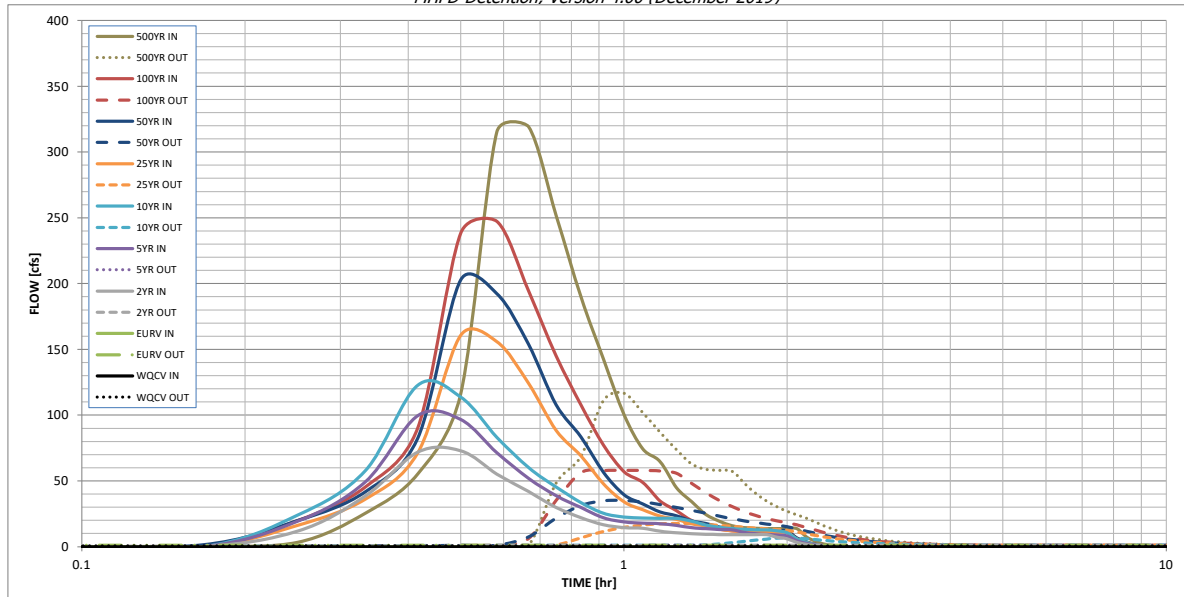

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename: _____

Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

	SOURCE	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP
Time Interval	TIME	WQCV [cfs]	EURV [cfs]	2 Year [cfs]	5 Year [cfs]	10 Year [cfs]	25 Year [cfs]	50 Year [cfs]	100 Year [cfs]	500 Year [cfs]
5.00 min	0:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:10:00	0.00	0.00	0.00	0.00	0.00	0.00	1.35	0.14	3.40
	0:15:00	0.00	0.00	11.84	19.24	23.93	16.13	19.76	19.71	25.41
	0:20:00	0.00	0.00	38.47	49.26	57.67	36.15	41.70	45.37	55.31
	0:25:00	0.00	0.00	71.90	99.51	122.76	71.44	82.68	90.48	116.27
	0:30:00	0.00	0.00	72.87	96.62	113.69	160.63	202.71	238.31	315.30
	0:35:00	0.00	0.00	55.17	71.29	83.09	155.84	192.39	247.17	319.17
	0:40:00	0.00	0.00	41.86	52.06	60.13	124.23	153.76	194.38	251.85
	0:45:00	0.00	0.00	29.85	38.68	45.34	88.38	108.00	144.98	189.78
	0:50:00	0.00	0.00	21.98	29.77	33.50	68.94	83.41	107.69	142.73
	0:55:00	0.00	0.00	16.71	22.00	25.41	47.81	56.67	77.35	100.69
	1:00:00	0.00	0.00	14.54	18.88	22.56	34.08	39.57	57.15	74.42
	1:05:00	0.00	0.00	13.90	17.89	21.84	28.04	32.52	48.85	64.68
	1:10:00	0.00	0.00	11.69	17.49	21.54	23.14	26.47	34.78	44.87
	1:15:00	0.00	0.00	10.54	16.06	21.44	20.71	23.51	27.30	34.27
	1:20:00	0.00	0.00	9.84	14.50	19.40	17.34	19.60	19.81	24.41
	1:25:00	0.00	0.00	9.47	13.63	16.46	15.68	17.70	15.86	19.30
	1:30:00	0.00	0.00	9.23	13.13	14.73	13.32	15.00	13.38	16.05
	1:35:00	0.00	0.00	9.11	12.84	13.74	12.03	13.52	12.17	14.48
	1:40:00	0.00	0.00	9.11	10.93	13.16	11.32	12.73	11.77	14.01
	1:45:00	0.00	0.00	9.11	9.87	12.83	10.96	12.33	11.59	13.80
	1:50:00	0.00	0.00	9.11	9.26	12.73	10.80	12.15	11.59	13.80
	1:55:00	0.00	0.00	7.13	8.93	12.15	10.73	12.07	11.59	13.80
	2:00:00	0.00	0.00	5.98	8.22	10.64	10.73	12.07	11.59	13.80
	2:05:00	0.00	0.00	3.31	4.59	5.96	6.02	6.76	6.47	7.68
	2:10:00	0.00	0.00	1.79	2.53	3.25	3.32	3.72	3.55	4.21
	2:15:00	0.00	0.00	0.85	1.29	1.63	1.69	1.89	1.80	2.12
	2:20:00	0.00	0.00	0.36	0.63	0.75	0.82	0.91	0.87	1.02
	2:25:00	0.00	0.00	0.12	0.20	0.22	0.26	0.28	0.27	0.31
	2:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

FSD POND 1 FORBAY VOLUMES

Required Forbay Volume = 3% of WQCV

WQCV = 0.394 ac-ft
WQCV = 17,155 cu-ft
3% of WQCV = 0.01 ac-ft
3% of WQCV = 514.65 cu-ft

POND PR 7

<i>ELEV</i>	<i>AREA</i>	<i>AREA AVG.</i>	<i>DELTA ELEV.</i>	<i>VOLUME</i>	<i>VOLUME TOTAL</i>
6925.50	198	198	1.5	297	
6927.00	198				297

End Area Method: 297 C.F.
0.007 A.F.

POND PR 10

<i>ELEV</i>	<i>AREA</i>	<i>AREA AVG.</i>	<i>DELTA ELEV.</i>	<i>VOLUME</i>	<i>VOLUME TOTAL</i>
6927.00	198	198	1.5	297	
6928.50	198				297

End Area Method: 297 C.F.
0.007 A.F.

TOTAL 594.000 A.F.
TOTAL 0.014 A.F.

FSD POND 2 FORBAY VOLUMES

Required Forbay Volume = 3% of WQCV

WQCV = 0.241 ac-ft
WQCV = 10,513 cu-ft
3% of WQCV = 0.01 ac-ft
3% of WQCV = 315.38 cu-ft

POND PR 17

<i>ELEV</i>	<i>AREA</i>	<i>AREA AVG.</i>	<i>DELTA ELEV.</i>	<i>VOLUME</i>	<i>VOLUME TOTAL</i>
6900.25	382	382	1.5	573	
6901.75	382				573

End Area Method: 573 C.F.
0.013 A.F.

FSD POND 3 FORBAY VOLUMES

Required Forbay Volume = 3% of WQCV

WQCV = 1.398 ac-ft
WQCV = 60,894 cu-ft
3% of WQCV = 0.04 ac-ft
3% of WQCV = 1826.82 cu-ft

POND PR 33

<i>ELEV</i>	<i>AREA</i>	<i>AREA AVG.</i>	<i>DELTA ELEV.</i>	<i>VOLUME</i>	<i>VOLUME TOTAL</i>
6900.25	900	900	1.5	1350	
6901.75	900				1350

End Area Method: 1350 C.F.
0.031 A.F.

POND PR 34A

<i>ELEV</i>	<i>AREA</i>	<i>AREA AVG.</i>	<i>DELTA ELEV.</i>	<i>VOLUME</i>	<i>VOLUME TOTAL</i>
6900.25	425	425	1.5	638	
6901.75	425				638

End Area Method: 638 C.F.
0.015 A.F.

TOTAL 1987.500 A.F.
TOTAL 0.046 A.F.

RUNOFF REDUCTION

AREA NOT TRIBUTARY TO WQ PONDS FOR RUNOFF REDUCTION

*AREA > 80,000
EQUALLY DIVIDED

BASIN I*	4.97 AC * 216663.77 SQ FT	BASIN I	DCIA	0.00	0.00
			UIA	0.00	0.00
			RPA	0.00	0.00
			SPA	216663.77	72221.26
			Total	216663.77	72221.26
BASIN J*	1.44 AC * 62714.31 SQ FT	BASIN J	DCIA	0.00	
			UIA	19060.56	
			RPA	5039.06	
			SPA	38614.69	
			Total	62714.31	
BASIN N	0.22 AC 9795.98 SQ FT	BASIN N	DCIA	0.00	
			UIA	5504.67	
			RPA	2173.63	
			SPA	2117.68	
			Total	9795.98	
BASIN M1	0.99 AC 42990.74 SQ FT	BASIN M1	DCIA	0.00	
			UIA	720.00	
			RPA	0.00	
			SPA	42270.74	
			Total	42990.74	
BASIN M2	0.35 AC 15313.67 SQ FT	BASIN M2	DCIA	0.00	
			UIA	0.00	
			RPA	0.00	
			SPA	15313.67	
			Total	15313.67	
BASIN P	0.70 AC 30406.49 SQ FT	BASIN N	DCIA	0.00	
			UIA	0.00	
			RPA	0.00	
			SPA	30406.49	
			Total	30406.49	
BASIN V	0.43 AC 18764.05 SQ FT	BASIN N	DCIA	0.00	
			UIA	4224.54	
			RPA	2399.10	
			SPA	12140.41	
			Total	18764.05	

*BROKE DOWN INTO SMALLER AREAS TO MEET MAX 80,000 SQ FT. THERE ARE NO SUBBASINS

Design Procedure Form: Runoff Reduction

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 1

Designer: Quentin Armijo
Company: Terra Nova Engineering, Inc.
Date: July 20, 2022
Project: Waterbury Filings 1 & 2
Location: *BASIN I, J & N WESTERN CHANNEL DIRECT RELEASE. THERE ARE NO SUBBASINS IA-IC WE JUST BROKE I DOWN TO MEET 80,000 SQ FT MAX REQUIREMENT

SITE INFORMATION (User Input in Blue Cells)

WQCV Rainfall Depth 0.60 inches
Depth of Average Runoff Producing Storm, d_0 = 0.43 inches (for Watersheds Outside of the Denver Region, Figure 3-1 in USDCM Vol. 3)

Area Type	SPA	SPA	SPA	SPA	UIA:RPA								
Area ID	IA	IB	IC	J	N								
Downstream Design Point ID	WEST CH	WEST CH	WEST CH	WEST CH	WEST CH								
Downstream BMP Type	None	None	None	None	None								
DCIA (ft ²)	--	--	--	--	--								
UIA (ft ²)	--	--	--	--	5,505								
RPA (ft ²)	--	--	--	--	2,174								
SPA (ft ²)	72,221	72,221	72,221	62,714	--								
HSG A (%)	100%	100%	100%	100%	100%								
HSG B (%)	0%	0%	0%	0%	0%								
HSG C/D (%)	0%	0%	0%	0%	0%								
Average Slope of RPA (ft/ft)	--	--	--	--	0.020								
UIA:RPA Interface Width (ft)	--	--	--	--	60.00								

CALCULATED RUNOFF RESULTS

Area ID	IA	IB	IC	J	N								
UIA:RPA Area (ft ²)	--	--	--	--	7,678								
L / W Ratio	--	--	--	--	2.13								
UIA / Area	--	--	--	--	0.7169								
Runoff (in)	0.00	0.00	0.00	0.00	0.00								
Runoff (ft ³)	0	0	0	0	0								
Runoff Reduction (ft ³)	3611	3611	3611	3136	229								

CALCULATED WQCV RESULTS

Area ID	IA	IB	IC	J	N								
WQCV (ft ³)	0	0	0	0	229								
WQCV Reduction (ft ³)	0	0	0	0	229								
WQCV Reduction (%)	0%	0%	0%	0%	100%								
Untreated WQCV (ft ³)	0	0	0	0	0								

CALCULATED DESIGN POINT RESULTS (sums results from all columns with the same Downstream Design Point ID)

Downstream Design Point ID	WEST CH												
DCIA (ft ²)	0												
UIA (ft ²)	5,505												
RPA (ft ²)	2,174												
SPA (ft ²)	279,378												
Total Area (ft ²)	287,056												
Total Impervious Area (ft ²)	5,505												
WQCV (ft ³)	229												
WQCV Reduction (ft ³)	229												
WQCV Reduction (%)	100%												
Untreated WQCV (ft ³)	0												

CALCULATED SITE RESULTS (sums results from all columns in worksheet)

Total Area (ft ²)	287,056
Total Impervious Area (ft ²)	5,505
WQCV (ft ³)	229
WQCV Reduction (ft ³)	229
WQCV Reduction (%)	100%
Untreated WQCV (ft ³)	0

Design Procedure Form: Runoff Reduction

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 1

Designer: QUENTIN ARMIJO
 Company: TERRA NOVA ENGINEERING, INC.
 Date: June 17, 2022
 Project: WATERBURY FILING 1 & 2
 Location: *BASIN M1 STAPELTON DRIVE DIRECT RELEASE.

SITE INFORMATION (User Input in Blue Cells)

WQCV Rainfall Depth 0.60 inches
 Depth of Average Runoff Producing Storm, d_0 = 0.43 inches (for Watersheds Outside of the Denver Region, Figure 3-1 in USDCM Vol. 3)

Area Type	SPA												
Area ID	M1												
Downstream Design Point ID	Stapleton Dr												
Downstream BMP Type	None												
DCIA (ft ²)	--												
UIA (ft ²)	--												
RPA (ft ²)	--												
SPA (ft ²)	42,991												
HSG A (%)	100%												
HSG B (%)	0%												
HSG C/D (%)	0%												
Average Slope of RPA (ft/ft)	--												
UIA:RPA Interface Width (ft)	--												

CALCULATED RUNOFF RESULTS

Area ID	M1												
UIA:RPA Area (ft ²)	--												
L / W Ratio	--												
UIA / Area	--												
Runoff (in)	0.00												
Runoff (ft ³)	0												
Runoff Reduction (ft ³)	2150												

CALCULATED WQCV RESULTS

Area ID	M1												
WQCV (ft ³)	0												
WQCV Reduction (ft ³)	0												
WQCV Reduction (%)	0%												
Untreated WQCV (ft ³)	0												

CALCULATED DESIGN POINT RESULTS (sums results from all columns with the same Downstream Design Point ID)

Downstream Design Point ID	Stapleton Dr												
DCIA (ft ²)	0												
UIA (ft ²)	0												
RPA (ft ²)	0												
SPA (ft ²)	42,991												
Total Area (ft ²)	42,991												
Total Impervious Area (ft ²)	0												
WQCV (ft ³)	0												
WQCV Reduction (ft ³)	0												
WQCV Reduction (%)	0%												
Untreated WQCV (ft ³)	0												

CALCULATED SITE RESULTS (sums results from all columns in worksheet)

Total Area (ft ²)	42,991
Total Impervious Area (ft ²)	0
WQCV (ft ³)	0
WQCV Reduction (ft ³)	0
WQCV Reduction (%)	0%
Untreated WQCV (ft ³)	0

Design Procedure Form: Runoff Reduction

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 1

Designer: **QUENTIN ARMIJO**
 Company: **TERRA NOVA ENGINEERING, INC.**
 Date: **June 17, 2022**
 Project: **WATERBURY FILING 1 & 2**
 Location: **BASINS M2, P, V, & Y EASTERN CHANNEL DIRECT RELEASE**

SITE INFORMATION (User Input in Blue Cells)

WQCV Rainfall Depth **0.60** inches
 Depth of Average Runoff Producing Storm, d_0 = **0.43** inches (for Watersheds Outside of the Denver Region, Figure 3-1 in USDCM Vol. 3)

Area Type	UIA:RPA	SPA	SPA									
Area ID	M2	P	Y									
Downstream Design Point ID	EAST CH	EAST CH	EAST CH									
Downstream BMP Type	None	None	None									
DCIA (ft ²)	--	--	--									
UIA (ft ²)	2,676	--	--									
RPA (ft ²)	9,048	--	--									
SPA (ft ²)	--	30,406	15,246									
HSG A (%)	100%	100%	100%									
HSG B (%)	0%	0%	0%									
HSG C/D (%)	0%	0%	0%									
Average Slope of RPA (ft/ft)	0.020	--	--									
UIA:RPA Interface Width (ft)	60.00	--	--									

CALCULATED RUNOFF RESULTS

Area ID	M2	P	Y									
UIA:RPA Area (ft ²)	11,724	--	--									
L / W Ratio	3.26	--	--									
UIA / Area	0.2283	--	--									
Runoff (in)	0.00	0.00	0.00									
Runoff (ft ³)	0	0	0									
Runoff Reduction (ft ³)	112	1520	762									

CALCULATED WQCV RESULTS

Area ID	M2	P	Y									
WQCV (ft ³)	112	0	0									
WQCV Reduction (ft ³)	112	0	0									
WQCV Reduction (%)	100%	0%	0%									
Untreated WQCV (ft ³)	0	0	0									

CALCULATED DESIGN POINT RESULTS (sums results from all columns with the same Downstream Design Point ID)

Downstream Design Point ID	EAST CH											
DCIA (ft ²)	0											
UIA (ft ²)	2,676											
RPA (ft ²)	9,048											
SPA (ft ²)	45,652											
Total Area (ft ²)	57,377											
Total Impervious Area (ft ²)	2,676											
WQCV (ft ³)	112											
WQCV Reduction (ft ³)	112											
WQCV Reduction (%)	100%											
Untreated WQCV (ft ³)	0											

CALCULATED SITE RESULTS (sums results from all columns in worksheet)

Total Area (ft ²)	57,377
Total Impervious Area (ft ²)	2,676
WQCV (ft ³)	112
WQCV Reduction (ft ³)	112
WQCV Reduction (%)	100%
Untreated WQCV (ft ³)	0

HEC-RAS ANALYSIS

TABLE 10-1

COMPOSITE ROUGHNESS COEFFICIENTS FOR UNLINED OPEN CHANNELS
(Reference: Chow, Ven Te, 1959; Open-Channel Hydraulics)

$$n = (n_o + n_1 + n_2 + n_3 + n_4)m \quad (10-2)$$

	<u>Channel Conditions</u>	<u>Value</u>
Material Type n_o	Earth	0.020
	Fine Gravel	0.024
	Coarse Gravel	0.028
Degree of Irregularity n_1	Smooth	0.000
	Minor	0.005
	Moderate	0.010
	Severe	0.020
Variation of Channel Cross Section n_2	Gradual	0.000
	Alternating	
	Occasionally	0.005
	Alternating Frequently	0.010 - 0.015
Relative Effect of Obstructions n_3	Negligible	0.000
	Minor	0.010 - 0.015
	Appreciable	0.020 - 0.030
	Severe	0.040 - 0.060
Vegetation n_4	Low	0.005 - 0.010
	Medium	0.010 - 0.025
	High	0.025 - 0.050
	Very High	0.050 - 0.100
Degree of Meandering m	Minor	1.000 - 1.200
	Appreciable	1.200 - 1.500
	Severe	1.500

TABLE 10-2 (Continued)

TYPICAL ROUGHNESS COEFFICIENTS FOR OPEN CHANNELS

<u>Type of Channel and Description</u>	<u>Minimum</u>	<u>Normal</u>	<u>Maximum</u>
NATURAL STREAMS			
Minor streams (top width at flood stage 100 ft)			
a. Streams on plain			
1. Clean, straight, full stage, no rifts or deep pools	0.025	0.030	0.033
2. Same as above, but more stones and weeds	0.030	0.035	0.040
3. Clean, winding, some pools and shoals	0.033	0.040	0.045
4. Same as above, but some weeds and stones	0.035	0.045	0.050
5. Same as above, lower stages, more ineffective slopes and sections	0.040	0.048	0.055
6. Same as 4, but more stones	0.045	0.050	0.060
7. Sluggish reaches, weedy, deep pools	0.050	0.070	0.080
8. Very weedy reaches, deep pools, or floodways with heavy stand of timber and underbrush	0.075	0.100	0.150
LINED OR BUILT-UP CHANNELS			
a. Corrugated Metal	0.021	0.025	0.030
b. Concrete			
1. Trowel finish	0.011	0.013	0.015
2. Float finish	0.013	0.015	0.016
3. Finished, with gravel on bottom	0.015	0.017	0.020
4. Unfinished	0.014	0.017	0.020
5. Gunite, good section	0.016	0.019	0.023
6. Gunite, wavy section	0.018	0.022	0.025
7. On good excavated rock	0.017	0.020	
8. On irregular excavated rock	0.022	0.027	

Table 3. Adjustment values for factors that affect roughness of flood plains

[Modified from Aldridge and Garrett, 1973, table 2]

Flood-plain conditions		<i>n</i> value adjustment	Example
Degree of irregularity (n_1)	Smooth	0.000	Compares to the smoothest, flattest flood plain attainable in a given bed material.
	Minor	0.001–0.005	Is a flood plain slightly irregular in shape. A few rises and dips or sloughs may be visible on the flood plain.
	Moderate	0.006–0.010	Has more rises and dips. Sloughs and hummocks may occur.
	Severe	0.011–0.020	Flood plain very irregular in shape. Many rises and dips or sloughs are visible. Irregular ground surfaces in pastureland and furrows perpendicular to the flow are also included.
Variation of flood-plain cross section (n_2)		0.0	Not applicable.
Effect of obstructions (n_3)	Negligible	0.000–0.004	Few scattered obstructions, which include debris deposits, stumps, exposed roots, logs, or isolated boulders, occupy less than 5 percent of the cross-sectional area.
	Minor	0.005–0.019	Obstructions occupy less than 15 percent of the cross-sectional area.
	Appreciable	0.020–0.030	Obstructions occupy from 15 to 50 percent of the cross-sectional area.
Amount of vegetation (n_4)	Small	0.001–0.010	Dense growth of flexible turf grass, such as Bermuda, or weeds growing where the average depth of flow is at least two times the height of the vegetation, or supple tree seedlings such as willow, cottonwood, arrowweed, or saltcedar growing where the average depth of flow is at least three times the height of the vegetation.
	Medium	0.011–0.025	Turf grass growing where the average depth of flow is from one to two times the height of the vegetation, or moderately dense stemmy grass, weeds, or tree seedlings growing where the average depth of flow is from two to three times the height of the vegetation; brushy, moderately dense vegetation, similar to 1- to 2-year-old willow trees in the dormant season.
	Large	0.025–0.050	Turf grass growing where the average depth of flow is about equal to the height of the vegetation, or 8- to 10-year-old willow or cottonwood trees intergrown with some weeds and brush (none of the vegetation in foliage) where the hydraulic radius exceeds 2 ft, or mature row crops such as small vegetables, or mature field crops where depth of flow is at least twice the height of the vegetation.
	Very large	0.050–0.100	Turf grass growing where the average depth of flow is less than half the height of the vegetation, or moderate to dense brush, or heavy stand of timber with few down trees and little undergrowth where depth of flow is below branches, or mature field crops where depth of flow is less than the height of the vegetation.
	Extreme	0.100–0.200	Dense bushy willow, mesquite, and saltcedar (all vegetation in full foliage), or heavy stand of timber, few down trees, depth of flow reaching branches.
Degree of meander (m)		1.0	Not applicable.

Chow (1959) presents a table showing minimum, normal, and maximum values of n for flood plains covered by pasture and crops. These values are helpful for comparing the roughness values of flood plains having similar vegetation.

Vegetation-Density Method

For a wooded flood plain, the vegetation-density method can be used as an alternative to the previous method for determining n values for flood plains. In a wooded flood plain, where the tree diameters can be measured, the vegetation density of the flood plain can be determined.

Determining the vegetation density is an effective way of relating plant height and density characteristics, as a function of depth of flow, to the flow resistance of vegetation. Application of the flow-resistance model presented below requires an estimate of the vegetation density as a function of depth of flow. The procedure requires a direct or indirect determination of vegetation density at a given depth. If the change in n value through a range in depth is required, then an estimation of vegetation density through that range is necessary.

Techniques for Determining Vegetation Density

Petryk and Bosmajian (1975) developed a method of analysis of the vegetation density to determine the rough-

Classification of Vegetal Covers

Retardance Class	Cover	Condition
A	Weeping lovegrass	Excellent stand, tall, average 30 in.
	Yellow bluestem <i>Ischaemum</i>	Excellent stand, tall, average 36 in.
B	Bermuda grass	Good stand, tall, average 12 in.
	Native grass mixture (little bluestem, bluestem, blue gamma, and other long and short Midwest grasses)	Good stand, unmowed
	Weeping lovegrass	Good stand, tall, average 24 in.
	Lespedeza serica	Good stand, not woody, tall, average 19 in.
	Alfalfa	Good stand uncut, average 11 in.
	Weeping lovegrass	Good stand, unmowed, average 13 in.
	Kudzu	Dense growth, uncut
	Blue gamma	Good stand, uncut, average 13 in.
	Crabgrass	Fair stand, uncut, avg. 10 in.
	Bermuda grass	Good stand, mowed, average 6 in.
C	Common lespedeza	Good stand, uncut, average 11 in.
	Grass-legume mixture - summer (orchard grass, redtop Italian ryegrass, and common lespedeza)	Good stand, uncut, average 6 to 8 in.
	Centipedegrass	Very dense cover, average 6 in.
	Kentucky Bluegrass	Good stand, headed, 6 to 12 in.
	Bermuda grass	Good stand, cut to 2.5 in. height
	Common lespedeza	Excellent stand, uncut, average 4.5 in.
	Buffalo Grass	Good stand, uncut, 3 to 6 in.
D	Grass-legume mixture - fall (orchard grass, redtop Italian ryegrass, and common lespedeza)	Good stand, uncut, 3 to 5 in.
	Lespedeza serica	After cutting to 2 in. height, good stand before cutting
E	Bermuda grass	Good stand, cut to average 1.5 in. height
	Bermuda grass	Burned stubble

Note: Covers classified have been tested in experimental channels. Covers were green and generally uniform.

Source: HEC-15



Coefficients for Roughness of Grass-Lined Channels

SCS Retardance Class	C _n
A	0.605
B	0.418
C	0.220
D	0.147
E	0.093

Source: HEC-15

Composite Roughness

Culverts using different materials for portions of the perimeter such as embedded culverts or culverts with an invert liner should use a composite Manning's n value. A weighted n value based on the materials can be derived using the following equation:

$$n_c = \left[\frac{\sum(p_i n_i^{1.5})}{p} \right]^{0.67}$$

Where:

- n_c = Composite/weighted Manning's n.
- p_i = Wetted perimeter for the material, ft.
- n_i = Manning's n value for the material.
- p = Total wetted perimeter, ft.

750.1.4.1.2 Hydraulic Radius

The hydraulic radius is a characteristic depth of flow and is defined as the cross-sectional area of flow divided by the wetted perimeter of the channel. The hydraulic radius is computed as follows:

$$R = \frac{A}{P}$$

where:

- R = hydraulic radius, ft
- A = cross-sectional area of flow, ft²
- P = wetted perimeter of the channel cross section, ft

750.1.4.1.3 Slope

Table 8-8 Characteristics of selected grass species for use in channels and waterways

Grass species	Height at maturity	
	(ft)	(m)
Cool-season grasses		
Creeping foxtail	3-4	0.9-1.2
Crested wheatgrass	2-3	0.6-0.9
Green needlegrass	3-4	0.9-1.2
Russian wild rye	3-4	0.9-1.2
Smooth brome grass	3-4	0.9-1.2
Tall fescue	3-4	0.9-1.2
Tall wheatgrass		1.2-1.5
Western wheatgrass	2-3	0.6-0.9
Warm-season grasses		
Bermudagrass	3/4-2	0.2-0.6
Big bluestem	4-6	1.2-1.8
Blue grama	1-2	0.3-0.6
Buffalograss	1/3-1	0.1-0.3
Green spangle top	3-4	0.9-1.2
Indiangrass	5-6	1.5-1.8
Klein grass	3-4	0.9-1.2
Little bluestem	3-4	0.9-1.2
Plains bristlegrass	1-2	0.3-0.6
Sand bluestem	5-6	1.5-1.8
Sideoats grama	2-3	0.6-0.9
Switchgrass	4-5	1.2-1.5
Vine mesquitegrass	1-2	0.3-0.6
Weeping lovegrass	3-4	0.9-1.2
Old World bluestems		
Caucasian bluestem	4-5	1.2-1.5
Ganada yellow bluestem	3-4	0.9-1.2

this table were obtained from a review of the available qualitative descriptions and stem counts reported by researchers studying channel resistance and stability.

Since cover conditions vary from year to year and season to season, it is recommended that an upper and lower bound be determined for C_F . The lower bound should be used in stability computations, and the upper bound should be used to determine channel capacity. Some practitioners find that the use of SCS retardance class (table 8-9) is a preferable approach.

The vegetal cover index, C_F , depends primarily on the density and uniformity of density in the immediate vicinity of the soil boundary. Because this parameter is associated with the prevention of local erosion damage which may lead to channel unraveling, the cover factor should represent the weakest area in a reach, rather than the average for the cover species. Recommended values for the cover factor are presented in table 8-10. Values in this table do not account for such considerations as maintenance practices or uniformity of soil fertility or moisture. Therefore, appropriate engineering judgment should be used in its application.

Table 8-10 Properties of grass channel linings values (apply to good uniform stands of each cover)

Cover factor (C_F)	Covers tested	Reference stem density (stems/ft ²)	Reference stem density (stems/m ²)
0.90	Bermudagrass	500	5,380
	Centipede grass	500	5,380
0.87	Buffalograss	400	4,300
	Kentucky bluegrass	350	3,770
	Blue grama	350	3,770
0.75	Grass mixture	200	2,150
0.50	Weeping lovegrass	350	3,770
	Yellow bluestem	250	2,690
0.50	Alfalfa	500	5,380
	Lespedeza sericea	300	3,280
0.50	Common lespedeza	150	1,610
	Sudangrass	50	538

Multiply the stem densities given by 1/3, 2/3, 1, 4/3, and 5/3 for poor, fair, good, very good, and excellent covers, respectively. Reduce the C_F by 20% for fair stands and 50% for poor stands.

Table 8-9 Retardance curve index by SCS retardance class

SCS retardance class	Retardance curve index
A	10.0
B	7.64
C	5.60
D	4.44
E	2.88

Two soil parameters are required for application of effective stress concepts to the stability design of lined or unlined channels having an erodible soil boundary: soil grain roughness, n_s , and allowable effective stress, τ_a . When the effective stress approach is used, the soil parameters are the same for both lined and unlined channels with negligible bed-material sediment transport.

Soil grain roughness is defined as the roughness associated with particles or aggregates of a size that can be independently moved by the flow at incipient channel failure. For noncohesive soils, the soil grain roughness and effective shear stress are both a function of the D_{75} grain size. When D_{75} is greater than 1.3 millimeter, the soil is considered coarse grained. When D_{75} is less than 1.3 millimeter, the soil is considered fine grained. Fine-grained roughness is considered to have a constant value of 0.0156. Fine-grained effective shear stress is taken to have a constant value of 0.02 pound per square foot. Coarse-grained shear stress and roughness are given in figures 8-21 and 8-22.

A soil grain roughness of 0.0156 is assigned to all cohesive soils. The allowable effective stresses are a function of the unified soil classification system soil type, the plasticity index, and the void ratio. The basic allowable shear stress, τ_{ab} , is determined from the plasticity index and soil classification, and then adjusted by the void ratio correction factor, C_e , using the following equation:

$$\tau_a = \tau_{ab} C_e^2 \quad (\text{eq. 8-29})$$

The basic allowable effective stress can be determined from figure 8-23 and the void ratio correction factor from figure 8-24. These two figures were developed directly from the allowable velocity curves in AH 667. Stress partitioning (slope partitioning) is essential to application of figures 8-21 to 8-24, with or without vegetation (Temple et al. 1987).

(e) General design procedure

Use the basic shear stress equation to determine effective shear stress on the soil beneath the vegetation. Use any consistent units of measurement.

$$\tau_e = \gamma d S (1 - C_f) \left(\frac{n_s}{n} \right)^2 \quad (\text{eq. 8-30})$$

where:

- τ_e = effective shear stress exerted on the soil beneath vegetation (lb/ft² or N/m²)
- γ = specific weight of water (lb/ft³ or N/m³)
- d = maximum depth of flow in the cross section (ft or m)
- S = energy slope, dimensionless
- C_f = vegetation cover factor (0 for unlined channel), dimensionless
- n_s = grain roughness of underlying soil, typically taken as dimensionless
- n = roughness coefficient of vegetation, typically taken as dimensionless

The flow depth is used instead of the hydraulic radius because this will result in the maximum local shear stress, rather than the average shear stress. The cover factor is a function of the grass and stem density. Roughness coefficients are standard Manning's roughness values; n_s can be determined from figure 8-22, n can be determined from the old SCS curves (fig. 8-20) or from the following equation.

$$n_R = \exp \left\{ C_1 \left[0.0133 (\ln R_v)^2 - 0.0954 \ln R_v + 0.297 \right] - 4.16 \right\} \quad (\text{eq. 8-31})$$

where:

- R_v = $(VR/v) \times 10^{-5}$ (this dimensionless term reduces to VR for practical application in English units)
- V = channel velocity (ft/s or m/s)
- R = hydraulic radius (ft or m)
- Limited to $0.0025 C_1^{2.5} < R_v < 36$

A reference value of Manning's resistance coefficient, n_R , is applicable to vegetation established on relatively smoothly graded fine-grained soil.

If vegetated channel liner mats are used, manufacturer-supplied roughness coefficients for particular mats may be used in the equation.



Maximum allowable shear stress, τ_{va} , in pound per square foot is determined as a function of the retardance curve index, C_r . Very little information is available for vegetal performance under very high stresses and this relation is believed to be conservative.


$$\tau_{va} = 0.75 C_r \quad (\text{eq. 8-32})$$

Table 8-3. Design parameters for naturalized channels

Design Parameter	Design Value	Results East Channel	Results West Channel
Maximum 100-year depth outside of bankfull channel	5 ft	< than 5 ft	< than 5 ft
Roughness values Per Table 8-5 used <i>Herbaceous wetlands (few or no willows)</i>	0.06 to 0.12	0.6 to 0.9	0.6 to 0.9
Maximum 100-year velocity, main channel (within bankfull channel width) (ft/s)	7 ft/s	4.08 ft/s	4.88 ft/s
Froude No., 100-year, main channel (within bankfull channel width)	0.8	0.78	0.81 (1.00)*
Maximum shear stress, 100-year, main channel (within bankfull channel width) <i>using shear retardance</i>	Class A: 10.0 lb/sq ft Class B: 7.46 lb/sq ft Class C: 5.6 lb/sq ft	3.08 lb/sq ft	3.69 lb/sq ft 7.46 lb/sq ft*
Minimum bankfull capacity of bankfull channel (based on future development conditions)	70% of 2-year discharge or 10% of 100-yr discharge, whichever is greater	NA Exist. doesn't have bankfull channel	NA Exist. doesn't have bankfull channel
Minimum bankfull channel geometry	Per Table 8-2	NA Exist. doesn't have bankfull channel	NA Exist. doesn't have bankfull channel
Minimum bankfull channel width/depth ratio (Equation 8-3)	9	NA Exist. doesn't have bankfull channel	NA Exist. doesn't have bankfull channel
Minimum entrenchment ratio (Equation 8-4)	3	NA Exist. Channel geometry	NA Exist. Channel geometry
Maximum longitudinal slope of low flow channel (assuming unlined, unvegetated low flow channel)	0.20%	NA Exist. doesn't have bankfull channel	NA Exist. doesn't have bankfull channel
Bankfull channel sinuosity (Equation 8-5)	1.1 to 1.3	NA Exist. doesn't have bankfull channel	NA Exist. doesn't have bankfull channel
Maximum overbank side slope	4(H):1(V)	NA Exist. Channel geometry	NA Exist. Channel geometry
Maximum bankfull side slope	2.5(H):1(V)	NA Exist. doesn't have bankfull channel	NA Exist. doesn't have bankfull channel
Minimum radius of curvature	2.5 times top width	NA Exist. Channel geometry	NA Exist. Channel geometry

* critical water surface cross sections with existing or proposed stabilization

WEST CHANNEL

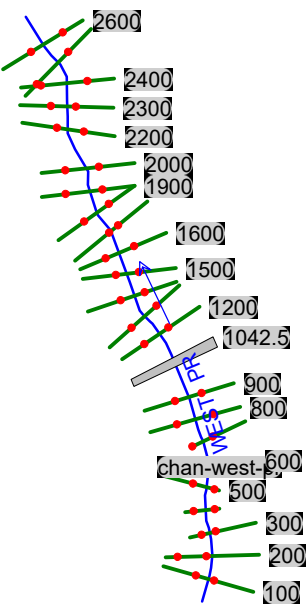

HEC-RAS Plan: Plan p02 River: WEST PR Reach: chan-west-pr Profile: PF 1

Reach	River Sta	Profile	Q Total (cfs)	Min Ch El (ft)	W.S. Elev (ft)	Crit W.S. (ft)	E.G. Elev (ft)	E.G. Slope (ft/ft)	Vel Chnl (ft/s)	Flow Area (sq ft)	Top Width (ft)	Froude # Chl
chan-west-pr	2500	PF 1	216.00	6964.65	6965.93		6965.98	0.013102	1.66	130.51	199.93	0.35
chan-west-pr	2400	PF 1	216.00	6963.47	6964.50		6964.55	0.015483	1.83	117.83	166.80	0.38
chan-west-pr	2300	PF 1	216.00	6961.36	6962.56		6962.65	0.024128	2.28	95.69	148.85	0.48
chan-west-pr	2200	PF 1	216.00	6958.48	6959.78		6959.88	0.032124	2.55	84.85	126.85	0.55
chan-west-pr	2000	PF 1	216.00	6954.19	6956.06		6956.14	0.012222	2.21	98.01	89.64	0.37
chan-west-pr	1900	PF 1	216.00	6952.67	6954.36		6954.52	0.022123	3.22	69.72	73.01	0.51
chan-west-pr	1800	PF 1	216.00	6949.81	6952.00		6952.15	0.024259	3.10	69.74	63.20	0.52
chan-west-pr	1700	PF 1	216.00	6947.04	6949.95		6950.10	0.017499	3.11	69.48	48.11	0.46
chan-west-pr	1600	PF 1	216.00	6945.84	6948.47		6948.56	0.013375	2.44	88.67	73.17	0.39
chan-west-pr	1500	PF 1	216.00	6944.87	6947.29	6946.56	6947.35	0.010886	2.05	105.67	99.84	0.35
chan-west-pr	1420	PF 1	216.00	6944.50	6945.02	6945.02	6945.27	0.121806	4.00	54.01	111.39	1.01
chan-west-pr	1400	PF 1	216.00	6941.00	6942.36		6942.40	0.005034	1.56	138.61	107.47	0.24
chan-west-pr	1380	PF 1	216.00	6940.70	6942.30		6942.33	0.002595	1.28	169.27	108.92	0.18
chan-west-pr	1300	PF 1	216.00	6939.80	6942.23		6942.24	0.000580	0.77	281.42	126.20	0.09
chan-west-pr	1200	PF 1	216.00	6938.25	6942.20	6938.86	6942.21	0.000175	0.60	372.36	110.12	0.05
chan-west-pr	1042.5		Culvert									
chan-west-pr	900	PF 1	222.00	6935.37	6936.87		6936.91	0.005198	1.59	139.91	108.24	0.25
chan-west-pr	800	PF 1	222.00	6934.42	6935.92		6935.98	0.020705	2.10	105.98	156.69	0.44
chan-west-pr	700	PF 1	222.00	6932.80	6934.03		6934.11	0.017047	2.16	104.21	138.09	0.42
chan-west-pr	600	PF 1	222.00	6930.86	6932.28		6932.35	0.018406	2.41	122.58	246.63	0.44
chan-west-pr	500	PF 1	222.00	6928.40	6929.88		6930.01	0.031392	2.93	75.73	90.03	0.56
chan-west-pr	400	PF 1	222.00	6924.97	6927.65		6927.75	0.016862	2.52	87.96	81.70	0.43
chan-west-pr	300	PF 1	222.00	6922.34	6924.48		6924.84	0.059899	4.79	46.31	42.54	0.81
chan-west-pr	200	PF 1	222.00	6919.98	6922.29	6921.40	6922.35	0.012718	1.99	121.48	119.30	0.31
chan-west-pr	100	PF 1	222.00	6918.00	6918.84	6918.84	6919.21	0.162131	4.88	45.46	61.54	1.00

Plan: Plan p02 WEST PR chan-west-pr RS: 2500 Profile: PF 1

E.G. Elev (ft)	6965.98	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.04	Wt. n-Val.		0.080	0.080
W.S. Elev (ft)	6965.93	Reach Len. (ft)	148.70	100.00	20.00
Crit W.S. (ft)		Flow Area (sq ft)		129.82	0.69
E.G. Slope (ft/ft)	0.013102	Area (sq ft)		129.82	0.69
Q Total (cfs)	216.00	Flow (cfs)		215.78	0.22
Top Width (ft)	199.93	Top Width (ft)		187.76	12.16
Vel Total (ft/s)	1.66	Avg. Vel. (ft/s)		1.66	0.31
Max Chl Dpth (ft)	1.28	Hydr. Depth (ft)		0.69	0.06
Conv. Total (cfs)	1887.1	Conv. (cfs)		1885.2	1.9
Length Wtd. (ft)	99.96	Wetted Per. (ft)		187.78	12.16
Min Ch El (ft)	6964.65	Shear (lb/sq ft)		0.57	0.05
Alpha	1.01	Stream Power (lb/ft s)		0.94	0.01
Frctn Loss (ft)	1.42	Cum Volume (acre-ft)	0.13	5.42	0.11
C & E Loss (ft)	0.00	Cum SA (acres)	0.40	5.38	0.42

Plan: Plan p02 WEST PR chan-west-pr RS: 2400 Profile: PF 1

E.G. Elev (ft)	6964.55	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.05	Wt. n-Val.		0.080	
W.S. Elev (ft)	6964.50	Reach Len. (ft)	119.30	100.00	96.70
Crit W.S. (ft)		Flow Area (sq ft)		117.83	
E.G. Slope (ft/ft)	0.015483	Area (sq ft)		117.83	
Q Total (cfs)	216.00	Flow (cfs)		216.00	
Top Width (ft)	166.80	Top Width (ft)		166.80	
Vel Total (ft/s)	1.83	Avg. Vel. (ft/s)		1.83	
Max Chl Dpth (ft)	1.03	Hydr. Depth (ft)		0.71	
Conv. Total (cfs)	1735.9	Conv. (cfs)		1735.9	
Length Wtd. (ft)	100.00	Wetted Per. (ft)		166.82	
Min Ch El (ft)	6963.47	Shear (lb/sq ft)		0.68	
Alpha	1.00	Stream Power (lb/ft s)		1.25	
Frctn Loss (ft)	1.91	Cum Volume (acre-ft)	0.13	5.14	0.11
C & E Loss (ft)	0.00	Cum SA (acres)	0.40	4.97	0.41

Plan: Plan p02 WEST PR chan-west-pr RS: 2300 Profile: PF 1

E.G. Elev (ft)	6962.65	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.08	Wt. n-Val.	0.080	0.080	0.080
W.S. Elev (ft)	6962.56	Reach Len. (ft)	113.10	100.00	97.60
Crit W.S. (ft)		Flow Area (sq ft)	0.29	94.03	1.36
E.G. Slope (ft/ft)	0.024128	Area (sq ft)	0.29	94.03	1.36
Q Total (cfs)	216.00	Flow (cfs)	0.13	214.86	1.01
Top Width (ft)	148.85	Top Width (ft)	5.00	133.38	10.47
Vel Total (ft/s)	2.26	Avg. Vel. (ft/s)	0.44	2.28	0.74
Max Chl Dpth (ft)	1.20	Hydr. Depth (ft)	0.06	0.71	0.13
Conv. Total (cfs)	1390.6	Conv. (cfs)	0.8	1383.2	6.5
Length Wtd. (ft)	100.00	Wetted Per. (ft)	5.00	133.42	10.47
Min Ch El (ft)	6961.36	Shear (lb/sq ft)	0.09	1.06	0.20
Alpha	1.02	Stream Power (lb/ft s)	0.04	2.43	0.15
Frctn Loss (ft)	2.77	Cum Volume (acre-ft)	0.13	4.89	0.11
C & E Loss (ft)	0.00	Cum SA (acres)	0.39	4.63	0.40

Plan: Plan p02 WEST PR chan-west-pr RS: 2200 Profile: PF 1

E.G. Elev (ft)	6959.88	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.10	Wt. n-Val.		0.080	
W.S. Elev (ft)	6959.78	Reach Len. (ft)	170.39	200.00	195.20
Crit W.S. (ft)		Flow Area (sq ft)		84.85	
E.G. Slope (ft/ft)	0.032124	Area (sq ft)		84.85	
Q Total (cfs)	216.00	Flow (cfs)		216.00	
Top Width (ft)	126.85	Top Width (ft)		126.85	
Vel Total (ft/s)	2.55	Avg. Vel. (ft/s)		2.55	
Max Chl Dpth (ft)	1.30	Hydr. Depth (ft)		0.67	
Conv. Total (cfs)	1205.1	Conv. (cfs)		1205.1	
Length Wtd. (ft)	200.00	Wetted Per. (ft)		126.88	
Min Ch El (ft)	6958.48	Shear (lb/sq ft)		1.34	
Alpha	1.00	Stream Power (lb/ft s)		3.41	
Frctn Loss (ft)	3.74	Cum Volume (acre-ft)	0.13	4.69	0.11
C & E Loss (ft)	0.01	Cum SA (acres)	0.38	4.33	0.39

Plan: Plan p02 WEST PR chan-west-pr RS: 2000 Profile: PF 1

E.G. Elev (ft)	6956.14	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.08	Wt. n-Val.	0.080	0.080	0.080
W.S. Elev (ft)	6956.06	Reach Len. (ft)	99.70	100.00	116.50
Crit W.S. (ft)		Flow Area (sq ft)	0.02	97.95	0.03
E.G. Slope (ft/ft)	0.012222	Area (sq ft)	0.02	97.95	0.03
Q Total (cfs)	216.00	Flow (cfs)	0.00	215.99	0.01
Top Width (ft)	89.64	Top Width (ft)	0.77	87.90	0.96
Vel Total (ft/s)	2.20	Avg. Vel. (ft/s)	0.20	2.21	0.20
Max Chl Dpth (ft)	1.87	Hydr. Depth (ft)	0.03	1.11	0.03
Conv. Total (cfs)	1953.8	Conv. (cfs)	0.0	1953.7	0.1
Length Wtd. (ft)	100.07	Wetted Per. (ft)	0.77	88.02	0.97
Min Ch El (ft)	6954.19	Shear (lb/sq ft)	0.02	0.85	0.02
Alpha	1.00	Stream Power (lb/ft s)	0.00	1.87	0.00
Frctn Loss (ft)	1.61	Cum Volume (acre-ft)	0.13	4.27	0.11
C & E Loss (ft)	0.01	Cum SA (acres)	0.38	3.84	0.39

Plan: Plan p02 WEST PR chan-west-pr RS: 1900 Profile: PF 1

E.G. Elev (ft)	6954.52	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.16	Wt. n-Val.	0.080	0.080	0.080
W.S. Elev (ft)	6954.36	Reach Len. (ft)	674.00	100.00	141.40
Crit W.S. (ft)		Flow Area (sq ft)	1.78	65.95	2.00
E.G. Slope (ft/ft)	0.022123	Area (sq ft)	1.78	65.95	2.00
Q Total (cfs)	216.00	Flow (cfs)	1.57	212.67	1.76
Top Width (ft)	73.01	Top Width (ft)	9.81	52.18	11.01
Vel Total (ft/s)	3.10	Avg. Vel. (ft/s)	0.88	3.22	0.88
Max Chl Dpth (ft)	1.69	Hydr. Depth (ft)	0.18	1.26	0.18
Conv. Total (cfs)	1452.2	Conv. (cfs)	10.6	1429.8	11.9
Length Wtd. (ft)	102.26	Wetted Per. (ft)	9.82	52.30	11.02
Min Ch El (ft)	6952.67	Shear (lb/sq ft)	0.25	1.74	0.25
Alpha	1.07	Stream Power (lb/ft s)	0.22	5.62	0.22
Frctn Loss (ft)	2.37	Cum Volume (acre-ft)	0.13	4.08	0.11
C & E Loss (ft)	0.00	Cum SA (acres)	0.37	3.68	0.37

Plan: Plan p02 WEST PR chan-west-pr RS: 1800 Profile: PF 1

E.G. Elev (ft)	6952.15	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.15	Wt. n-Val.	0.000	0.080	
W.S. Elev (ft)	6952.00	Reach Len. (ft)	99.30	100.00	113.30
Crit W.S. (ft)		Flow Area (sq ft)	0.00	69.74	
E.G. Slope (ft/ft)	0.024259	Area (sq ft)	0.00	69.74	0.00
Q Total (cfs)	216.00	Flow (cfs)	0.00	216.00	
Top Width (ft)	63.20	Top Width (ft)	0.41	62.78	
Vel Total (ft/s)	3.10	Avg. Vel. (ft/s)	0.14	3.10	
Max Chl Dpth (ft)	2.19	Hydr. Depth (ft)	0.01	1.11	
Conv. Total (cfs)	1386.8	Conv. (cfs)	0.0	1386.8	
Length Wtd. (ft)	100.00	Wetted Per. (ft)	0.41	62.95	
Min Ch El (ft)	6949.81	Shear (lb/sq ft)		1.68	
Alpha	1.00	Stream Power (lb/ft s)		5.20	
Frctn Loss (ft)	2.05	Cum Volume (acre-ft)	0.11	3.93	0.11
C & E Loss (ft)	0.00	Cum SA (acres)	0.29	3.54	0.35

Plan: Plan p02 WEST PR chan-west-pr RS: 1700 Profile: PF 1

E.G. Elev (ft)	6950.10	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.15	Wt. n-Val.		0.080	
W.S. Elev (ft)	6949.95	Reach Len. (ft)	113.00	100.00	112.30
Crit W.S. (ft)		Flow Area (sq ft)		69.48	
E.G. Slope (ft/ft)	0.017499	Area (sq ft)		69.48	
Q Total (cfs)	216.00	Flow (cfs)		216.00	
Top Width (ft)	48.11	Top Width (ft)		48.11	
Vel Total (ft/s)	3.11	Avg. Vel. (ft/s)		3.11	
Max Chl Dpth (ft)	2.91	Hydr. Depth (ft)		1.44	
Conv. Total (cfs)	1632.9	Conv. (cfs)		1632.9	
Length Wtd. (ft)	100.00	Wetted Per. (ft)		48.82	
Min Ch El (ft)	6947.04	Shear (lb/sq ft)		1.55	
Alpha	1.00	Stream Power (lb/ft s)		4.83	
Frctn Loss (ft)	1.52	Cum Volume (acre-ft)	0.11	3.77	0.11
C & E Loss (ft)	0.02	Cum SA (acres)	0.29	3.42	0.35

Plan: Plan p02 WEST PR chan-west-pr RS: 1600 Profile: PF 1

E.G. Elev (ft)	6948.56	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.09	Wt. n-Val.		0.080	
W.S. Elev (ft)	6948.47	Reach Len. (ft)	113.20	100.00	83.60
Crit W.S. (ft)		Flow Area (sq ft)		88.67	
E.G. Slope (ft/ft)	0.013375	Area (sq ft)		88.67	
Q Total (cfs)	216.00	Flow (cfs)		216.00	
Top Width (ft)	73.17	Top Width (ft)		73.17	
Vel Total (ft/s)	2.44	Avg. Vel. (ft/s)		2.44	
Max Chl Dpth (ft)	2.63	Hydr. Depth (ft)		1.21	
Conv. Total (cfs)	1867.7	Conv. (cfs)		1867.7	
Length Wtd. (ft)	100.00	Wetted Per. (ft)		73.42	
Min Ch El (ft)	6945.84	Shear (lb/sq ft)		1.01	
Alpha	1.00	Stream Power (lb/ft s)		2.46	
Frctn Loss (ft)	1.20	Cum Volume (acre-ft)	0.11	3.58	0.11
C & E Loss (ft)	0.01	Cum SA (acres)	0.29	3.28	0.35

Plan: Plan p02 WEST PR chan-west-pr RS: 1500 Profile: PF 1

E.G. Elev (ft)	6947.35	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.07	Wt. n-Val.	0.080	0.080	
W.S. Elev (ft)	6947.29	Reach Len. (ft)	69.00	80.00	90.00
Crit W.S. (ft)	6946.56	Flow Area (sq ft)	0.13	105.54	
E.G. Slope (ft/ft)	0.010886	Area (sq ft)	0.13	105.54	
Q Total (cfs)	216.00	Flow (cfs)	0.03	215.97	
Top Width (ft)	99.84	Top Width (ft)	2.78	97.06	
Vel Total (ft/s)	2.04	Avg. Vel. (ft/s)	0.26	2.05	
Max Chl Dpth (ft)	2.42	Hydr. Depth (ft)	0.05	1.09	
Conv. Total (cfs)	2070.3	Conv. (cfs)	0.3	2069.9	
Length Wtd. (ft)	80.00	Wetted Per. (ft)	2.78	97.26	
Min Ch El (ft)	6944.87	Shear (lb/sq ft)	0.03	0.74	
Alpha	1.00	Stream Power (lb/ft s)	0.01	1.51	
Frctn Loss (ft)	2.06	Cum Volume (acre-ft)	0.11	3.36	0.11
C & E Loss (ft)	0.02	Cum SA (acres)	0.29	3.08	0.35

Plan: Plan p02 WEST PR chan-west-pr RS: 1420 Profile: PF 1

E.G. Elev (ft)	6945.27	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.25	Wt. n-Val.		0.080	
W.S. Elev (ft)	6945.02	Reach Len. (ft)	19.90	20.00	20.20
Crit W.S. (ft)	6945.02	Flow Area (sq ft)		54.01	
E.G. Slope (ft/ft)	0.121806	Area (sq ft)		54.01	
Q Total (cfs)	216.00	Flow (cfs)		216.00	
Top Width (ft)	111.39	Top Width (ft)		111.39	
Vel Total (ft/s)	4.00	Avg. Vel. (ft/s)		4.00	
Max Chl Dpth (ft)	0.52	Hydr. Depth (ft)		0.48	
Conv. Total (cfs)	618.9	Conv. (cfs)		618.9	
Length Wtd. (ft)	20.00	Wetted Per. (ft)		111.45	
Min Ch El (ft)	6944.50	Shear (lb/sq ft)		3.69	
Alpha	1.00	Stream Power (lb/ft s)		14.74	
Frctn Loss (ft)	0.28	Cum Volume (acre-ft)	0.11	3.22	0.11
C & E Loss (ft)	0.06	Cum SA (acres)	0.28	2.89	0.35

Plan: Plan p02 WEST PR chan-west-pr RS: 1400 Profile: PF 1

E.G. Elev (ft)	6942.40	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.04	Wt. n-Val.		0.080	
W.S. Elev (ft)	6942.36	Reach Len. (ft)	19.90	20.00	21.00
Crit W.S. (ft)		Flow Area (sq ft)		138.61	
E.G. Slope (ft/ft)	0.005034	Area (sq ft)		138.61	
Q Total (cfs)	216.00	Flow (cfs)		216.00	
Top Width (ft)	107.47	Top Width (ft)		107.47	
Vel Total (ft/s)	1.56	Avg. Vel. (ft/s)		1.56	
Max Chl Dpth (ft)	1.36	Hydr. Depth (ft)		1.29	
Conv. Total (cfs)	3044.5	Conv. (cfs)		3044.5	
Length Wtd. (ft)	20.00	Wetted Per. (ft)		107.78	
Min Ch El (ft)	6941.00	Shear (lb/sq ft)		0.40	
Alpha	1.00	Stream Power (lb/ft s)		0.63	
Frctn Loss (ft)	0.07	Cum Volume (acre-ft)	0.11	3.17	0.11
C & E Loss (ft)	0.00	Cum SA (acres)	0.28	2.84	0.35

Plan: Plan p02 WEST PR chan-west-pr RS: 1380 Profile: PF 1

E.G. Elev (ft)	6942.33	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.03	Wt. n-Val.	0.080	0.080	0.080
W.S. Elev (ft)	6942.30	Reach Len. (ft)	53.20	80.00	101.00
Crit W.S. (ft)		Flow Area (sq ft)	0.18	168.87	0.22
E.G. Slope (ft/ft)	0.002595	Area (sq ft)	0.18	168.87	0.22
Q Total (cfs)	216.00	Flow (cfs)	0.05	215.89	0.06
Top Width (ft)	108.92	Top Width (ft)	1.19	106.30	1.42
Vel Total (ft/s)	1.28	Avg. Vel. (ft/s)	0.26	1.28	0.27
Max Chl Dpth (ft)	1.60	Hydr. Depth (ft)	0.15	1.59	0.15
Conv. Total (cfs)	4240.4	Conv. (cfs)	0.9	4238.4	1.1
Length Wtd. (ft)	80.00	Wetted Per. (ft)	1.23	107.51	1.45
Min Ch El (ft)	6940.70	Shear (lb/sq ft)	0.02	0.25	0.02
Alpha	1.00	Stream Power (lb/ft s)	0.01	0.33	0.01
Frctn Loss (ft)	0.09	Cum Volume (acre-ft)	0.11	3.10	0.11
C & E Loss (ft)	0.00	Cum SA (acres)	0.28	2.79	0.35

Plan: Plan p02 WEST PR chan-west-pr RS: 1300 Profile: PF 1

E.G. Elev (ft)	6942.24	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.01	Wt. n-Val.	0.080	0.080	0.080
W.S. Elev (ft)	6942.23	Reach Len. (ft)	107.40	100.00	88.80
Crit W.S. (ft)		Flow Area (sq ft)	0.06	281.26	0.10
E.G. Slope (ft/ft)	0.000580	Area (sq ft)	0.06	281.26	0.10
Q Total (cfs)	216.00	Flow (cfs)	0.00	215.99	0.01
Top Width (ft)	126.20	Top Width (ft)	0.70	124.60	0.90
Vel Total (ft/s)	0.77	Avg. Vel. (ft/s)	0.08	0.77	0.10
Max Chl Dpth (ft)	2.43	Hydr. Depth (ft)	0.08	2.26	0.11
Conv. Total (cfs)	8966.4	Conv. (cfs)	0.2	8965.8	0.4
Length Wtd. (ft)	99.98	Wetted Per. (ft)	0.72	125.10	0.93
Min Ch El (ft)	6939.80	Shear (lb/sq ft)	0.00	0.08	0.00
Alpha	1.00	Stream Power (lb/ft s)	0.00	0.06	0.00
Frctn Loss (ft)	0.03	Cum Volume (acre-ft)	0.11	2.69	0.11
C & E Loss (ft)	0.00	Cum SA (acres)	0.28	2.58	0.35

Plan: Plan p02 WEST PR chan-west-pr RS: 1200 Profile: PF 1

E.G. Elev (ft)	6942.21	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.01	Wt. n-Val.	0.080	0.080	0.080
W.S. Elev (ft)	6942.20	Reach Len. (ft)	313.70	300.00	276.40
Crit W.S. (ft)	6938.86	Flow Area (sq ft)	9.72	352.84	9.80
E.G. Slope (ft/ft)	0.000175	Area (sq ft)	9.72	352.84	9.80
Q Total (cfs)	216.00	Flow (cfs)	2.50	210.98	2.52
Top Width (ft)	110.12	Top Width (ft)	8.82	92.43	8.88
Vel Total (ft/s)	0.58	Avg. Vel. (ft/s)	0.26	0.60	0.26
Max Chl Dpth (ft)	3.95	Hydr. Depth (ft)	1.10	3.82	1.10
Conv. Total (cfs)	16338.2	Conv. (cfs)	189.0	15958.7	190.5
Length Wtd. (ft)	300.00	Wetted Per. (ft)	9.09	92.86	9.14
Min Ch El (ft)	6938.25	Shear (lb/sq ft)	0.01	0.04	0.01
Alpha	1.04	Stream Power (lb/ft s)	0.00	0.02	0.00
Frctn Loss (ft)		Cum Volume (acre-ft)	0.10	1.96	0.10
C & E Loss (ft)		Cum SA (acres)	0.27	2.33	0.34

Plan: Plan p02 WEST PR chan-west-pr RS: 900 Profile: PF 1

E.G. Elev (ft)	6936.91	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.04	Wt. n-Val.		0.080	
W.S. Elev (ft)	6936.87	Reach Len. (ft)	104.20	100.00	101.80
Crit W.S. (ft)		Flow Area (sq ft)		139.91	
E.G. Slope (ft/ft)	0.005198	Area (sq ft)		139.91	
Q Total (cfs)	222.00	Flow (cfs)		222.00	
Top Width (ft)	108.24	Top Width (ft)		108.24	
Vel Total (ft/s)	1.59	Avg. Vel. (ft/s)		1.59	
Max Chl Dpth (ft)	1.50	Hydr. Depth (ft)		1.29	
Conv. Total (cfs)	3079.3	Conv. (cfs)		3079.3	
Length Wtd. (ft)	100.00	Wetted Per. (ft)		108.47	
Min Ch El (ft)	6935.37	Shear (lb/sq ft)		0.42	
Alpha	1.00	Stream Power (lb/ft s)		0.66	
Frctn Loss (ft)	0.92	Cum Volume (acre-ft)	0.10	1.54	0.10
C & E Loss (ft)	0.00	Cum SA (acres)	0.24	1.64	0.31

Plan: Plan p02 WEST PR chan-west-pr RS: 800 Profile: PF 1

E.G. Elev (ft)	6935.98	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.07	Wt. n-Val.		0.080	0.080
W.S. Elev (ft)	6935.92	Reach Len. (ft)	96.40	100.00	114.30
Crit W.S. (ft)		Flow Area (sq ft)		105.93	0.05
E.G. Slope (ft/ft)	0.020705	Area (sq ft)		105.93	0.05
Q Total (cfs)	222.00	Flow (cfs)		221.99	0.01
Top Width (ft)	156.69	Top Width (ft)		152.39	4.29
Vel Total (ft/s)	2.09	Avg. Vel. (ft/s)		2.10	0.14
Max Chl Dpth (ft)	1.50	Hydr. Depth (ft)		0.70	0.01
Conv. Total (cfs)	1542.8	Conv. (cfs)		1542.8	0.0
Length Wtd. (ft)	100.04	Wetted Per. (ft)		152.57	4.32
Min Ch El (ft)	6934.42	Shear (lb/sq ft)		0.90	0.02
Alpha	1.00	Stream Power (lb/ft s)		1.88	0.00
Frctn Loss (ft)	1.88	Cum Volume (acre-ft)	0.10	1.26	0.10
C & E Loss (ft)	0.00	Cum SA (acres)	0.24	1.34	0.31

Plan: Plan p02 WEST PR chan-west-pr RS: 700 Profile: PF 1

E.G. Elev (ft)	6934.11	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.07	Wt. n-Val.	0.000	0.080	0.080
W.S. Elev (ft)	6934.03	Reach Len. (ft)	114.30	100.00	85.80
Crit W.S. (ft)		Flow Area (sq ft)	0.00	102.13	2.08
E.G. Slope (ft/ft)	0.017047	Area (sq ft)	0.00	102.13	2.08
Q Total (cfs)	222.00	Flow (cfs)	0.00	220.74	1.26
Top Width (ft)	138.09	Top Width (ft)	0.14	121.30	16.65
Vel Total (ft/s)	2.13	Avg. Vel. (ft/s)	0.16	2.16	0.61
Max Chl Dpth (ft)	1.23	Hydr. Depth (ft)	0.02	0.84	0.12
Conv. Total (cfs)	1700.3	Conv. (cfs)	0.0	1690.7	9.6
Length Wtd. (ft)	98.84	Wetted Per. (ft)	0.15	121.38	16.65
Min Ch El (ft)	6932.80	Shear (lb/sq ft)		0.90	0.13
Alpha	1.02	Stream Power (lb/ft s)		1.94	0.08
Frctn Loss (ft)	1.75	Cum Volume (acre-ft)	0.10	1.02	0.09
C & E Loss (ft)	0.00	Cum SA (acres)	0.24	1.03	0.28

Plan: Plan p02 WEST PR chan-west-pr RS: 600 Profile: PF 1

E.G. Elev (ft)	6932.35	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.07	Wt. n-Val.	0.080	0.080	0.080
W.S. Elev (ft)	6932.28	Reach Len. (ft)	110.80	100.00	88.00
Crit W.S. (ft)		Flow Area (sq ft)	16.97	60.32	45.29
E.G. Slope (ft/ft)	0.018406	Area (sq ft)	16.97	60.32	45.29
Q Total (cfs)	222.00	Flow (cfs)	20.81	145.32	55.88
Top Width (ft)	246.63	Top Width (ft)	49.93	64.50	132.21
Vel Total (ft/s)	1.81	Avg. Vel. (ft/s)	1.23	2.41	1.23
Max Chl Dpth (ft)	1.42	Hydr. Depth (ft)	0.34	0.94	0.34
Conv. Total (cfs)	1636.3	Conv. (cfs)	153.4	1071.1	411.9
Length Wtd. (ft)	99.00	Wetted Per. (ft)	50.03	64.53	132.21
Min Ch EI (ft)	6930.86	Shear (lb/sq ft)	0.39	1.07	0.39
Alpha	1.32	Stream Power (lb/ft s)	0.48	2.59	0.49
Frctn Loss (ft)	2.34	Cum Volume (acre-ft)	0.08	0.83	0.05
C & E Loss (ft)	0.01	Cum SA (acres)	0.17	0.81	0.13

Plan: Plan p02 WEST PR chan-west-pr RS: 500 Profile: PF 1

E.G. Elev (ft)	6930.01	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.13	Wt. n-Val.		0.080	
W.S. Elev (ft)	6929.88	Reach Len. (ft)	85.20	100.00	105.50
Crit W.S. (ft)		Flow Area (sq ft)		75.73	
E.G. Slope (ft/ft)	0.031392	Area (sq ft)		75.73	
Q Total (cfs)	222.00	Flow (cfs)		222.00	
Top Width (ft)	90.03	Top Width (ft)		90.03	
Vel Total (ft/s)	2.93	Avg. Vel. (ft/s)		2.93	
Max Chl Dpth (ft)	1.48	Hydr. Depth (ft)		0.84	
Conv. Total (cfs)	1253.0	Conv. (cfs)		1253.0	
Length Wtd. (ft)	100.00	Wetted Per. (ft)		90.09	
Min Ch EI (ft)	6928.40	Shear (lb/sq ft)		1.65	
Alpha	1.00	Stream Power (lb/ft s)		4.83	
Frctn Loss (ft)	2.25	Cum Volume (acre-ft)	0.06	0.68	
C & E Loss (ft)	0.01	Cum SA (acres)	0.11	0.64	

Plan: Plan p02 WEST PR chan-west-pr RS: 400 Profile: PF 1

E.G. Elev (ft)	6927.75	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.10	Wt. n-Val.		0.080	
W.S. Elev (ft)	6927.65	Reach Len. (ft)	95.20	100.00	105.50
Crit W.S. (ft)		Flow Area (sq ft)		87.96	
E.G. Slope (ft/ft)	0.016862	Area (sq ft)		87.96	
Q Total (cfs)	222.00	Flow (cfs)		222.00	
Top Width (ft)	81.70	Top Width (ft)		81.70	
Vel Total (ft/s)	2.52	Avg. Vel. (ft/s)		2.52	
Max Chl Dpth (ft)	2.68	Hydr. Depth (ft)		1.08	
Conv. Total (cfs)	1709.6	Conv. (cfs)		1709.6	
Length Wtd. (ft)	100.00	Wetted Per. (ft)		82.17	
Min Ch EI (ft)	6924.97	Shear (lb/sq ft)		1.13	
Alpha	1.00	Stream Power (lb/ft s)		2.84	
Frctn Loss (ft)	2.88	Cum Volume (acre-ft)	0.06	0.49	
C & E Loss (ft)	0.03	Cum SA (acres)	0.11	0.44	

Plan: Plan p02 WEST PR chan-west-pr RS: 300 Profile: PF 1


E.G. Elev (ft)	6924.84	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.36	Wt. n-Val.		0.080	
W.S. Elev (ft)	6924.48	Reach Len. (ft)	113.50	100.00	139.70
Crit W.S. (ft)		Flow Area (sq ft)		46.31	
E.G. Slope (ft/ft)	0.059899	Area (sq ft)		46.31	
Q Total (cfs)	222.00	Flow (cfs)		222.00	
Top Width (ft)	42.54	Top Width (ft)		42.54	
Vel Total (ft/s)	4.79	Avg. Vel. (ft/s)		4.79	
Max Chl Dpth (ft)	2.14	Hydr. Depth (ft)		1.09	
Conv. Total (cfs)	907.1	Conv. (cfs)		907.1	
Length Wtd. (ft)	100.71	Wetted Per. (ft)		42.76	
Min Ch El (ft)	6922.34	Shear (lb/sq ft)		4.05	
Alpha	1.00	Stream Power (lb/ft s)		19.41	
Frctn Loss (ft)	2.40	Cum Volume (acre-ft)	0.06	0.33	
C & E Loss (ft)	0.09	Cum SA (acres)	0.11	0.30	


Plan: Plan p02 WEST PR chan-west-pr RS: 200 Profile: PF 1


E.G. Elev (ft)	6922.35	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.06	Wt. n-Val.	0.100	0.100	
W.S. Elev (ft)	6922.29	Reach Len. (ft)	109.50	100.00	110.20
Crit W.S. (ft)	6921.40	Flow Area (sq ft)	21.86	99.62	
E.G. Slope (ft/ft)	0.012718	Area (sq ft)	21.86	99.62	
Q Total (cfs)	222.00	Flow (cfs)	23.40	198.60	
Top Width (ft)	119.30	Top Width (ft)	42.68	76.62	
Vel Total (ft/s)	1.83	Avg. Vel. (ft/s)	1.07	1.99	
Max Chl Dpth (ft)	2.31	Hydr. Depth (ft)	0.51	1.30	
Conv. Total (cfs)	1968.5	Conv. (cfs)	207.5	1761.0	
Length Wtd. (ft)	100.50	Wetted Per. (ft)	42.80	76.78	
Min Ch El (ft)	6919.98	Shear (lb/sq ft)	0.41	1.03	
Alpha	1.10	Stream Power (lb/ft s)	0.43	2.05	
Frctn Loss (ft)	3.12	Cum Volume (acre-ft)	0.03	0.17	
C & E Loss (ft)	0.03	Cum SA (acres)	0.05	0.16	


Plan: Plan p02 WEST PR chan-west-pr RS: 100 Profile: PF 1


E.G. Elev (ft)	6919.21	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.37	Wt. n-Val.		0.100	
W.S. Elev (ft)	6918.84	Reach Len. (ft)			
Crit W.S. (ft)	6918.84	Flow Area (sq ft)		45.46	
E.G. Slope (ft/ft)	0.162131	Area (sq ft)		45.46	
Q Total (cfs)	222.00	Flow (cfs)		222.00	
Top Width (ft)	61.54	Top Width (ft)		61.54	
Vel Total (ft/s)	4.88	Avg. Vel. (ft/s)		4.88	
Max Chl Dpth (ft)	0.83	Hydr. Depth (ft)		0.74	
Conv. Total (cfs)	551.3	Conv. (cfs)		551.3	
Length Wtd. (ft)		Wetted Per. (ft)		61.64	
Min Ch El (ft)	6918.00	Shear (lb/sq ft)		7.46	
Alpha	1.00	Stream Power (lb/ft s)		36.46	
Frctn Loss (ft)		Cum Volume (acre-ft)			
C & E Loss (ft)		Cum SA (acres)			

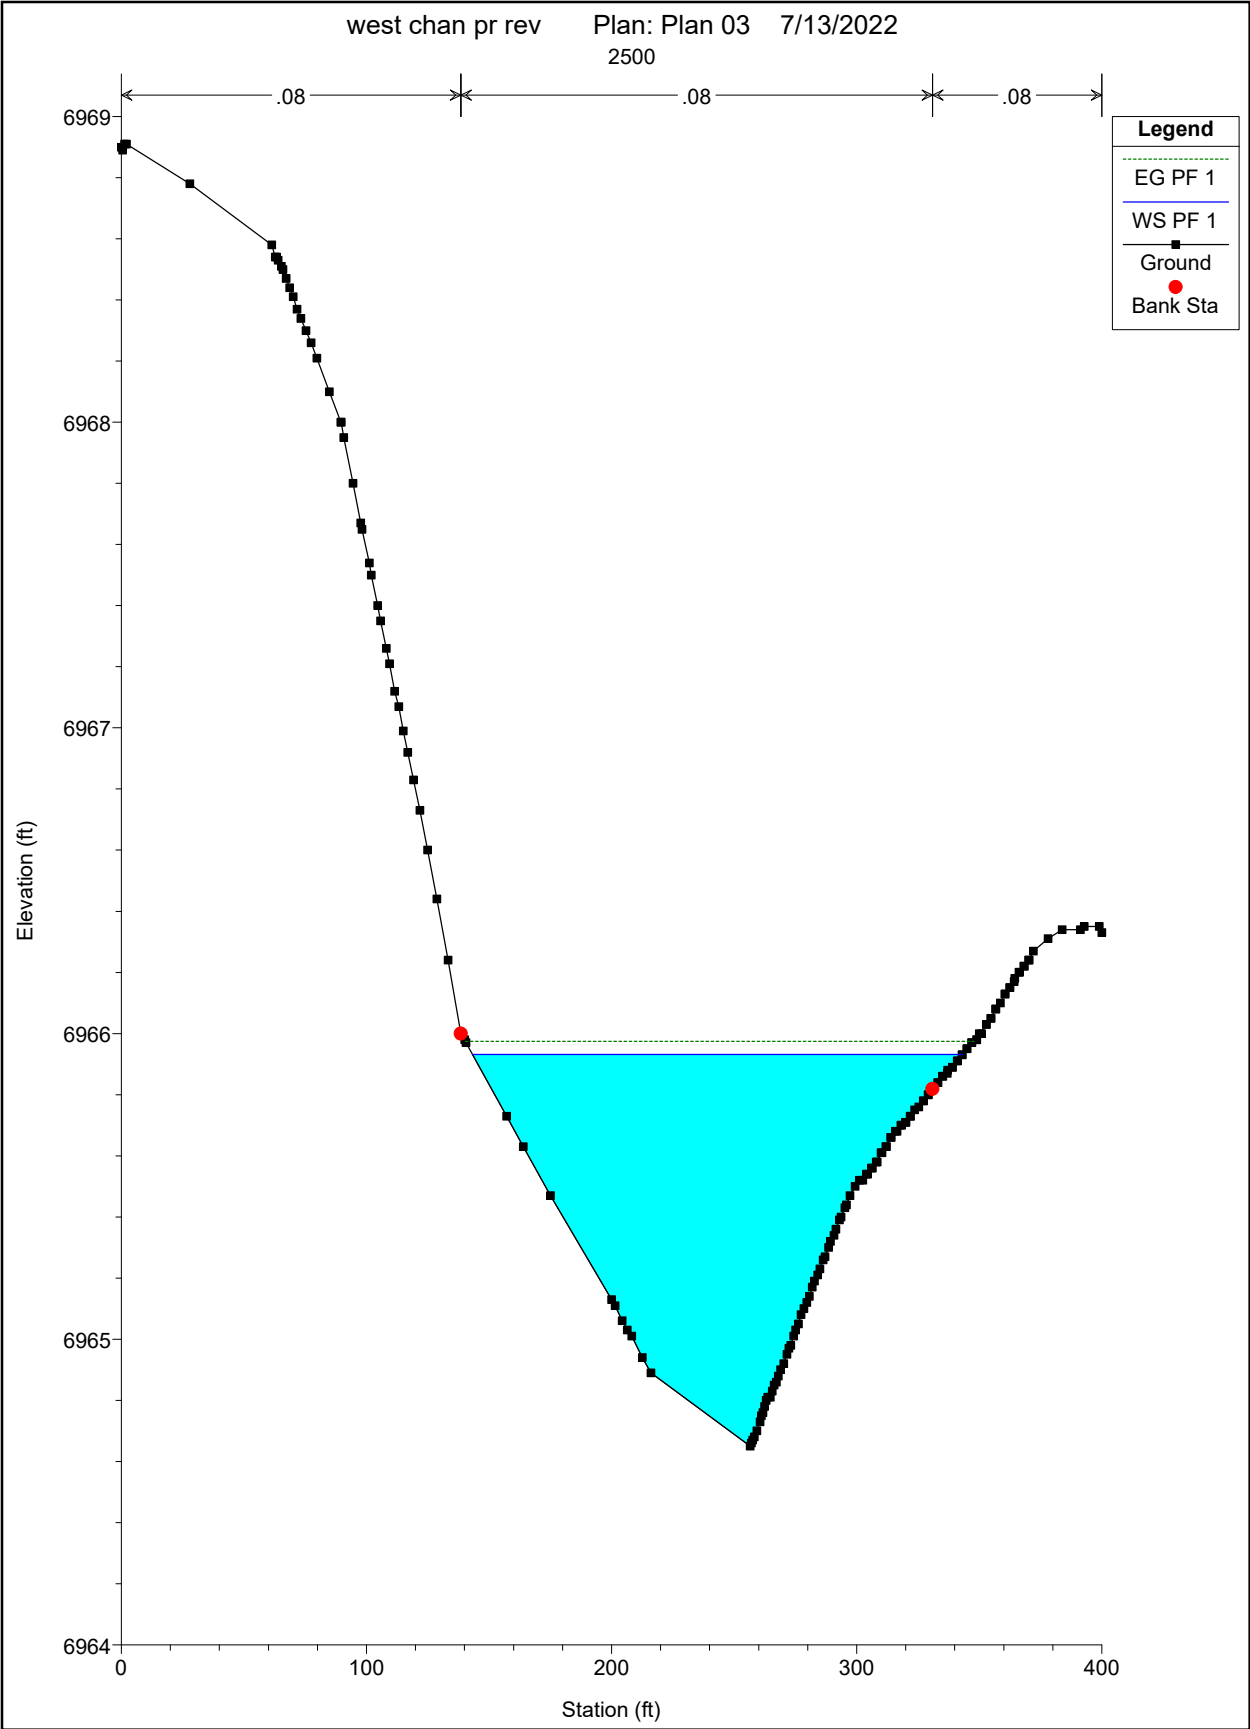


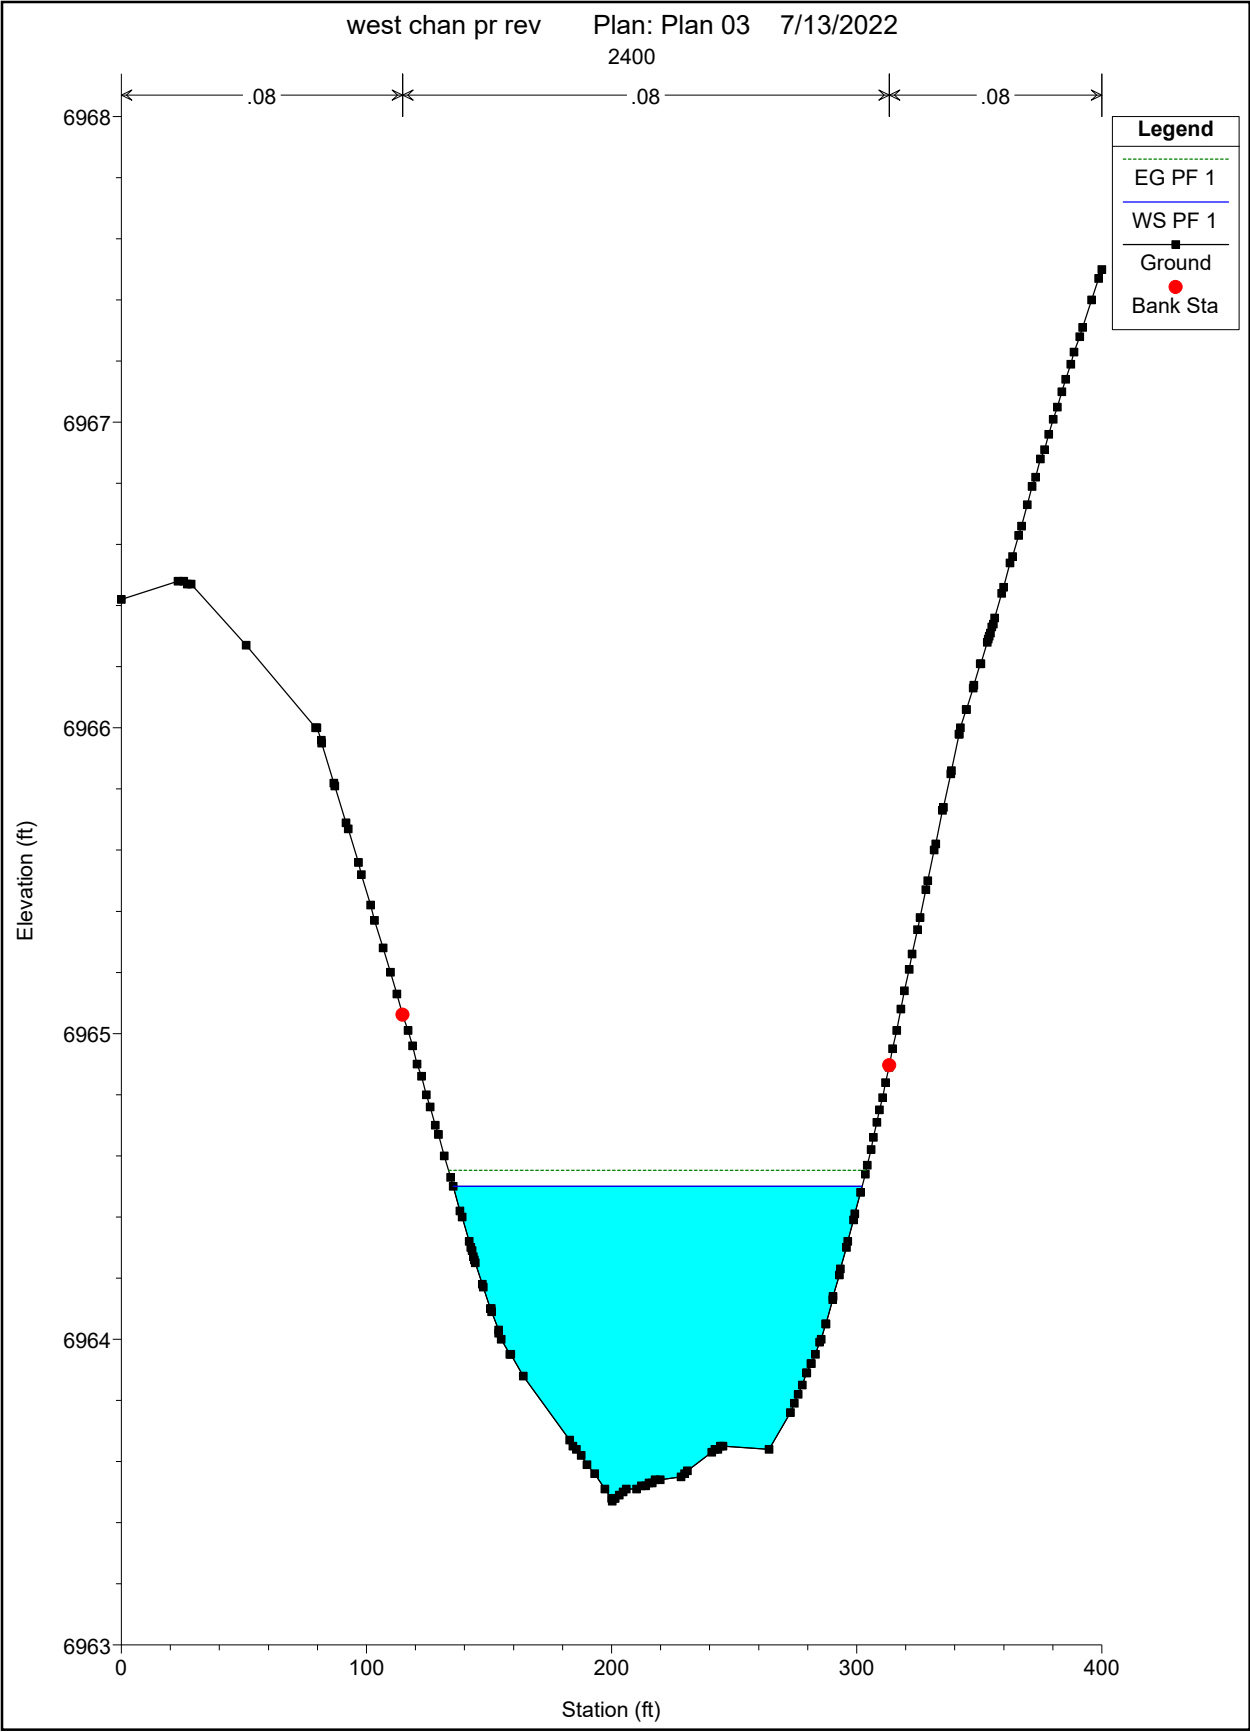


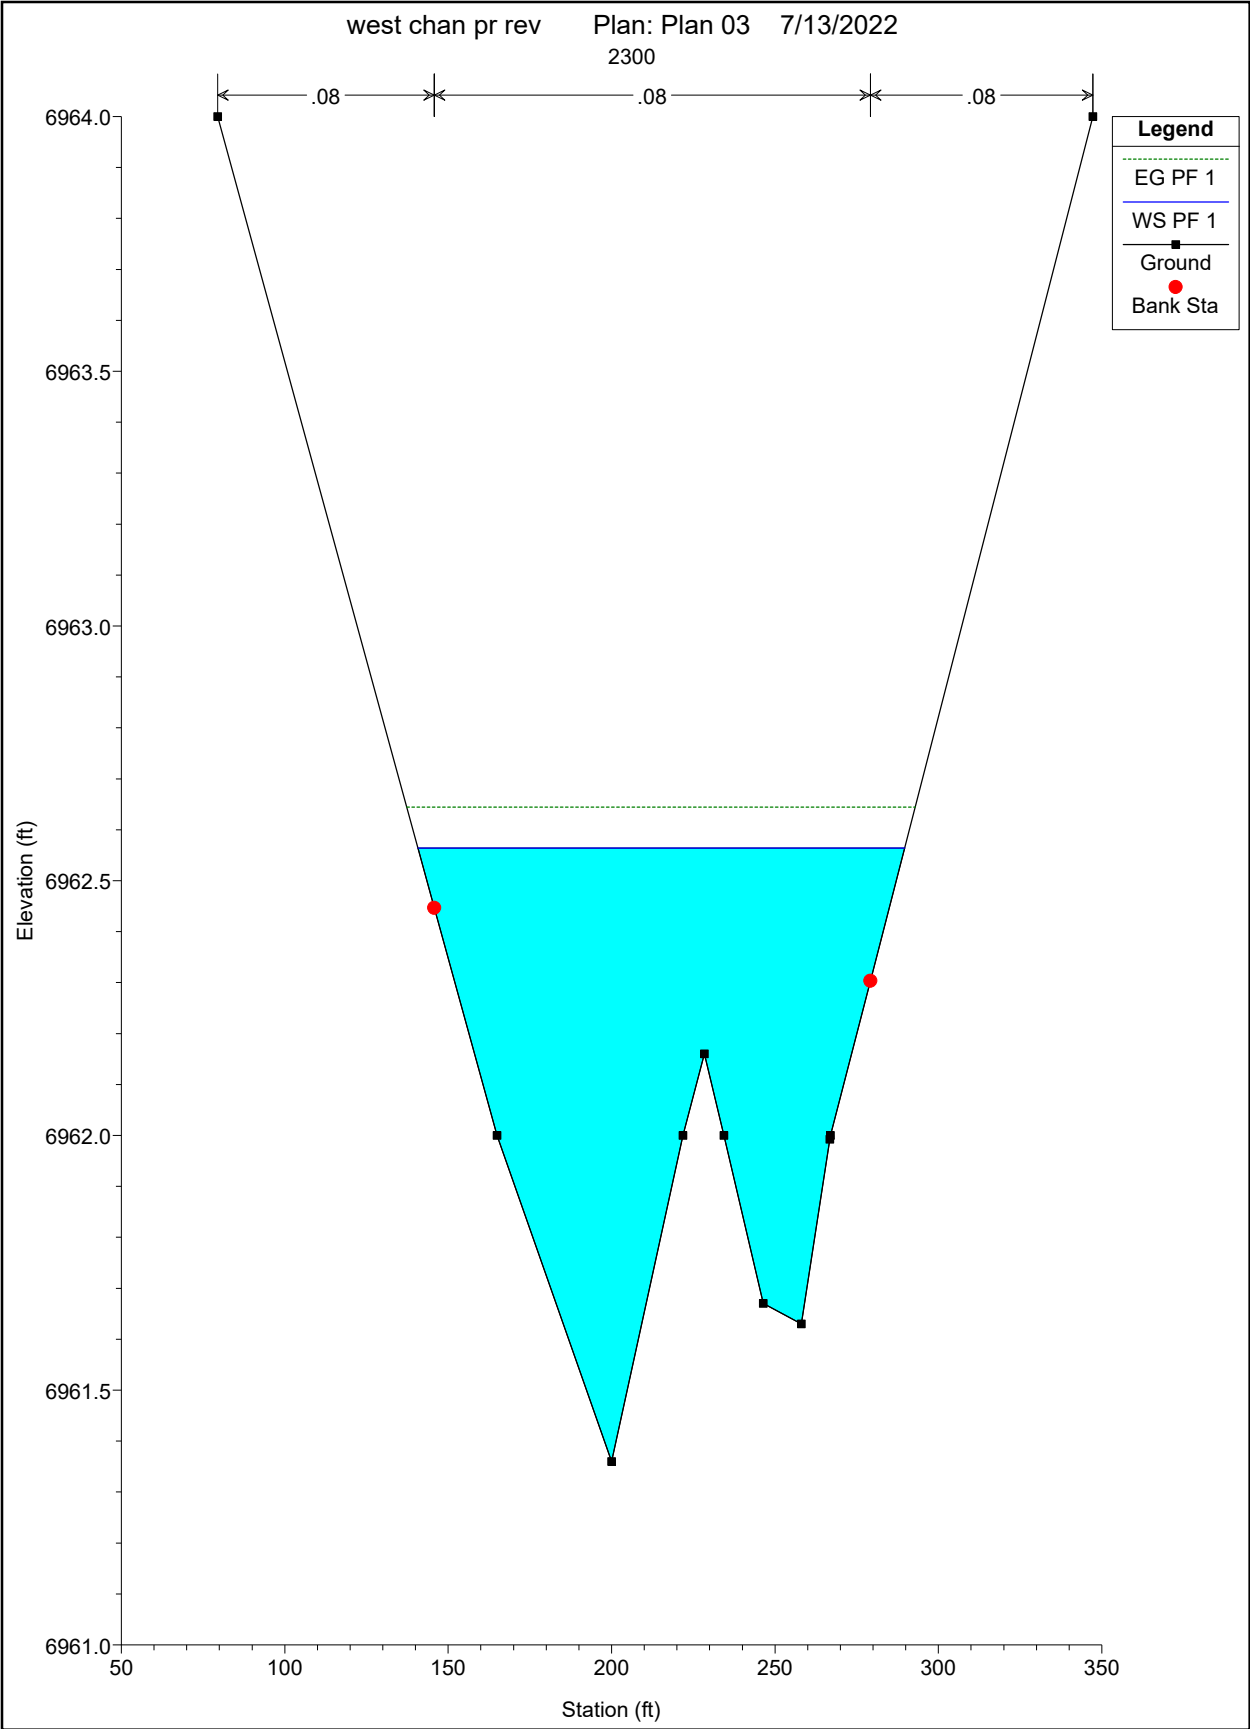


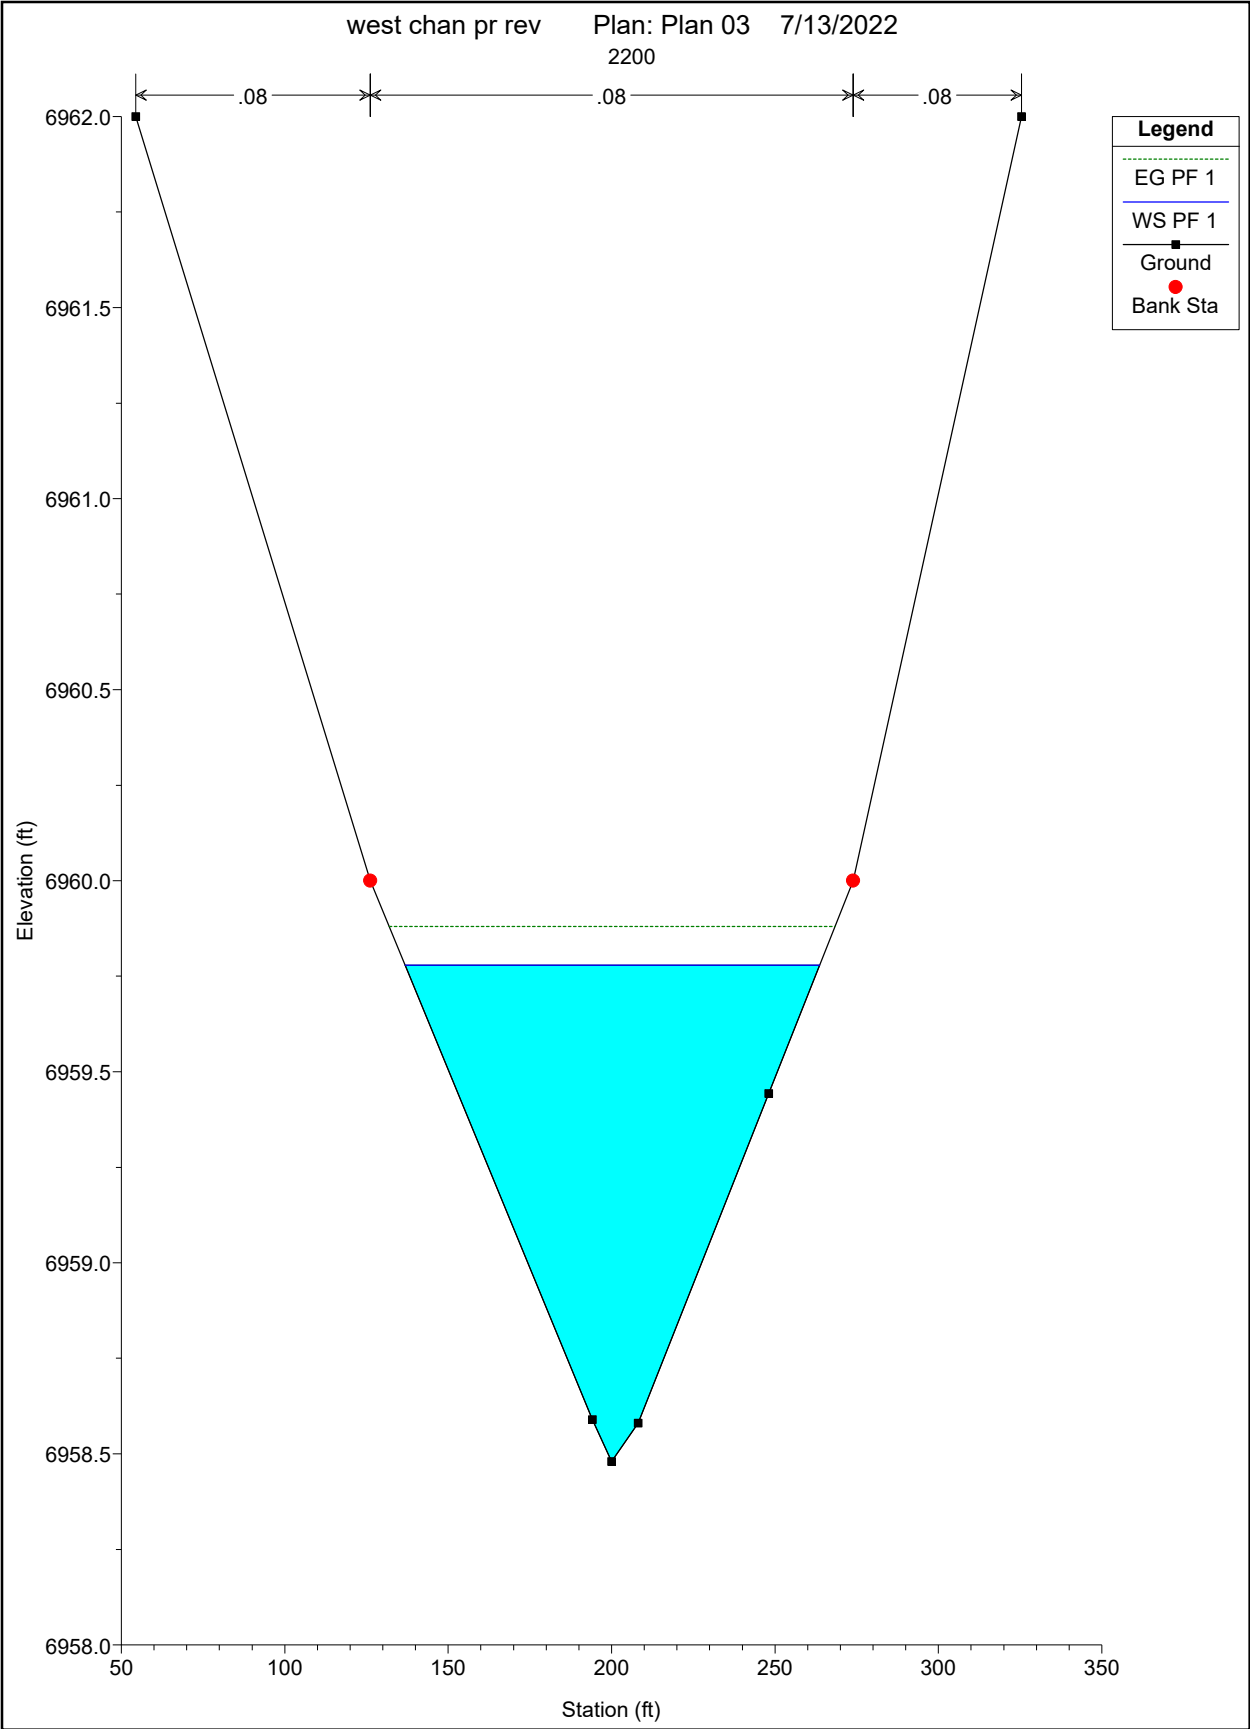


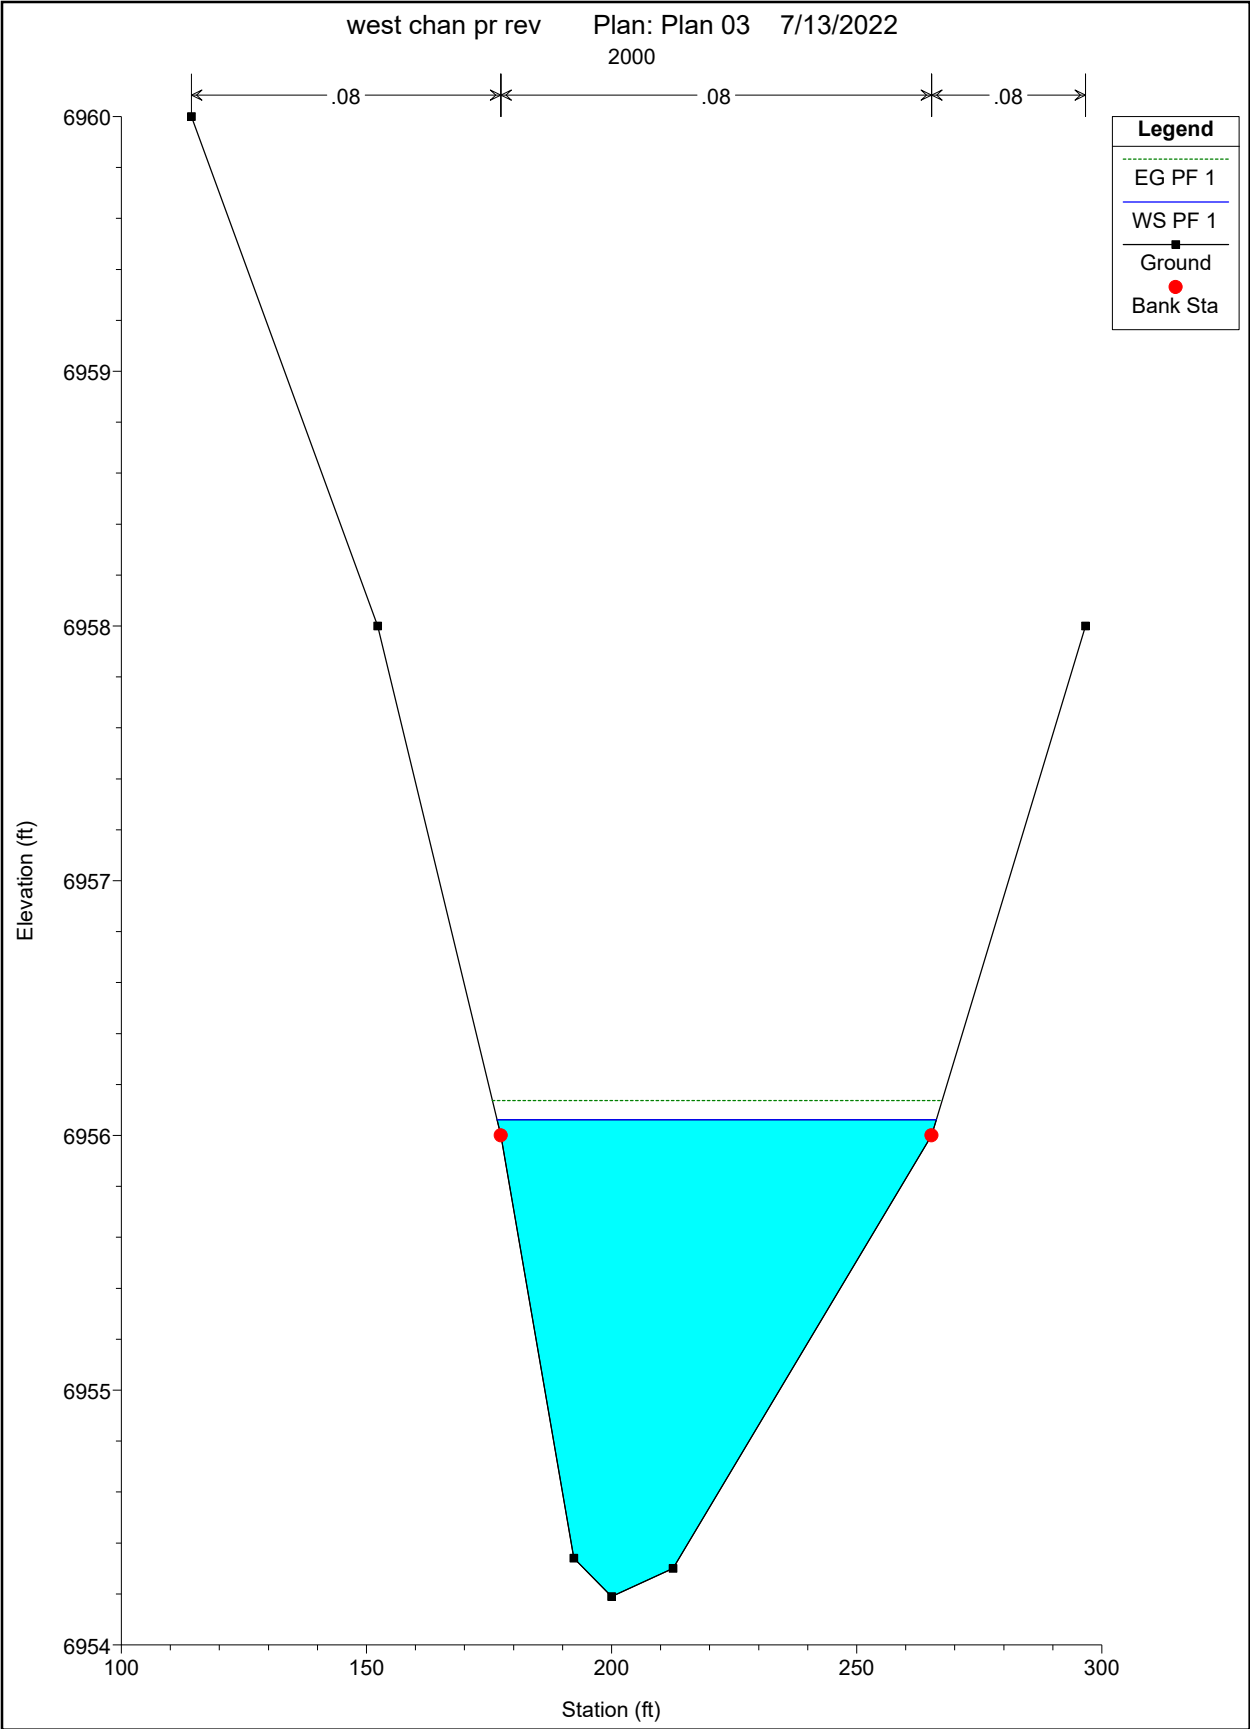


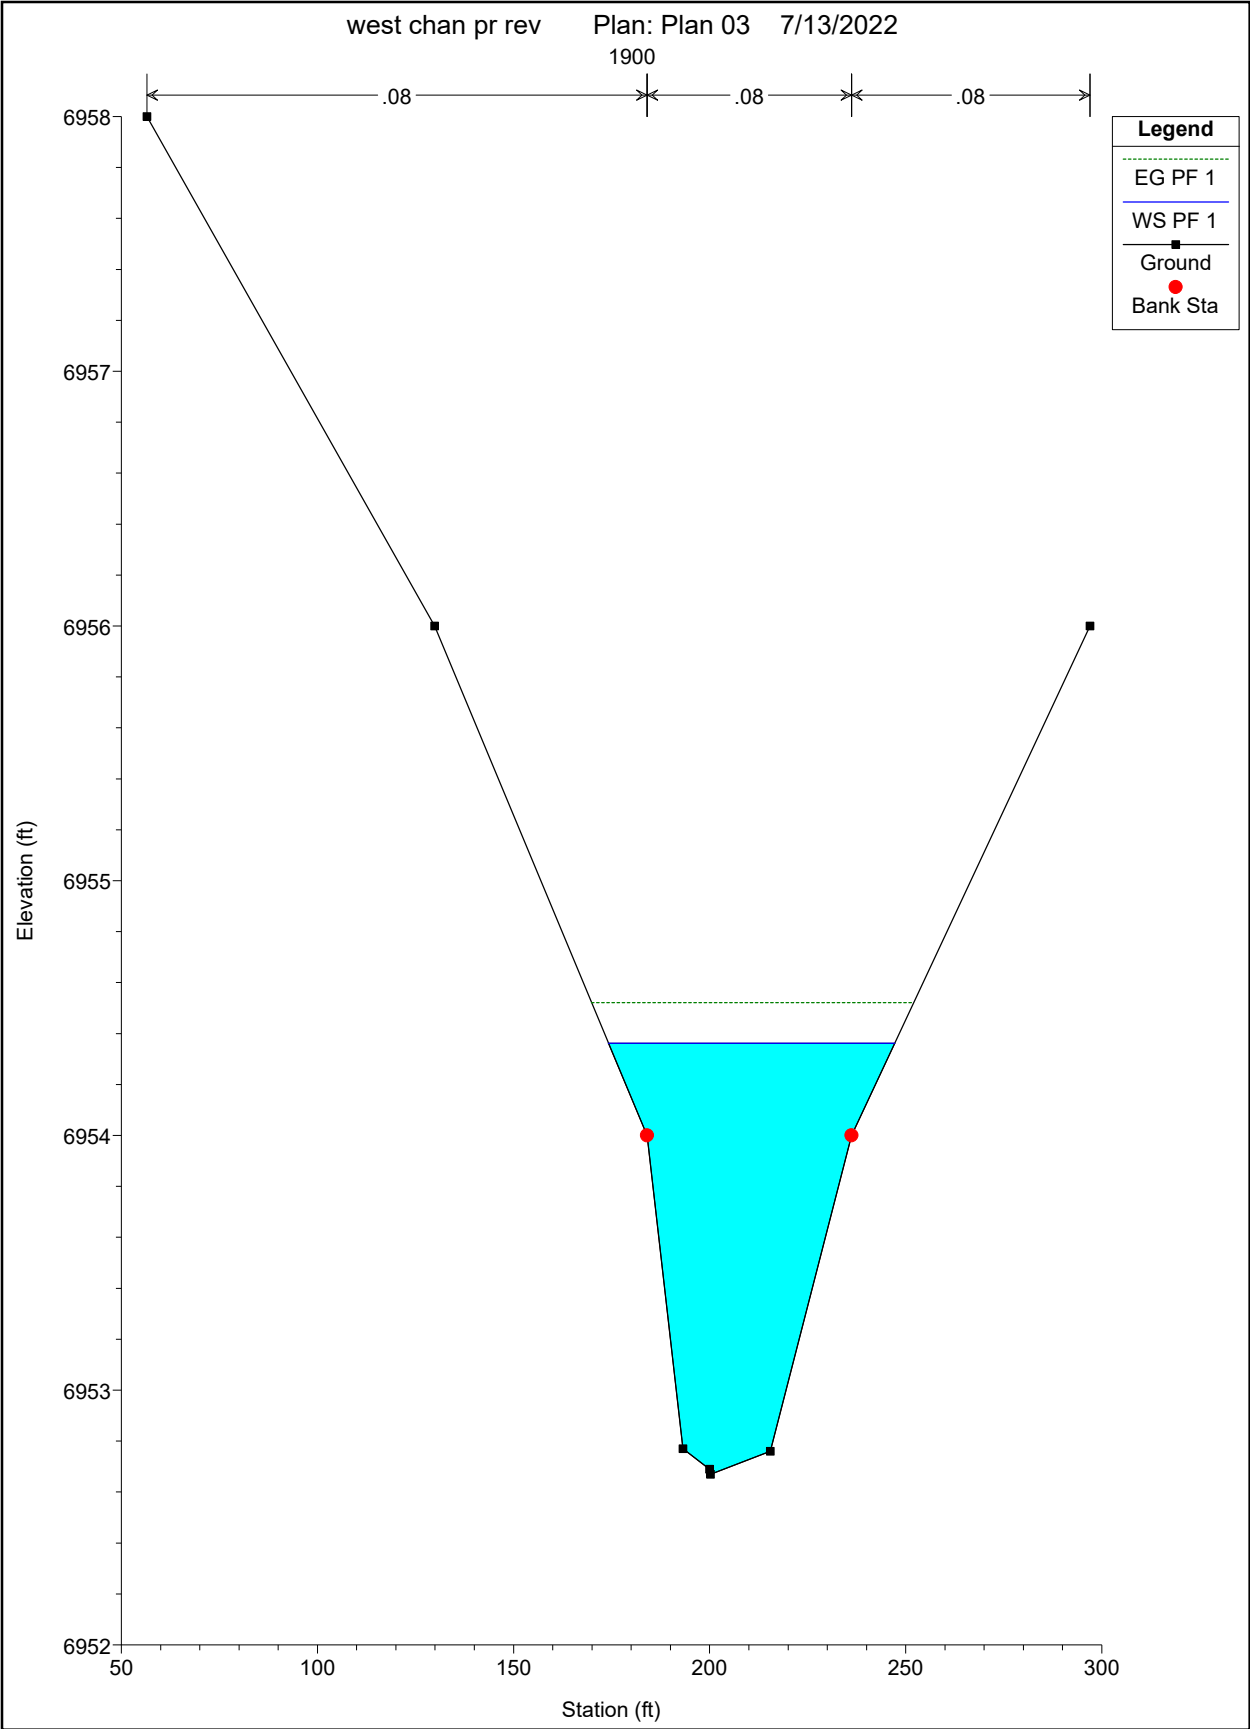


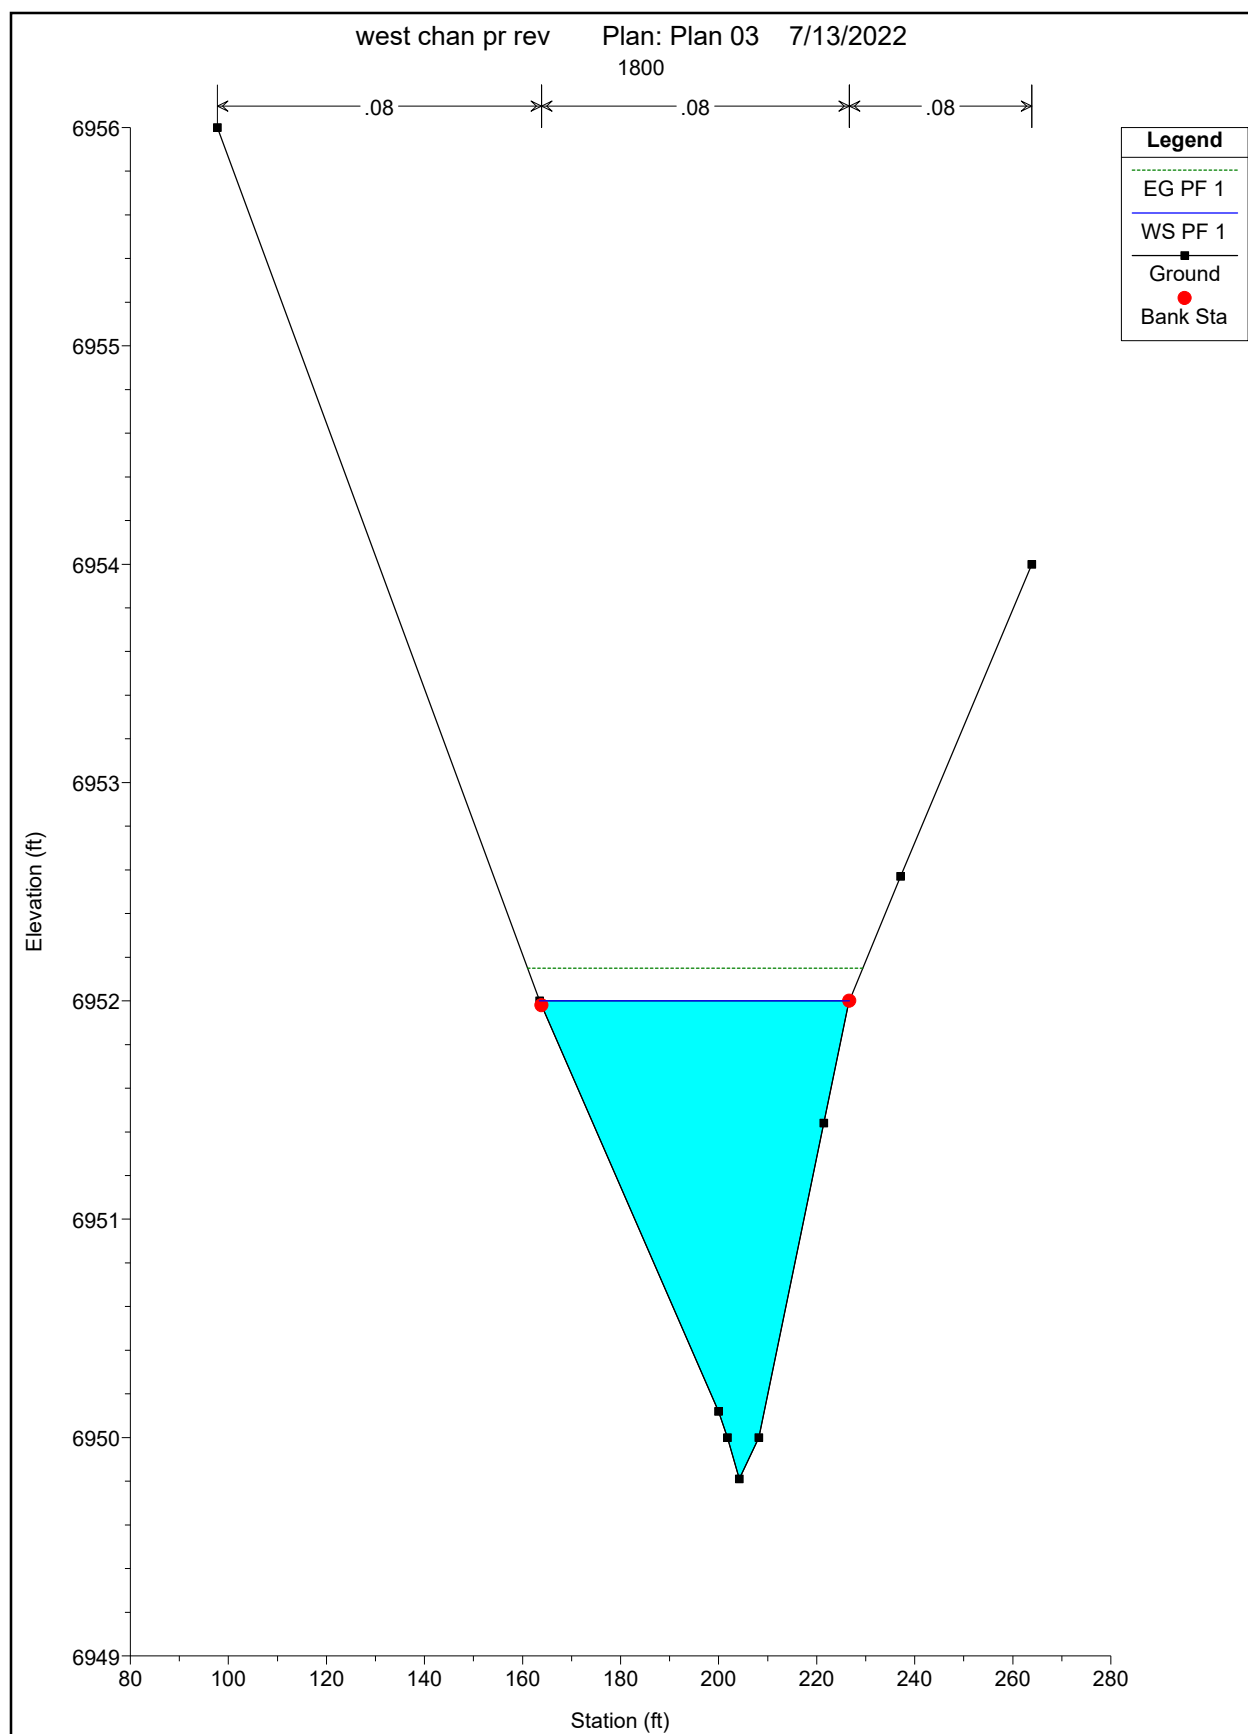


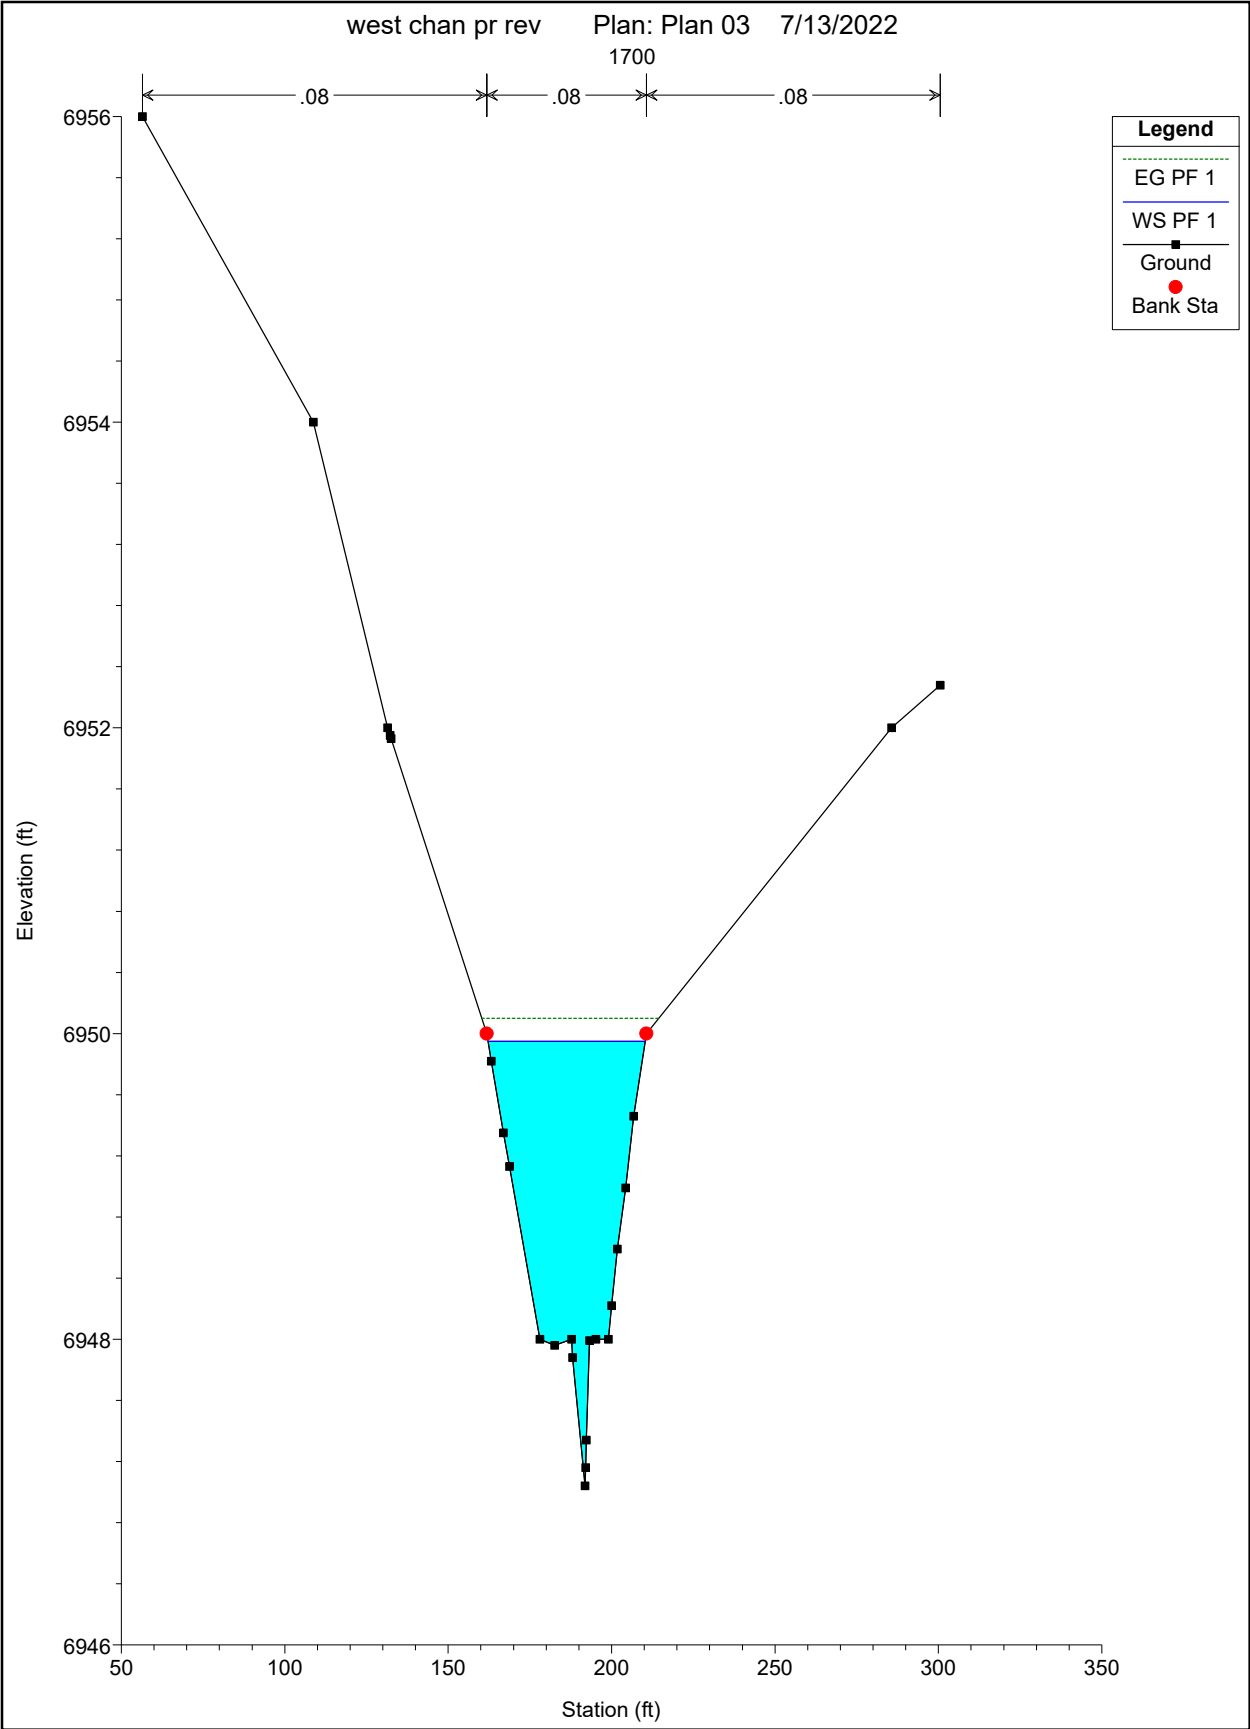


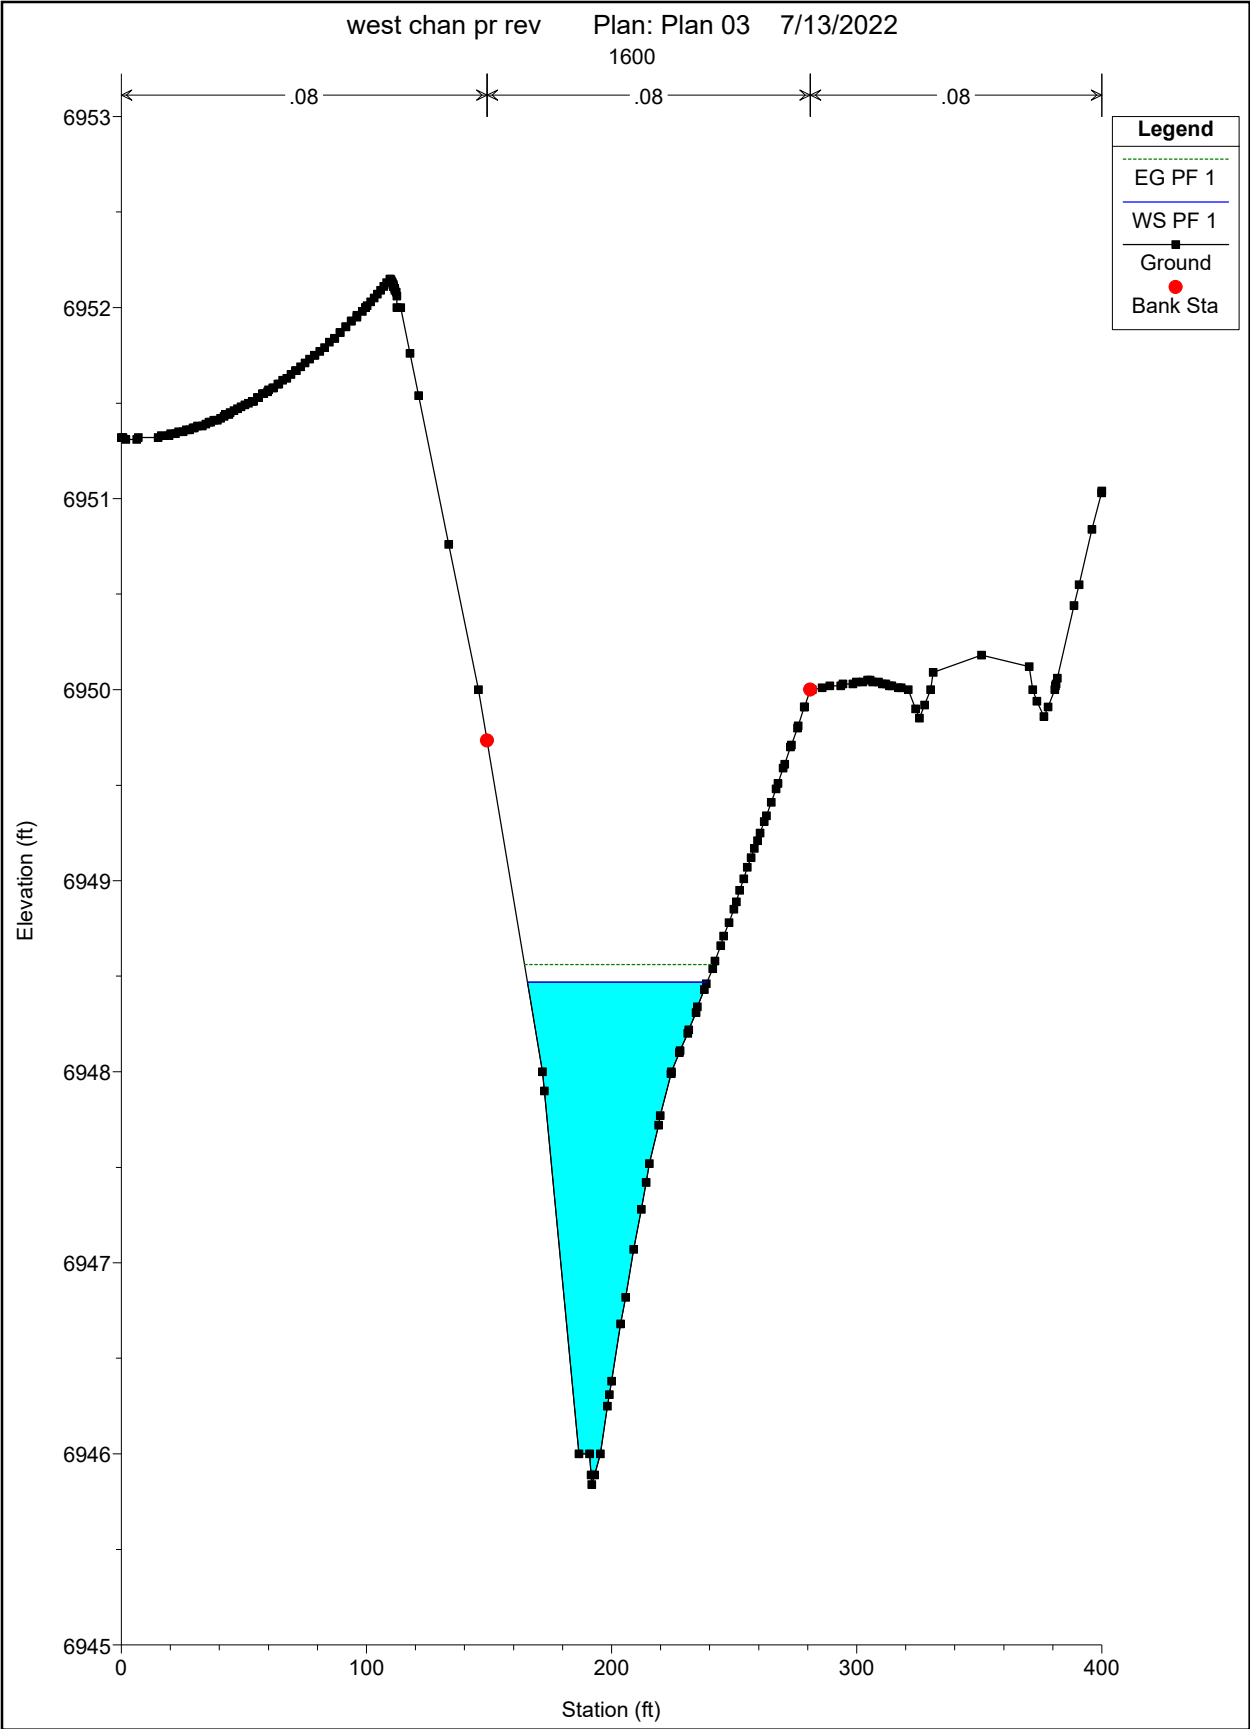

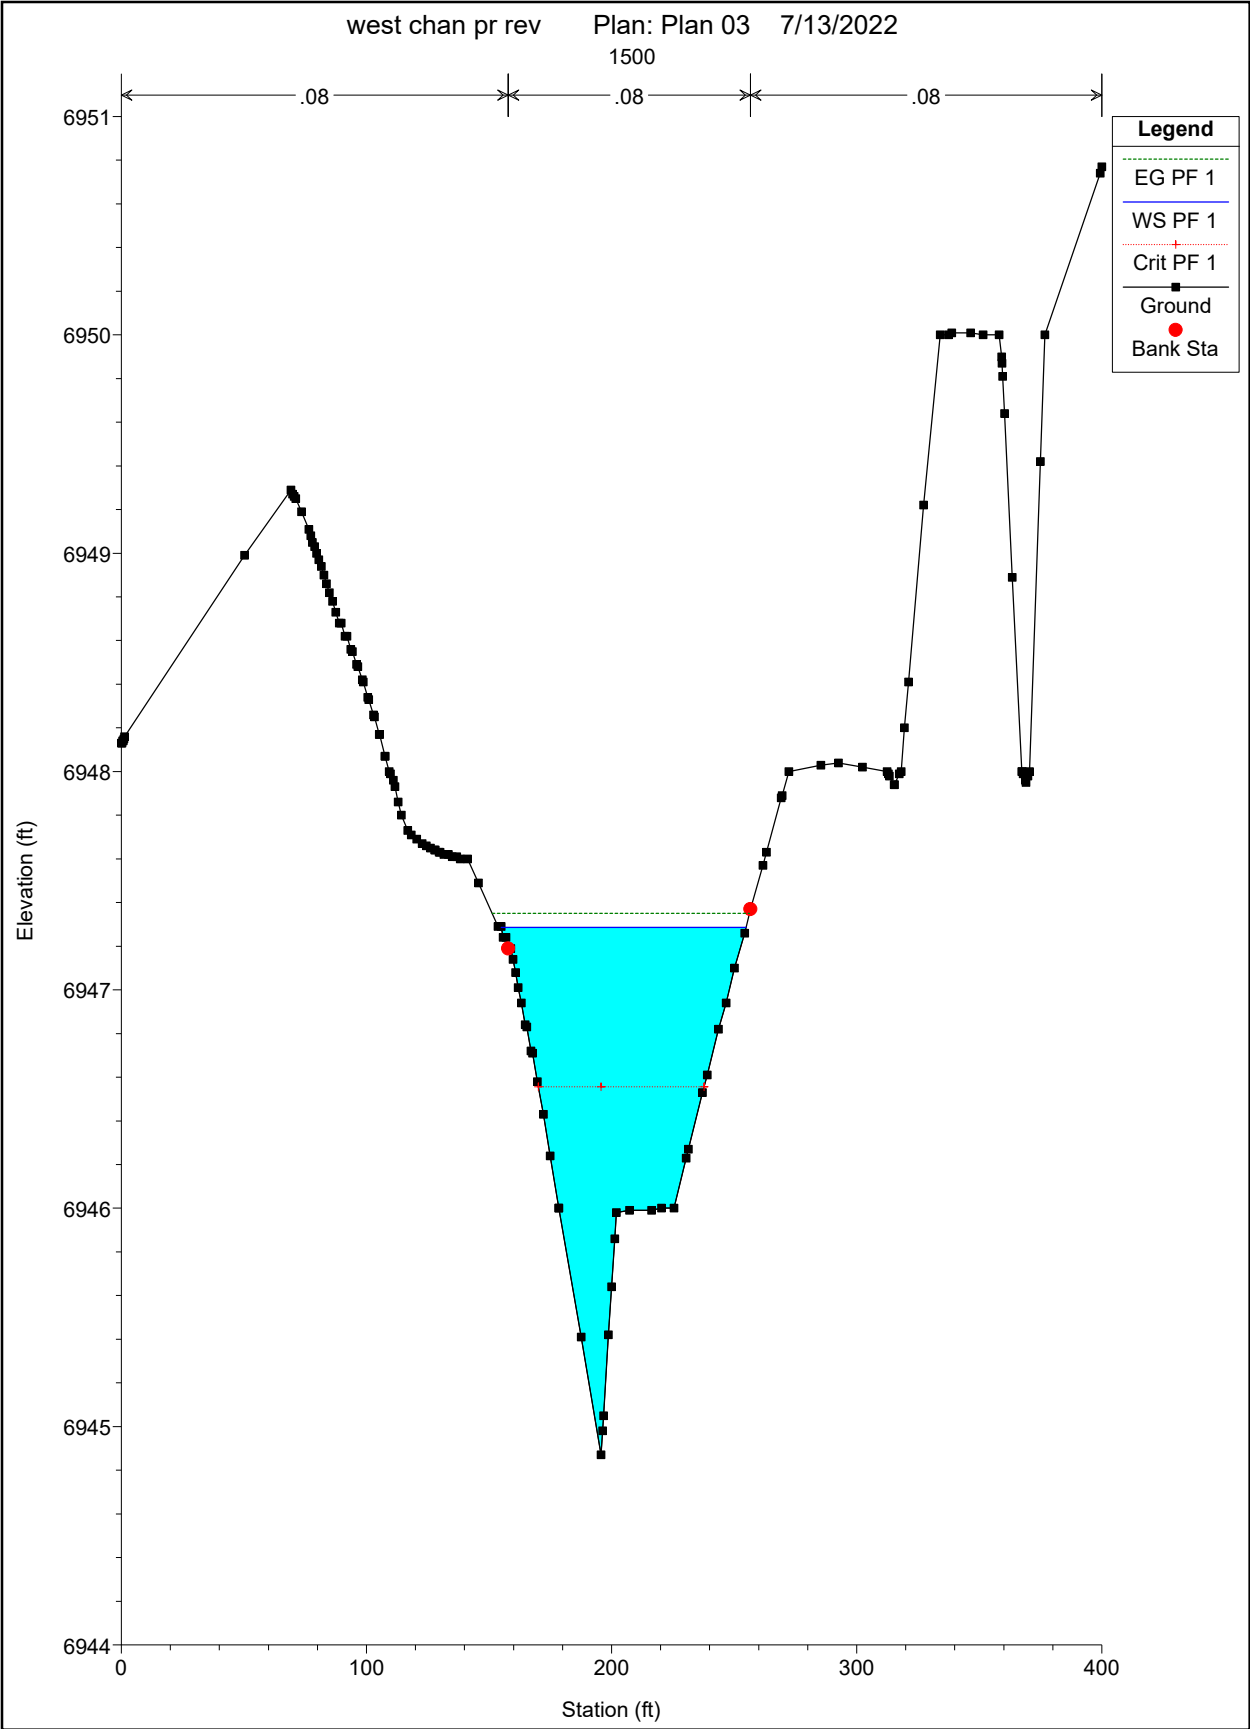

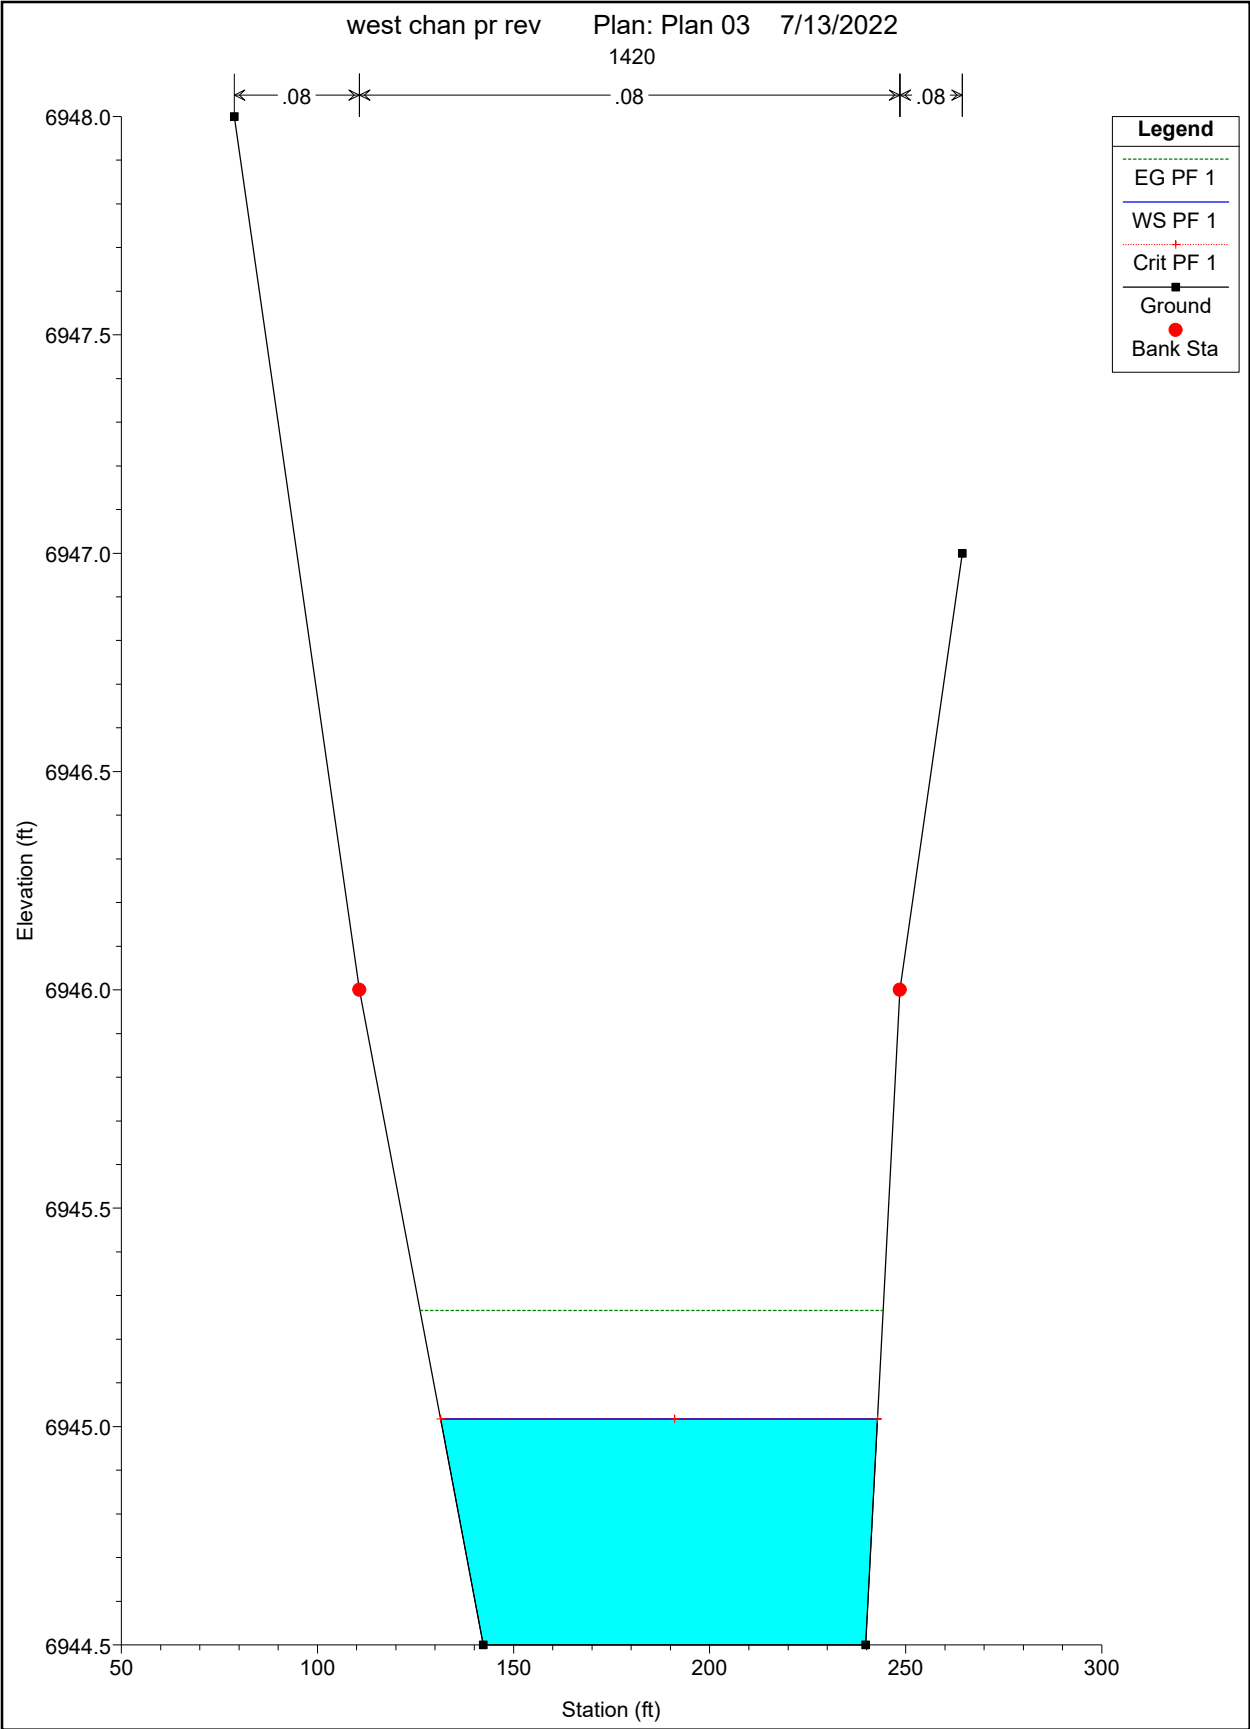

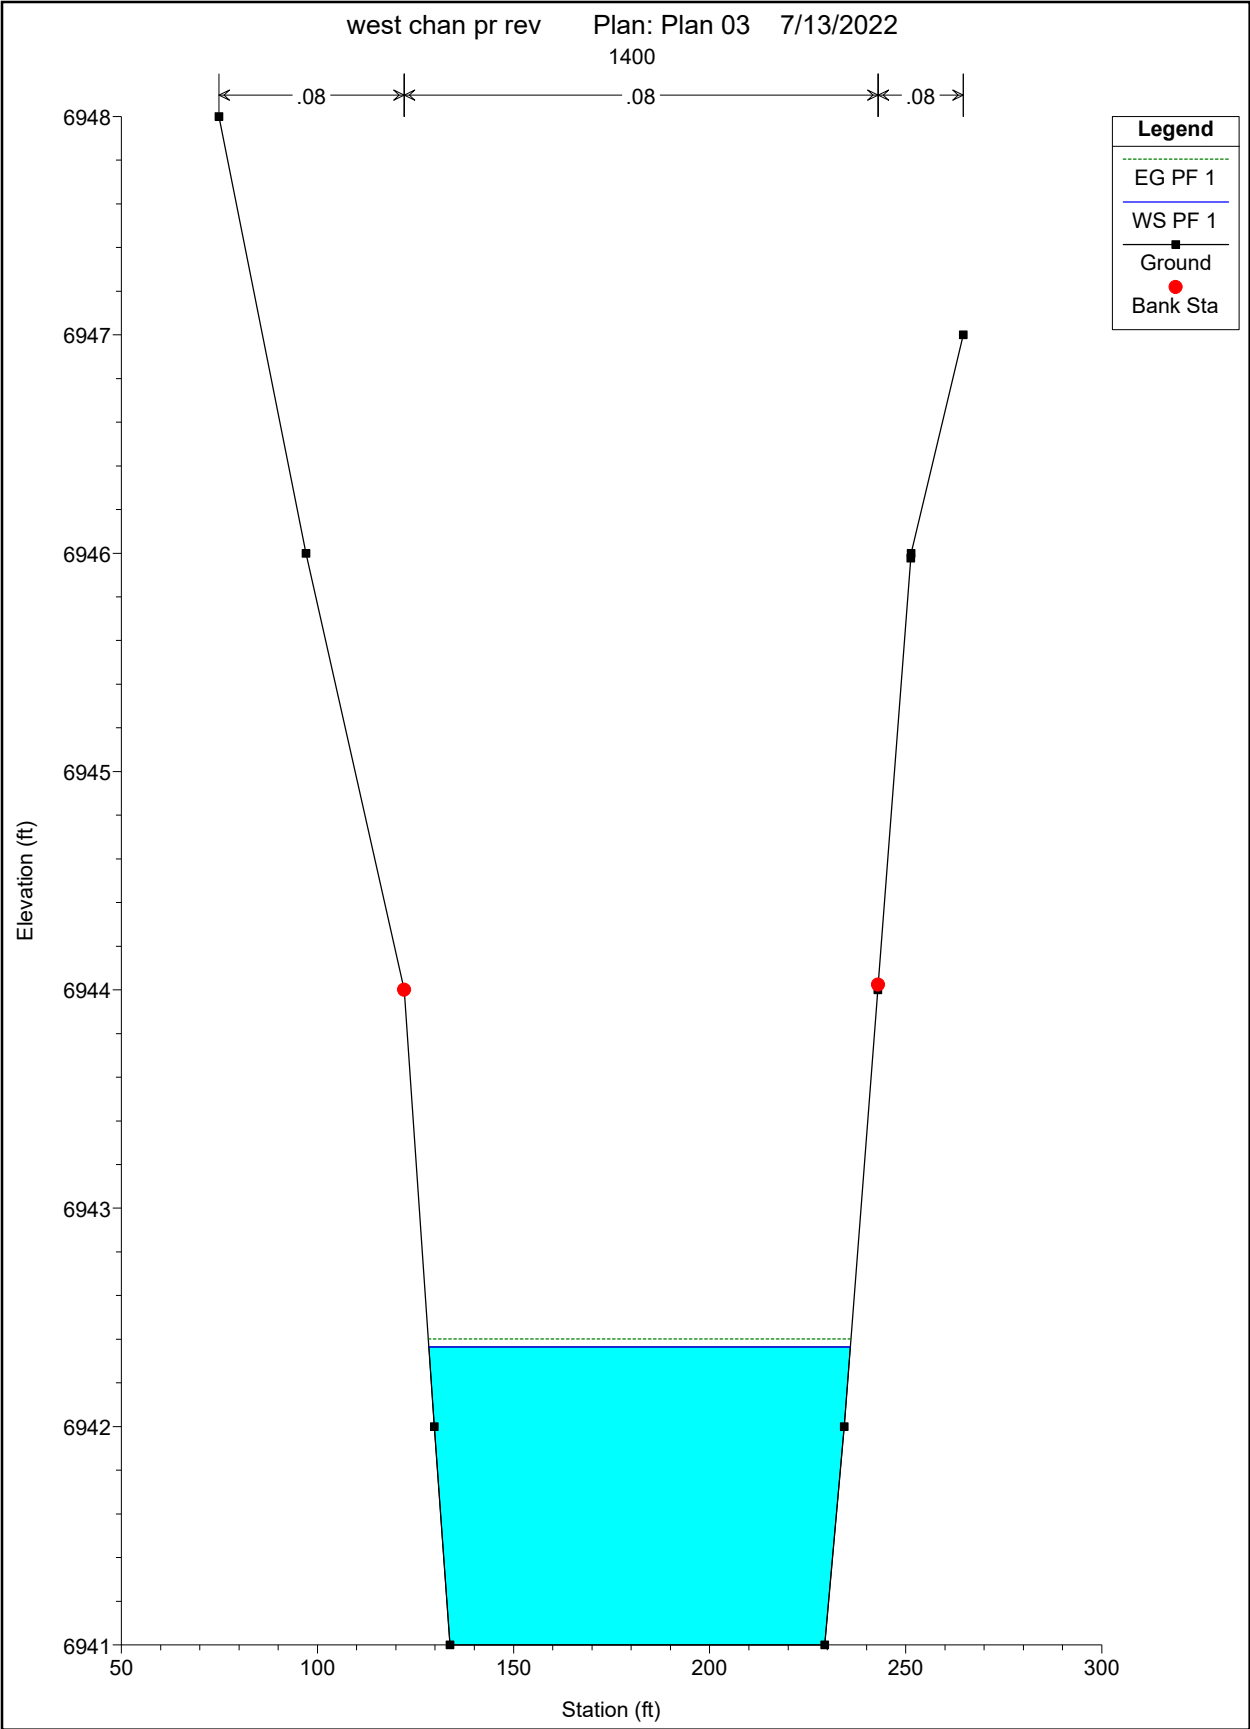


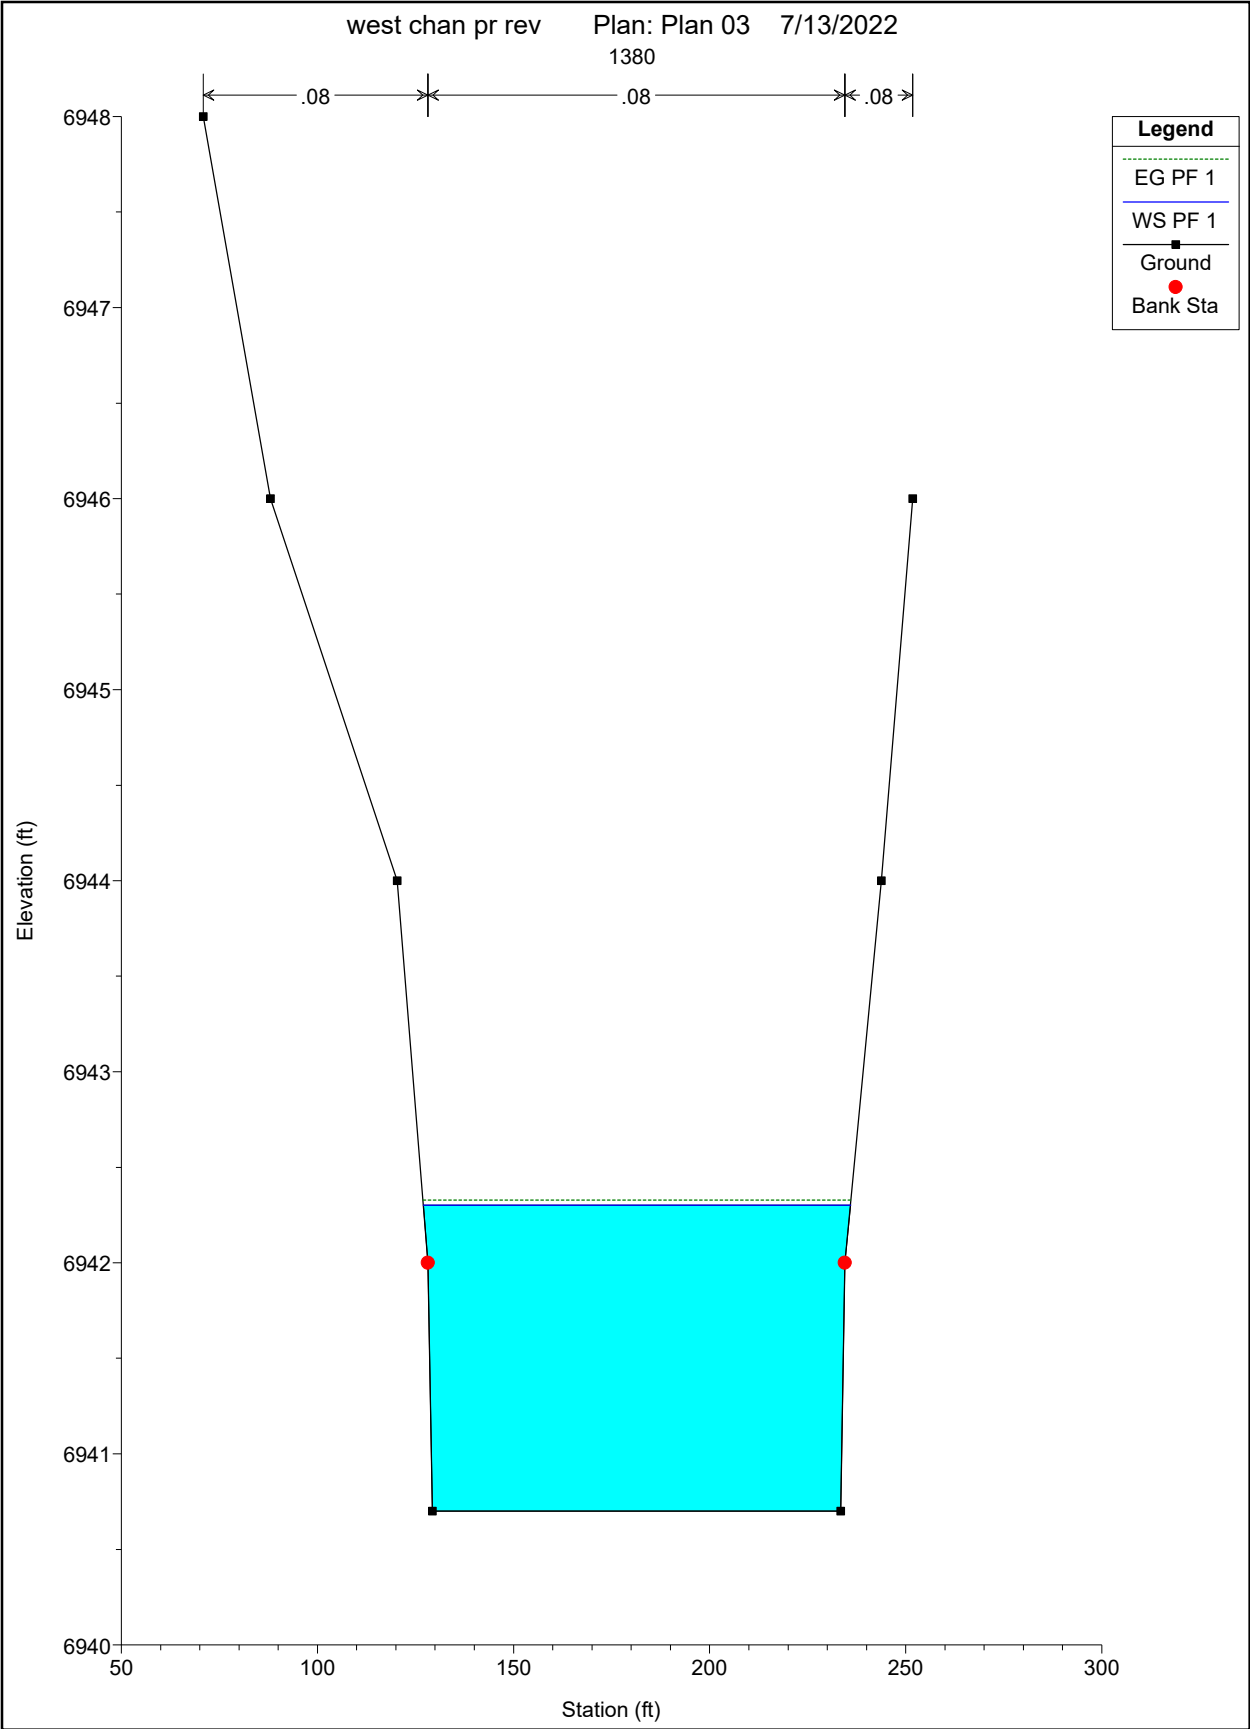



west chan pr rev


Plan: Plan 03 7/13/2022


1300

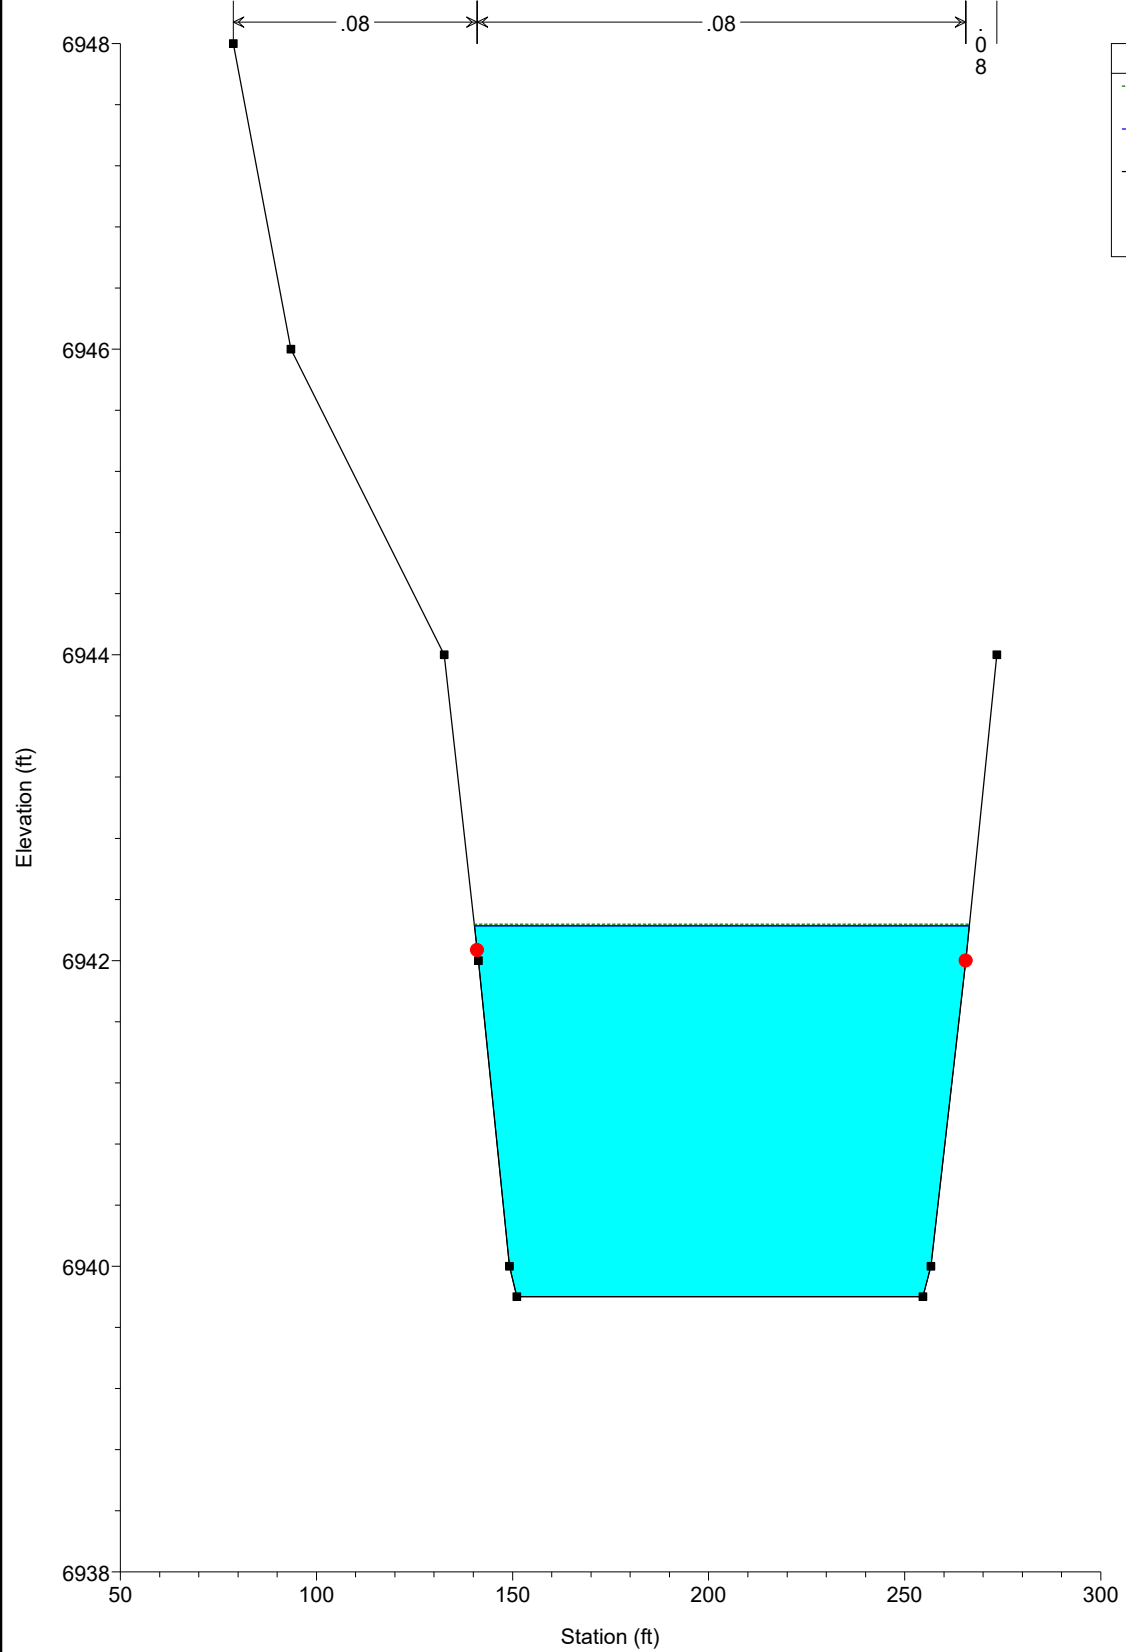

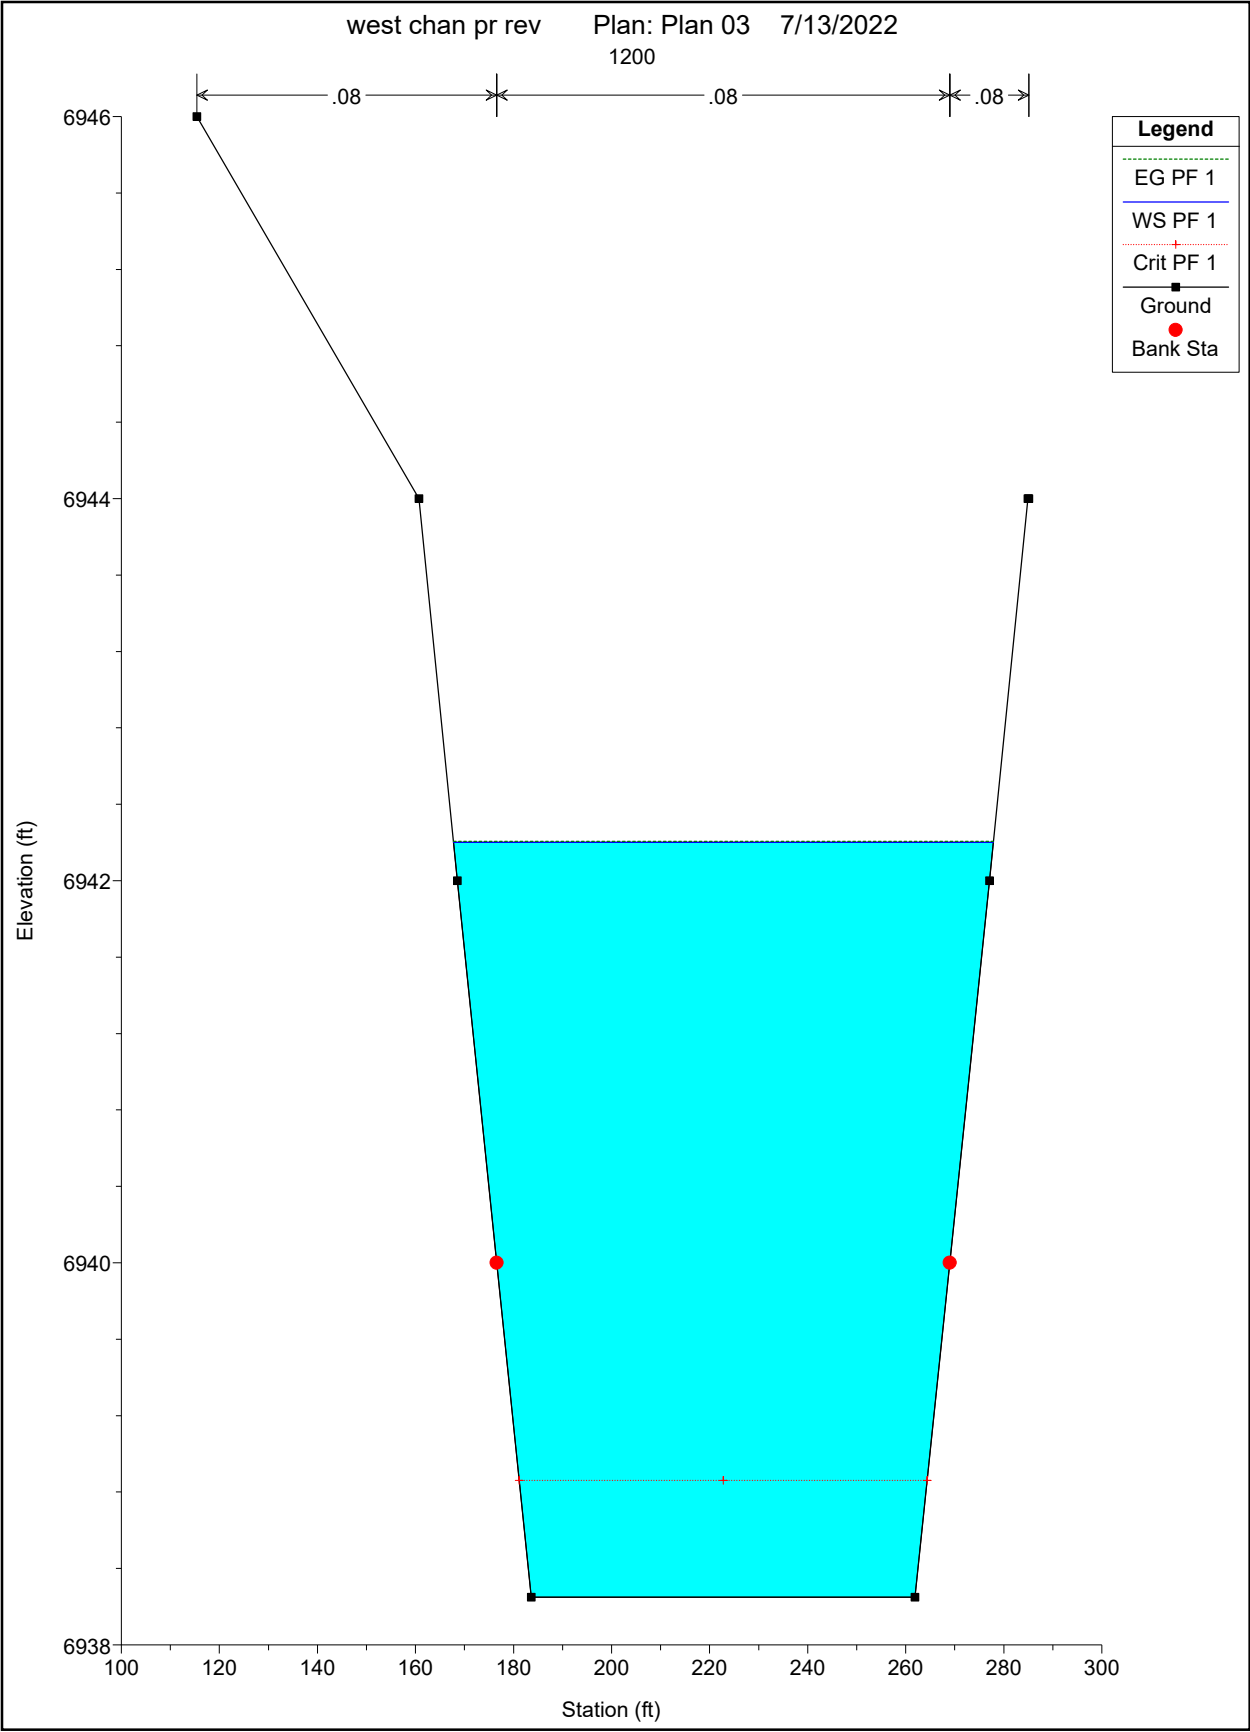


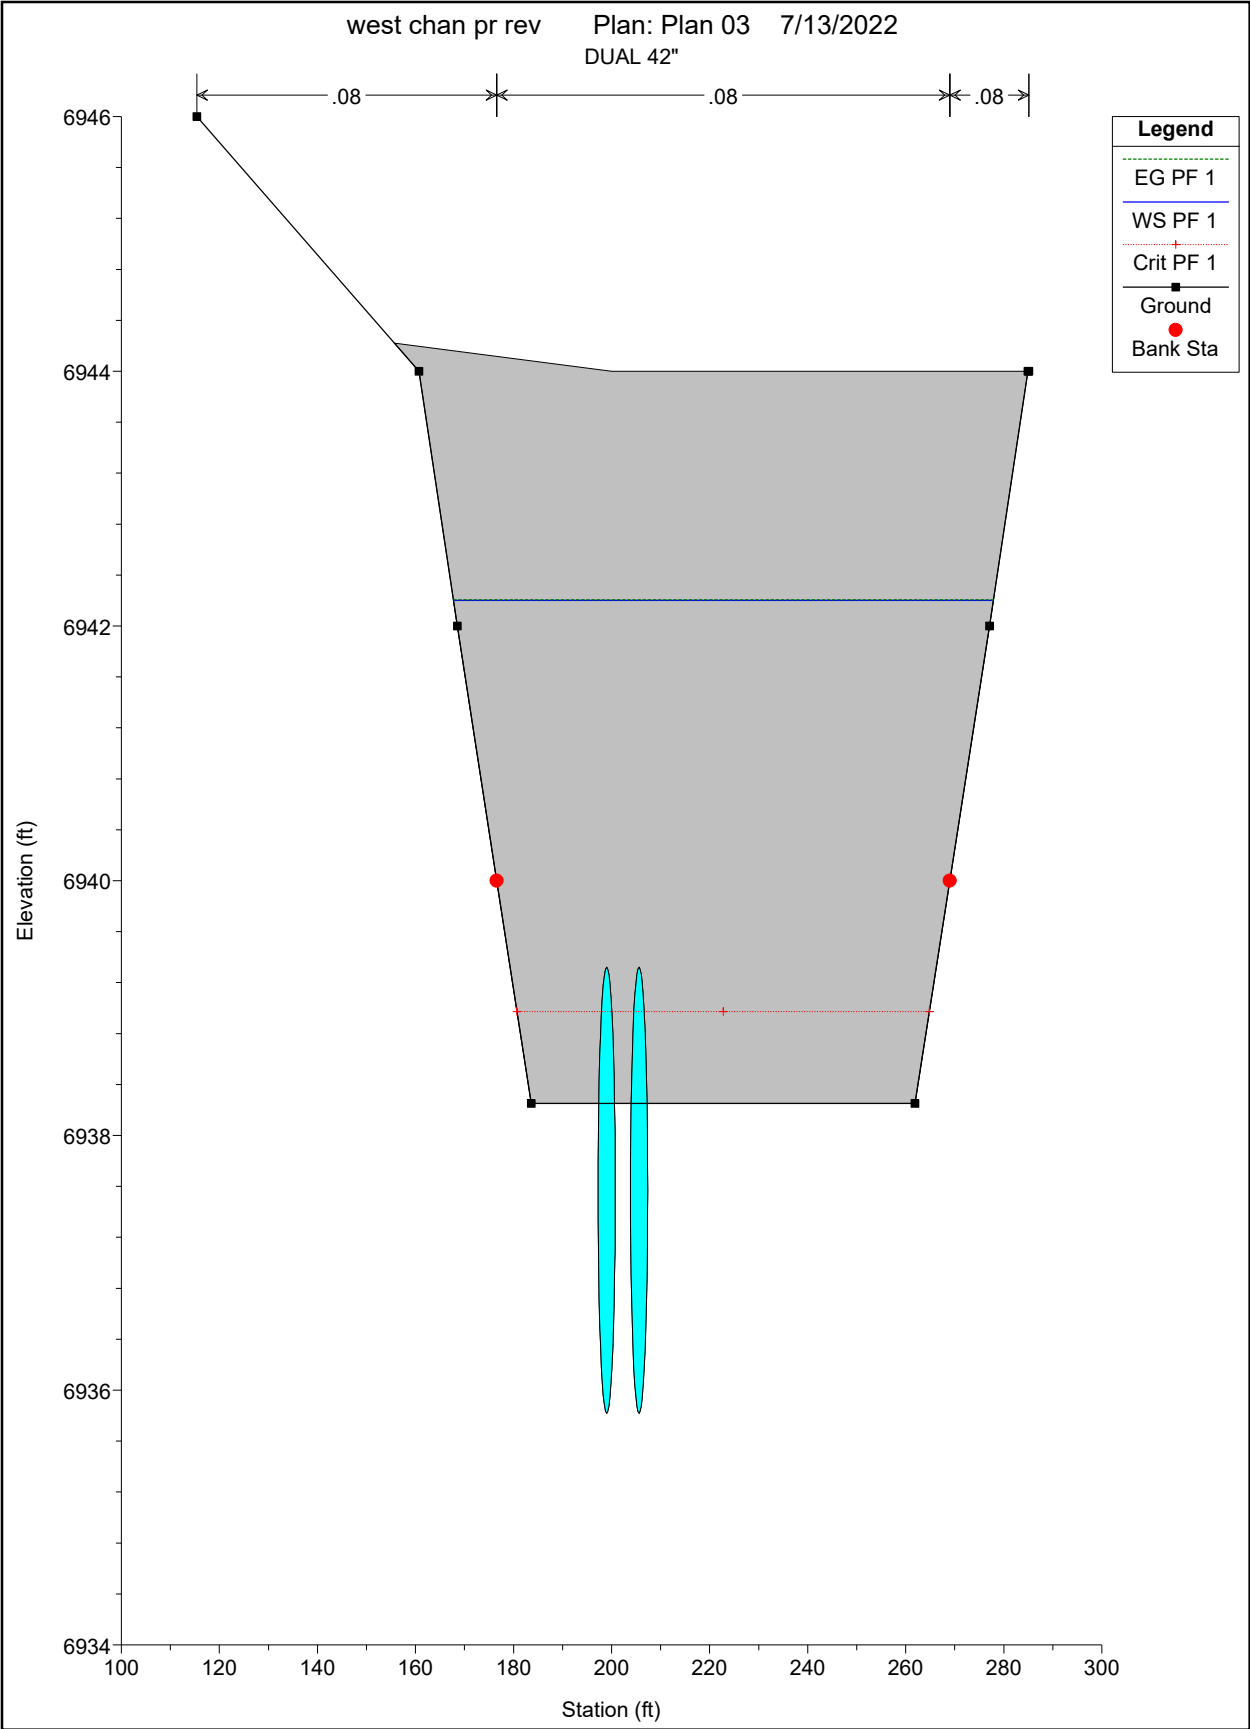

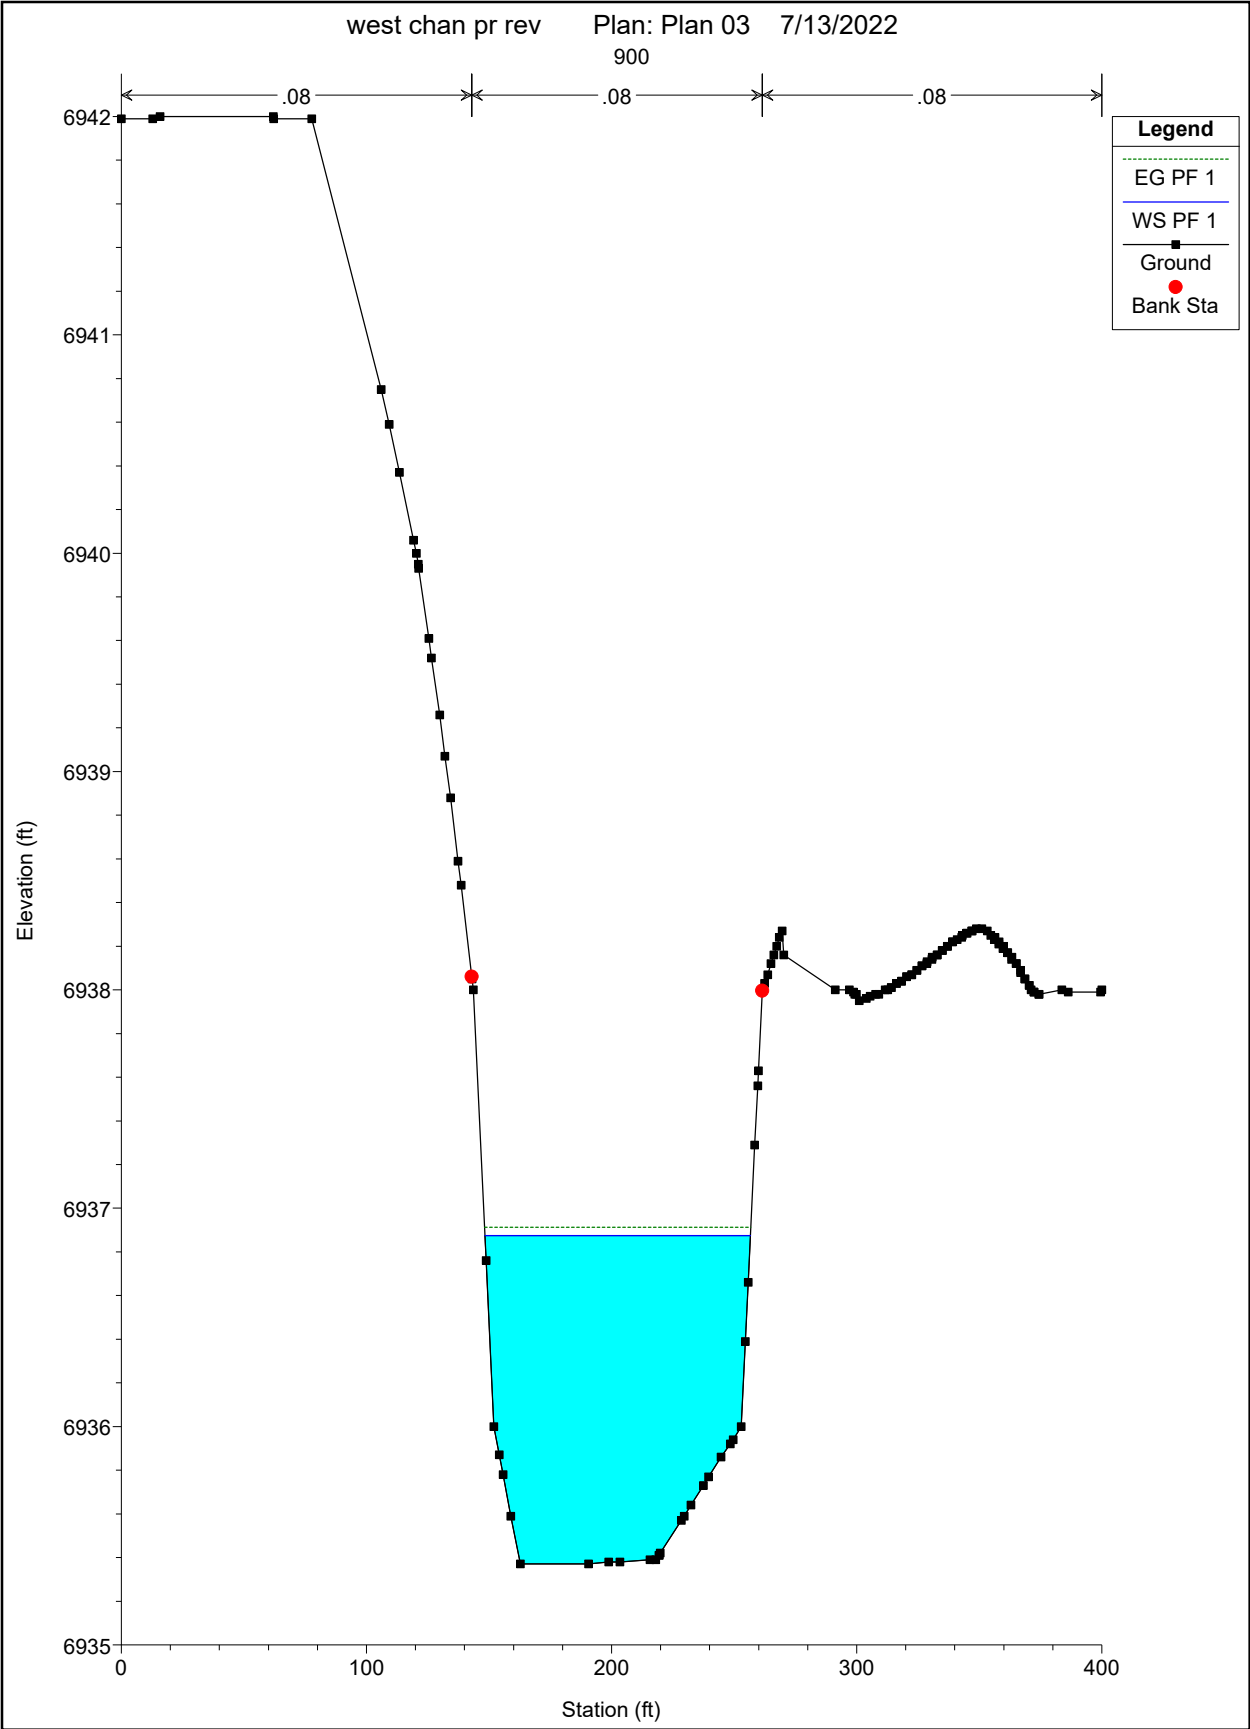


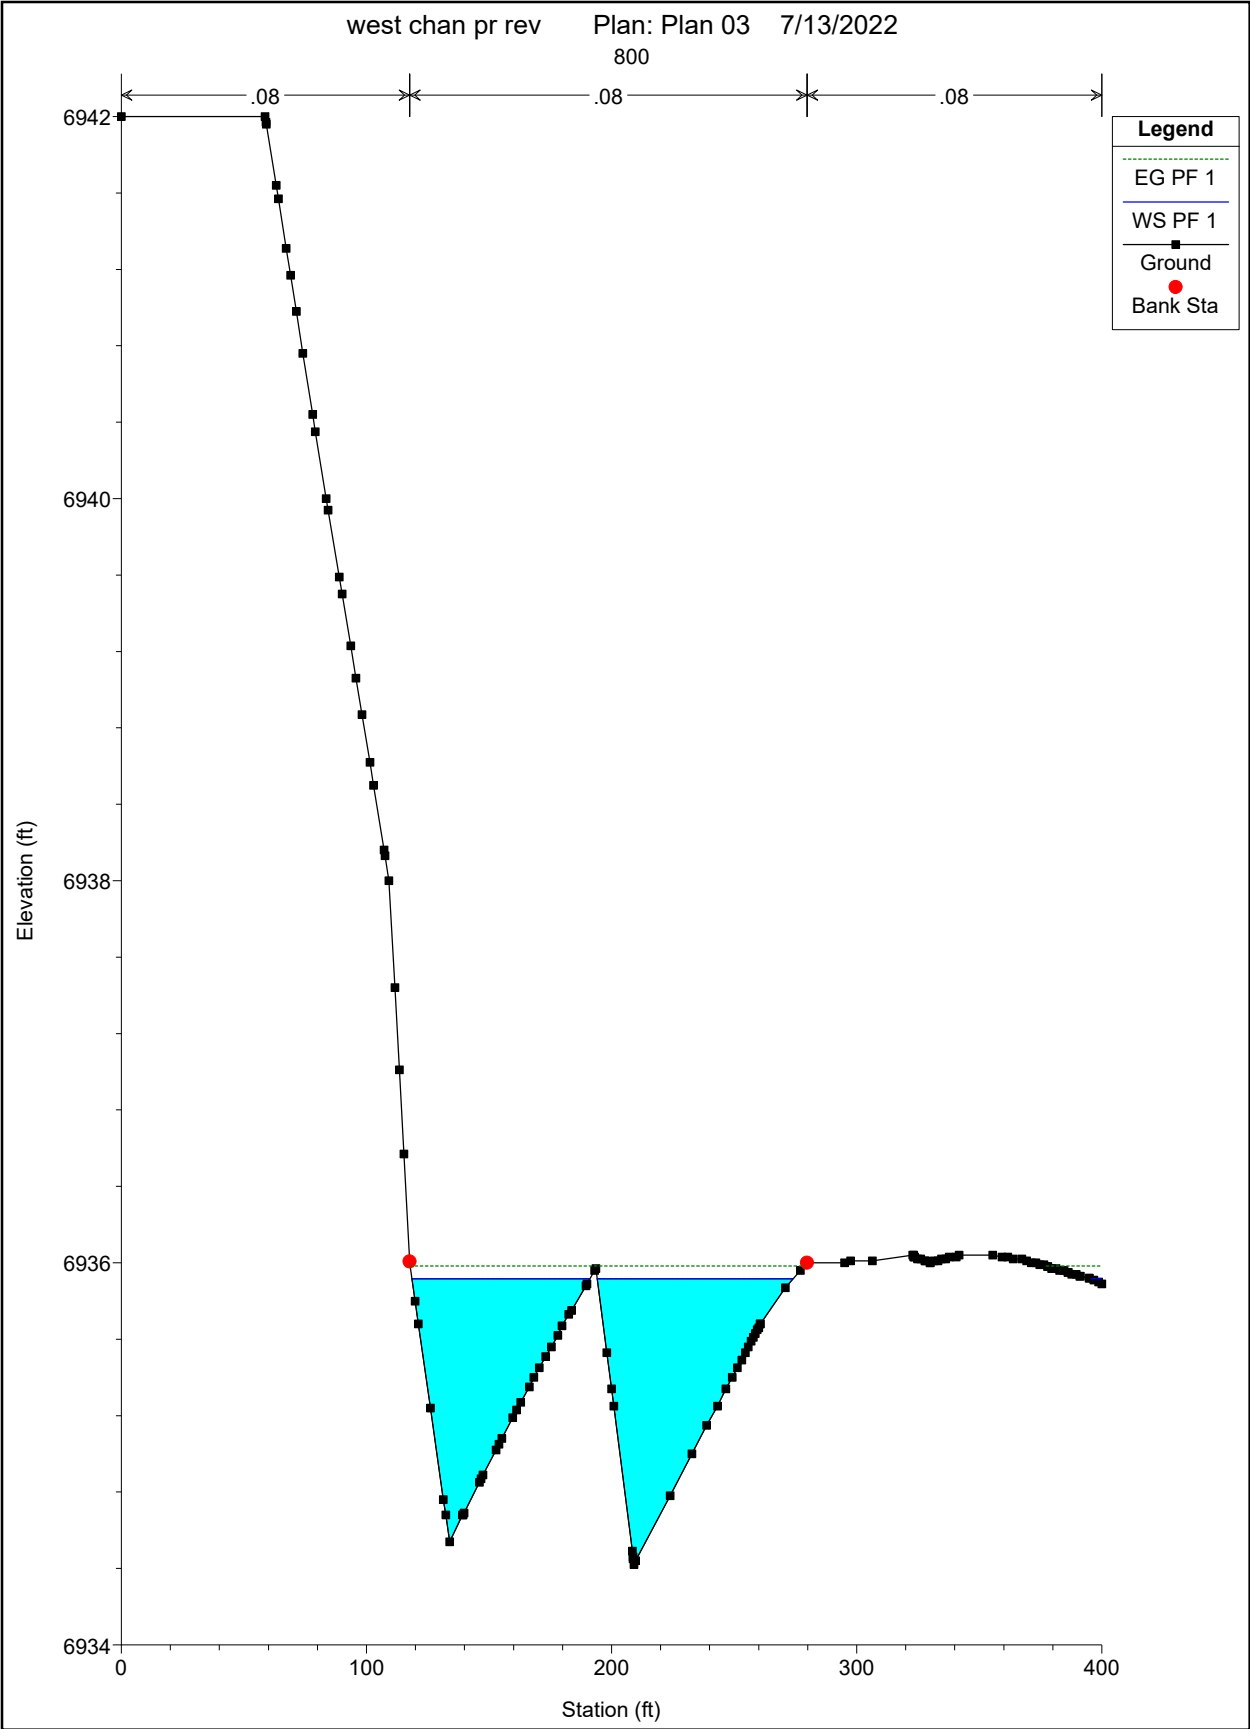


west chan pr rev Plan: Plan 03 7/13/2022
700

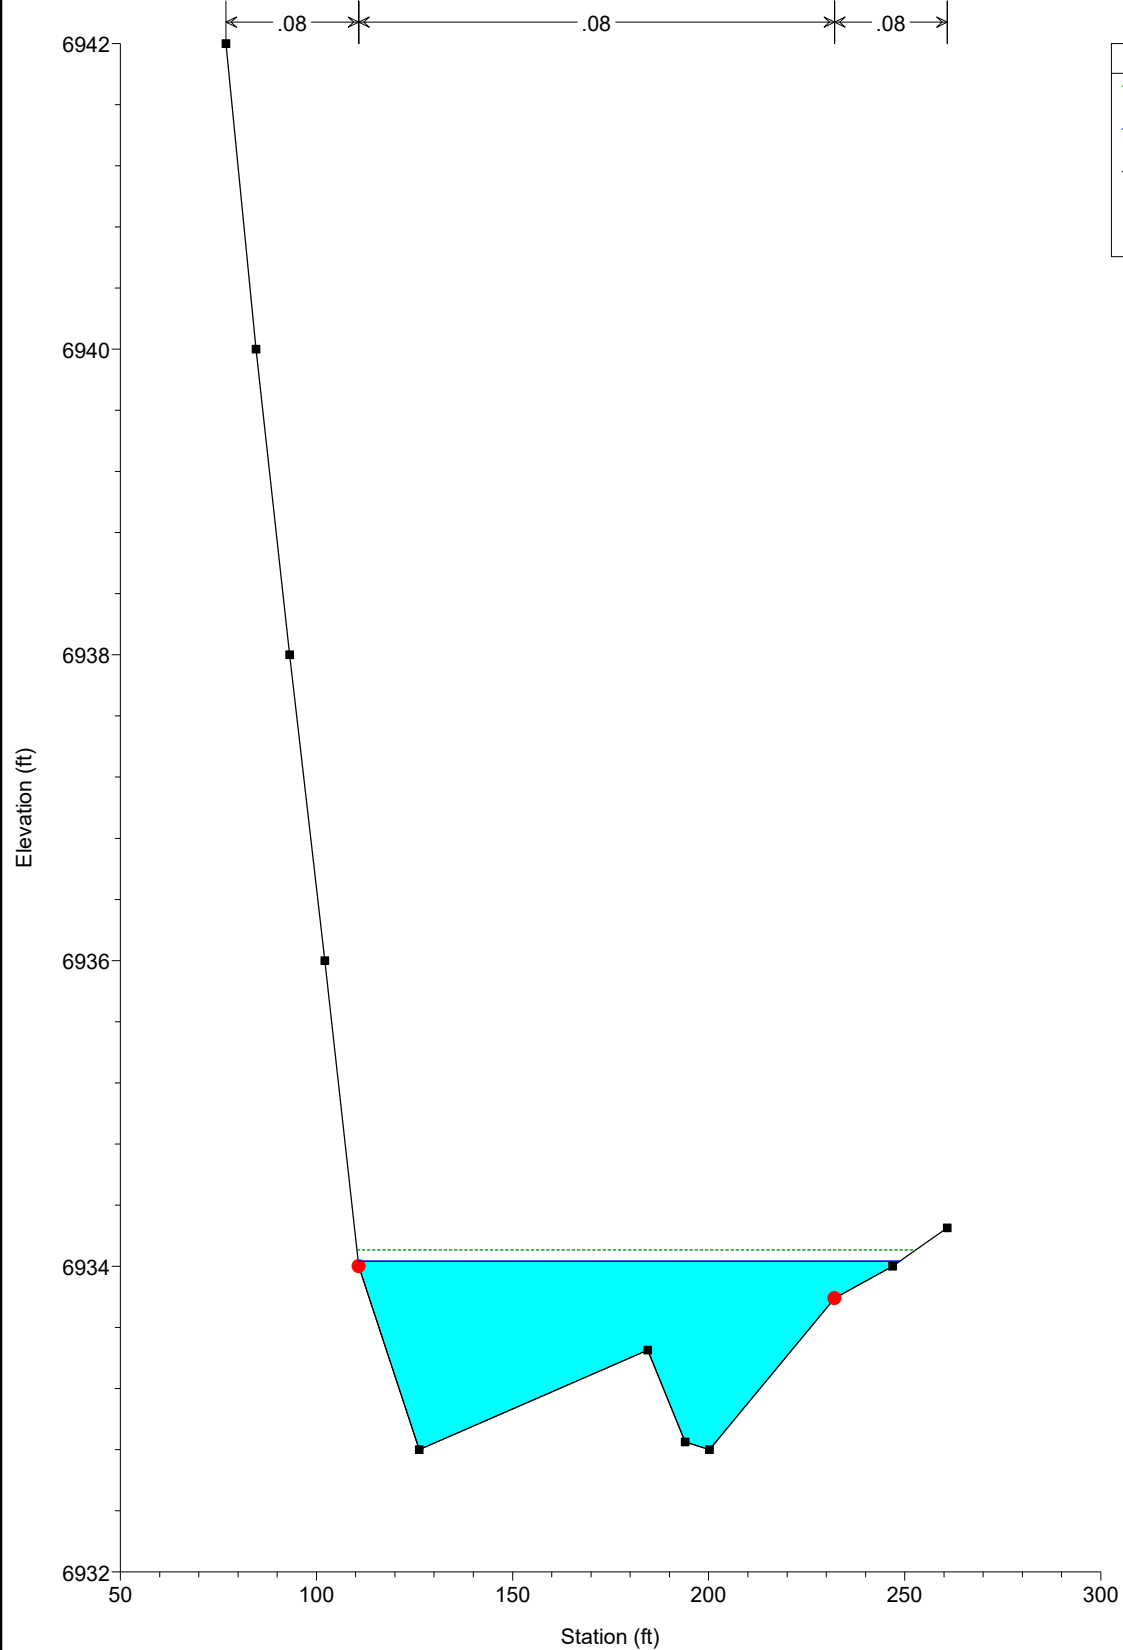


Legend
EG PF 1
WS PF 1
Ground
Bank Sta

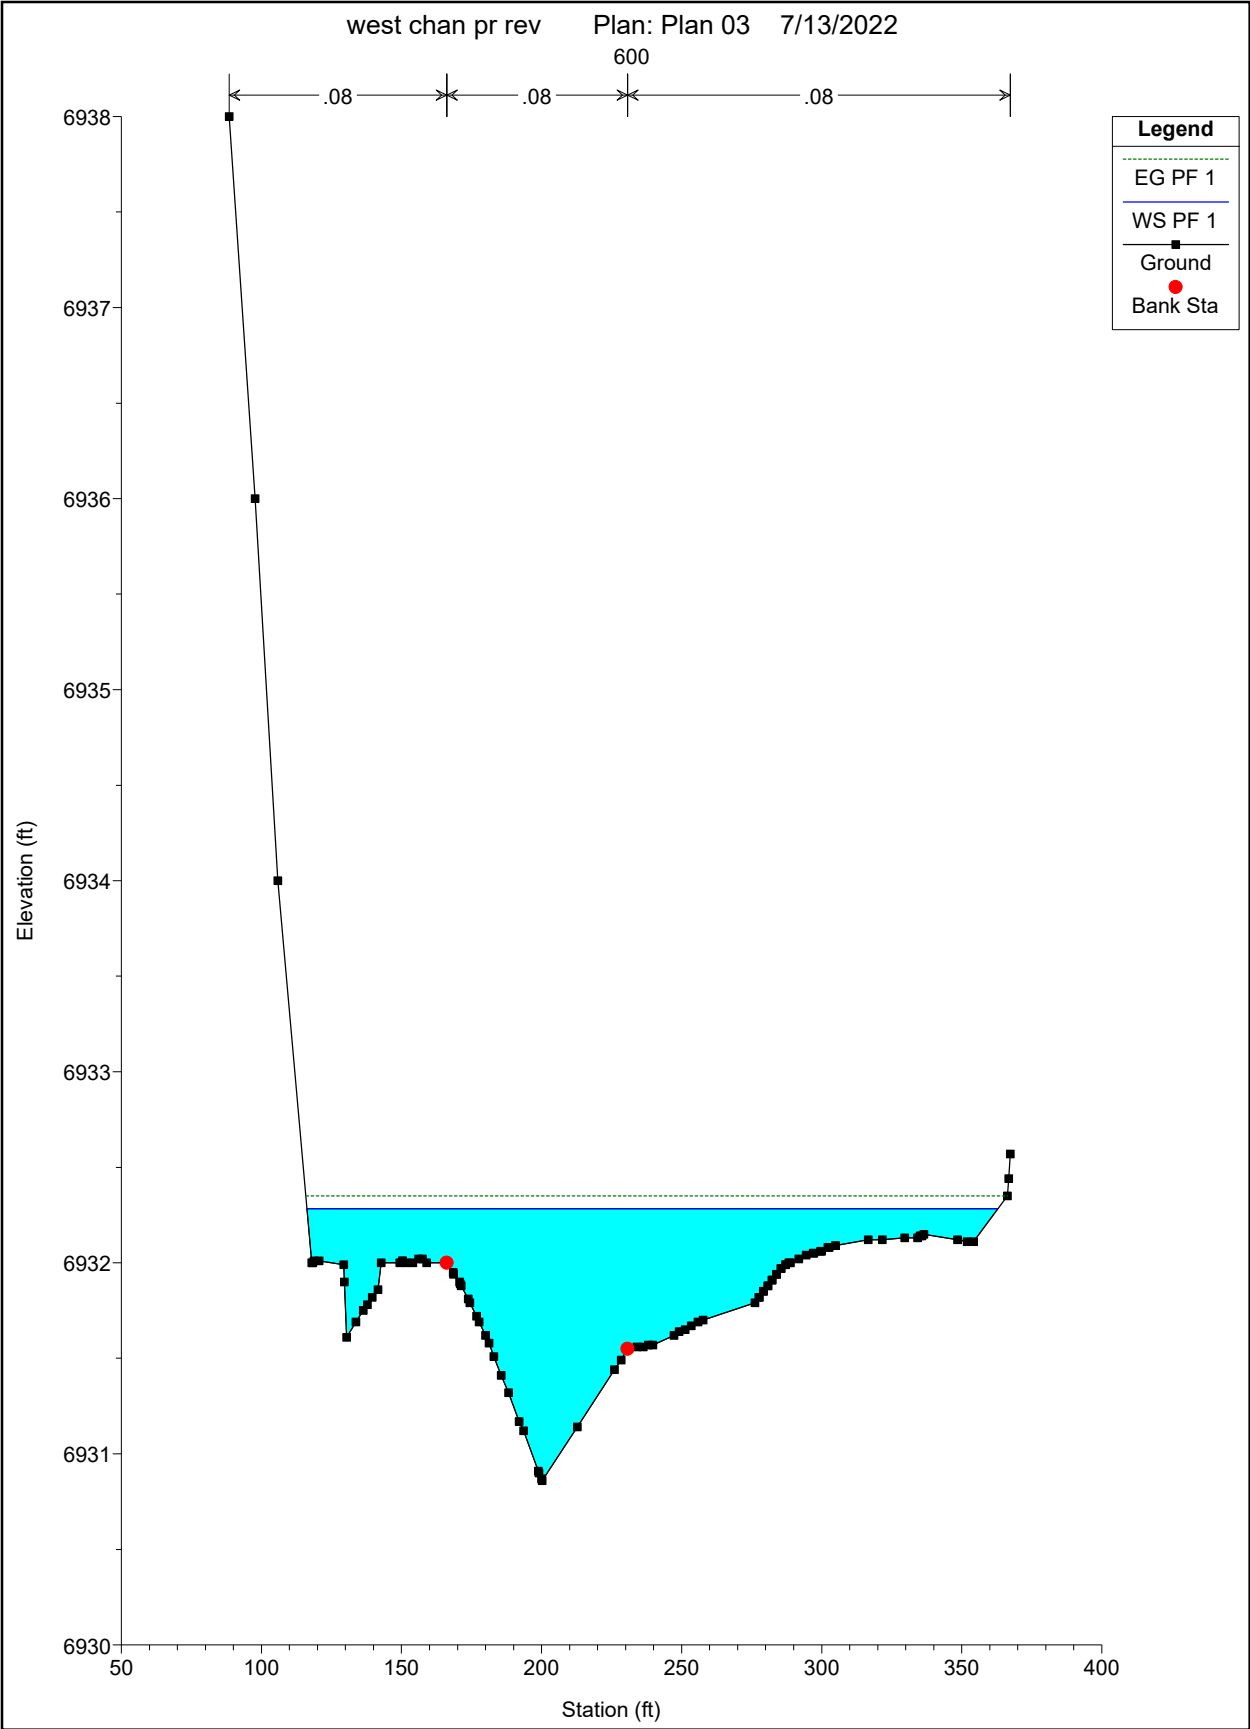


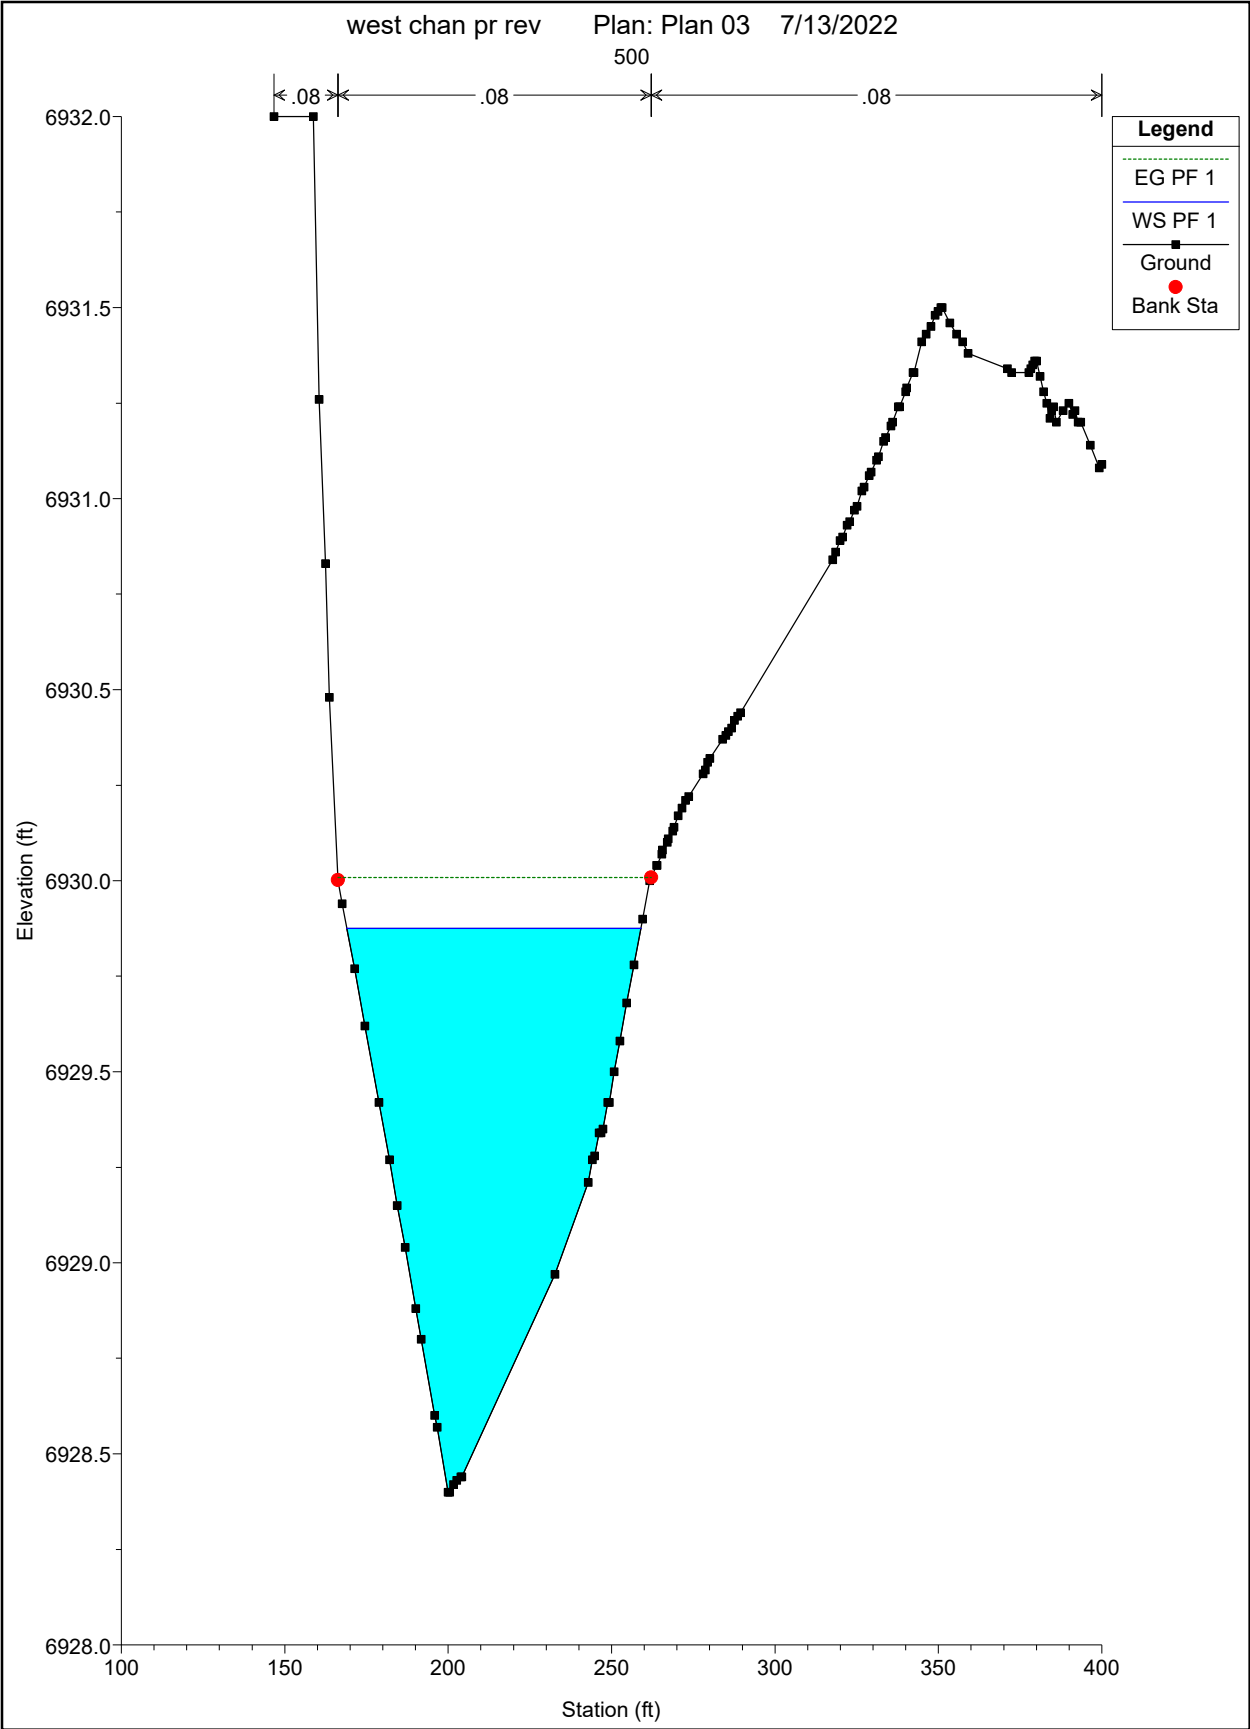


west chan pr rev Plan: Plan 03 7/13/2022
400

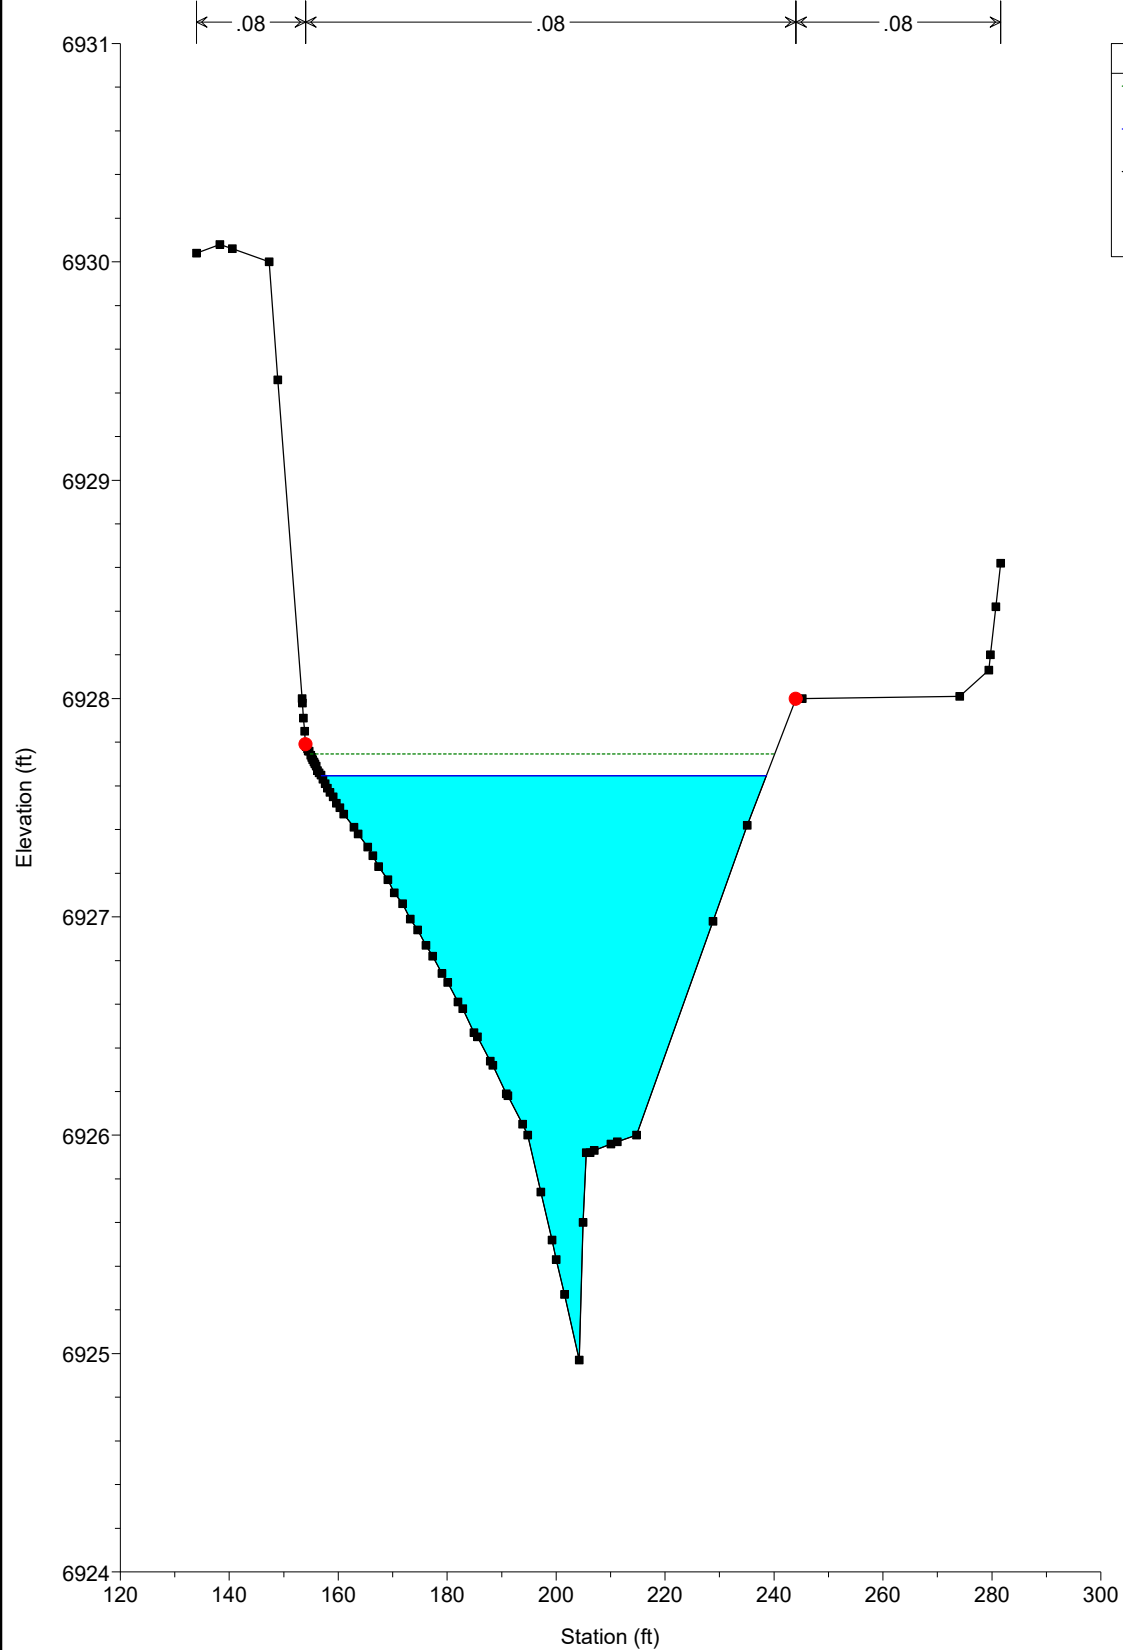


Legend	
EG PF 1	
WS PF 1	
Ground	
Bank Sta	

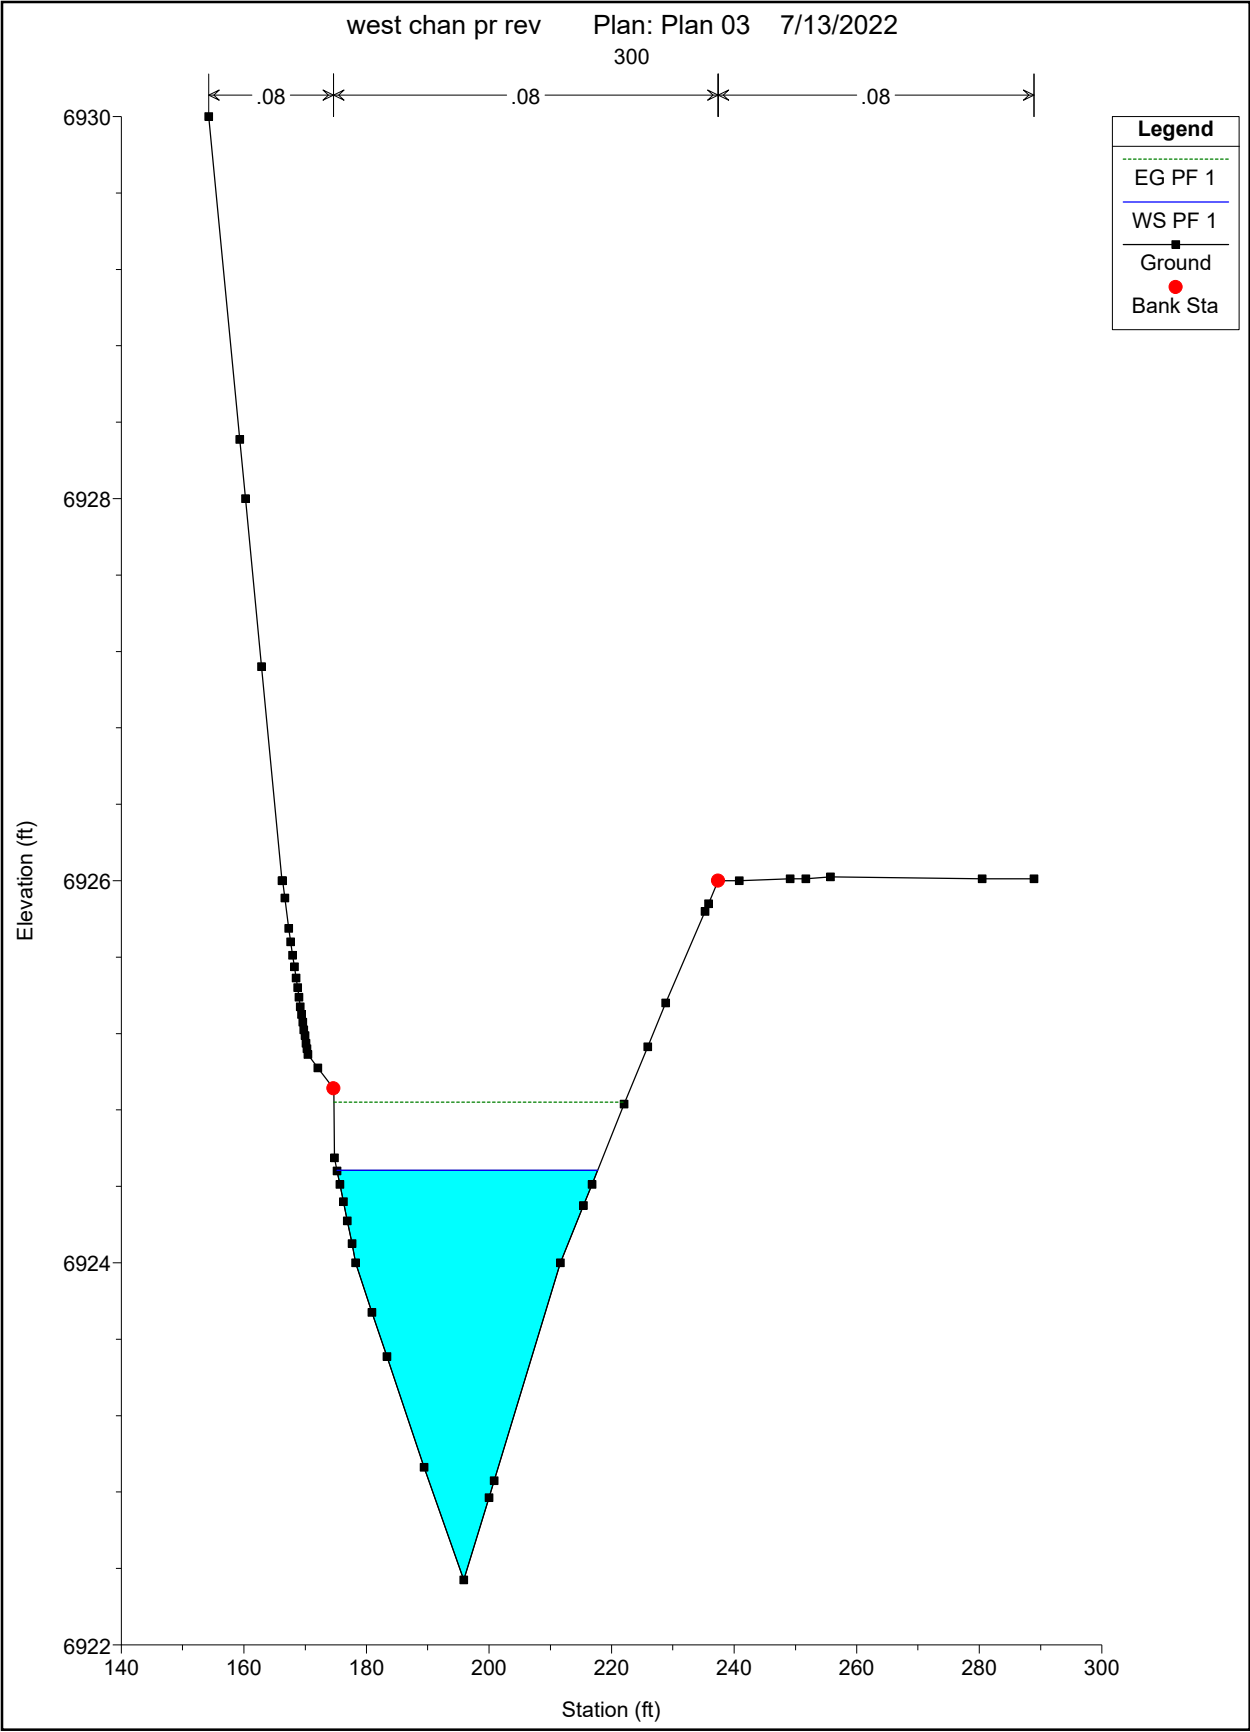


west chan pr rev Plan: Plan 03 7/13/2022
200

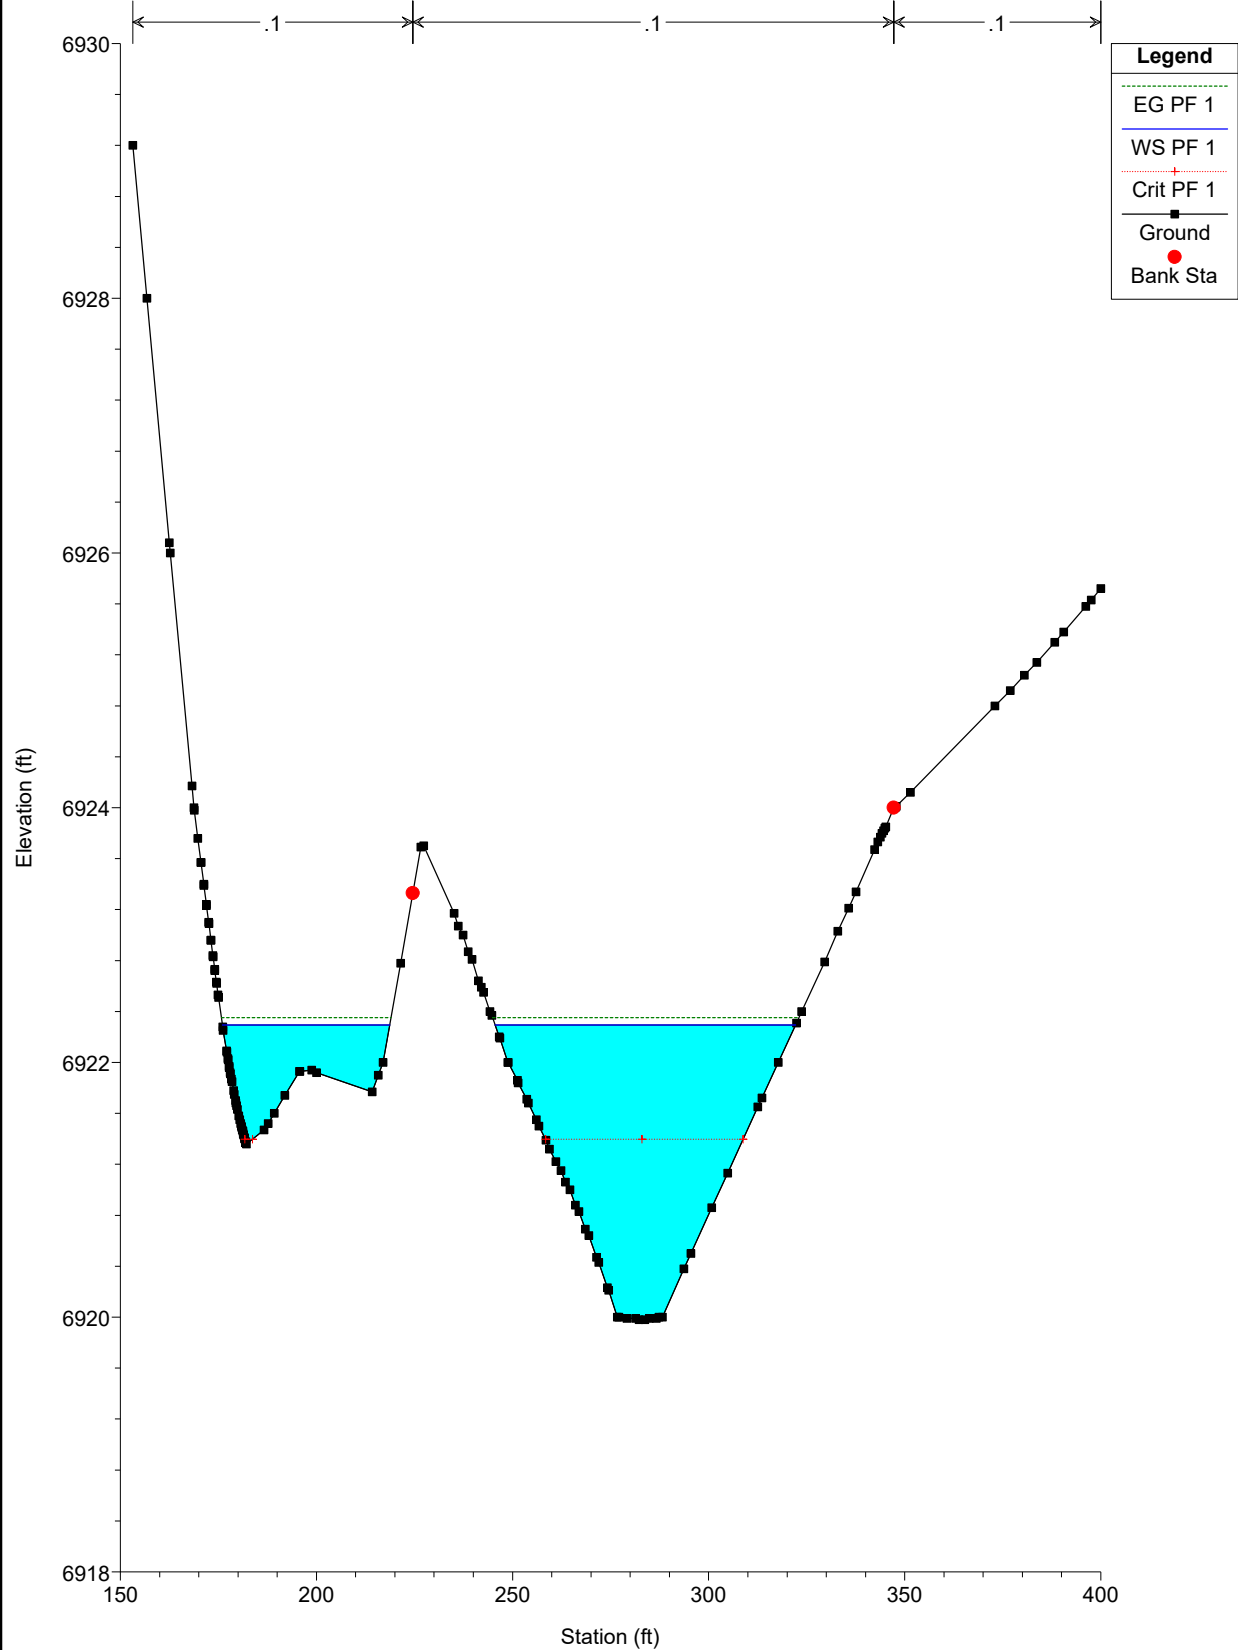

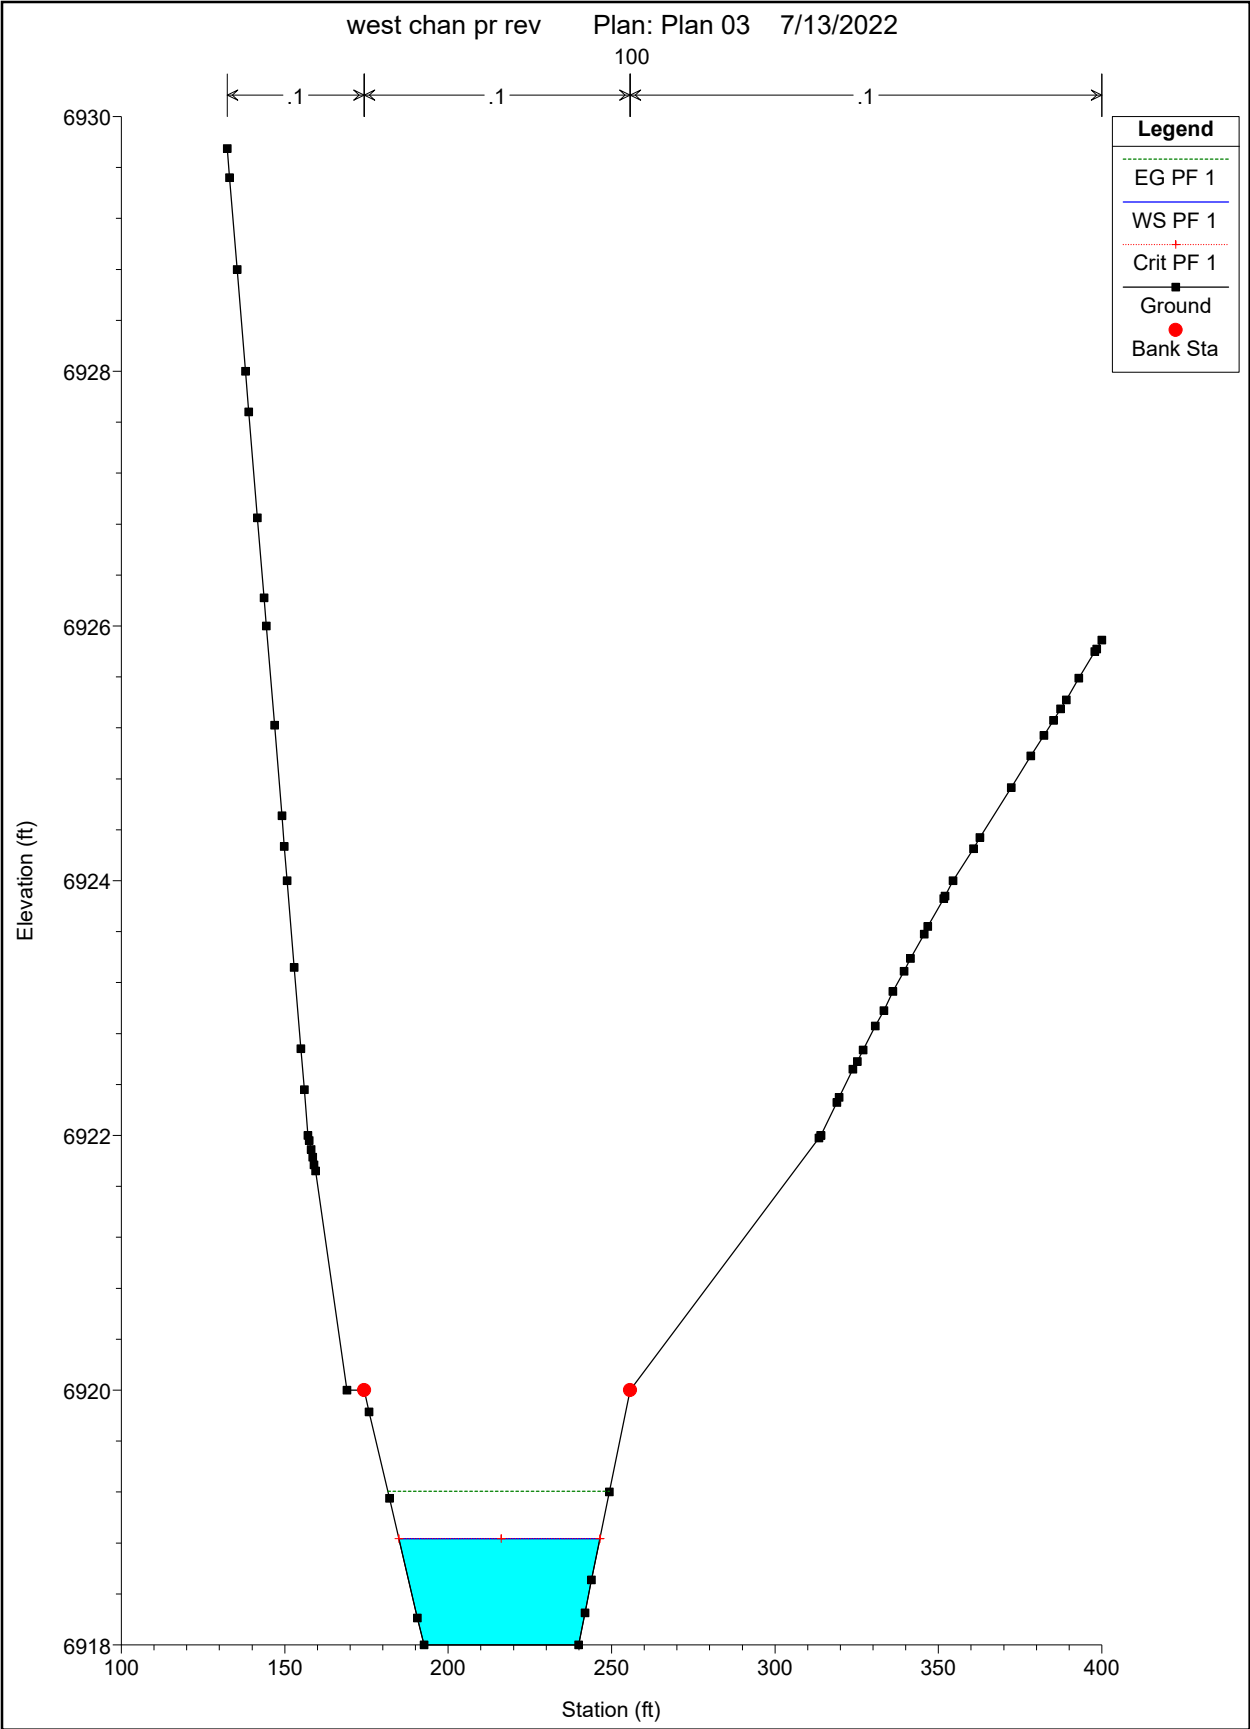

EAST CHANNEL

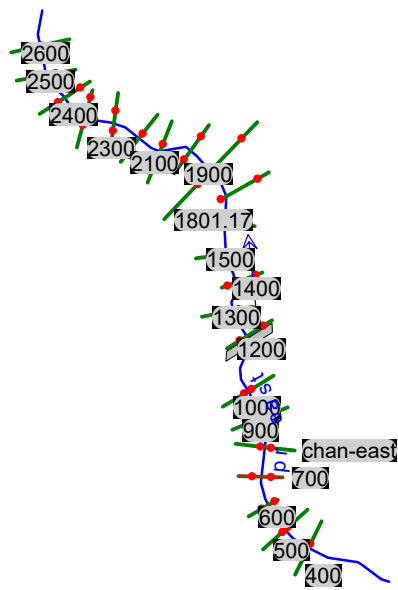

HEC-RAS Plan: 1 River: pr east Reach: chan-east Profile: PF 1

Reach	River Sta	Profile	Q Total (cfs)	Min Ch El (ft)	W.S. Elev (ft)	Crit W.S. (ft)	E.G. Elev (ft)	E.G. Slope (ft/ft)	Vel Chnl (ft/s)	Flow Area (sq ft)	Top Width (ft)	Froude # Chl
chan-east	2600	PF 1	120.00	6943.35	6944.50		6944.59	0.022506	2.84	54.22	101.57	0.55
chan-east	2500	PF 1	120.00	6941.98	6943.06		6943.10	0.010181	1.74	73.94	110.02	0.32
chan-east	2400	PF 1	120.00	6939.99	6941.36		6941.46	0.030541	2.64	45.54	62.19	0.54
chan-east	2300	PF 1	120.00	6938.00	6939.49		6939.54	0.013098	1.77	67.85	88.93	0.36
chan-east	2200	PF 1	120.00	6937.26	6938.45		6938.49	0.008433	1.66	78.63	105.74	0.30
chan-east	2100	PF 1	120.00	6935.98	6937.45		6937.52	0.011651	2.14	56.06	50.54	0.36
chan-east	2010.89	PF 1	120.00	6934.00	6935.26		6935.46	0.064640	3.57	33.61	51.05	0.78
chan-east	1900	PF 1	120.00	6932.00	6933.70		6933.73	0.006557	1.48	80.81	82.29	0.26
chan-east	1801.17	PF 1	120.00	6931.95	6932.41		6932.46	0.035199	1.80	66.80	180.44	0.52
chan-east	1694.83	PF 1	120.00	6930.00	6930.97		6930.99	0.007316	1.27	94.36	131.59	0.26
chan-east	1600	PF 1	120.00	6928.53	6929.30		6929.43	0.065268	2.87	41.77	88.59	0.74
chan-east	1500	PF 1	120.00	6924.59	6926.37		6926.49	0.016584	2.84	43.68	42.35	0.44
chan-east	1400	PF 1	120.00	6922.19	6924.51		6924.60	0.021594	2.38	50.49	61.86	0.46
chan-east	1300	PF 1	120.00	6920.82	6923.46		6923.51	0.006539	1.70	70.77	58.74	0.27
chan-east	1200	PF 1	120.00	6919.97	6923.45	6920.60	6923.45	0.000136	0.44	285.10	116.70	0.05
chan-east	1111.15		Culvert									
chan-east	1000	PF 1	120.00	6917.10	6918.83		6918.92	0.011112	2.55	54.22	58.40	0.37
chan-east	900	PF 1	120.00	6915.94	6917.41		6917.53	0.017879	2.74	43.84	37.59	0.45
chan-east	800	PF 1	120.00	6913.99	6916.40		6916.47	0.006825	2.10	58.47	43.21	0.29
chan-east	700	PF 1	120.00	6913.94	6915.73		6915.78	0.006896	1.87	64.09	47.26	0.28
chan-east	600	PF 1	120.00	6912.09	6914.04		6914.29	0.050209	4.08	29.42	30.06	0.73
chan-east	500	PF 1	120.00	6909.99	6912.66		6912.75	0.007031	2.41	51.99	34.20	0.30
chan-east	400	PF 1	120.00	6909.92	6911.71	6910.93	6911.82	0.012998	2.65	45.35	31.95	0.39

Plan: 1 pr east chan-east RS: 2600 Profile: PF 1

E.G. Elev (ft)	6944.59	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.09	Wt. n-Val.	0.070	0.070	0.070
W.S. Elev (ft)	6944.50	Reach Len. (ft)	104.70	100.00	103.80
Crit W.S. (ft)		Flow Area (sq ft)	1.79	18.41	34.02
E.G. Slope (ft/ft)	0.022506	Area (sq ft)	1.79	18.41	34.02
Q Total (cfs)	120.00	Flow (cfs)	2.23	52.33	65.45
Top Width (ft)	101.57	Top Width (ft)	7.34	21.80	72.43
Vel Total (ft/s)	2.21	Avg. Vel. (ft/s)	1.24	2.84	1.92
Max Chl Dpth (ft)	1.15	Hydr. Depth (ft)	0.24	0.84	0.47
Conv. Total (cfs)	799.9	Conv. (cfs)	14.8	348.8	436.3
Length Wtd. (ft)	101.18	Wetted Per. (ft)	7.36	21.84	72.44
Min Ch El (ft)	6943.35	Shear (lb/sq ft)	0.34	1.18	0.66
Alpha	1.14	Stream Power (lb/ft s)	0.43	3.37	1.27
Frctn Loss (ft)	1.47	Cum Volume (acre-ft)	0.04	2.90	0.10
C & E Loss (ft)	0.01	Cum SA (acres)	0.19	3.26	0.31

Plan: 1 pr east chan-east RS: 2500 Profile: PF 1

E.G. Elev (ft)	6943.10	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.05	Wt. n-Val.	0.080	0.080	0.080
W.S. Elev (ft)	6943.06	Reach Len. (ft)	81.90	100.00	112.30
Crit W.S. (ft)		Flow Area (sq ft)	4.01	65.97	3.96
E.G. Slope (ft/ft)	0.010181	Area (sq ft)	4.01	65.97	3.96
Q Total (cfs)	120.00	Flow (cfs)	2.57	114.51	2.92
Top Width (ft)	110.02	Top Width (ft)	20.05	74.00	15.97
Vel Total (ft/s)	1.62	Avg. Vel. (ft/s)	0.64	1.74	0.74
Max Chl Dpth (ft)	1.08	Hydr. Depth (ft)	0.20	0.89	0.25
Conv. Total (cfs)	1189.3	Conv. (cfs)	25.5	1134.8	29.0
Length Wtd. (ft)	99.96	Wetted Per. (ft)	20.06	74.02	15.97
Min Ch El (ft)	6941.98	Shear (lb/sq ft)	0.13	0.57	0.16
Alpha	1.10	Stream Power (lb/ft s)	0.08	0.98	0.12
Frctn Loss (ft)	1.64	Cum Volume (acre-ft)	0.03	2.80	0.05
C & E Loss (ft)	0.01	Cum SA (acres)	0.16	3.15	0.21

Plan: 1 pr east chan-east RS: 2400 Profile: PF 1

E.G. Elev (ft)	6941.46	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.11	Wt. n-Val.		0.080	
W.S. Elev (ft)	6941.36	Reach Len. (ft)	81.40	100.00	147.60
Crit W.S. (ft)		Flow Area (sq ft)		45.54	
E.G. Slope (ft/ft)	0.030541	Area (sq ft)		45.54	
Q Total (cfs)	120.00	Flow (cfs)		120.00	
Top Width (ft)	62.19	Top Width (ft)		62.19	
Vel Total (ft/s)	2.64	Avg. Vel. (ft/s)		2.64	
Max Chl Dpth (ft)	1.37	Hydr. Depth (ft)		0.73	
Conv. Total (cfs)	686.7	Conv. (cfs)		686.7	
Length Wtd. (ft)	100.00	Wetted Per. (ft)		62.26	
Min Ch El (ft)	6939.99	Shear (lb/sq ft)		1.39	
Alpha	1.00	Stream Power (lb/ft s)		3.67	
Frctn Loss (ft)	1.91	Cum Volume (acre-ft)	0.03	2.67	0.05
C & E Loss (ft)	0.02	Cum SA (acres)	0.14	2.99	0.19

Plan: 1 pr east chan-east RS: 2300 Profile: PF 1

E.G. Elev (ft)	6939.54	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.05	Wt. n-Val.		0.080	
W.S. Elev (ft)	6939.49	Reach Len. (ft)	96.47	100.00	113.00
Crit W.S. (ft)		Flow Area (sq ft)		67.85	
E.G. Slope (ft/ft)	0.013098	Area (sq ft)		67.85	
Q Total (cfs)	120.00	Flow (cfs)		120.00	
Top Width (ft)	88.93	Top Width (ft)		88.93	
Vel Total (ft/s)	1.77	Avg. Vel. (ft/s)		1.77	
Max Chl Dpth (ft)	1.49	Hydr. Depth (ft)		0.76	
Conv. Total (cfs)	1048.5	Conv. (cfs)		1048.5	
Length Wtd. (ft)	100.56	Wetted Per. (ft)		89.39	
Min Ch El (ft)	6938.00	Shear (lb/sq ft)		0.62	
Alpha	1.00	Stream Power (lb/ft s)		1.10	
Frctn Loss (ft)	1.04	Cum Volume (acre-ft)	0.03	2.54	0.05
C & E Loss (ft)	0.00	Cum SA (acres)	0.14	2.82	0.19

Plan: 1 pr east chan-east RS: 2200 Profile: PF 1

E.G. Elev (ft)	6938.49	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.04	Wt. n-Val.	0.080	0.080	0.080
W.S. Elev (ft)	6938.45	Reach Len. (ft)	115.85	100.00	47.10
Crit W.S. (ft)		Flow Area (sq ft)	3.06	64.80	10.77
E.G. Slope (ft/ft)	0.008433	Area (sq ft)	3.06	64.80	10.77
Q Total (cfs)	120.00	Flow (cfs)	1.86	107.28	10.86
Top Width (ft)	105.74	Top Width (ft)	14.39	67.70	23.65
Vel Total (ft/s)	1.53	Avg. Vel. (ft/s)	0.61	1.66	1.01
Max Chl Dpth (ft)	1.19	Hydr. Depth (ft)	0.21	0.96	0.46
Conv. Total (cfs)	1306.8	Conv. (cfs)	20.2	1168.3	118.3
Length Wtd. (ft)	97.73	Wetted Per. (ft)	14.40	67.75	23.72
Min Ch El (ft)	6937.26	Shear (lb/sq ft)	0.11	0.50	0.24
Alpha	1.09	Stream Power (lb/ft s)	0.07	0.83	0.24
Frctn Loss (ft)	0.96	Cum Volume (acre-ft)	0.03	2.39	0.03
C & E Loss (ft)	0.00	Cum SA (acres)	0.12	2.64	0.16

Plan: 1 pr east chan-east RS: 2100 Profile: PF 1

E.G. Elev (ft)	6937.52	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.07	Wt. n-Val.		0.080	
W.S. Elev (ft)	6937.45	Reach Len. (ft)	70.40	89.11	90.82
Crit W.S. (ft)		Flow Area (sq ft)		56.06	
E.G. Slope (ft/ft)	0.011651	Area (sq ft)		56.06	
Q Total (cfs)	120.00	Flow (cfs)		120.00	
Top Width (ft)	50.54	Top Width (ft)		50.54	
Vel Total (ft/s)	2.14	Avg. Vel. (ft/s)		2.14	
Max Chl Dpth (ft)	1.47	Hydr. Depth (ft)		1.11	
Conv. Total (cfs)	1111.7	Conv. (cfs)		1111.7	
Length Wtd. (ft)	89.11	Wetted Per. (ft)		50.81	
Min Ch El (ft)	6935.98	Shear (lb/sq ft)		0.80	
Alpha	1.00	Stream Power (lb/ft s)		1.72	
Frctn Loss (ft)	2.05	Cum Volume (acre-ft)	0.02	2.25	0.03
C & E Loss (ft)	0.01	Cum SA (acres)	0.10	2.50	0.14

Plan: 1 pr east chan-east RS: 2010.89 Profile: PF 1

E.G. Elev (ft)	6935.46	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.20	Wt. n-Val.		0.080	
W.S. Elev (ft)	6935.26	Reach Len. (ft)	113.80	110.89	86.50
Crit W.S. (ft)		Flow Area (sq ft)		33.61	
E.G. Slope (ft/ft)	0.064640	Area (sq ft)		33.61	
Q Total (cfs)	120.00	Flow (cfs)		120.00	
Top Width (ft)	51.05	Top Width (ft)		51.05	
Vel Total (ft/s)	3.57	Avg. Vel. (ft/s)		3.57	
Max Chl Dpth (ft)	1.26	Hydr. Depth (ft)		0.66	
Conv. Total (cfs)	472.0	Conv. (cfs)		472.0	
Length Wtd. (ft)	110.89	Wetted Per. (ft)		51.12	
Min Ch El (ft)	6934.00	Shear (lb/sq ft)		2.65	
Alpha	1.00	Stream Power (lb/ft s)		9.47	
Frctn Loss (ft)	1.67	Cum Volume (acre-ft)	0.02	2.16	0.03
C & E Loss (ft)	0.05	Cum SA (acres)	0.10	2.40	0.14

Plan: 1 pr east chan-east RS: 1900 Profile: PF 1

E.G. Elev (ft)	6933.73	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.03	Wt. n-Val.		0.080	
W.S. Elev (ft)	6933.70	Reach Len. (ft)	102.83	98.83	136.70
Crit W.S. (ft)		Flow Area (sq ft)		80.81	
E.G. Slope (ft/ft)	0.006557	Area (sq ft)		80.81	
Q Total (cfs)	120.00	Flow (cfs)		120.00	
Top Width (ft)	82.29	Top Width (ft)		82.29	
Vel Total (ft/s)	1.48	Avg. Vel. (ft/s)		1.48	
Max Chl Dpth (ft)	1.70	Hydr. Depth (ft)		0.98	
Conv. Total (cfs)	1481.9	Conv. (cfs)		1481.9	
Length Wtd. (ft)	98.83	Wetted Per. (ft)		82.38	
Min Ch El (ft)	6932.00	Shear (lb/sq ft)		0.40	
Alpha	1.00	Stream Power (lb/ft s)		0.60	
Frctn Loss (ft)	1.26	Cum Volume (acre-ft)	0.02	2.01	0.03
C & E Loss (ft)	0.00	Cum SA (acres)	0.10	2.23	0.14

Plan: 1 pr east chan-east RS: 1801.17 Profile: PF 1

E.G. Elev (ft)	6932.46	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.05	Wt. n-Val.		0.080	
W.S. Elev (ft)	6932.41	Reach Len. (ft)	82.11	106.34	125.47
Crit W.S. (ft)		Flow Area (sq ft)		66.80	
E.G. Slope (ft/ft)	0.035199	Area (sq ft)		66.80	
Q Total (cfs)	120.00	Flow (cfs)		120.00	
Top Width (ft)	180.44	Top Width (ft)		180.44	
Vel Total (ft/s)	1.80	Avg. Vel. (ft/s)		1.80	
Max Chl Dpth (ft)	0.46	Hydr. Depth (ft)		0.37	
Conv. Total (cfs)	639.6	Conv. (cfs)		639.6	
Length Wtd. (ft)	106.34	Wetted Per. (ft)		180.50	
Min Ch El (ft)	6931.95	Shear (lb/sq ft)		0.81	
Alpha	1.00	Stream Power (lb/ft s)		1.46	
Frctn Loss (ft)	1.47	Cum Volume (acre-ft)	0.02	1.84	0.03
C & E Loss (ft)	0.01	Cum SA (acres)	0.10	1.93	0.14

Plan: 1 pr east chan-east RS: 1694.83 Profile: PF 1

E.G. Elev (ft)	6930.99	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.03	Wt. n-Val.		0.080	
W.S. Elev (ft)	6930.97	Reach Len. (ft)	105.81	94.83	54.45
Crit W.S. (ft)		Flow Area (sq ft)		94.36	
E.G. Slope (ft/ft)	0.007316	Area (sq ft)		94.36	
Q Total (cfs)	120.00	Flow (cfs)		120.00	
Top Width (ft)	131.59	Top Width (ft)		131.59	
Vel Total (ft/s)	1.27	Avg. Vel. (ft/s)		1.27	
Max Chl Dpth (ft)	0.97	Hydr. Depth (ft)		0.72	
Conv. Total (cfs)	1403.0	Conv. (cfs)		1403.0	
Length Wtd. (ft)	94.83	Wetted Per. (ft)		131.76	
Min Ch El (ft)	6930.00	Shear (lb/sq ft)		0.33	
Alpha	1.00	Stream Power (lb/ft s)		0.42	
Frctn Loss (ft)	1.56	Cum Volume (acre-ft)	0.02	1.65	0.03
C & E Loss (ft)	0.01	Cum SA (acres)	0.10	1.55	0.14

Plan: 1 pr east chan-east RS: 1600 Profile: PF 1

E.G. Elev (ft)	6929.43	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.13	Wt. n-Val.		0.080	
W.S. Elev (ft)	6929.30	Reach Len. (ft)	96.10	100.00	115.30
Crit W.S. (ft)		Flow Area (sq ft)		41.77	
E.G. Slope (ft/ft)	0.065268	Area (sq ft)		41.77	
Q Total (cfs)	120.00	Flow (cfs)		120.00	
Top Width (ft)	88.59	Top Width (ft)		88.59	
Vel Total (ft/s)	2.87	Avg. Vel. (ft/s)		2.87	
Max Chl Dpth (ft)	0.77	Hydr. Depth (ft)		0.47	
Conv. Total (cfs)	469.7	Conv. (cfs)		469.7	
Length Wtd. (ft)	100.04	Wetted Per. (ft)		88.65	
Min Ch El (ft)	6928.53	Shear (lb/sq ft)		1.92	
Alpha	1.00	Stream Power (lb/ft s)		5.52	
Frctn Loss (ft)	2.93	Cum Volume (acre-ft)	0.02	1.50	0.03
C & E Loss (ft)	0.00	Cum SA (acres)	0.10	1.31	0.14

Plan: 1 pr east chan-east RS: 1500 Profile: PF 1

E.G. Elev (ft)	6926.49	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.12	Wt. n-Val.	0.080	0.080	0.080
W.S. Elev (ft)	6926.37	Reach Len. (ft)	96.00	100.00	103.60
Crit W.S. (ft)		Flow Area (sq ft)	0.85	41.79	1.04
E.G. Slope (ft/ft)	0.016584	Area (sq ft)	0.85	41.79	1.04
Q Total (cfs)	120.00	Flow (cfs)	0.66	118.53	0.81
Top Width (ft)	42.35	Top Width (ft)	4.59	32.16	5.60
Vel Total (ft/s)	2.75	Avg. Vel. (ft/s)	0.78	2.84	0.78
Max Chl Dpth (ft)	1.78	Hydr. Depth (ft)	0.19	1.30	0.19
Conv. Total (cfs)	931.8	Conv. (cfs)	5.1	920.4	6.3
Length Wtd. (ft)	100.00	Wetted Per. (ft)	4.61	32.36	5.61
Min Ch El (ft)	6924.59	Shear (lb/sq ft)	0.19	1.34	0.19
Alpha	1.05	Stream Power (lb/ft s)	0.15	3.79	0.15
Frctn Loss (ft)	1.88	Cum Volume (acre-ft)	0.02	1.40	0.03
C & E Loss (ft)	0.01	Cum SA (acres)	0.10	1.17	0.14

Plan: 1 pr east chan-east RS: 1400 Profile: PF 1

E.G. Elev (ft)	6924.60	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.09	Wt. n-Val.		0.080	
W.S. Elev (ft)	6924.51	Reach Len. (ft)	92.90	100.00	105.60
Crit W.S. (ft)		Flow Area (sq ft)		50.49	
E.G. Slope (ft/ft)	0.021594	Area (sq ft)		50.49	
Q Total (cfs)	120.00	Flow (cfs)		120.00	
Top Width (ft)	61.86	Top Width (ft)		61.86	
Vel Total (ft/s)	2.38	Avg. Vel. (ft/s)		2.38	
Max Chl Dpth (ft)	2.32	Hydr. Depth (ft)		0.82	
Conv. Total (cfs)	816.6	Conv. (cfs)		816.6	
Length Wtd. (ft)	100.00	Wetted Per. (ft)		62.14	
Min Ch El (ft)	6922.19	Shear (lb/sq ft)		1.10	
Alpha	1.00	Stream Power (lb/ft s)		2.60	
Frctn Loss (ft)	1.09	Cum Volume (acre-ft)	0.02	1.30	0.02
C & E Loss (ft)	0.01	Cum SA (acres)	0.09	1.06	0.13

Plan: 1 pr east chan-east RS: 1300 Profile: PF 1

E.G. Elev (ft)	6923.51	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.04	Wt. n-Val.		0.080	
W.S. Elev (ft)	6923.46	Reach Len. (ft)	85.10	100.00	113.20
Crit W.S. (ft)		Flow Area (sq ft)		70.77	
E.G. Slope (ft/ft)	0.006539	Area (sq ft)		70.77	
Q Total (cfs)	120.00	Flow (cfs)		120.00	
Top Width (ft)	58.74	Top Width (ft)		58.74	
Vel Total (ft/s)	1.70	Avg. Vel. (ft/s)		1.70	
Max Chl Dpth (ft)	2.64	Hydr. Depth (ft)		1.20	
Conv. Total (cfs)	1483.9	Conv. (cfs)		1483.9	
Length Wtd. (ft)	99.96	Wetted Per. (ft)		58.99	
Min Ch El (ft)	6920.82	Shear (lb/sq ft)		0.49	
Alpha	1.00	Stream Power (lb/ft s)		0.83	
Frctn Loss (ft)	0.04	Cum Volume (acre-ft)	0.02	1.16	0.02
C & E Loss (ft)	0.01	Cum SA (acres)	0.09	0.92	0.13

Plan: 1 pr east chan-east RS: 1200 Profile: PF 1

E.G. Elev (ft)	6923.45	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.00	Wt. n-Val.	0.080	0.080	0.080
W.S. Elev (ft)	6923.45	Reach Len. (ft)	200.00	200.00	200.00
Crit W.S. (ft)	6920.60	Flow Area (sq ft)	10.09	267.92	7.08
E.G. Slope (ft/ft)	0.000136	Area (sq ft)	10.09	267.92	7.08
Q Total (cfs)	120.00	Flow (cfs)	1.76	117.02	1.23
Top Width (ft)	116.70	Top Width (ft)	13.90	93.04	9.76
Vel Total (ft/s)	0.42	Avg. Vel. (ft/s)	0.17	0.44	0.17
Max Chl Dpth (ft)	3.48	Hydr. Depth (ft)	0.73	2.88	0.73
Conv. Total (cfs)	10302.1	Conv. (cfs)	150.8	10045.9	105.4
Length Wtd. (ft)	200.00	Wetted Per. (ft)	13.98	93.41	9.87
Min Ch El (ft)	6919.97	Shear (lb/sq ft)	0.01	0.02	0.01
Alpha	1.05	Stream Power (lb/ft s)	0.00	0.01	0.00
Frctn Loss (ft)		Cum Volume (acre-ft)	0.01	0.77	0.02
C & E Loss (ft)		Cum SA (acres)	0.08	0.75	0.12

Plan: 1 pr east chan-east RS: 1000 Profile: PF 1

E.G. Elev (ft)	6918.92	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.09	Wt. n-Val.	0.080	0.080	0.080
W.S. Elev (ft)	6918.83	Reach Len. (ft)	102.70	100.00	98.00
Crit W.S. (ft)		Flow Area (sq ft)	3.16	42.00	9.06
E.G. Slope (ft/ft)	0.011112	Area (sq ft)	3.16	42.00	9.06
Q Total (cfs)	120.00	Flow (cfs)	3.27	106.92	9.80
Top Width (ft)	58.40	Top Width (ft)	8.14	28.20	22.06
Vel Total (ft/s)	2.21	Avg. Vel. (ft/s)	1.04	2.55	1.08
Max Chl Dpth (ft)	1.73	Hydr. Depth (ft)	0.39	1.49	0.41
Conv. Total (cfs)	1138.4	Conv. (cfs)	31.1	1014.3	93.0
Length Wtd. (ft)	99.96	Wetted Per. (ft)	8.18	28.33	22.08
Min Ch El (ft)	6917.10	Shear (lb/sq ft)	0.27	1.03	0.28
Alpha	1.20	Stream Power (lb/ft s)	0.28	2.62	0.31
Frctn Loss (ft)	1.39	Cum Volume (acre-ft)	0.01	0.66	0.02
C & E Loss (ft)	0.00	Cum SA (acres)	0.03	0.47	0.04

Plan: 1 pr east chan-east RS: 900 Profile: PF 1

E.G. Elev (ft)	6917.53	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.12	Wt. n-Val.		0.080	
W.S. Elev (ft)	6917.41	Reach Len. (ft)	106.40	100.00	87.20
Crit W.S. (ft)		Flow Area (sq ft)		43.84	
E.G. Slope (ft/ft)	0.017879	Area (sq ft)		43.84	
Q Total (cfs)	120.00	Flow (cfs)		120.00	
Top Width (ft)	37.59	Top Width (ft)		37.59	
Vel Total (ft/s)	2.74	Avg. Vel. (ft/s)		2.74	
Max Chl Dpth (ft)	1.47	Hydr. Depth (ft)		1.17	
Conv. Total (cfs)	897.5	Conv. (cfs)		897.5	
Length Wtd. (ft)	99.98	Wetted Per. (ft)		37.89	
Min Ch El (ft)	6915.94	Shear (lb/sq ft)		1.29	
Alpha	1.00	Stream Power (lb/ft s)		3.54	
Frctn Loss (ft)	1.04	Cum Volume (acre-ft)	0.01	0.56	0.00
C & E Loss (ft)	0.01	Cum SA (acres)	0.02	0.40	0.02

Plan: 1 pr east chan-east RS: 800 Profile: PF 1

E.G. Elev (ft)	6916.47	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.07	Wt. n-Val.	0.080	0.080	0.080
W.S. Elev (ft)	6916.40	Reach Len. (ft)	100.24	100.00	100.56
Crit W.S. (ft)		Flow Area (sq ft)	0.53	56.83	1.12
E.G. Slope (ft/ft)	0.006825	Area (sq ft)	0.53	56.83	1.12
Q Total (cfs)	120.00	Flow (cfs)	0.28	119.12	0.60
Top Width (ft)	43.21	Top Width (ft)	2.58	35.30	5.33
Vel Total (ft/s)	2.05	Avg. Vel. (ft/s)	0.53	2.10	0.54
Max Chl Dpth (ft)	2.41	Hydr. Depth (ft)	0.20	1.61	0.21
Conv. Total (cfs)	1452.6	Conv. (cfs)	3.4	1441.9	7.3
Length Wtd. (ft)	100.00	Wetted Per. (ft)	2.62	35.59	5.34
Min Ch El (ft)	6913.99	Shear (lb/sq ft)	0.09	0.68	0.09
Alpha	1.04	Stream Power (lb/ft s)	0.05	1.43	0.05
Frctn Loss (ft)	0.69	Cum Volume (acre-ft)	0.01	0.44	0.00
C & E Loss (ft)	0.00	Cum SA (acres)	0.02	0.31	0.01

Plan: 1 pr east chan-east RS: 700 Profile: PF 1

E.G. Elev (ft)	6915.78	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.05	Wt. n-Val.		0.080	
W.S. Elev (ft)	6915.73	Reach Len. (ft)	89.37	100.00	115.50
Crit W.S. (ft)		Flow Area (sq ft)		64.09	
E.G. Slope (ft/ft)	0.006896	Area (sq ft)		64.09	
Q Total (cfs)	120.00	Flow (cfs)		120.00	
Top Width (ft)	47.26	Top Width (ft)		47.26	
Vel Total (ft/s)	1.87	Avg. Vel. (ft/s)		1.87	
Max Chl Dpth (ft)	1.79	Hydr. Depth (ft)		1.36	
Conv. Total (cfs)	1445.1	Conv. (cfs)		1445.1	
Length Wtd. (ft)	100.00	Wetted Per. (ft)		47.92	
Min Ch El (ft)	6913.94	Shear (lb/sq ft)		0.58	
Alpha	1.00	Stream Power (lb/ft s)		1.08	
Frctn Loss (ft)	1.47	Cum Volume (acre-ft)	0.00	0.31	0.00
C & E Loss (ft)	0.02	Cum SA (acres)	0.01	0.22	0.01

Plan: 1 pr east chan-east RS: 600 Profile: PF 1


E.G. Elev (ft)	6914.29	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.26	Wt. n-Val.		0.080	
W.S. Elev (ft)	6914.04	Reach Len. (ft)	111.40	100.00	103.43
Crit W.S. (ft)		Flow Area (sq ft)		29.42	
E.G. Slope (ft/ft)	0.050209	Area (sq ft)		29.42	
Q Total (cfs)	120.00	Flow (cfs)		120.00	
Top Width (ft)	30.06	Top Width (ft)		30.06	
Vel Total (ft/s)	4.08	Avg. Vel. (ft/s)		4.08	
Max Chl Dpth (ft)	1.95	Hydr. Depth (ft)		0.98	
Conv. Total (cfs)	535.5	Conv. (cfs)		535.5	
Length Wtd. (ft)	100.09	Wetted Per. (ft)		30.31	
Min Ch El (ft)	6912.09	Shear (lb/sq ft)		3.04	
Alpha	1.00	Stream Power (lb/ft s)		12.41	
Frctn Loss (ft)	1.49	Cum Volume (acre-ft)	0.00	0.20	0.00
C & E Loss (ft)	0.05	Cum SA (acres)	0.01	0.13	0.01

Plan: 1 pr east chan-east RS: 500 Profile: PF 1


E.G. Elev (ft)	6912.75	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.09	Wt. n-Val.	0.080	0.080	0.080
W.S. Elev (ft)	6912.66	Reach Len. (ft)	93.00	100.00	104.10
Crit W.S. (ft)		Flow Area (sq ft)	2.09	48.86	1.04
E.G. Slope (ft/ft)	0.007031	Area (sq ft)	2.09	48.86	1.04
Q Total (cfs)	120.00	Flow (cfs)	1.60	117.64	0.76
Top Width (ft)	34.20	Top Width (ft)	6.02	25.00	3.18
Vel Total (ft/s)	2.31	Avg. Vel. (ft/s)	0.76	2.41	0.73
Max Chl Dpth (ft)	2.67	Hydr. Depth (ft)	0.35	1.95	0.33
Conv. Total (cfs)	1431.1	Conv. (cfs)	19.0	1403.0	9.1
Length Wtd. (ft)	99.97	Wetted Per. (ft)	6.07	25.42	3.25
Min Ch El (ft)	6909.99	Shear (lb/sq ft)	0.15	0.84	0.14
Alpha	1.07	Stream Power (lb/ft s)	0.12	2.03	0.10
Frctn Loss (ft)	0.93	Cum Volume (acre-ft)	0.00	0.11	0.00
C & E Loss (ft)	0.00	Cum SA (acres)	0.01	0.07	0.00

Plan: 1 pr east chan-east RS: 400 Profile: PF 1


E.G. Elev (ft)	6911.82	Element	Left OB	Channel	Right OB
Vel Head (ft)	0.11	Wt. n-Val.		0.080	
W.S. Elev (ft)	6911.71	Reach Len. (ft)			
Crit W.S. (ft)	6910.93	Flow Area (sq ft)		45.35	
E.G. Slope (ft/ft)	0.012998	Area (sq ft)		45.35	
Q Total (cfs)	120.00	Flow (cfs)		120.00	
Top Width (ft)	31.95	Top Width (ft)		31.95	
Vel Total (ft/s)	2.65	Avg. Vel. (ft/s)		2.65	
Max Chl Dpth (ft)	1.79	Hydr. Depth (ft)		1.42	
Conv. Total (cfs)	1052.6	Conv. (cfs)		1052.6	
Length Wtd. (ft)		Wetted Per. (ft)		32.46	
Min Ch El (ft)	6909.92	Shear (lb/sq ft)		1.13	
Alpha	1.00	Stream Power (lb/ft s)		3.00	
Frctn Loss (ft)		Cum Volume (acre-ft)			
C & E Loss (ft)		Cum SA (acres)			

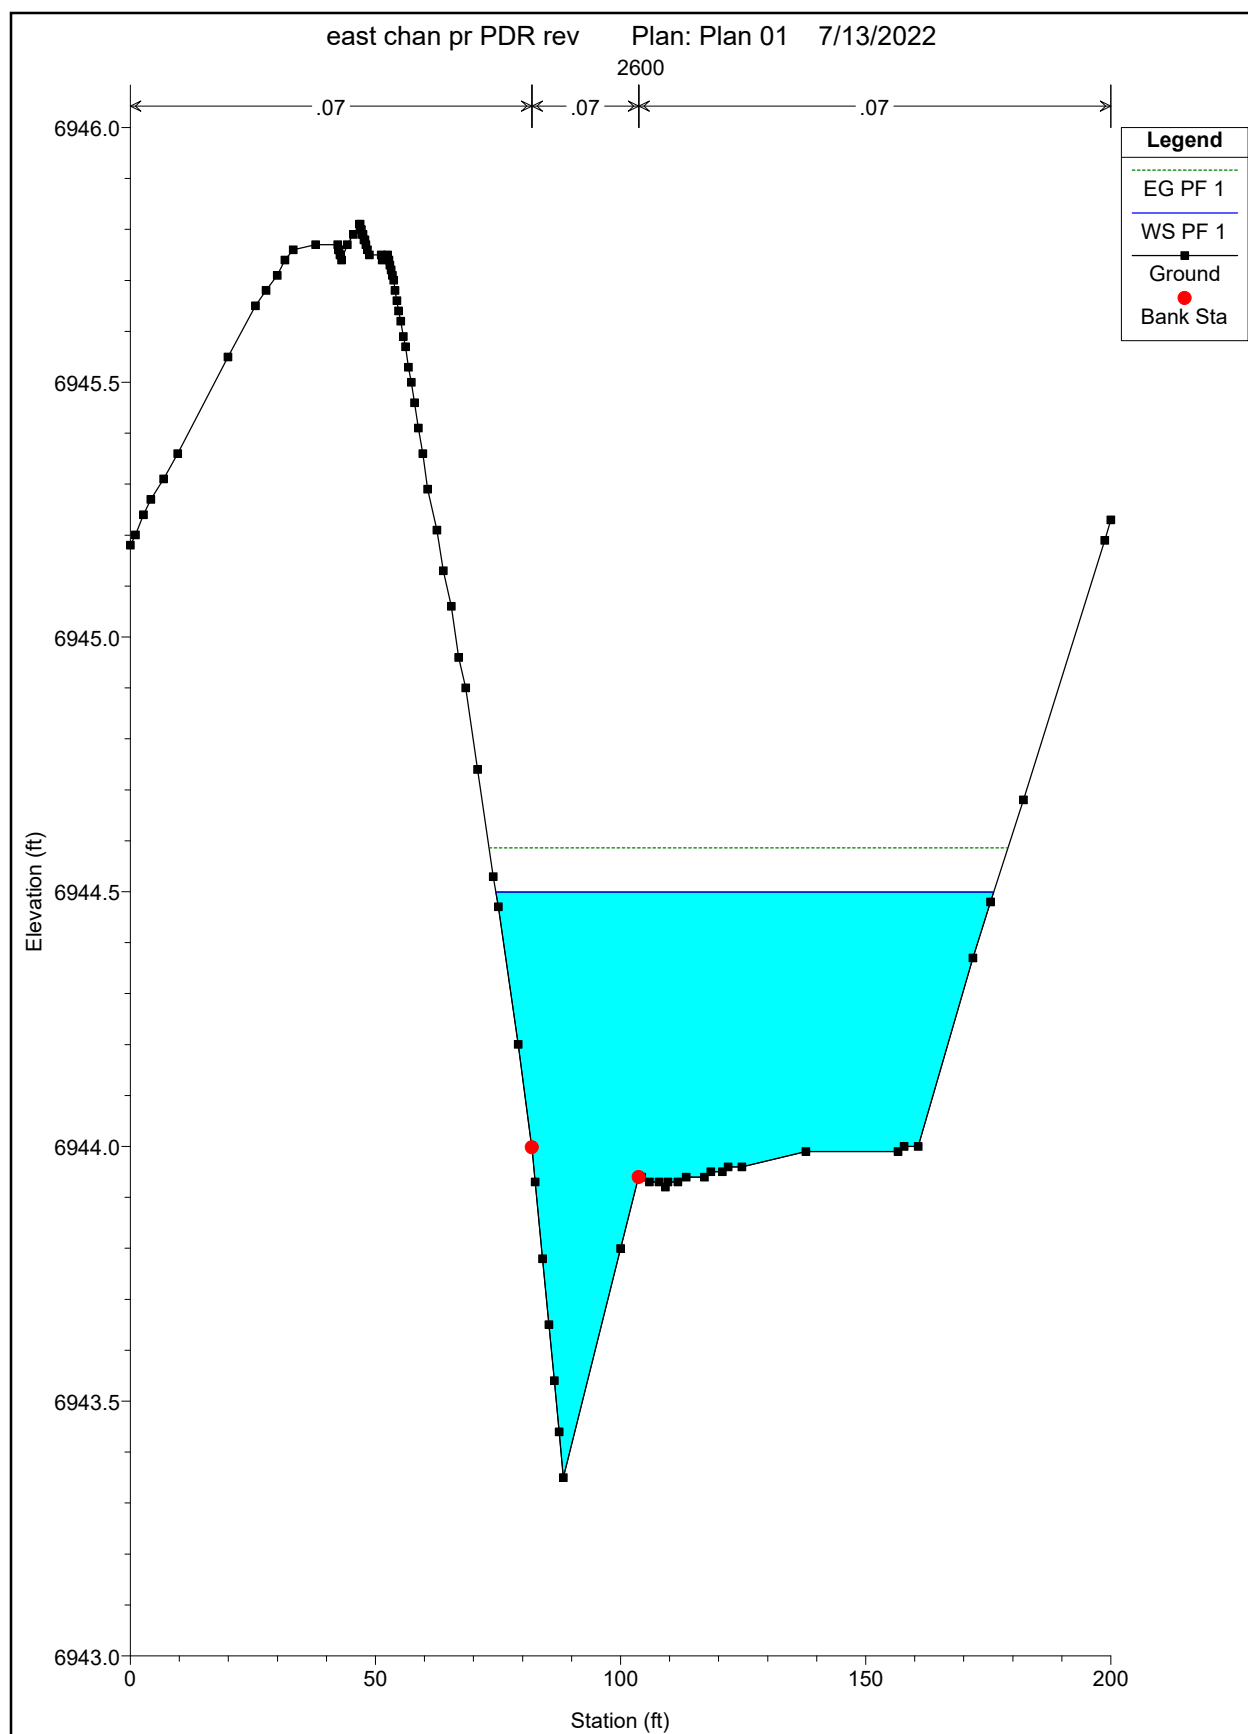


east chan pr PDR rev Plan: Plan 01 7/13/2022
2500

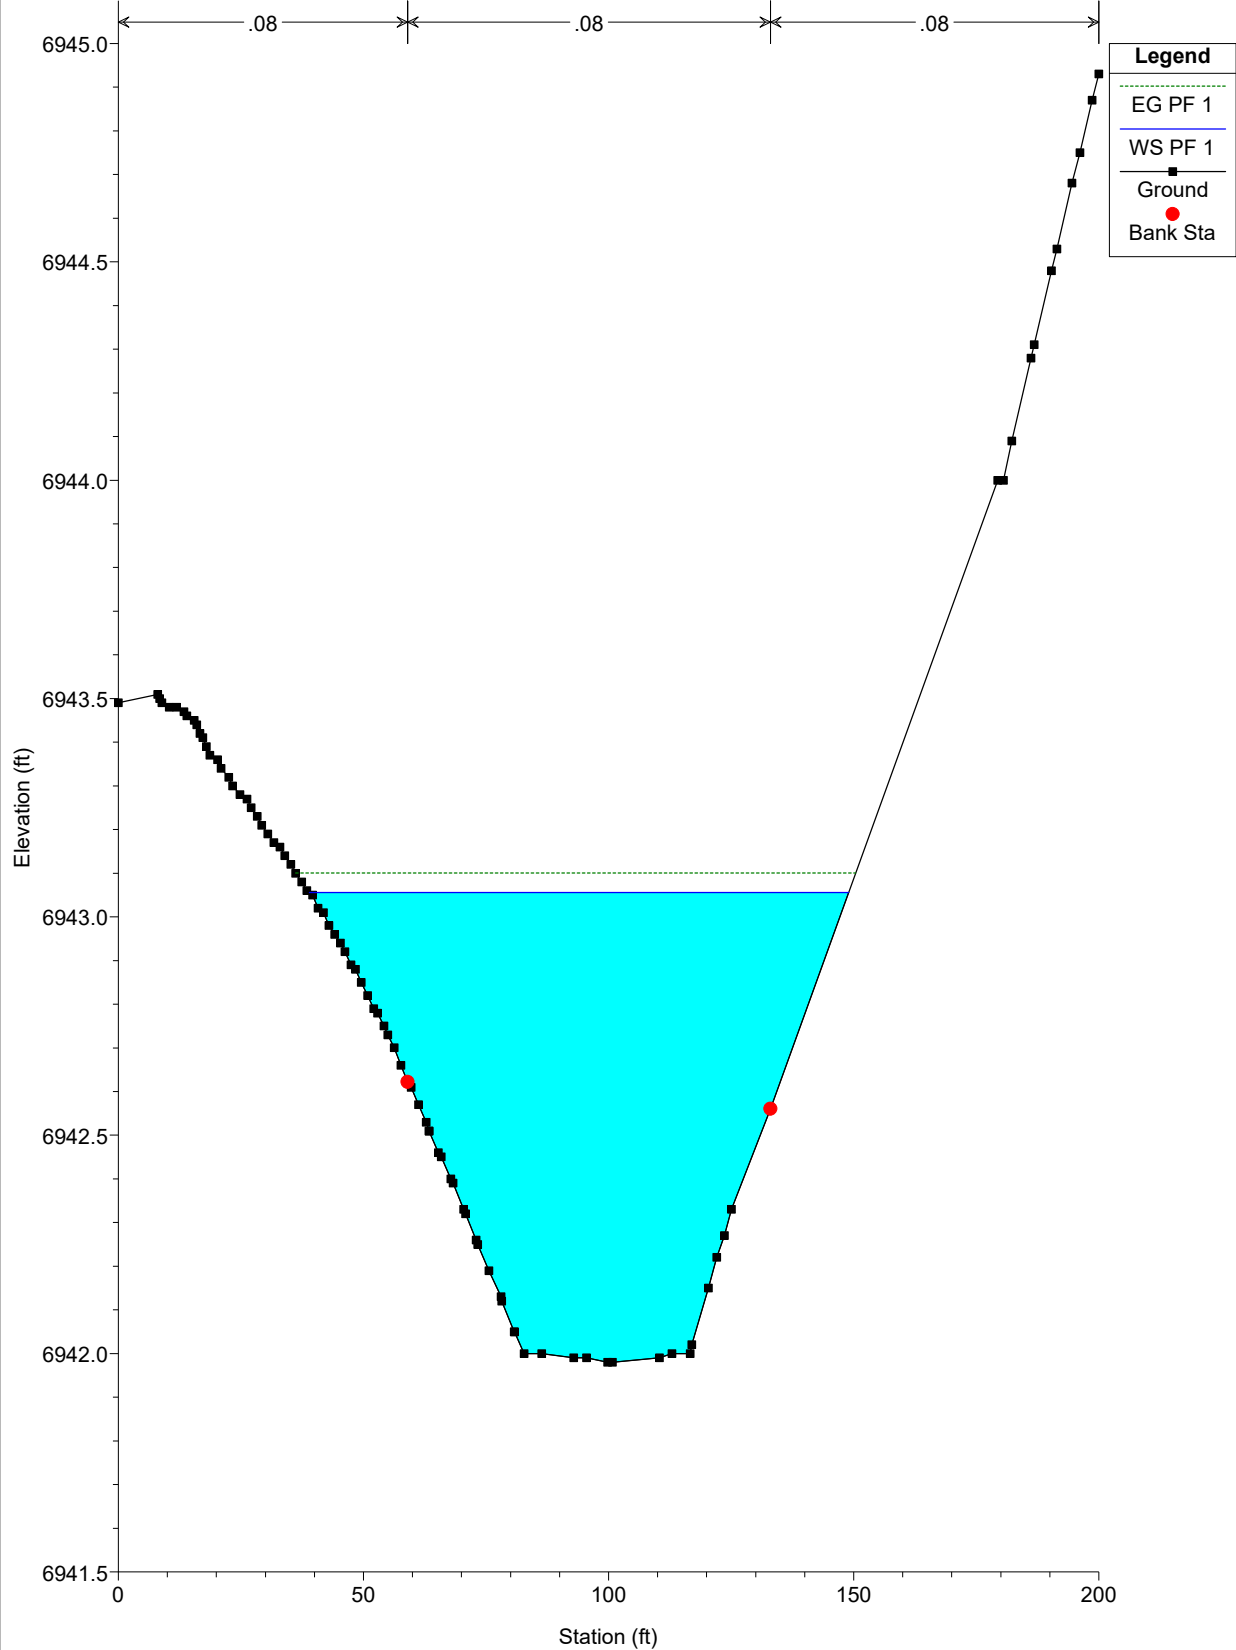


east chan pr PDR rev Plan: Plan 01 7/13/2022
2400

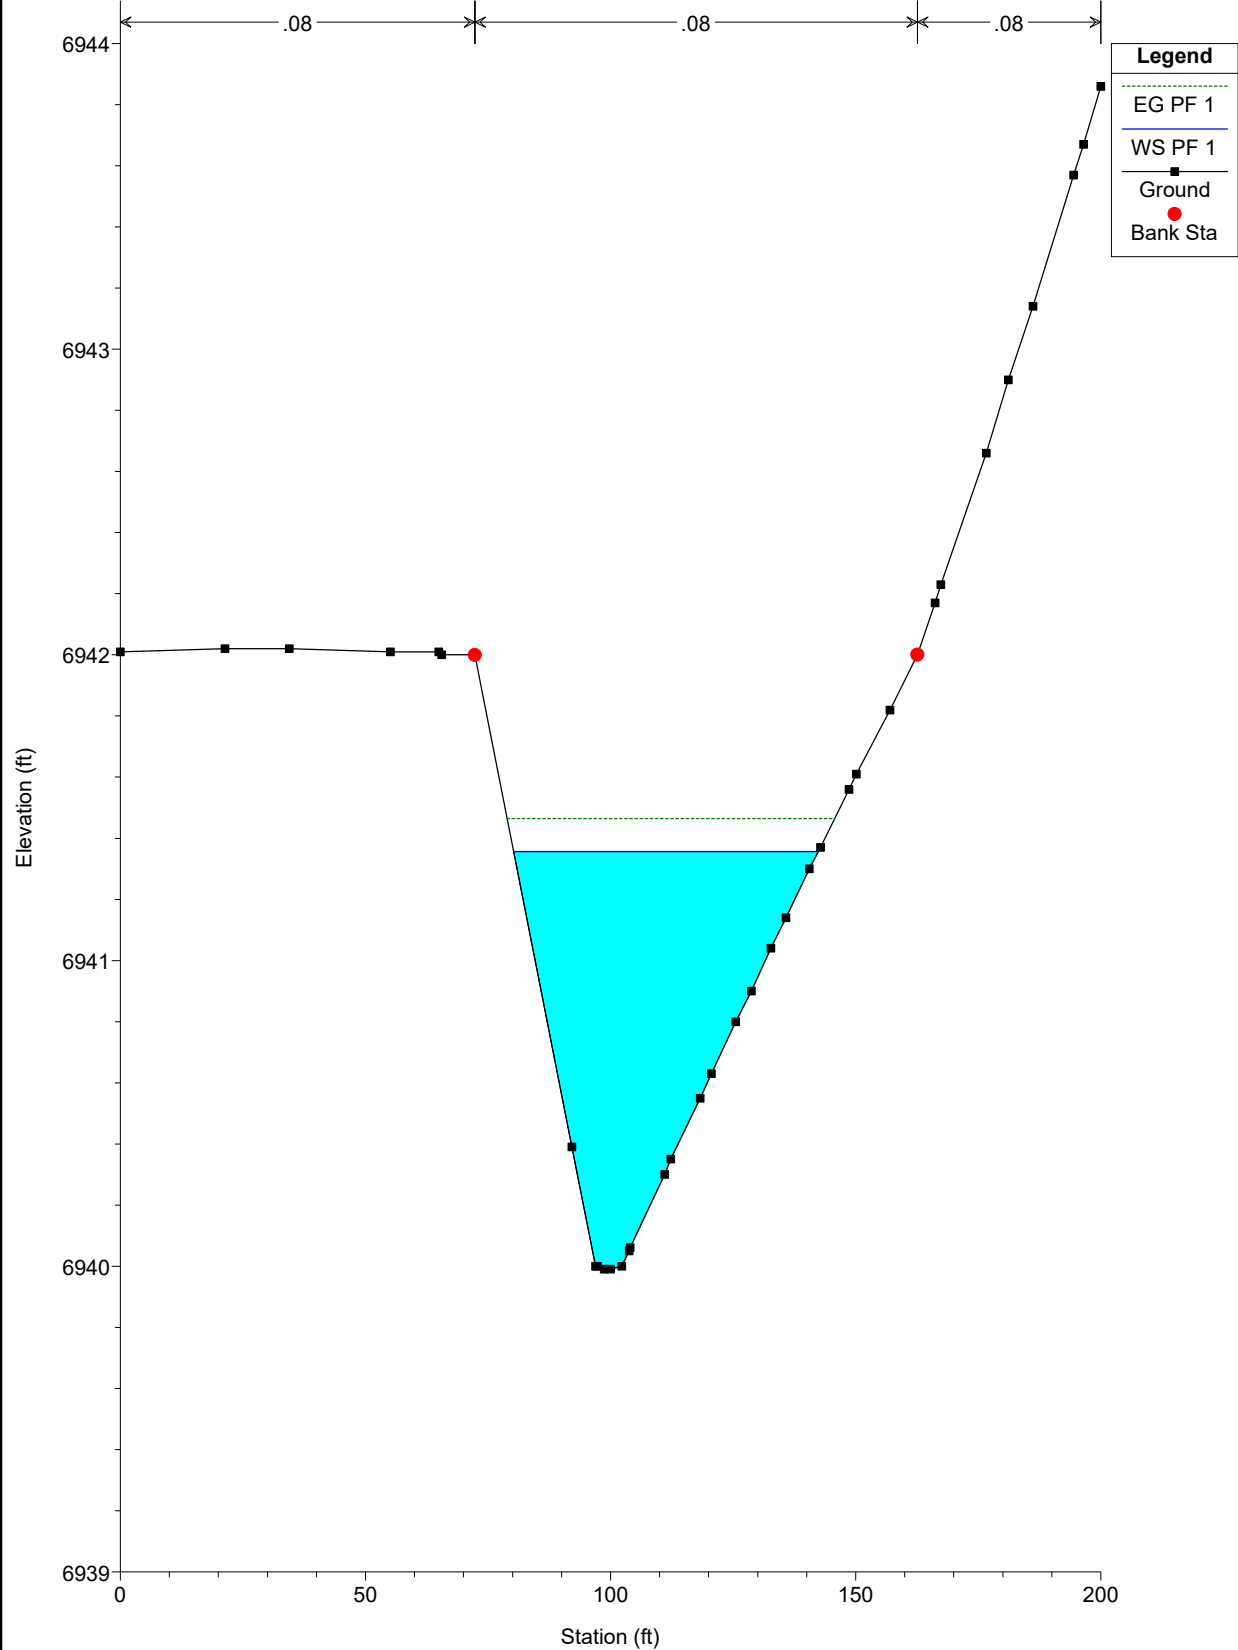


east chan pr PDR rev Plan: Plan 01 7/13/2022
2300

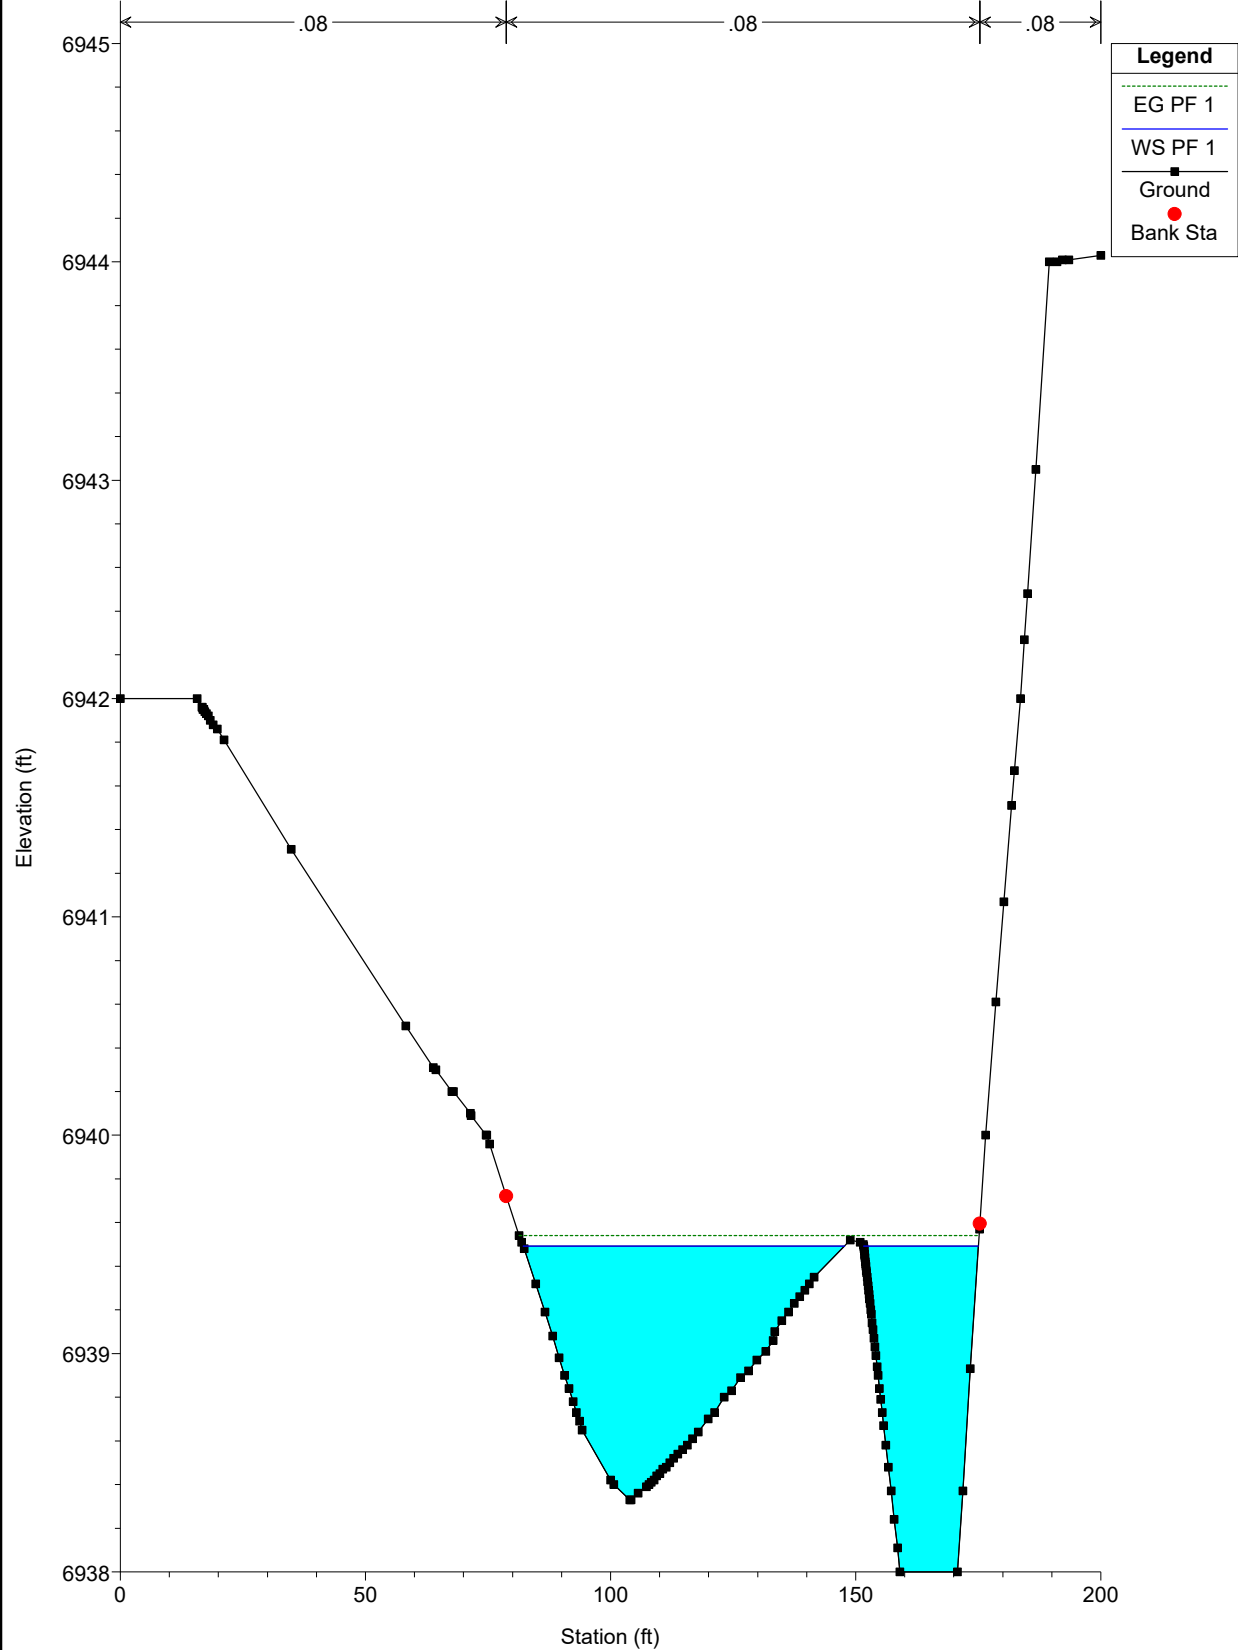

east chan pr PDR rev Plan: Plan 01 7/13/2022
2200

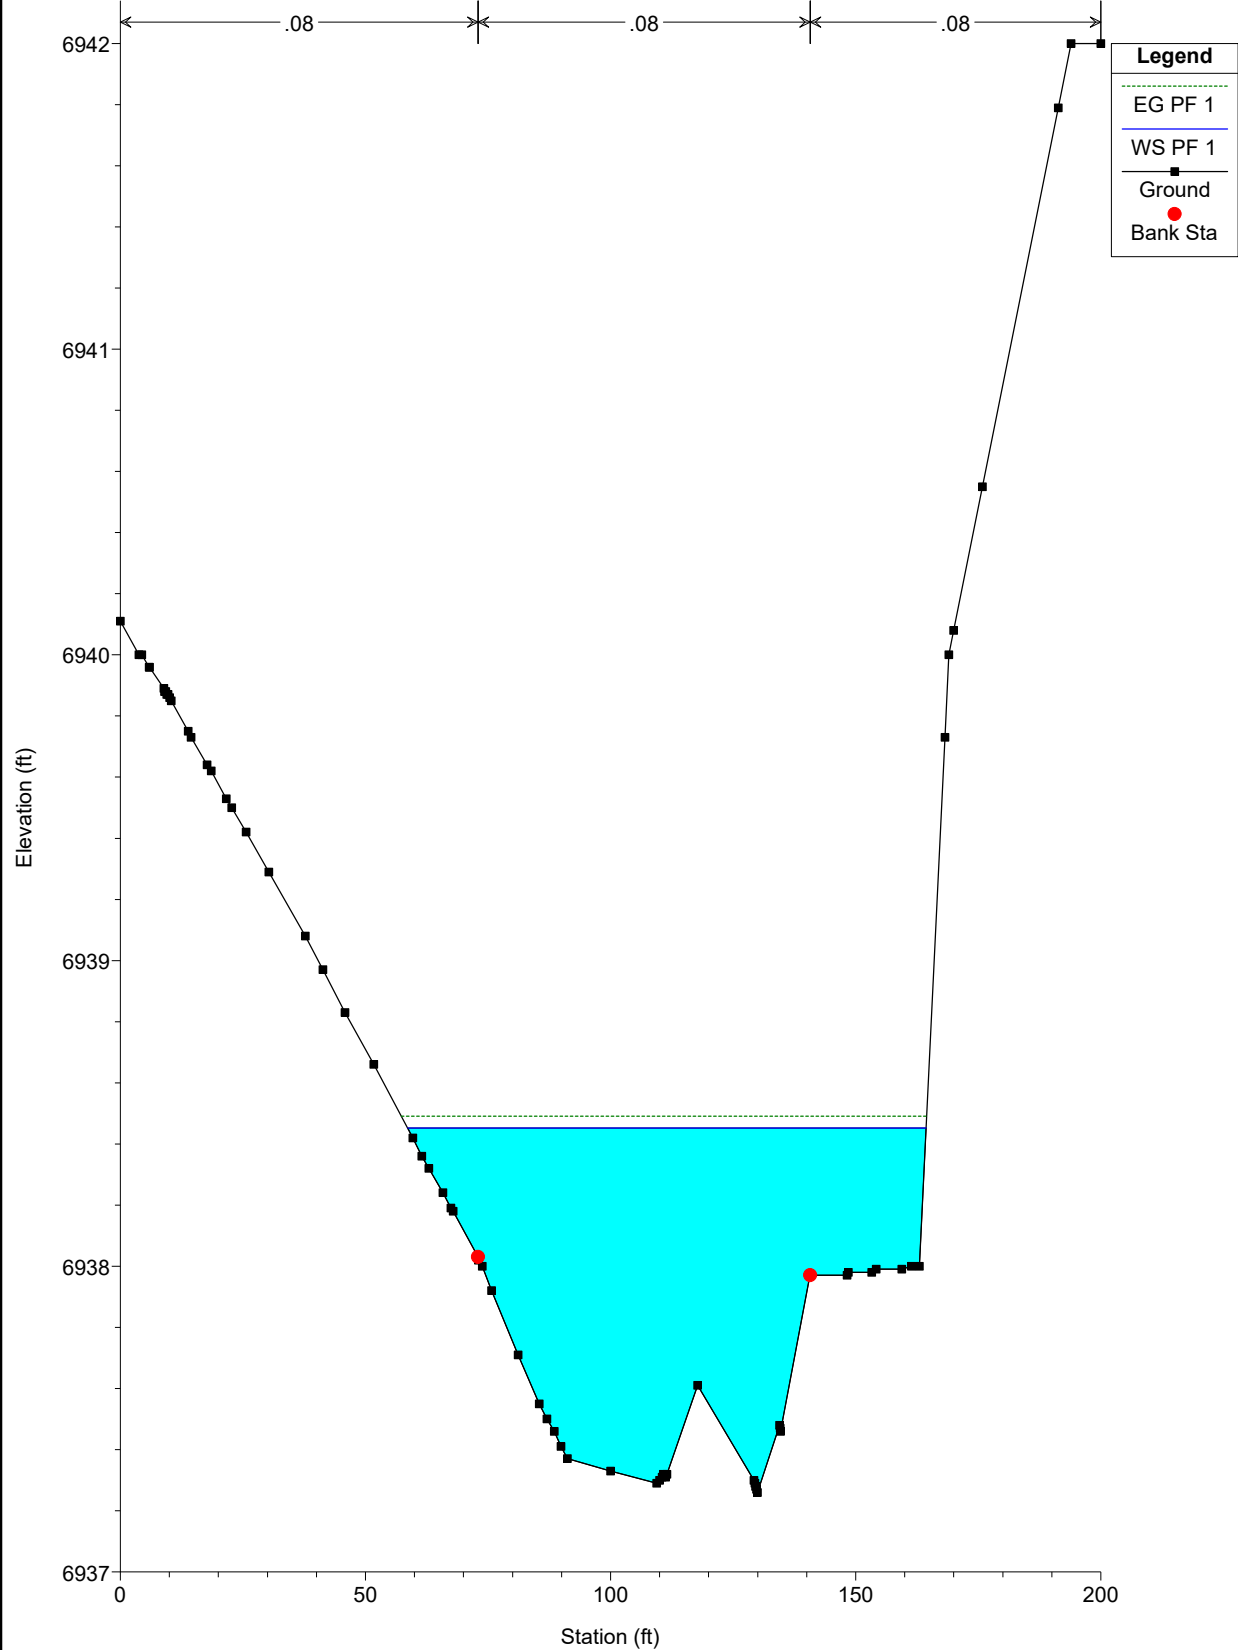


east chan pr PDR rev Plan: Plan 01 7/13/2022
2100

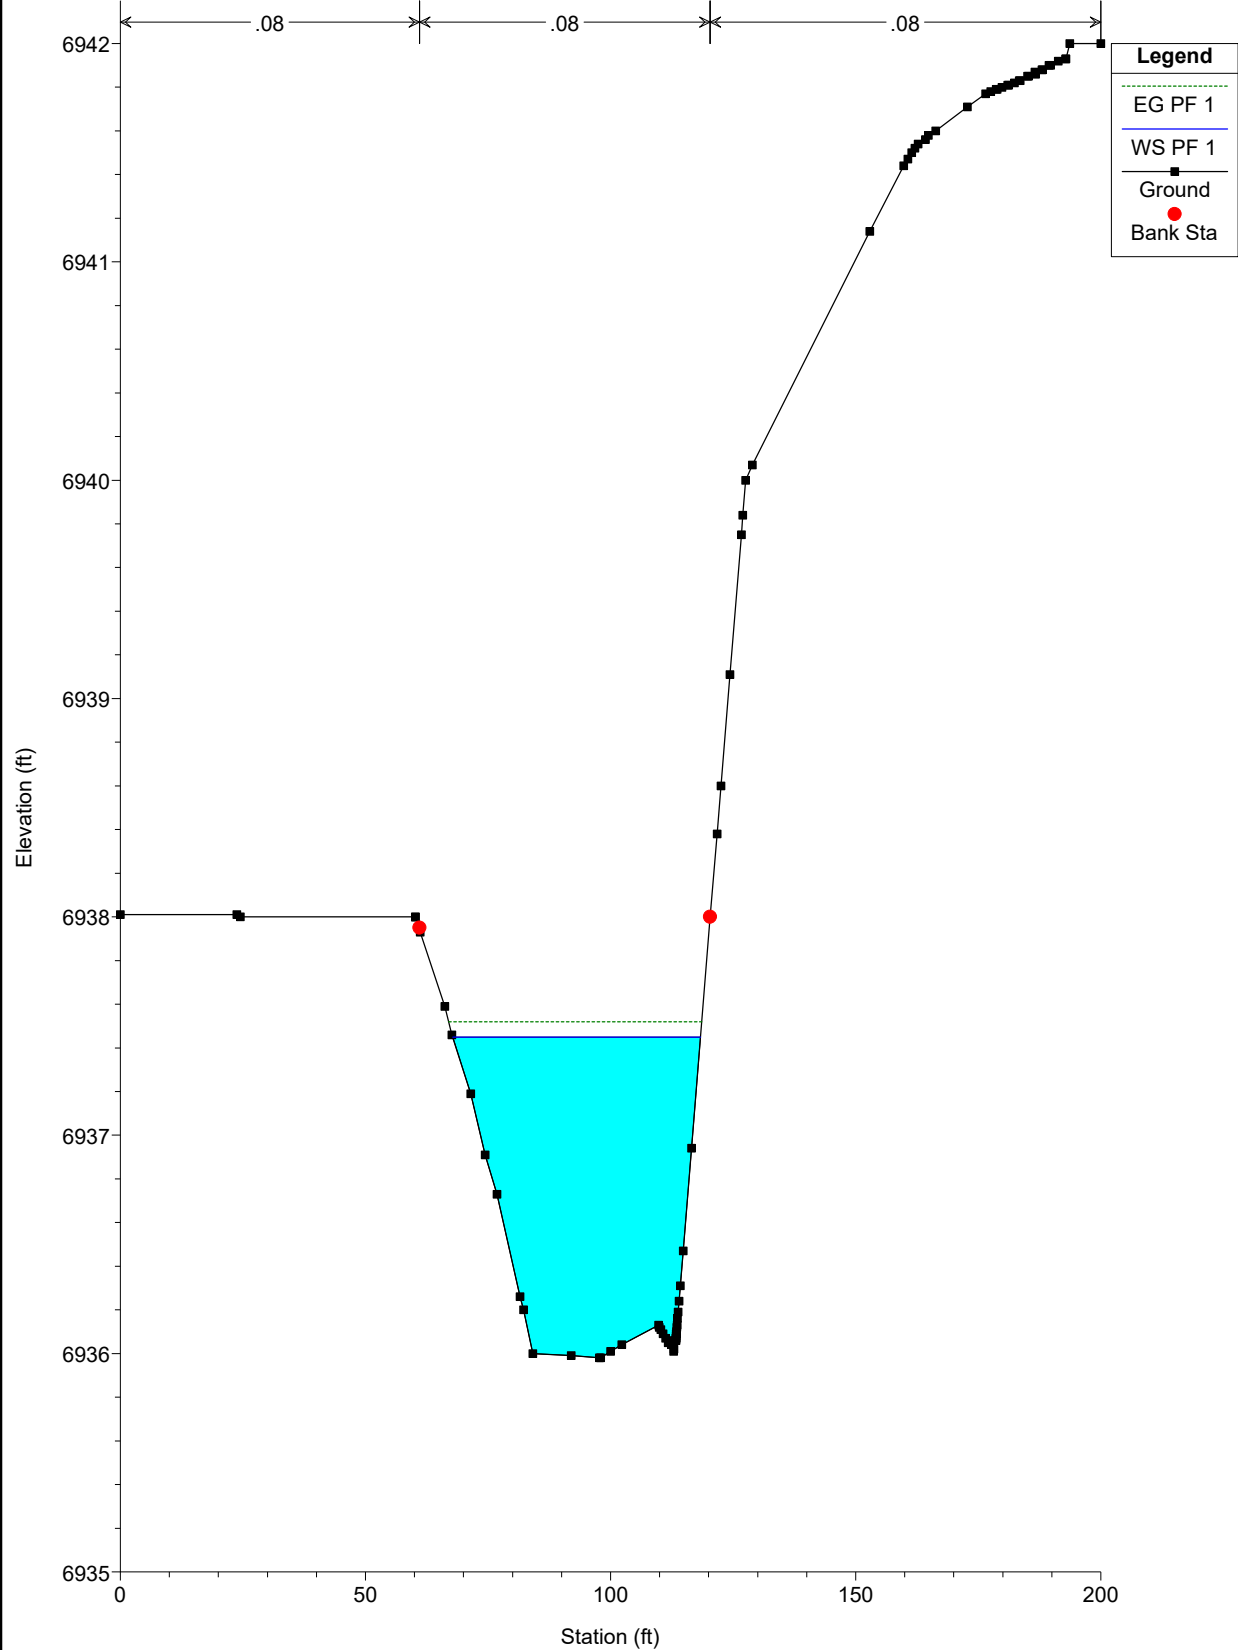


east chan pr PDR rev Plan: Plan 01 7/13/2022

2010.89

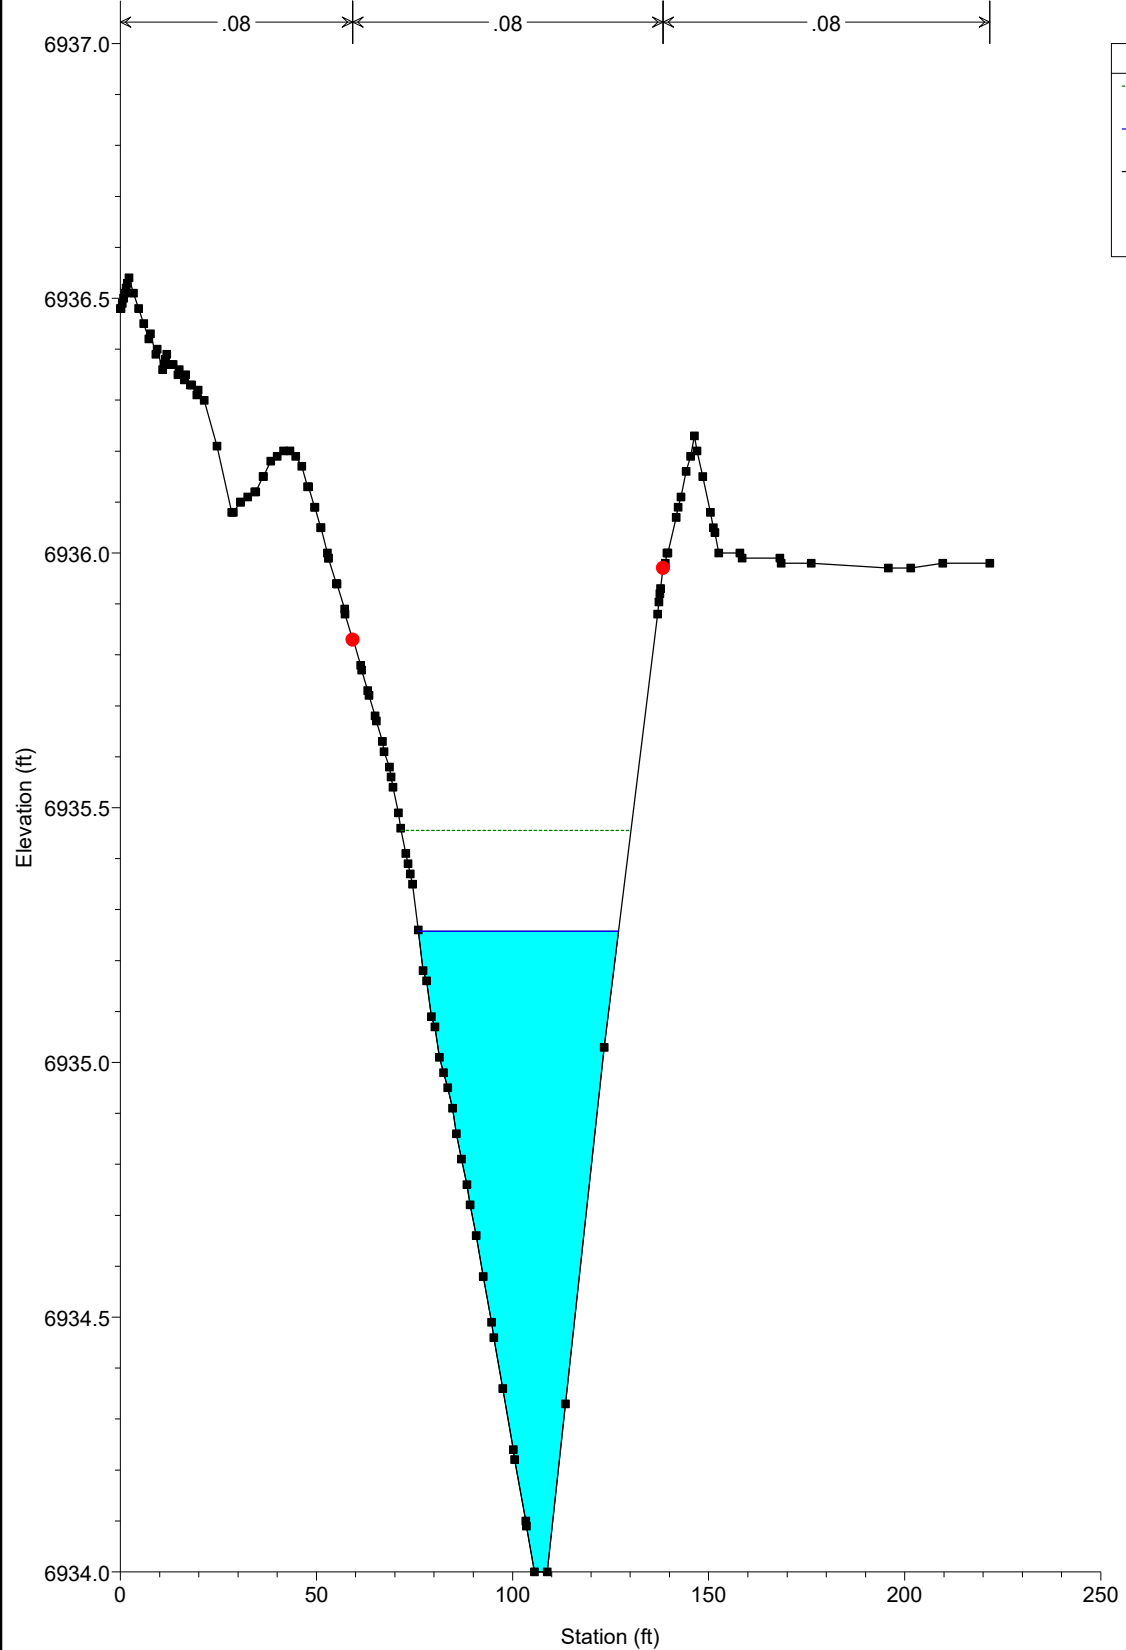


east chan pr PDR rev Plan: Plan 01 7/13/2022
1900

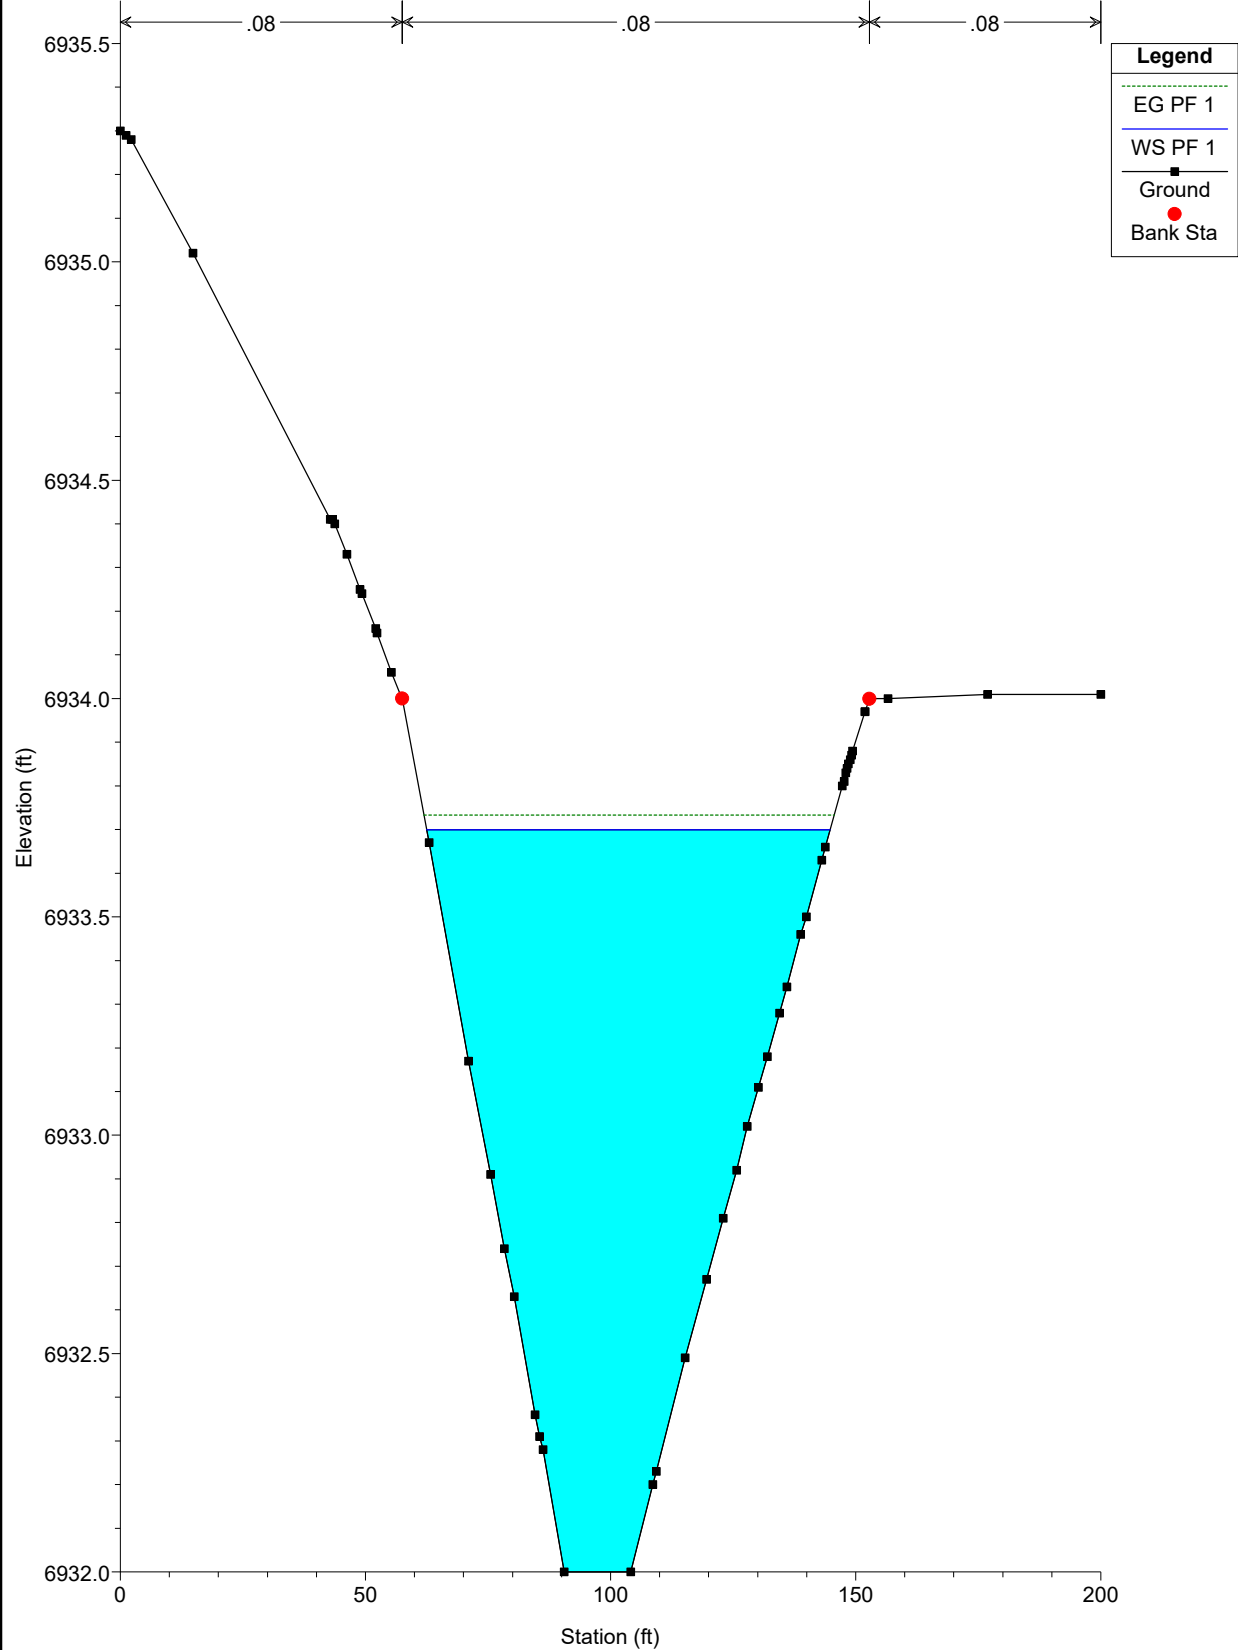


east chan pr PDR rev Plan: Plan 01 7/13/2022

1801.17

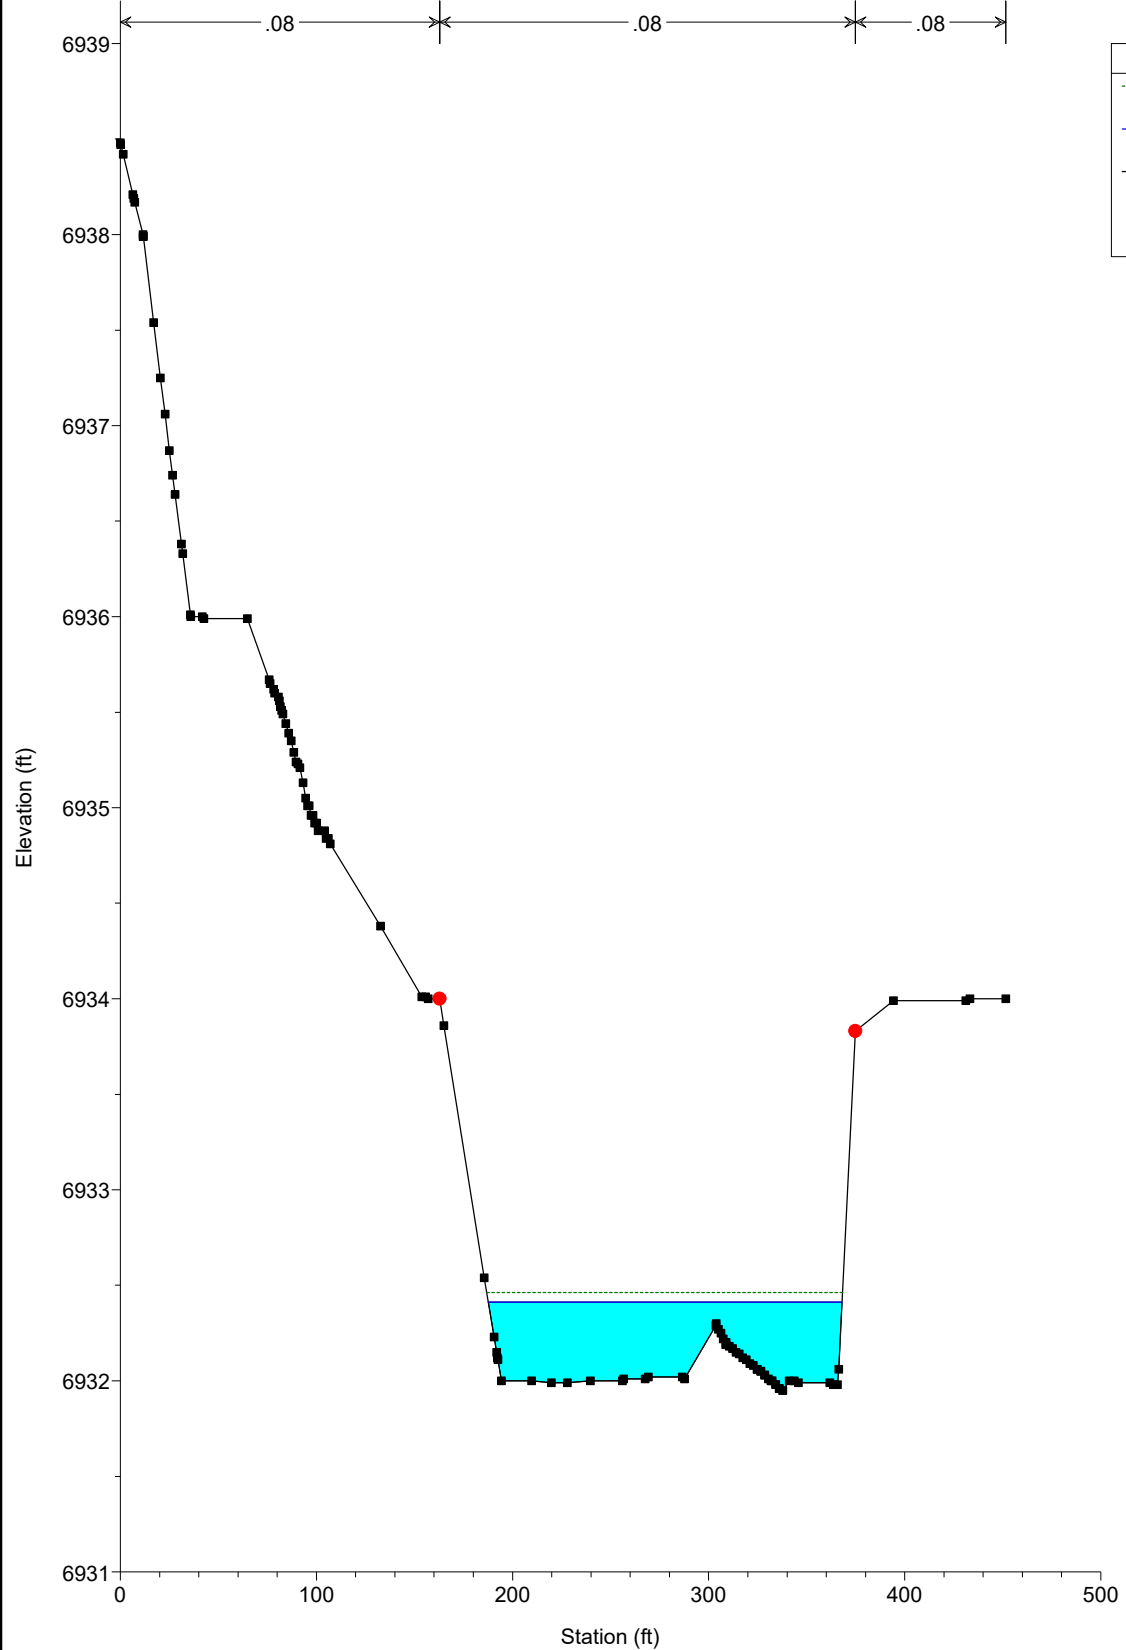



east chan pr PDR rev Plan: Plan 01 7/13/2022


1694.83

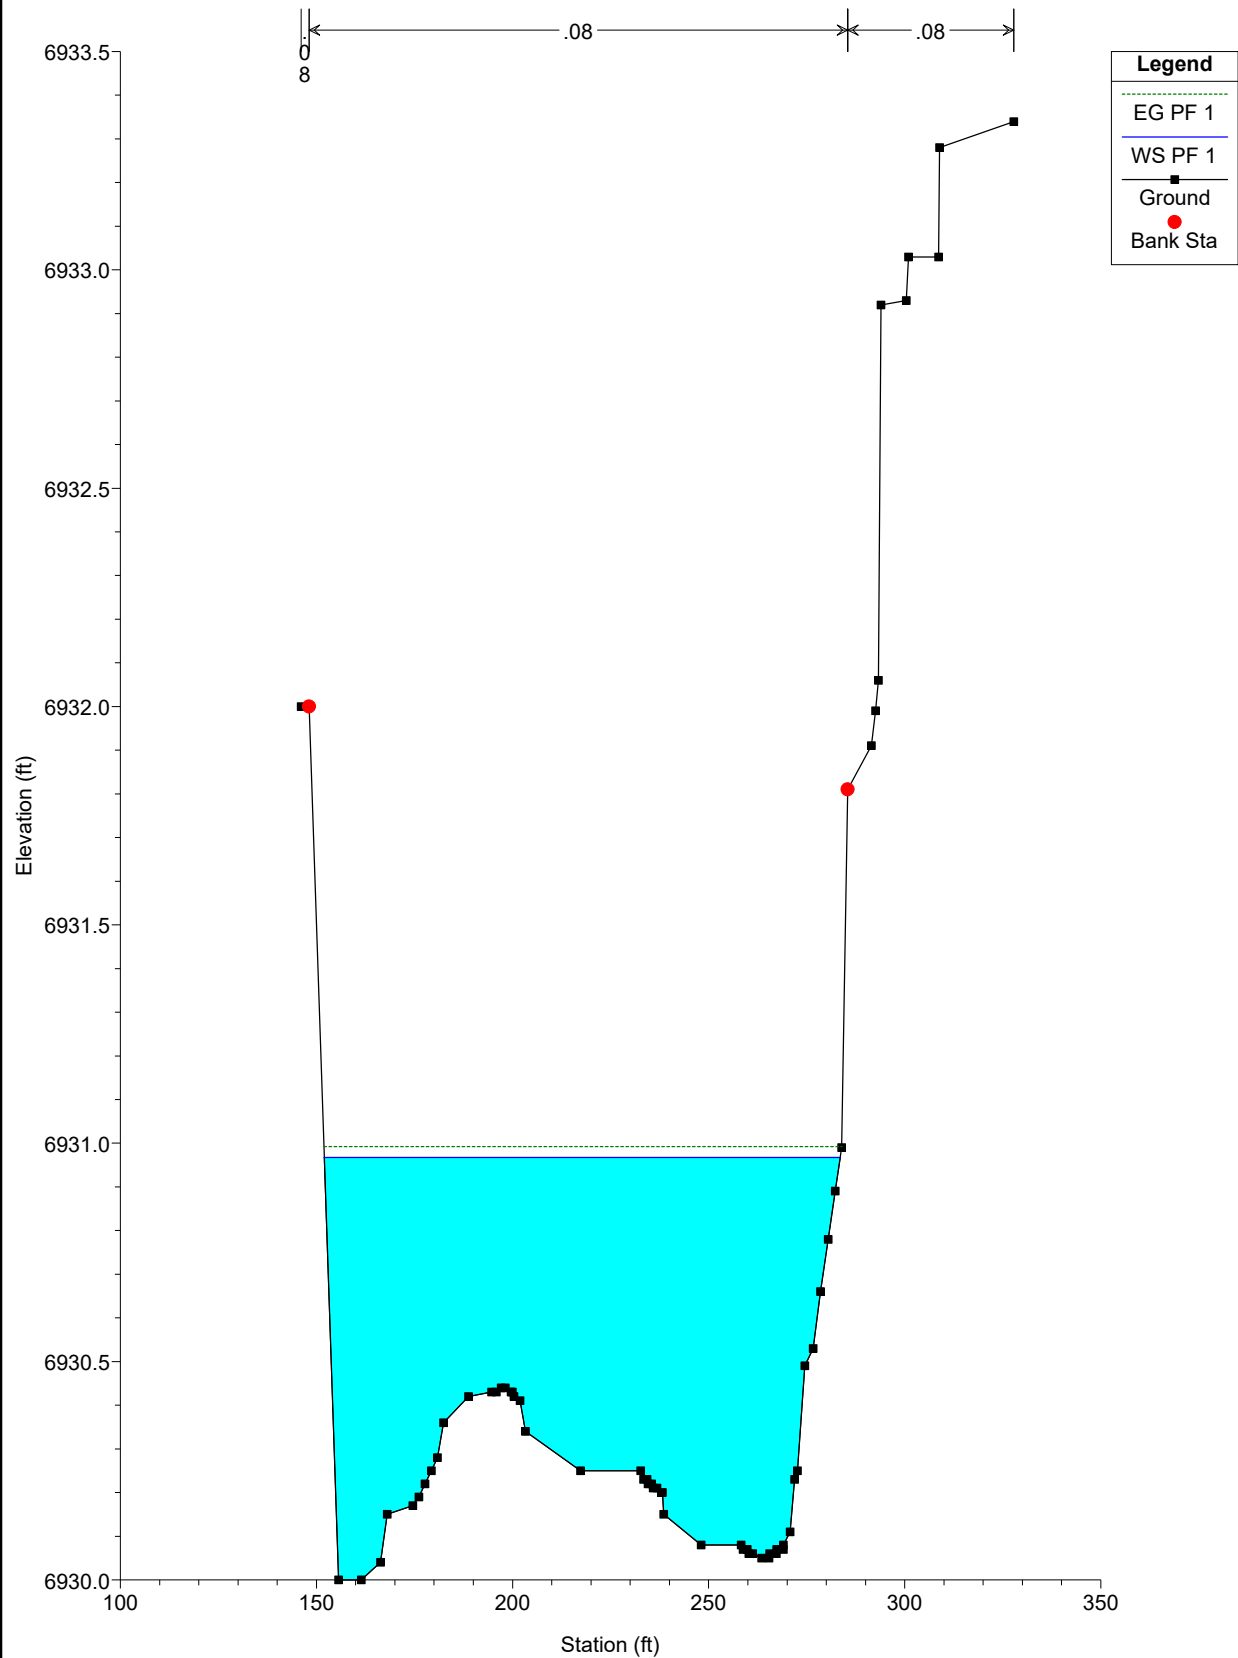


east chan pr PDR rev Plan: Plan 01 7/13/2022
1600

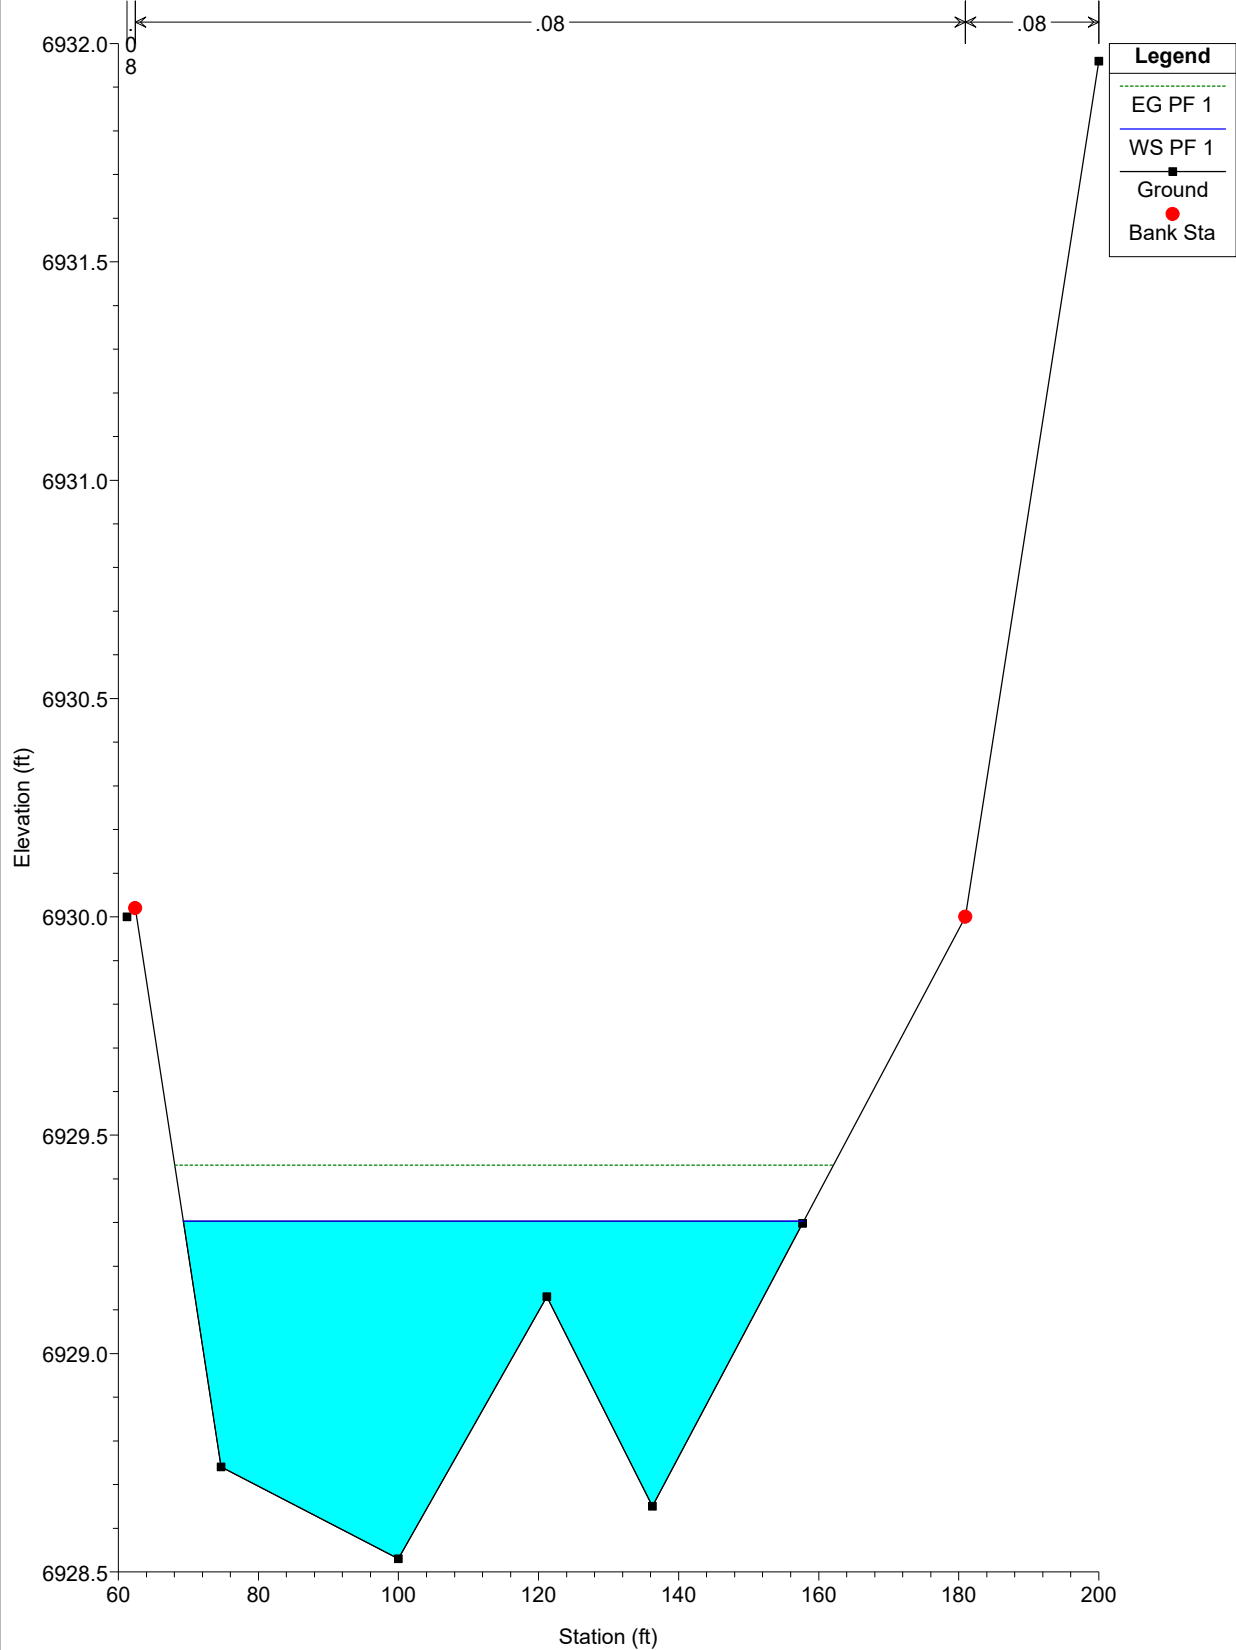


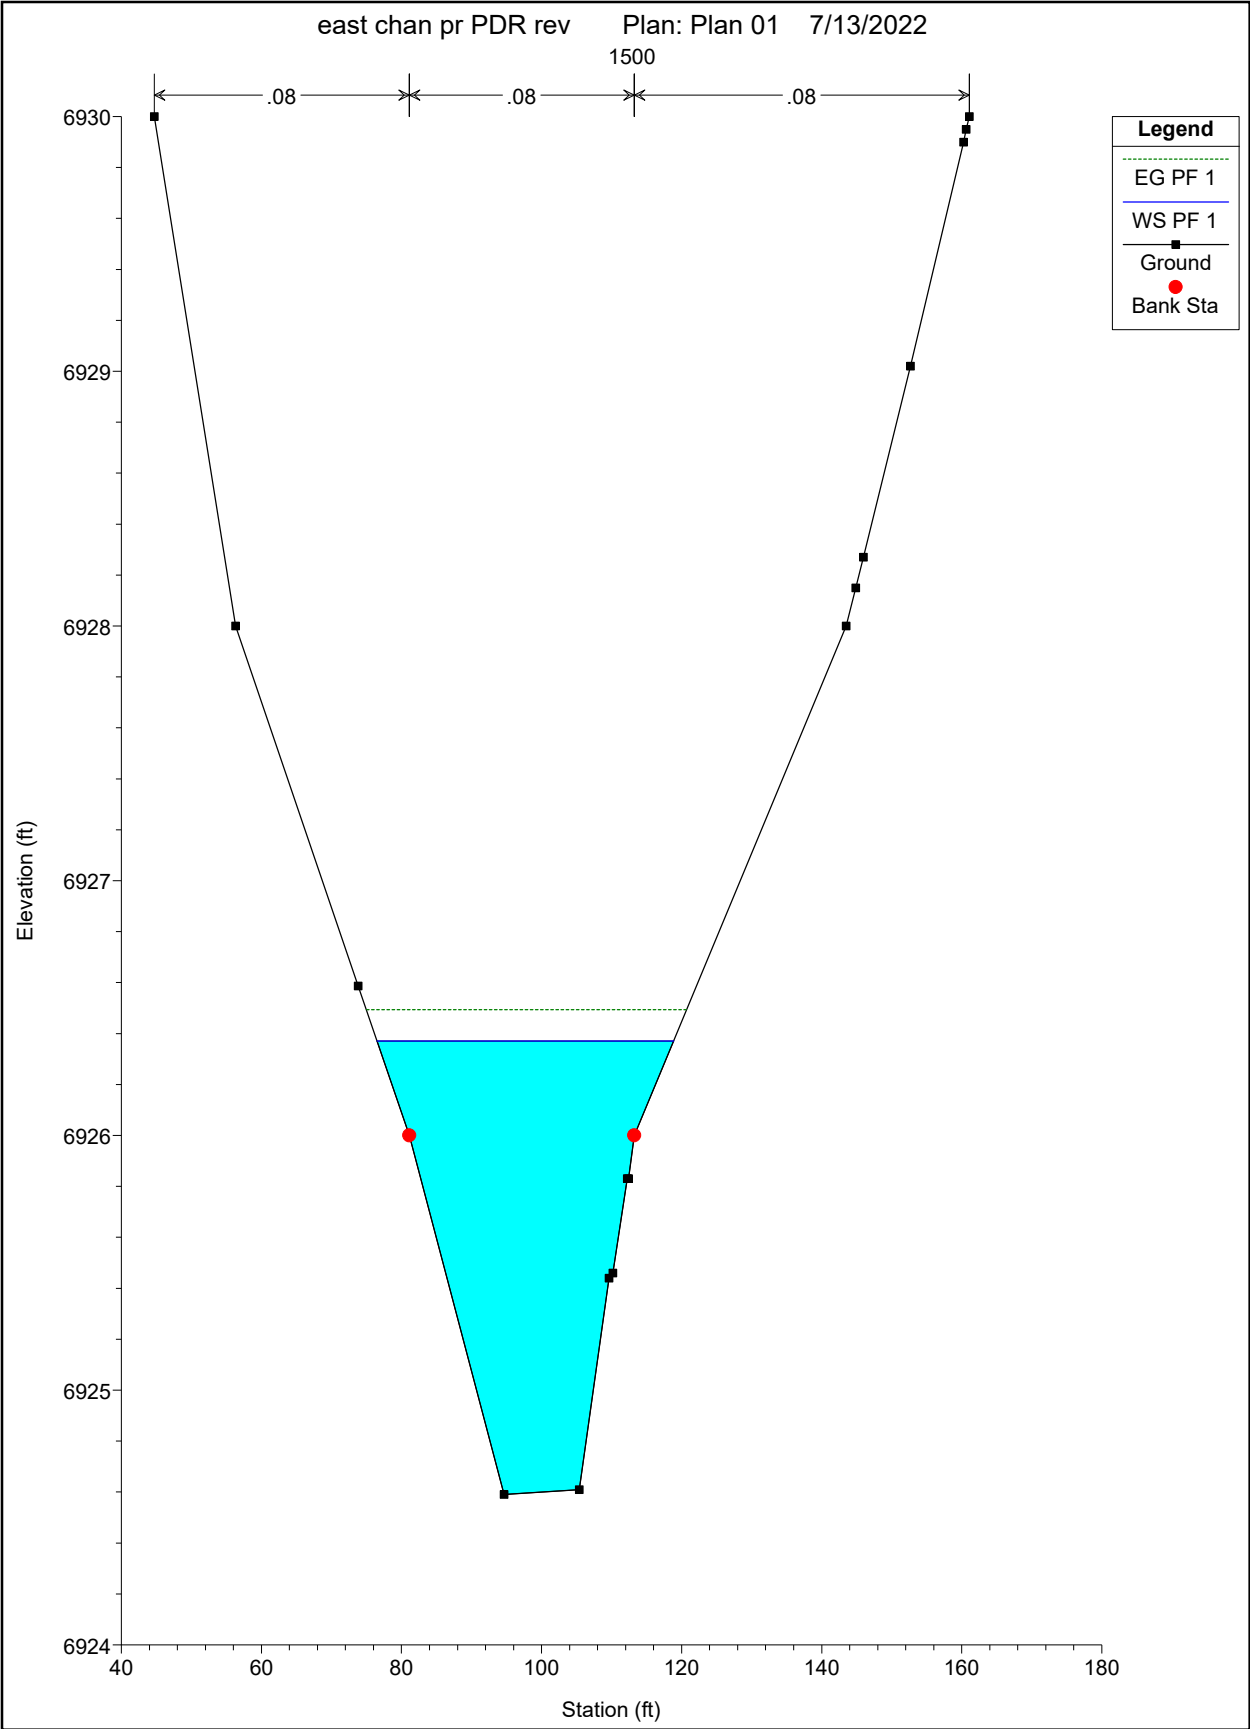

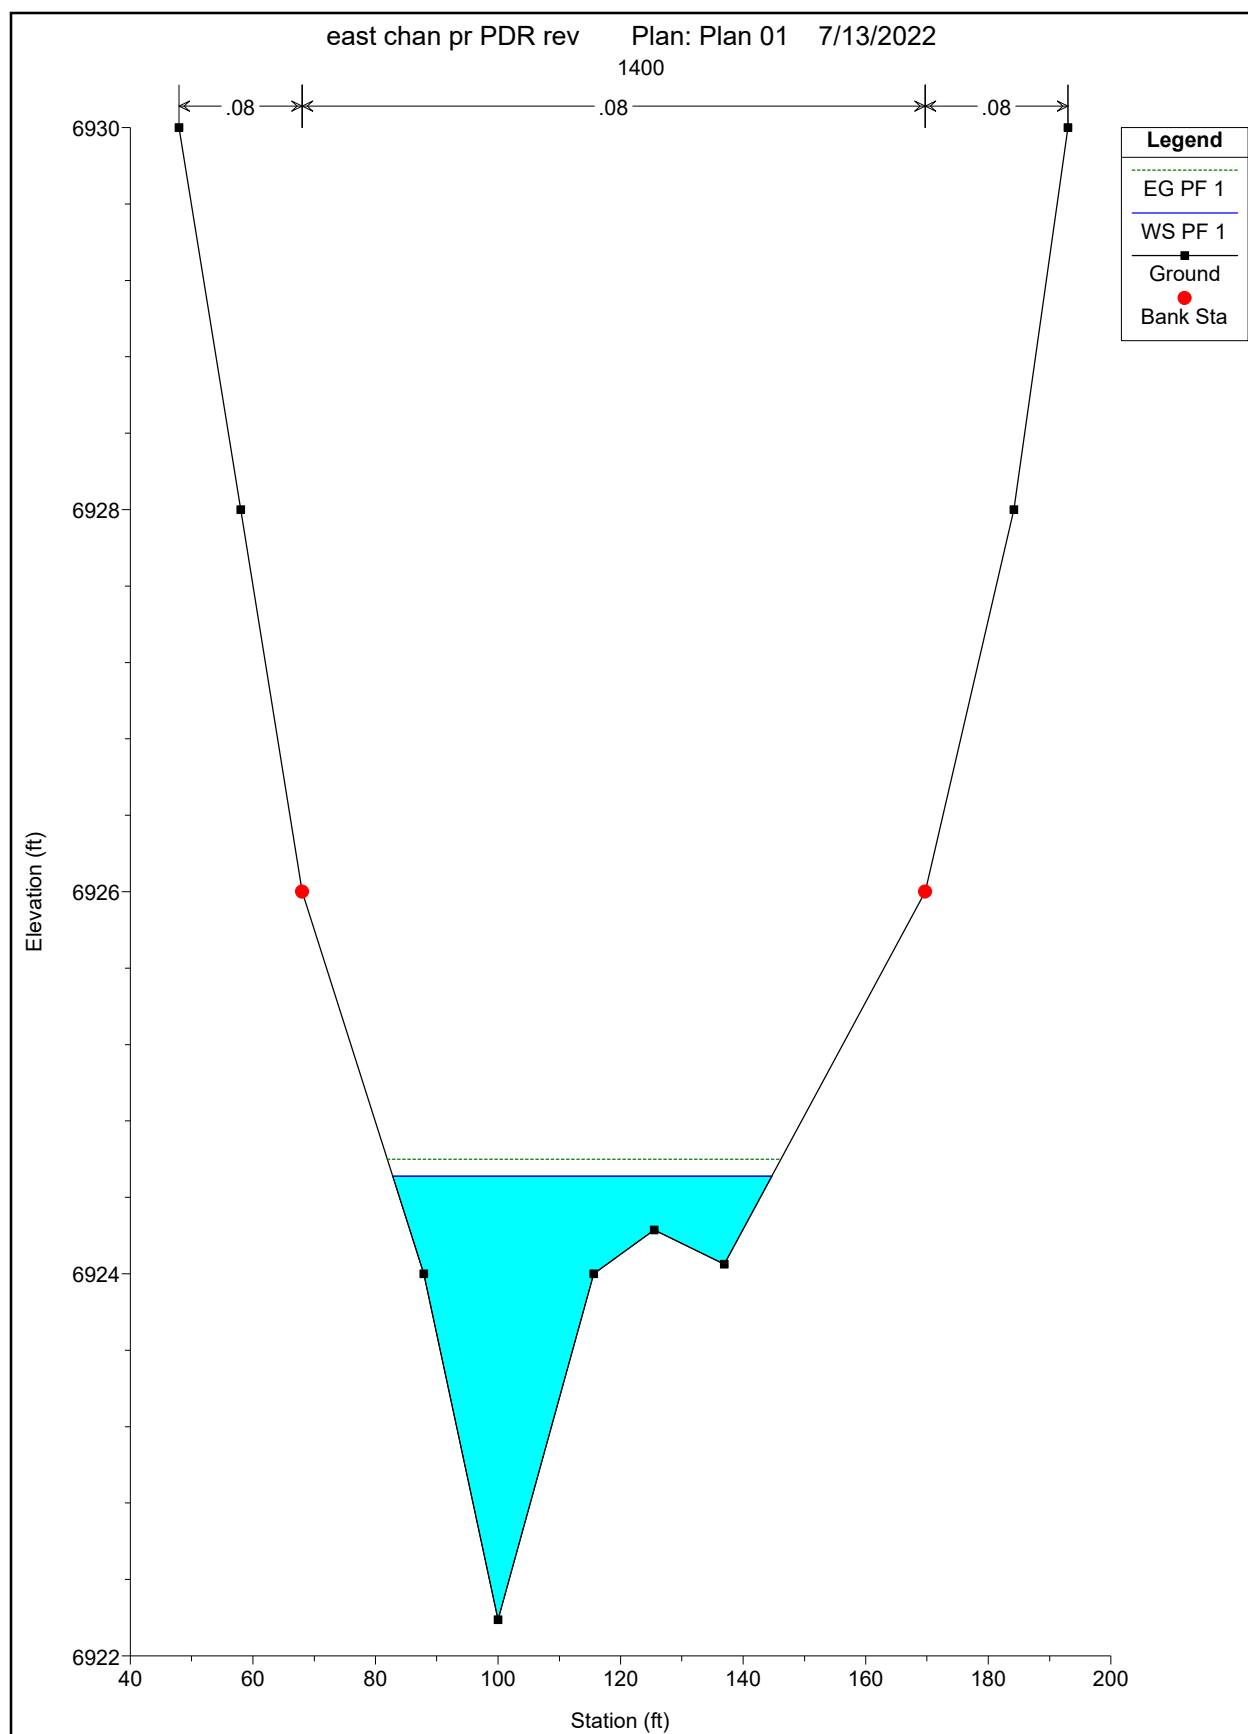


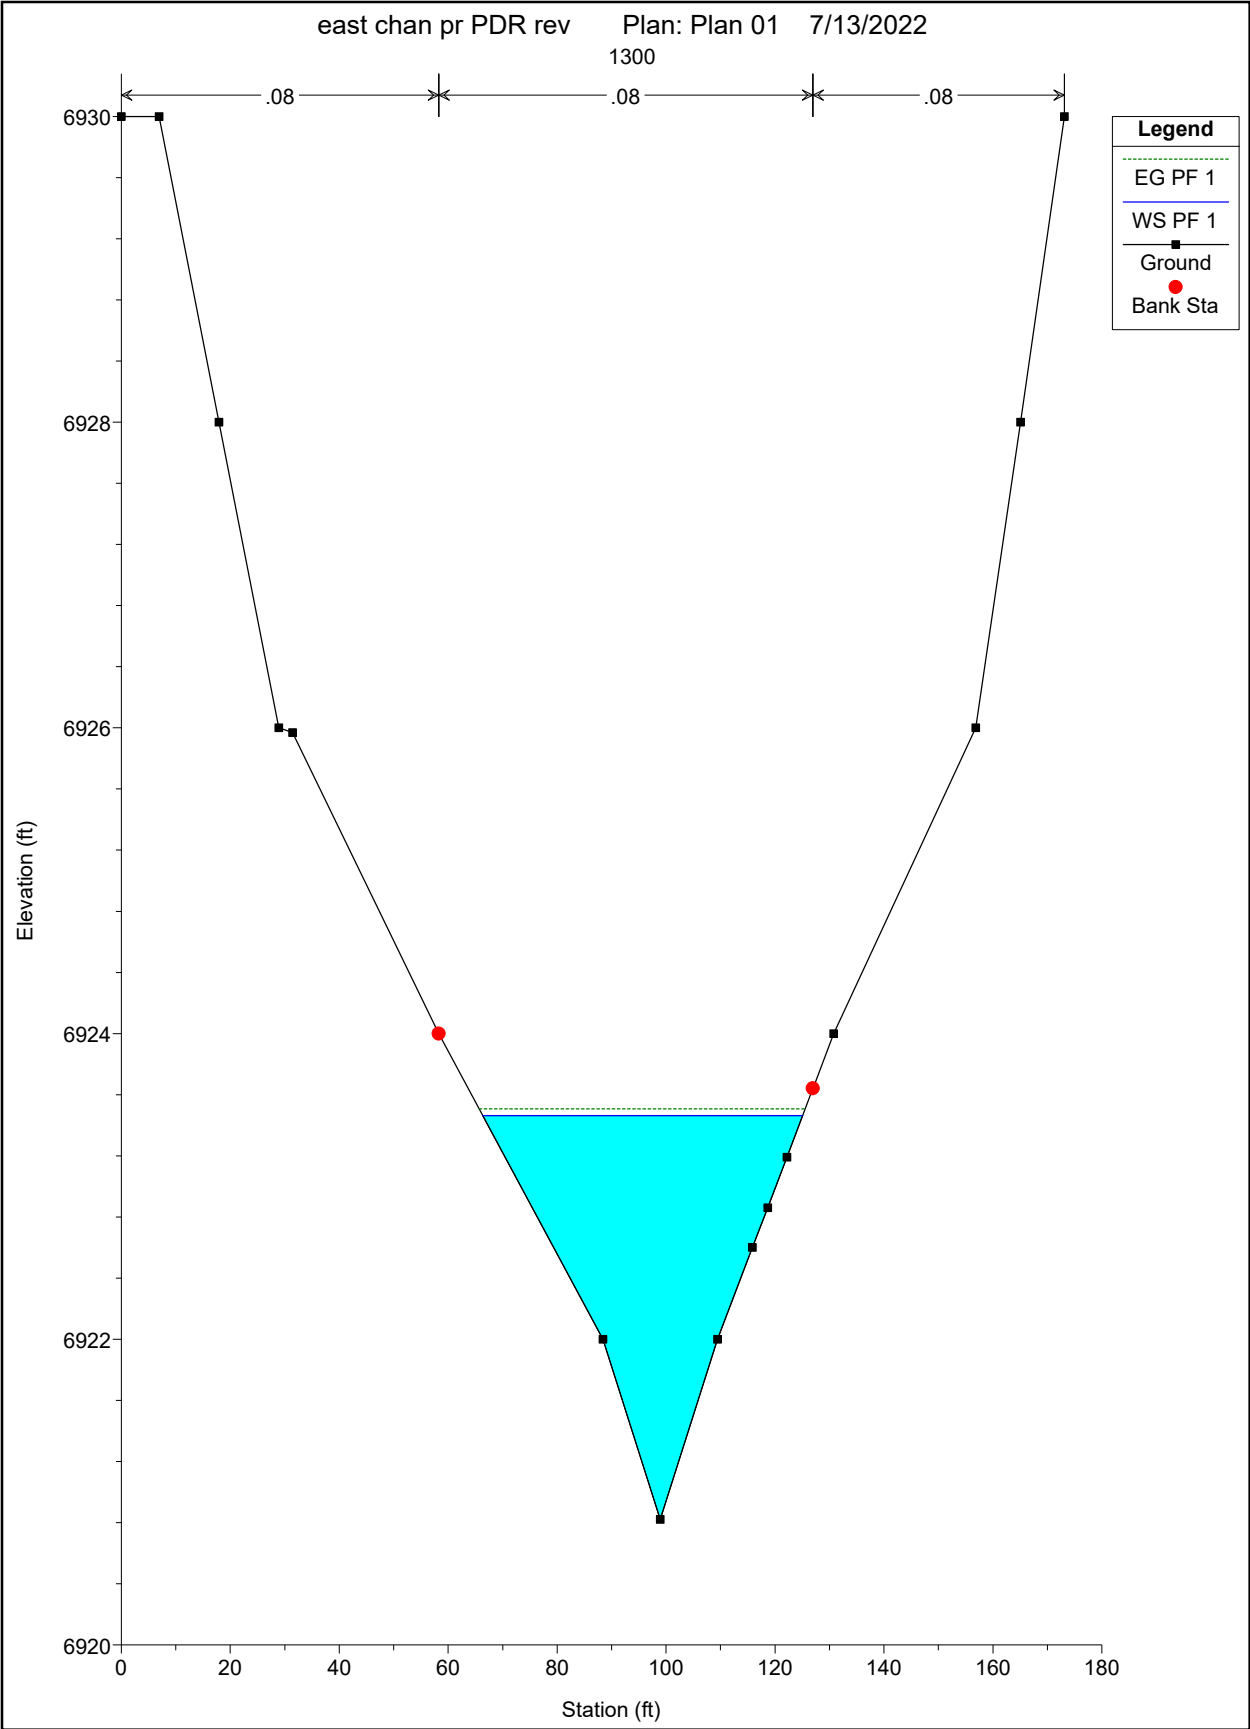


east chan pr PDR rev Plan: Plan 01 7/13/2022
1200

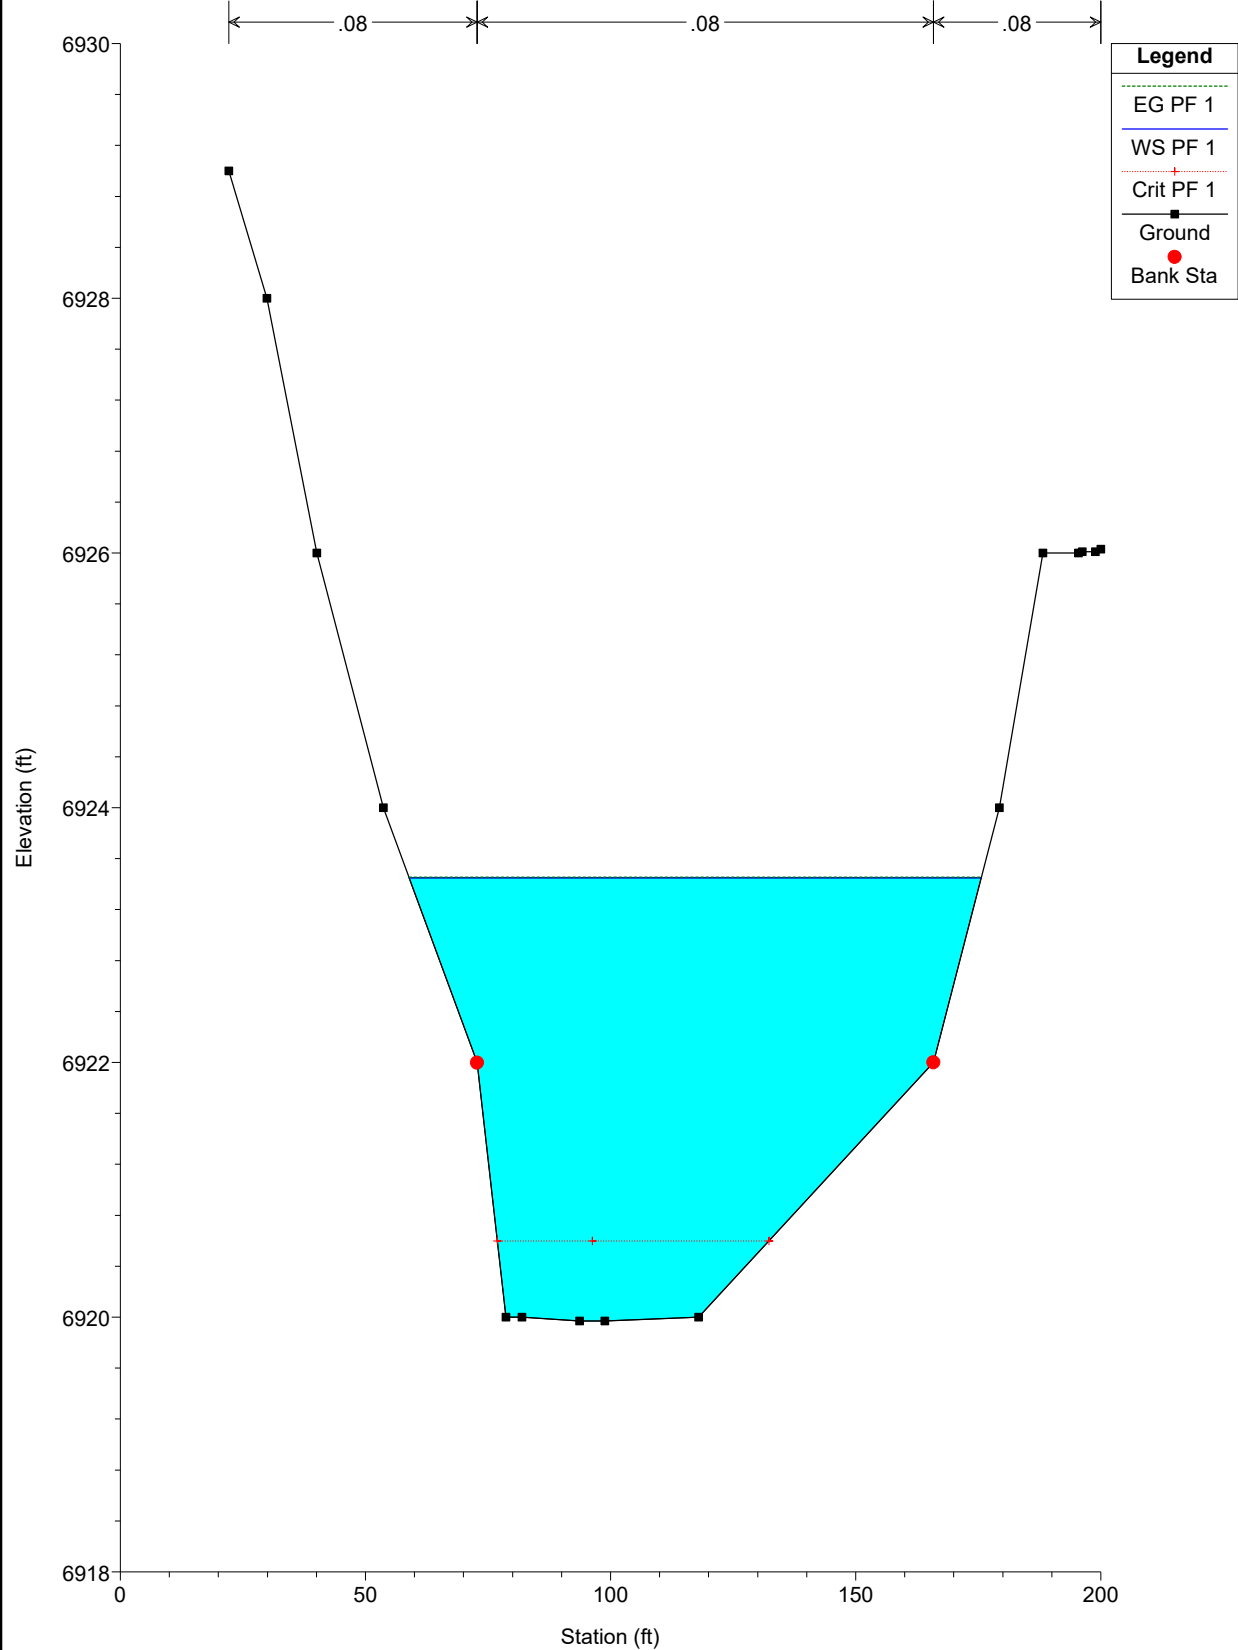


east chan pr PDR rev Plan: Plan 01 7/13/2022

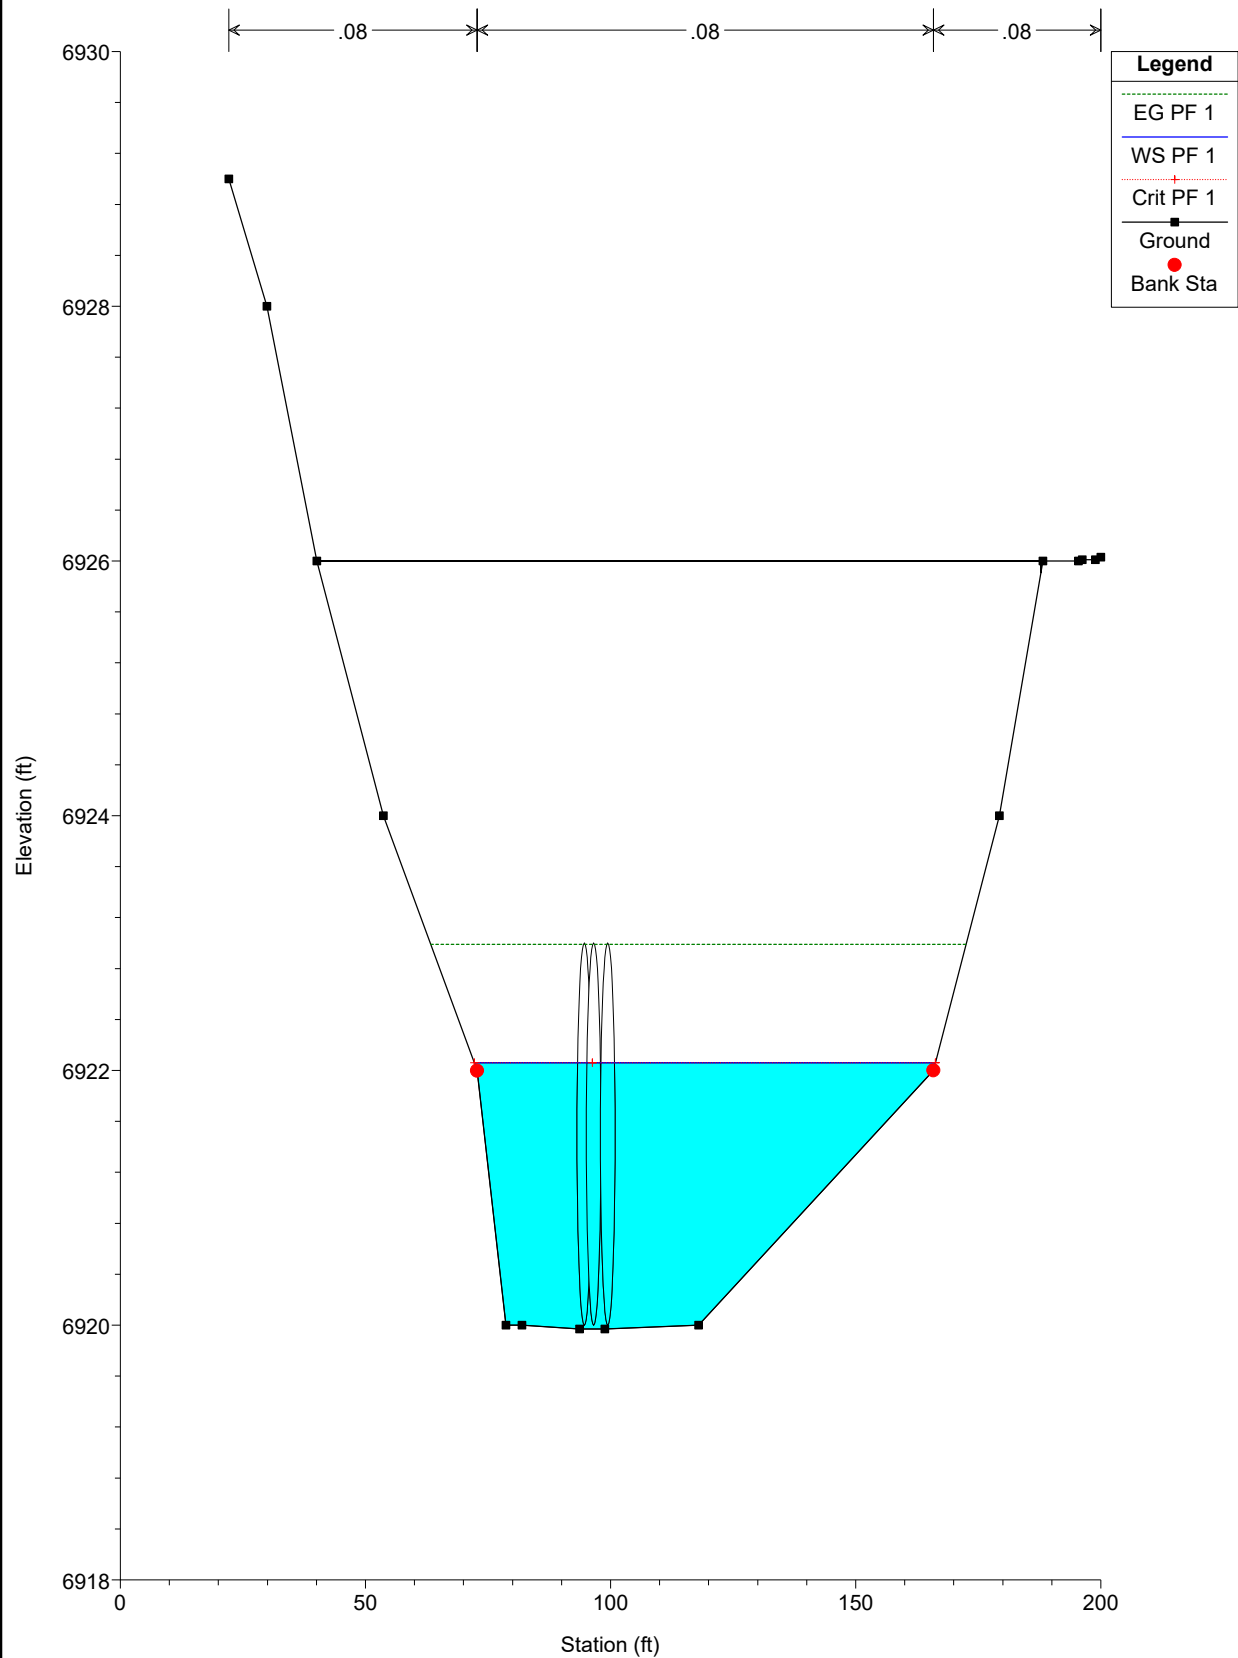


east chan pr PDR rev Plan: Plan 01 7/13/2022
1000

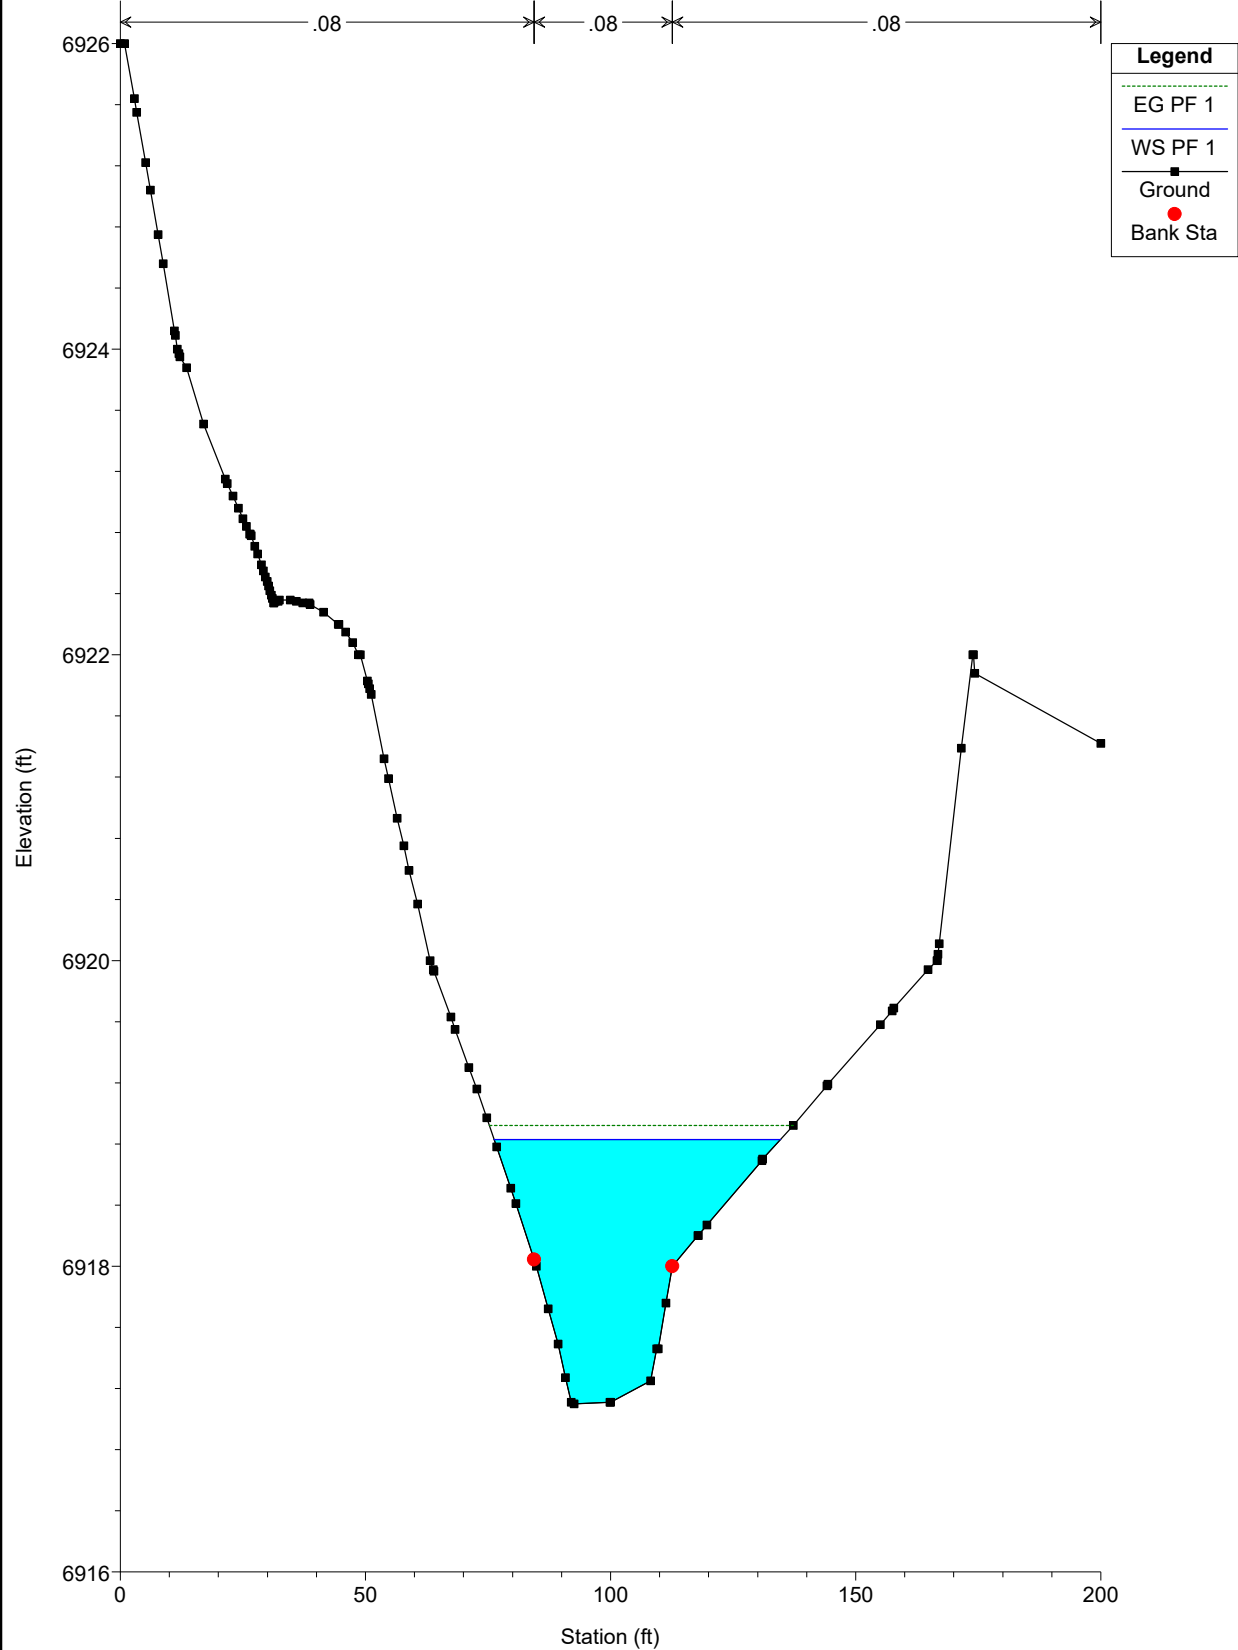


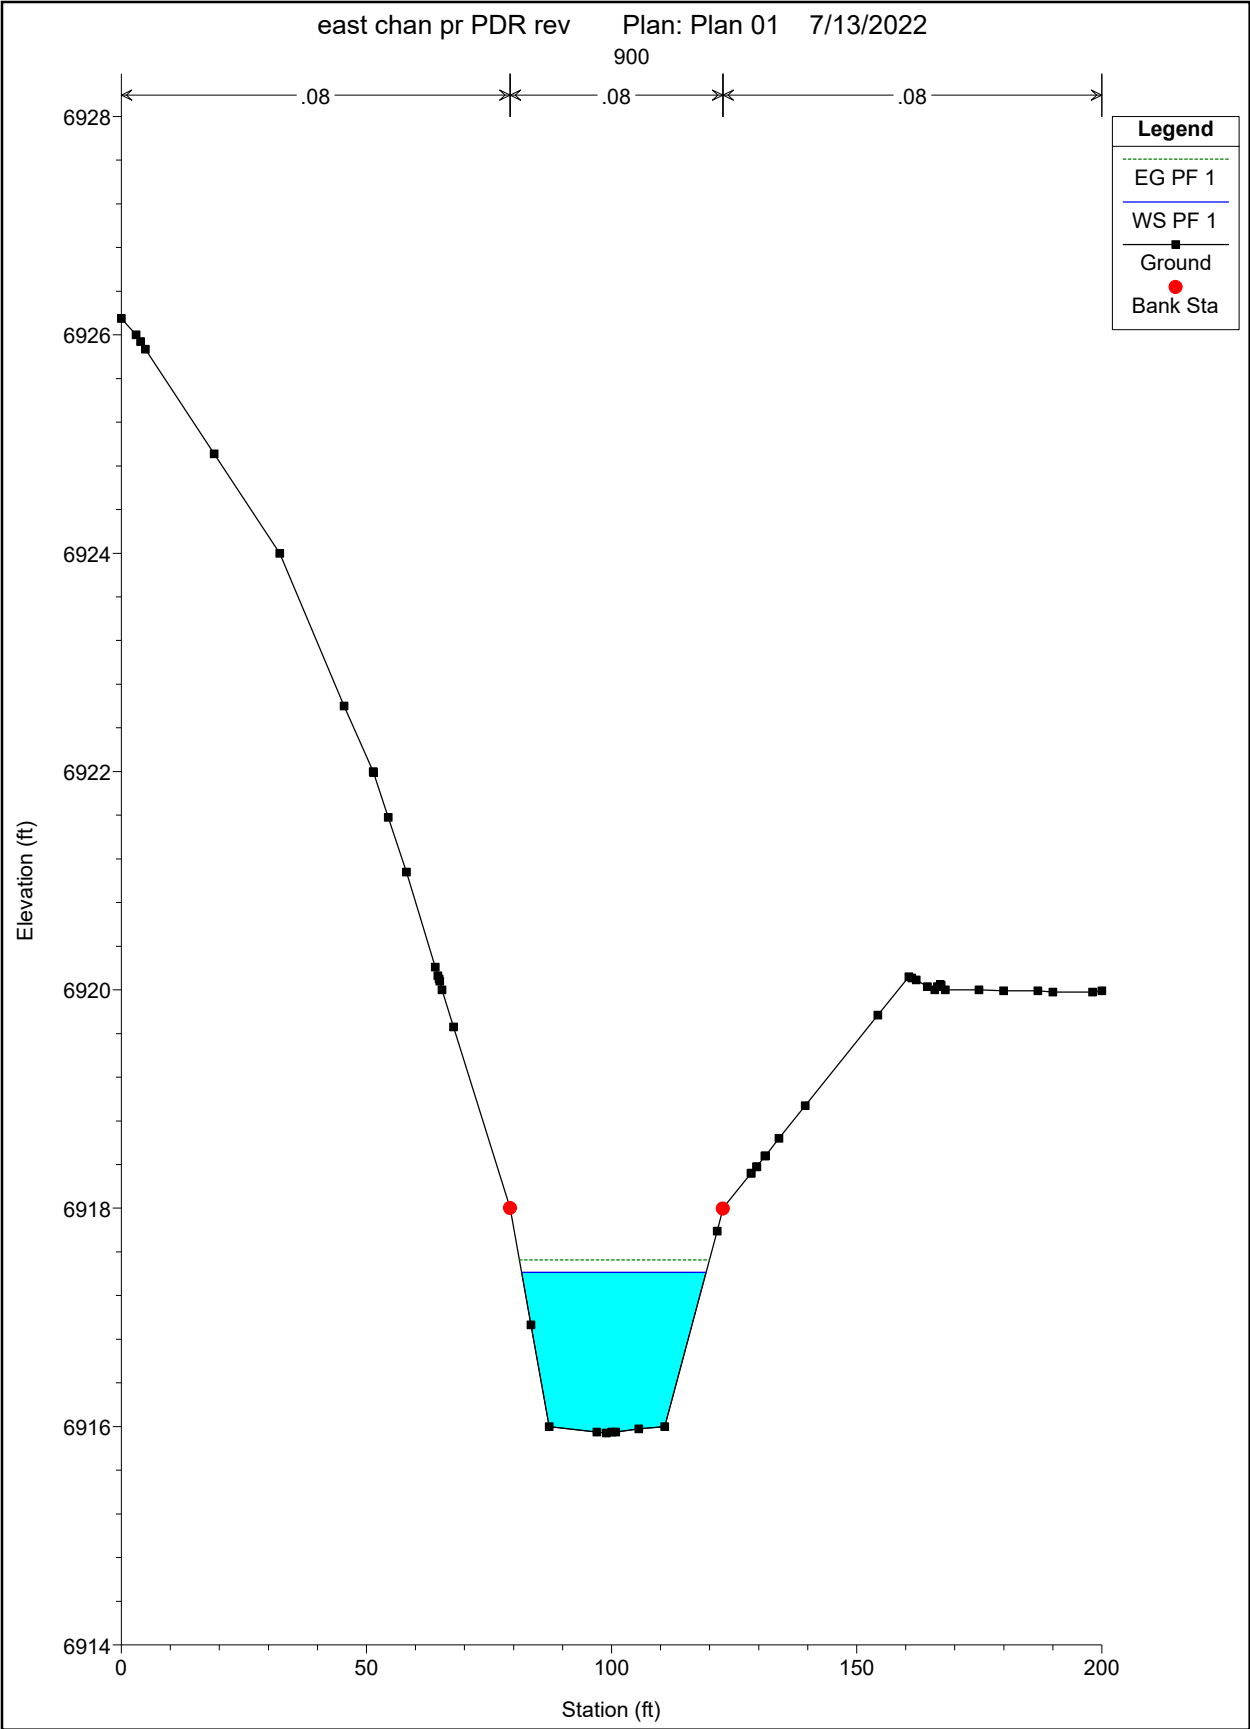


east chan pr PDR rev Plan: Plan 01 7/13/2022
800

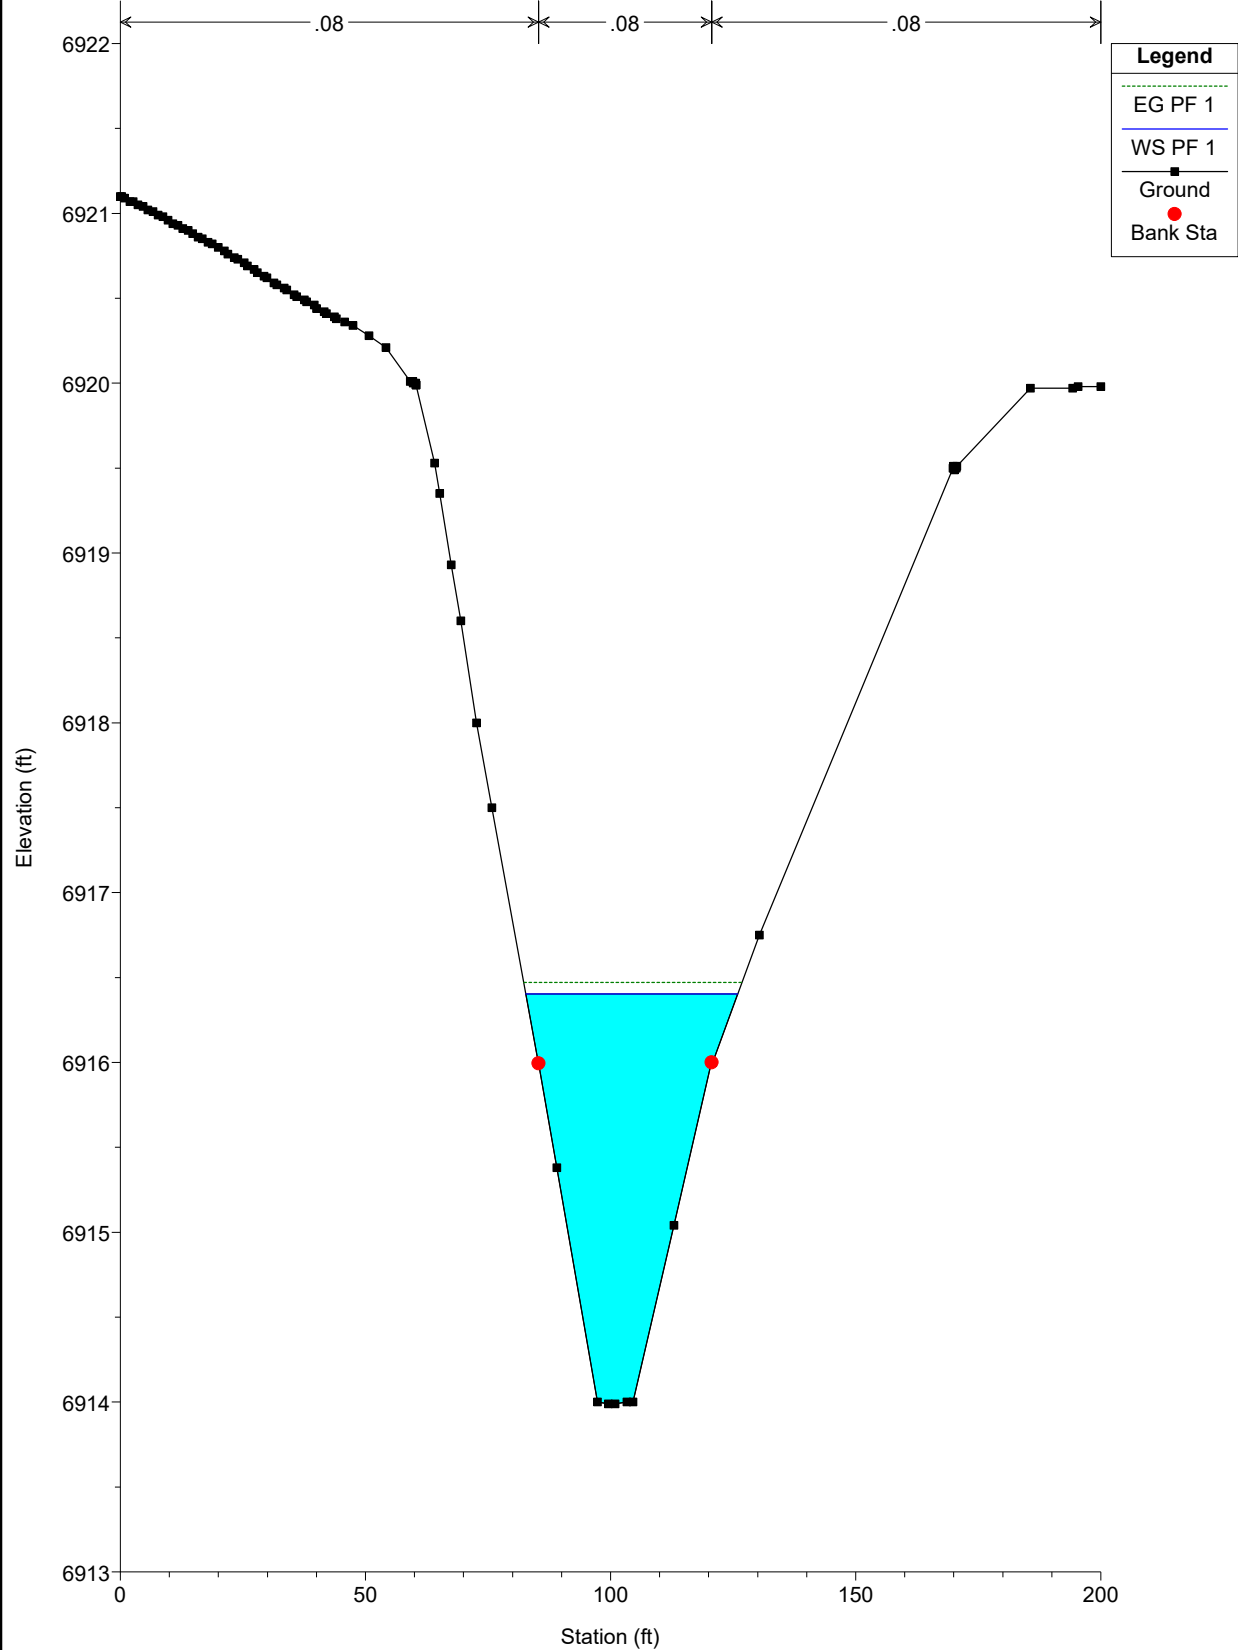


east chan pr PDR rev Plan: Plan 01 7/13/2022
700

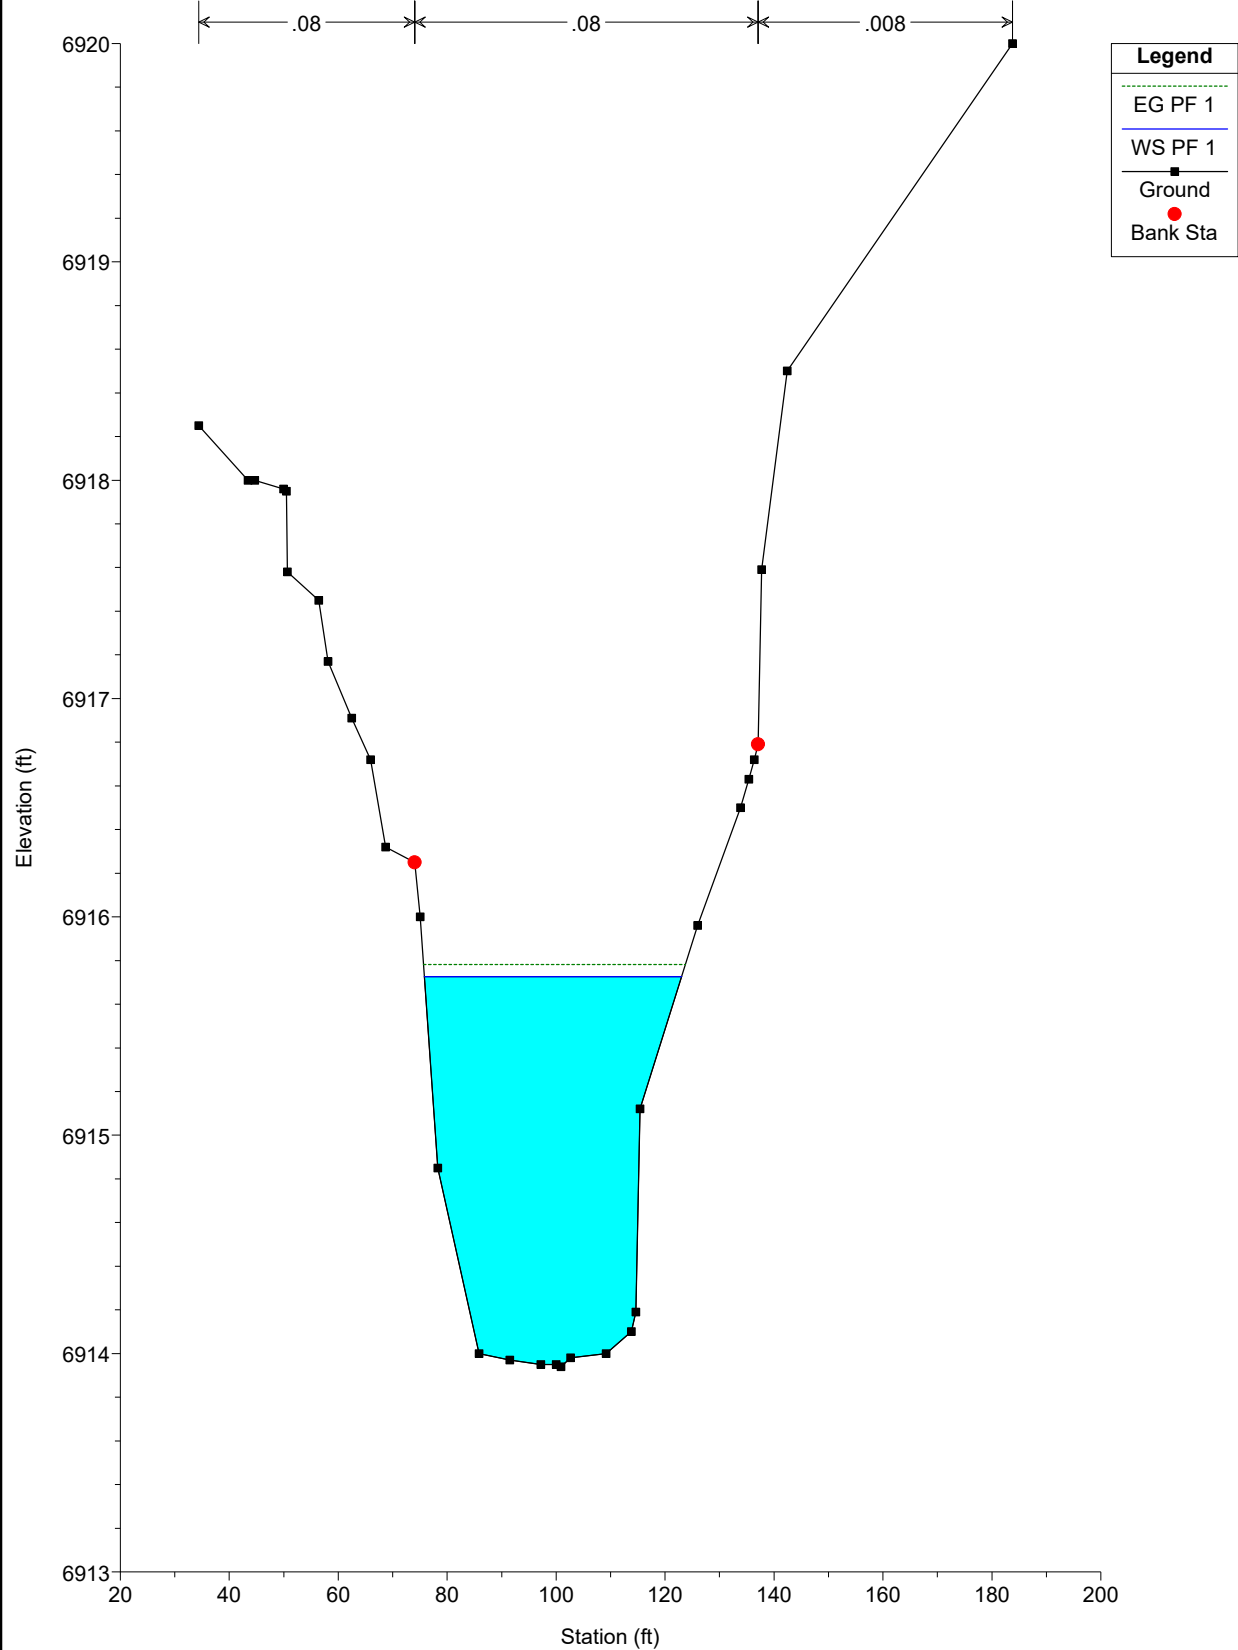


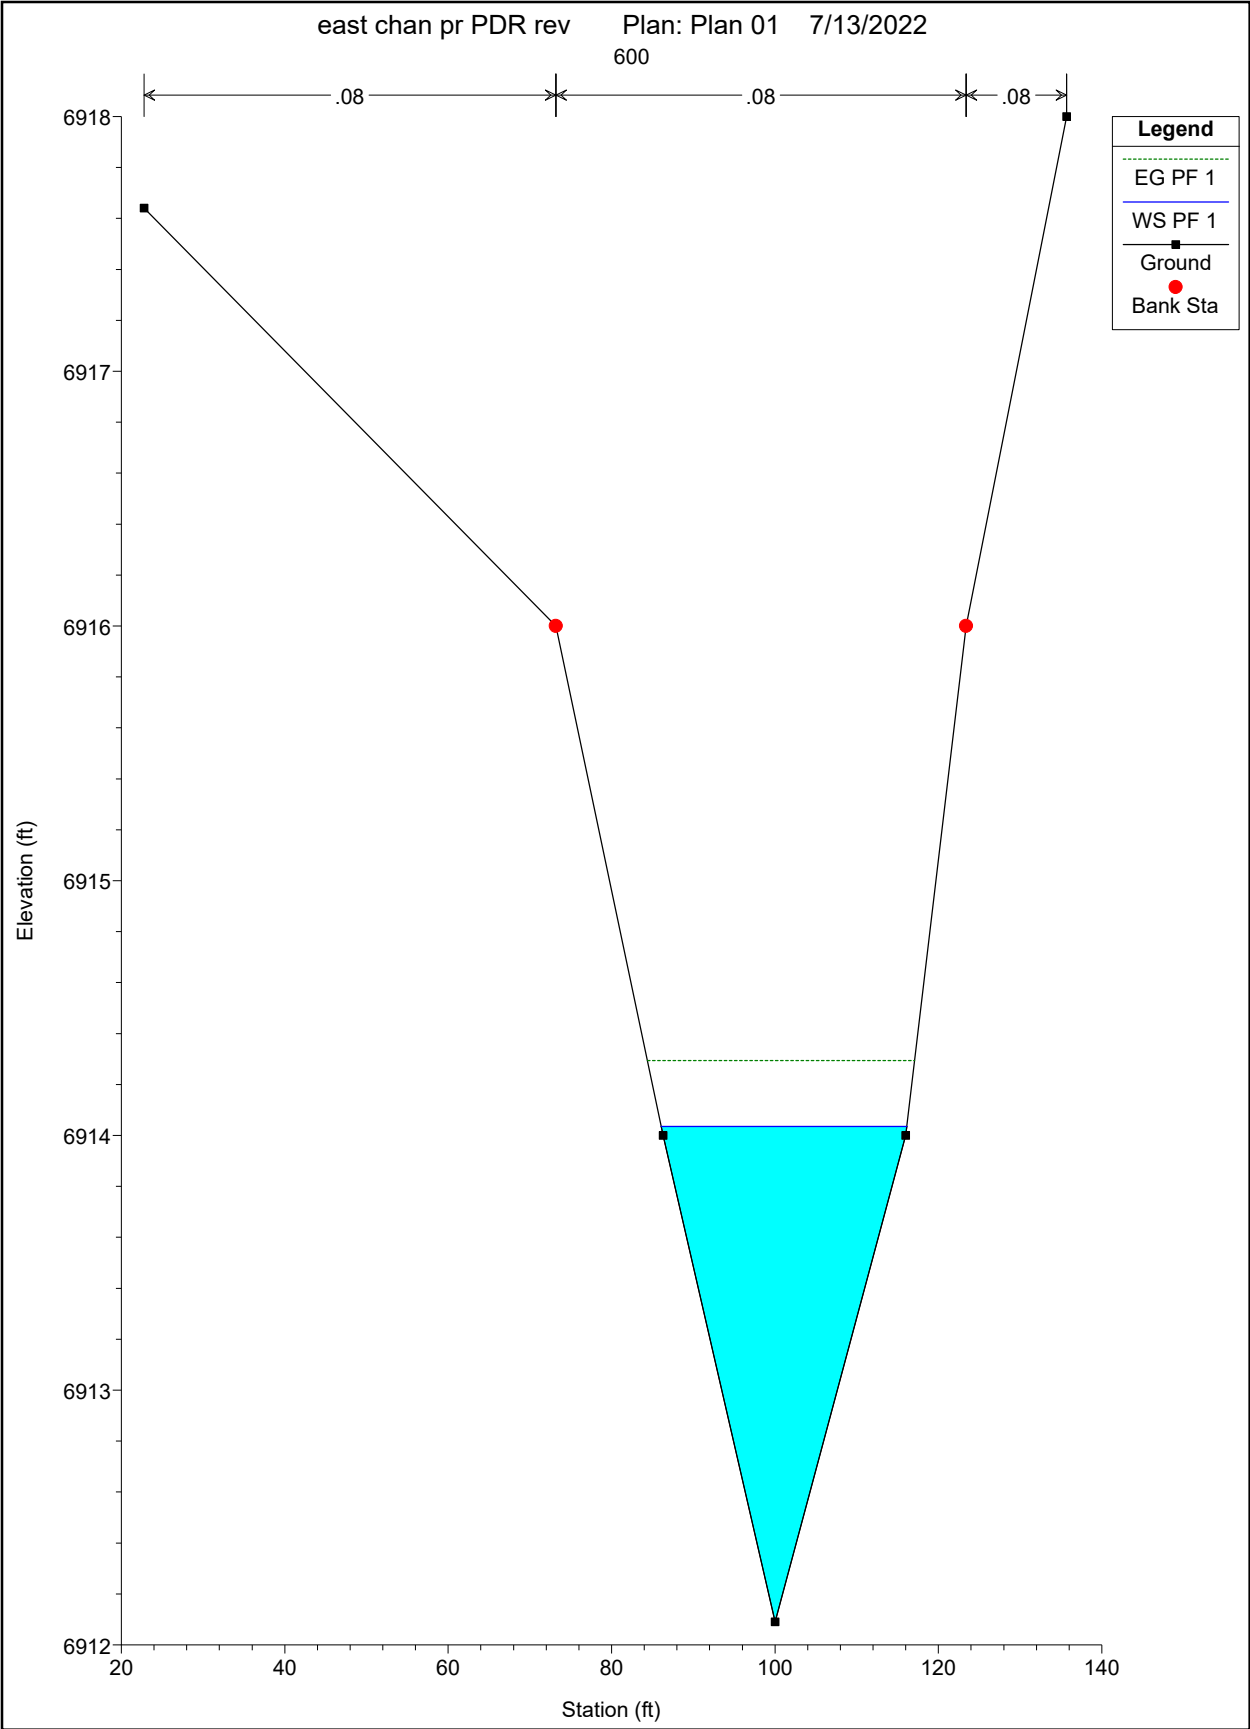


east chan pr PDR rev Plan: Plan 01 7/13/2022

500

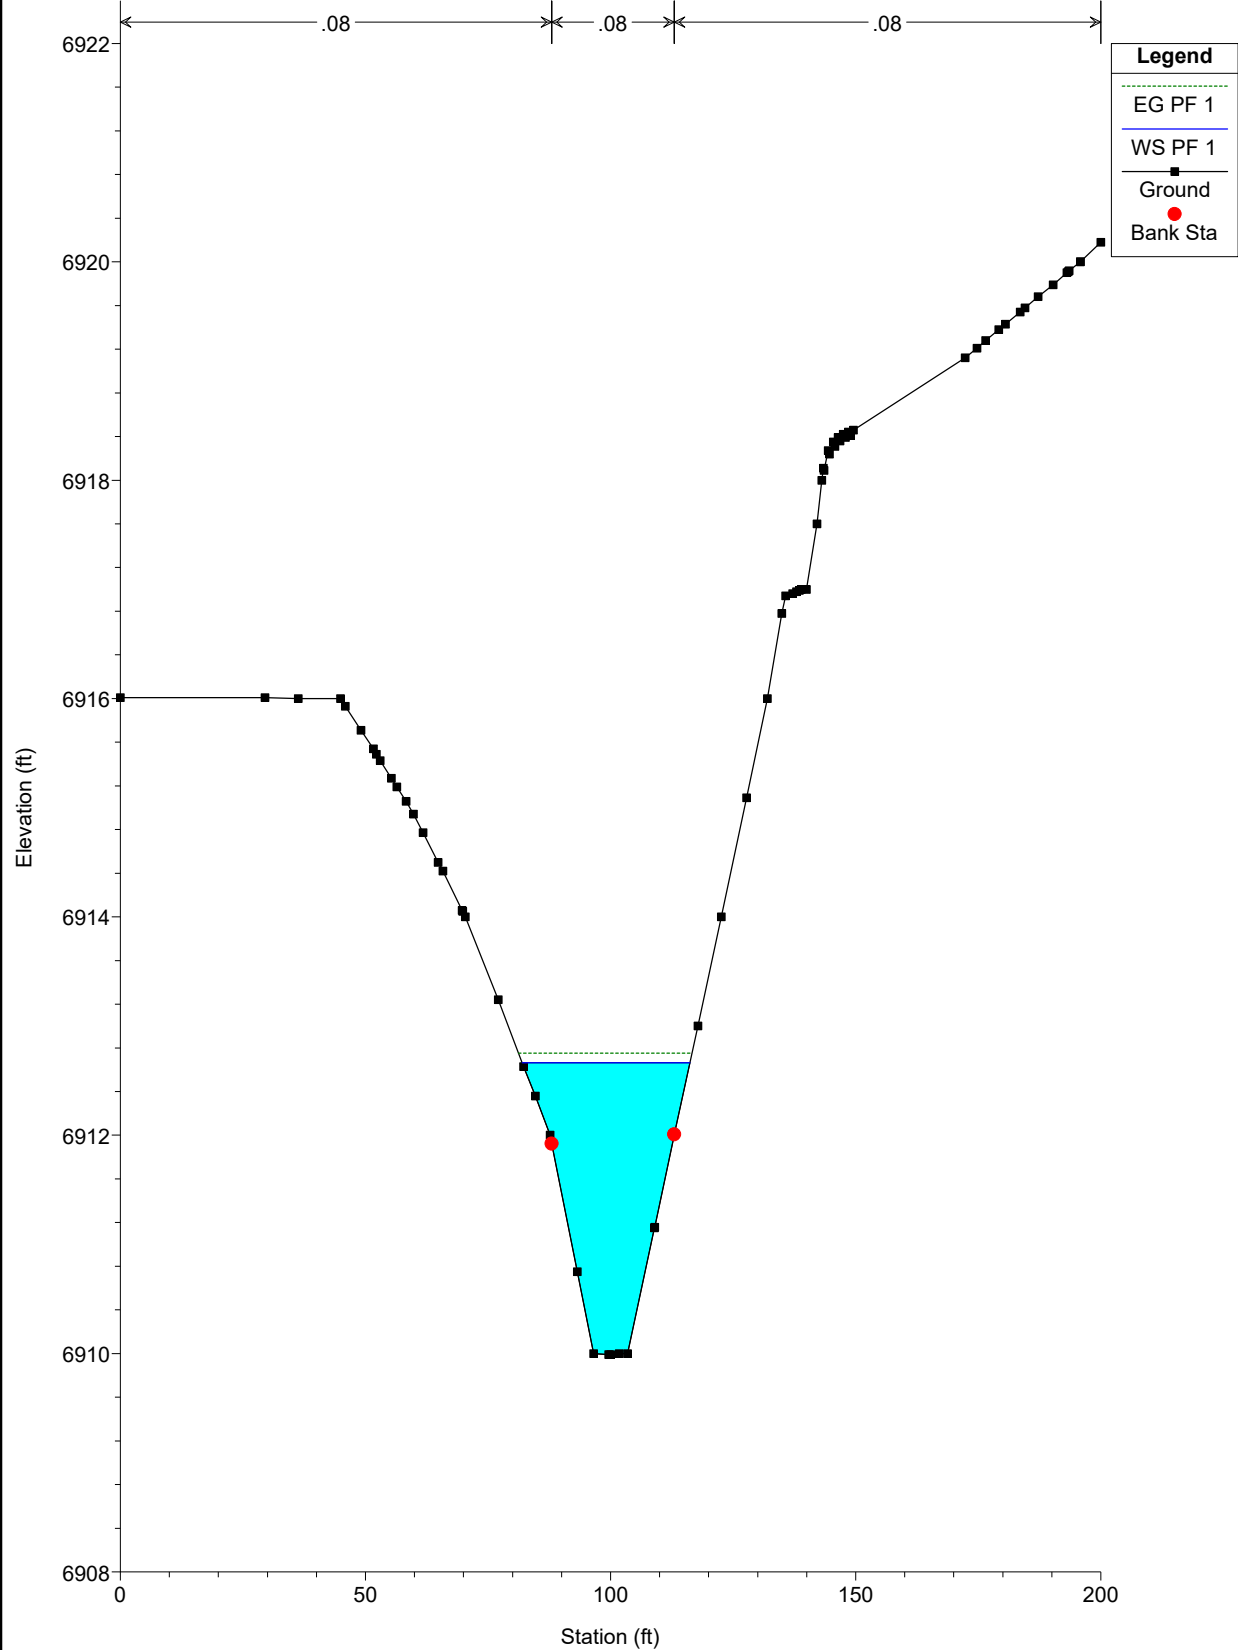

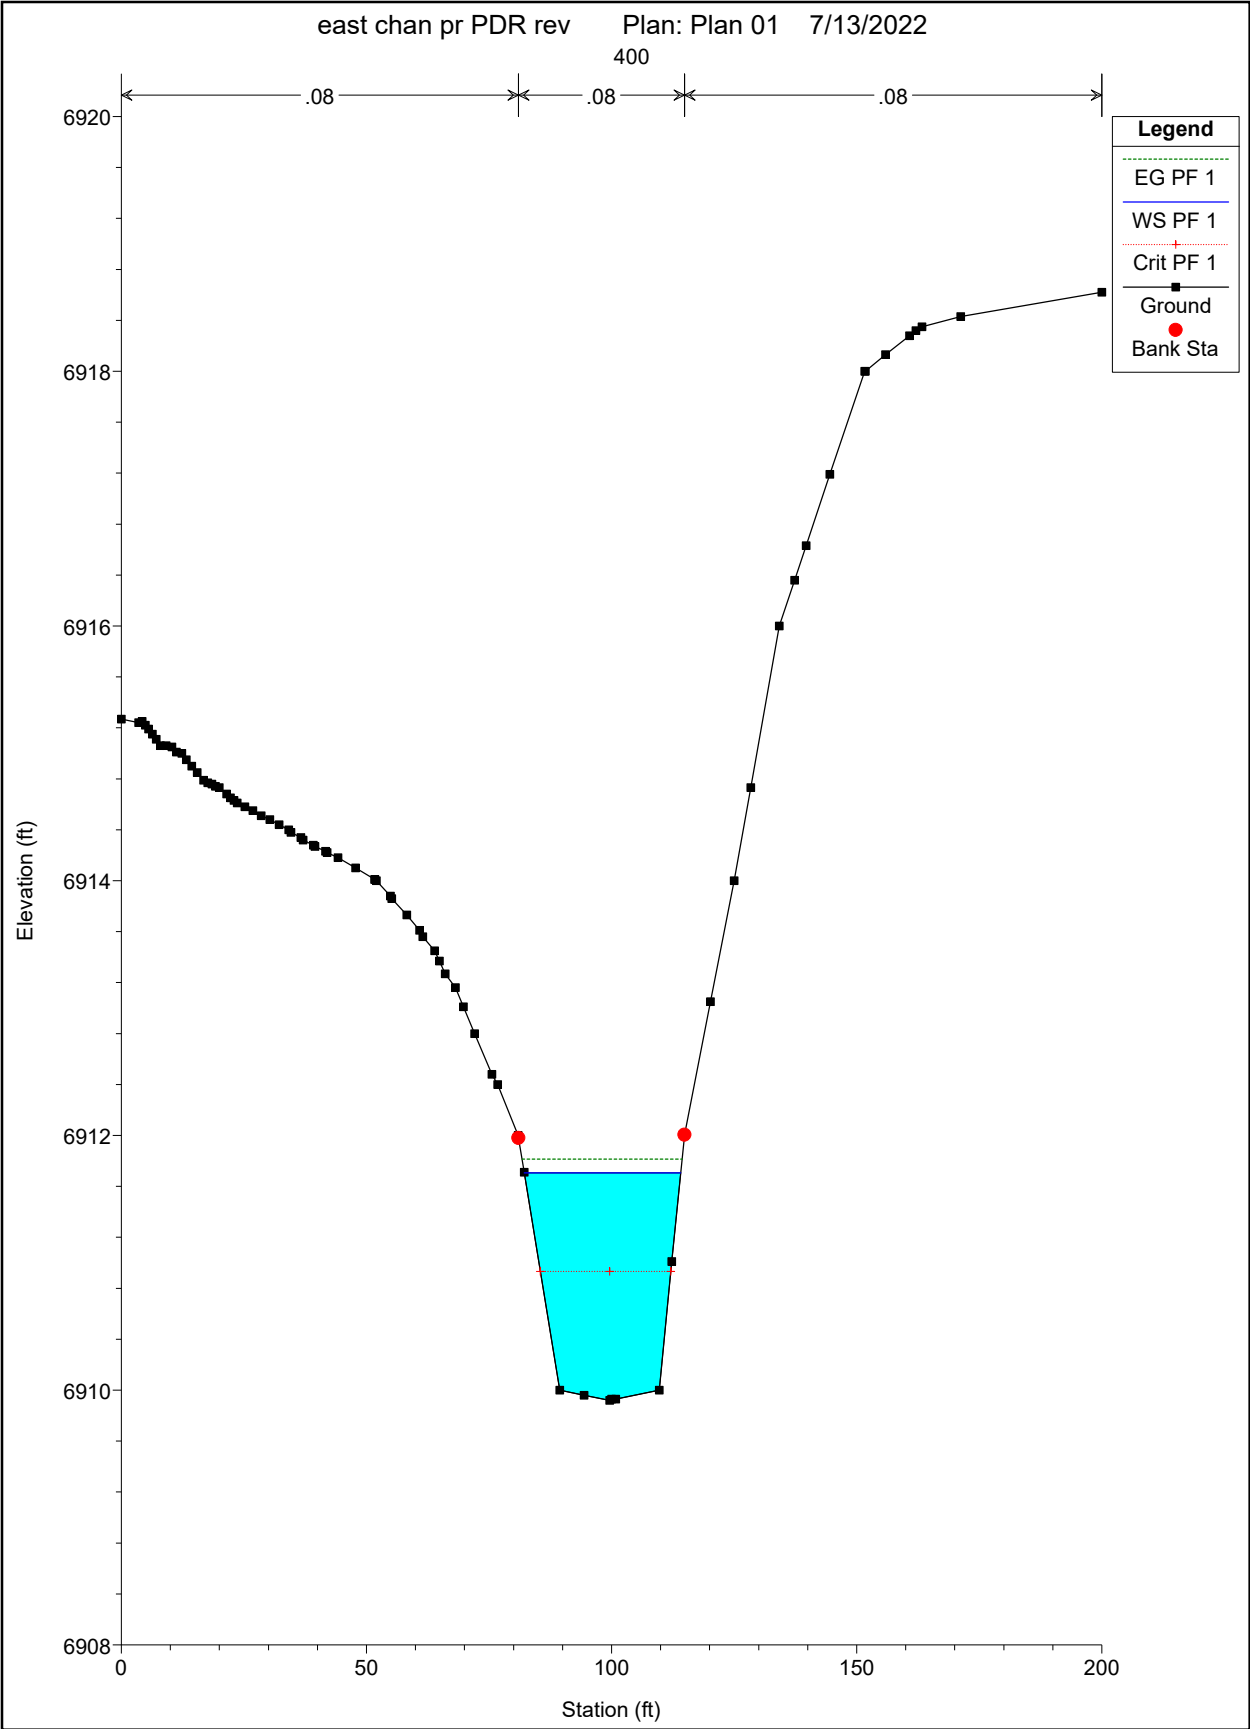

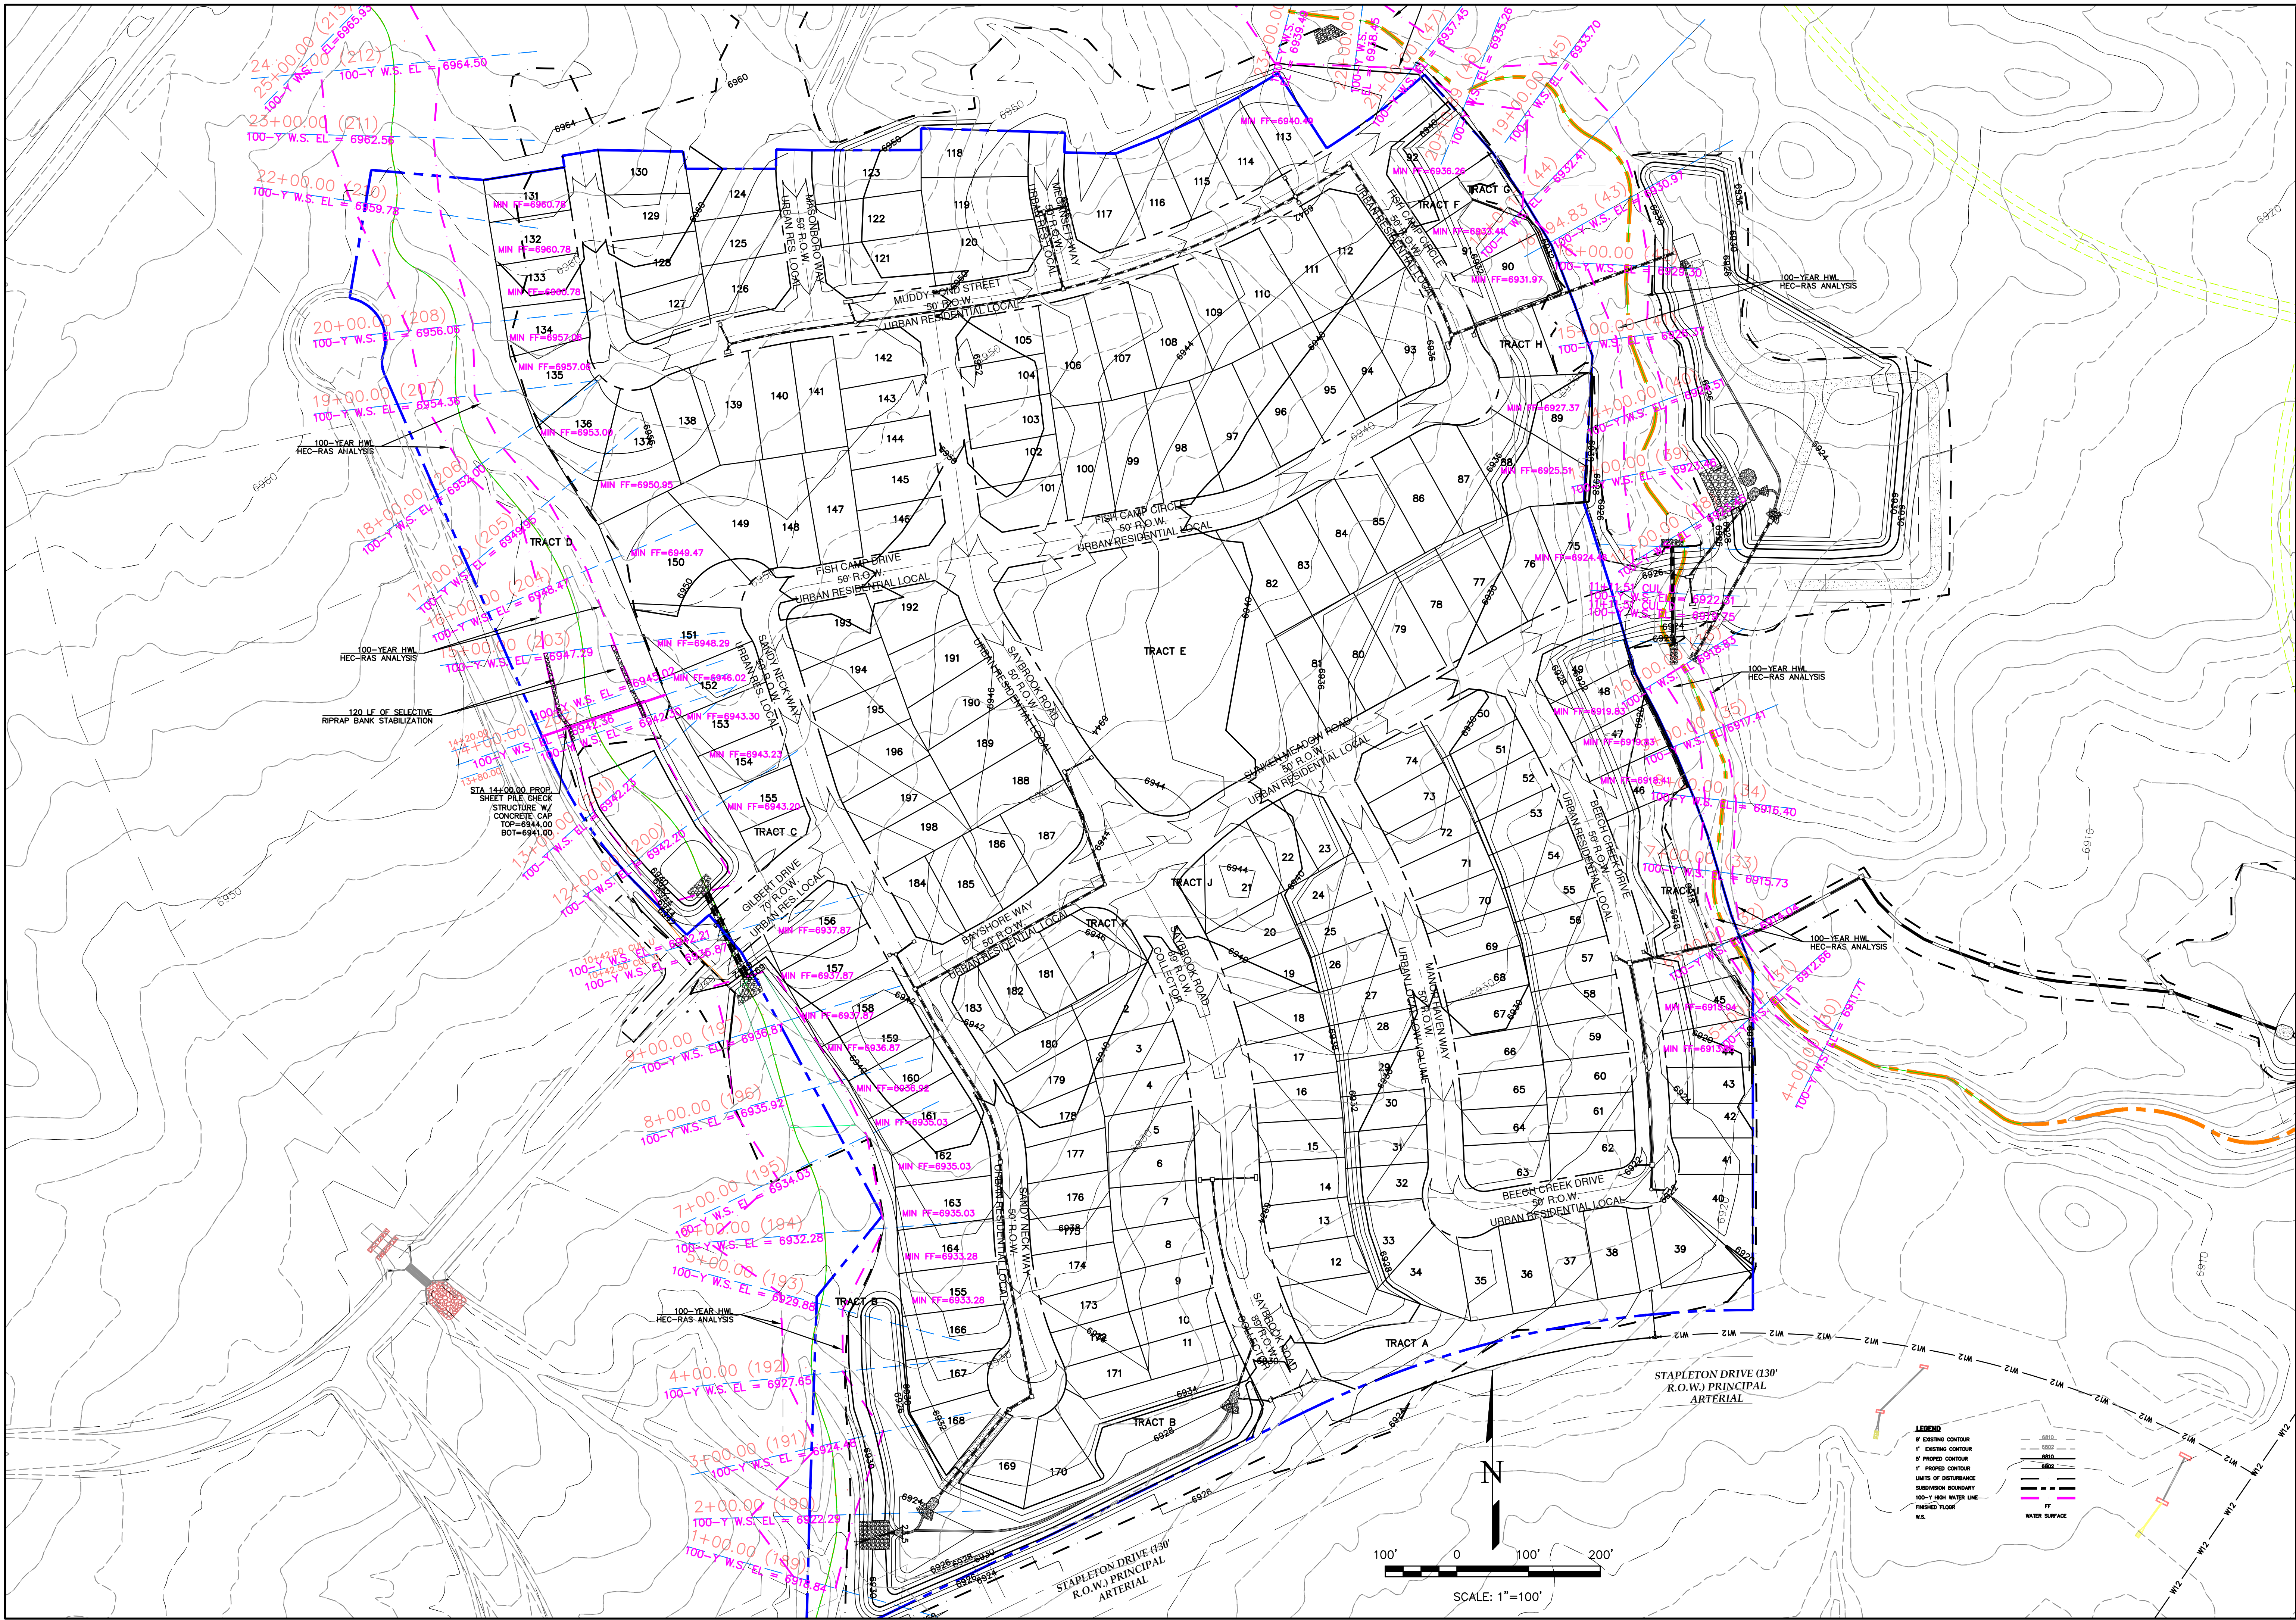

REVISIONS	
NO.	DESCRIPTION

UNTIL SUCH TIME AS THESE DRAWINGS ARE APPROVED BY THE REVIEWING AGENCIES, TERRA NOVA ENGINEERING, INC. APPROVES THEIR USE ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED BY WRITTEN AUTHORIZATION.

PREPARED FOR: 4-WAY RANCH JOINT VENTURE ATTN: PETER MARTZ P.O. BOX 50223 COLORADO SPRINGS, CO 80949 719-491-3150
--

721 S. 23RD STREET COLORADO SPRINGS, CO 80904 OFFICE: 719-635-6422 FAX: 719-635-6426 www.tnecinc.com	 Terra Nova Engineering, Inc. Civil Five Civil Engineering
--	---

WATERBURY FILING NO. 1 & 2 GRADING AND UTILITIES PLAN


DESIGNED BY DLF DRAWN BY QNA CHECKED BY QNA H-SCALE 1" = 100' V-SCALE N/A JOB NO. 1715.00 DATE ISSUED 7/14/22 SHEET NO. 1 OF 1

DRAINAGE MAPS

MDDP DRAINAGE REPORT ~ EXISTING BASIN RUNOFF COEFFICIENT SUMMARY										
BASIN	TOTAL AREA (AC)	IMPERVIOUS / DEVELOPED AREA			NONIMPERVIOUS / UNDEVELOPED AREA			WEIGHTED		WEIGHTED CA
		AREA (AC)	C(5)	C(100)	AREA (AC)	C(5)	C(100)	C(5)	C(100)	
EXA	9.62	0.00	0.45	0.59	9.62	0.09	0.36	0.09	0.36	0.87
EXB	4.09	0.00	0.45	0.59	4.09	0.09	0.36	0.09	0.36	0.37
EXC	24.80	0.00	0.45	0.59	24.80	0.09	0.36	0.09	0.36	2.23
EXD	15.87	0.00	0.45	0.59	15.87	0.09	0.36	0.09	0.36	1.43
EXE	5.83	0.00	0.45	0.59	5.83	0.09	0.36	0.09	0.36	0.52
EXF	1.62	0.00	0.45	0.59	1.62	0.09	0.36	0.09	0.36	0.15
OS-1	45.02	0.00	0.45	0.59	45.02	0.09	0.36	0.09	0.36	4.05
OS-2	11.40	0.00	0.45	0.59	11.40	0.09	0.36	0.09	0.36	1.03
OS-3	1.11	0.00	0.45	0.59	1.11	0.09	0.36	0.09	0.36	0.10
OS-4	0.29	0.00	0.45	0.59	0.29	0.09	0.36	0.09	0.36	0.03
OS-5	6.74	0.00	0.45	0.59	6.74	0.09	0.36	0.09	0.36	0.61
OS-6	2.56									
OS-9	11.80									
OS-10A	12.80									
FLOW TAKEN FROM MERIDAIN RANCH MDDP										
FLOW TAKEN FROM MERIDAIN RANCH MDDP										
FLOW TAKEN FROM MERIDAIN RANCH MDDP										

MDDP ~ EXISTING BASIN RUNOFF SUMMARY														
BASIN	WEIGHTED CA(5) CA(100)		OVERLAND			STREET / CHANNEL FLOW			Tc		INTENSITY		TOTAL FLOWS	
	CA(5)	CA(100)	C(5)	Length (ft)	Height (ft)	Tc (min)	Length (ft)	Slope (%)	Velocity (ft/s)	Tc (min)	TOTAL I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
EXA	0.87	3.46	0.25	100	3	11.1	1193	1.7%	4.5	4.4	15.4	3.43	5.81	3 20
EXB	0.37	1.47	0.25	100	2	12.6	623	2.2%	5.2	2.0	14.6	3.51	5.96	1 9
EXC	2.23	8.93	0.25	100	2.5	11.7	2420	1.7%	4.6	8.9	20.6	3.01	5.01	7 45
EXD	1.43	5.71	0.25	100	2	12.6	1615	2.6%	5.6	4.8	17.4	3.25	5.47	5 31
EXE	0.52	2.10	0.25	100	8	8.0	1063	2.1%	5.0	3.5	11.5	3.86	6.66	2 14
EXF	0.15	0.58	0.25	100	6	8.8	400	2.6%	5.5	1.2	10.0	4.06	7.07	1 4
OS-1	4.05	16.21	0.25	100	6	8.8	3219	2.3%	5.3	10.1	18.9	3.13	5.24	13 85
OS-2	1.03	4.11	0.25	100	2	12.6	1263	1.0%	3.5	5.7	18.4	3.17	5.32	3 22
OS-3	0.10	0.40	0.25	100	2	12.6	330	2.6%	5.6	1.0	13.6	3.61	6.17	0 2
OS-4	0.03	0.11	0.25	100	2	12.6	230	2.6%	5.7	0.7	13.3	3.64	6.23	0 1
OS-5	0.61	2.43	0.25	80	5	7.8	1000	2.5%	5.5	3.0	10.8	3.96	6.85	2 17
OS-6													5	11
OS-9													8	19
FLOW TAKEN FROM MERIDAIN RANCH MDDP														
FLOW TAKEN FROM MERIDAIN RANCH MDDP														

MDDP ~ EXISTING SURFACE ROUTING SUMMARY									
Design Point(s)	Contributing Basins	Area (AC)	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow	
						I(5)	I(100)	Q(5)	Q(100)
EX1	EXA, OS-5, & DP-EX10A	16.92	1.47	5.89	15.4	3.43	5.81	33	219
EX2	EXB	4.09	0.37	1.47	14.6	3.51	5.96	1	9
EX3	EXC & OS-4	25.10	2.26	9.03	20.6	3.01	5.01	7	45
EX4	EXD & OS-3	16.98	1.53	6.11	17.4	3.25	5.47	5	33
EX5	EXE, OS-2 & OS-8	17.23	1.55	6.20	18.4	3.17	5.32	10	44
EX6	EXF	1.62	0.15	0.58	13.8	3.59	6.12	1	4
EX7	EXE, EXF, OS-1, OS-2, OS-8 & OS-9	78.24	5.75	23.00	18.9	3.13	5.24	31	151
EX9	OS-9	11.80						8	19
EX10	OS-8	2.56						5	11
EX10A	MERIDAIN POND E RELEASE							28	185
Meridain Ranch Filing 3 FDR Calculated Flows									EX 3-42" RCP Culverts

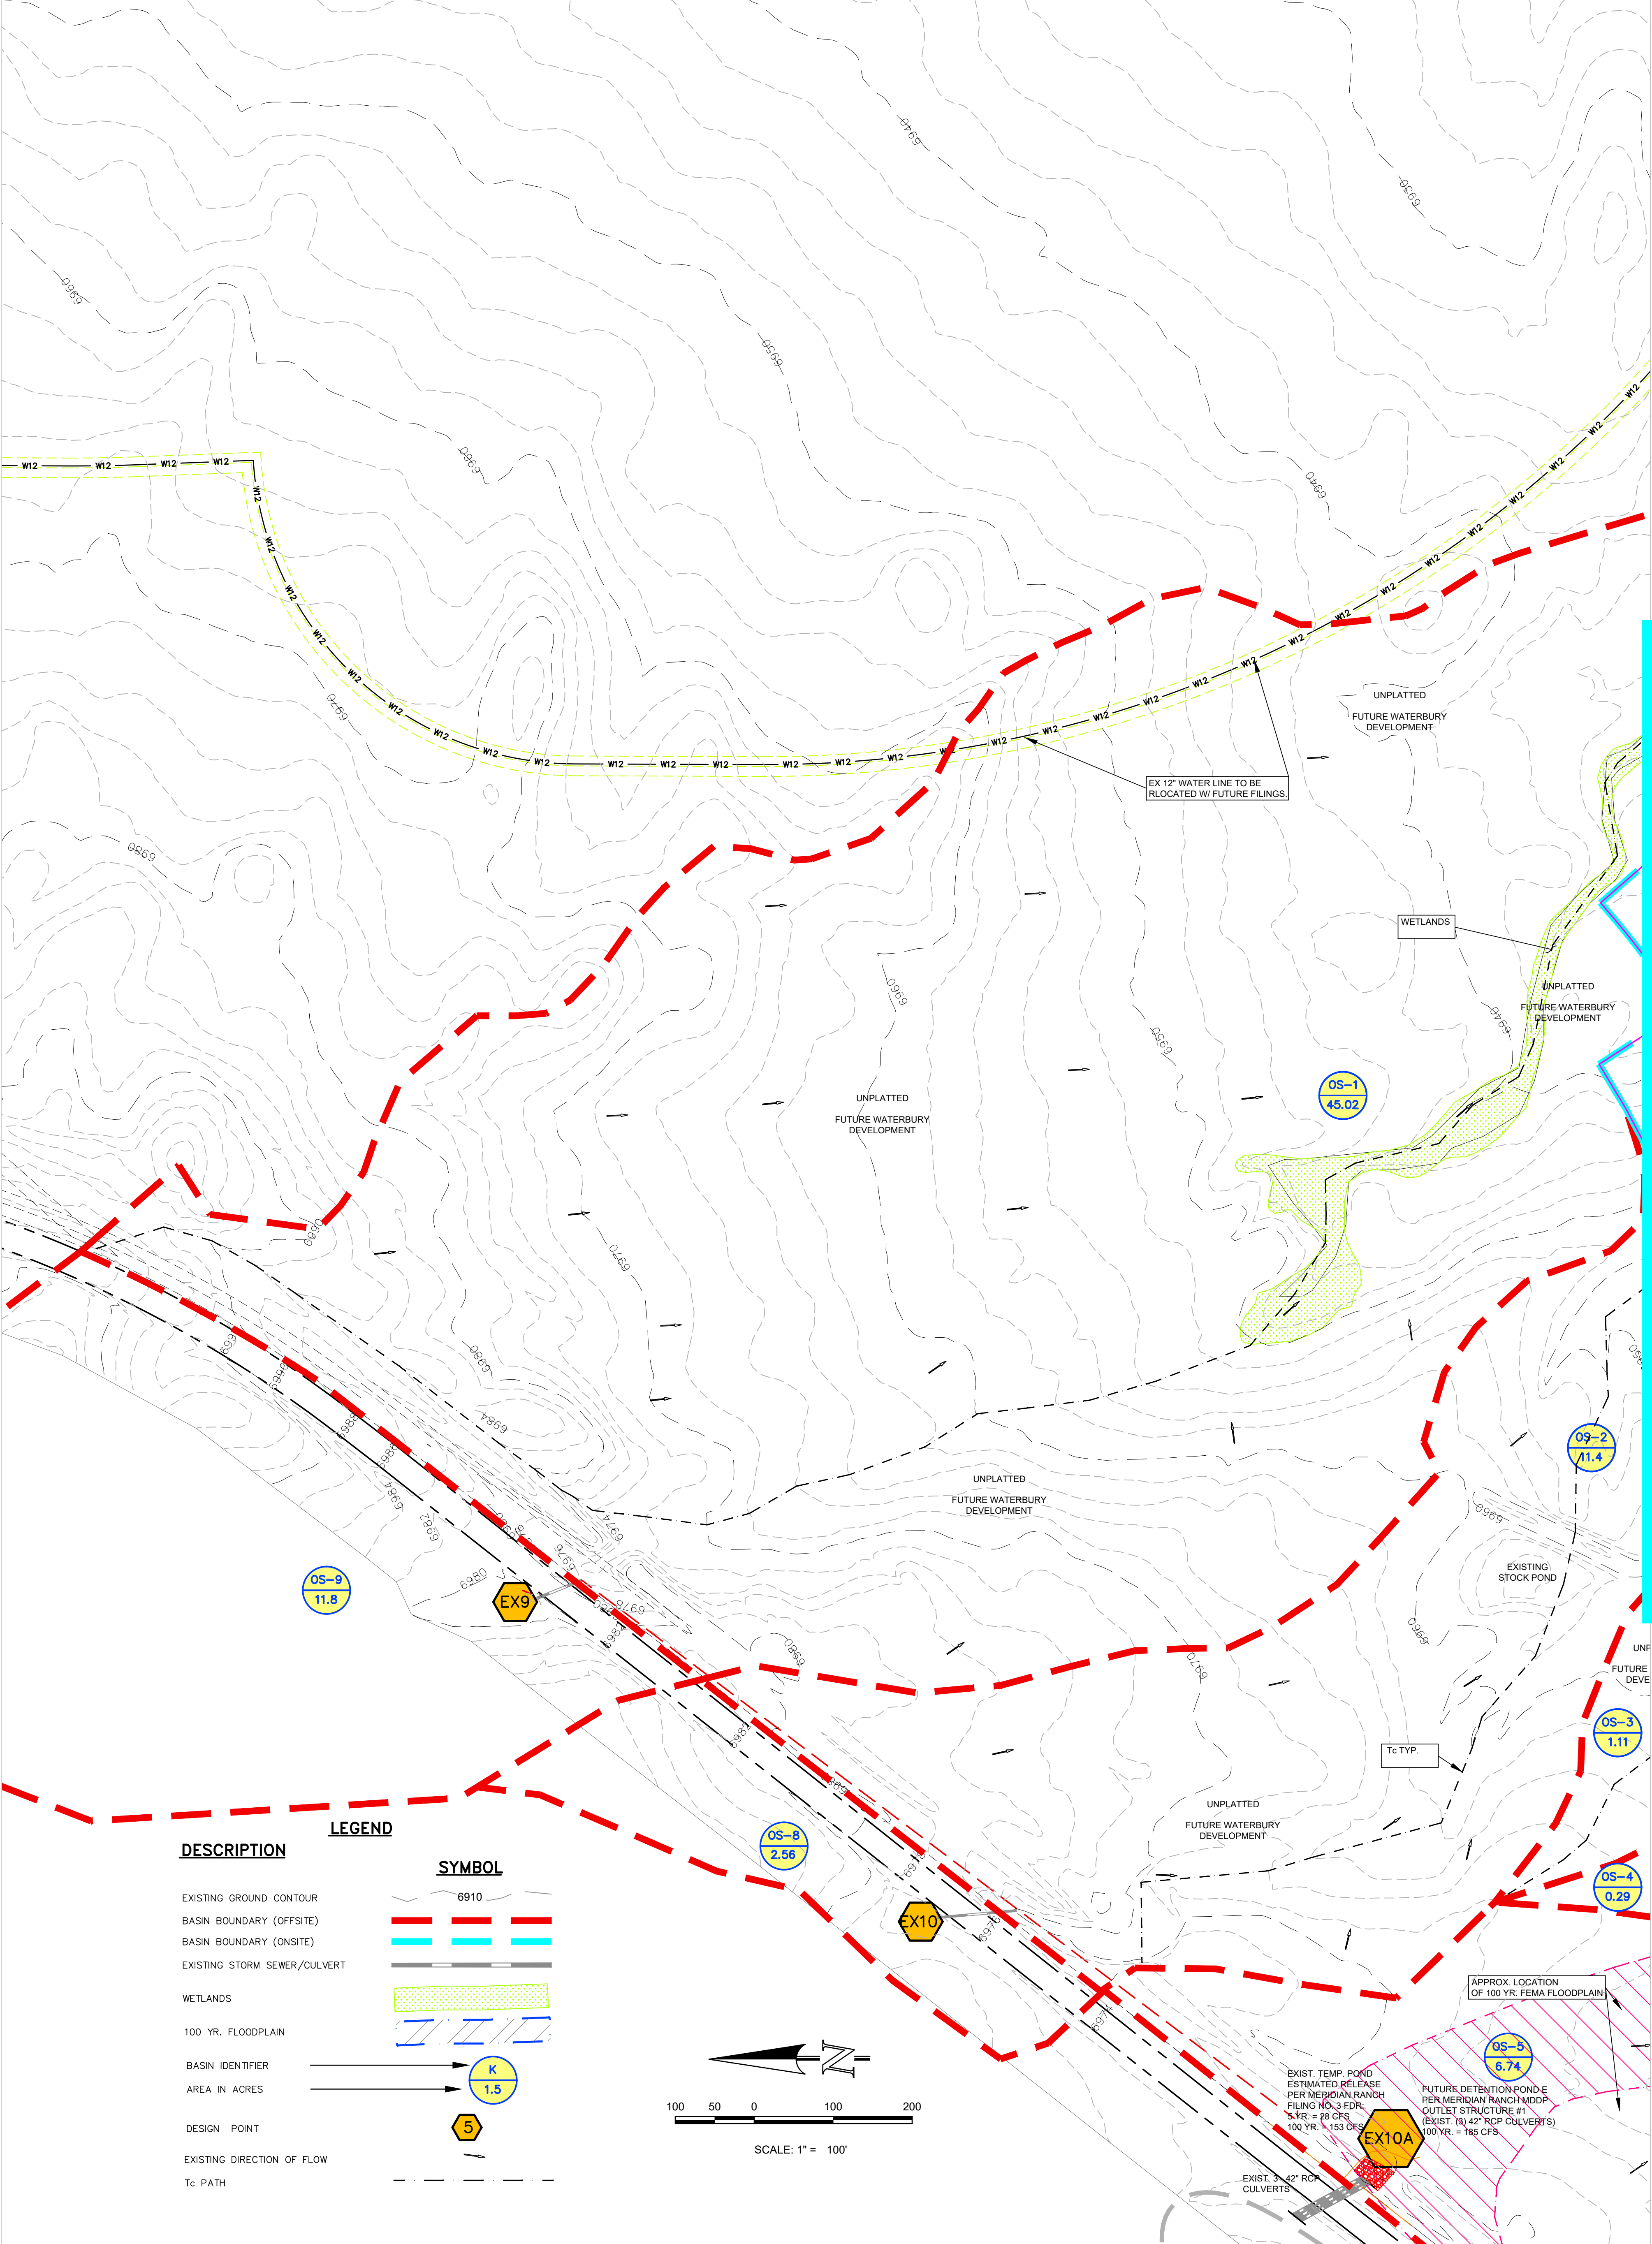

MATCHLINE SEE SHEET 2

DESIGNED BY: QNA
DRAWN BY: QNA
CHECKED BY:
H-S SCALE: 1"=100'
V-S SCALE:
JOB NO. 1715.00
DATE ISSUED 3/3/22
SHEET NO. 1 OF 2


WATERBURY FILING 1 & 2
EXISTING MDDP DRAINAGE MAP 1
OFFSITE MAP

PREPARED FOR:
4-WAY RANCH JOINT VENTURES
ATTN: PETER MARTZ
PO BOX 50223
COLORADO SPRINGS, CO 80949
719-471-3150

PREPARED BY:
Terra Nova
Engineering, Inc.
721 S. 23RD STREET
COLORADO SPRINGS, CO 80904
OFFICE: 719-634-4432
FAX: 719-635-6436
www.tnainc.com

REVISIONS
NO. DESCRIPTION DATE
UNTIL SUCH TIME AS THESE REVISIONS ARE APPROVED BY THE REVIEWING AGENCIES, THIS DRAWING AND SURVEYING, INC. APPROVES THEIR USE ONLY FOR THE PROJECT SPECIFICALLY DESIGNATED BY WRITTEN AUTHORIZATION.


MATCHLINE SEE SHEET 1

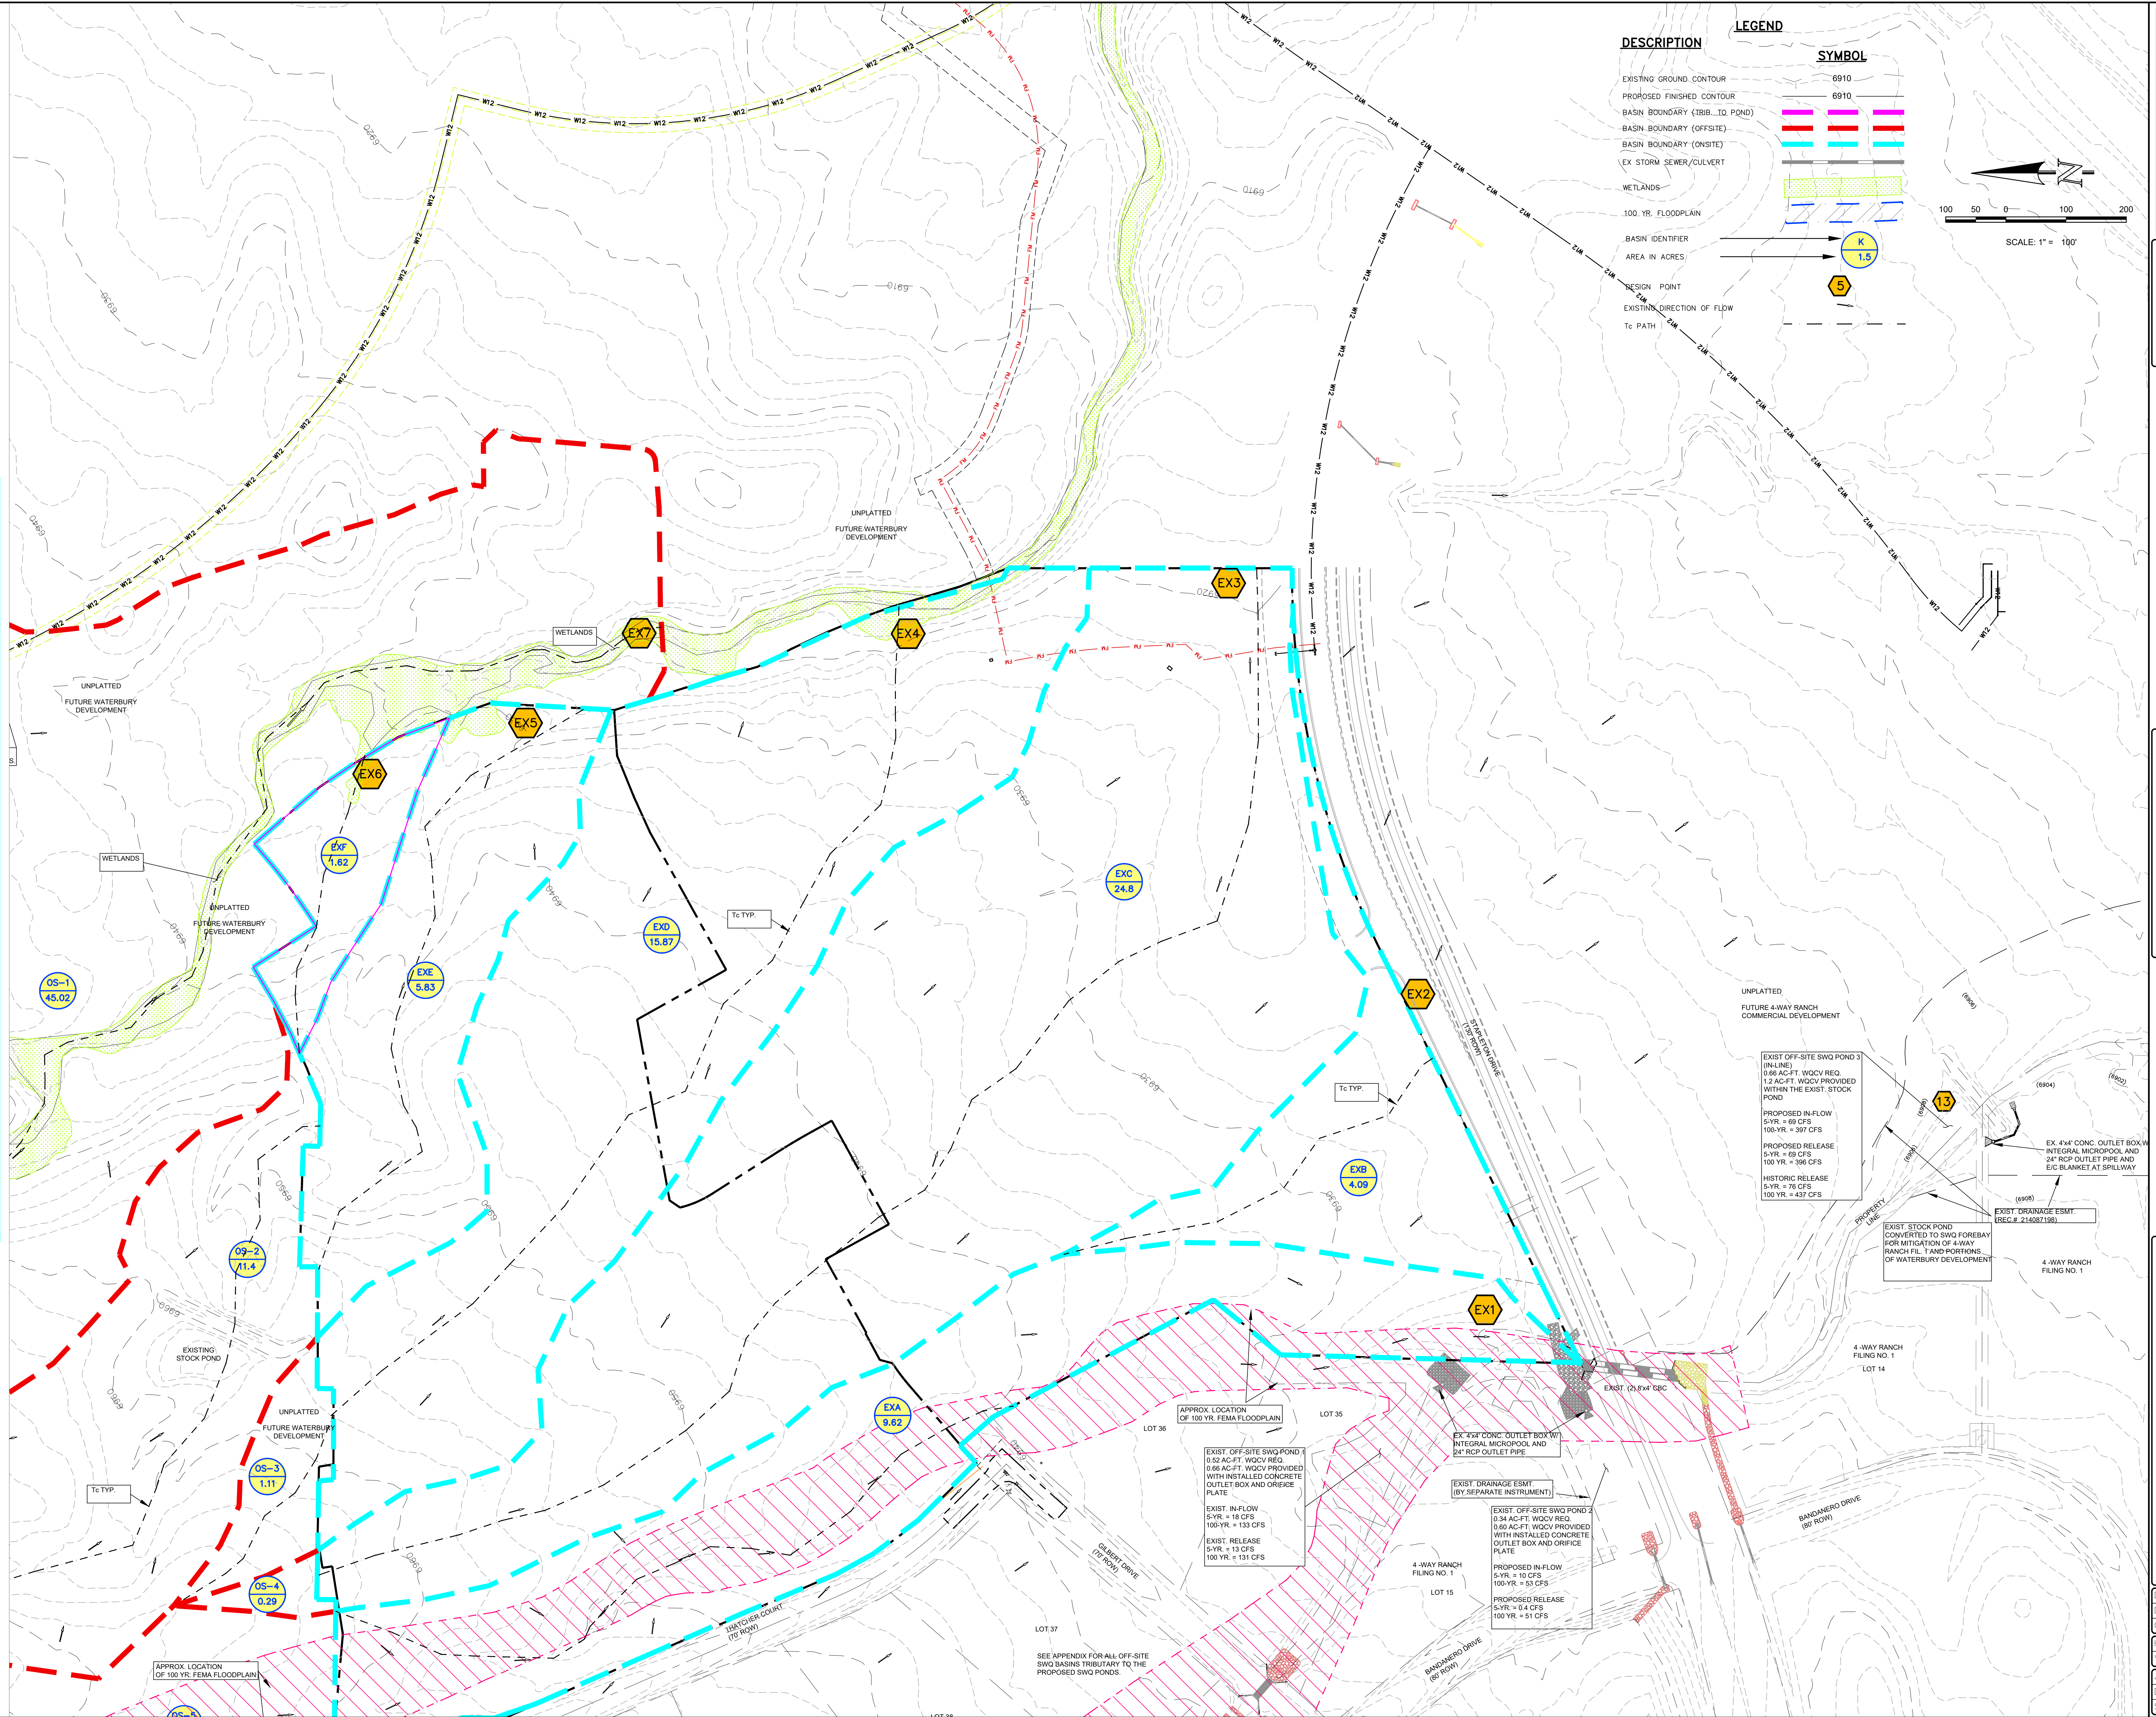[illegible]

MDDP DRAINAGE REPORT ~ EARLY GRADING BASIN RUNOFF COEFFICIENT SUMMARY											
BASIN	TOTAL AREA (AC)	IMPERVIOUS / DEVELOPED AREA			NONIMPERVIOUS / UNDEVELOPED AREA			WEIGHTED		WEIGHTED CA	
		AREA (AC)	C(5)	C(100)	AREA (AC)	C(5)	C(100)	C(5)	C(100)	CA(5)	CA(100)
PRE-A	4.61	0.00	0.45	0.59	4.61	0.09	0.36	0.09	0.36	0.41	1.66
PRE-B	12.35	0.00	0.45	0.59	12.35	0.09	0.36	0.09	0.36	1.11	4.45
PRE-C	19.08	0.00	0.45	0.59	19.08	0.09	0.36	0.09	0.36	1.72	6.87
PRE-D	15.52	0.00	0.45	0.59	15.52	0.09	0.36	0.09	0.36	1.40	5.59
PRE-E	6.33	0.00	0.45	0.59	6.33	0.09	0.36	0.09	0.36	0.57	2.28
PRE-F	0.62	0.00	0.45	0.59	0.62	0.09	0.36	0.09	0.36	0.06	0.22
PRE-G	2.00	0.00	0.45	0.59	2.00	0.09	0.36	0.09	0.36	0.18	0.72
PRE-H	1.33	0.00	0.45	0.59	1.33	0.09	0.36	0.09	0.36	0.12	0.48
OS-1	0.75	0.00	0.45	0.59	0.75	0.09	0.36	0.09	0.36	0.07	0.27
OS-2	11.15	0.00	0.45	0.59	11.15	0.09	0.36	0.09	0.36	1.00	4.51
OS-3	1.11	0.00	0.45	0.59	1.11	0.09	0.36	0.09	0.36	0.10	0.40
OS-4	0.56	0.00	0.45	0.59	0.56	0.09	0.36	0.09	0.36	0.05	0.20
OS-8	2.56	FLOW TAKEN FROM MERIDIAN RANCH MDDP									

MDDP ~ EARLY GRADING BASIN RUNOFF SUMMARY														
BASIN	WEIGHTED		OVERLAND			STREET / CHANNEL FLOW			Tc		INTENSITY		TOTAL FLOWS	
	CA(5)	CA(100)	C(5)	Length (ft)	Height (ft)	Tc (min)	Length (ft)	Slope (%)	Velocity (ft/s)	Tc (min)	TOTAL I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
PRE-A	0.41	1.66	0.25	100	2.5	11.7	969	1.4%	4.2	3.6	15.4	3.43	5.85	1 10
PRE-B	1.11	4.45	0.25	100	2.5	11.7	1612	1.3%	4.0	6.7	18.5	3.16	5.31	4 24
PRE-C	1.72	6.87	0.25	100	2.5	11.7	1308	1.3%	4.0	5.5	17.2	3.27	5.50	6 38
PRE-D	1.40	5.59	0.25	100	2	12.6	1297	1.6%	4.5	4.9	17.5	3.24	5.46	5 30
PRE-E	0.57	2.28	0.25	100	8	8.0	752	2.1%	5.1	2.5	19.5	4.00	6.94	2 16
PRE-F	0.06	0.22	0.25	64	2	8.7					8.7	4.26	7.47	0 2
PRE-G	0.18	0.72	0.25	161	5	13.9					13.9	3.58	6.12	1 4
PRE-H	0.12	0.48	0.25	67	2	9.1					9.1	4.21	7.36	1 4
OS-1	0.07	0.27	0.25	85	2	11.0	75	1.3%	4.0	0.3	11.4	3.88	6.70	0 2
OS-2	1.00	4.01	0.25	76	2	10.1	1427	2.1%	5.1	4.7	14.8	3.49	5.94	4 24
OS-3	0.10	0.40	0.25	100	9	7.7	329	2.5%	5.5	1.0	8.7	4.27	7.49	0 3
OS-4	0.05	0.20	0.25	100	2	12.6	127	2.4%	5.4	0.4	13.0	3.68	6.30	0 1
OS-8			FLOW TAKEN FROM MERIDIAN RANCH MDDP											

MDDP ~ EARLY GRADING SURFACE ROUTING SUMMARY										
Design Point(s)	Contributing Basins	Area (AC)	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Facility Size
						I(5)	I(100)	Q(5)	Q(100)	
PRE1	PRE-B & OS-4	4.65	1.16	4.65	18.5	3.16	5.31	4	25	TSB 1
PRE2	PRE-C	19.08	1.72	6.87	17.2	3.27	5.50	6	38	TSB 2
PRE3	PRE-D & OS-3	16.63	1.50	5.99	17.5	3.24	5.46	5	33	TSB 3
PRE4	PRE-E & OS-1	7.07	0.64	2.55	10.5	4.00	6.94	3	18	TSB 4
PRE5	OS-8 & OS-2	13.71	1.00	4.01	14.8	3.49	5.94	9	35	EASTERN CHANNEL
PRE6	PRE-F	0.62	0.06	0.22	8.7	4.26	7.47	0	2	STAPLETON ROAD
PRE7	PRE-G, PRE-H & DPS PRE2- PRES	59.82	5.15	20.61	17.5	3.24	5.46	25	147	EX GEICK RANCH CHANNEL

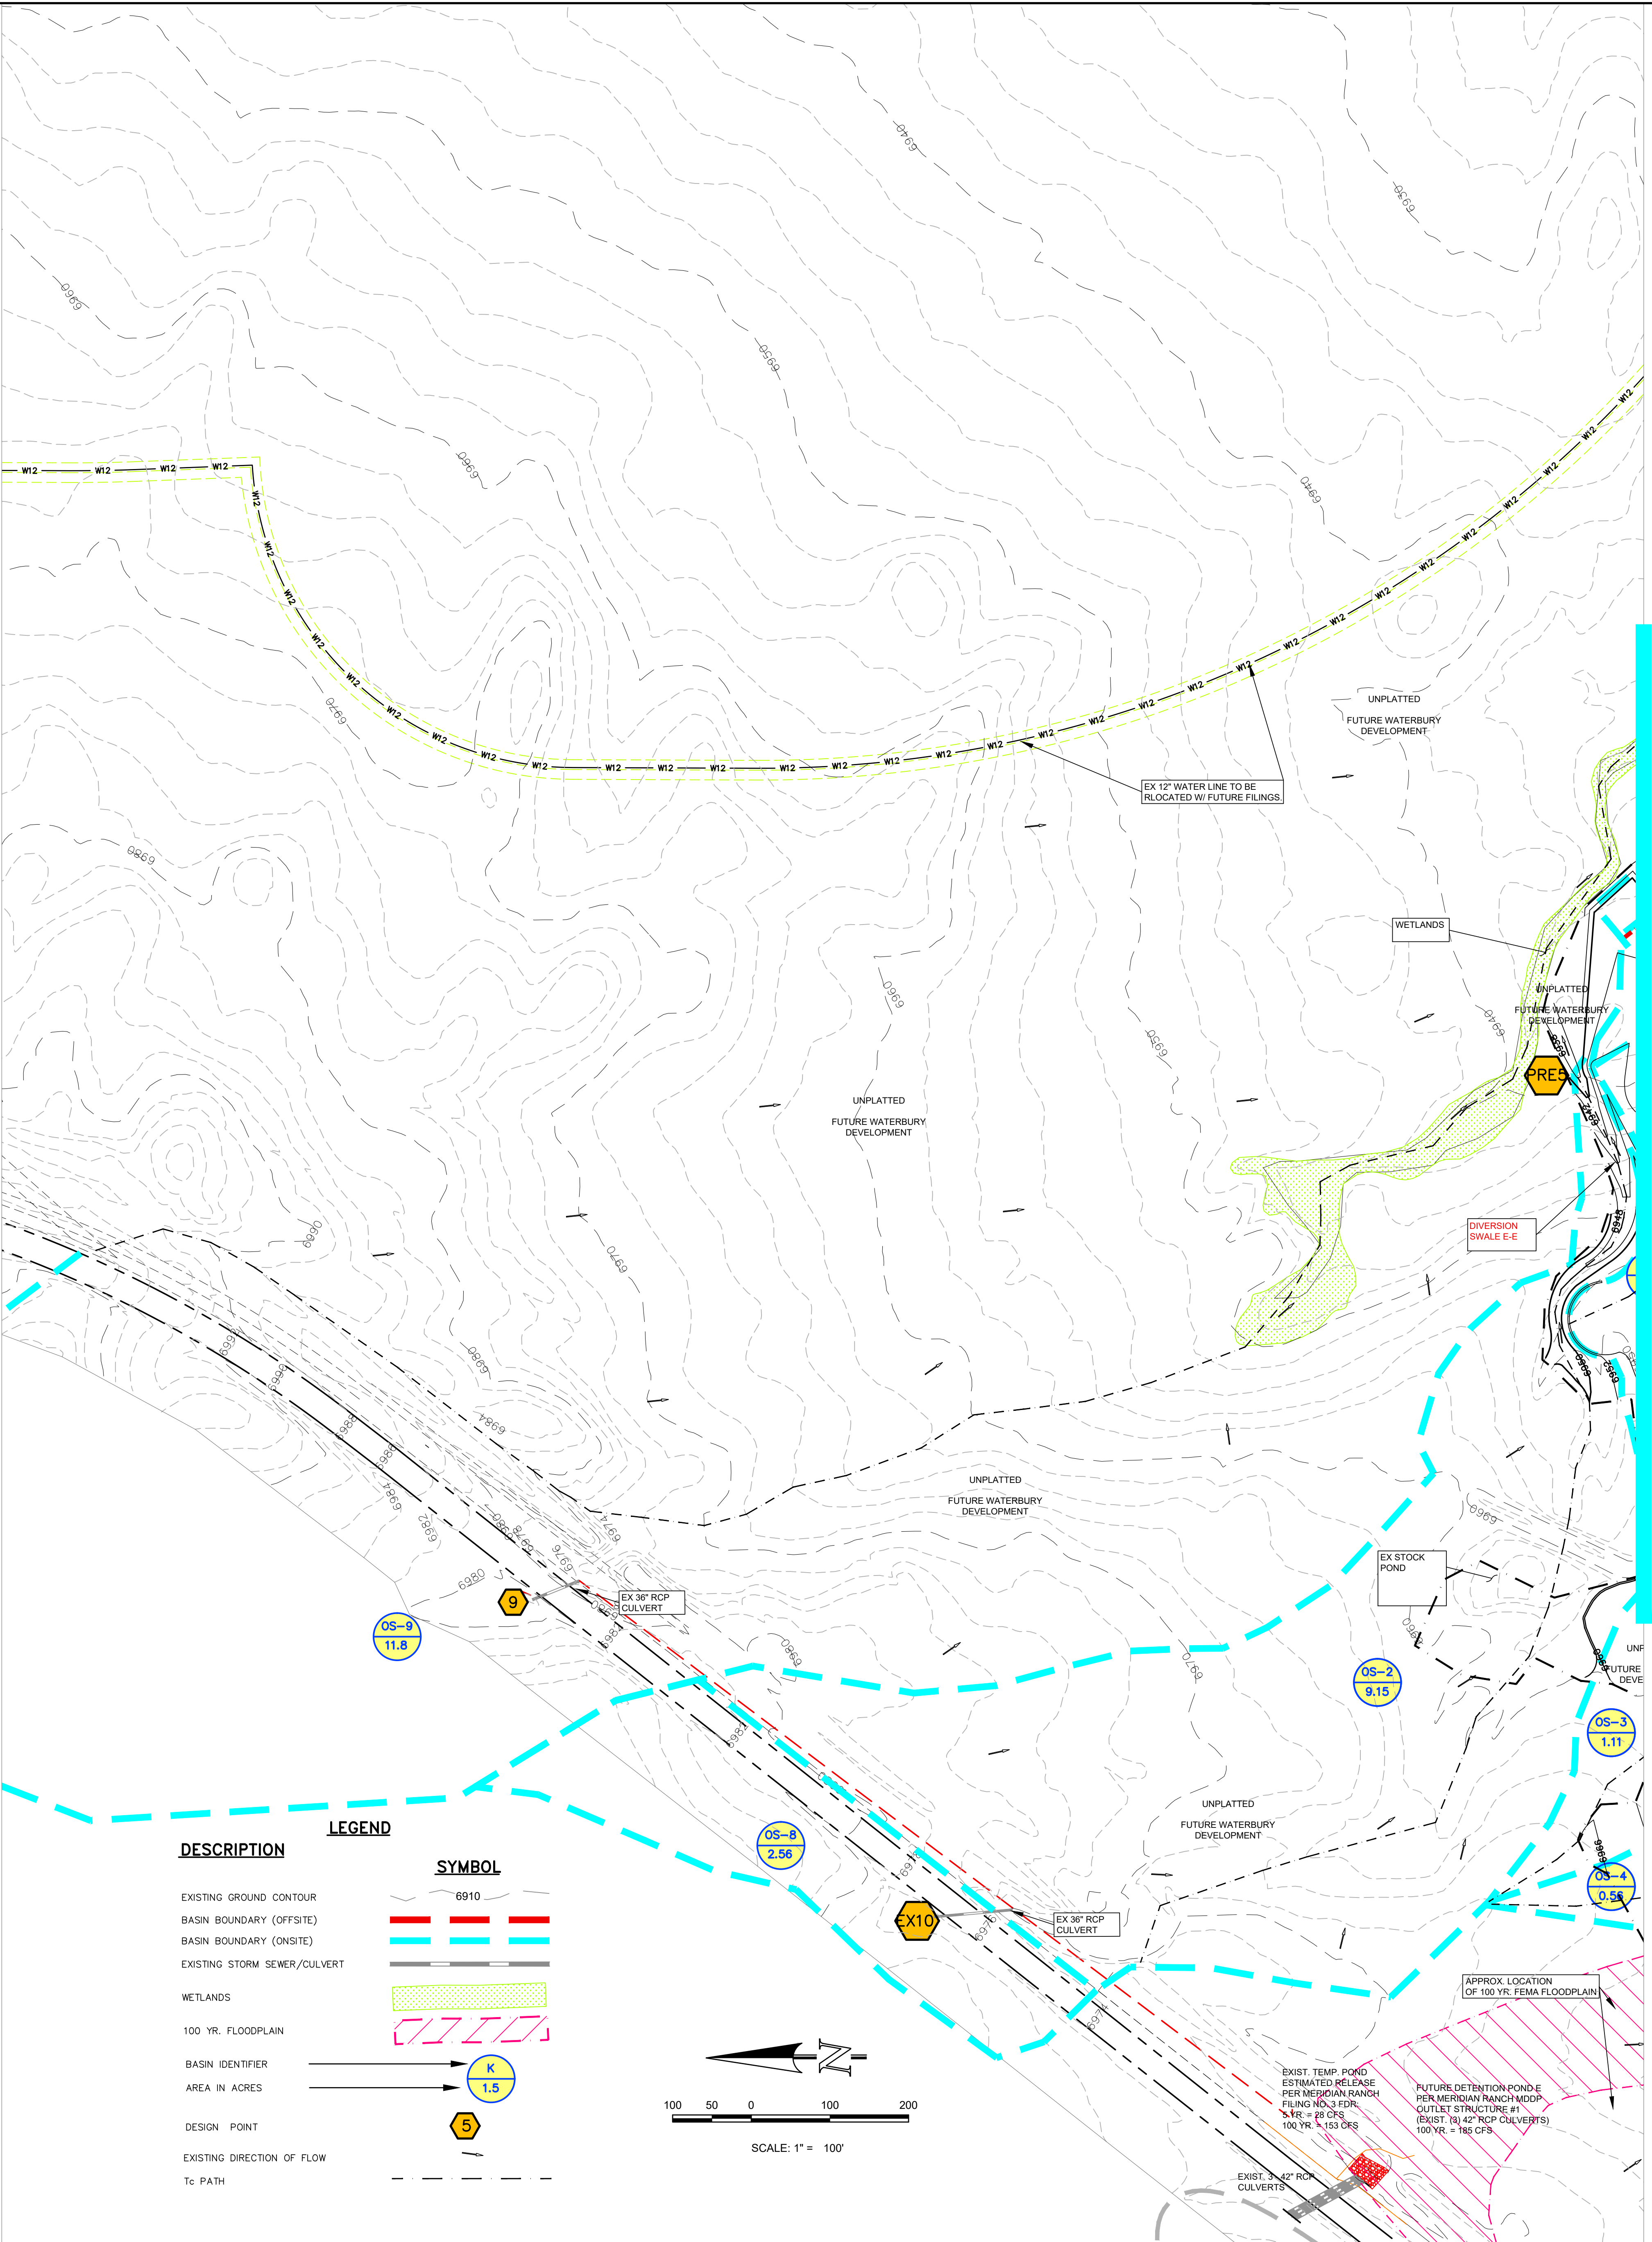

REVISIONS

NO.	DESCRIPTION	DATE

UNTIL SUCH TIME AS THESE PLANS ARE REVISED BY THE APPLICANT, THE REVIEWING AGENCIES, ENGINEERING AND SURVEYING, INC., APPROVES THEIR USE ONLY FOR THE PROJECT DESIGNATED BY WRITTEN AUTHORIZATION.

PREPARED FOR:

4-WAY RANCH JOINT VENTURES
ATTN: PETER MARTZ
PO BOX 50223
COLORADO SPRINGS, CO 80949
719-471-3150

DESIGNED BY: QNA

DRAWN BY: QNA

CHECKED BY:

WATERBURY FILING 1 & 2

EARLY GRADING DRAINAGE MAP 2

OFFSITE MAP

H-Scale 1"=100'

V-Scale

JOB NO. 1715.00

DATE ISSUED 3/3/22

SHEET NO. 2 OF 2


MDDP ~ PROPOSED SURFACE ROUTING SUMMARY											
Design Point(s)	Contributing Basins	Area (AC)	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Facility Size	
						I(5)	I(100)	Q(5)	Q(100)		
1	A	3.39	1.52	2.00	14.3	3.54	6.03	5	12	10" Type R Sump Inlet	
2	C	0.86	0.39	0.51	9.9	4.98	8.14	2	4	5" Type R Sump Inlet	
3	B1	2.30	1.03	1.36	14.2	3.55	6.05	4	8	5" Type R Sump Inlet	
4	B2	2.69	1.21	1.59	14.8	3.49	5.93	4	9	5" Type R Sump Inlet	
5	F & H	3.31	1.49	1.95	9.5	4.14	7.22	6	14	10" Type R Sump Inlet	
6	D	2.11	0.95	1.24	11.4	3.87	6.89	4	8	5" Type R Sump Inlets	
7	E	2.18	0.98	1.29	13.8	3.59	6.12	4	8	5" Type R Sump Inlets	
7A	G1	0.53	0.24	0.31	5.0	5.00	9.06	1	3	5" Type R At-grade Inlet	
7B	G2	0.69	0.31	0.41	5.0	5.00	9.06	2	4	5" Type R At-grade Inlet	
8	DESIGN POINTS 1-7 & K	16.84	7.58	9.94	14.8	3.49	5.93	26	59	FSD Pond 1	
9	OS-9	11.80						8	19	EX 36" CMP Culvert	
10	OS-8	2.56						5	11	EX 36" CMP Culvert	
10A	MERIDIAN POND E RELEASE	Meridian Ranch Filing 3 FDR Calculated Flows								28	185
11	OS-S, L DP10A (MERIDIAN POND E RELEASE)	Sum of Basins								36	213
12	OS-6	1.06	0.48	0.63	10.1	4.05	7.04	2	4	18" RCP Culvert	
13	TOTAL OFFSITE EX STOCK POND INFLOW	Per Final Drainage Report for Waterbury Filing No. 1 dated September 2016, by Classic Consulting								69	396
14	L1	3.04	1.37	1.79	16.1	3.36	5.69	5	10	10" Type R Sump Inlet	
15	L2	2.00	0.90	1.18	12.8	3.70	6.34	3	7	5" Type R Sump Inlet	
16	O1	2.82	1.27	1.66	13.5	3.62	6.19	5	10	10" Type R Sump Inlet	
17	O2	0.71	0.32	0.42	15.5	3.42	5.80	1	2	5" Type R Sump Inlet	
18	DESIGN POINTS 14-17 & BASIN OS-4	19.48	4.84	5.06	16.1	3.36	5.69	16	29	Interim FSD Pond 2	
19	Q1 & OS-Q1	5.37	2.41	3.17	22.4	2.88	4.78	7	15	10" Type R Sump Inlet	
20	Q2 & OS-Q2	1.89	0.85	1.12	12.4	3.75	6.43	3	7	5" Type R Sump Inlet	
21	R & OS-R	7.06	3.18	4.17	11.4	3.87	6.89	12	28	10" Type R At-grade Inlet	
22	S1 & OS-S1 & DP 21 FLOW BY	6.34	4.42	5.64	16.7	3.32	5.90	15	32	10" Type R Sump Inlet	
23	S2 & OS-S2	0.31	0.14	0.18	12.8	3.72	6.39	1	1	10" Type R Sump Inlet	
22 & 23 SPLIT	S1, OS-S1, S2, OS-S2 & DP 21 FLOW BY	6.65	4.56	5.82	16.7	3.32	5.90	8	16	2-10" Type R Sump Inlets	
24	T1	1.42	0.64	0.84	10.7	3.97	6.88	3	6	5" Type R Sump Inlets	
25	T2 & OS-T2	1.99	0.90	1.18	13.5	3.63	6.20	3	7	5" Type R Sump Inlets	
26	U1	4.38	1.97	2.58	14.3	3.54	6.03	7	16	10" Type R Sump Inlets	
27	U2	1.89	0.85	1.11	13.8	3.59	6.12	3	7	5" Type R Sump Inlets	
28	W	5.20	2.34	3.07	15.0	3.47	5.89	8	18	2-10" Type R Sump Inlets	
29	DPS 19-26, 31-32, OFF SITE BASINS OS-1, 2, 3, 36, 7, 8, 9	82.02	35.91	47.46	22.4	2.88	4.78	112	246	FSD POND	
30	W & OS-W	3.76	0.46	1.43	13.5	3.62	6.19	2	9	Triple 36" RCP Culverts	
30	FSD POND 3 EMERGENCY SPILLWAY RELEASE	MHFD DETENTION 100YR PEAK INFLOW								204	
31	V	0.54	0.24	0.32	5.0	5.00	9.06	1	3	18" DIA INLETS	
32	X	0.43	0.19	0.25	5.0	5.00	9.06	1	2	18" DIA INLETS	
33	O-3	0.45	0.20	0.27	5.0	5.00	9.06	1	2	18" DIA INLETS	
34	O-4	0.38	0.17	0.23	5.0	5.00	9.06	1	2	18" DIA INLETS	

MDDP ~ PROPOSED BASIN RUNOFF SUMMARY											
BASIN	CA(5)	CA(100)	OVERLAND			STREET / CHANNEL FLOW			Tc		
			C(5)	Length (ft)	Height (ft)	Slope (ft/ft)	Velocity (ft/s)	Tc (min)	Tc (min)	I(5) (in/hr)	I(100) (in/hr)
A	1.52	2.00	0.25	100	2	12.6	4.0	1.5	4.3	1.6	14.3
B1	1.03	1.36	0.25	100	2	12.6	4.0	1.5	4.3	1.6	14.2
B2	1.21	1.59	0.25	100	2	12.6	4.0	1.5	4.3	2.1	14.8
C	0.39	0.51	0.25	20	0.5	5.3	500	2.0	4.9	1.7	6.9
D	0.95	1.24	0.25	80	2	10.5	300	2.5	5.5	0.9	11.4
E	0.98	1.29	0.25	100	2	12.6	400	2.5	5.5	1.2	13.8
F	0.98	1.29	0.25	50	2	7.1	630	1.5	4.3	2.4	9.5
G1	0.24	0.31	0.25							5.0	5.00
G2	0.31	0.41	0.25							5.0	5.00
H	0.51	0.67	0.25	50	2	7.1	525	1.5	4.3	2.0	9.2
I	1.43	2.72	0.25	80	4	8.4	250	2.0	4.9	0.9	9.2
J	0.90	1.17	0.25	99	6	8.1	650	2.0	4.9	2.9	10.9
K	0.69	1.37	0.25	100	18	6.1	80	1.0	3.5	0.4	6.5
L1	1.37	1.79	0.25	100	2	12.6	660	1.4	4.1	3.5	16.1
L2	0.90	1.18	0.25	55	1.1	9.4	860	1.4	4.1	3.5	12.8
M1	0.74	0.97	0.25	70	1.5	10.3	200	2.0	4.9	0.7	11.0
M2	0.30	0.26	0.25	65	3	7.7	0	0.0	0.0	7.7	4.43
N	0.10	0.13	0.25							5.0	5.00
O1	1.27	1.66	0.25	100	2.5	11.7	460	1.5	4.3	1.8	13.5
O2	0.32	0.42	0.25	100	2	12.6	850	2.0	4.9	2.9	15.5
O3	0.20	0.27	0.25							5.0	5.00
O4	0.17	0.23	0.25							5.0	5.00
P	0.06	0.25	0.25							5.0	5.00
Q1	0.48	0.62	0.25	55	1.3	8.9	445	2.0	5.0	1.5	10.4
Q2	0.43	0.56	0.25	55	1.3	8.9	445	2.0	5.0	1.5	10.4
R	0.46	0.60	0.25	100	4	10.1	700	2.0	4.9	2.4	12.4
S1	0.70	0.91	0.25	100	6	8.8	175	2.0	4.9	0.6	9.4
S2	0.06	0.08	0.25							5.0	5.00
T1	0.64	0.84	0.25	55	1.1	9.4	390	2.0	4.9	1.3	10.7
T2	0.55	0.73	0.25	100	2	12.6	345	2.0	5.0	0.8	13.5
U1	1.97	2.58	0.25	100	2	12.6	520	2.3	5.3	1.6	14.3
U2	0.85	1.11	0.25	100	2	12.6	385	2.3	5.4	1.2	13.8
V	0.24	0.32	0.25							5.0	5.00
W	2.34	3.07	0.25	100	2	12.6	630	1.6	4.4	2.4	15.0
X	0.19	0.25	0.25							5.0	5.00
Y	0.16	0.21	0.25							5.0	5.00
OS-1	5.31	6.97	0.25	100	2	12.6	699	2.0	5.0	2.3	15.0
OS-2	5.19	6.90	0.25	100	2	12.6	1700	1.8	4.6	6.1	16.7
OS-3A	0.35	0.47	0.25	55	1.1	9.4	480	1.3	3.9	2.0	11.4
OS-3B	2.55	3.34	0.25	100	2	12.6	480	1.3	3.9	2.0	14.7
OS-4	0.98	3.92	0.25	800	26	30.5				30.5	2.46
OS-5	0.51	2.03	0.25	80	5	7.8	1000	2.5	5.5	3.0	10.8
OS-6	0.48	0.63	0.25	30	0.6	6.9	900	1.6	4.7	3.2	16.1
OS-7	0.25	1.01								5.0	5.00
OS-8	FLOW TAKEN FROM MERIDIAN RANCH MDDP										5
OS-9	FLOW TAKEN FROM MERIDIAN RANCH MDDP										8
OS-10	0.31	1.23	0.25	100	2	12.6	300	2.7	5.7	0.9	13.5
OS-Q1	1.94	2.54	0.25	200	5	16.6	1000	1.5	4.3	5.8	22.4
OS-Q2	0.43	0.55	0.25	50	1	8.9	300	1.5	4.3	3.5	12.4
OS-R	2.72	3.57	0.25	99	1	8.9	650	2.7	5.8	2.5	11.4
OS-S1	2.51	3.30	0.25	100	2	12.6	920	1.2	3.8	4.0	16.7
OS-S2	0.08	0.10	0.25	100	2	12.6				12.6	3.72
OS-T2	0.34	0.45	0.25	100	2	12.6				12.6	3.72


MDDP - PIPE ROUTING SUMMARY										
Pipe Run	Contributing Design Points/Basins	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Pipe Size*	
					I(5)	I(100)	Q(5)	Q(100)		
1	DP 2	0.39	0.51	6.9	4.58	8.14	2	4	18" RCP	
2	DP 1 & 2	1.91	2.51	14.3	3.54	6.03	7	15	24" RCP	
3	DP 3	1.03	1.36	14.2	3.55	6.05	4	8	18" RCP	
4	DP-4	1.21	1.59	14.8	3.49	5.93	4	9	18" RCP	
5	DP 3 & 4	2.25	2.94	14.8	3.49	5.93	8	17	24" RCP	
6	DP 1-4	4.16	5.45	14.8	3.49	5.93	15	32	30" RCP	
7	DP-1-5	5.65	7.41	14.8	3.49	5.93	20	44	36" RCP	
8	DP-6	0.95	1.24	11.4	3.87	6.69	4	8	18" RCP	
9	DP-7	0.88	1.29	13.8	3.59	6.12	4	8	18" RCP	
10	DP-8 & 7	1.97	2.58	13.8	3.59	6.12	7	16	24" RCP	
10A	DP-7A	0.24	0.31	5.0	5.00	9.06	1	3	24" RCP	
10B	DP-7A & 7B	0.55	0.72	5.0	5.00	9.06	3	7	24" RCP	
10C	POND 1 RELEASE	2.95	3.87	13.8	3.59	6.12	0.4	8.2	18" RCP	
11	DP-14	1.37	1.79	16.1	3.36	5.69	5	10	24" RCP	
12	DP-15	0.90	1.18	12.8	3.70	6.34	3	7	18" RCP	
13	DP 14 & 15	2.27	2.98	16.1	3.36	5.69	8	17	30" RCP	
14	DP 16	1.27	1.66	13.5	3.62	6.19	5	10	24" RCP	
15	DP 14, 15 & 16	3.54	4.64	16.1	3.36	5.69	12	26	36" RCP	
16	DP 17	0.32	0.42	15.5	3.42	5.80	1	2	18" RCP	
17	DP 14, 15, 16, 17, 33, & 34	4.24	5.55	16.1	3.36	5.69	14	32	36" RCP	
17A	POND 2 RELEASE						0.2	10.1	18" RCP	
18	DP 19	2.41	3.17	22.4	2.88	4.78	7	15	24" RCP	
19	DP 20	0.85	1.12	12.4	3.75	6.43	3	7	18" RCP	
20	DP 18 & 19	3.27	4.28	22.4	2.88	4.78	9	20	24" RCP	
21	DP 21 PICK UP						8	14	18" RCP	
22	DP 19, 20 & 21	6.04	7.21	22.4	2.88	4.78	17	34	30" RCP	
23	DP 22	2.28	2.91	16.7	3.32	5.60	8	16	24" RCP	
24	DP 23	2.28	2.91	16.7	3.32	5.60	8	16	24" RCP	
25	DP 22 & 23	4.56	5.82	16.7	3.32	5.60	15	33	30" RCP	
26	DP 19-23	10.60	13.03	22.4	2.88	4.78	31	62	36" RCP	
27	DP 24	0.64	0.84	10.7	3.97	6.88	3	6	18" RCP	
28	DP 25	0.90	1.18	13.5	3.63	6.20	3	7	18" RCP	
29	DP 19-25	12.13	15.05	22.4	2.88	4.78	35	72	36" RCP	
30	DP 26	1.97	2.58	14.3	3.54	6.03	7	16	24" RCP	
31	DP 19-26	14.10	17.63	22.4	2.89	4.79	41	84	42" RCP	
32	DP 27	0.85	1.11	13.8	3.59	6.12	3	7	18" RCP	
33	DP 19-27, & 31	15.19	19.06	22.4	2.88	4.78	44	91	42" RCP	
34	DP 28 SPLIT	1.17	1.53	15.0	3.47	5.89	4	9	18" RCP	
34A	29 & 32	2.53	3.32	15.0	3.47	5.89	9	20	18" RCP	
35	Pond 3 Release			MHFD U/D-DETENTION POND RELEASE			1.2	58.1	36" RCP	
36	DP 30			FSD POND 3 EMERGENCY SPLITWAY RELEASE				204.3	TRIPLE 36" RCP	
37	DP 31	0.24	0.32	5.00	5.00	9.06	1.2	3	15" HDPE	
38	DP 32	0.19	0.25	5.00	5.00	9.06	1.2	2	15" HDPE	
39	DP 33	0.20	0.27	5.00	5.00	9.06	1.2	2	15" HDPE	
40	DP 34	0.17	0.23	5.00	5.00	9.06	1.2	2	15" HDPE	

east chan pr PDR rev Plan: Plan 01 7/13/2022


2600

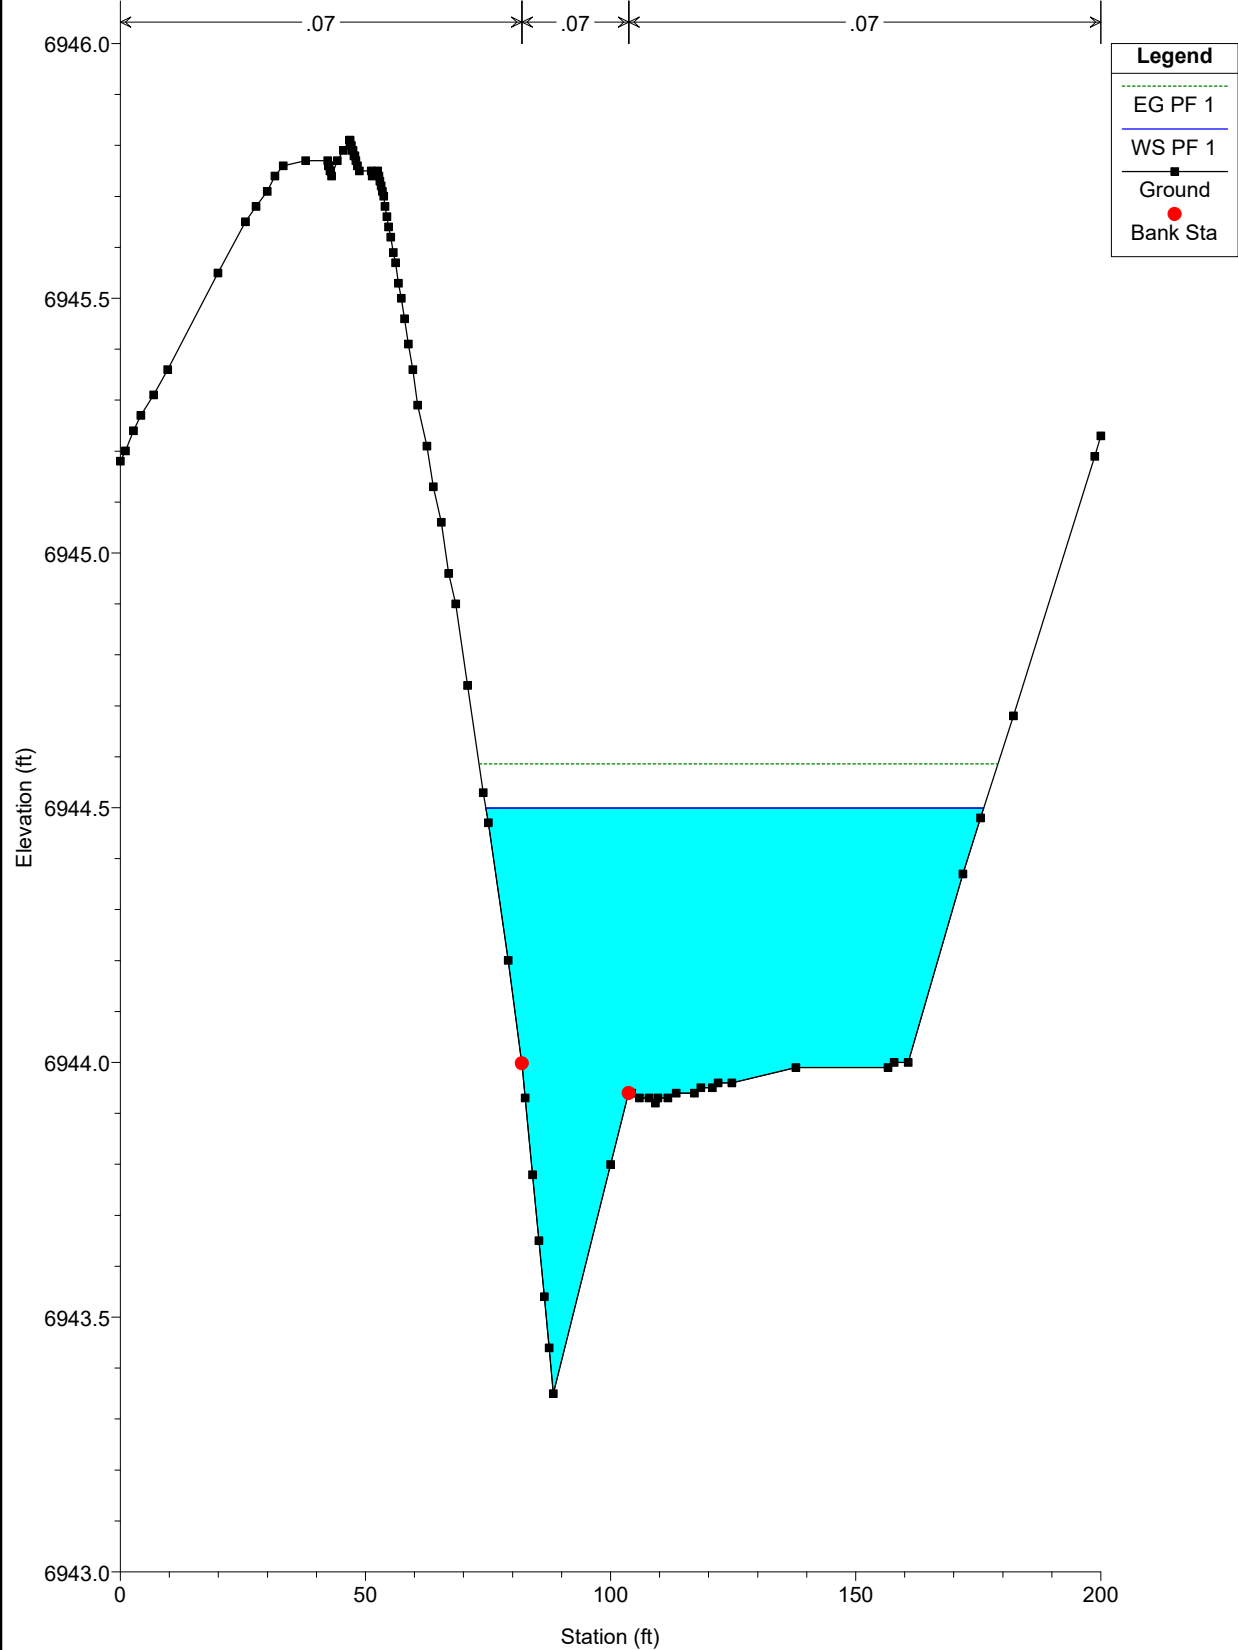


east chan pr PDR rev Plan: Plan 01 7/13/2022
2500

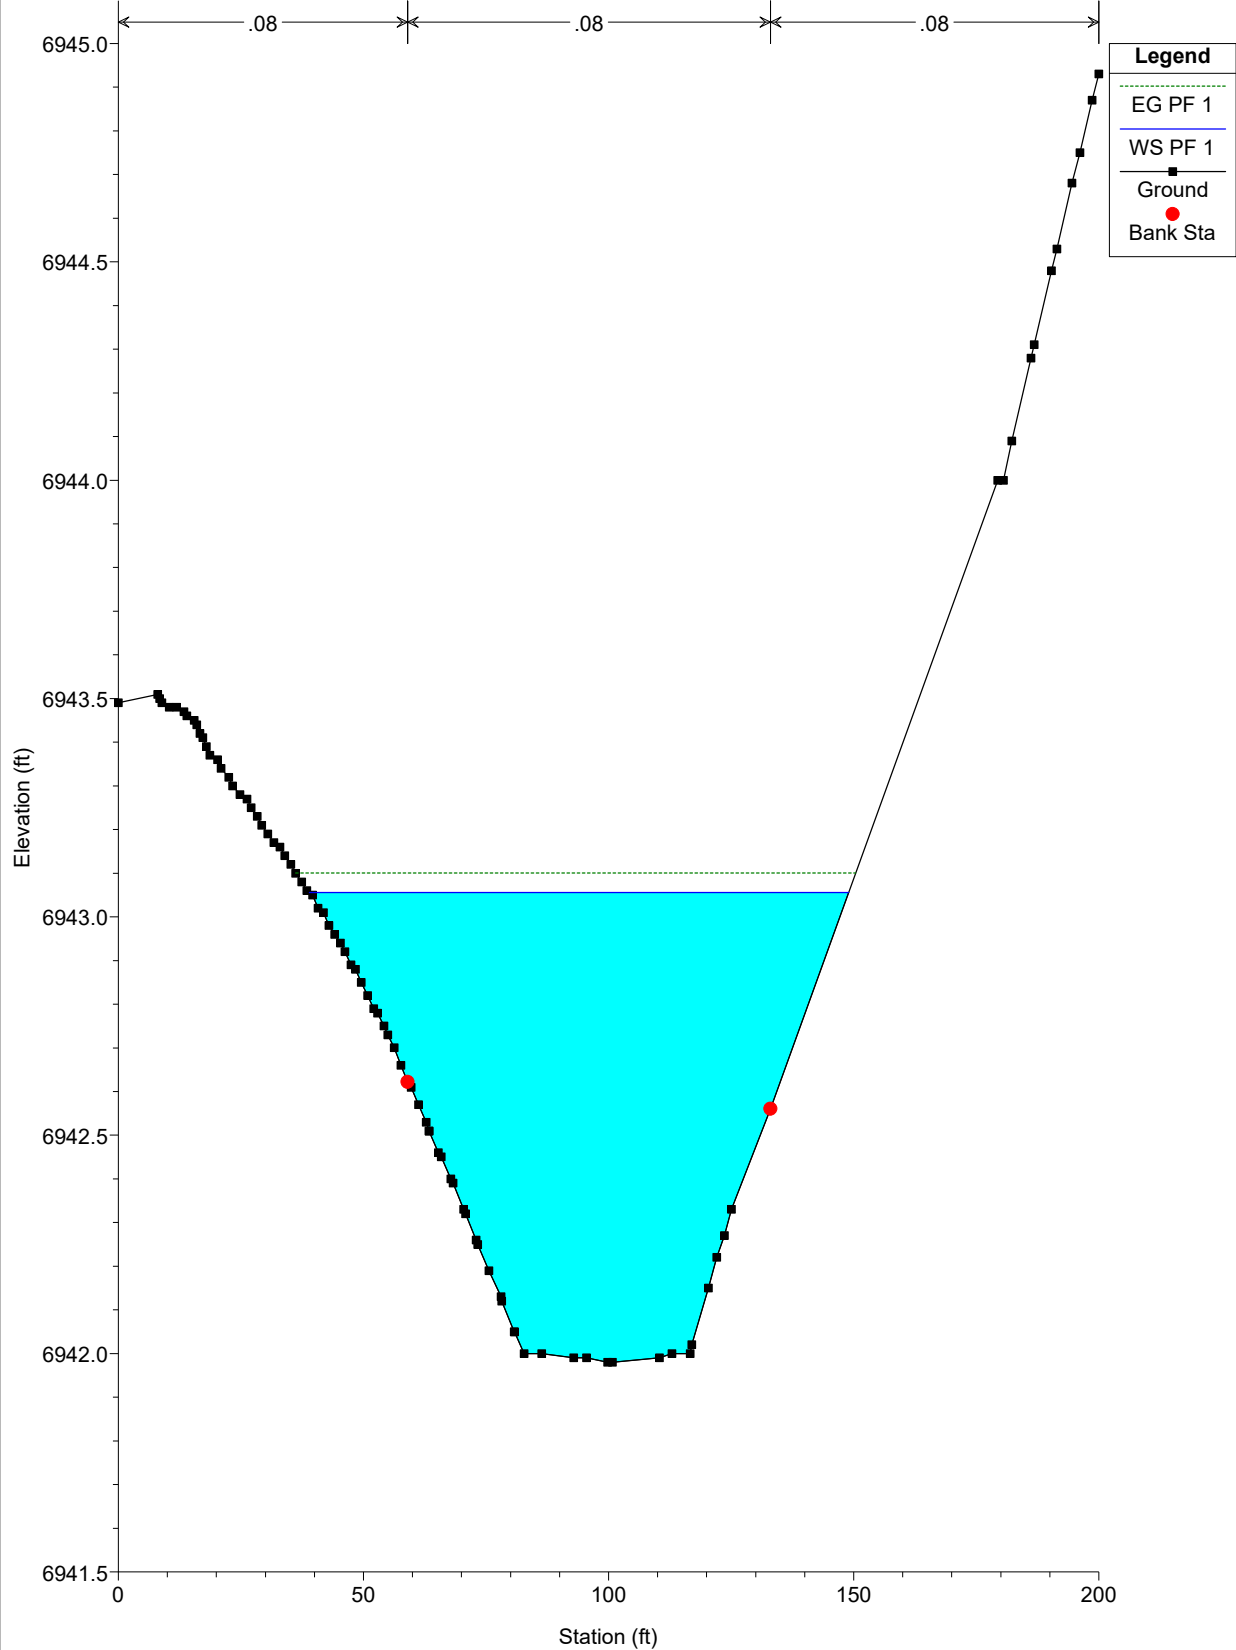


east chan pr PDR rev Plan: Plan 01 7/13/2022
2400

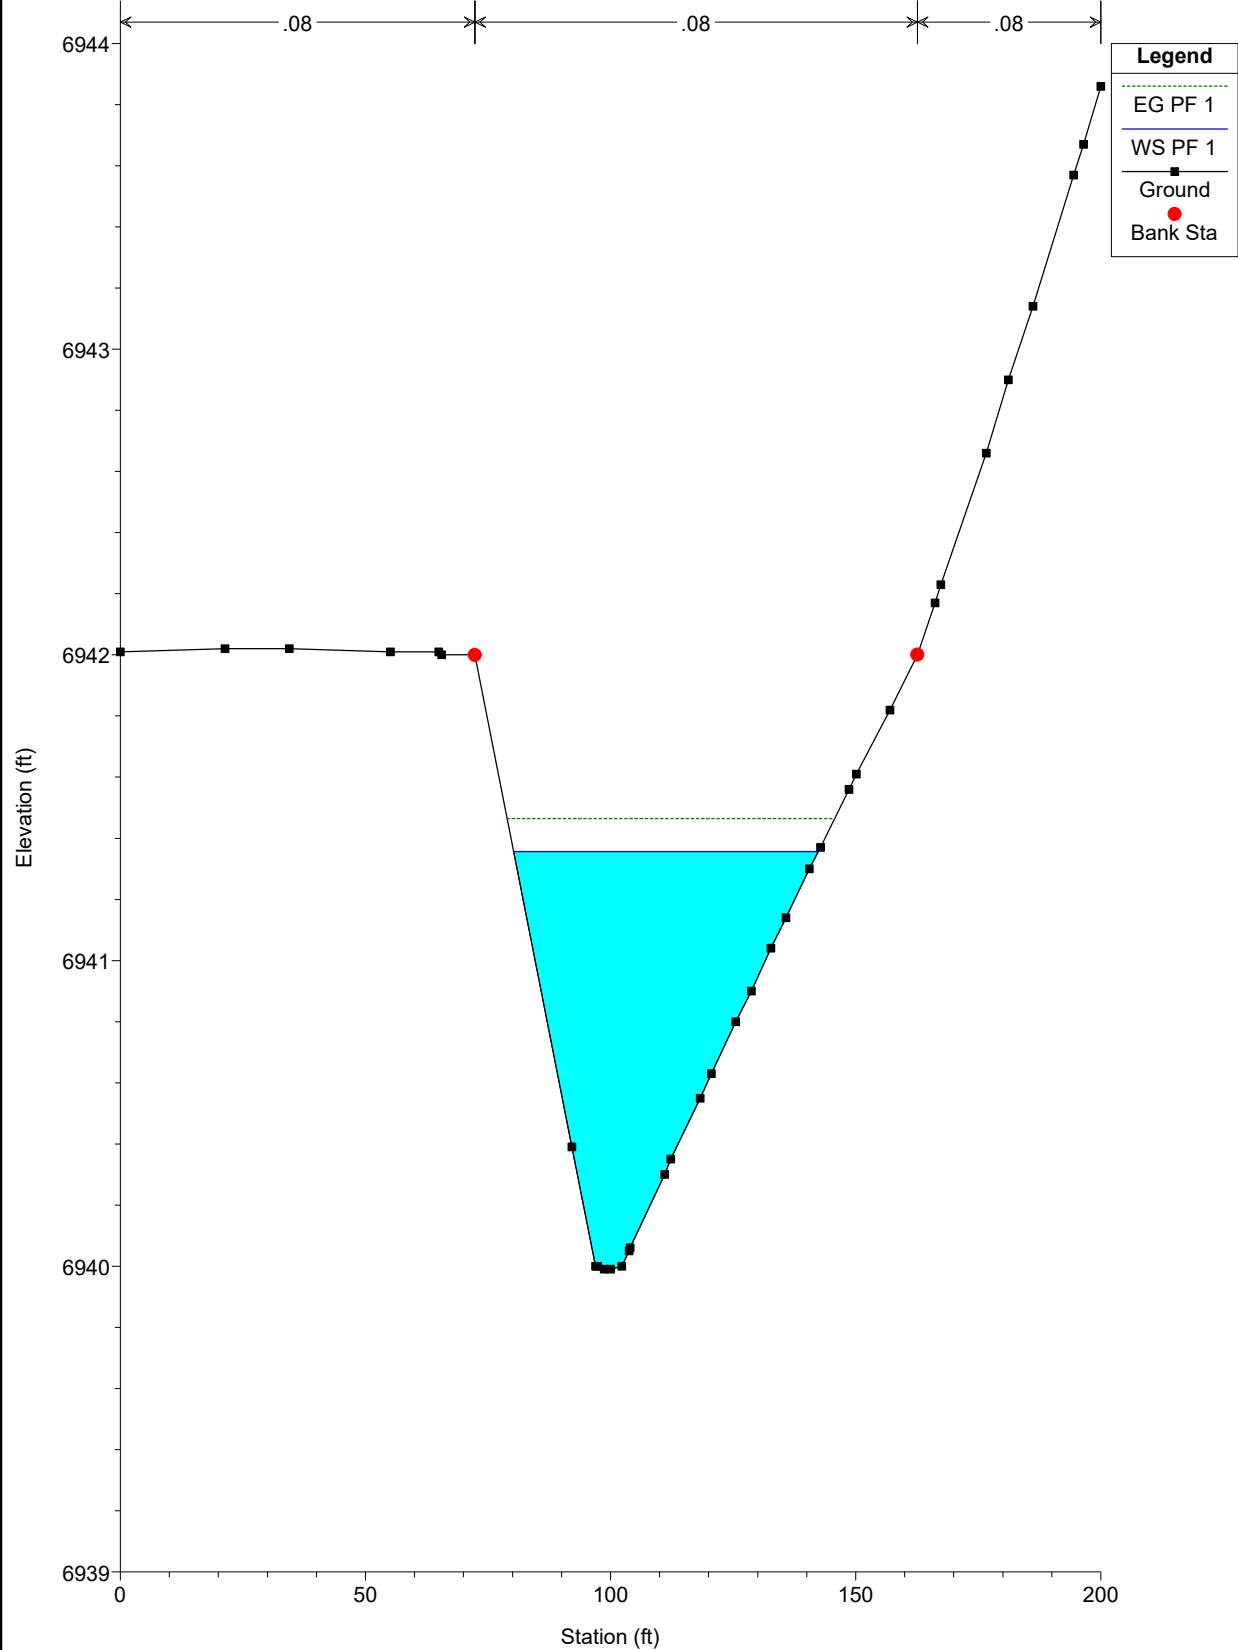


east chan pr PDR rev Plan: Plan 01 7/13/2022
2300

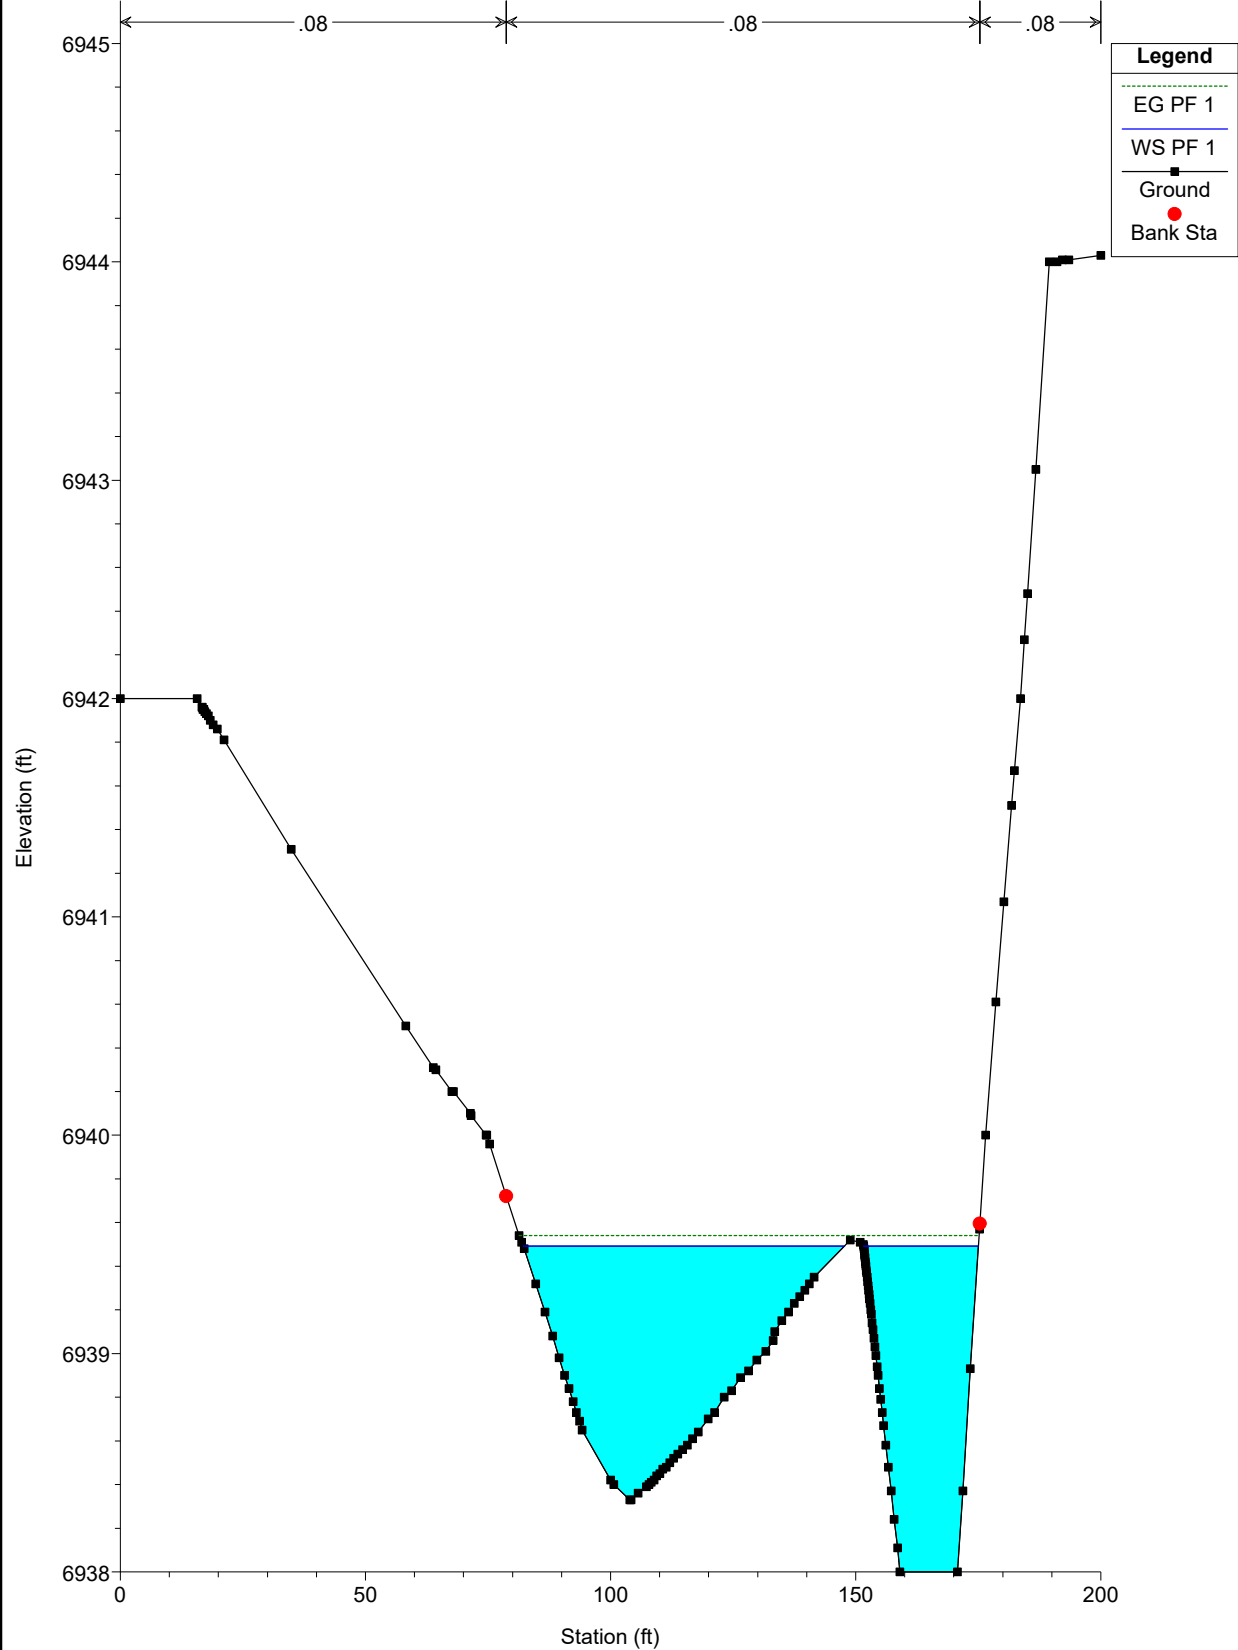

east chan pr PDR rev Plan: Plan 01 7/13/2022
2200

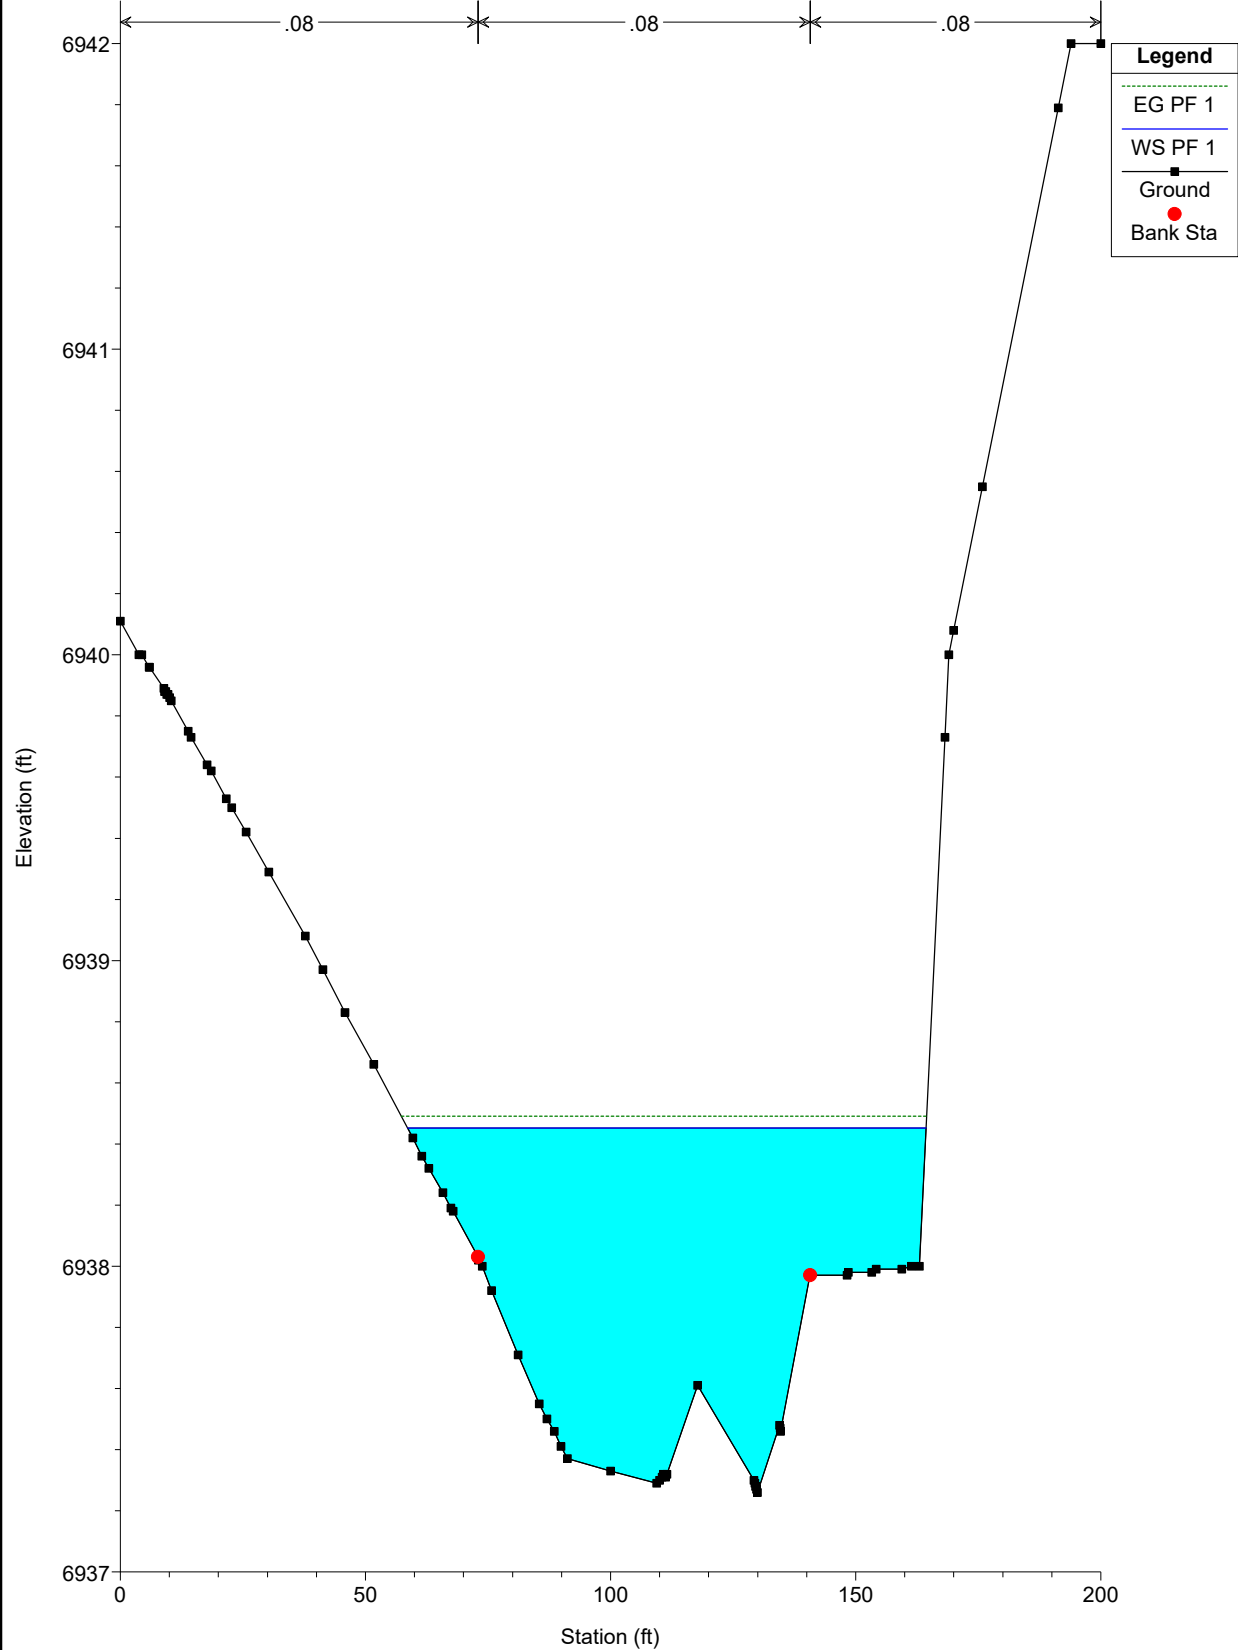


east chan pr PDR rev Plan: Plan 01 7/13/2022
2100

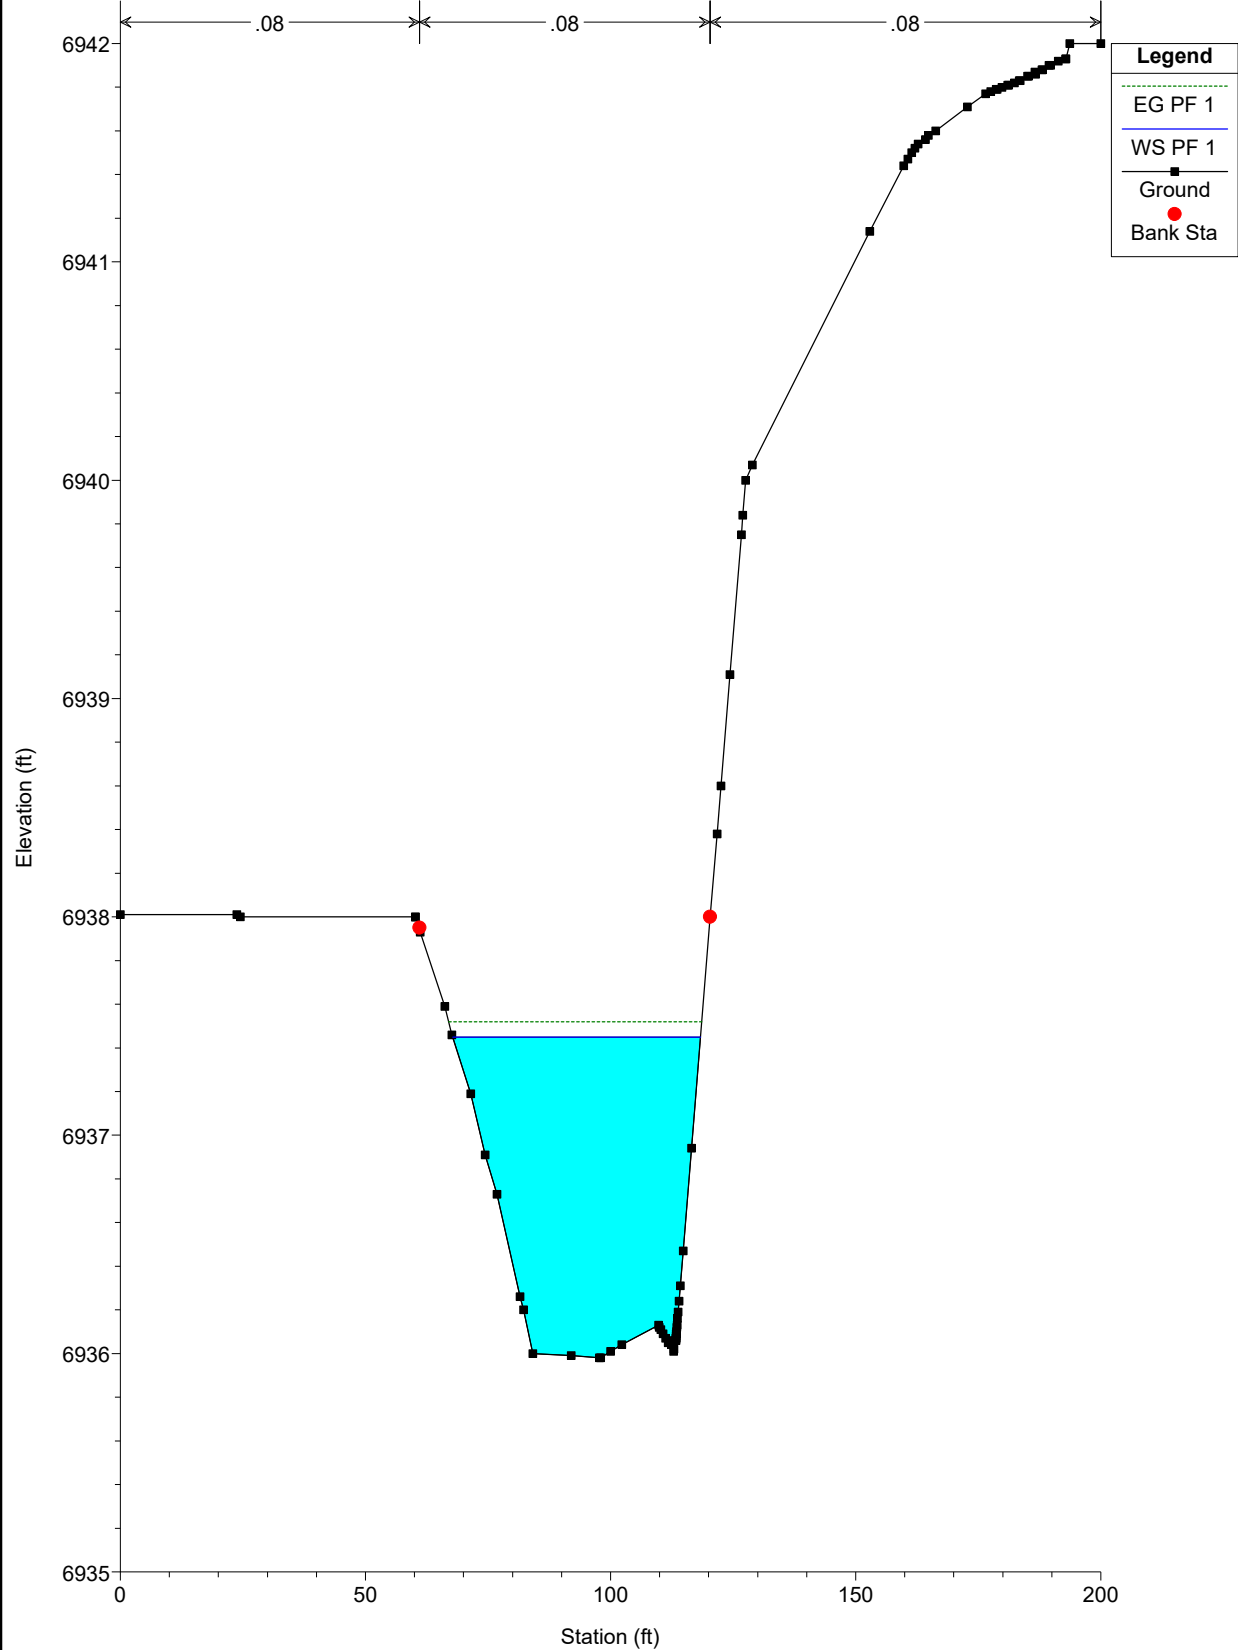


east chan pr PDR rev Plan: Plan 01 7/13/2022

2010.89

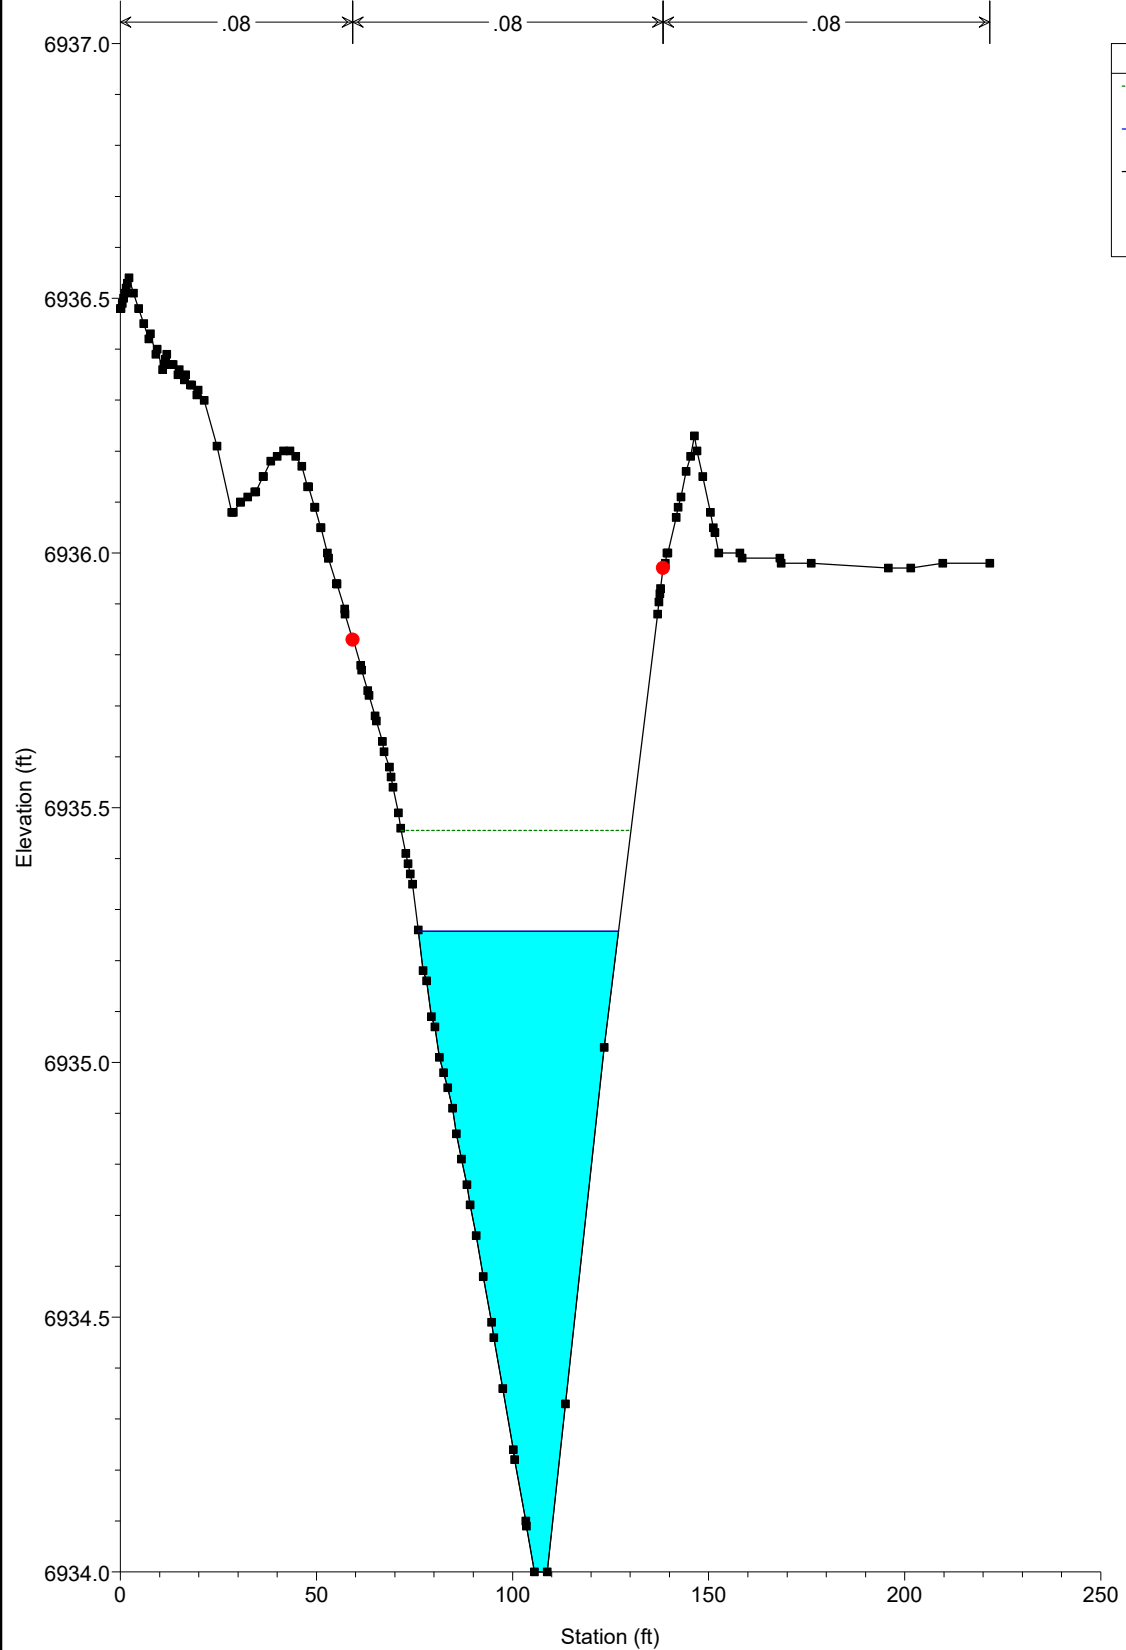


Legend	
EG PF 1	
WS PF 1	
Ground	
Bank Sta	

east chan pr PDR rev Plan: Plan 01 7/13/2022
1900

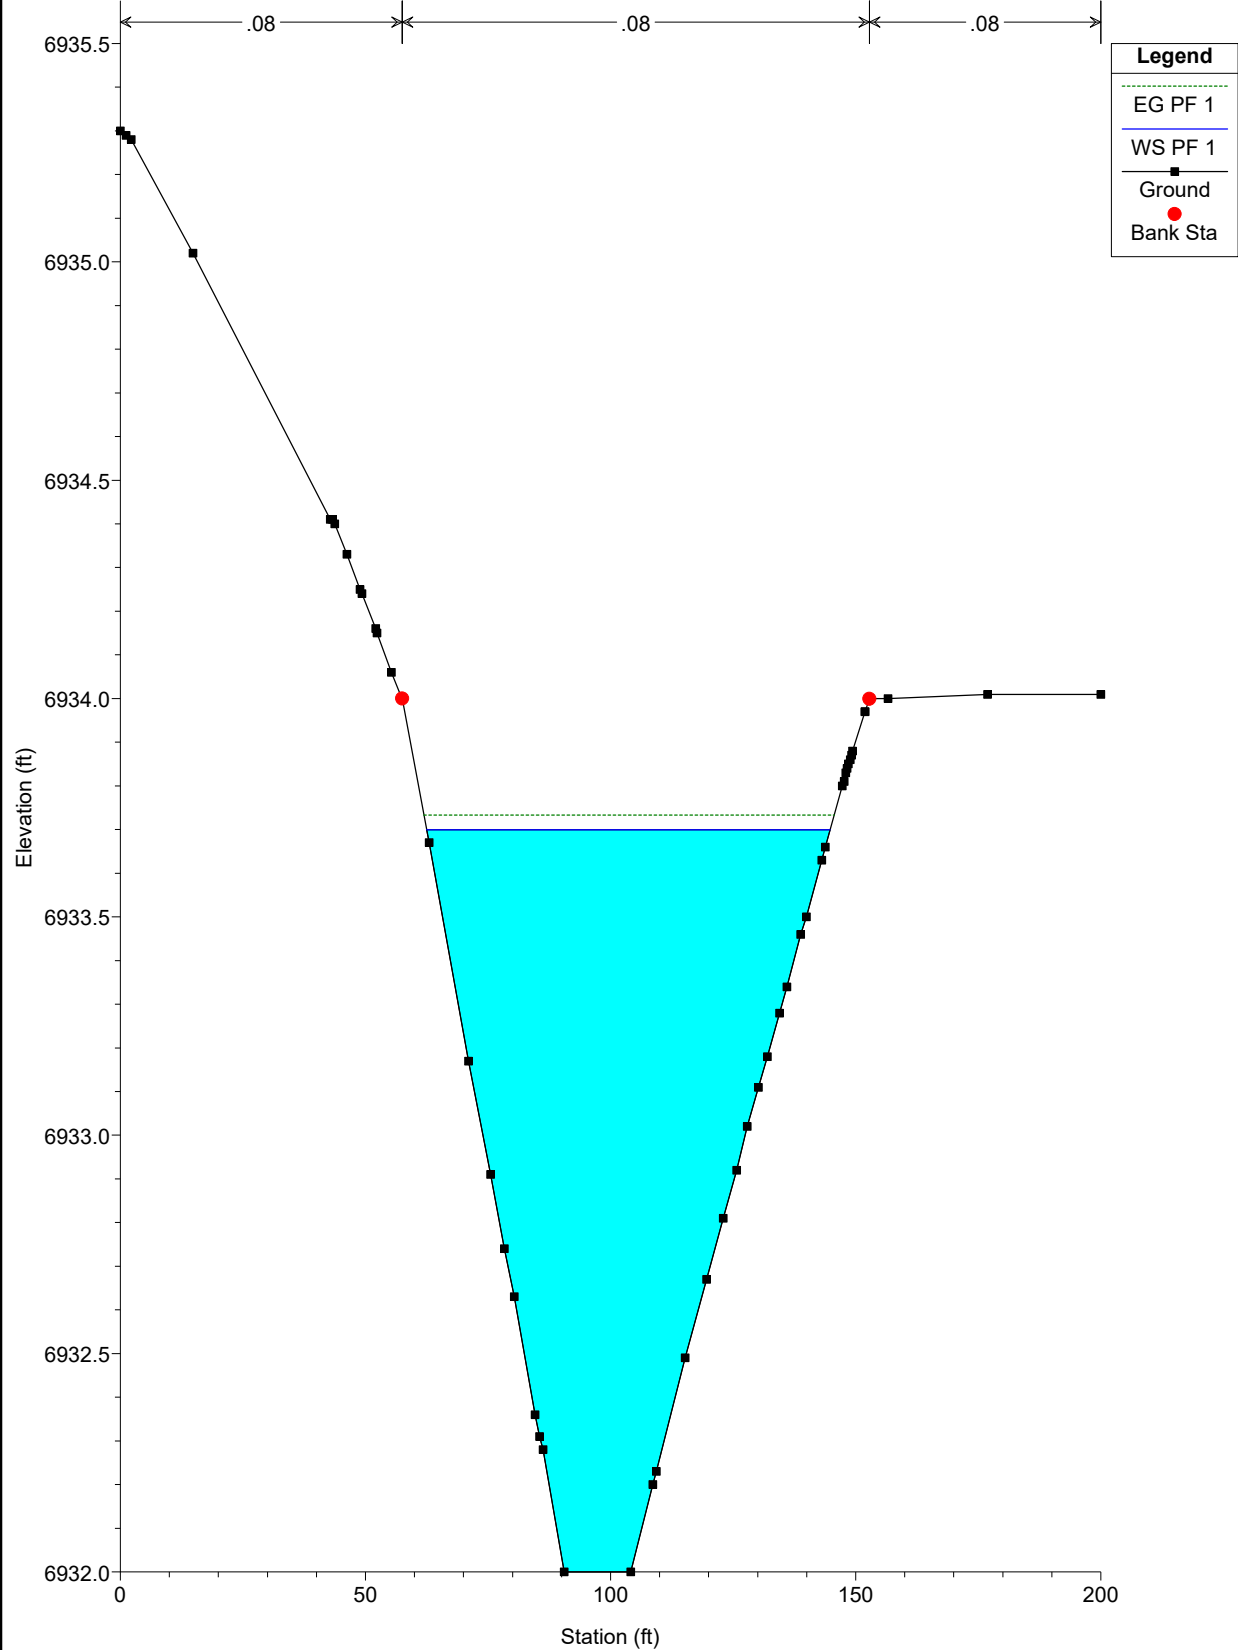


east chan pr PDR rev Plan: Plan 01 7/13/2022

1801.17

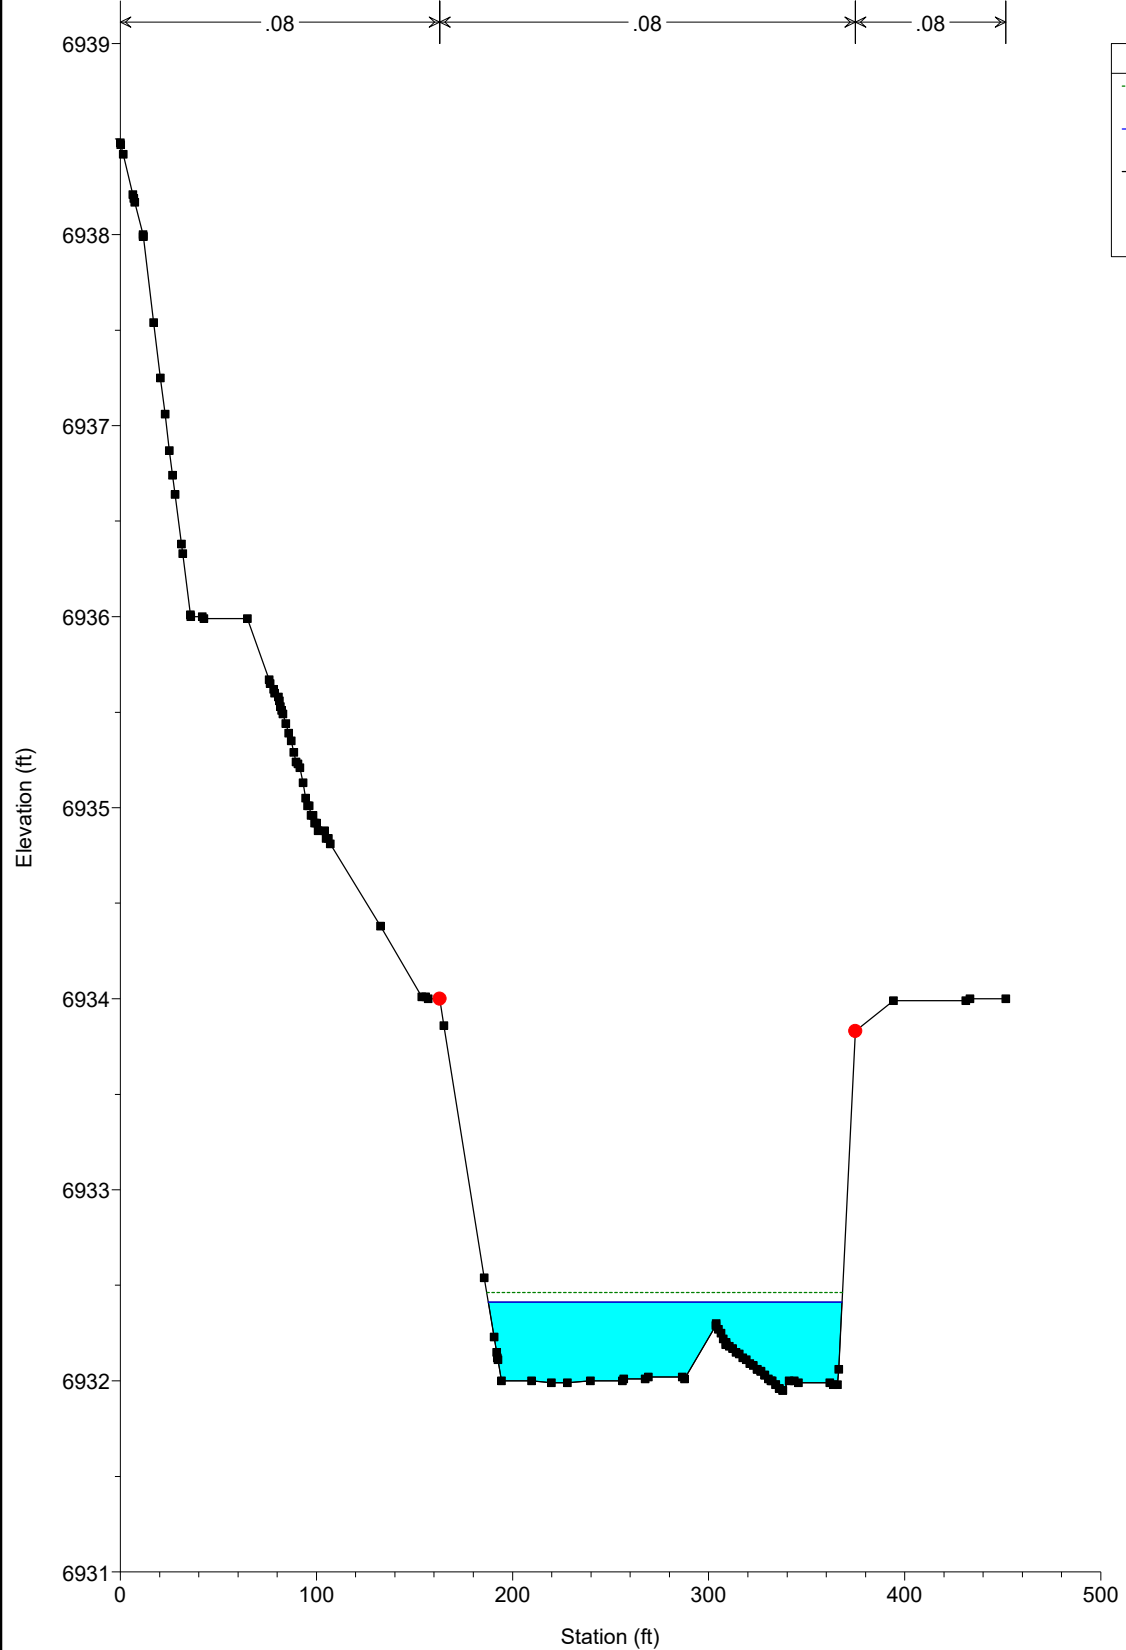



east chan pr PDR rev Plan: Plan 01 7/13/2022


1694.83

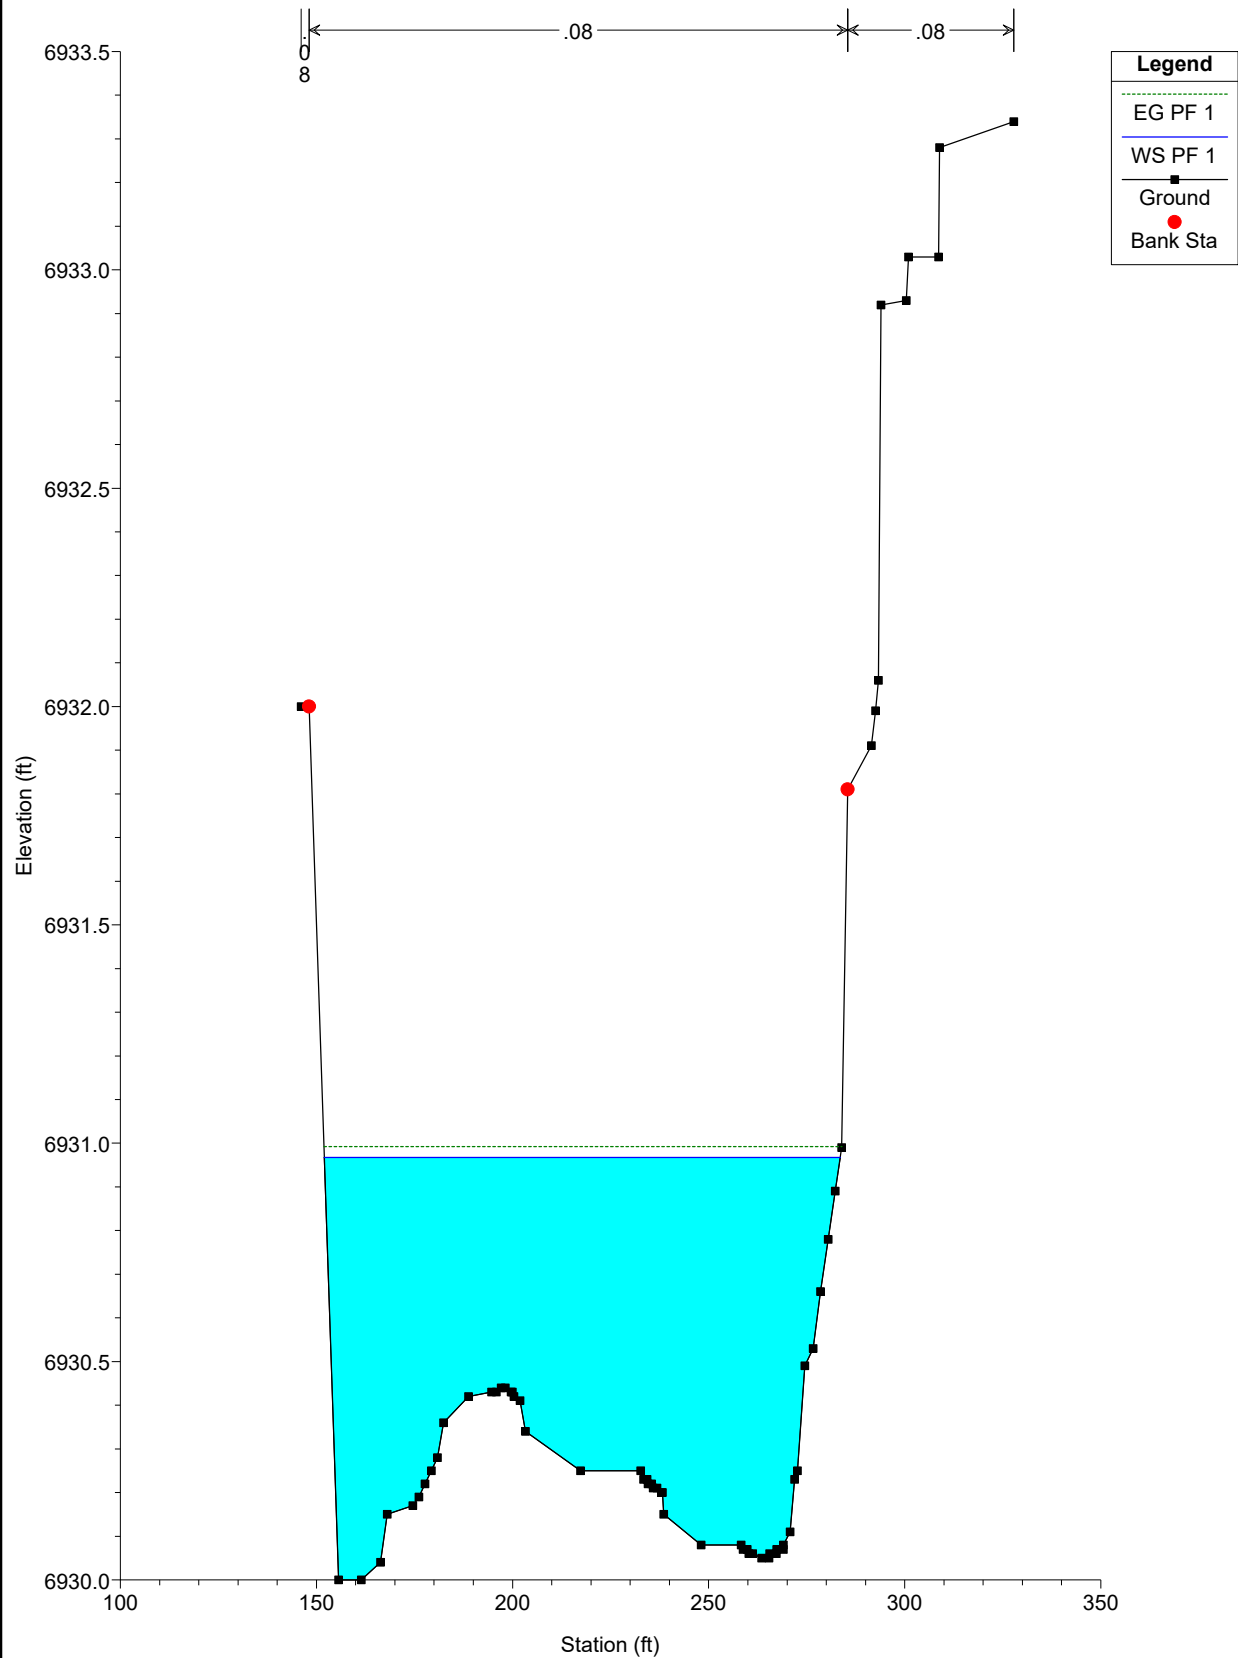


east chan pr PDR rev Plan: Plan 01 7/13/2022
1600

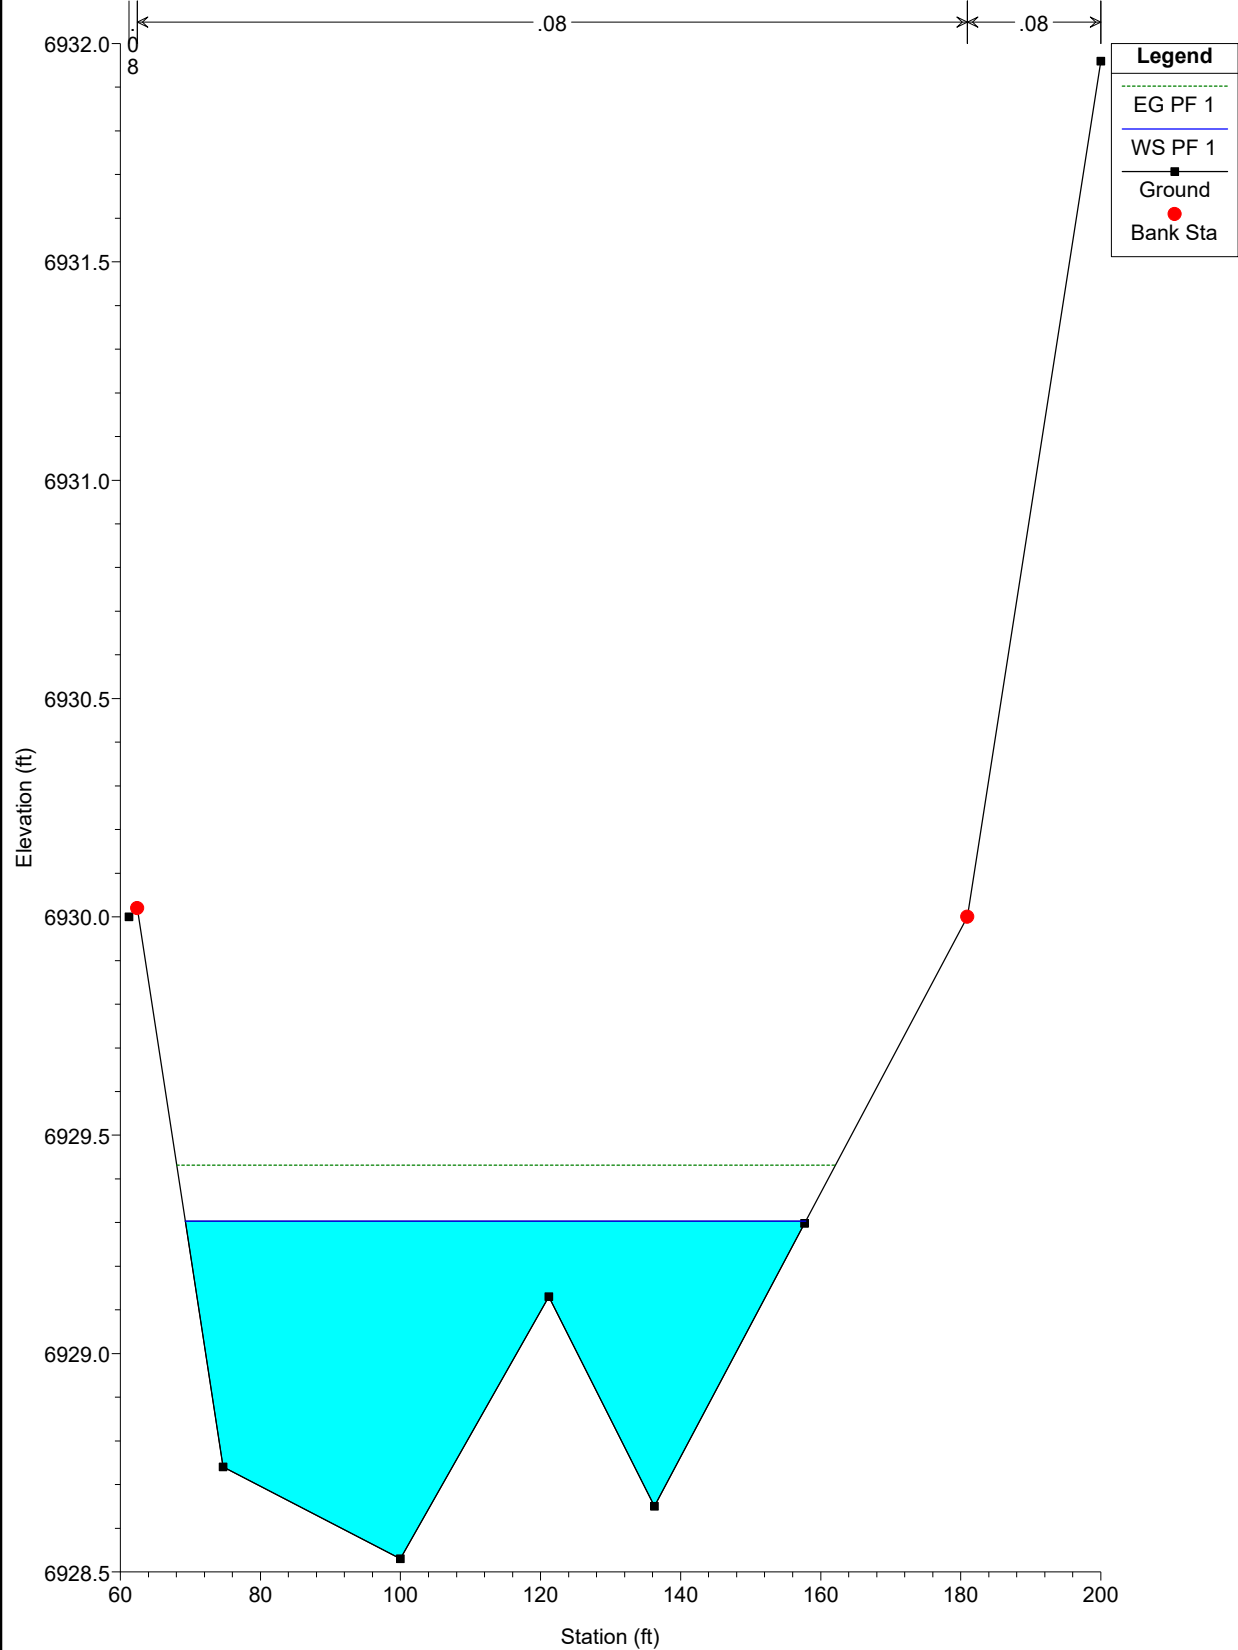


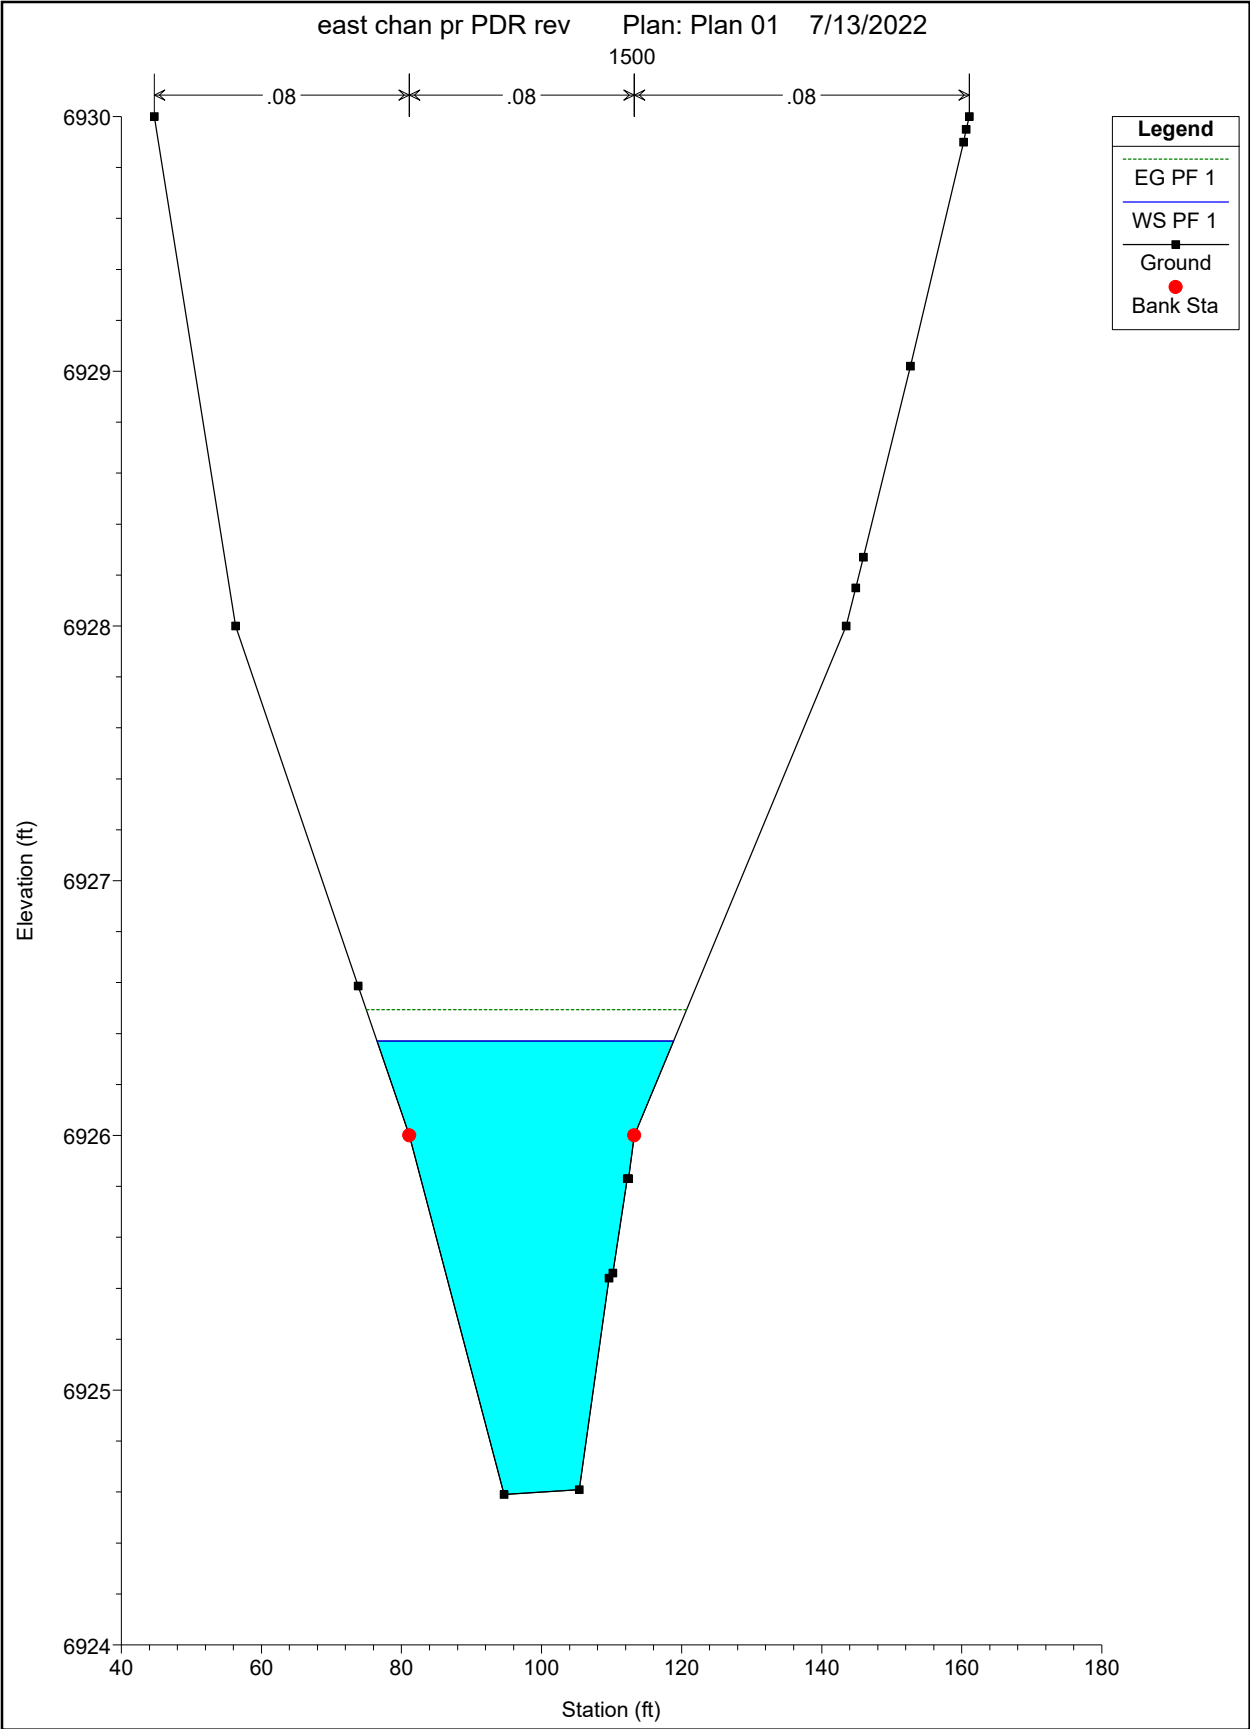

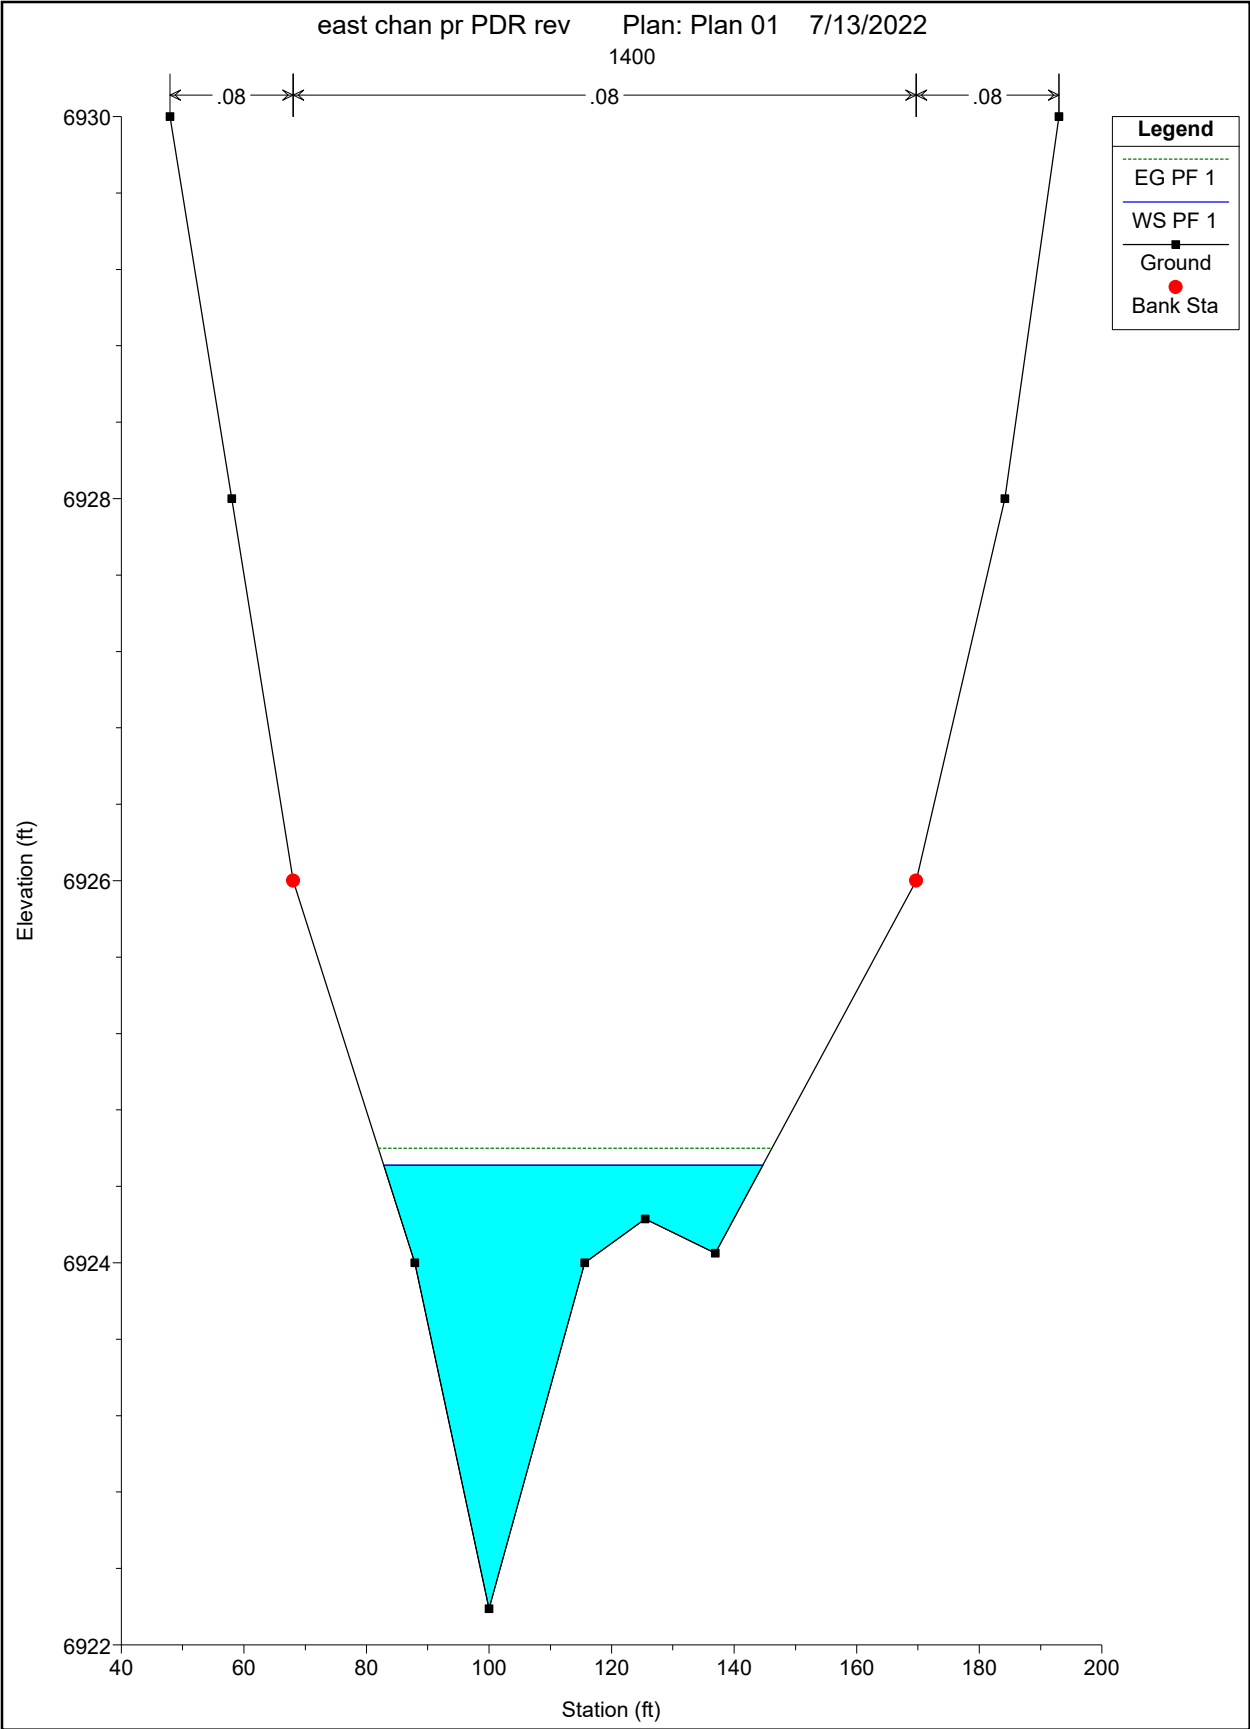


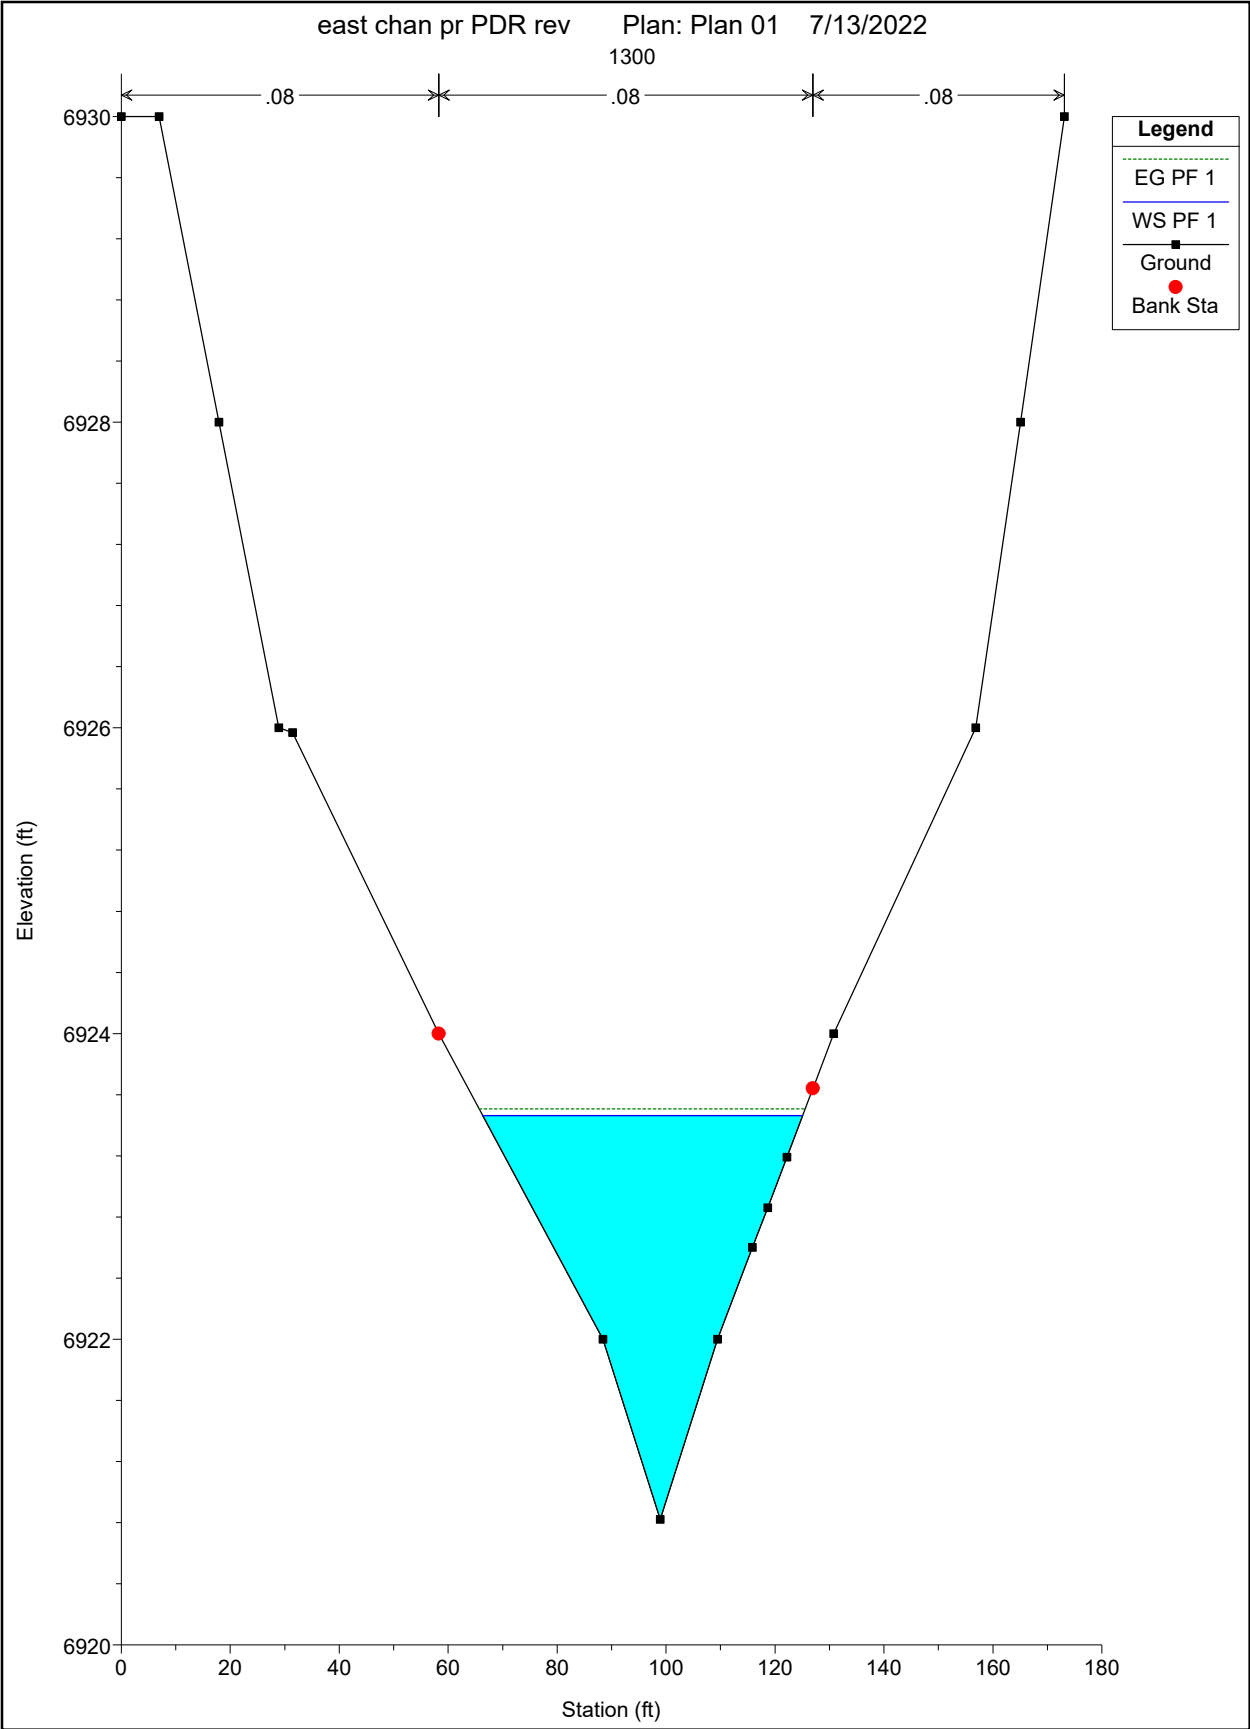


east chan pr PDR rev Plan: Plan 01 7/13/2022
1200

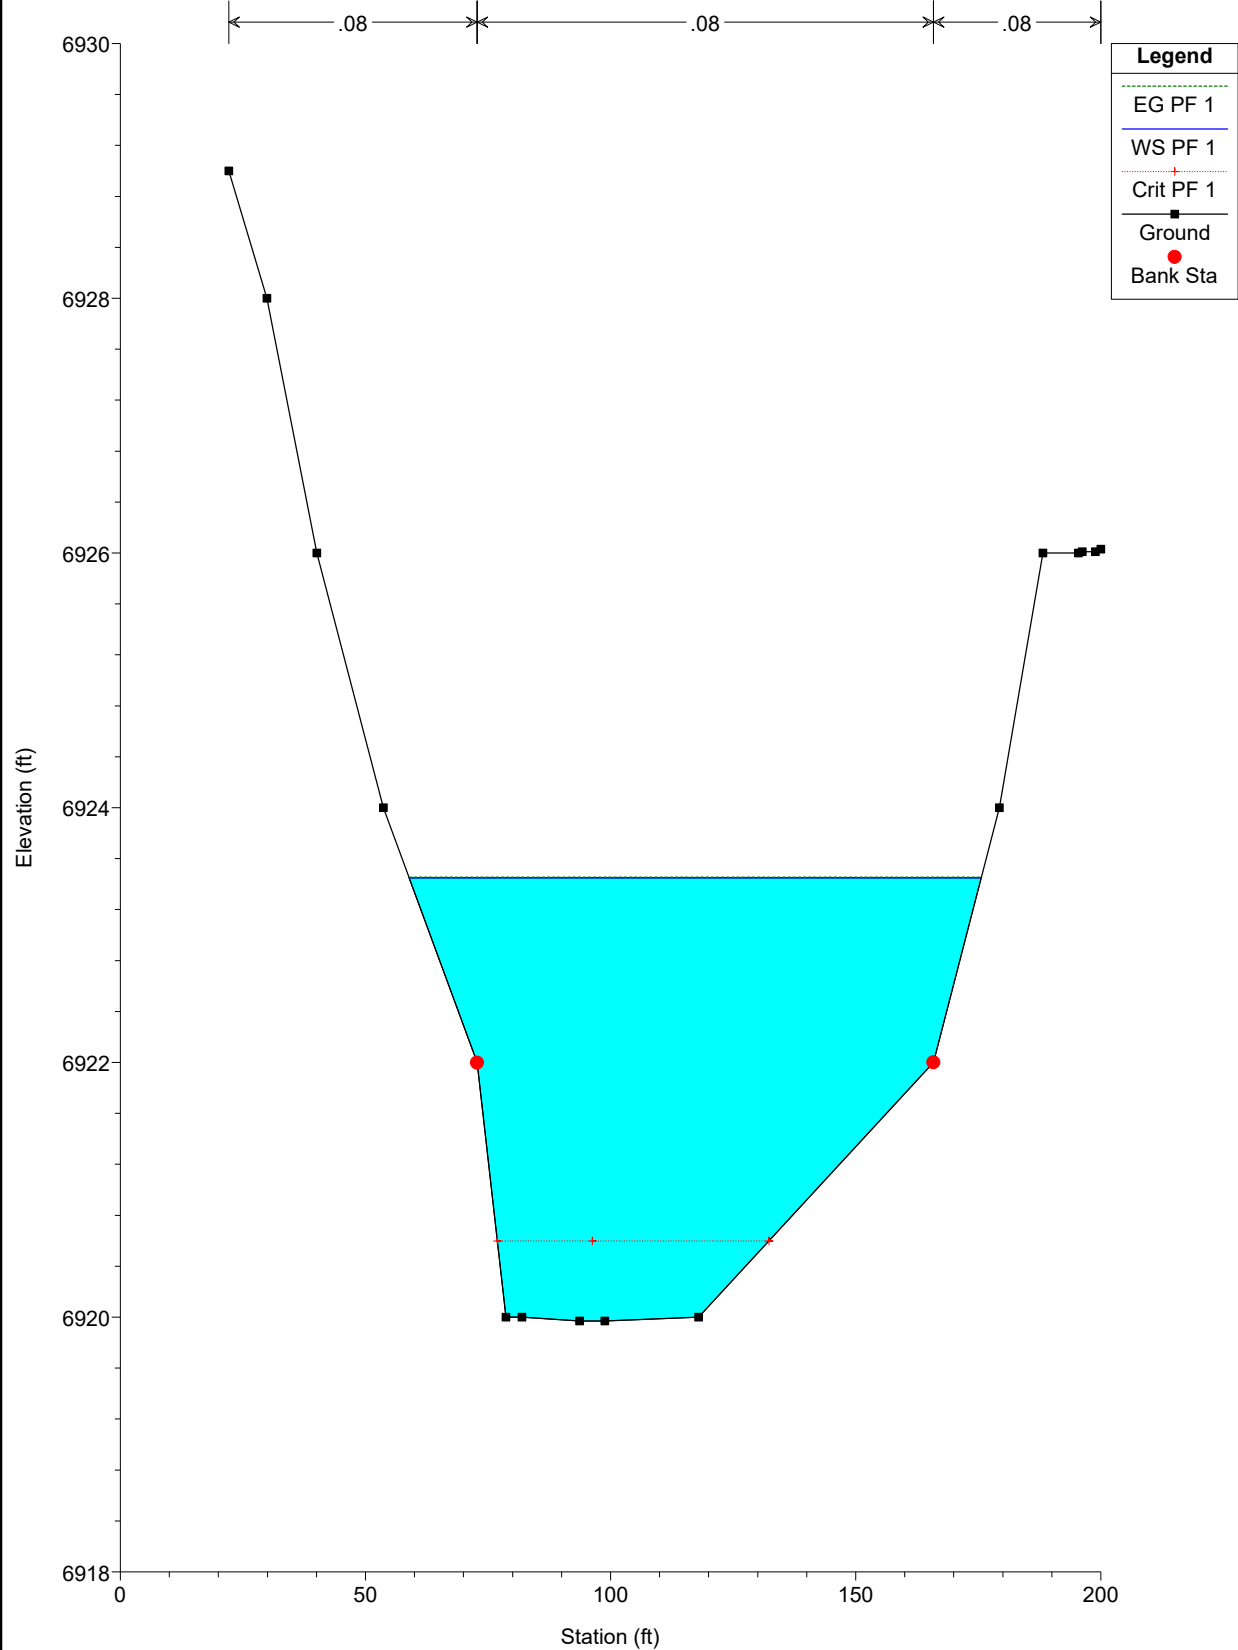


east chan pr PDR rev Plan: Plan 01 7/13/2022

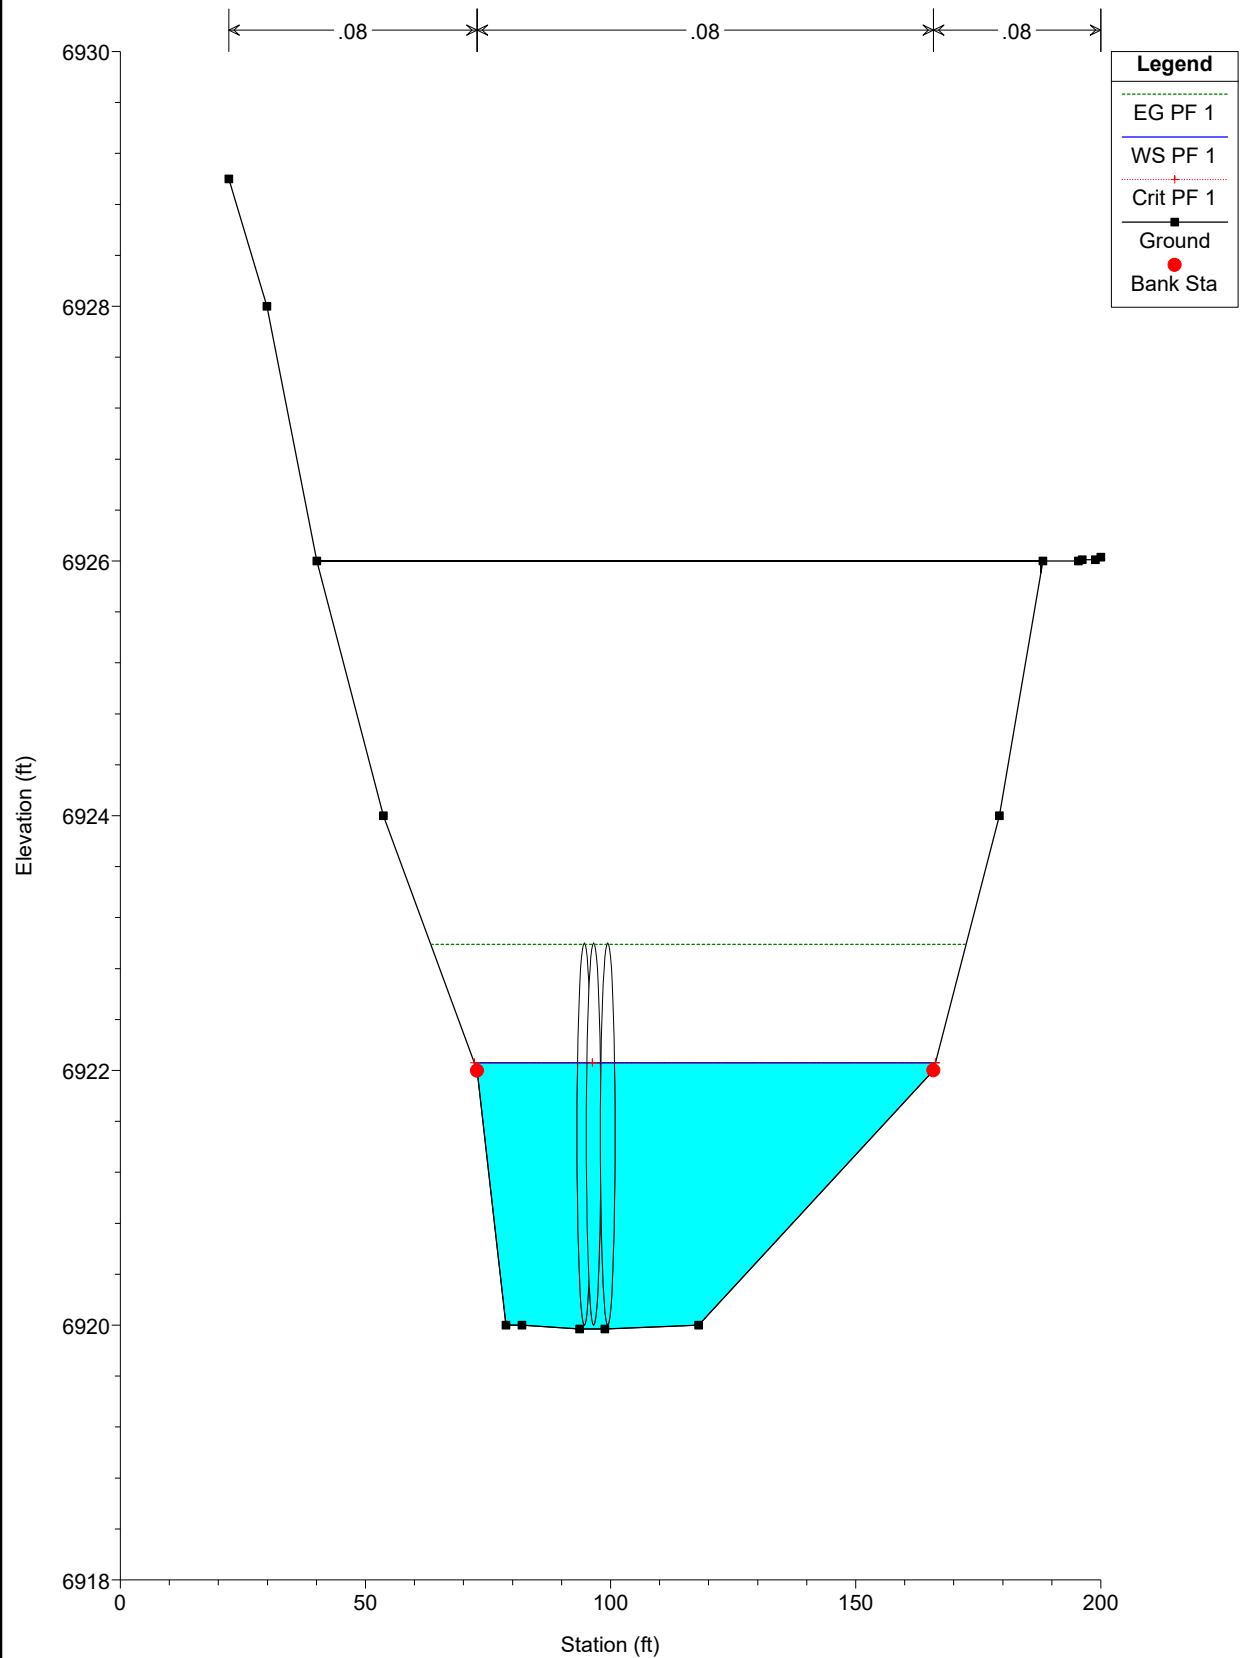


east chan pr PDR rev Plan: Plan 01 7/13/2022
1000

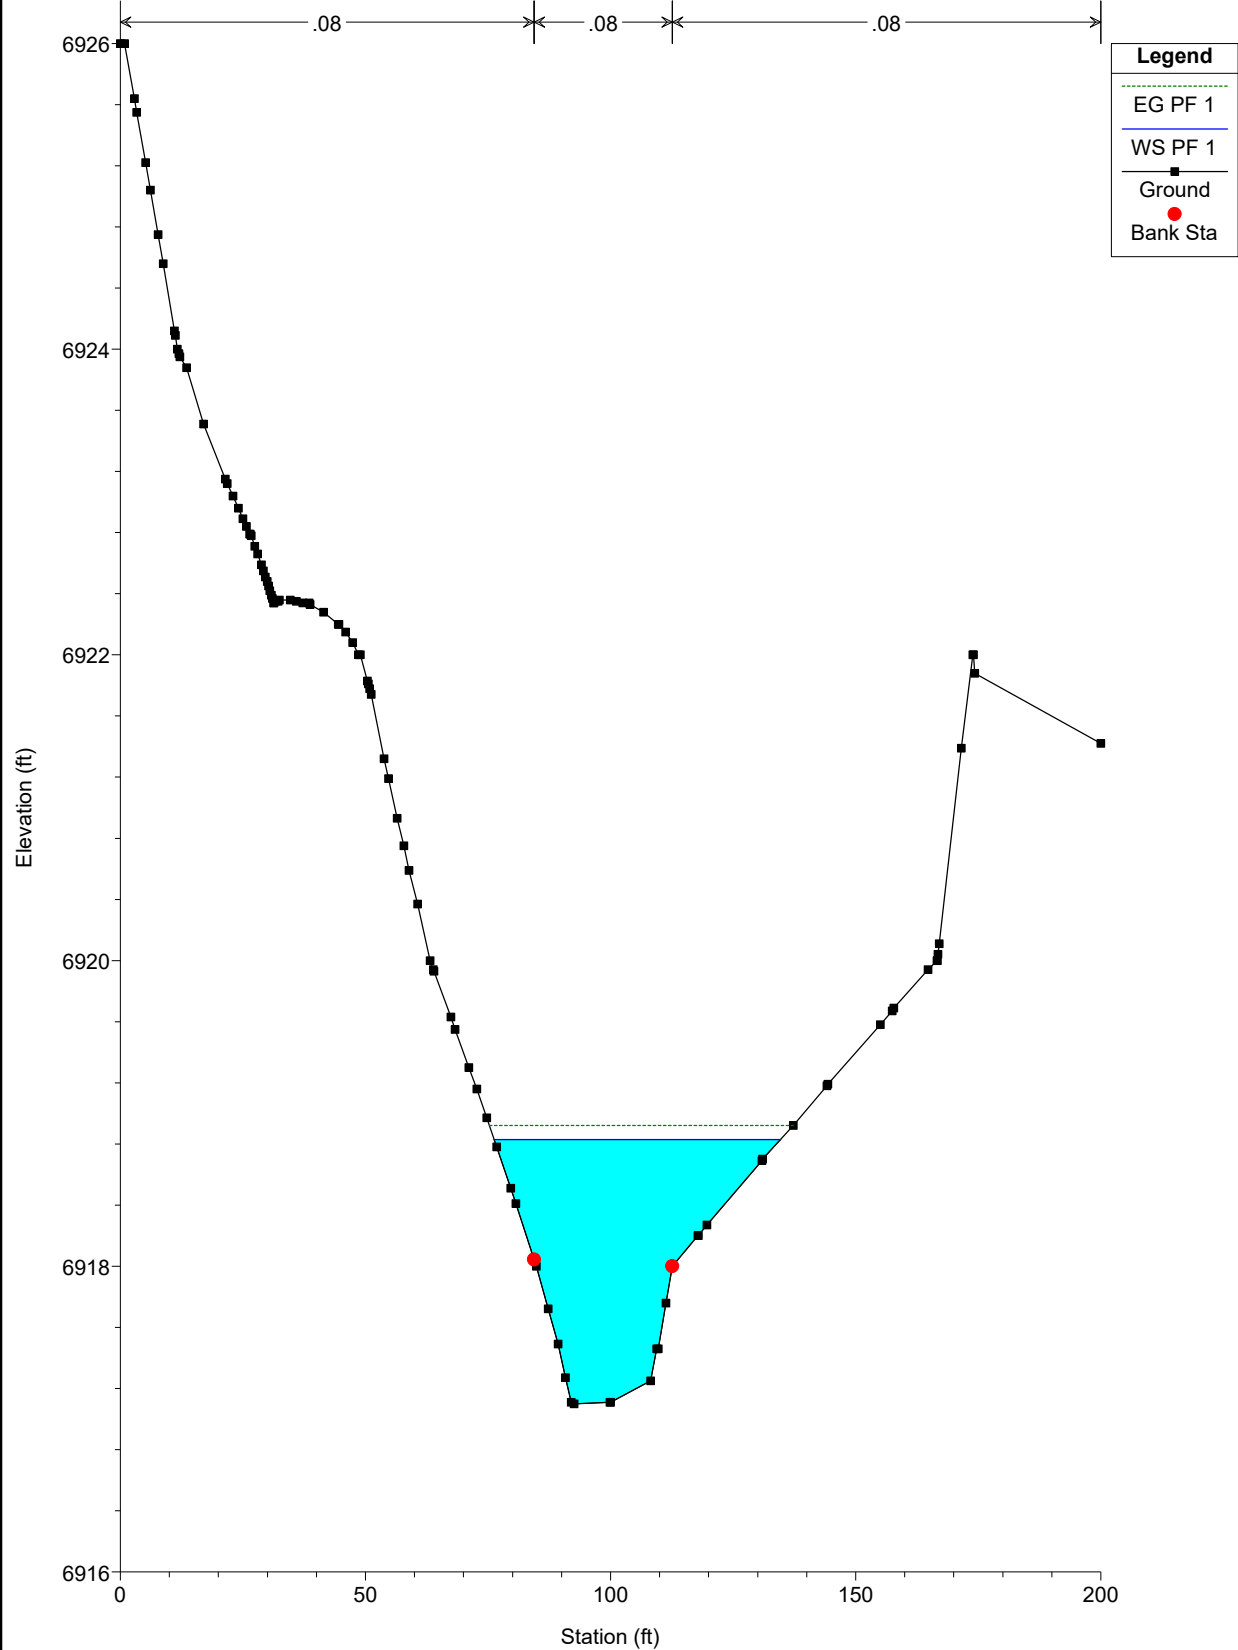


east chan pr PDR rev Plan: Plan 01 7/13/2022
900

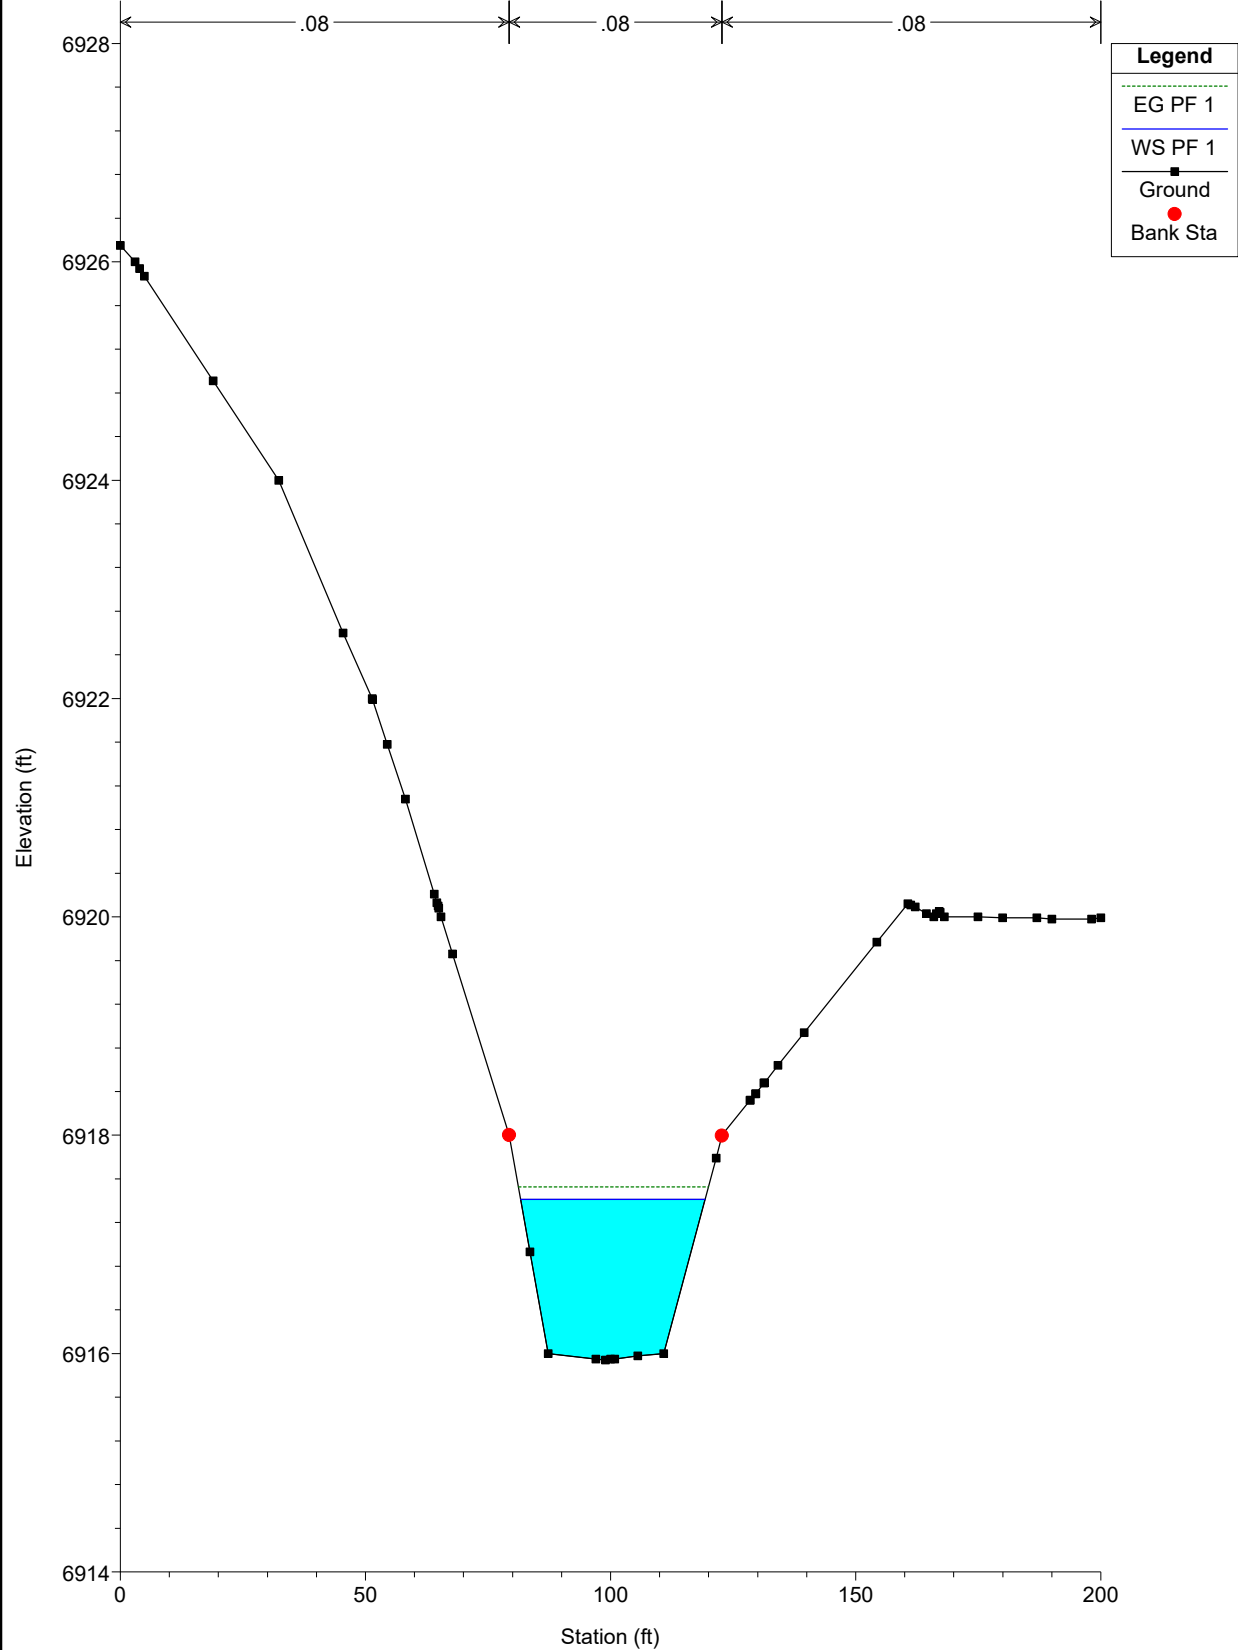


east chan pr PDR rev Plan: Plan 01 7/13/2022
800

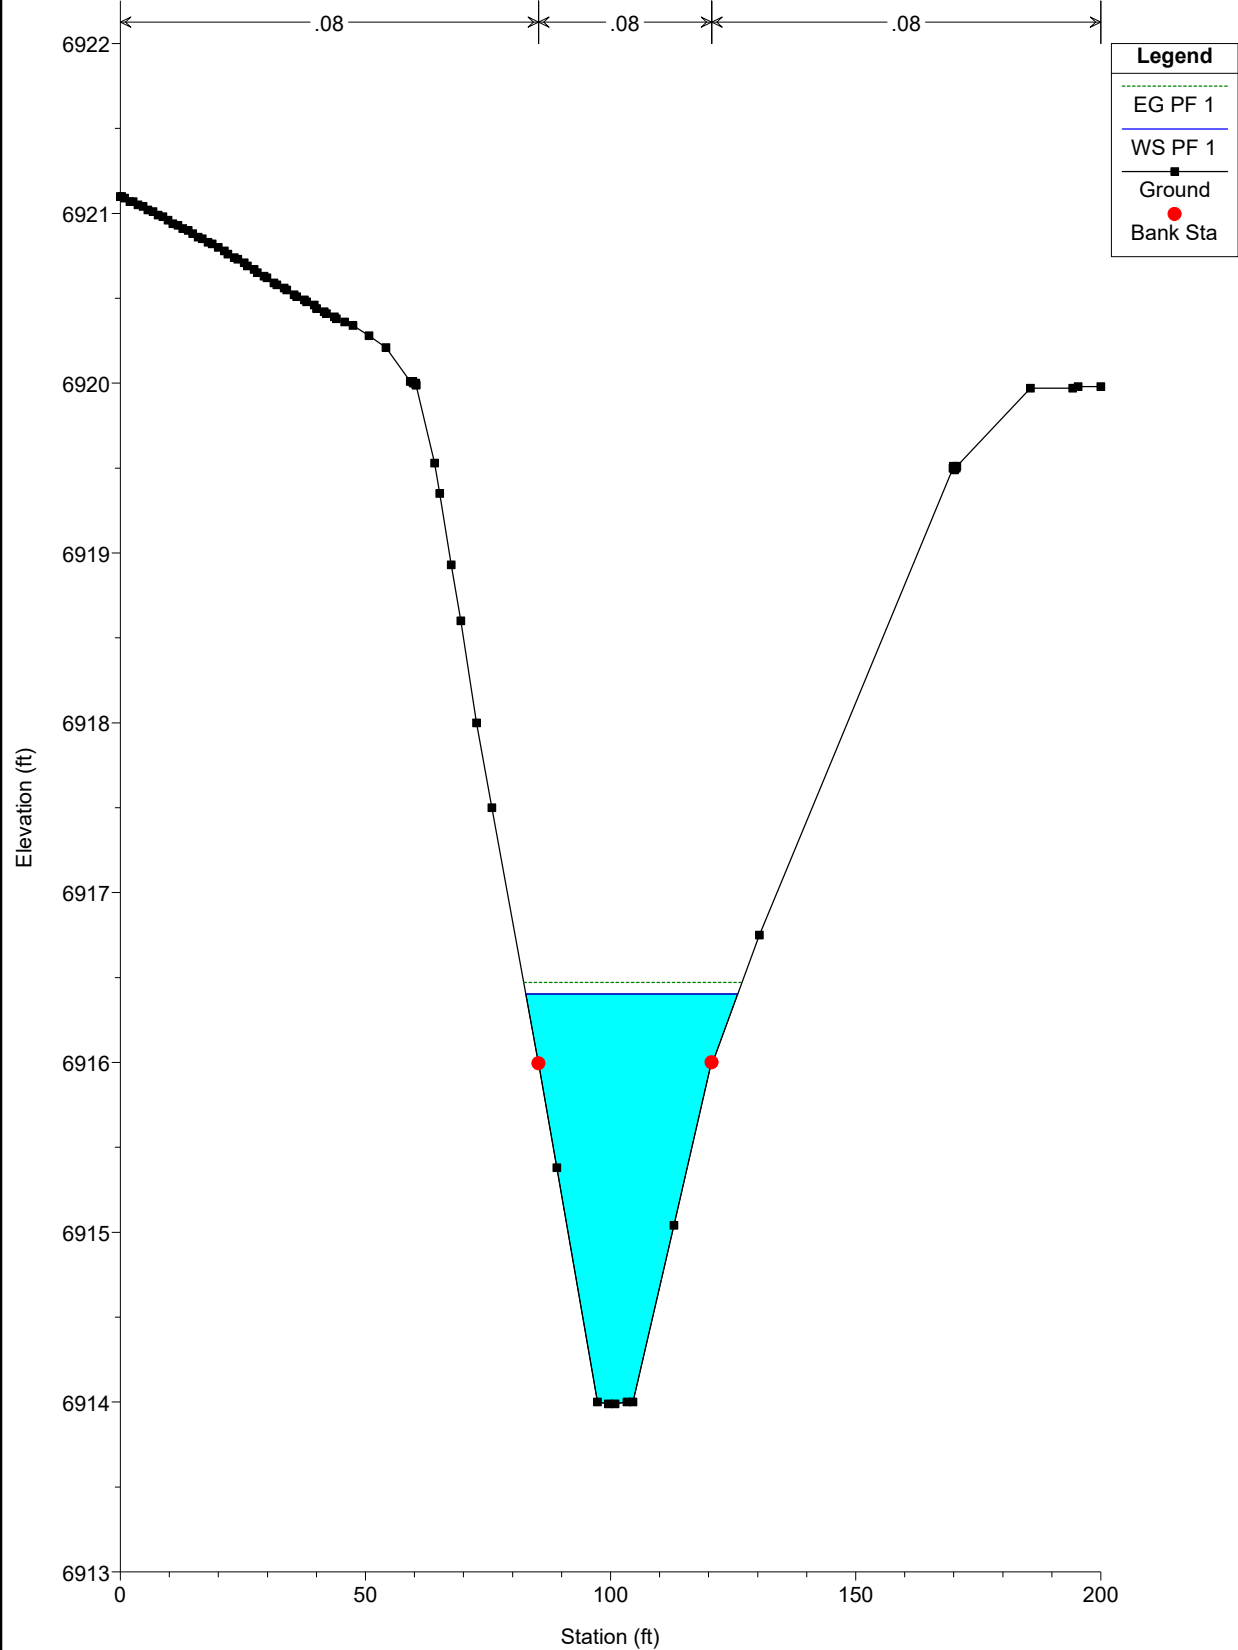


east chan pr PDR rev Plan: Plan 01 7/13/2022
700

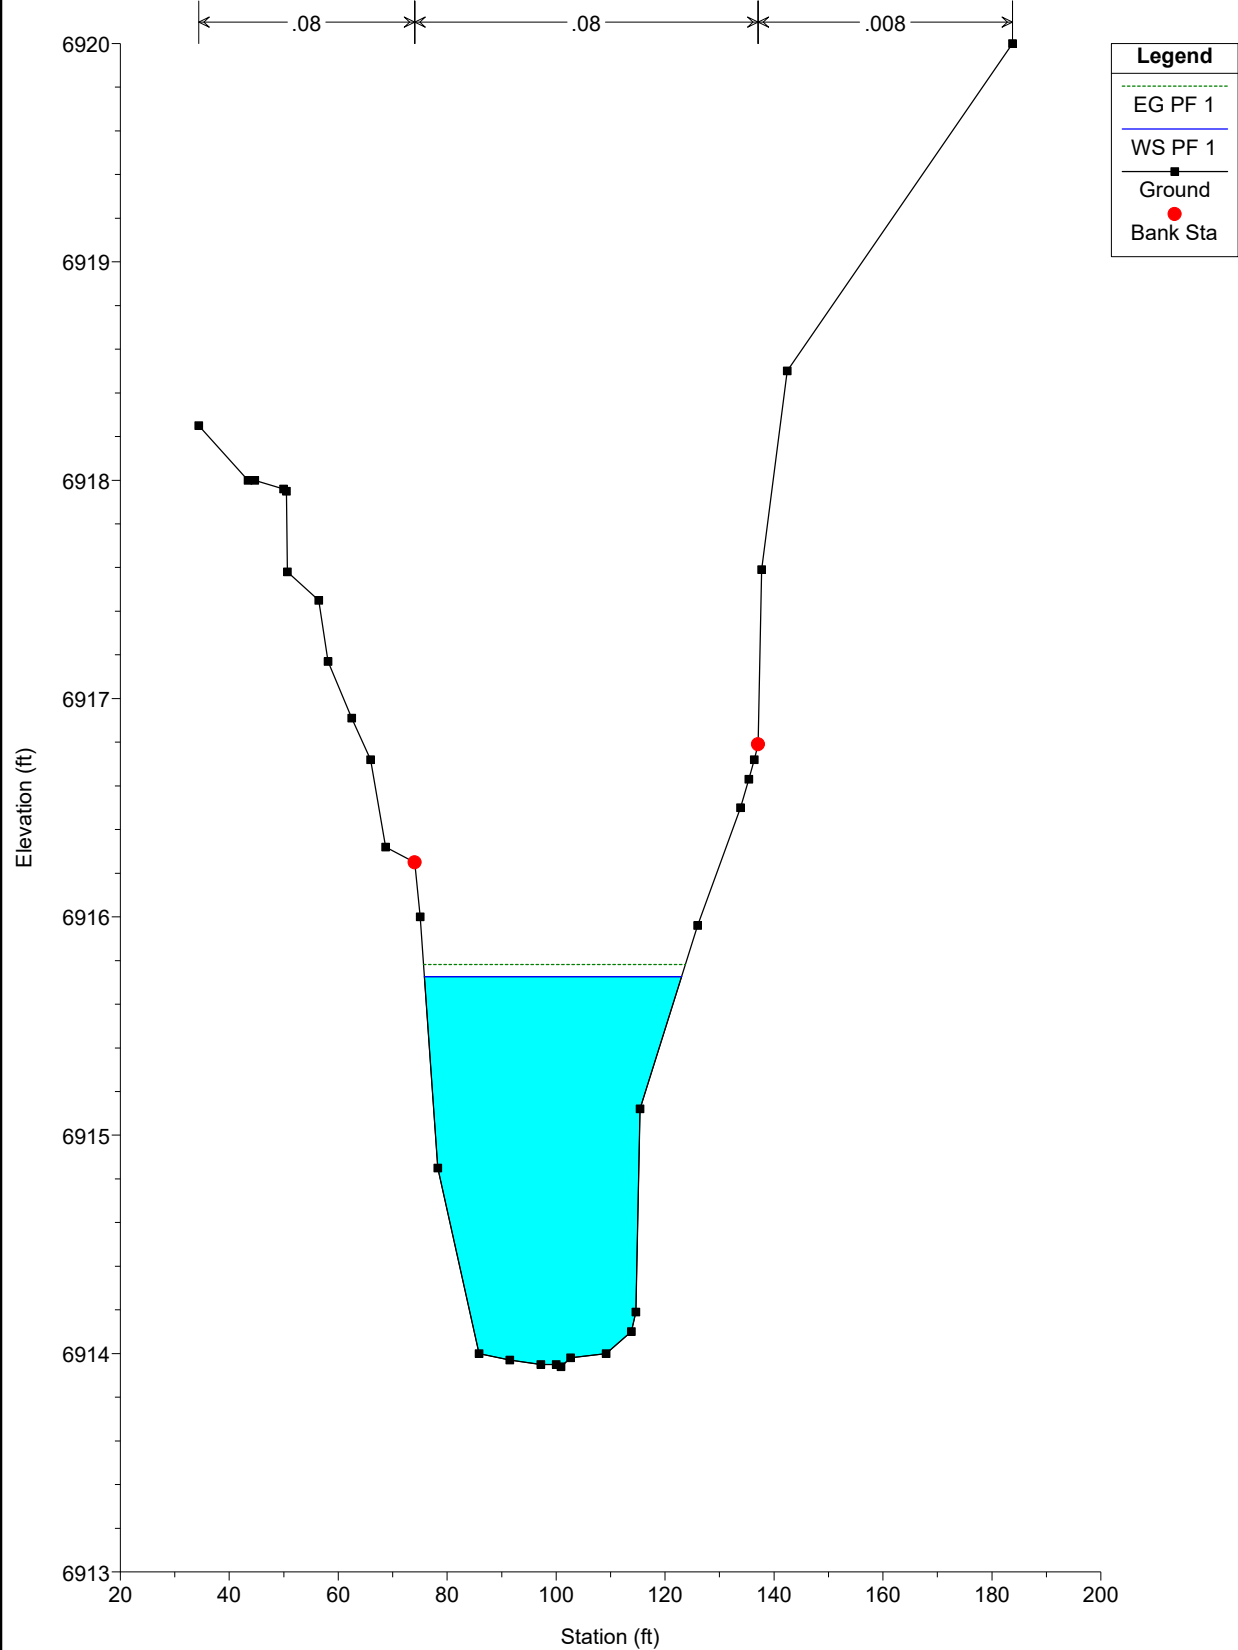


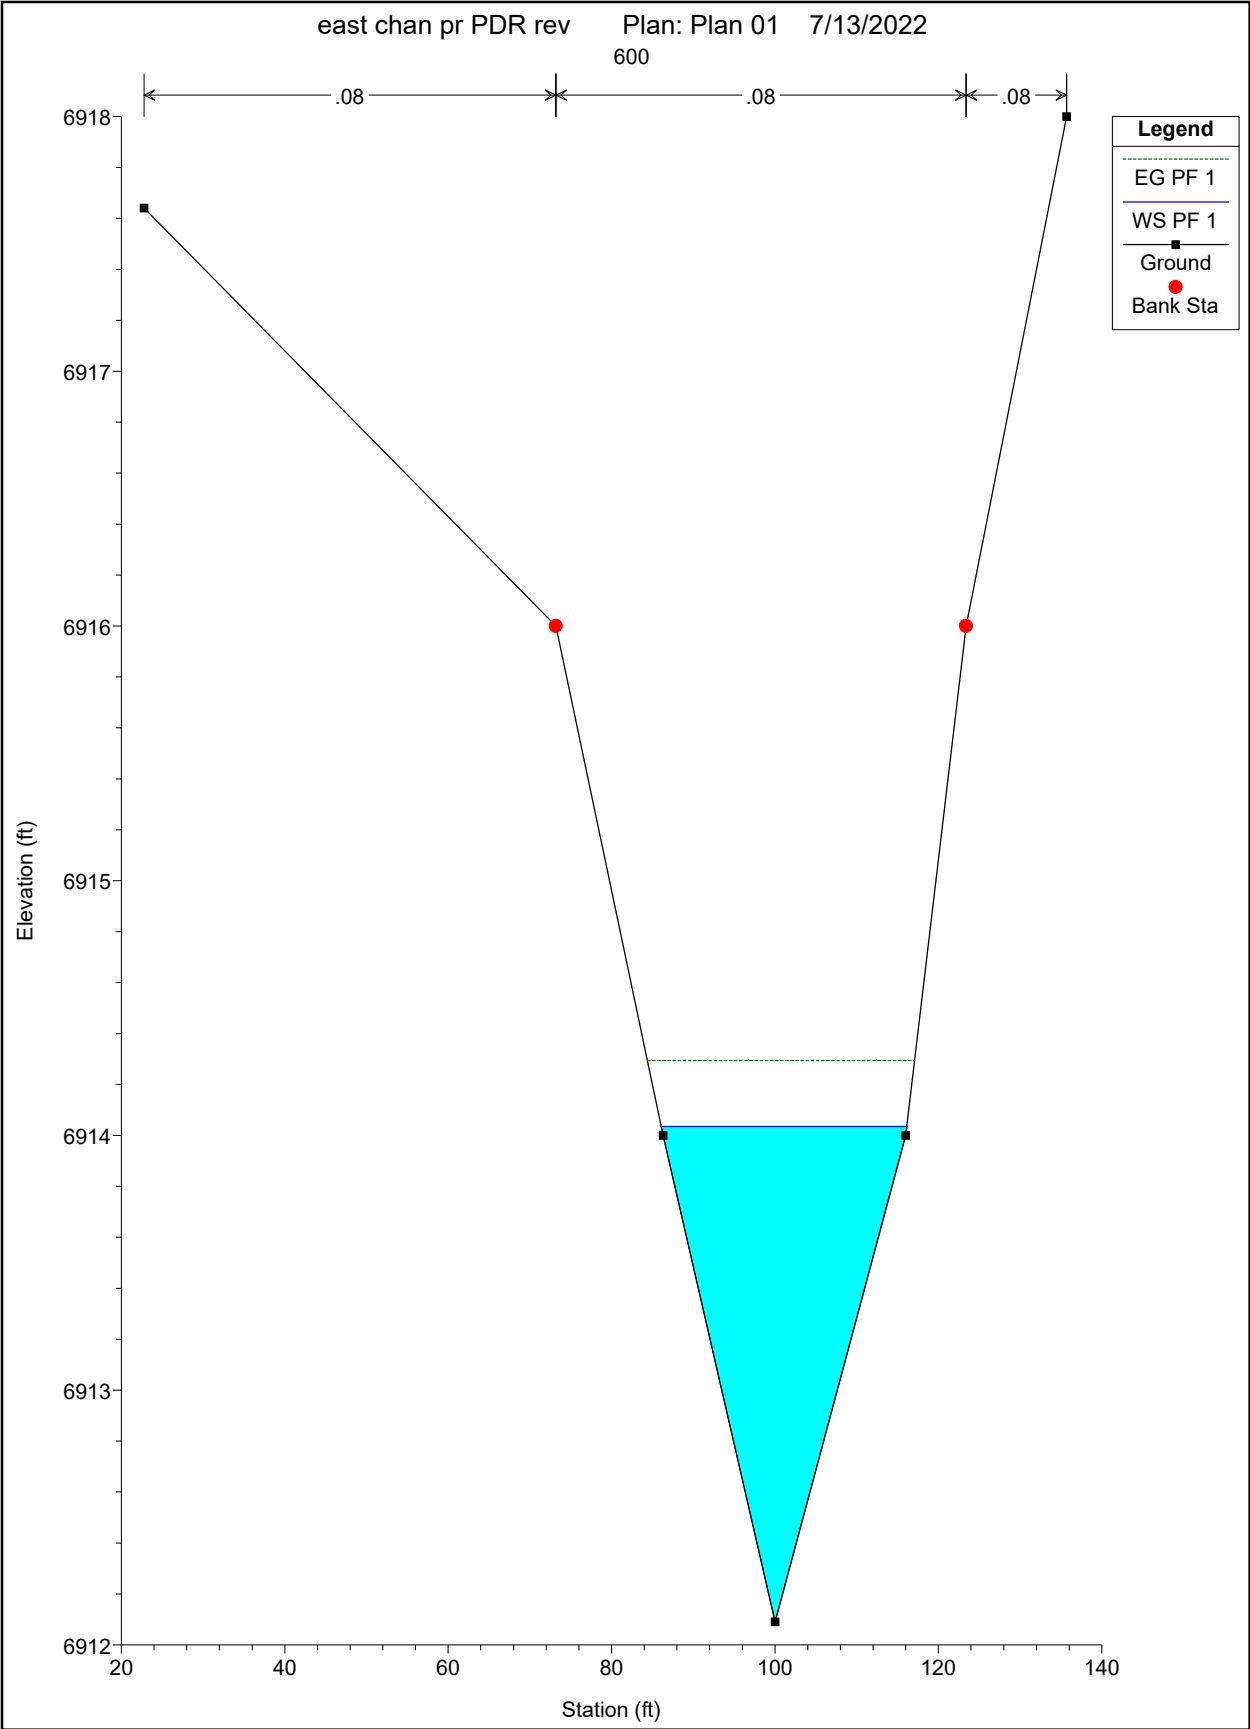

east chan pr PDR rev Plan: Plan 01 7/13/2022

500

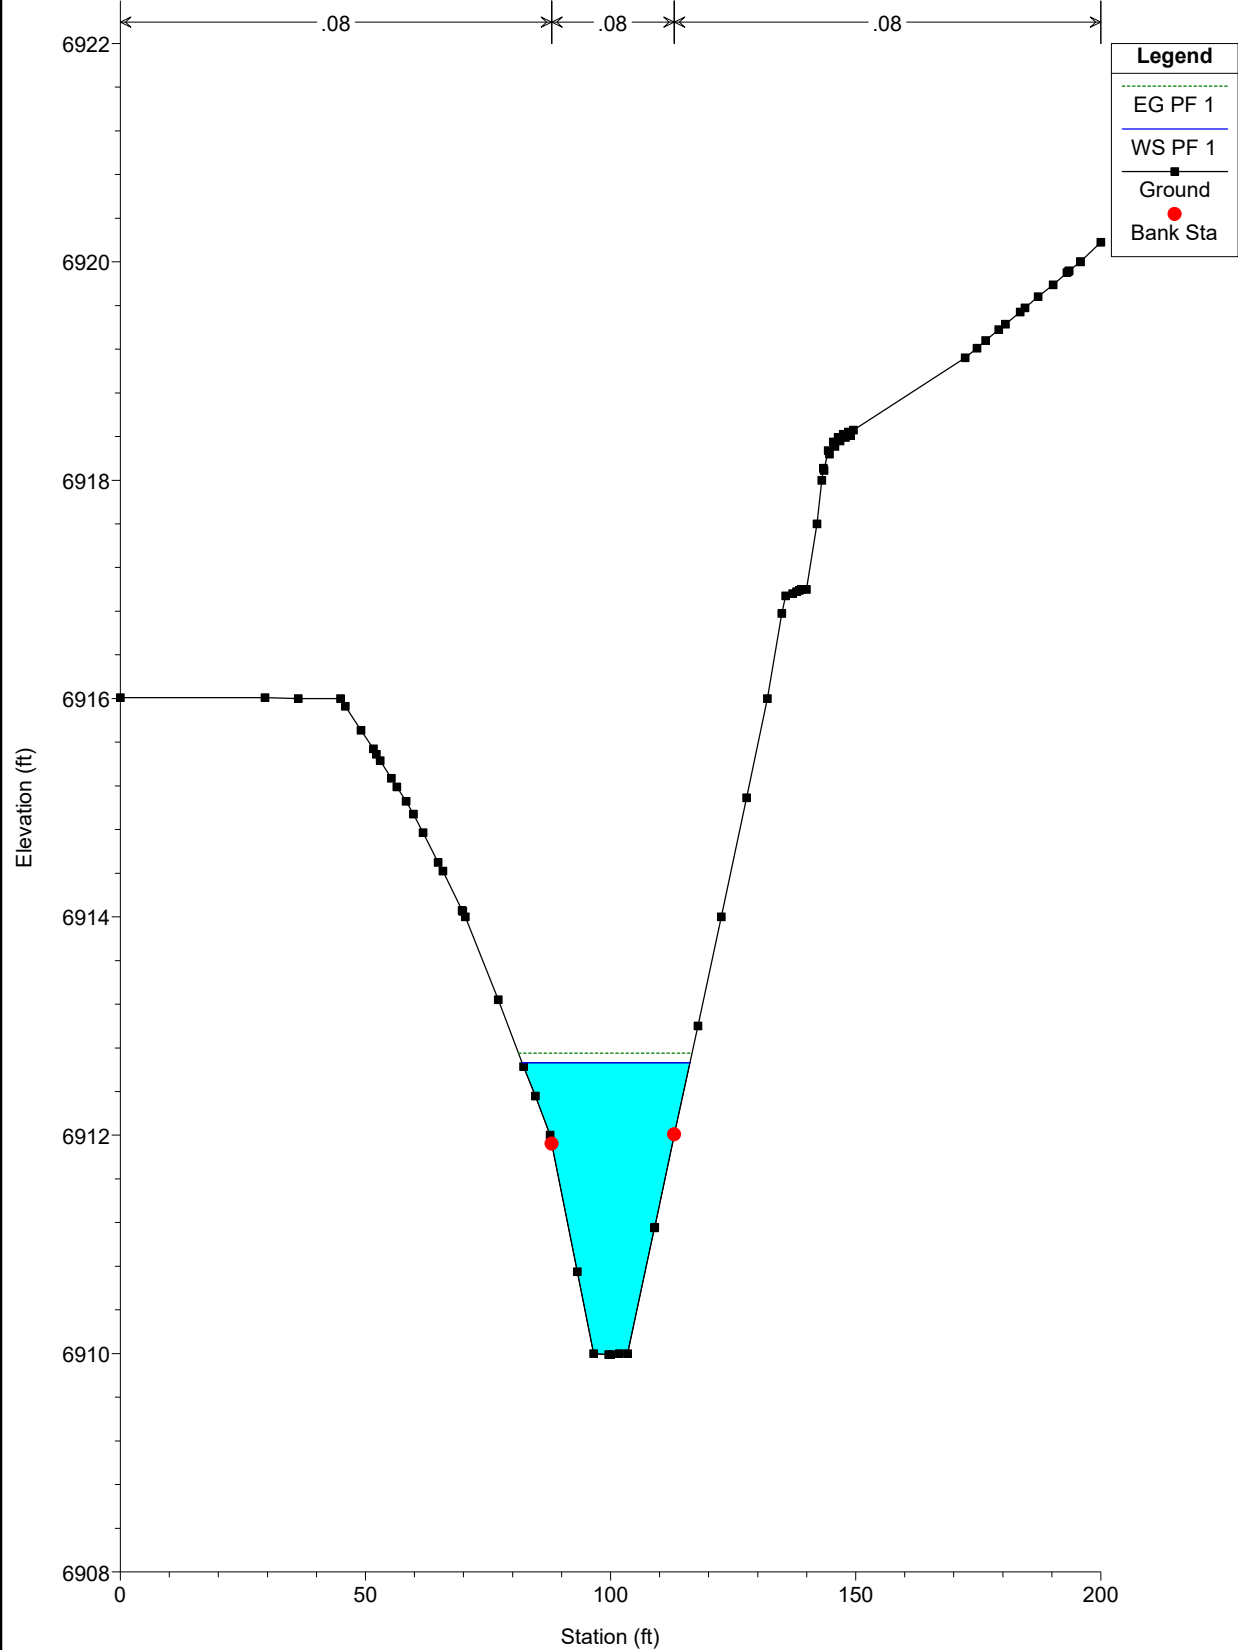

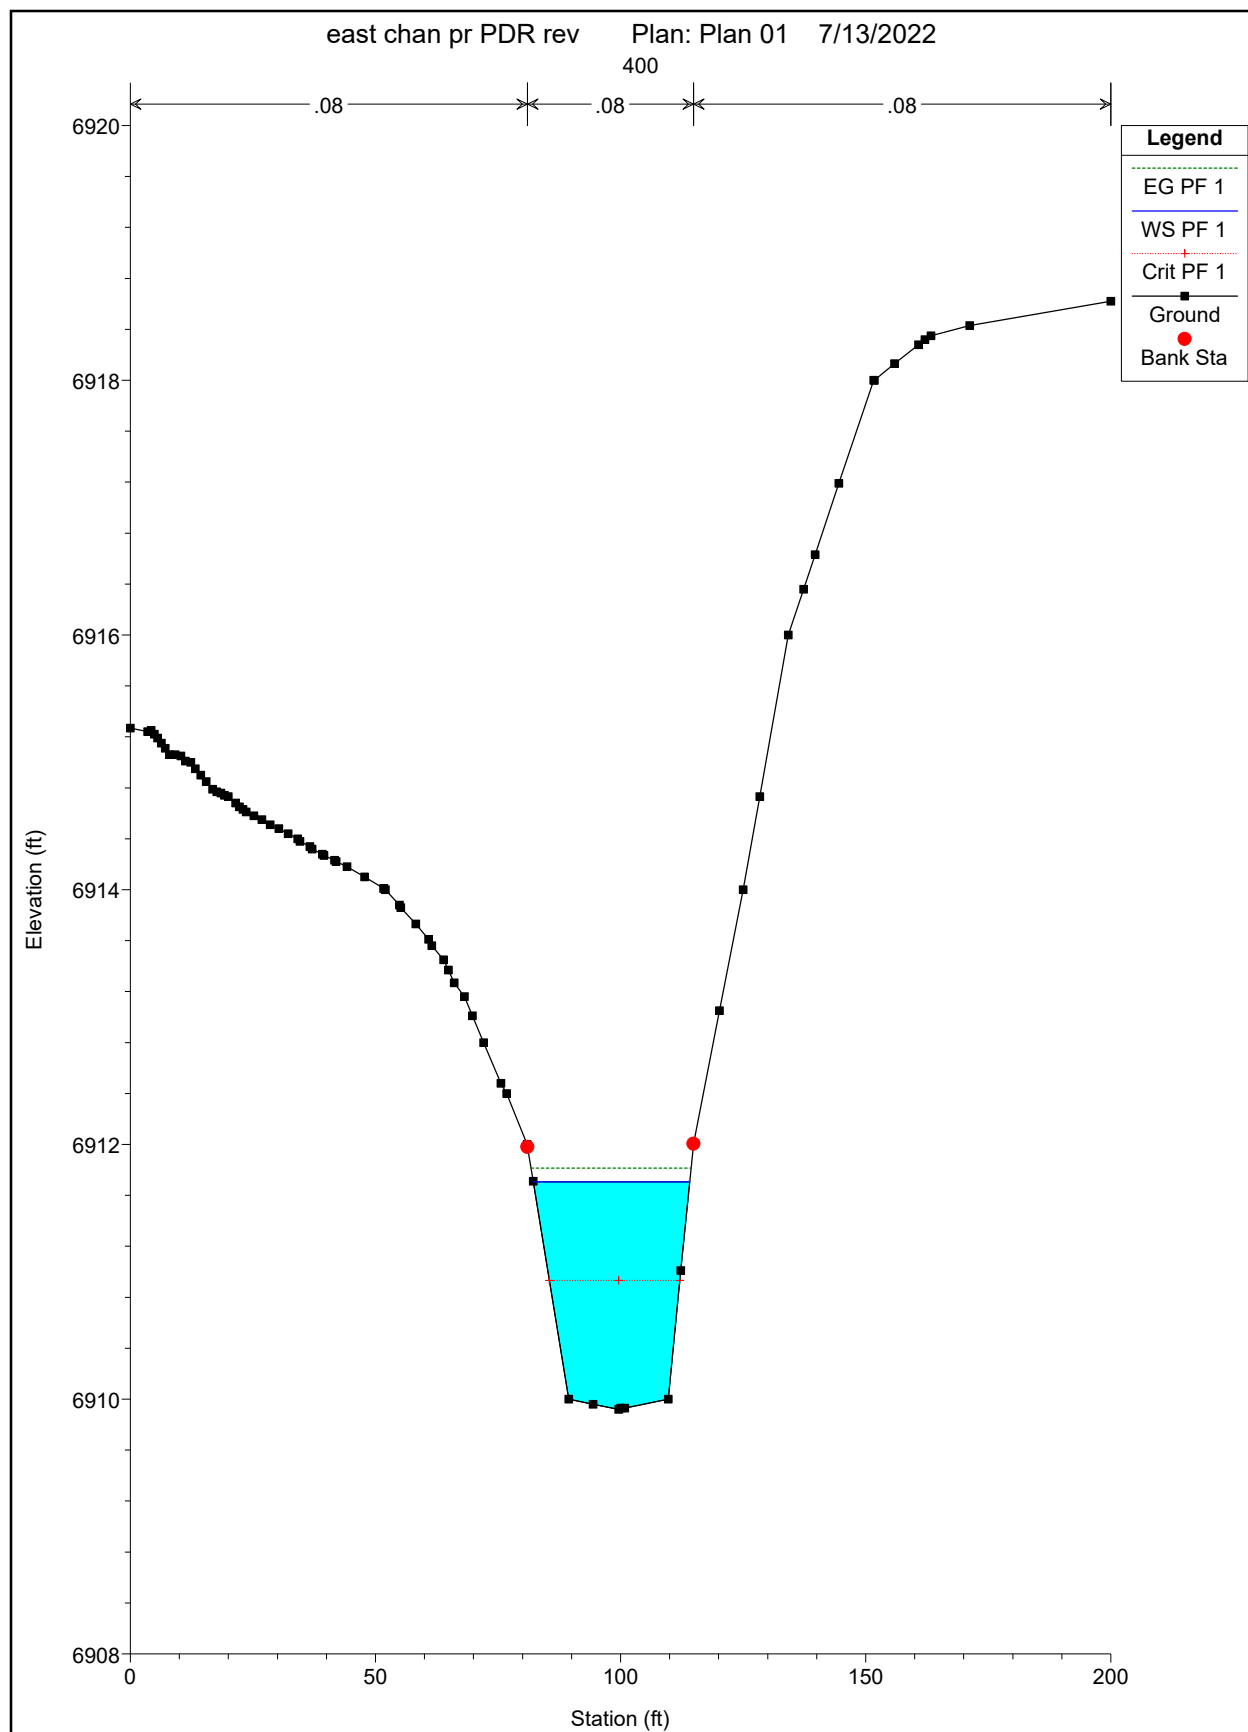


DRAINAGE MAPS

MDDP DRAINAGE REPORT ~ EXISTING BASIN RUNOFF COEFFICIENT SUMMARY										
BASIN	TOTAL AREA (AC)	IMPERVIOUS / DEVELOPED AREA			NONIMPERVIOUS / UNDEVELOPED AREA			WEIGHTED		WEIGHTED CA
		AREA (AC)	C(5)	C(100)	AREA (AC)	C(5)	C(100)	C(5)	C(100)	
EXA	9.62	0.00	0.45	0.59	9.62	0.09	0.36	0.09	0.36	0.87
EXB	4.09	0.00	0.45	0.59	4.09	0.09	0.36	0.09	0.36	0.37
EXC	24.80	0.00	0.45	0.59	24.80	0.09	0.36	0.09	0.36	2.23
EXD	15.87	0.00	0.45	0.59	15.87	0.09	0.36	0.09	0.36	1.43
EXE	5.83	0.00	0.45	0.59	5.83	0.09	0.36	0.09	0.36	0.52
EXF	1.62	0.00	0.45	0.59	1.62	0.09	0.36	0.09	0.36	0.15
OS-1	45.02	0.00	0.45	0.59	45.02	0.09	0.36	0.09	0.36	4.05
OS-2	11.40	0.00	0.45	0.59	11.40	0.09	0.36	0.09	0.36	1.03
OS-3	1.11	0.00	0.45	0.59	1.11	0.09	0.36	0.09	0.36	0.10
OS-4	0.29	0.00	0.45	0.59	0.29	0.09	0.36	0.09	0.36	0.03
OS-5	6.74	0.00	0.45	0.59	6.74	0.09	0.36	0.09	0.36	0.61
OS-6	2.56									
OS-9	11.80									
OS-10A	12.80									
FLOW TAKEN FROM MERIDAIN RANCH MDDP										
FLOW TAKEN FROM MERIDAIN RANCH MDDP										
FLOW TAKEN FROM MERIDAIN RANCH MDDP										

MDDP ~ EXISTING BASIN RUNOFF SUMMARY														
BASIN	WEIGHTED CA(5) CA(100)		OVERLAND				STREET / CHANNEL FLOW				Tc		INTENSITY	
	CA(5)	CA(100)	C(5)	Length (ft)	Height (ft)	Tc (min)	Length (ft)	Slope (%)	Velocity (ft/s)	Tc (min)	TOTAL (min)	I(5) (in/hr)	I(100) (in/hr)	TOTAL Q(5) (cfs)
EXA	0.87	3.46	0.25	100	3	11.1	1193	1.7%	4.5	4.4	15.4	3.43	5.81	3
EXB	0.37	1.47	0.25	100	2	12.6	623	2.2%	5.2	2.0	14.6	3.51	5.96	1
EXC	2.23	8.93	0.25	100	2.5	11.7	2420	1.7%	4.6	8.9	20.6	3.01	5.01	7
EXD	1.43	5.71	0.25	100	2	12.6	1615	2.6%	5.6	4.8	17.4	3.25	5.47	5
EXE	0.52	2.10	0.25	100	8	8.0	1063	2.1%	5.0	3.5	11.5	3.86	6.66	2
EXF	0.15	0.58	0.25	100	6	8.8	400	2.5%	5.5	1.2	10.0	4.06	7.07	1
OS-1	4.05	16.21	0.25	100	6	8.8	3219	2.3%	5.3	10.1	18.9	3.13	5.24	13
OS-2	1.03	4.11	0.25	100	2	12.6	1263	1.0%	3.5	5.7	18.4	3.17	5.32	3
OS-3	0.10	0.40	0.25	100	2	12.6	330	2.6%	5.6	1.0	13.6	3.61	6.17	0
OS-4	0.03	0.11	0.25	100	2	12.6	230	2.6%	5.7	0.7	13.3	3.64	6.23	0
OS-5	0.61	2.43	0.25	80	5	7.8	1000	2.5%	5.5	3.0	10.8	3.96	6.85	2
OS-6														5
OS-9														8
FLOW TAKEN FROM MERIDAIN RANCH MDDP														
FLOW TAKEN FROM MERIDAIN RANCH MDDP														

MDDP ~ EXISTING SURFACE ROUTING SUMMARY									
Design Point(s)	Contributing Basins	Area (AC)	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow	
						I(5)	I(100)	Q(5)	Q(100)
EX1	EXA, OS-5, & DP-EX10A	16.92	1.47	5.89	15.4	3.43	5.81	33	219
EX2	EXB	4.09	0.37	1.47	14.6	3.51	5.96	1	9
EX3	EXC & OS-4	25.10	2.26	9.03	20.6	3.01	5.01	7	45
EX4	EXD & OS-3	16.98	1.53	6.11	17.4	3.25	5.47	5	33
EX5	EXE, OS-2 & OS-8	17.23	1.55	6.20	18.4	3.17	5.32	10	44
EX6	EXF	1.62	0.15	0.58	13.8	3.59	6.12	1	4
EX7	EXE, EXF, OS-1, OS-2, OS-8 & OS-9	78.24	5.75	23.00	18.9	3.13	5.24	31	151
EX9	OS-9	11.80						8	19
EX10	OS-8	2.56						5	11
EX10A	MERIDIAN POND E RELEASE							28	185
Meridian Ranch Filing 3 FDR Calculated Flows									EX 3-42" RCP Culverts

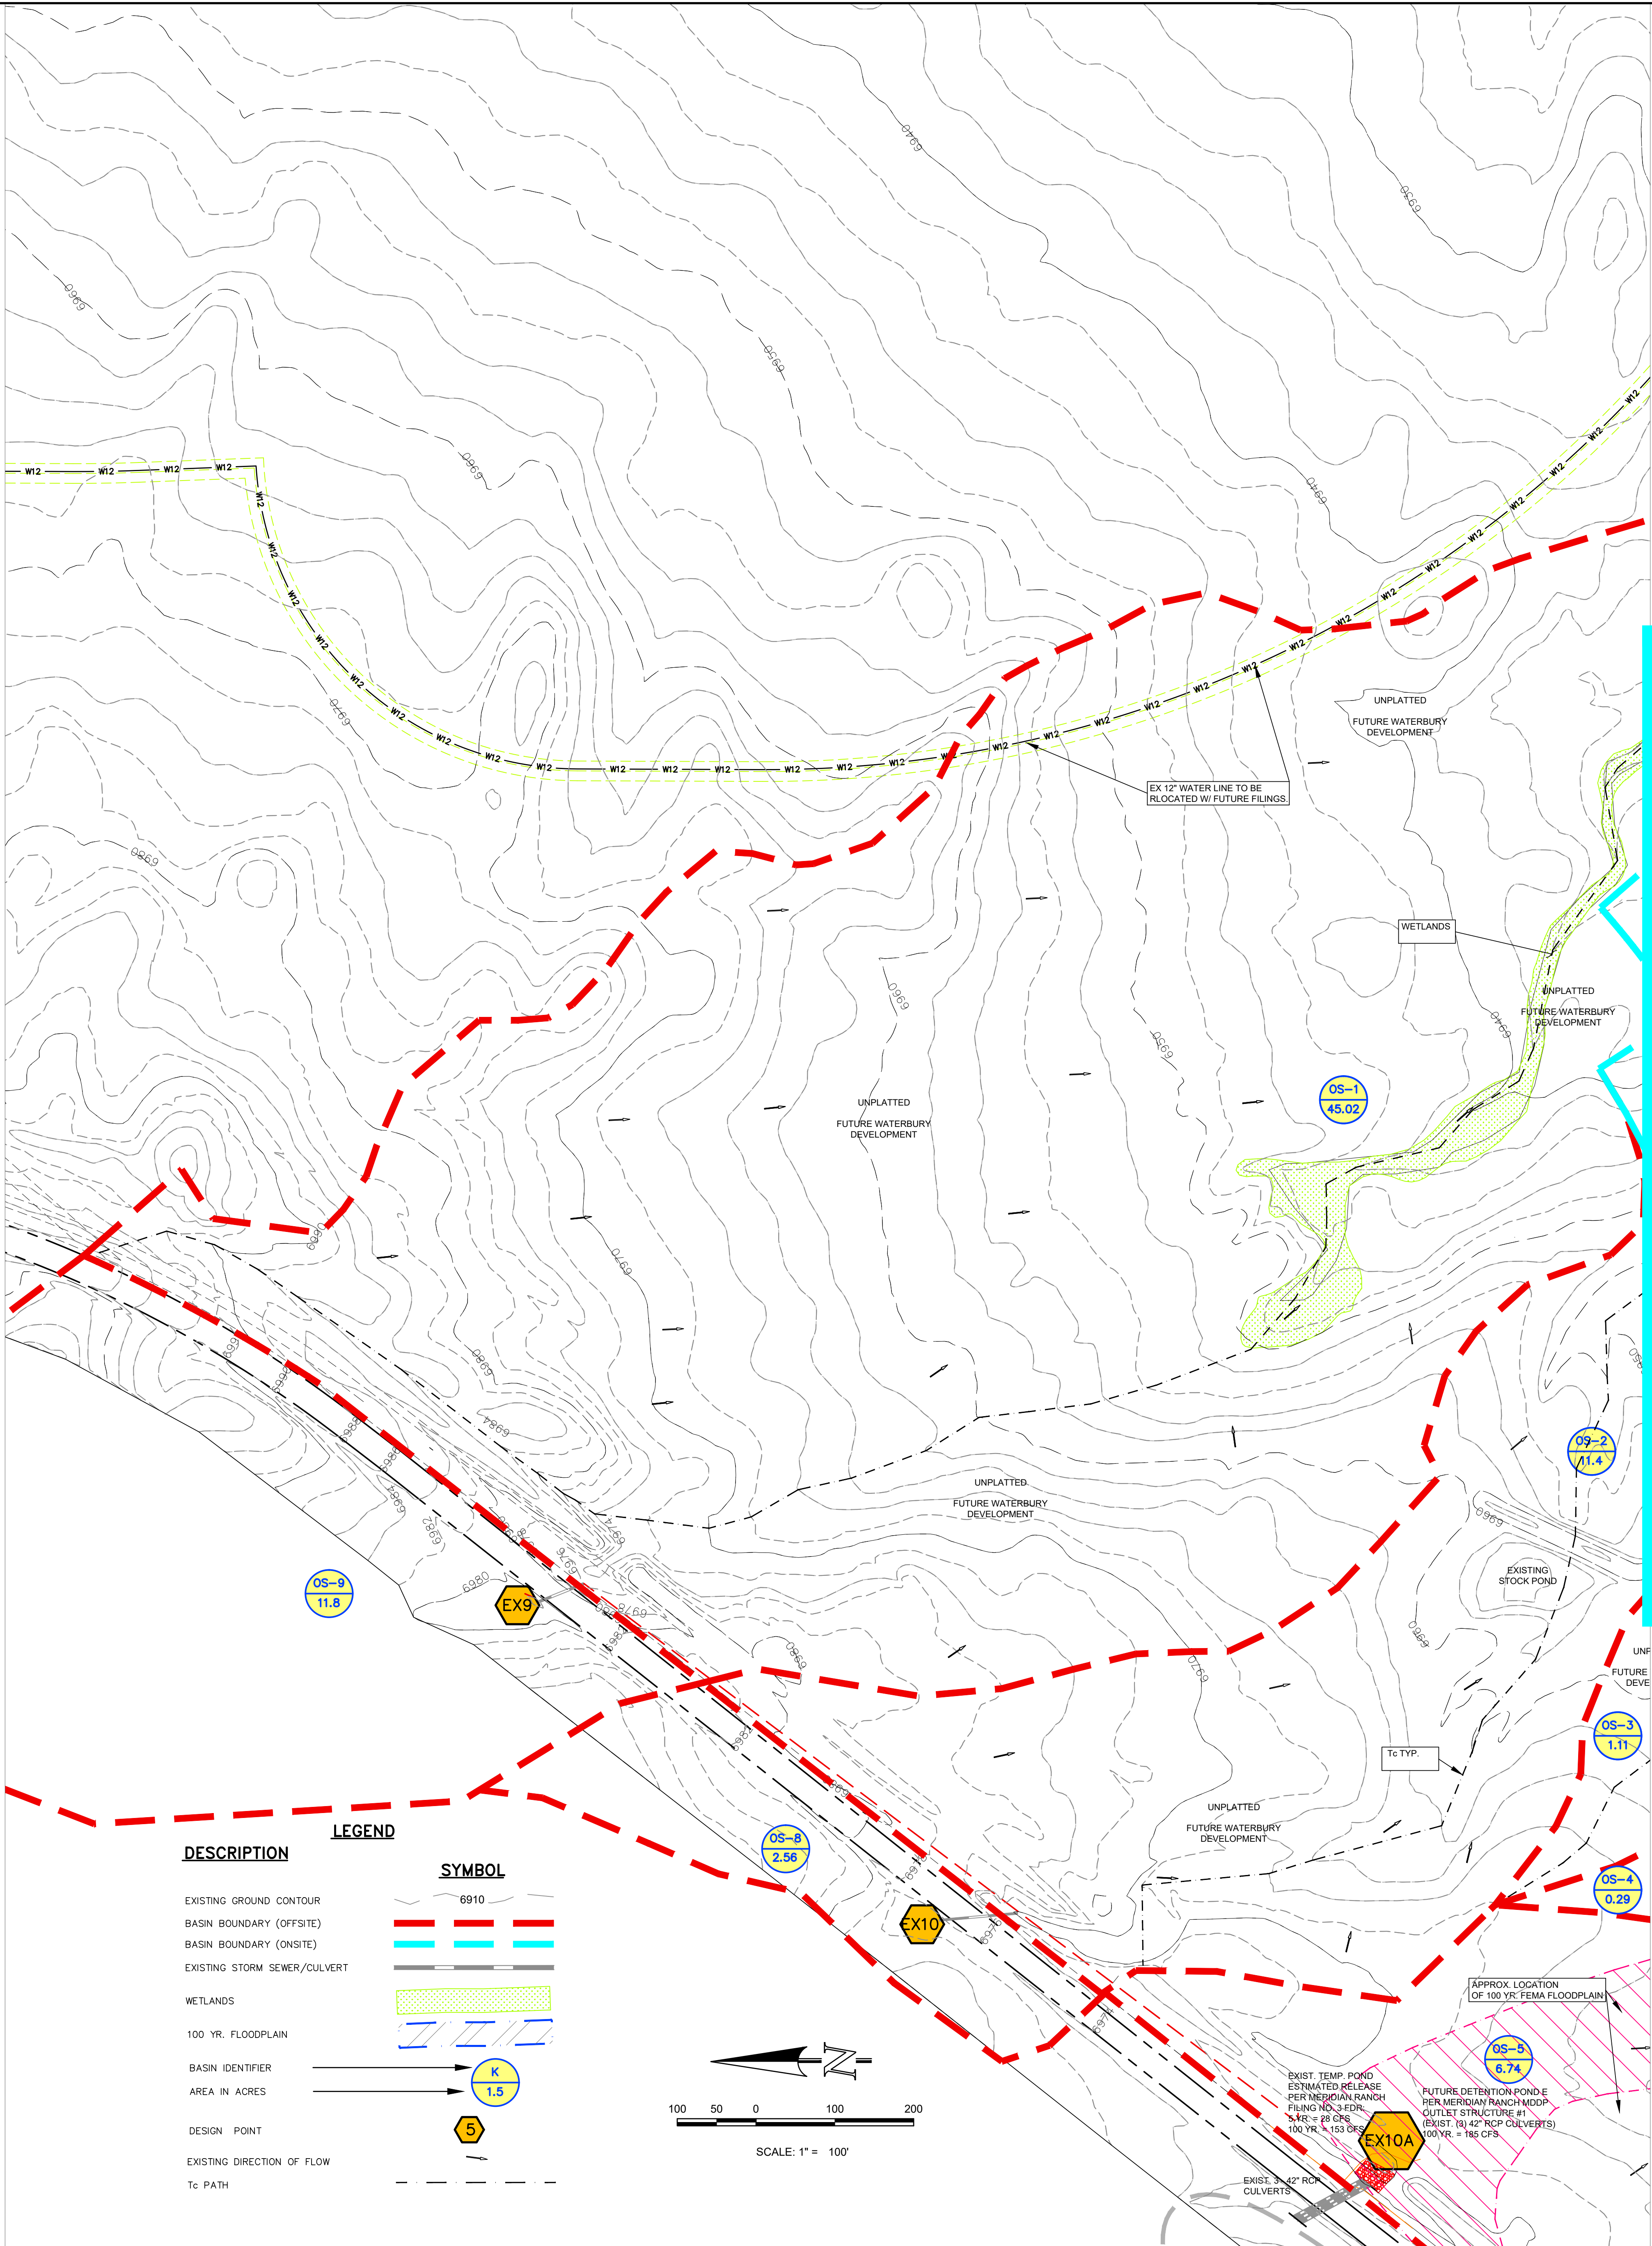

REVISIONS

NO.	DESCRIPTION	DATE

UNTIL SUCH TIME AS THESE PLANS ARE APPROVED BY THE REVIEWING AGENCIES FOR THE PROJECT, THE DESIGNING AND SURVEYING, INC. APPROVES THEIR USE ONLY FOR THE PROJECT DESIGNATED BY WRITTEN AUTHORIZATION.

PREPARED FOR:

4-WAY RANCH JOINT VENTURES
ATTN: PETER MARTZ
PO BOX 50223
COLORADO SPRINGS, CO 80949
719-471-3150

DESIGNED BY: QNA

DRAWN BY: QNA

CHECKED BY: QNA

H-Scale: 1"=100'

V-Scale: 1"=100'

JOB NO. 1715.00

DATE ISSUED 6/17/22

SHEET NO. 1 OF 2

WATERBURY FILING 1 & 2


EXISTING MDDP DRAINAGE MAP 1

OFFSITE MAP


Terra Nova Engineering, Inc.

721 S. 23RD STREET
COLORADO SPRINGS, CO 80904
OFFICE: 719-634-4432
FAX: 719-635-6436
www.terrano.com

MATCHLINE SEE SHEET 1

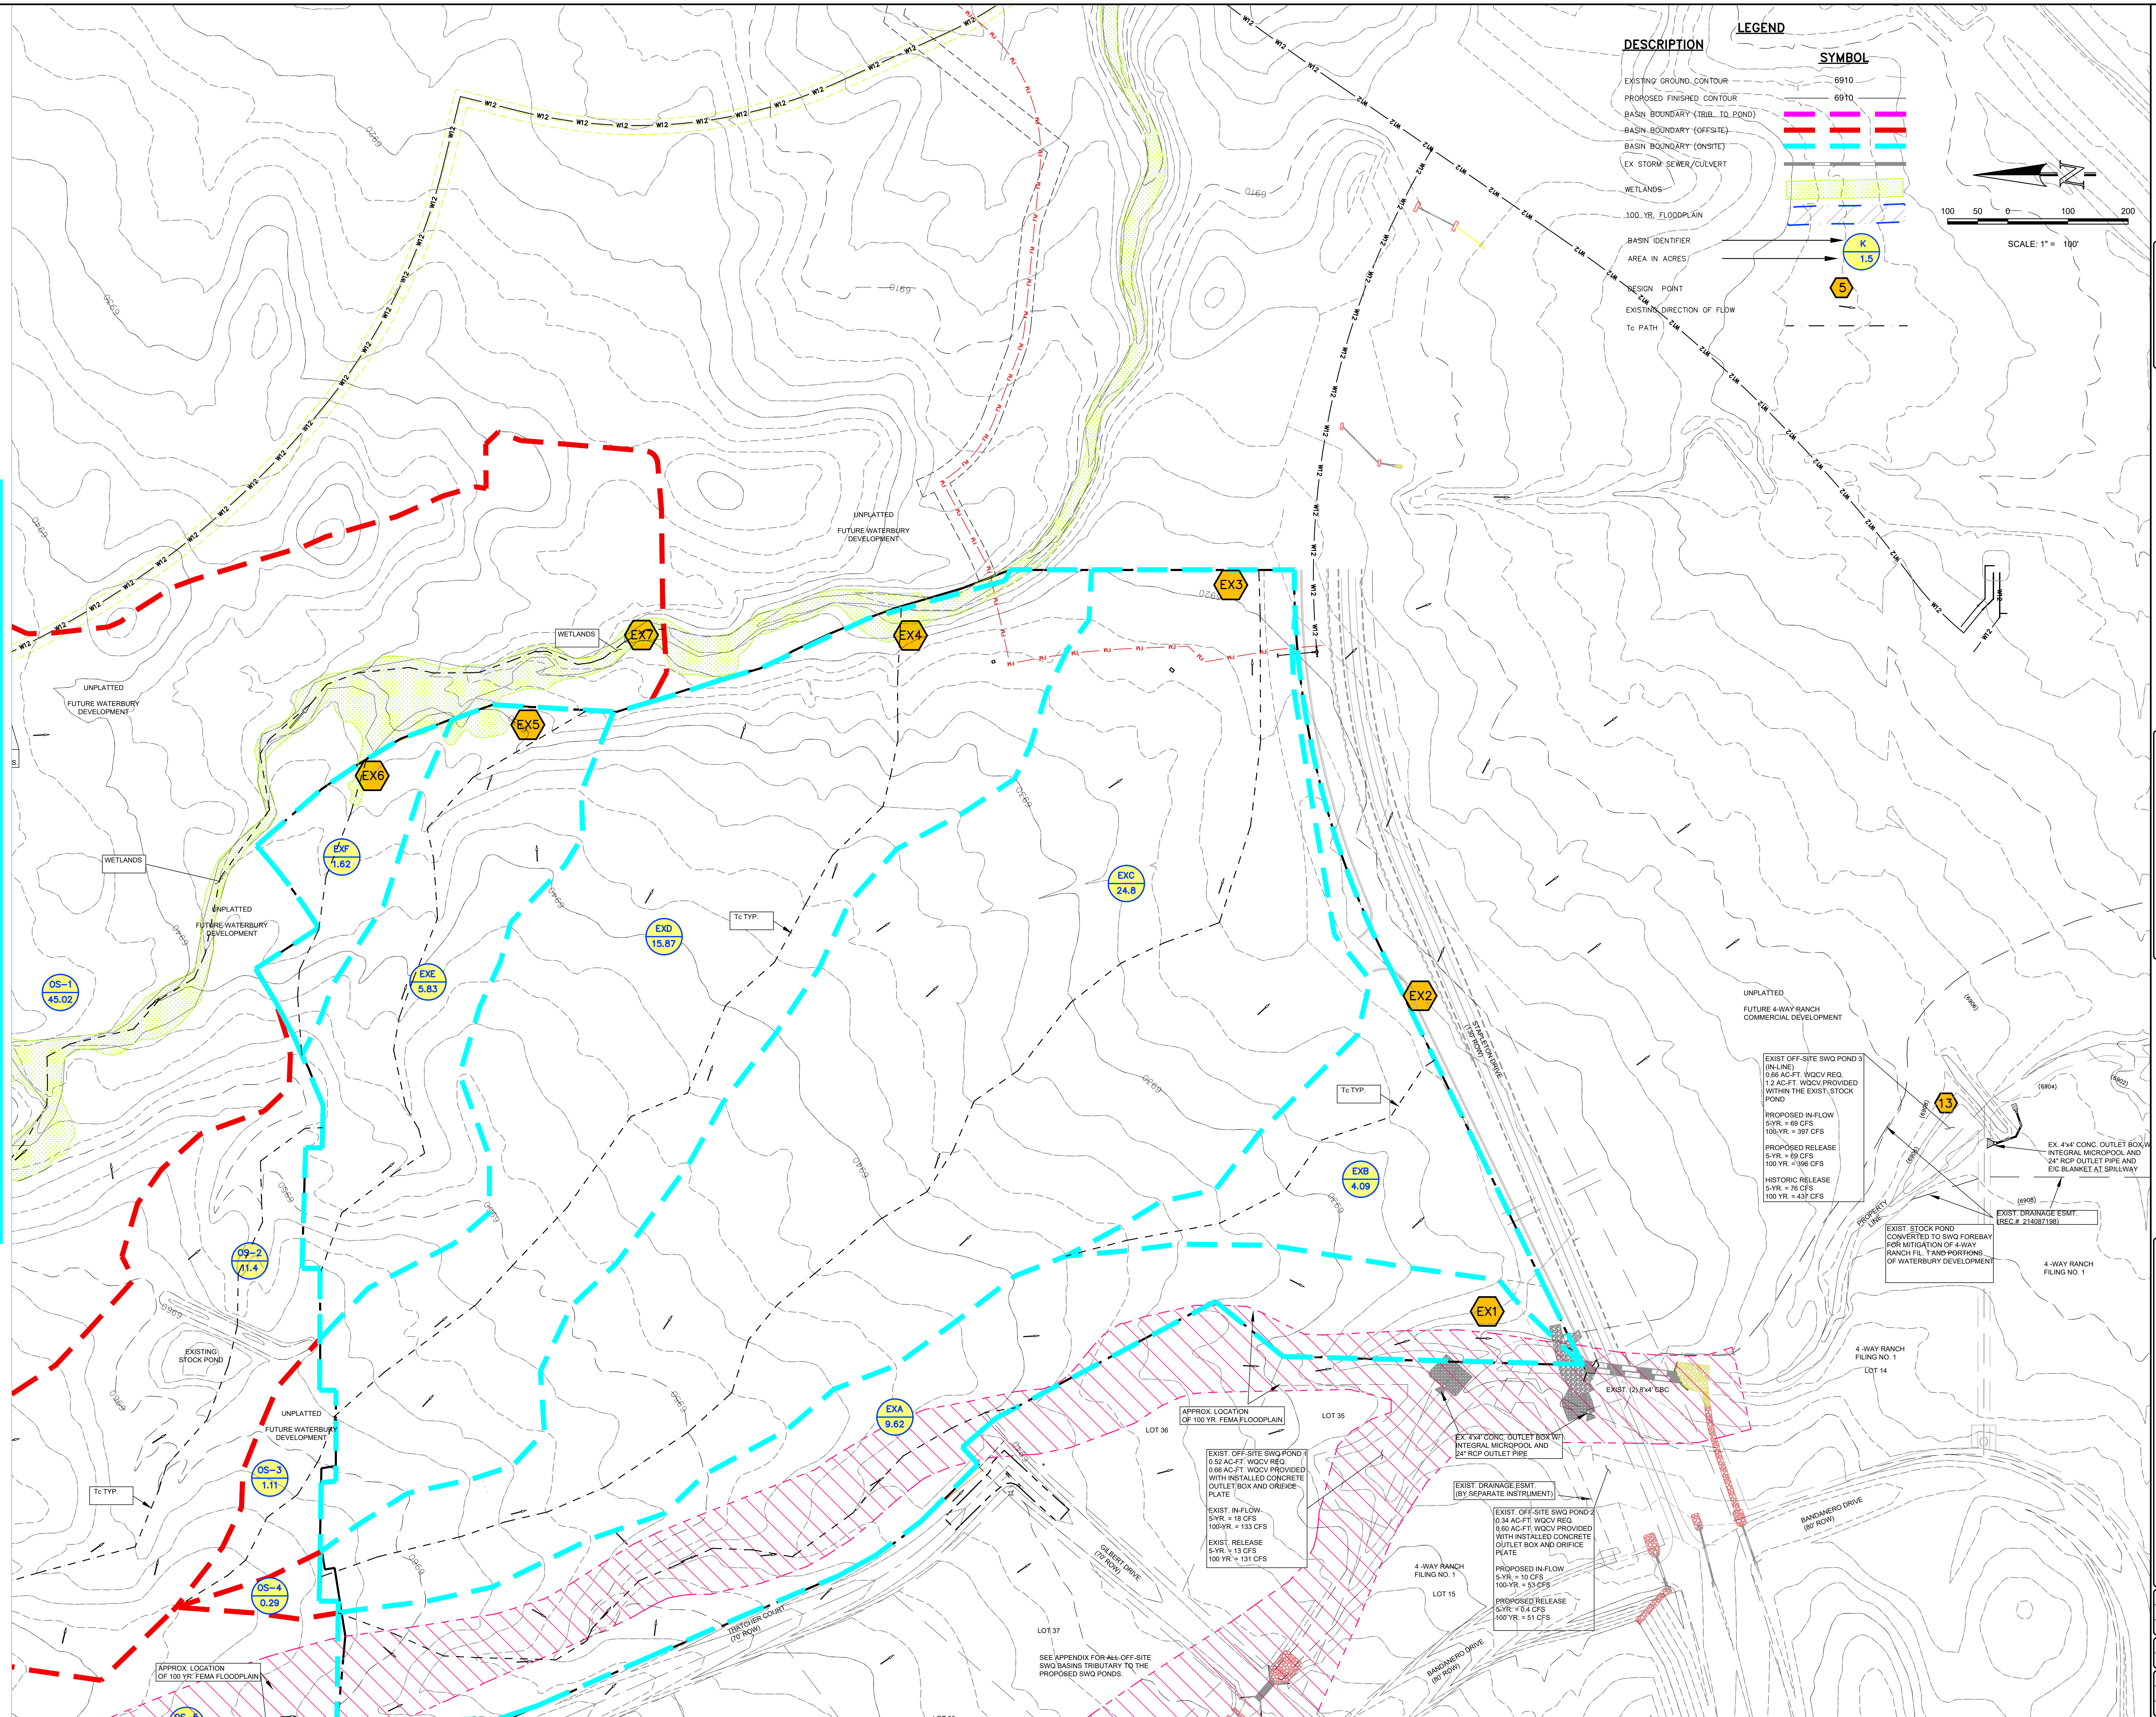[illegible]

MATCHLINE SEE SHEET 2

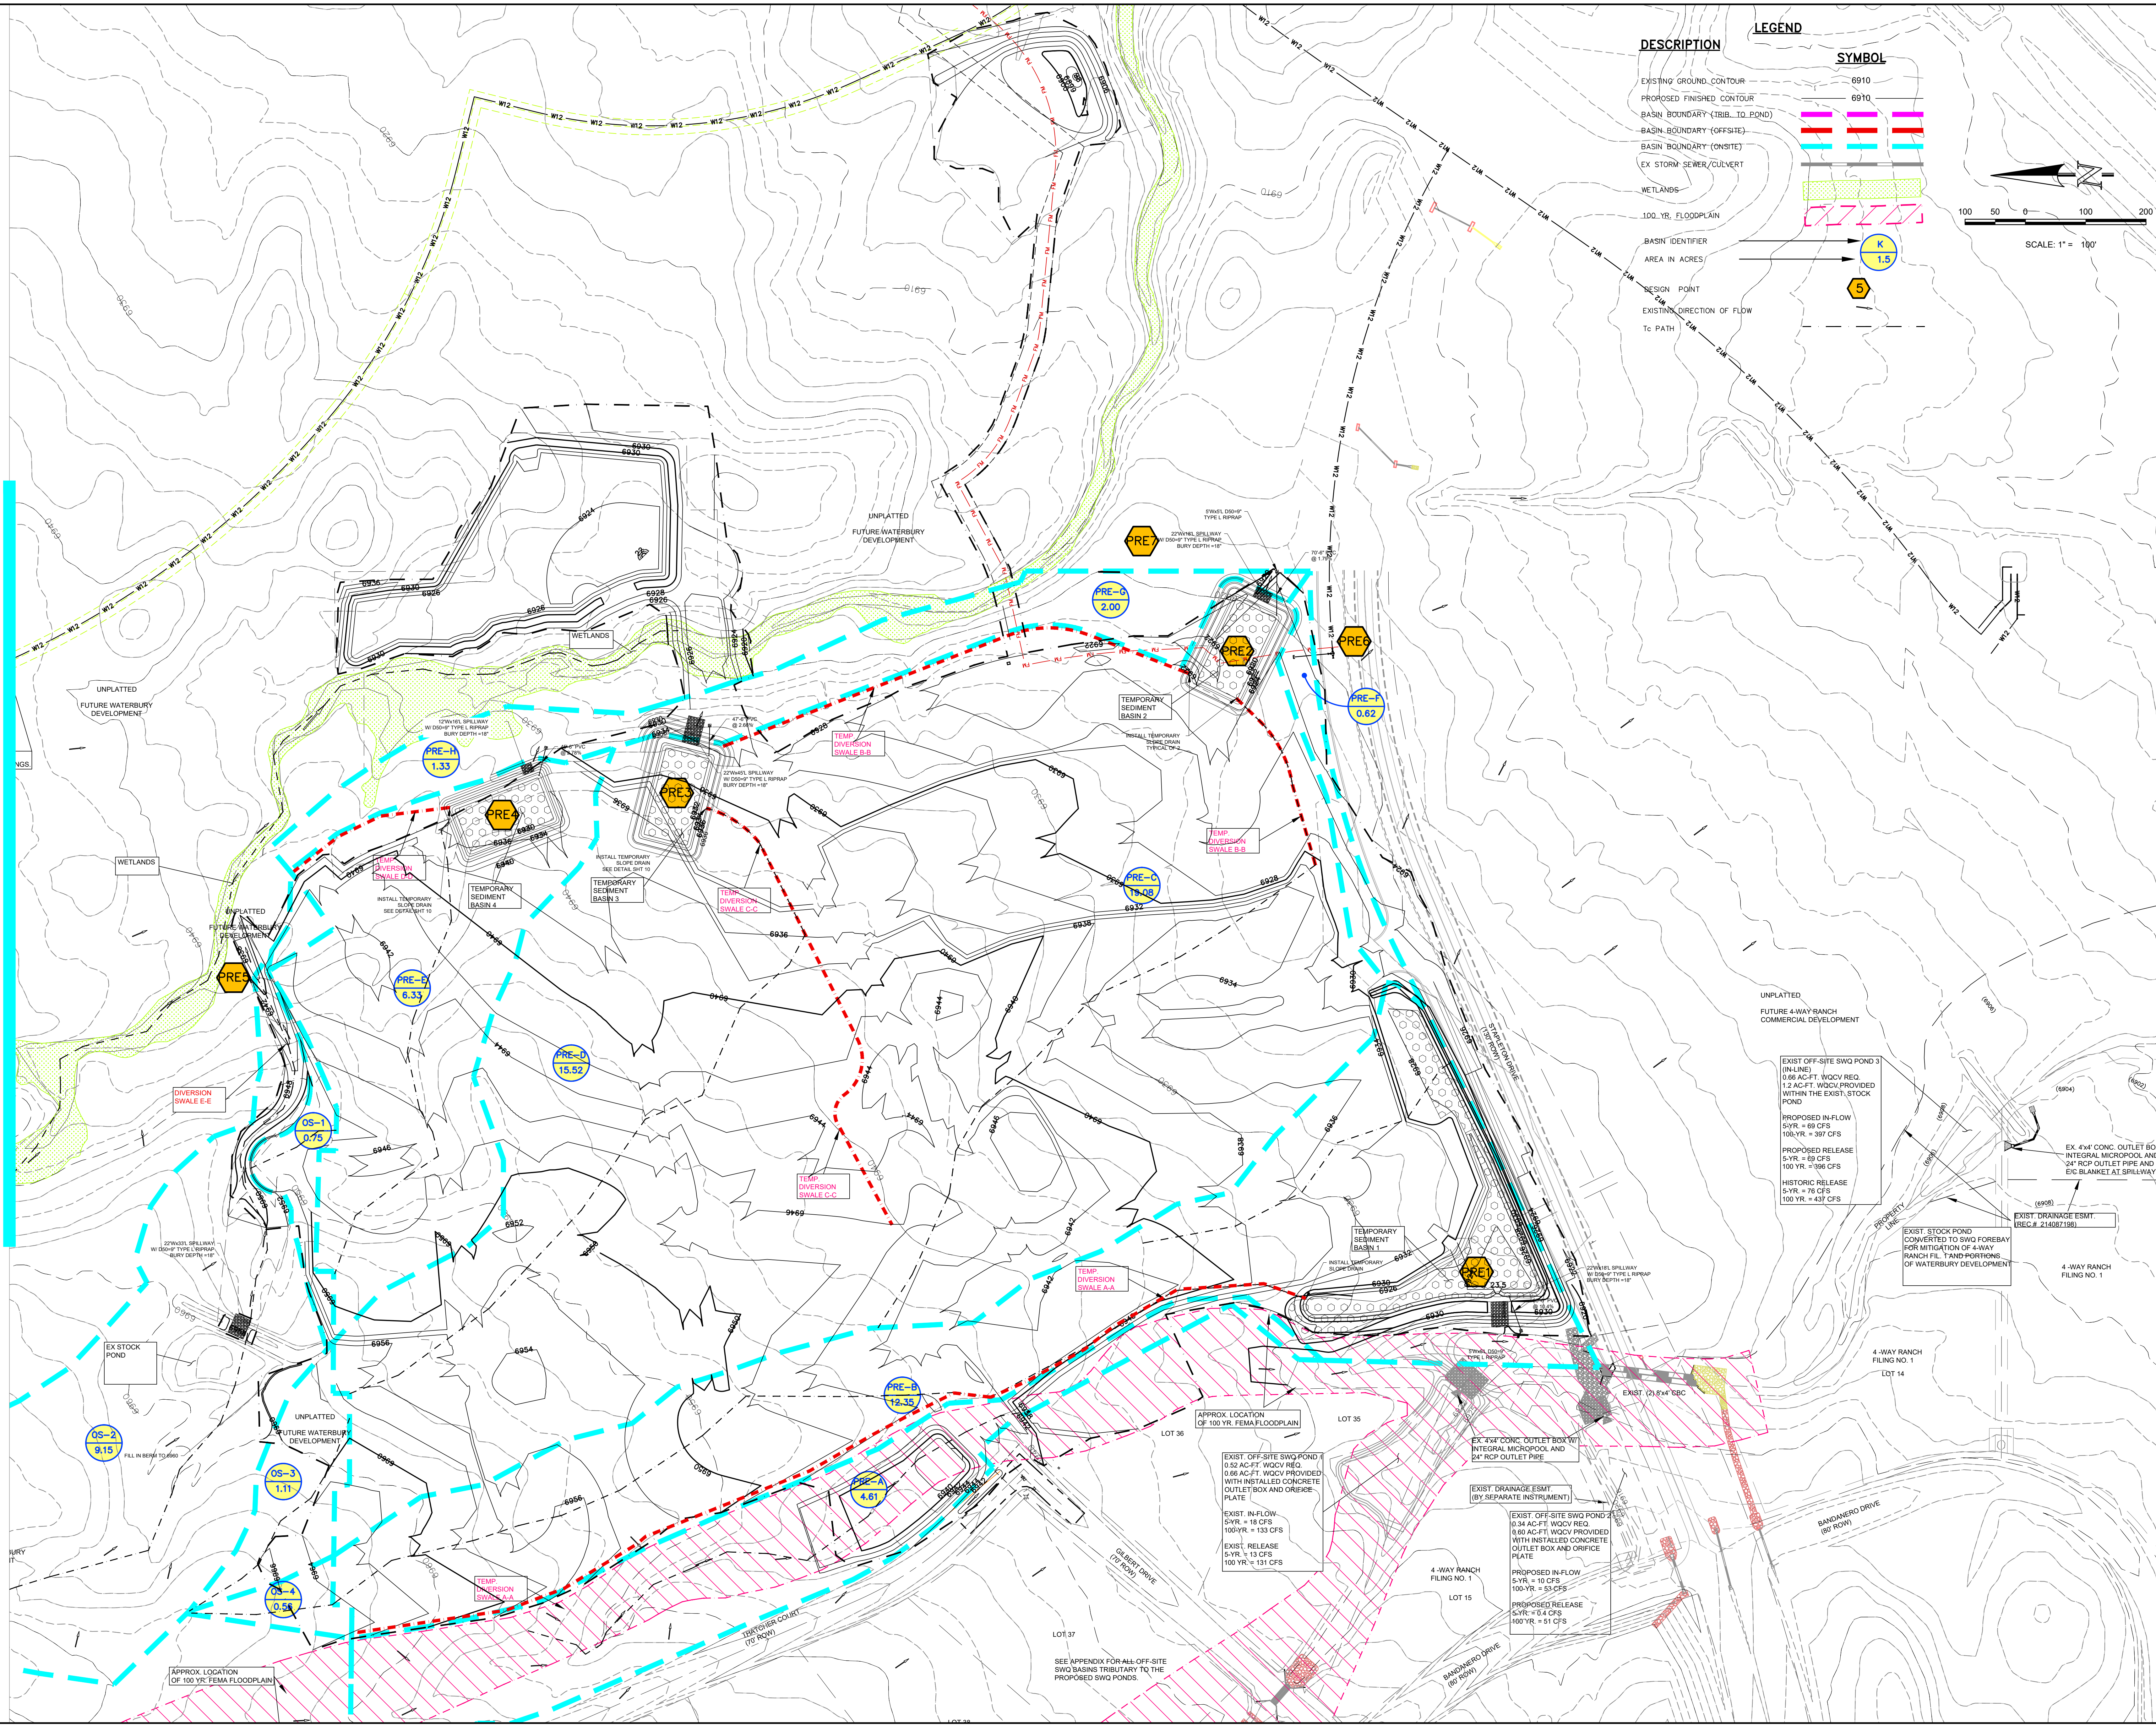

DESCRIPTION

EXISTING GROUND CONTOUR
PROPOSED FINISHED CONTOUR
BASIN BOUNDARY (TRIB. TO POND)
BASIN BOUNDARY (OFFSITE)
BASIN BOUNDARY (ONSITE)
EX STORM SEWER/CULVERT
WETLANDS
100 YR. FLOODPLAIN
BASIN IDENTIFIER
AREA IN ACRES
DESIGN POINT
EXISTING DIRECTION OF FLOW
TO PATH

LEGEND

SYMBOL

6910
6910
K 1.5
5

SCALE: 1" = 100'

UNITS SUCH TIME AS THESE
BY THE APPROPRIATE
REVIEWING AGENCIES
AND SURVEYING, INC.
APPROVES THEIR USE ONLY
DESIGNATED BY WRITTEN
AUTHORIZATION.

NO. DESCRIPTION DATE

REVISIONS

PREPARED FOR:
4-WAY RANCH JOINT VENTURES
ATTN: PETER MARTZ
PO BOX 50223
COLORADO SPRINGS, CO 80949
719-471-3150

Terra Nova
Engineering, Inc.
Pres/Pr. Civil Engineer (REG.)

721 S. 23RD STREET
COLORADO SPRINGS, CO 80904
OFFICE: 719-634-4432
FAX: 719-635-6436
www.terrano.com

WATERBURY FILING 1 & 2
EARLY GRADING DRAINAGE MAP 2
ONSITE MAP

DESIGNED BY: QNA
DRAWN BY: QNA
CHECKED BY:
H-SCALE 1"=100'
V-SCALE
JOB NO. 1715.00
DATE ISSUED 7/20/22
SHEET NO. 1 OF 2

MDDP - PROPOSED SURFACE ROUTING SUMMARY											
Design Points	Contributing Basins	Area (AC)	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Facility Size	
						I(5)	I(100)	Q(5)	Q(100)		
1	A	3.39	1.52	2.00	14.3	3.54	6.03	5	12	10" Type R Sump Inlet	
2	C	0.86	0.39	0.51	6.9	4.98	8.14	2	4	5" Type R Sump Inlet	
3	B1	2.30	1.03	1.36	14.2	3.55	6.05	4	8	5" Type R Sump Inlet	
4	B2	3.58	1.61	2.11	14.8	3.49	5.93	6	13	10" Type R Sump Inlet	
5	F & H	3.65	1.64	2.15	9.5	4.14	7.22	7	16	10" Type R Sump Inlet	
6	D	2.11	0.95	1.24	11.4	3.87	6.09	4	8	5" Type R Sump Inlet	
7	E	2.18	0.98	1.29	13.8	3.59	5.12	4	8	5" Type R Sump Inlets	
7A	G1	0.53	0.24	0.31	5.0	5.00	9.06	1	3	5" Type R Algrade Inlet	
7B	G2	0.69	0.31	0.41	5.0	5.00	9.06	2	4	5" Type R Algrade Inlet	
8	DESIGN POINTS 1-7 & K	18.06	8.13	10.66	14.8	3.49	5.93	28	63	FSD Pond 1	
9	OS-9	11.80						8	19	EX 36" RCP Culvert	
10	OS-8	2.56						5	11	EX 36" RCP Culvert	
10A	MERIDIAN POND E RELEASE	Meridian Ranch Filing 3 FOR Calculated Flows							28	185	EX 3-42" RCP Culverts
11	OS-A, L, OP18A (MERIDIAN POND E RELEASE)	Sum of Basins							34	216	PR 2-42" RCP Culverts
11A	DP 11 & BASIN J	Sum of Basins							37	222	PR 2-42" RCP Culverts
12	OS-6	1.06	0.48	0.63	10.1	4.05	7.04	2	4	18" RCP Culvert	
13	TOTAL OFFSITE EX STOCK POND INFLOW	Per "Final Drainage Report for Waterbury Filing No. 1" dated September 2016, by Classic Consulting							69	396	EX STOCK POND
14	L1	3.79	1.71	2.24	16.1	3.36	5.69	6	13	10" Type R Sump Inlet	
15	L2	2.00	0.90	1.18	12.8	3.70	6.34	3	7	5" Type R Sump Inlet	
16	O1	2.62	1.27	1.66	13.5	3.62	6.19	5	10	10" Type R Sump Inlet	
17	O2	0.71	0.32	0.42	15.5	3.42	5.80	1	2	5" Type R Sump Inlet	
18	DESIGN POINTS 14-17 & BASIN OS-4	20.23	5.18	5.50	16.1	3.36	5.69	17	31	Interim FSD Pond 2	
19	O1 & OS-O1	5.78	2.60	3.41	22.4	2.88	4.78	8	16	10" Type R Sump Inlet	
20	Q2 & OS-Q2	1.89	0.85	1.12	12.4	3.75	6.43	3	7	5" Type R Sump Inlet	
21	R & OS-R	7.06	3.18	4.17	11.4	3.87	6.69	12	28	10" Type R Algrade Inlet	
22	S1 & OS-S1 & DP 21 FLOWBY	8.34	4.42	5.64	16.7	3.32	5.60	15	32	10" Type R Sump Inlet	
23	S2 & OS-S2	0.31	0.14	0.18	12.6	3.72	6.39	1	1	10" Type R Sump Inlet	
23 & 23 SPLIT	S1, OS-S1, S2, OS-S2, & DP 21 FLOWBY	8.65	4.56	5.82	16.7	3.32	5.60	8	16	2-10" Type R Sump Inlets	
24	T1	1.42	0.64	0.84	10.7	3.97	6.88	3	6	5" Type R Sump Inlets	
25	T2 & OS-T2	1.99	0.90	1.18	13.5	3.63	6.20	3	7	5" Type R Sump Inlets	
26	U1	4.38	1.97	2.58	14.3	3.54	6.03	7	16	10" Type R Sump Inlets	
27	U2	1.89	0.85	1.11	13.8	3.59	5.12	3	7	5" Type R Sump Inlets	
28	W	5.20	2.34	3.07	15.0	3.47	5.89	8	18	2-10" Type R Sump Inlets	
29	OPS 19, 31, 32, OFFSITE BASINS OS-1, 2, 3A, 3B, 7, 8, 9	82.44	36.10	47.71	22.4	2.88	4.78	112	247	FSD POND	
30	"Y" & OS-Y	3.76	0.46	1.43	13.5	3.62	6.19	2	9	Triple 36" RCP Culverts	
30	FSD POND 3 EMERGENCY SPILLWAY RELEASE	MHFD DETENTION 100YR PEAK INFLOW							247	Triple 36" RCP Culverts	
30A	FSD POND RELEASE & DP 30	MHFD DETENTION 100YR PEAK INFLOW							3	67	EAST CHANNEL
31	V	0.54	0.24	0.32	5.0	5.00	9.06	1	3	18" DIA INLETS	
32	X	0.43	0.19	0.25	5.0	5.00	9.06	1	2	18" DIA INLETS	
33	O-3	0.45	0.20	0.27	5.0	5.00	9.06	1	2	18" DIA INLETS	
34	O-4	0.38	0.17	0.23	5.0	5.00	9.06	1	2	18" DIA INLETS	

MDDP - PROPOSED BASIN RUNOFF SUMMARY										
BASIN	WEIGHTED CA(5)	CA(100)	C(5)	Length (ft)	Height (ft)	Tc (min)	STREET / CHANNEL FLOW Length (ft)	Velocity (ft/s)	Tc (min)	TOTAL (ft)
A	1.52	2.00	0.25	100	2	12.6	420	1.54	4.3	1.6
B1	1.03	1.36	0.25	100	2	12.6	400	1.54	4.3	1.6
B2	1.61	2.11	0.25	100	2	12.6	550	1.54	4.3	2.1
C	0.39	0.51	0.25	80	0.5	5.3	500	2.05	4.9	1.7
D	0.95	1.24	0.25	80	2	10.6	300	2.05	5.5	0.9
E	0.98	1.29	0.25	100	2	12.6	400	2.05	5.5	1.2
F	0.98	1.29	0.25	90	2	7.1	620	1.54	4.3	2.4
G1	0.24	0.31	0.25							5.0
G2	0.31	0.41	0.25							5.0
H	0.86	0.86	0.25	90	2	7.1	525	1.54	4.3	2.0
I	0.97	2.12	0.25	80	4	8.4	250	2.05	4.9	0.8
J	0.65	0.85	0.25	90	6	8.1	850	2.05	4.9	2.9
K	0.69	1.37	0.25	100	18	6.1	80	1.04	3.5	0.4
L1	1.71	2.24	0.25	100	2	12.6	880	1.44	4.1	3.5
L2	0.90	1.18	0.25	55	1.1	9.4	880	1.44	4.1	3.5
M1	0.44	0.58	0.25	70	1.5	10.3	200	2.05	4.9	0.7
M2	0.16	0.21	0.25	65	3	7.7	0	0.05	0.0	0.0
N	0.10	0.13	0.25							5.0
O1	1.27	1.66	0.25	100	2.5	11.7	480	1.54	4.3	1.8
O2	0.32	0.42	0.25	100	2	12.6	850	2.05	4.9	2.9
O3	0.20	0.27	0.25							5.0
O4	0.17	0.23	0.25							5.0
P	0.06	0.25	0.25							5.0
Q1	0.86	0.87	0.25	55	1.3	8.9	445	2.05	5.0	1.5
Q2	0.43	0.56	0.25	55	1.3	8.9	445	2.05	5.0	1.5
R	0.46	0.60	0.25	100	4	10.1	700	2.05	4.9	2.4
S1	0.70	0.91	0.25	100	6	8.8	175	2.05	4.9	0.6
S2	0.06	0.08	0.25							5.0
T1	0.64	0.84	0.25	55	1.1	9.4	380	2.05	4.9	1.3
T2	0.55	0.73	0.25	100	2	12.6	245	2.05	5.0	0.8
U1	1.97	2.58	0.25	100	2	12.6	550	2.34	5.3	1.6
U2	0.85	1.11	0.25	100	2	12.6	385	2.34	5.4	1.2
V	0.24	0.32	0.25							5.0
W	2.34	3.07	0.25	100	2	12.6	630	1.64	4.4	2.4
X	0.19	0.25	0.25							5.0
Y	0.16	0.21	0.25							5.0
OS-1	5.31	6.97	0.25	100	2	12.6	680	2.05	5.0	2.3
OS-2	5.19	6.80	0.25	100	2	12.6	1700	1.84	4.6	6.1
OS-3A	0.35	0.47	0.25	55	1.1	9.4	480	1.34	3.9	2.0
OS-3B	2.55	3.34	0.25	100	2	12.6	480	1.34	3.9	2.0
OS-4	0.98	3.92	0.25	800	26	30.5				30.5
OS-5	0.51	2.03	0.25	80	5	7.8	1000	2.54	5.5	3.0
OS-6	0.48	0.63	0.25	30	0.6	6.9	800	1.84	4.7	3.2
OS-7	0.25	1.01								5.0
OS-8	FLOW TAKEN FROM MERIDIAN RANCH MDP									5
OS-9	FLOW TAKEN FROM MERIDIAN RANCH MDP									8
OS-10	0.31	1.23	0.25	100	2	12.6	300	2.74	5.7	0.9
OS-01	1.94	2.94	0.25	200	5	16.6	1500	1.54	4.3	5.8
OS-02	0.42	0.95	0.25	90	1	8.9	900	1.54	4.3	3.5
OS-R	2.72	3.57	0.25	90	1	8.9	850	2.74	5.8	2.5
OS-S1	2.91	3.30	0.25	100	2	12.6	620	1.24	3.8	4.0
OS-S2	0.08	0.10	0.25	100	2	12.6				12.6
OS-T2	0.34	0.45	0.25	100	2	12.6				12.6

* PIPES ARE LISTED AT MAXIMUM SIZE REQUIRED TO ACCOMMODATE Q100 FLOWS AT MINIMUM GRADE. REFER TO INDIVIDUAL PIPE SHEETS FOR HYDRAULIC INFORMATION.

MDDP - PIPE ROUTING SUMMARY										
Pipe Run	Contributing Design Points/Basins	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Pipe Size*	
					I(5)	I(100)	Q(5)	Q(100)		
1	DP 2	0.39	0.51	6.9	4.58	8.14	2	4	18" RCP	
2	DP 1 & 2	1.91	2.51	14.3	3.54	6.03	7	15	24" RCP	
3	DP 3	1.03	1.36	14.2	3.55	6.05	4	8	18" RCP	
4	DP-4	1.61	2.11	14.8	3.49	5.93	6	13	18" RCP	
5	DP 3 & 4	2.64	3.47	14.8	3.49	5.93	9	21	24" RCP	
6	DP 1-4	4.56	5.97	14.8	3.49	5.93	16	35	36" RCP	
7	DP-1-5	6.20	8.12	14.8	3.49	5.93	22	48	36" RCP	
8	DP-6	0.95	1.24	11.4	3.67	6.09	4	8	18" RCP	
9	DP-7	0.98	1.29	13.8	3.59	6.12	4	8	18" RCP	
10	DP-6 & 7	1.97	2.58	13.8	3.59	6.12	7	16	24" RCP	
10A	DP-7A	0.24	0.31	5.0	5.00	9.06	1	3	15" RCP	
10B	DP-7A & 7B	0.55	0.72	5.0	5.00	9.06	3	7	18" RCP	
10C	POND 1 RELEASE	2.95	3.87	13.8	3.59	6.12	0.4	14.5	18" RCP	
11	DP-14	1.71	2.24	16.1	3.36	5.69	6	13	24" RCP	
12	DP-15	0.90	1.18	12.8	3.70	6.34	3	7	18" RCP	
13	DP 14 & 15	2.61	3.42	16.1	3.36	5.69	9	19	30" RCP	
14	DP 16	1.27	1.66	13.5	3.62	6.19	5	10	24" RCP	
15	DP 14, 15 & 16	3.88	5.08	16.1	3.36	5.69	13	29	36" RCP	
16	DP 17	0.32	0.42	15.5	3.42	5.80	1	2	18" RCP	
17	DP 14, 15, 16, 17, 33, & 34	4.57	6.00	16.1	3.36	5.69	15	34	36" RCP	
17A	POND 2 RELEASE						0.2	15.1	18" RCP	
18	DP 19	2.60	3.41	22.4	2.88	4.78	8	16	24" RCP	
19	DP 20	0.85	1.12	12.4	3.75	6.43	3	7	18" RCP	
20	DP 18 & 19	3.46	4.53	22.4	2.88	4.78	10	22	24" RCP	
21	DP 21 PICK UP						8	14	18" RCP	
22	DP 19, 20 & 21	6.23	7.46	22.4	2.88	4.78	16	36	30" RCP	
23	DP 22	2.28	2.91	16.7	3.32	5.60	8	16	24" RCP	
24	DP 23	2.28	2.91	16.7	3.32	5.60	8	16	24" RCP	
25	DP 22 & 23	4.56	5.82	16.7	3.32	5.60	15	33	36" RCP	
26	DP 19-23	10.79	13.28	22.4	2.88	4.78	31	63	36" RCP	
27	DP 24	0.64	0.84	10.7	3.97	6.86	3	6	18" RCP	
28	DP 25	0.90	1.18	13.5	3.63	6.20	3	7	18" RCP	
29	DP 19-25	12.32	15.29	22.4	2.88	4.78	36	73	36" RCP	
30	DP 26	1.97	2.58	14.3	3.54	6.03	7	16	24" RCP	
31	DP 19-26	14.29	17.88	22.4	2.89	4.79	41	86	42" RCP	
32	DP 27	0.85	1.11	13.8	3.59	6.12	3	7	18" RCP	
33	DP 19-27, & 31	15.38	19.31	22.4	2.88	4.78	44	92	42" RCP	
34	DP 28 SPLIT	1.17	1.53	15.0	3.47	5.89	4	9	24" RCP	
34A	29 & 32	2.53	3.32	13.84	3.59	6.12	9	20	30" RCP	
35	Pond 3 Release	MHFD UD-DETENTION POND RELEASE					1.2	58.0	36" RCP	
36	DP 30	FSD POND 3 EMERGENCY SPILLWAY RELEASE						247.2	TRIPLE 36" RCP	
37	DP 31	0.24	0.32	5.00	5.00	9.06	1.2	3	15" HDPE	
38	DP 32	0.19	0.25	5.00	5.00	9.06	1.2	2	15" HDPE	
39	DP 33	0.20	0.27	5.00	5.00	9.06	1.2	2	15" HDPE	
40	DP 34	0.17	0.23	5.00	5.00	9.06	1.2	2	15" HDPE	

PELIMINARY DRAINAGE REPORT - SURFACE ROUTING SUMMARY										
Design Point(s)	Contributing Basins	Area (AC)	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow		Facility Size
						I(5)	I(100)	Q(5)	Q(100)	
1	A	3.39	1.52	2.30	14.3	3.54	4.00	5	12	10" Type R Sump Inlet
2	C	0.85	0.39	0.51	6.9	4.58	8.14	2	4	5" Type R Sump Inlet
3	B1	2.30	1.03	1.36	14.2	3.55	6.05	4	8	5" Type R Sump Inlet
4	B2	3.58	1.61	2.11	14.8	3.49	5.93	6	13	10" Type R Sump Inlet
5	F & H	3.05	1.64	2.15	9.5	4.14	7.22	7	16	10" Type R Sump Inlet
6	D	2.11	0.95	1.24	11.4	3.87	6.69	4	8	5" Type R Sump Inlet
7	E	2.18	0.98	1.29	13.8	3.59	6.12	4	8	5" Type R Sump Inlet
7A	G1	0.53	0.24	0.31	5.0	5.00	9.06	1	3	5" Type R Aggregate Inlet
7B	G2	0.69	0.31	0.41	5.0	5.00	9.06	2	4	5" Type R Aggregate Inlet
8	DESIGN POINTS 1-7 & K	18.06	8.13	10.66	14.8	3.48	5.93	26	63	FSD Pond 1
9	OS-9							8	19	EX 36" RCP Culvert
10	OS-8	2.56						5	11	EX 36" RCP Culvert
10A	MERIDIAN POND E RELEASE	Meridian Ranch Filing 3 FOR Calculated Flows						28	185	EX 3-42" RCP Culverts
11	OS-5, 1, OS-8 & MERIDIAN POND E RELEASE	Sum of Basins						34	216	PR 2-42" RCP Culverts
11A	DP 11 & BASIN J	Sum of Basins						37	222	PR 2-42" RCP Culverts
12	OS-6	1.06	0.48	0.63	10.1	4.06	7.04	2	4	18" RCP Culvert
13	TOTAL OFFSITE EX STOCK POND INFLOW	Per Final Drainage Report by Watersbury Filing No. 1 dated September 2016, by Classic Consulting						60	396	EX STOCK POND
14	L1	3.79	1.71	2.24	16.1	3.36	5.69	6	13	10" Type R Sump Inlet
15	L2	2.00	0.90	1.18	16.1	3.36	5.69	3	7	5" Type R Sump Inlet
16	O1	2.82	1.27	1.66	13.5	3.62	6.19	5	10	10" Type R Sump Inlet
17	G2	0.71	0.32	0.42	15.5	3.42	5.80	1	2	5" Type R Sump Inlet
18	DESIGN POINTS 14-17 & BASIN OS-4	20.23	5.18	5.50	16.1	3.36	5.69	17	31	Interim FSD Pond 2
19*	Q1 & OS-Q1	1.81	0.89	0.99	13.2	3.86	6.27	3	6	10" Type R Sump Inlet
20*	Q2 & OS-Q2	1.18	0.45	0.65	9.5	4.14	7.24	2	5	5" Type R Sump Inlet
21*	R & OS-R	2.06	0.55	0.98	12.4	3.75	6.44	2	6	10" Type R Aggregate Inlet
22*	S1 & OS-S1	1.86	0.72	1.02	12.4	3.75	6.44	3	7	10" Type R Sump Inlet
23*	S2 & OS-S2	0.27	0.07	0.13	5.0	5.00	9.06	0	1	10" Type R Sump Inlet
24*	T1	1.42	0.64	0.84	10.7	3.97	6.88	3	6	5" Type R Sump Inlets
25*	T2 & OS-T2	1.54	0.58	0.84	13.5	3.83	6.30	2	5	5" Type R Sump Inlets
26*	U1	4.38	1.97	2.58	14.3	3.54	6.05	7	16	5" Type R Sump Inlets
27*	U2	1.89	0.85	1.11	13.8	3.59	6.12	3	7	5" Type R Sump Inlets
28	W	5.29	2.34	3.07	15.0	3.47	5.89	8	18	2-10" Type R Sump Inlets
29*	DESIGN POINTS 19-28 & OS-7	24.41	9.13	13.21	15.0	3.47	5.89	32	78	FSD POND 3
E-E*	OS-2 & OS-8	14.58	2.66	6.20	18.4	3.17	5.32	8	33	DIVERSION SWALE E-E
30*	Y, OS-1, OS-2, OS-8 & OS-9	67.82	9.32	20.34	21.1	3.97	4.94	36	120	Triple 36" RCP Culverts
31	V	0.54	0.24	0.32	5.0	5.00	9.06	1	3	18" DIA INLETS
32	X	0.43	0.19	0.25	5.0	5.00	9.06	1	2	18" DIA INLETS
33	O-3	0.45	0.20	0.27	5.0	5.00	9.06	1	2	18" DIA INLETS
34	O-4	0.38	0.17	0.23	5.0	5.00	9.06	1	2	18" DIA INLETS


DESIGN POINT ** DESIGN POINT REVISED FROM MDDP IN PRELIMINARY CONDITION DUE TO UNDEVELOPED UPSTREAM

PELIMINARY DRAINAGE REPORT - PIPE ROUTING SUMMARY										
Pipe Run	Contributing Design Points/Basins	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity		Flow			Pipe Size*
					I(5)	I(100)	Q(5)	Q(100)		
1	DP-2	0.39	0.51	6.9	4.58	8.14	2	4		18" RCP
2	DP 1 & 2	1.91	2.51	14.3	3.54	6.03	7	15		24" RCP
3	DP-3	1.03	1.36	14.2	3.55	6.05	4	8		18" RCP
4	DP-4	1.61	2.11	14.8	3.49	5.93	6	13		18" RCP
5	DP 3 & 4	2.54	3.47	14.8	3.48	5.93	9	21		24" RCP
6	DP 1-4	4.56	5.97	14.8	3.49	5.93	16	35		30" RCP
7	DP 1-5	6.20	8.12	14.8	3.49	5.93	22	48		30" RCP
8	DP-6	0.95	1.24	11.4	3.87	6.69	4	8		18" RCP
9	DP-7	0.98	1.29	13.8	3.59	6.12	4	8		18" RCP
10	DP-8 & 7	1.93	2.53	13.8	3.59	6.12	7	15		24" RCP
10A	DP-7A	0.24	0.31	5.0	5.00	9.06	1	3		15" RCP
10B	DP-7A & 7B	0.55	0.72	5.0	5.00	9.06	3	7		18" RCP
10C	Pond 1 Release							0.4	14.5	18" RCP
11	DP-14	1.71	2.24	16.1	3.36	5.69	6	13		24" RCP
12	DP-15	0.90	1.18	16.1	3.36	5.69	3	7		18" RCP
13	DP 14 & 15	2.61	3.42	16.1	3.36	5.69	9	19		30" RCP
14	DP 16	1.27	1.66	13.5	3.62	6.19	5	10		24" RCP
15	DP 14, 15 & 16	3.88	5.08	16.1	3.36	5.69	13	29		30" RCP
16	DP 17	0.32	0.42	15.5	3.42	5.80	1	2		18" RCP
17	DP 14, 15, 16, & 17	4.20	5.50	16.1	3.36	5.69	14	31		30" RCP
17A	Pond 2 Release							1.1	2.4	18" RCP
18*	DP 19	0.69	0.99	13.2	3.88	6.27	3	6		24" RCP
19*	DP 20	0.45	0.65	9.5	4.14	7.24	2	5		18" RCP
20*	DP 19 & 20	1.15	1.64	13.2	3.88	6.27	4	10		24" RCP
21*	DP 21 PICK UP							2	6	18" RCP
22*	DP 19, 20 & 21	1.69	2.59	13.2	3.88	6.27	6	16		30" RCP
23*	DP 22	0.72	1.02	12.4	3.75	6.44	3	7		24" RCP
24*	DP 23	0.67	0.13	5.0	5.00	9.06	0	1		24" RCP
25*	DP 22 & 23	0.80	1.15	12.4	3.75	6.44	3	7		30" RCP
26*	DP 19-23	2.49	3.74	13.2	3.88	6.27	9	23		30" RCP
27*	DP 24	0.64	0.84	10.7	3.97	6.88	3	6		18" RCP
28*	DP 25	0.58	0.84	13.5	3.83	6.30	2	5		18" RCP
29*	DP 19-25	3.71	5.42	13.5	3.83	6.30	13	34		30" RCP
30*	DP 26	1.97	2.58	14.3	3.54	6.03	7	16		24" RCP
31*	DP 19-26	5.68	8.00	14.3	3.54	6.03	20	48		42" RCP
32*	DP 27	0.85	1.11	13.8	3.59	6.12	3	7		18" RCP
33*	DP 19-27 & 31	6.77	9.43	14.3	3.54	6.03	24	57		42" RCP
34	DP 28	2.34	3.07	15.03	3.47	5.89	8	18		24" RCP
34A	29 & 32	2.53	3.32	15.0	3.47	5.89	9	20		30" RCP
35	Pond 3 Release							1	58	36" RCP
36*	DP 30	SUM OF BASINS						36	120	TRIPLE 36" RCP
37	DP 31	0.24	0.32	5.00	5.00	9.06	1	3		15" HDPE
38	DP 32	0.19	0.25	5.00	5.00	9.06	1	2		15" HDPE
39	DP 33	0.20	0.27	5.00	5.00	9.06	1	2		15" HDPE
40	DP 34	0.17	0.23	5.00	5.00	9.06	1	2		15" HDPE

PIPE RUN ** PIPE RUN REVISED FROM MDDP IN PRELIMINARY CONDITION DUE TO UNDEVELOPED UPSTREAM


PELIMINARY DRAINAGE REPORT - BASIN RUNOFF SUMMARY													
BASIN	WEIGHTED CA(5)	CA(100)	C(5)	OVERLAND Length (ft)	STREET / CHANNEL FLOW Velocity (ft/s)	Tc (min)	INTENSITY I(5)	TOTAL Q(5)	INTENSITY I(100)	TOTAL Q(100)	5	10	
A	1.52	2.00	0.25	100	2	12.6	430	1.56	4.3	1.6	14.3	3.54	6.03
B1	1.03	1.36	0.25	100	2	12.6	400	1.56	4.3	1.6	14.2	3.55	6.05
B2	1.61	2.11	0.25	100	2	12.6	590	1.56	4.3	2.1	14.8	3.49	5.93
C	0.39	0.51	0.25	20	0.5	5.3	500	2.06	4.9	1.7	6.9	4.58	8.14
D	0.95	1.24	0.25	80	2	10.5	300	2.06	5.5	0.9	11.4	3.87	6.69
E	0.98	1.29	0.25	100	2	12.6	400	2.06	5.5	1.2	15.8	3.59	6.12
F	0.98	1.29	0.25	90	2	7.1	630	1.56	4.3	2.4	9.5	4.14	7.22
G1	0.54	0.71	0.25								5.0	5.00	9.06
G2	0.51	0.41	0.25								5.0	5.00	9.06
H	0.66	0.86	0.25	50	2	7.1	525	1.56	4.3	2.0	9.2	4.18	7.33
I	0.87	2.12	0.25	80	4	8.4	200	2.06	4.9	0.8	9.2	4.18	7.32
J	0.65	0.85	0.25	90	6	8.1	800	2.06	4.9	2.9	10.6	3.94	6.81
K	0.69	1.37	0.25	100	16	6.1	80	1.06	3.5	0.4	6.5	4.67	8.33
L1	1.71	2.24	0.25	100	2	12.6	860	1.46	4.1	3.5	16.1	3.36	5.69
L2	0.90	1.18	0.25	55	1.1	9.4	860	1.46	4.1	3.5	12.8	3.70	6.34
M1	0.44	0.58	0.25	70	1.5	10.3	200	2.06	4.9	0.7	11.0	3.82	6.19
M2	0.16	0.21	0.25	65	3	7.7	0	0.06	0.0	0.0	7.7	4.43	7.83
N	0.10	0.13	0.25								5.0	5.00	9.06
O1	1.27	1.66	0.25	100	25	11.7	480	1.56	4.3	1.8	15.5	3.62	6.19
O2	0.32	0.42	0.25	100	2	12.6	800	2.06	4.9	2.9	15.5	3.42	5.80
O3	0.20	0.27	0.25								5.0	5.00	9.06
O4	0.17	0.23	0.25								5.0	5.00	9.06
P	0.06	0.25	0.25								5.0	5.00	9.06
Q1	0.66	0.87	0.25	55	1.3	8.9	445	2.06	5.0	1.5	10.4	4.01	6.97
Q2	0.43	0.56	0.25	55	1.3	8.9	445	2.06	5.0	1.5	10.4	4.01	6.97
R	0.46	0.60	0.25	100	4	10.1	700	2.06	4.9	2.4	12.4	3.75	6.44
S1	0.70	0.91	0.25	100	6	8.8	175	2.06	4.9	0.6	9.4	4.16	7.26
S2	0.54	0.68	0.25								5.0	5.00	9.06
T1	0.94	0.94	0.25	55	1.1	9.4	300	2.06	4.9	1.3	10.7	3.97	6.88
T2	1.55	0.73	0.25	100	2	12.6	245	2.06	5.0	0.8	15.5	3.60	6.2
U1	1.07	2.78	0.25	100	2	12.6	1200	2.35	5.3	1.6	14.3	3.44	6.07
U2	0.85	1.11	0.25	100	2	12.6	355	2.06	5.4	1.2	13.8	3.59	6.12
V	0.24	0.32	0.25								5.0	5.00	9.06
W	2.34	3.07	0.25	100	2	12.6	630	1.66	4.4	2.4	15.0	3.47	5.89
X	0.19	0.25	0.25								5.0	5.00	9.06
Y	0.16	0.21	0.25								5.0	5.00	9.06
Z	0.33	0.43	0.25								5.0	5.00	9.06
GS-1	7.35	14.79	0.25	100	2	12.6	2000	2.25	5.3	8.5	21.1	2.87	4.44
GS-2	1.48	4.33	0.25	100	2	12.6	1000	1.66	3.5	5.7	18.4	3.71	5.32
GS-3	0.55	0.73	0.25	100	6	35.5	200	2.06	5.0	1.5	10.4	4.01	6.97
GS-4	0.51	1.03	0.25	100	5	7.8	100	2.06	5.0	1.7	7.4	4.03	7.06
GS-5	0.48	0.63	0.25	100	0	6.5	80	1.66	4.7	1.2	10.1	4.05	7.06
GS-6	0.25	0.11	0.25								5.0	5.00	9.06
FLOW TAKEN FROM MEDIAN DRAINAGE HOOD													
GS-8											5	11	
FLOW TAKEN FROM MEDIAN DRAINAGE HOOD													
GS-10*	0.03	0.12	0.25	100	1	12.6	135	1.56	4.3	0.5	13.2	3.68	6.27
GS-10*	0.02	0.08	0.25	100	1	12.6	135	1.56	4.3	0.5	14.4	3.74	7.24
GS-10*	0.09	0.38	0.25	100	2	12.6	50	2.75	5.8	6.1	12.8	3.73	6.3
GS-10*	0.03	0.11	0.25								5.0	5.00	9.06
GS-12	0.01	0.05	0.25								5.0	5.00	9.06
GS-12	0.03	0.11	0.25								5.0	5.00	9.06

FINAL DRAINAGE REPORT - BASIN RUNOFF SUMMARY													
BASIN	WEIGHTED CA(5)	CA(100)	C(5)	OVERLAND Length (ft)	Height (ft)	Tc (min)	STREET / CHANNEL FLOW Length (ft)	Slope (%)	Velocity (ft/s)	Tc (min)	Tc TOTAL (min)	INTENSITY I(2) (in/hr)	TOTAL FLOWS Q(2) (cfs)
A	1.80	1.88	0.25	100	2	12.6	420	1.5%	4.3	1.8	14.3	2.97	3.54
B1	1.25	1.47	0.25	100	2	12.6	400	1.5%	4.3	1.8	14.2	2.98	3.55
B2	1.14	1.34	0.25	100	2	12.6	550	1.5%	4.3	2.1	14.8	2.53	3.49
C	0.33	0.35	0.25	20	0.5	5.3	500	2.0%	4.9	1.7	6.9	3.38	4.65
D	0.84	0.98	0.25	90	2	10.5	300	2.0%	5.5	0.9	11.4	2.83	3.90
E	0.40	0.43	0.25	20	0.5	5.3	400	2.0%	5.5	1.2	6.5	3.48	4.76
F	0.96	1.12	0.25	80	2	10.5	920	1.5%	4.3	2.4	12.9	2.80	3.76
G	0.90	1.05	0.25	90	2	7.1	530	2.0%	4.9	1.8	8.9	3.11	4.28
H	0.57	0.67	0.25	50	2	7.1	525	1.5%	4.3	2.0	9.2	3.08	4.24
I	0.85	1.09	0.25	80	4	8.4	250	2.0%	4.9	0.8	9.2	3.07	4.23
J	0.90	1.15	0.25	90	6	8.1	850	2.0%	4.9	2.9	10.9	2.88	3.96
K	0.55	0.70	0.25	100	18	6.1	80	1.0%	3.5	0.4	6.5	3.45	4.75
L	0.10	0.14	0.25								5.0	3.71	5.10
M	0.22	0.26	0.25								5.0	3.71	5.10
N	0.17	0.19	0.25								5.0	3.71	5.10
O	0.55	0.62	0.25	80	6	7.3	200	3.0%	6.1	0.5	7.9	3.25	4.47
P	0.40	0.47	0.25	100	6	8.8					8.8	3.12	4.30
OS-1	0.63	0.74	0.25	50	1	8.9	300	2.0%	4.9	1.0	10.0	2.99	4.11
OS-2	0.23	0.27	0.25								5.0	3.71	5.10
OS-3	0.96	0.77	0.25	30	5	7.8					7.8	3.26	4.49
OS-4	0.34	0.40	0.25	100	4	10.1					10.1	2.97	4.09
OS-5	4.53	5.89	0.25	80	5	7.8	1000	2.5%	5.5	3.0	10.8	2.90	3.98
OS-6	0.88	0.76	0.25	30	0.6	6.9	900	1.8%	4.7	3.2	10.1	2.97	4.08

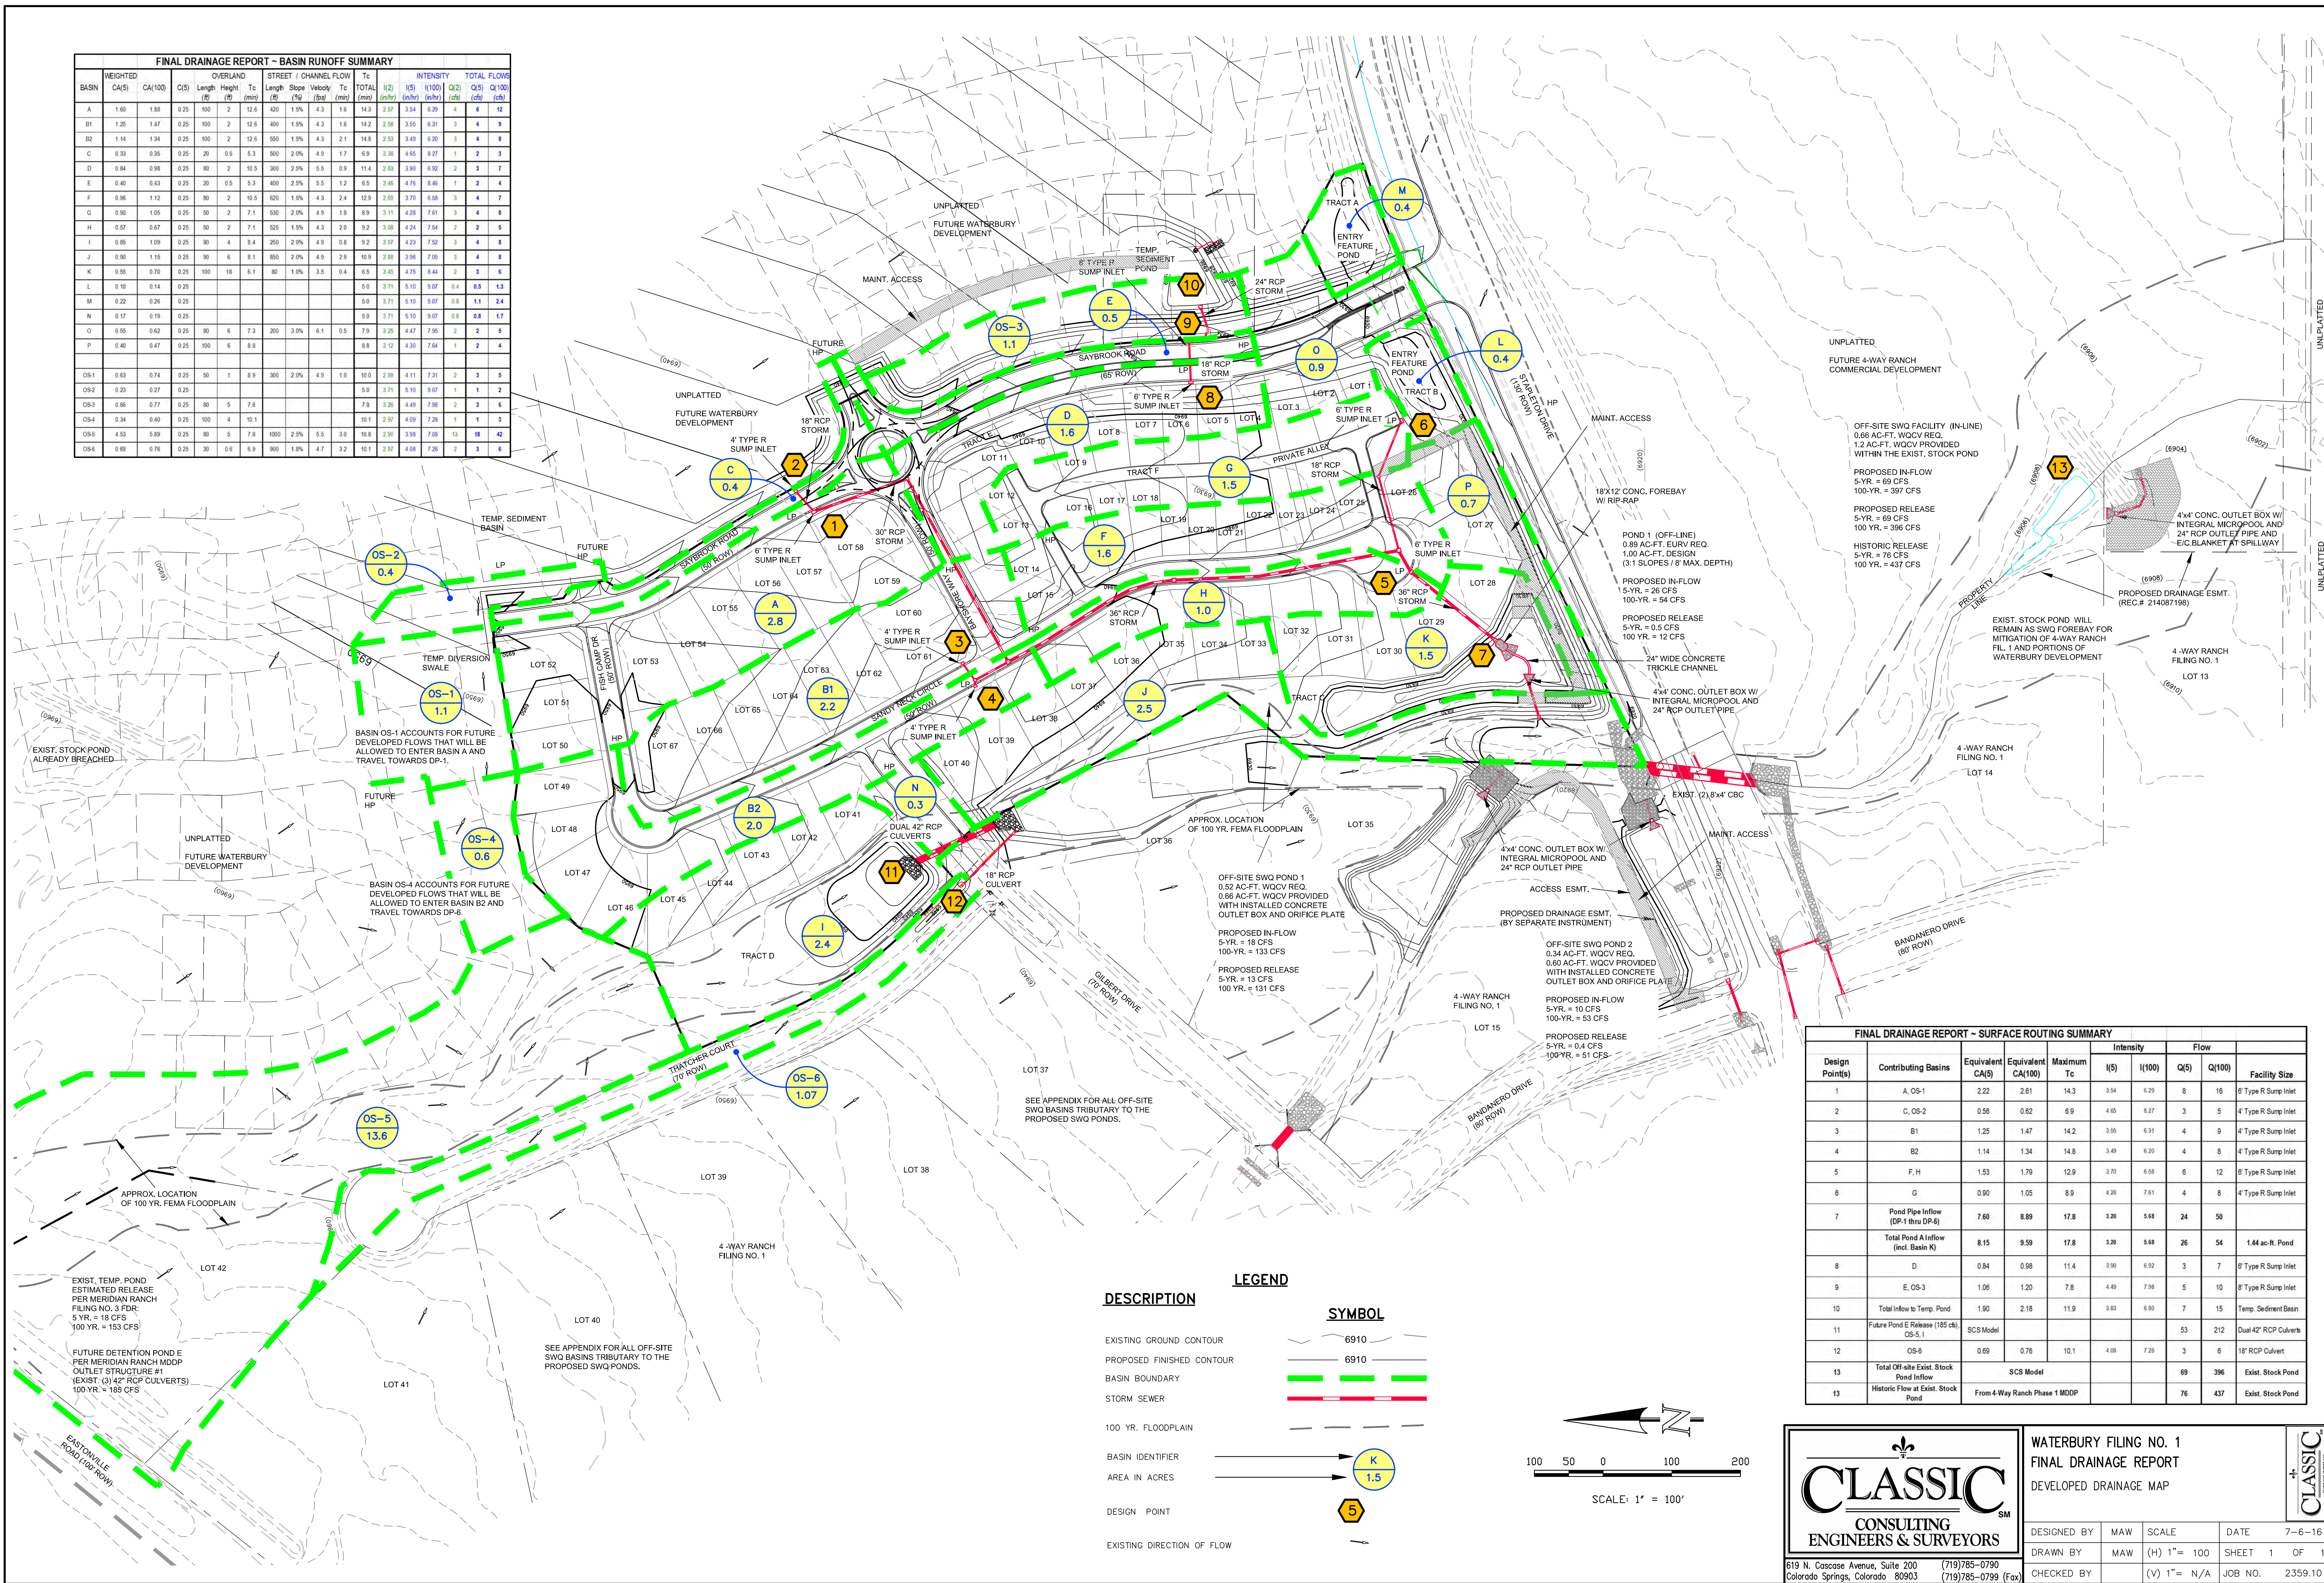

FINAL DRAINAGE REPORT - SURFACE ROUTING SUMMARY									
Design Point(s)	Contributing Basins	Equivalent CA(5)	Equivalent CA(100)	Maximum Tc	Intensity I(5)	Intensity I(100)	Flow Q(5)	Flow Q(100)	Facility Size
1	A, OS-1	2.22	2.61	14.3	3.54	6.29	8	16	6" Type R Sump Inlet
2	C, OS-2	0.58	0.62	6.9	4.65	8.27	3	5	4" Type R Sump Inlet
3	B1	1.25	1.47	14.2	3.55	6.31	4	9	4" Type R Sump Inlet
4	B2	1.14	1.34	14.8	3.49	6.20	4	8	4" Type R Sump Inlet
5	F, H	1.53	1.79	12.9	3.70	6.58	6	12	6" Type R Sump Inlet
6	G	0.90	1.05	8.9	4.26	7.61	4	8	4" Type R Sump Inlet
7	Pond Pipe Inflow (DP-1 thru DP-6)	7.60	8.89	17.8	1.38	5.68	24	50	
	Total Pond A Inflow (incl. Basin K)	8.15	9.59	17.8	1.38	5.68	26	54	1.44 ac-ft. Pond
8	D	0.84	0.98	11.4	3.98	6.92	3	7	6" Type R Sump Inlet
9	E, OS-3	1.06	1.20	7.8	4.49	7.98	5	10	6" Type R Sump Inlet
10	Total Inflow to Temp. Pond	1.50	2.18	11.9	3.63	6.80	7	15	Temp. Sediment Basin
11	Future Pond E Release (185 cfs) OS-5, I	SCS Model					53	212	Dual 42" RCP Culverts
12	OS-6	0.69	0.76	10.1	4.08	7.26	3	6	18" RCP Culvert
13	Total Off-site Exist. Stock Pond Inflow	SCS Model					69	396	Exist. Stock Pond
13	Historic Flow at Exist. Stock Pond	From 4-Way Ranch Phase 1 MDDP					76	437	Exist. Stock Pond

DESCRIPTION	SYMBOL
EXISTING GROUND CONTOUR	6910
PROPOSED FINISHED CONTOUR	6910
BASIN BOUNDARY	
STORM SEWER	
100 YR. FLOODPLAIN	
BASIN IDENTIFIER	K 1.5
AREA IN ACRES	5
DESIGN POINT	
EXISTING DIRECTION OF FLOW	

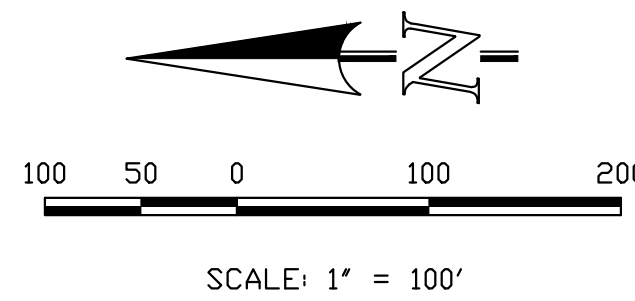

CLASSIC
CONSULTING
ENGINEERS & SURVEYORS

619 N. Cascade Avenue, Suite 200
Colorado Springs, Colorado 80903

(719)785-0790
(719)785-0799 (Fax)

WATERBURY FILING NO. 1 FINAL DRAINAGE REPORT DEVELOPED DRAINAGE MAP			
DESIGNED BY	MAW	SCALE	DATE
DRAWN BY	MAW	(H) 1" = 100'	SHEET 1 OF 1
CHECKED BY		(V) 1" = N/A	JOB NO. 2359.10

CLASSIC
ENGINEERS & SURVEYORS