

PRELIMINARY/FINAL DRAINAGE REPORT

FOR

JACKSON OFFICE WAREHOUSE & STORAGE BUILDINGS DEVELOPMENT ROCKY MOUNTAIN INDUSTRIAL PARK FILING NO. 1A, LOT 2

Prepared For:

**Jackson Developmental Solutions, LLC
55963 Maroon Mesa Drive
Colorado Springs, CO 80918**

Prepared By:

**Associated Design Professionals, Inc.
3520 Austin Bluffs Parkway Suite 102
Colorado Springs, CO 80918
719.266-5212**

ADP Project No.170602

March 27, 2018

PCD File No. PPR-17-057





ENGINEER'S STATEMENT:

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports, and said report is in conformity with the master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.

Michael A. Bartusek, P.E. #23329



DEVELOPER'S STATEMENT:

I, the Developer, have read and will comply with all of the requirements specified in this drainage report and plan.

By: _____

Title: President

Address: Jackson Developmental Solutions, LLC
5963 Maroon Mesa Drive
Colorado Springs, CO 80918

Filed in accordance the El Paso County Land Development Code, Drainage Criteria Manual Volumes 1 and 2, and the Engineering Criteria Manual, as amended.

Jennifer Irvine, County Engineer/ECM Administrator

Date

Conditions:

Kiowa Engineering Corporation. These flows enter the site within a 10' wide channel with estimated flows of 51.0 cfs for the 5-year storm and 116.7 cfs for the 100-year storm at DP1. The off-site sub-basin OS1 only drains the existing landscape area and produces flows of 0.2 cfs for the 5-year storm and 1.1 cfs for the 100-year storm. Sub-basin AEX drains to the western portion of the undeveloped site. It produces flows of 0.8 cfs and 5.7 cfs respectively. These flows combine with the flows from OS1 at DP2 to produce flows to Sandy Court of 0.8 cfs for the 5-year storm and 6.3 cfs for the 100-year storm. These flows combine with the flows from DP1 at DP2 to produce total flows of 51.0 cfs for the 5-year storm and 116.7 cfs for the 100-year storm.

The estimated runoff amounts produced for the project under existing conditions are shown in Table 1 below.

TABLE 1 – EXISTING CONDITIONS		
Sub-Basin	Q₅CFS	Q₁₀₀ CFS
OS1	0.2	1.1
AEX	0.8	5.7
DP1	50.2	116.8
DP2 (OS1 + AEX)	0.8	6.3
DP3(DP1+DP2)	49.5	118.4

DEVELOPED DRAINAGE CONDITIONS

The development of this site includes the addition of two (2) 5,067 sf office/warehouse buildings in the center of the site and a 3,000 sf vehicle storage building in the northwest corner of the site.

The lower portion of the lot will be paved with asphalt while the upper portion will be covered with gravel. The site will be regraded to direct the flows around the proposed office/warehouse buildings.

Flows from the northern area will be directed to curbs and cross pans in the southern area and directed into a sand filter water quality basin.

As stated in the previous section, a small amount of off-site flow enters the site from a grass-covered berm on the north side of the site. Sub-basin OS1 drains the western part of this berm and produces flows of 0.1 cfs for the 5-year storm and 0.7 cfs for the 100-year storm. These flows drain onto Sub-basin A1.

The western portion of the developed site is designated as Sub-basin A1. This sub-basin will produce flows of 2.5 cfs and 5.2 cfs respectively. These flows combine with the flows from OS1 at DP2 to produce flows of 2.6 cfs for the 5-year storm and 5.7 cfs for the 100-year storm. Flows from DP1 continue to the east and into Sub-basin A2.

Sub-basin OS2 drains the eastern part of this berm and produces flows of 0.1 cfs for the 5-year storm and 0.4 cfs for the 100-year storm. These flows drain onto Sub-basin A2.

The eastern portion of the developed site is designated as Sub-basin A2. This sub-basin will produce flows of 2.1 cfs and 4.2 cfs respectively. These flows combine with the flows from OS2 at DP3 to produce flows of 2.1 cfs for the 5-year storm and 4.6 cfs for the 100-year storm.

Flows from DP3 combine with the flows from DP2 at DP4 to produce total flows into the sand filter basin of 4.7 cfs for the 5-year storm and 10.2 cfs for the 100-year storm.

No flows enter the site from the east; however, flows from the north do enter the site as delineated in the Final Drainage Report for the Rocky Mountain Industrial Park by Kiowa Engineering Corporation. These flows enter the site within a 10' wide channel with estimated flows of 51.0 cfs for the 5-year storm and 116.7 cfs for the 100-year storm at DP1.

Sub-basin B drains the eastern swale and the landscape area south of the developed site. This area produces flows of 0.3 cfs and 1.1 cfs respectively. These flows combine with the flows from DP4 at DP5 to produce total site flows of 4.9 cfs for the 5-year storm and 11.2 cfs for the 100-year storm. These flows combine with the off-site flows from DP1 at DP6 to produce total site flows of 52.4 cfs for the 5-year storm and 122.0 cfs for the 100-year storm.

Table 2 shows the estimated runoff which will be produced for the project under developed conditions.

TABLE 2 –PHASE I DEVELOPED CONDITIONS		
Sub-Basin	Q₅CFS	Q₁₀₀ CFS
OS1	0.1	0.7
Os2	0.1	0.4
A1	2.5	5.2
A2	2.1	4.2
B	0.3	1.1
DP1	50.2	116.8
DP2 (OS1 + A1)	2.6	5.7
DP3 (OS2 + A2)	2.1	4.6
DP4 (DP2 + DP3)	4.7	10.2
DP5 (DP4 + B)	4.9	11.2
DP6(DP1+DP5)	52.4	122.0

WATER QUALITY

Water quality for the site will be achieved through a 1,400 cf sand filter basin (SFB) with a four-inch slotted underdrain tied into a "Type C" inlet with an 18" HDPE pipe outlet. This SFB will be privately owned and maintained by the property owner.

DETENTION

A Regional Detention Facility is proposed to be built upstream of the Rocky Mountain Industrial Park. This facility will be designed to account for the proposed flows within the proposed development within the industrial development according to the Hydrology Analysis section of the Final Drainage Report for the Rocky Mountain Industrial Park Filing No. 1 by Kiowa Engineering Corporation. No detention was proposed or exists within the existing subdivision, only Water Quality basins.

PRIVATE DRAINAGE FACILITIES

Item	Unit	Quantity	Unit Cost	Total Cost
18" HDPE FES	EA	1	\$400	\$ 400
18" HDPE	LF	15	\$40	\$ 600
Outlet Structure	EA	1	\$5,000	\$5,000

Emergency Spillway	EA	1	\$1,500	<u>\$1,500</u>
			Sub-Total	<u>\$7,500</u>
			15% Contingency & Engineering	<u>\$1,125</u>
			TOTAL	\$8,625

DRAINAGE BASIN FEES

The entire project was previously platted and lies within the Sand Creek Drainage Basin; therefore, no fees are due.

CONCLUSION

The proposed development and subsequent lot developments follow the "Four Step Process" as mandated by the EPA as follows:

Step 1: Runoff has been reduced by disconnecting impervious areas where possible, eliminating "unnecessary" impervious areas and encouraging infiltration into suitable soils.

Step 2: All drainageways, ditches and channels have been stabilized by the following methods:

- Tributaries have been left in their relatively natural state where possible.
- New drainageways and swales have been stabilized with either riprap or erosion control fabric depending on the erosion potential.
- No new roadside ditches are proposed for the development.

Step 3: The proposed development will disturb approximately 2.0 acres.

Step 4: The development of this project will not affect sensitive waters.



The development of this site will have little impact on downstream properties once the water quality is constructed.

REFERENCES

1. City of Colorado Springs and El Paso County (1994). *Drainage Criteria Manual Volume 1* (DCM).
2. City of Colorado Springs and El Paso County (1994). *Drainage Criteria Manual Volume II* (DCM).
3. Soil Survey of El Paso County Area, Colorado by USDA, NRCS.
4. *El Paso County (January 2006) Engineering Criteria Manual*.
5. Urban Drainage and Flood Control District (June 2011). *Urban Storm Drainage Criteria Manual, Volume 1-3*.
6. Rocky Mountain Industrial Park Filing No. 1 Final Drainage Plan by Kiowa Engineering Corporation, dated February 2002.
7. Rocky Mountain Industrial Park Filing No. 1A by Land Development Consultants, Inc., dated March, 2009.


APPENDIX A

MAPS

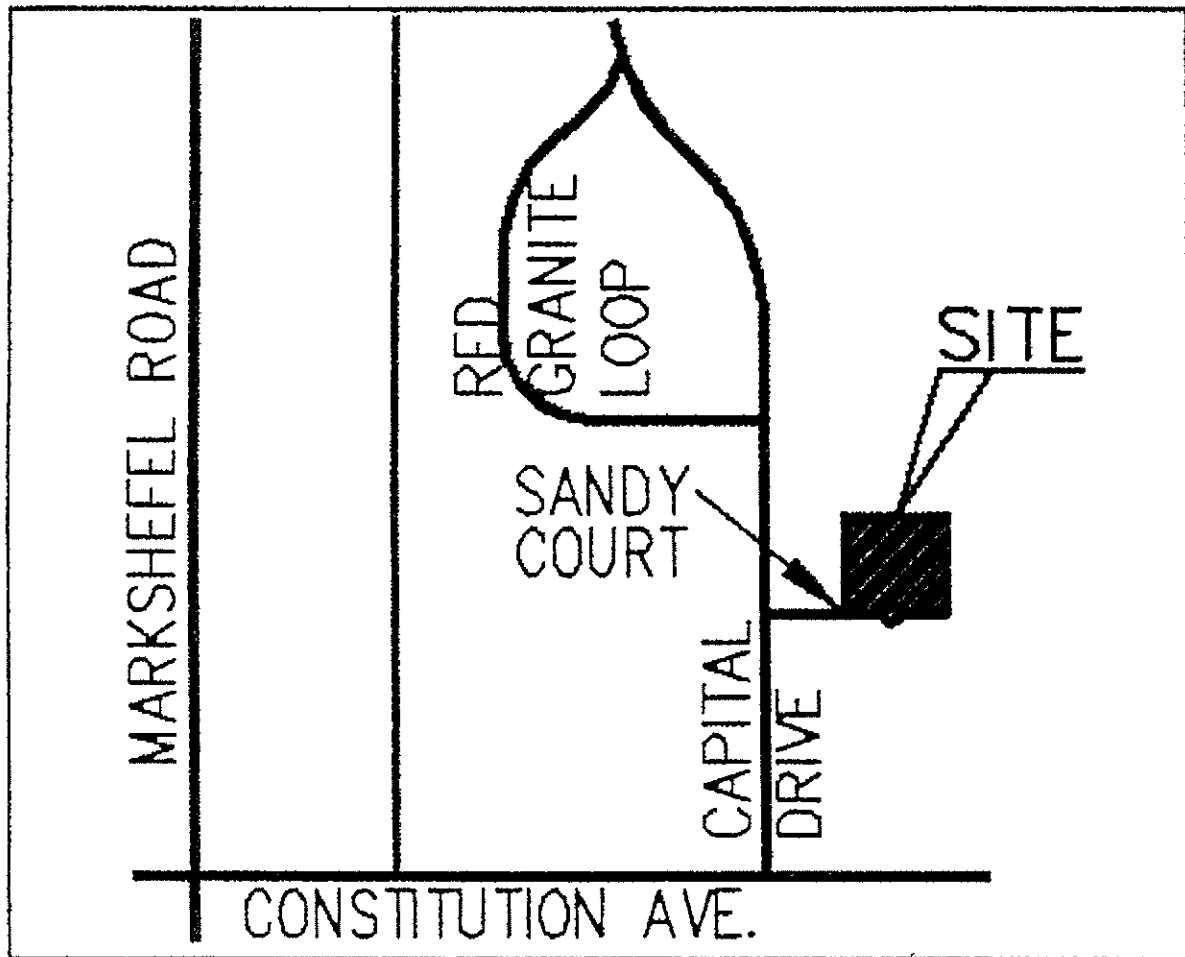

VICINITY MAP

N.T.S.

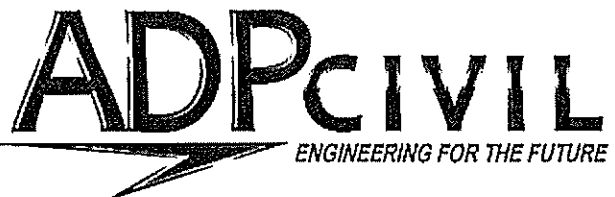

3520 Austin Bluffs Pkwy, Suite 102
Colorado Springs, CO 80918
(719) 266-5212
fax: (719) 266-5341



SOILS MAP

N.T.S.




3520 Austin Bluffs Pkwy, Suite 102
Colorado Springs, CO 80918
(719) 266-5212
fax: (719) 266-5341



APPROXIMATE SCALE IN FEET
500 0 500

JOINS PANEL 0543

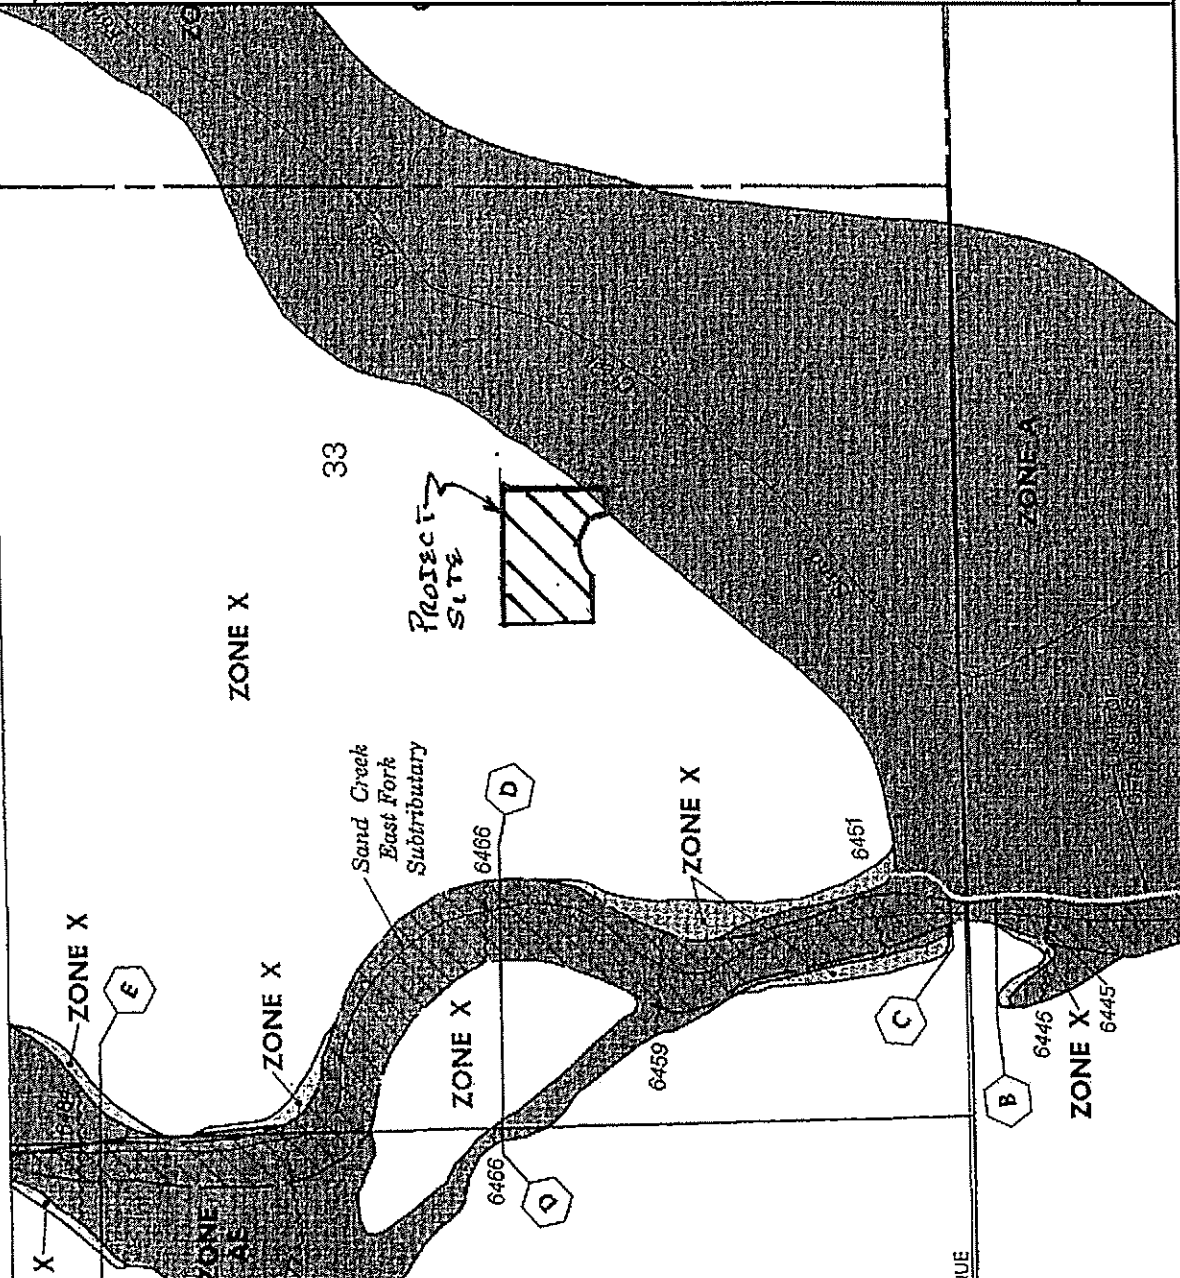

NATIONAL FLOOD INSURANCE PROGRAM

FIRM FLOOD INSURANCE RATE MAP EL PASO COUNTY, COLORADO AND INCORPORATED AREAS

PANEL 756 OF 1300
(SEE MAP INDEX FOR PANELS NOT PRINTED)

CONTAINS:	NUMBER	PANEL	SUFFIX
COLORADO SPRINGS, CITY OF	000000	0756	F
EL PASO COUNTY, COLORADO	000000	0756	F
INCORPORATED AREAS	000000	0756	F

MAP NUMBER
08041C0756 F

EFFECTIVE DATE:
MARCH 17, 1997




Federal Emergency Management Agency


This is an official copy of a portion of the above referenced flood map. It was extracted using F-MIR On-Line. This map does not reflect changes or amendments which may have been made subsequent to the date on the title block. For the latest product information about National Flood Insurance Program flood maps check the FEMA Flood Map Store at www.msc.fema.gov

APPENDIX B

DESIGN CALCULATIONS

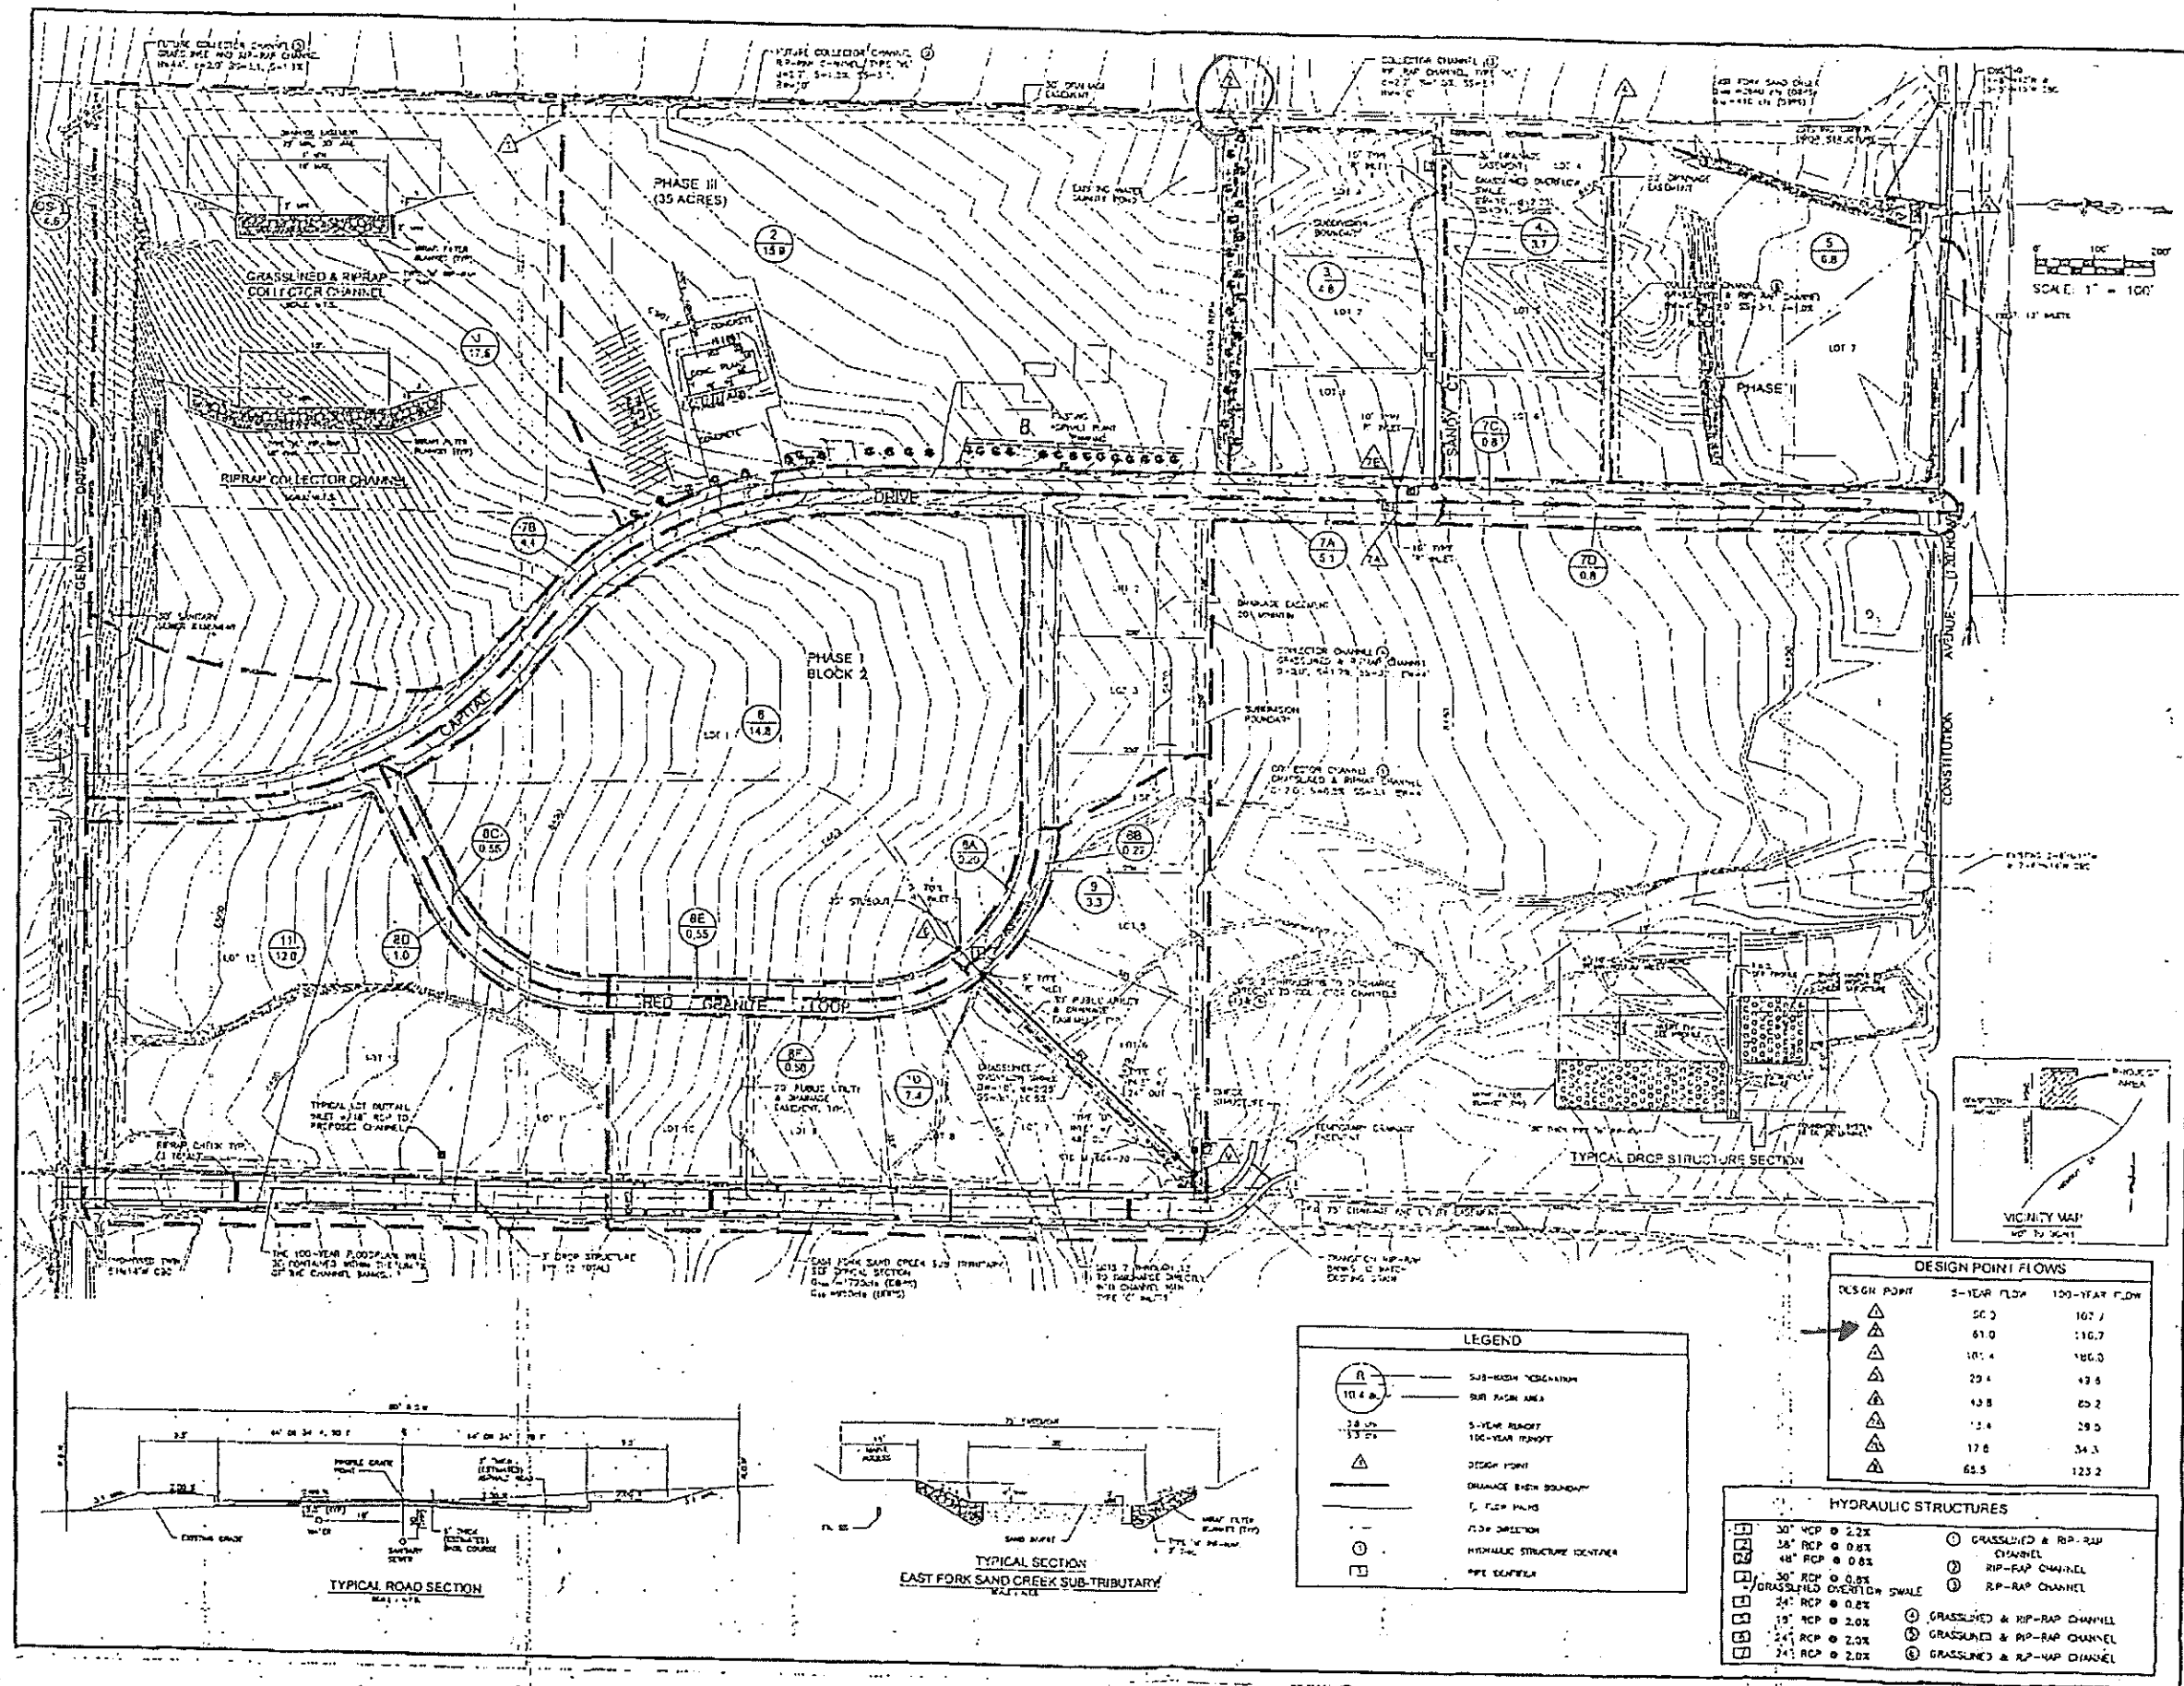

SCALE: 1" = 100'



LEGEND

- 10.4 ft. 3.8 ft. 13.3 ft.
- 3.8 ft. 13.3 ft.
- DESIGN POINT
- DRAINAGE BATH BOUNDARY
- 5.0% FLOOD
- 1.0% FLOOD
- HYDRAULIC STRUCTURE IDENTIFIER
- PIPE DRAINAGE

DESIGN POINT FLOWS

DESIGN POINT	5-YEAR FLOW	100-YEAR FLOW
10.4 ft.	50.3	107.1
13.3 ft.	61.0	116.7
13.3 ft.	101.4	180.0
13.3 ft.	23.4	43.6
13.3 ft.	43.8	80.2
13.3 ft.	12.4	28.0
13.3 ft.	17.8	34.3
13.3 ft.	62.5	123.2

HYDRAULIC STRUCTURES	
30" RCP @ 2.2%	① GRASSLINED & R.P.-RAP CHANNEL
36" RCP @ 0.8%	② R.P.-RAP CHANNEL
48" RCP @ 0.8%	③ R.P.-RAP CHANNEL
30" RCP @ 0.8%	
GRASSLINED OVERFLOW SWALE	
24" RCP @ 0.8%	
18" RCP @ 2.0%	④ GRASSLINED & R.P.-RAP CHANNEL
24" RCP @ 2.0%	⑤ GRASSLINED & R.P.-RAP CHANNEL
24" RCP @ 2.0%	⑥ GRASSLINED & R.P.-RAP CHANNEL

Design Procedure Form: Sand Filter (SF)

UD-BMP (Version 3.06, November 2016)

Sheet 1 of 2

Designer: Michael A Bartusek
 Company: Associated Design Professionals
 Date: March 27, 2018
 Project: Jackson Office/Warehouse Storage Buildings Development
 Location: Rocky Mountain Industrial Park Fil 1A Lot 2

1. Basin Storage Volume

- A) Effective Imperviousness of Tributary Area, I_a
 (100% if all paved and roofed areas upstream of sand filter)
- B) Tributary Area's Imperviousness Ratio ($i = I_a/100$)
- C) Water Quality Capture Volume (WQCV) Based on 12-hour Drain Time
 $WQCV = 0.8 * (0.91 * i^3 - 1.19 * i^2 + 0.78 * i)$
- D) Contributing Watershed Area (including sand filter area)
- E) Water Quality Capture Volume (WQCV) Design Volume
 $V_{WQCV} = WQCV / 12 * \text{Area}$
- F) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm
- G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume
- H) User Input of Water Quality Capture Volume (WQCV) Design Volume
 (Only if a different WQCV Design Volume is desired)

$I_a = 63.0 \%$

$i = 0.630$

$WQCV = 0.20$ watershed inches

Area = 91,475 sq ft

$V_{WQCV} = 1,504$ cu ft

$d_e = 0.40$ in

$V_{WQCV \text{ OTHER}} = 1,399$ cu ft

$V_{WQCV \text{ USER}} = 1,400$ cu ft

2. Basin Geometry

- A) WQCV Depth
- B) Sand Filter Side Slopes (Horizontal distance per unit vertical, 4:1 or flatter preferred). Use "0" if sand filter has vertical walls.
- C) Minimum Filter Area (Flat Surface Area)
- D) Actual Filter Area
- E) Volume Provided

$D_{WQCV} = 1.4$ ft

$Z = 4.00$ ft / ft

$A_{Min} = 720$ sq ft

$A_{Actual} = 792$ sq ft

$V_T = 1400$ cu ft

3. Filter Material

- Choose One
- ☒ 18" CDOT Class B or C Filter Material
- ☐ Other (Explain):

4. Underdrain System

- A) Are underdrains provided?
- B) Underdrain system orifice diameter for 12 hour drain time
- i) Distance From Lowest Elevation of the Storage Volume to the Center of the Orifice
- ii) Volume to Drain in 12 Hours
- iii) Orifice Diameter, 3/8" Minimum

- Choose One
- ☒ YES
- ☐ NO

$y = 1.8$ ft

$Vol_{12} = 1,400$ cu ft

$D_o = 7/8$ in

Design Procedure Form: Sand Filter (SF)

Sheet 2 of 2

Designer: Michael A Bartusek
 Company: Associated Design Professionals
 Date: March 27, 2018
 Project: Jackson Office/Warehouse Storage Buildings Development
 Location: Rocky Mountain Industrial Park Fil 1A Lot 2

5. Impermeable Geomembrane Liner and Geotextile Separator Fabric

A) Is an impermeable liner provided due to proximity of structures or groundwater contamination?

Choose One _____
☐ YES ☒ NO

6-7. Inlet / Outlet Works

A) Describe the type of energy dissipation at inlet points and means of conveying flows in excess of the WQCV through the outlet

Riprap rundowns into basin with riprap emergency spillway.
 Type C inlet w/18" HDPE pie outlet structure.

Notes: _____

APPENDIX C

DESIGN CHARTS

Table 6-6. Runoff Coefficients for Rational Method
(Source: UDFCD 2001)

Land Use or Surface Characteristics	Percent Impervious	Runoff Coefficients											
		2-year		5-year		10-year		25-year		50-year		100-year	
		HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D
Business													
Commercial Areas	95	0.79	0.80	0.81	0.82	0.83	0.84	0.85	0.87	0.87	0.88	0.88	0.89
Neighborhood Areas	70	0.45	0.49	0.49	0.53	0.53	0.57	0.58	0.62	0.60	0.65	0.62	0.68
Residential													
1/8 Acre or less	65	0.41	0.45	0.45	0.49	0.49	0.54	0.54	0.59	0.57	0.62	0.59	0.65
1/4 Acre	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
1/3 Acre	30	0.18	0.22	0.25	0.30	0.32	0.38	0.39	0.47	0.43	0.52	0.47	0.57
1/2 Acre	25	0.15	0.20	0.22	0.28	0.30	0.36	0.37	0.46	0.41	0.51	0.46	0.56
1 Acre	20	0.12	0.17	0.20	0.26	0.27	0.34	0.35	0.44	0.40	0.50	0.44	0.55
Industrial													
Light Areas	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Heavy Areas	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Parks and Cemeteries													
Parks and Cemeteries	7	0.05	0.09	0.12	0.19	0.20	0.29	0.30	0.40	0.34	0.46	0.39	0.52
Playgrounds	13	0.07	0.13	0.16	0.23	0.24	0.31	0.32	0.42	0.37	0.48	0.41	0.54
Railroad Yard Areas	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
Undeveloped Areas													
Historic Flow Analysis-- Greenbelts, Agriculture	2	0.03	0.05	0.03	0.16	0.17	0.26	0.26	0.38	0.31	0.45	0.36	0.51
Pasture/Meadow	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Forest	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Exposed Rock	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Offsite Flow Analysis (when landuse is undefined)	45	0.26	0.31	0.32	0.37	0.38	0.44	0.44	0.51	0.48	0.55	0.51	0.59
Streets													
Paved	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Gravel	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Drive and Walks													
Drive and Walks	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Roofs													
Roofs	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Lawns													
Lawns	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50

Figure 6-25. Estimate of Average Concentrated Shallow Flow


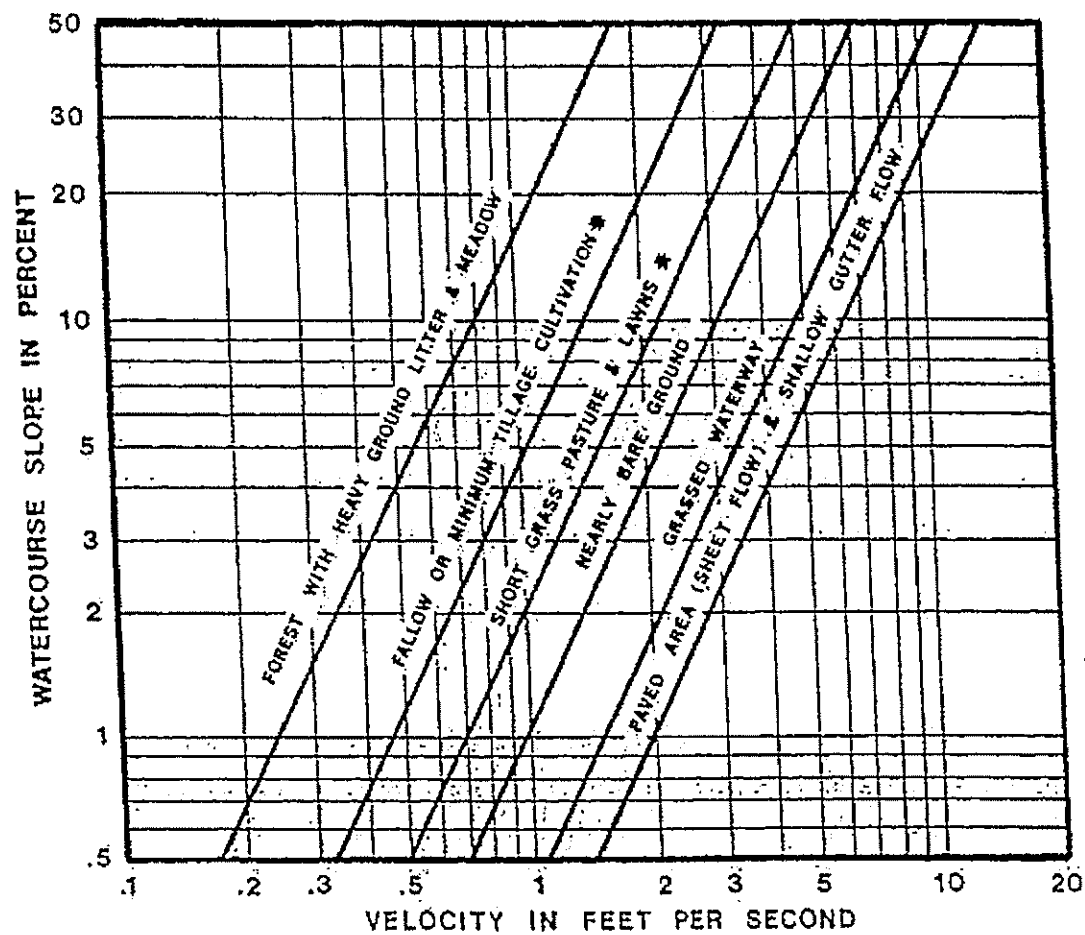


Figure 6-5. Colorado Springs Rainfall Intensity Duration Frequency

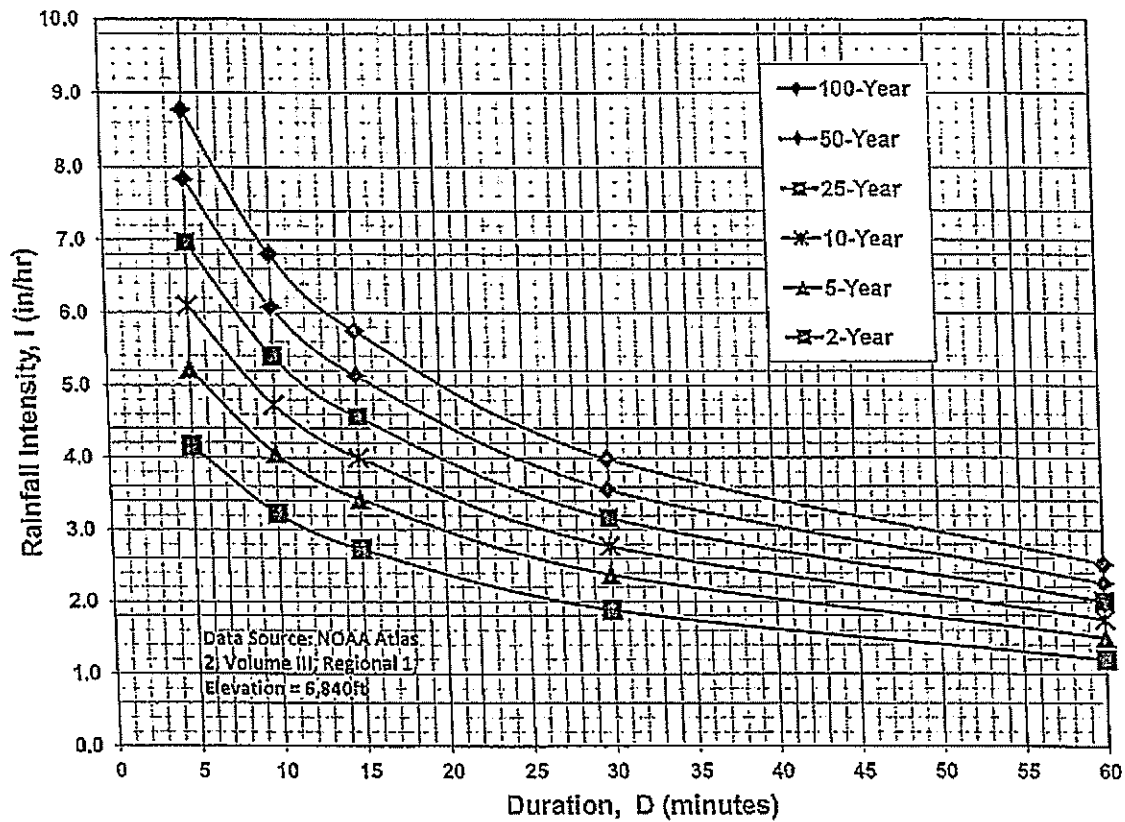

IDF Equations

$$I_{100} = -2.52 \ln(D) + 12.735$$

$$I_{50} = -2.25 \ln(D) + 11.375$$


$$I_{25} = -2.00 \ln(D) + 10.111$$

$$I_{10} = -1.75 \ln(D) + 8.847$$



$$I_5 = -1.50 \ln(D) + 7.583$$

$$I_2 = -1.19 \ln(D) + 6.035$$


Note: Values calculated by equations may not precisely duplicate values read from figure.

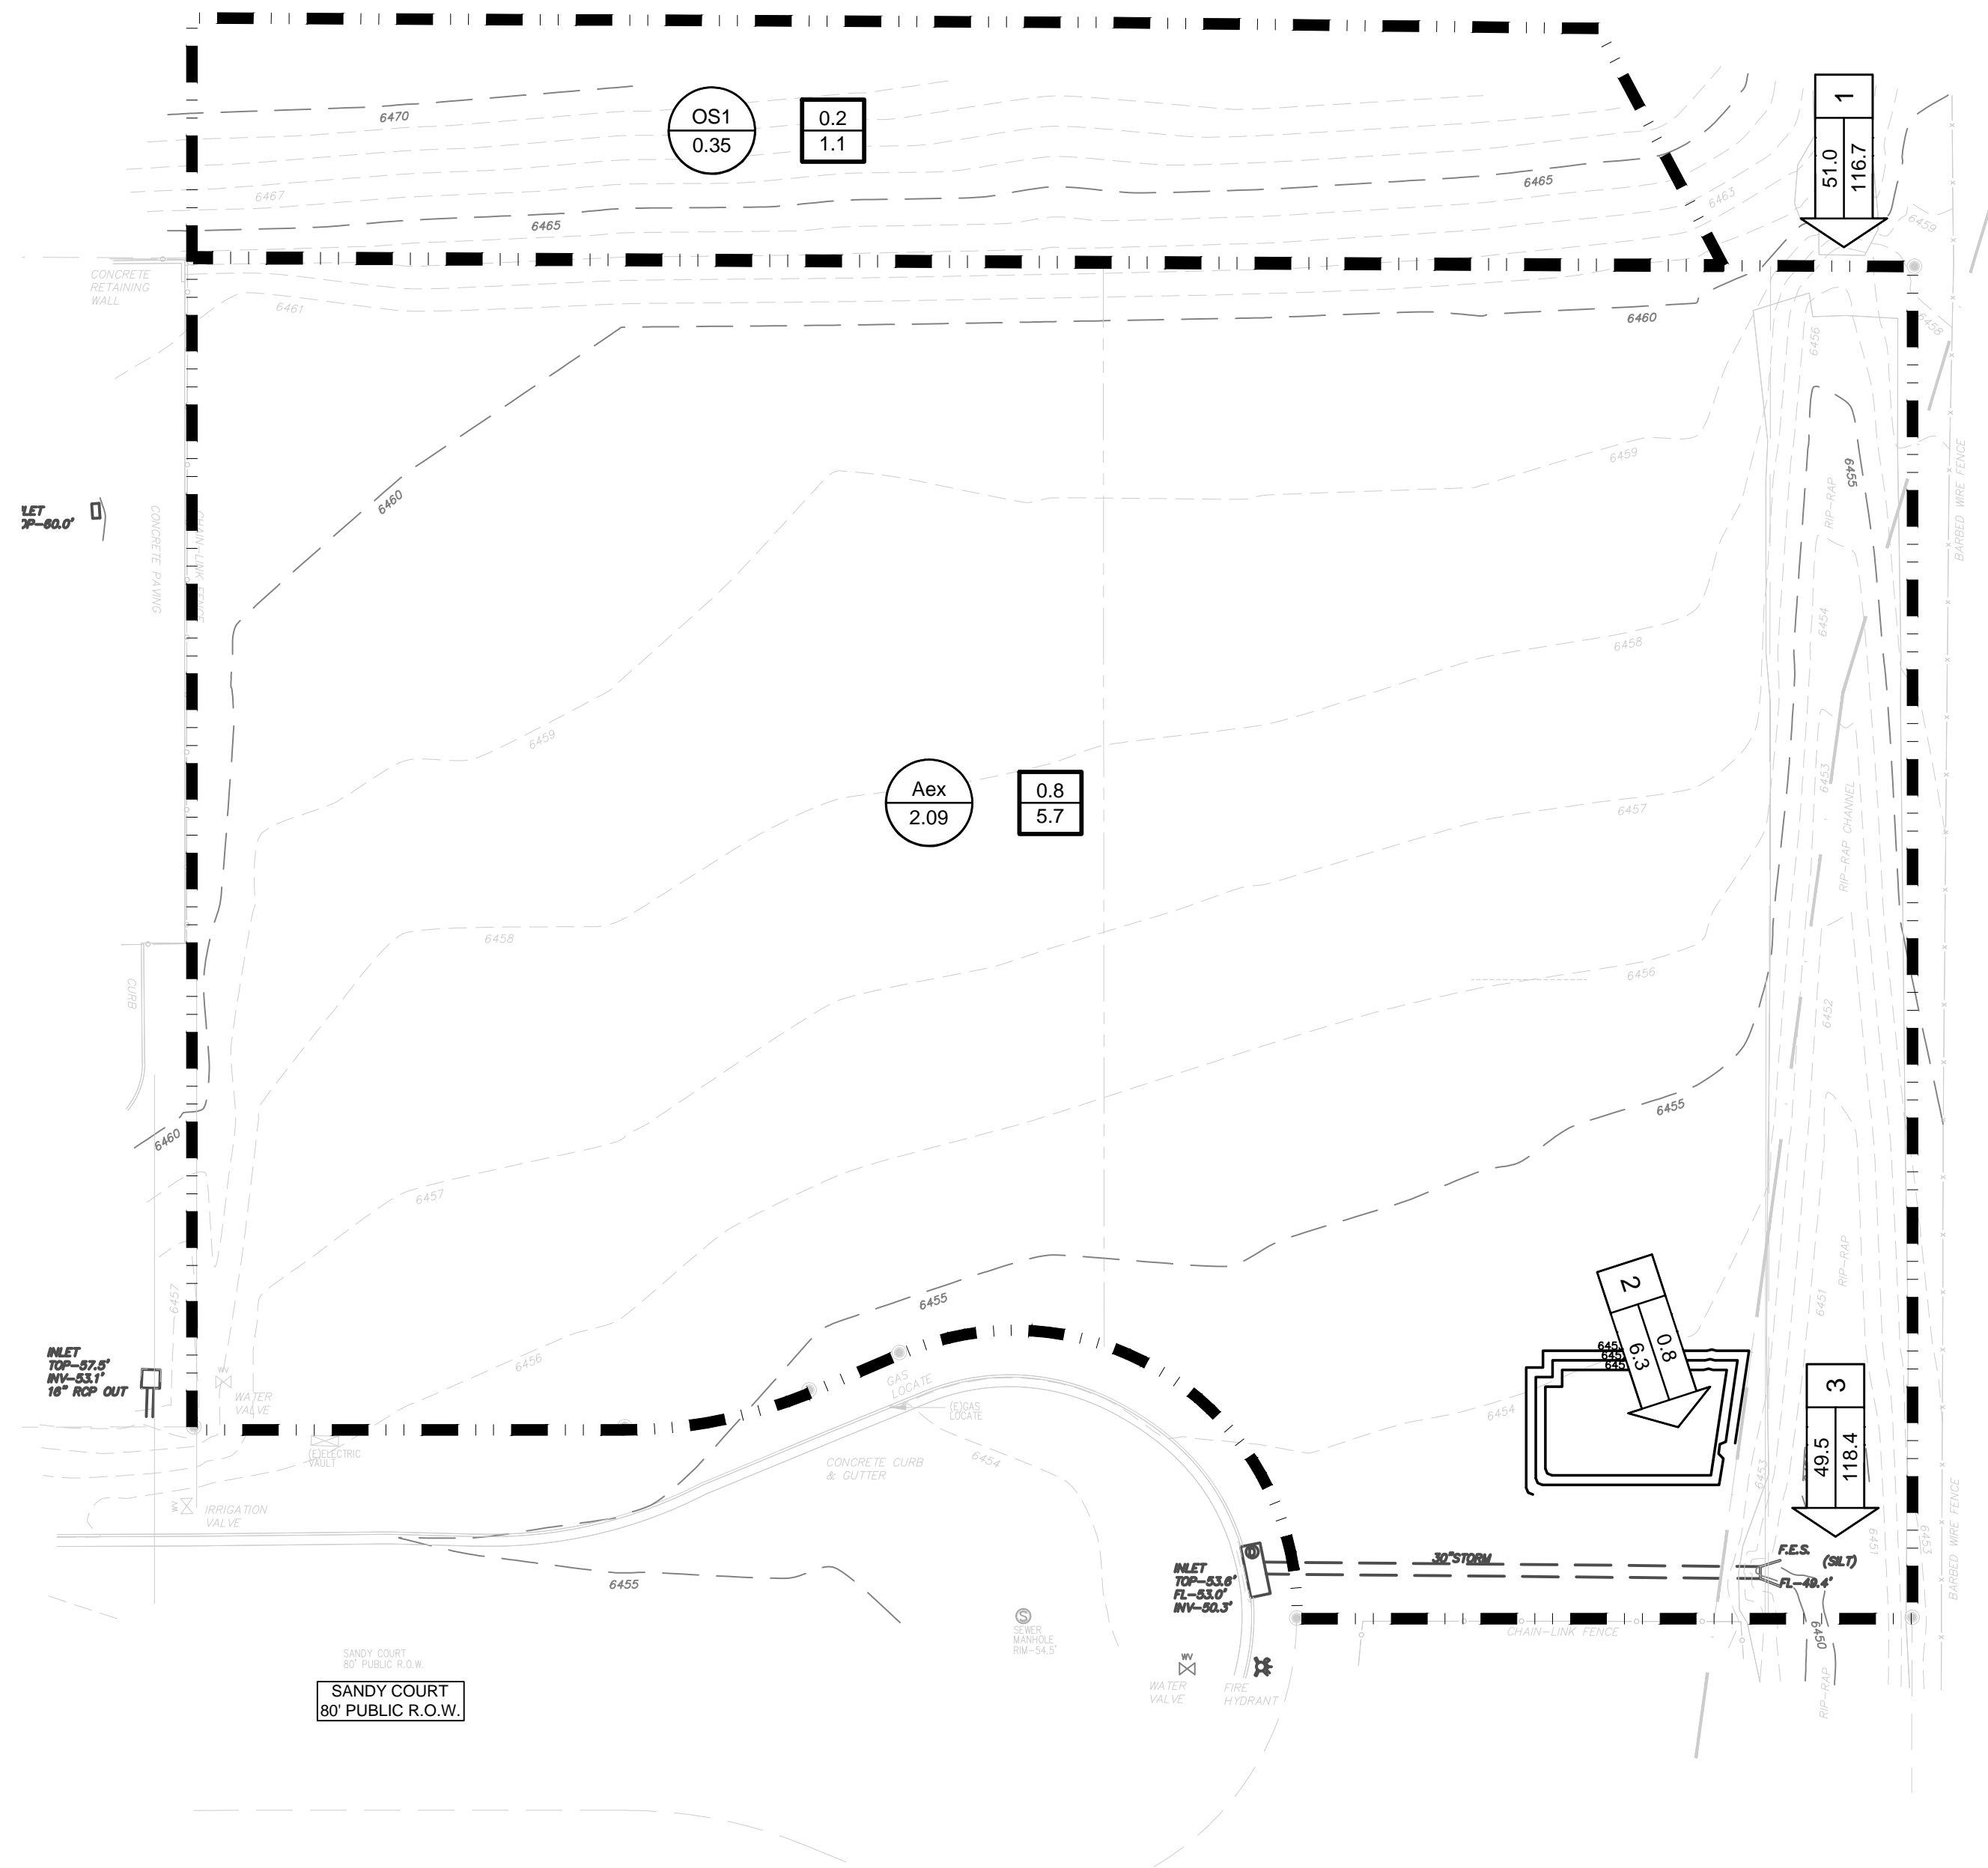


EXISTING CONDITIONS

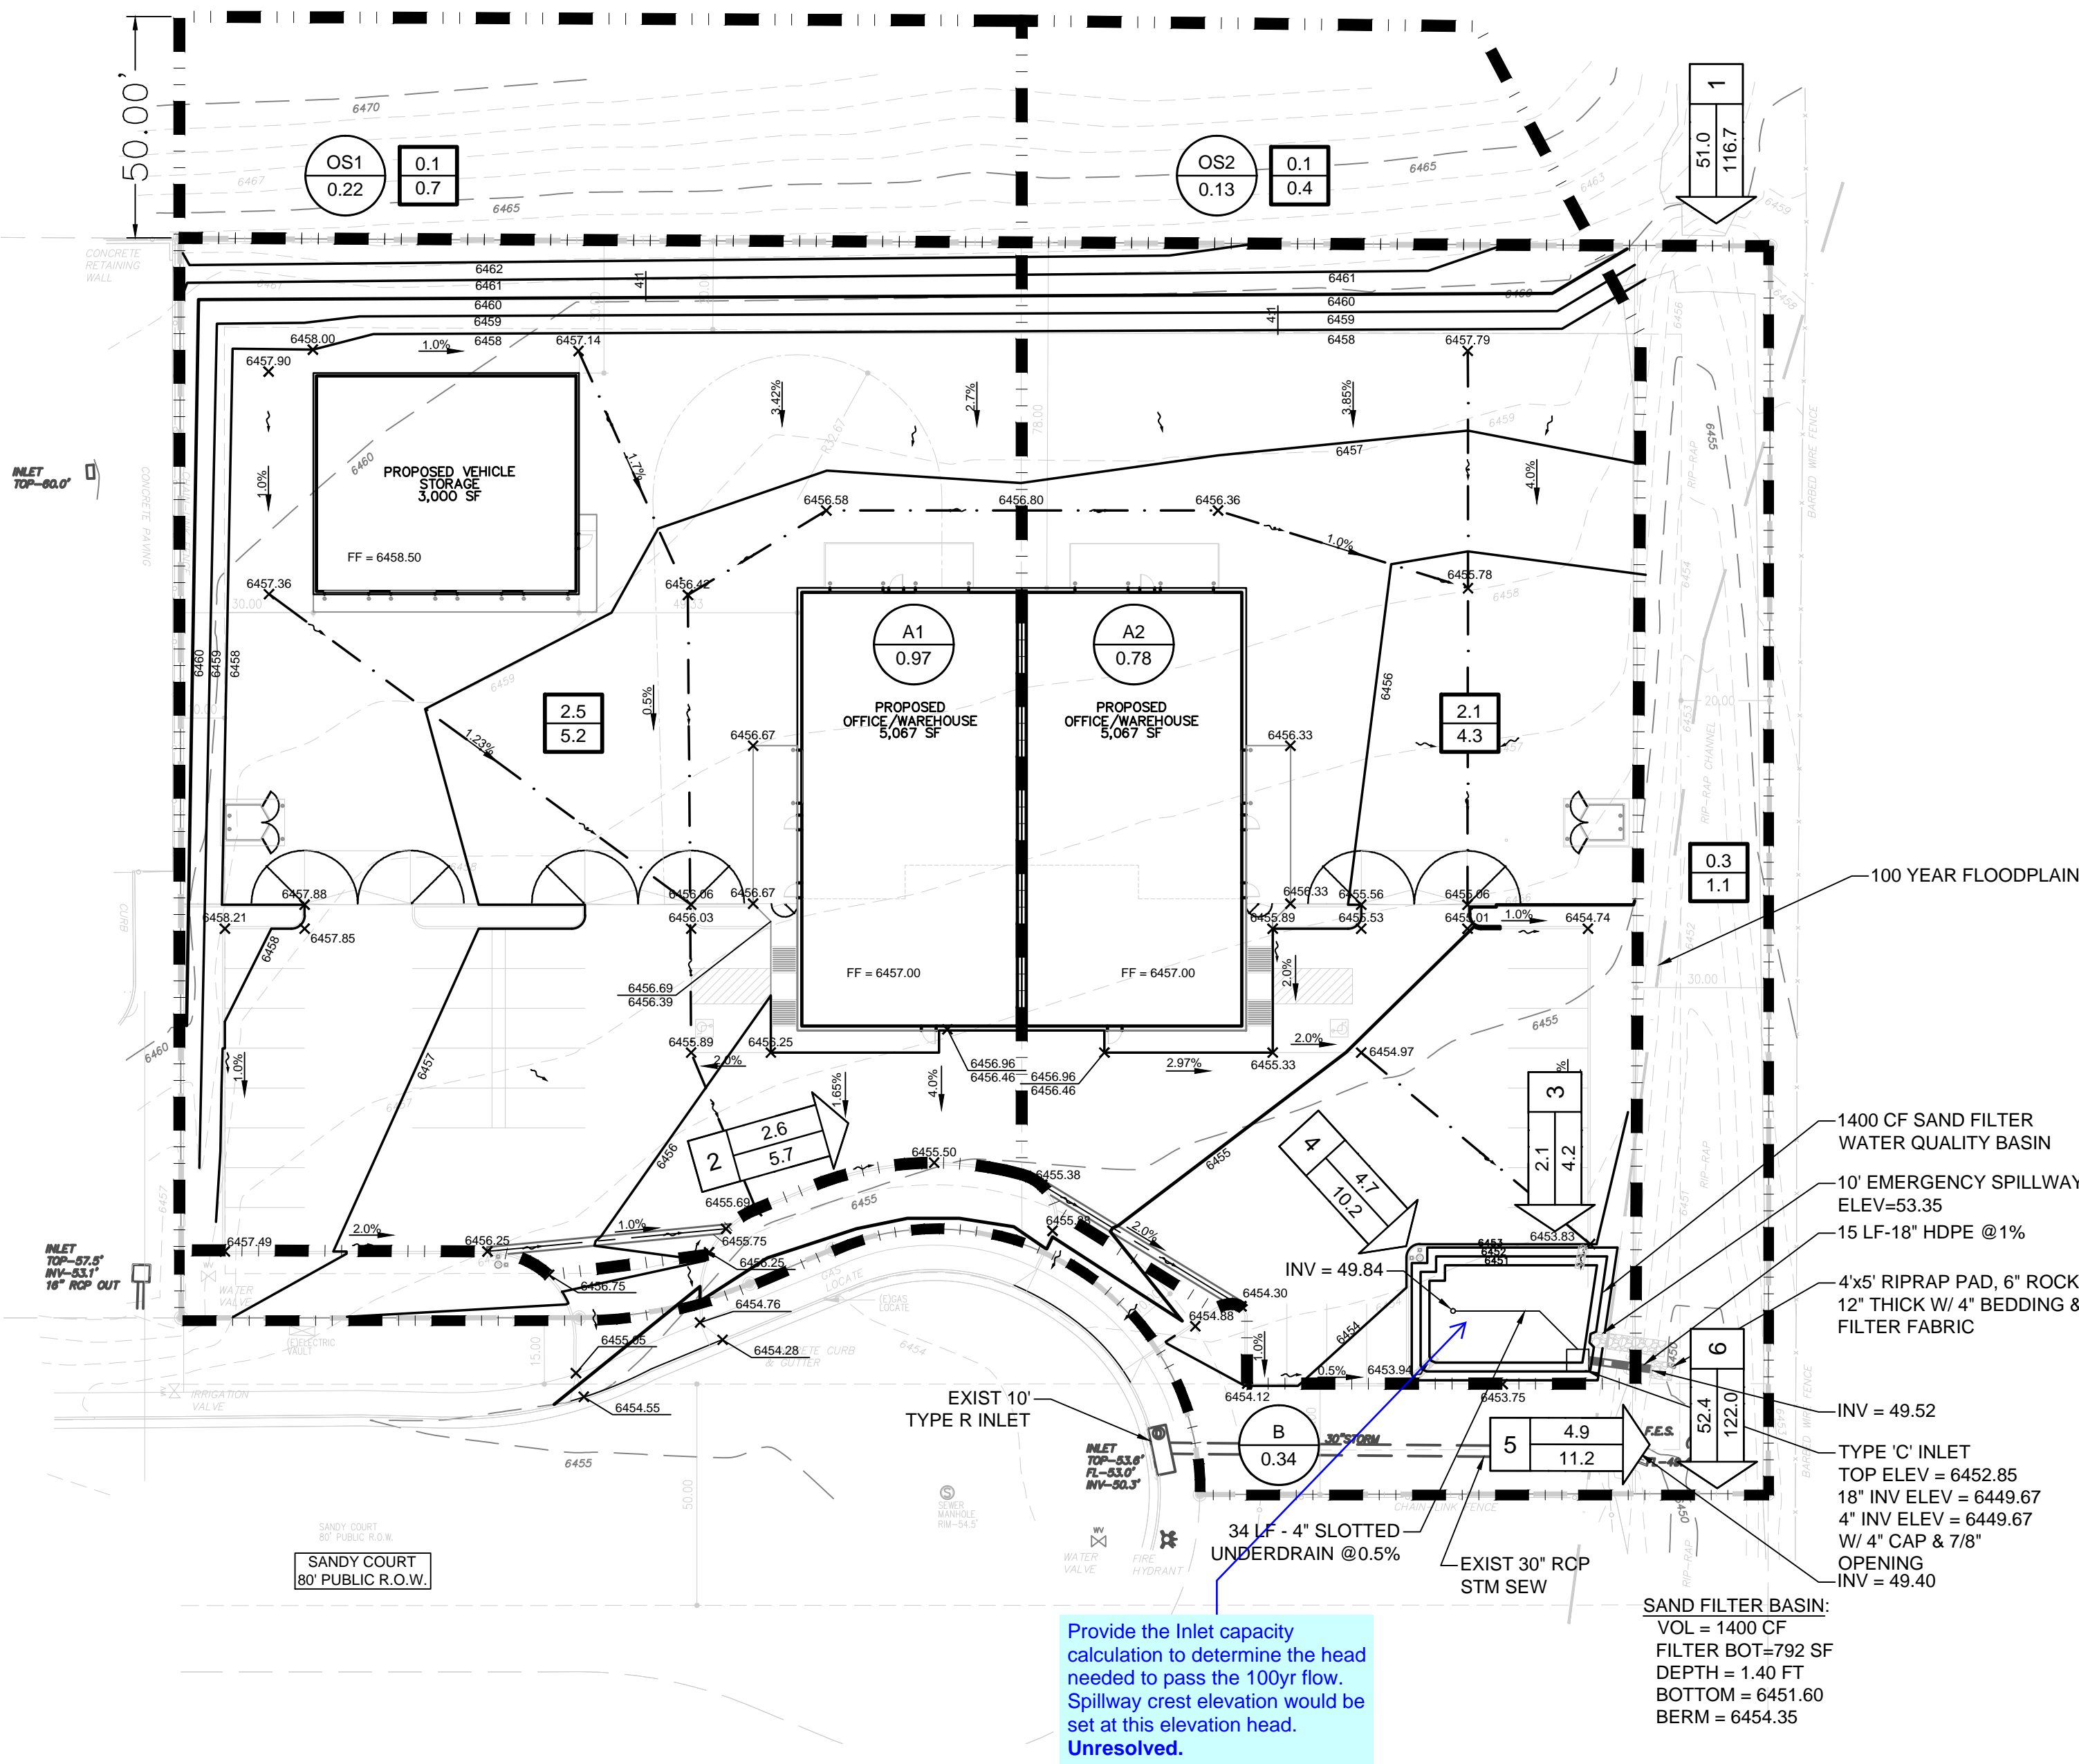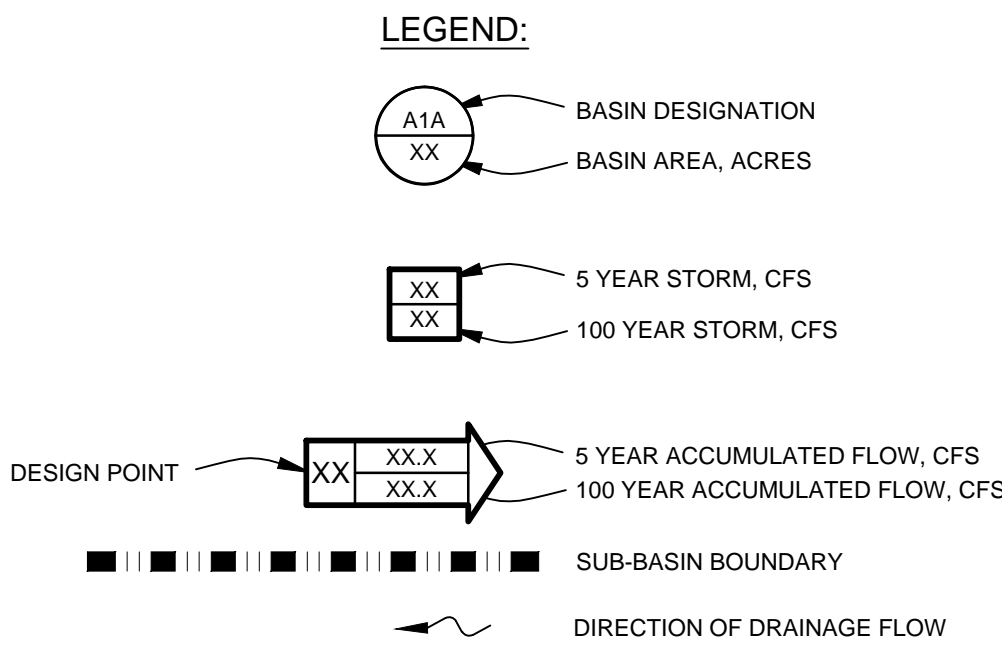

PROPOSED CONDITIONS

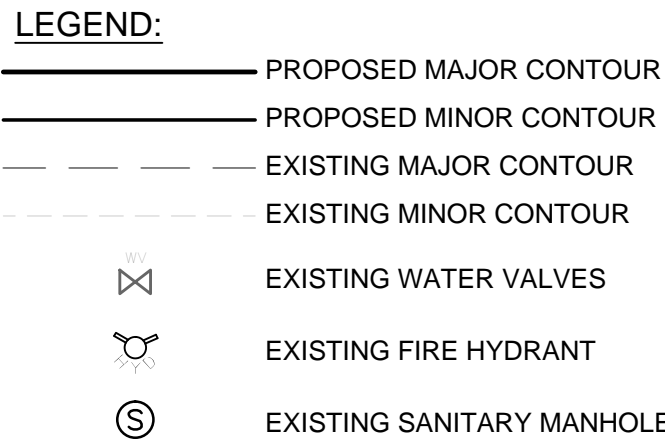

BENCHMARK:
CP#
N
E
ELEV

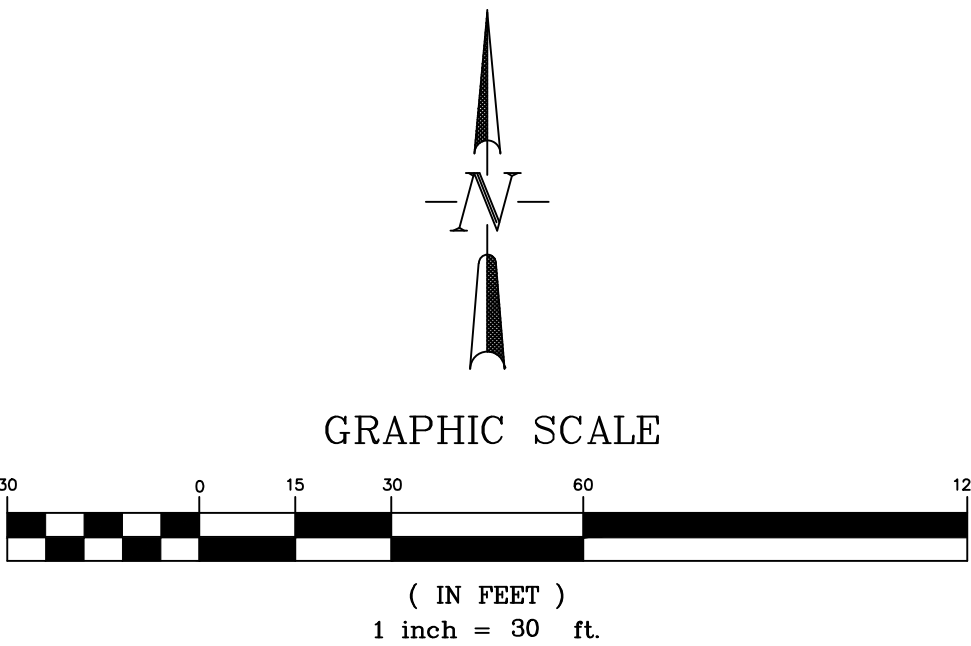

DESIGNED BY
MAB
PROJECT ENGINEER
MAB
PROJECT MANAGER
MAB
CAD FILE NO.
170802
DRAWN BY
HUG

DATE:
10/06/17
JOB NO.
170802
SCALE: 1" = 30'
VERT. XX" = XX'

PREPARED BY:


ADPcivIL
ENGINEERING FOR THE FUTURE
3520 Austin Bluffs Parkway
Suite 102
Colorado Springs, CO 80918
(719) 266-5212
fax: (719) 266-5341

NO.	DATE	REVISION	BY

JACKSON OFFICE WAREHOUSE & STORAGE BLDGS
8140 SANDY COURT
EL PASO COUNTY, COLORADO
EXIST & DEVELOPED DRAINAGE PLAN

Markup Summary

dsdlaforce (1)



Subject: Callout
Page Label: 21
Lock: Locked
Status:
Checkmark: Unchecked
Author: dsdlaforce
Date: 5/1/2018 9:30:12 AM
Color:
Layer:
Space:

Provide the Inlet capacity calculation to determine the head needed to pass the 100yr flow. Spillway crest elevation would be set at this elevation head. Unresolved.