

Client: Dave Gish  
 Widefield School District 3  
 1820 Main Street  
 Colorado Springs, CO 80911

## Webster Elementary School Addition & Alterations

Report Date: Apr 28, 2023  
 Work Order Date: Mar 31, 2023

Work Order No.: 22-8500.Concrete.0050; ver: 3  
 Reviewed by: Daniel Crea

### Concrete

Concrete Contractor: Araco  
 Placement Method: Tailgated  
 Total Quantity Placed: 7.25 yd<sup>3</sup>  
 Placement Location: Trickle Channel—Location 1 Attached  
 Comments: No mix design provided. Air and slump specifications provided by Steve Buellesbach with Nunn Construction. Air 5-8%, Slump 2.5-5".

Performed by: Nick Davidson  
 Finish Method: Hand Finished  
 Weather: Calm|Partly Cloudy|Sunny

### On-site Notifications, Specification, and Mix Information

On-Site Notification(s)	Item / Structure Type	Test	Specified	Mix Design
Steve Buellesbach with Nunn Construction	General Concrete	Air Content (%)	-	-
		Slump (in)	-	-
	Mix Placed	Unit Weight (pcf)	-	-
	Holcim LLC T34592110	Comp. Strength (psi)	-	-

### Sampling (ASTM C172 / AASHTO R60 / CDOT CP61)

Sample No.	Location	Sampled From	Quantity (yd <sup>3</sup> )	Truck No.	Ticket No.	Batch Time	Test Time	Air Temp. (°F)	Water Added (gal)
49	Trickle Channel—Location 1 Attached	Point of Delivery	7.25	49	86603034	8:35 AM	9:45 AM	40	0

### Field Tests (ASTM C138, C143, C231, and C1064 / AASHTO T119, T121, and T152)

Sample No.	Concrete Temp. (°F)	Slump (in)	Air Cont. (%)	Meas. Vol. (ft <sup>3</sup> )	Empty Meas. (lb)	Full Meas. (lb)	Unit Wt. (pcf)	Lab Samples Cast
49	65	4	5.6	.250	7.93	42.82	139.6	Yes

### Compressive Strength (ASTM C31 and C39 / AASHTO T22 and T23)

Sample No.	Lab ID	Age (d)	Diameter (in)	Area (in <sup>2</sup> )	Fracture Type	Max. Load (lb-f)	Corrected Strength (psi)	Strength at Acceptance (psi)
49	C4863	7	4.00	12.57	5 / Side	51,040	4,060	-
	C4864	28	4.00	12.57	5 / Side	59,300	4,720	4,720
	C4865	28	4.00	12.57	5 / Side	60,850	4,840	4,840
	C4866	28	4.00	12.57	5 / Side	62,680	4,990	4,990
<b>Average Compressive Strength (psi):</b>								<b>4,850</b>

Results apply only to the specific items and locations referenced and at the time of testing, observations or special inspections. Unless noted otherwise, specimens were received in adequate condition. Compressive strength specimens, if tested, were capped in accordance with ASTM C1231 or ASTM C617, as applicable. This report should not be reproduced, except in full, without the written permission of GROUND Engineering Consultants, Inc.

## Webster Elementary School Addition & Alterations

Report Date: Apr 28, 2023


Work Order No.: 22-8500.Concrete.0050; ver: 3

Work Order Date: Mar 31, 2023

Reviewed by: Daniel Crea

### Concrete

#### Photos

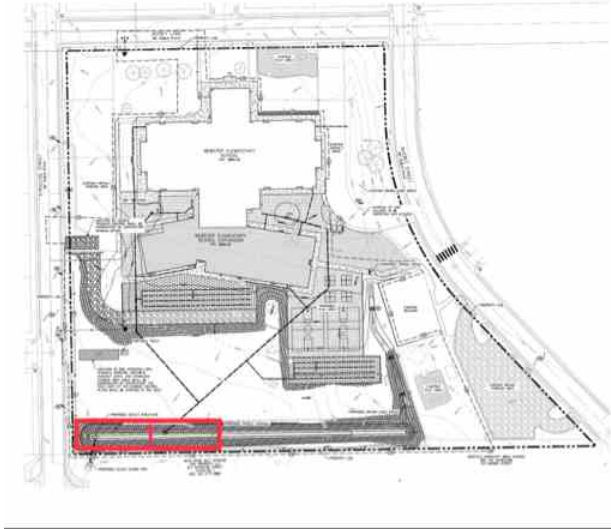

Location 1 Attached



Placement Location

Results apply only to the specific items and locations referenced and at the time of testing, observations or special inspections. Unless noted otherwise, specimens were received in adequate condition. Compressive strength specimens, if tested, were capped in accordance with ASTM C1231 or ASTM C617, as applicable. This report should not be reproduced, except in full, without the written permission of GROUND Engineering Consultants, Inc.