



MVE, INC.
ENGINEERS SURVEYORS

1903 kalaray street, suite 200
colorado springs, co 80909
719.635.5736

Final Drainage Report

Monument Small Engine Storage

Project No. 61092

Revised: January 20, 2020

PCD File No. PPR1946

Final Drainage Report

for

Monument Small Engine Storage

Project No. 61092

Revised: January 20, 2020

prepared for

David P. Hellbusch

137 N. Monument Lake Road

Monument, CO 80132

719.448.3230

prepared by

MVE, Inc.

1903 Lelaray Street, Suite 200

Colorado Springs, CO 80909

719.635.5736

Copyright © MVE, Inc., 2018

61092-Monument Small Engine-FDR-Revised 2019.odt

Statements and Acknowledgments

Engineer's Statement

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the applicable master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions of my staff in preparing this report.




David R. Gorman, P.E.
For and on Behalf of M&E, Inc. Colorado No. 31672

2/21/20
Date

Developer's Statement

I, the owner/developer have read and will comply with all of the requirements specified in this drainage report and plan.


David P. Hellbusch
Owner
137 N. Monument Lake Rd
Monument, CO 80132

2-26-20
Date

El Paso County

Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 and 2, El Paso County Engineering Criteria Manual and Land Development Code as amended.

Jennifer Irvine, P.E.,
County Engineer / ECM Administrator

Date

Contents

Statements and Acknowledgments.....	iii
Contents.....	v
Final Drainage Report.....	1
1 General Location and Description.....	1
1.1 Location.....	1
1.2 Description of Property.....	1
2 Drainage Basins and Sub-Basins.....	2
2.1 Major Basin Descriptions.....	2
2.2 Other Drainage Reports.....	3
2.3 Sub-Basin Description.....	3
3 Drainage Design Criteria.....	3
3.1 Development Criteria Reference.....	3
3.2 Hydrologic Criteria.....	4
4 Drainage Facility Design.....	4
4.1 General Concept.....	4
4.2 Specific Details.....	4
4.3 Erosion Control.....	7
4.4 Water Quality Enhancement Best Management Practices.....	7
5 Opinion of Probable Cost for Drainage Facilities.....	8
6 Drainage and Bridge Fees.....	8
7 Conclusion.....	8

References.....	9
Appendices.....	11
8 General Maps and Supporting Data.....	11
9 Hydrologic Calculations.....	12
10 Hydraulic Calculations.....	33
11 Report Maps.....	41

Final Drainage Report

The purpose of this Final Drainage Report is to identify drainage patterns and quantities within and affecting the proposed Monument Small Engine Storage site. This land use application is an amendment to a prior site development plan approved August 23, 2018 by El Paso County Planning and Community Development. This revised amended drainage report is in support of a site plan approval for the 2018 rezone application to allow outdoor RV storage on the property. The report will “identify specific solutions to problems on-site and off-site resulting from the proposed project. The report and included maps present results of hydrologic and drainage facilities analyses. The report will discuss the recommended drainage improvements to the site and identify drainage requirements relative to the proposed project. This report has been prepared and submitted in accordance with the requirements of the El Paso County development approval process. An Appendix is included with this report with pertinent calculations and graphs used in the drainage analyses and design.

1 General Location and Description

1.1 Location

The proposed Monument Small Engine Storage site is located within the southwest one-quarter of the northeast one-quarter of Section 15, Township 11 South, Range 67 west of the 6th principal meridian in El Paso County, Colorado. The 3.89± acre site is situated north of the intersection of Mitchell Avenue and Monument Lake Road. The site is generally west of the Denver & Rio Grand Railroad, north of Monument Lake Road at Mitchell Avenue. The site contains an existing business using the address of 137 N. Monument Lake Road. The El Paso County Assessor's Schedule Number for the site is 711510008. The proposed site has never been platted. A **Vicinity Map** is included in the **Appendix**.

The south edge of the site is adjacent to an unplatted parcel containing a single-family residence and zoned PRD (Planned Residential Development). This parcel is located in the Town of Monument and separates the site from Monument Lake Road (60' R.O.W.) which is located along the south edge of the parcel. Mount Herman RV Storage Subdivision, located along the east side of the site, is located within the Town of Monument, is zoned PID (Planned Industrial Development) and contains an RV storage business. Unplatted and undeveloped property, located within El Paso County and zoned RR-5 (Residential Rural), lies north of the site. Unplatted property zoned RR-5 and containing a single family residence is located adjacent to the east side of the site.

Crystal Creek, a tributary to Monument Creek, flows northeast to southwest through the adjacent property to north. The site is located in El Paso County's Crystal Creek Drainage Basin.

1.2 Description of Property

The Monument Small Engine Storage site 3.89± acres and is zoned CS (Commercial Service). The property is the location of a business with an existing shop, garage building, shed, gravel drives and parking areas, mostly concentrated at the southeast portion.

The site has been used for many years as an equipment and engine repair shop with an approved Variance of Use from El Paso County. A past use of the site has been as a plant and tree nursery with green house buildings, gravel drives and open space. Terraced railroad tie retaining walls are

located in the western portion of the site. A gravel parking area is located in the northeastern portion. A gravel access drive formerly ran through the site from north to south that is also used to serve the adjacent residence. The access easement has been vacated (Reception No. 219109534) and this gravel drive is no longer used to access the adjacent property. Ground cover in the non gravel areas is typically native grasses and weeds with sparse trees and shrubs scattered. The condition of the ground cover on the site varies from poor to good, depending on location within the site. Former drive areas are relatively bare, but the nursery areas are in good condition. Access to the site is via one point off of North Monument Lake Road from the south. Power poles and lines are also located near and through the site.

The site slopes generally from east to west with grades ranging from 1% to 6% with intermittent walls or short terraces. The lowest point on the site is the southwest corner. An existing stormwater quality pond exists on the adjacent property on the east which outfalls onto the site near the eastern boundary in the center. An existing 12" CMP culvert discharges from the pond into the site and the outflow is intercepted by a shallow ditch, which directs the flows to the northwest corner and then offsite. No significant drainageways flow through the site and no significant drainage improvements or drainage facilities currently exist on the site.

According to the National Resource Conservation Service, the soil in the area of the Monument Small Engine Storage site consists of Tomah-Crowfoot loamy sand (map unit 92). The soil is deep and well drained. Permeability is moderately rapid, surface runoff is slow, and the hazard of erosion is slight to moderate. Tomah-Crowfoot loamy sand is classified as being part of Hydrologic Soil Group B. A portion of the Soil Map and data tables from the National Cooperative Soil Survey and relevant Official Soil Series Descriptions (OSD) are included in the **Appendix**.^{1 2}

There are no major drainageways in the Monument Small Engine Storage site. However, Crystal Creek is located to the north of the site. Crystal Creek drains into Monument Reservoir and is tributary to Monument Creek.

The current Flood Insurance Study of the region includes Flood Insurance Rate Maps (FIRM), effective on December 7, 2018.³ The proposed subdivision is included in two Community Panels Numbered 08041C0276 G of the Flood Insurance Rate Maps for the El Paso County. No part of the site is shown to be included in a 100-year flood hazard area as determined by FEMA. A portion of the current FEMA Flood Insurance Rate Maps with the site delineated is included in the **Appendix**.

2 Drainage Basins and Sub-Basins

2.1 Major Basin Descriptions

The Monument Small Engine Storage site is located in the Crystal Creek Drainage Basin (FOFO5300) of the Fountain Creek Major Drainage Basin (FO). This basin drains to Monument Creek. The *Dirty Woman Creek and Crystal Creek Drainage Basin Planning Study* provides development recommendations and requirements for drainage development in the Crystal Creek Drainage Basin (DBPS).⁴ The Crystal Creek Drainage Basin encompasses a part of the northwest portion of the Town of Monument and extends to the north and east. The drainage basin and Crystal Creek drains southwest into Monument Creek. The Monument Small Engine Storage site is located east of Crystal Creek as it flows offsite towards Monument Creek. The site is located in sub-basin CC 185, upstream of Design Point 185 of the Drainage Basin Planning Study. The closest drainage improvements that the study recommends is offsite at the Monument Lake Road crossing of Crystal Creek. No other improvements are recommended on or near the project site. A copy of a portion of the "**Drainage Area Identification Study**"⁵ map, showing the site location within the Basin is included in the **Appendix**. The proposed Monument Small Engine Storage project is in conformance with the DBPS.

1 WSS
2 OSD
3 FIRM
4 DBPS
5 Drain. Area Ident. Study

2.2 Other Drainage Reports

The adjacent property in the east was studied as detailed in the report “Final Drainage Report, Mount Herman RV Storage Subdivision, Town of Monument Colorado” by M.V.E., Inc. dated January 30, 2014.⁶ The Mount Herman report establishes the offsite basin conditions to the east, including the existing storm water quality sand filter basin. The offsite basin and pond were re-evaluated in the report “Final Drainage Report, Monument Small Engine Storage” by M.V.E., Inc. dated June 15, 2018 using the current drainage criteria adopted by the County and those updated results are included in this revised Monument Small Engine Storage drainage report.

2.3 Sub-Basin Description

The existing drainage patterns of the Monument Small Engine Storage are described by two on-site drainage basins and one offsite basin. All of these basins are previously disturbed or developed to a degree as described below. All existing basin delineations and data are depicted on the attached **Existing Drainage Map**.

2.3.1 Existing Drainage Patterns (Off-Site)

Existing off site sub-basin OSA1 is located to the east of the site, containing the developed Lot 1 Mount Herman RV Storage Subdivision with existing RV storage area, pond area, landscape area and railroad right-of-way. The basin drains to the existing water quality pond and then into the site by way of an exiting 12” CMP pipe from the pond along with the pond spillway located on the property line. This flow enters the onsite basin A1 and continues through the site.

2.3.2 Existing Drainage Patterns (On-Site)

The site generally drains to the west, but contains a gravel drive and ditch that drains to towards the northwest corner of the site. The northeast portion of the site, combined with flows from off-site Basin OSA1 drain towards the northwest corner of the site. The remaining portion of the site drains west towards the site's western boundary.

Existing sub-basin A1 is located in the northeastern portion of the site and contains some gravel parking area and slope leading to the existing ditch and gravel drive. The existing 12” CMP from offsite Basin OSA1 outfalls into Basin A1. All flows from Basin A1 exit the site at the southwest corner into the adjacent site to the west, which is also owned by the owner of the adjacent property to the east. These flows continue west through the adjacent properties to Crystal Creek.

Existing sub-basin A2 is also located in the northeastern portion of the site, just south of sub-basin A1. The sub-basin contains gravel drive, leach field area, and pasture/meadow. All flows from sub-basin A2 exit the site at the west property line. The western adjacent property is owned by the owner of the adjacent property to the east. These flows continue west through the adjacent property and into Crystal Creek.

Existing sub-basin B1 is located on the southerly and westerly portion of the site, containing the existing shop, garage, and shed buildings, paved parking and walk areas, gravel drive and parking areas and open meadow areas with tiered railroad tie walls. The previously existing greenhouse buildings in this basin have been removed. The flows generated by this basin drain to the west and exit the site by sheet flow into the adjacent site to the west. These flows continue west through the adjacent properties to Crystal Creek. All flows from the site eventually enter Monument Reservoir and then Monument Creek.

3 Drainage Design Criteria

3.1 Development Criteria Reference

This Final Drainage Report for Monument Small Engine Storage has been prepared according to the report guidelines presented in the latest edition of *El Paso County Drainage Criteria Manual* (DCM)⁷.

⁶ Mount Herman FDR

⁷ DCM Section 4.3 and Section 4.4

The County has also adopted portions of the City of Colorado Springs Drainage Criteria Manual Volumes 1 and 2, especially concerning the calculation of rainfall runoff flow rates.^{8 9} The hydrologic analysis is based on a collection of data from the DCM, the NRCS Web Soil Survey¹⁰, Existing topographic data by Cornerstone Surveying, and proposed site plan by RMJ Designs.

3.2 Hydrologic Criteria

For this Final Drainage Report, the Rational Method as described in the *Drainage Criteria Manual* has been used for all Storm Runoff calculations, as the development and all sub-basins are less than 130 acres in area. “Colorado Springs Rainfall Intensity Duration Frequency” curves, Figure 6-5 in the DCM, was used to obtain the design rainfall values; a copy is included in the **Appendix**. The “Overland (Initial) Flow Equation” (Eq. 6-8) in the DCM, and Manning's equation with estimated depths were used in time of concentration calculations. “Runoff Coefficients for Rational Method”, Table 6-6 in the DCM, was utilized as a guide in estimating runoff coefficient and Percent Impervious values; a copy is included in the **Appendix**. Peak runoff discharges were calculated for each drainage sub-basin for both the 5-year storm event and the 100-year storm event with the Rational Method formula, (Eq. 6-5) in the DCM.¹¹

The “Water Quality Control Volume procedure, Section 3.2.3 of the *Urban Drainage and Flood Control District Drainage Criteria Manual, Volume 3* (UDFCD)^{12 13} method was used for water quality volume calculations with the aid of the “UD-BMP_v3.06” spreadsheet developed by the Urban Drainage and Flood Control District. Storm routing calculation through the proposed water quality basin was performed using triangular hydrographs based on the rational method peak discharges and times of concentrations with the aid of the detention design spreadsheet, “UD-Detention_v3.07”, developed by the Urban Drainage and Flood Control District.¹⁴

4 Drainage Facility Design

4.1 General Concept

The intent of the drainage concept presented in this Final Drainage Report is to maintain the existing drainage patterns on the site while addressing water quality requirements for the site. Major and minor storm flows will continue to be safely conveyed through the site and downstream.

The existing and proposed drainage hydrologic conditions are described in more detail below. Input data and results for all calculations are included in the **Appendix**. Drainage maps for the hydrology are also included in the **Appendix**.

4.2 Specific Details

4.2.1 Existing Hydrologic Conditions

The off-site drainage area east of the site, Basin OSA1, contains the existing RV storage area, pond area, landscape area and railroad right-of-way. The sub-basin is 4.05 acres in area and drains westerly and into the existing offsite water quality pond. Basin OSA1 generates peak storm runoff discharges of $Q_5 = 7.6$ cfs and $Q_{100} = 16.6$ cfs (existing flows) which enter the pond, which is a full-infiltration type Sand Filter basin. The Water Quality Capture Volume (WQCV) is captured and percolates into the ground. Runoff greater than the WQCV from the existing pond discharges into the site by way of the 12” CMP and emergency spillway with peak flows of $Q_5 = 2.8$ cfs and $Q_{100} = 12.1$ cfs (existing flows), which enter the site into sub-basin A1. In the 100 year rainfall event, approximately 4.4 cfs exits the pond from the existing 12” CMP and is discharged onto the site, while approximately 7.7 cfs exits through the emergency spillway crest and into the site. Once in the site, these flows continue to drain to the northwest corner.

8 CS DCM Vol 1
 9 CS DCM Vol 2
 10 WSS
 11 DCM
 12 UDFCD V.2
 13 UDFCDV.3
 14 UDFCD

The stated flows entering the site from sub-basin OSA1 are an existing condition which is greater than flows from a pre-developed condition. However, this site and the easterly offsite property was previously used for many years as a landscape nursery with significant areas dedicated to greenhouse buildings and landscape operations characterized with packed gravel drives and material storage. In the current condition, the greenhouse buildings have been removed and storage areas are gone. The current offsite condition with recycled asphalt surface is not significantly different than the previously existing (at least 38 years) with greenhouses and compacted gravel. The developed flows from the sub-basin OSA1 travel through the site and enters Crystal Creek located approximately 250 feet northwest of the site. The Crystal Creek Basin extends more than two miles to the north of the site with a contributing area of more than 550 acres upstream of the site. The peak flows from off-site sub-basin OSA1, along with the on-site flows discussed below, reach Crystal Creek and pass downstream well before the peak discharges of the much larger basin travel by the area. The small increase flows have no effect on peak flows in Crystal Creek and do not present a hazard to the downstream properties, drainage basin, or drainageways.

Existing sub-basin A1 is 1.42 acres in area located on the northern portion of the site and contained a gravel drive and meadow area. The sub-basin accepts the offsite flows from sub-basin OSA1 as described above. Sub-basin A1 produces peak discharges of $Q_5 = 0.7$ cfs and $Q_{100} = 3.4$ cfs (existing flows) which drain westerly to the existing gravel drive and ditch, joining the off-site flows from Basin OSA1. The combined flows of $Q_5 = 3.5$ cfs and $Q_{100} = 15.5$ cfs (existing flows) continue towards the northwest corner of the site to existing Design Point 1 (DP1). The flows continue westerly offsite, through the adjacent property and into Crystal Creek.

Existing sub-basin A2, located in the northwestern portion of the site and just south of sub-basin A1, is 0.32 acres in area. Sub-basin A2 contains a gravel drive, leach field and meadow/pasture area. Peak storm runoff rates are $Q_5 = 0.2$ cfs and $Q_{100} = 1.0$ cfs (existing flows) which drain westerly into the adjacent property, in a combination of sheet flow and an area of concentrated flow in the southwest edge of the basin. The concentrated flow occurs in an existing swale flowing to the west through the adjacent property towards Crystal Creek. Flows from existing Design Point 1 also flow into this swale. The combined discharges of Design Point 1 and sub-basin A2 are $Q_5 = 3.7$ cfs and $Q_{100} = 16.3$ cfs (existing flows). The flows continue westerly offsite, through the adjacent property and into Crystal Creek.

Existing sub-basin B1 (2.15 acres) is comprised of the southerly and westerly portion of the site and contains the existing shop, garage, and shed buildings, paved parking and walk areas, gravel drive and parking areas and open meadow areas with tiered railroad tie walls. The sub-basin generates flows of $Q_5 = 2.0$ cfs and $Q_{100} = 6.1$ cfs (existing flow), which drains westerly and exit the site by sheet flow into the adjacent property. These flows, along with the flows from existing DP1 and sub-basin A2, continue offsite to Crystal Creek and into Monument Reservoir and Monument Creek as described in Section 2.3 above.

The **Existing Drainage Map** depicts the existing topographic mapping, drainage basin delineations, drainage patterns, existing drives, drainage facilities, and runoff quantities with a data table including drainage areas and flow rates.

4.2.2 Proposed Hydrologic Conditions

Water quality treatment for the new disturbed and impervious areas on the site will be provided by a proposed Sand Filter Basin which will capture, contain, treat and release the Water Quality Capture Volume (WQCV). No detention for flood control is being provided because the downstream effects of the minor increases in peak flow rates are negligible. Several greenhouse buildings have been removed from the site in recent months and additional buildings are to be removed in the proposed site plan. This building removal partially offsets the additional parking areas on the site. The parking area surface is not completely impervious, but rather compacted recycled asphalt material or gravel, which allows a degree of perviousness on the site. Additionally, the developed flows from the offsite and onsite sub-basins travel through the site and enters Crystal Creek located approximately 250 feet northwest of the site. The Crystal Creek Basin extends more than two miles to the north of the site with a contributing area of more than 550 acres upstream of the site. The peak flows from off-site sub-basin OSA1, along with the on-site flows discussed below, reach Crystal Creek and pass

downstream well before the peak discharges of the much larger basin travel by the area. The small increase flows have no effect on peak flows in Crystal Creek and do not present a hazard to the downstream properties, drainage basin, or drainageways and no storm detention is required in addition to the WQCV.

The off-site drainage basin, OSA1 (4.05 acres), will continue to drain into the site as in existing conditions. The discharges entering the site from the existing offsite water quality pond are $Q_5 = 2.8$ cfs and $Q_{100} = 12.1$ cfs (proposed flow) which enter proposed onsite sub-basin A2. The existing pond discharges into the site by way of the 12" CMP and emergency spillway with peak flows of $Q_5 = 2.8$ cfs and $Q_{100} = 12.1$ cfs (existing flows), which enter the site into sub-basin A2. In the 100 year rainfall event, approximately 4.4 cfs exits the pond from the existing 12" CMP and is discharged onto the site, while approximately 7.7 cfs exits through the emergency spillway crest and into the site. Once in the site, these flows continue to drain to the northwest corner.

Proposed sub-basin A1 (0.51 acres) is comprised of a portion of the south side of site. The sub-basin will contain the proposed new shop building and recycled asphalt product parking surface. The existing garage and shed will be removed and the existing gravel drive will be reconfigured. A concrete sidewalk will also be installed adjacent to the building on two sides. The developed discharges from sub-basin A1 are $Q_5 = 0.9$ cfs and $Q_{100} = 2.0$ cfs (proposed flows). These flows travel overland to the northwest and will be directed by new drainage swale on the west and north sides of the new building to a new 8" hdpe pipe at Design Point (DP1) to the northeast and enter the ditch/swale in sub-basin A2.

Proposed sub-basin A2 (1.97 acres) will be more developed with RV parking area and the parking surface will be stabilized with recycled asphalt product. The sub-basin will continue to accept the off-site flows from sub-basin OSA1 to the east. These flows will continue to be conveyed in the existing drainage ditch/swale located along the east edge of the existing gravel drive. This ditch/swale will be reshaped. The developed discharges generated by sub-basin A2 are $Q_5 = 4.3$ cfs and $Q_{100} = 9.2$ cfs (proposed flow), which drains westerly to the existing ditch/swale and combine with the off-site flows from sub-basin OSA1 and the pipe flow from sub-basin A1 until reaching the northwest corner of the site at Design Point 2 (DP2). The combined discharges at Design Point 2 (DP2) are $Q_5 = 7.4$ cfs and $Q_{100} = 22.0$ cfs (proposed flow). These flows will enter the proposed water quality sand filter basin (WQSF) to be located in the northwest corner of the site.

Proposed sub-basin A3 (0.42 acres) will be more developed with RV parking area and the parking surface will be stabilized with recycled asphalt product. These flows will be directed to the north by a proposed berm and ditch/swale to be constructed along the west side of the existing gravel drive. The developed discharges generated by sub-basin A3 are $Q_5 = 0.9$ cfs and $Q_{100} = 2.0$ cfs (proposed flow), which drains northerly and will enter the proposed WQSF basin to be located in the northwest corner of the site.

The proposed WQSF basin (DP3) will be 2,134 cubic feet in volume and have a sand surface area of 1,322 square feet. The proposed water quality basin will have an underdrain with metered outfall, a 18" hdpe outfall pipe and a 17' wide emergency spillway stabilized with rip-rap lining. Outflows from the pond are $Q_5 = 5.0$ cfs and $Q_{100} = 18.1$ cfs (proposed flow). In the minor storm event (5-year), approximately 2.0 cfs exits the pond from the 18" standpipe inlet located just above the WQCV elevation in the pond and the remaining 3.0 cfs exits by way of the emergency spillway. In the 100-year rainfall event, approximately 2.8 cfs exits the pond from the 18" standpipe inlet located just above the WQCV elevation in the pond and the remaining 15.3 cfs exits by way of the emergency spillway. Pond outflows will be discharged to a culvert and swale in sub-basin A4. The outflows will be spread and evenly distributed as sheet flow before exiting the west site boundary by a riprap lined spreading depression.

Proposed sub-basin A4 consist of primarily undisturbed pasture/meadow with the addition of a swale directing the flows from the WQSF basin to the south and into a rip rap lined spreading depression and berm that will force the flow to sheet over a wide area reducing velocities depth at the property line and is a suitable outfall of the pond outflows. The developed discharges generated by sub-basin A4 are $Q_5 = 0.3$ cfs and $Q_{100} = 2.2$ cfs (proposed flow), combine with the flows from the WQCV pond at Design Point 3 (DP3). The combined discharges at Design Point 4 (DP4) are $Q_5 = 5.3$ cfs and

$Q_{100} = 20.3$ cfs (proposed flow). This represents a decrease in flows from the existing conditions of 0.4 cfs in the 100-year event and 2.3 cfs in the 100-year event. These flows will continue westerly through the adjacent property and flow towards Crystal Creek, the same manner as existing conditions. The existing stable flow path through the adjacent site is adequate to carry the existing and developed flows. Flow velocities in the existing flow path are not erosive and require no special lining. Hydraulic analysis the downstream flow path is included in then appendix. The flow path delivers the flows west to Crystal Creek.

Proposed sub-basin A5 consists of a small portion of the downhill slope of the proposed WQSF basin (0.11 acres) at the north end of the site. This basin is grassed pervious area. The discharges generated by sub-basin A5 are $Q_5 = 0.0$ cfs and $Q_{100} = 0.3$ cfs (proposed flow).

Existing sub-basins OSA1, A1 and A2 generated a combined flow of $Q_5 = 3.7$ cfs and $Q_{100} = 16.5$ cfs (historic flow) directed generally towards the existing structures on the adjacent property to the west. The combined historic flows that leave the site along the west edge from existing sub-basins A1, A2 & B1 are $Q_5 = 5.7$ cfs and $Q_{100} = 22.6$ cfs. In the developed condition, the proposed WQSF basin outfall and rip rap lined spreading depression and berm will direct flows south and away from the existing structures and into an area of open grassland to be released over a wide area. The combined developed condition discharges leaving the property at Design Point 4 (DP4) are $Q_5 = 5.6$ cfs and $Q_{100} = 23.6$ cfs (proposed flow), which is 0.1 cfs less than existing flow during the 5 year event and 1.0 cfs greater than the existing flows in the in the 100 year event. The implementation of the development includes the removal of structures and paved area, the new RV parking areas are not paved with impervious materials and the proposed water quality sand filter basin provides a degree of storm peak attenuation. The calculated increase in the 100-year event is an insignificant and negligible increase for the 3.9 acre site and no detention is required.

4.3 Erosion Control

During future construction, best management practices (BMP's) for erosion control will be employed based on the previously referenced City of Colorado Springs Drainage Criteria Manual Volume 2 and the Erosion Control Plan for the site. During Construction, silt fencing, sediment control log, vehicle tracking control and concrete washout area will be in place to minimize erosion from the site. Silt Fencing will be placed along the northern and western sides of the disturbed areas. This will inhibit suspended sediment form leaving the site during construction. Silt fencing is to remain in place until the parking area is stabilized with the recycled asphalt and until vegetation is reestablished in the other disturbed areas which are to be reseeded. Vehicle tracking control will be placed at the access point in the private driveway connecting to Monument Lake Road. Inlet protection will be placed at the water quality pond outlet locations. BMP's will be utilized as deemed necessary by the contractor, engineer, owner, or County inspector and are not limited to the measures described above. The water quality sand filters will also serve as sediment traps until construction is complete.

4.4 Water Quality Enhancement Best Management Practices

The Sand Filter Basins described above will provide storage for the Water Quality Capture Volume (WQCV) for the site. A Grading and Erosion Control Plan for the construction of the site has been prepared in accordance with the provisions of the DCM. Placement of construction stormwater BMP's will as required by the plan will limit soil erosion and deposition by stormwater flowing over the site.

The El Paso County Engineering Criteria Manual (Appendix I, Section I.7.2) requires the consideration of a "Four Step Process for receiving water protection that focuses on reducing runoff volumes, treating the water quality capture volume (WQCV), stabilizing drainageways, and implementing long term source controls". The Four Step Process is incorporated in this project and the elements are discussed below.

1) Runoff Reduction Practices are employed in this project. Impervious surfaces have been reduced as much as practically possible. Some of the existing structures on the site are being removed, reducing impervious surfaces. There is only minimal concrete or other hard surfaces proposed. RV storage area will be stabilized with recycled asphalt surfacing, which remains a partially pervious

surface. Minimized Directly Connected Impervious Areas (MDCIA) is employed on the project because runoff passes through the western open space meadow area before leaving the site.

2) All drainage paths on the site are stabilized with pavement or appropriate landscape treatment. The water quality ponds are intended to intercept flows from developed areas. Additionally, the pond outflow points will have rip rap protection.

3) The project contains no potentially hazardous uses. All developed areas drain into a proposed a WQCV BMP.

4) The site contains no storage of potentially harmful substances or use of potentially harmful substances. No Site Specific or Other Source Control BMP's are required.

5 Opinion of Probable Cost for Drainage Facilities

There is no public or private storm drain system proposed for development of this site. The private water quality facilities will be constructed as part of the site grading plan at the time of building construction. The property owner is responsible for construction and maintenance of the water quality facilities.

6 Drainage and Bridge Fees

The site is not being platted. No Drainage or Bridge Fees are due for this project.

7 Conclusion

This Final Drainage Report presents existing and proposed drainage conditions for the proposed Monument Small Engine Storage project. The development will have negligible and inconsequential effects on the existing site drainage and drainage conditions downstream. Water Quality treatment will be provided. The proposed project will not, with respect to stormwater runoff, negatively impact the adjacent properties and downstream properties.

References

- NRCS Web Soil Survey*. United States Department of Agriculture, Natural Resources Conservation Service ("<http://websoilsurvey.nrcs.usda.gov/app/WebSoilSurvey.aspx>", accessed March, 2018).
- NRCS Official Soil Series Descriptions*. United States Department of Agriculture, Natural Resources Conservation Service ("<http://soils.usda.gov/technical/classification/osd/index.html>", accessed March, 2018).
- Flood Insurance Rate Map*. Federal Emergency Management Agency, National Flood Insurance Program (Washington D.C.: FEMA, March 17, 1997).
- Drainage Area Identification Study*. Muller Engineering Company, Inc. (Lakewood, CO: , 1986).
- Dirty Woman Creek and Crystal Creek Drainage Basin Planning Study*. Kiowa Engineering Corporation (Colorado Springs: El Paso County, September, 1993).
- Final Drainage Report, Mount Herman RV Storage Subdivision, Town of Monument, Colorado*. M.V.E., Inc. (Colorado Springs, CO: , January 30, 2014).
- NCSS Web Soil Survey*. United States Department of Agriculture, Natural Resources Conservation Service ("<http://websoilsurvey.nrcs.usda.gov/app/WebSoilSurvey.aspx>", accessed May, 2017).
- Drainage Criteria Manual Volume 2, Stormwater Quality Policies, Procedures and Best Management Practices (BMPs)*. City of Colorado Spring Engineering Division (Colorado Springs: , May 2014).
- City of Colorado Springs Drainage Criterial Manual, Volume 1*. City of Colorado Springs Engineering Division Staff, Matrix Desgin Group/Wright Water Engineers (Colorado Springs: , May 2014).
- City of Colorado Springs/El Paso County Drainage Criteria Manual*. City of Colorado Springs, Department of Public Works, Engineering Division; HDR Infrastructure, Inc.; El Paso County, Department of Public Works, Engineering Division (Colorado Springs: City of Colorado Springs, Revised November 1991).
- City of Colorado Springs Drainage Criteria Manual Volume 1*. City of Colorado Springs Engineering Division with Matrix Design Group and Wright Water Engineers (Colorado Springs, Colorado: , May 2014).
- Detention Design Spreadsheet*. Urban Drainage and Flood Control District ("http://www.udfcd.org/downloads/software/UD-Detention_v2.2.xls", accessed January 2010).
- Urban Storm Drainage Criteria Manual Volume 3*. Urban Drainage and Flood Control District (Denver, Colorado: , August, 2011).


Drainage Criteria Manual (Volume 2). Urban Drainage and Flood Control District (Denver, Colorado: Urban Drainage and Flood Control District, Rev. April, 2008).

| Appendices

8 General Maps and Supporting Data

- Vicinity Map
- Portions of Flood Insurance Rate Map
- Portion of Drainage Area Identification Study Map
- NRCS Soil Map and Tables
- SCS Soil Type Descriptions
- Hydrologic Soil Group Map and Tables


VICINITY MAP (no scale)

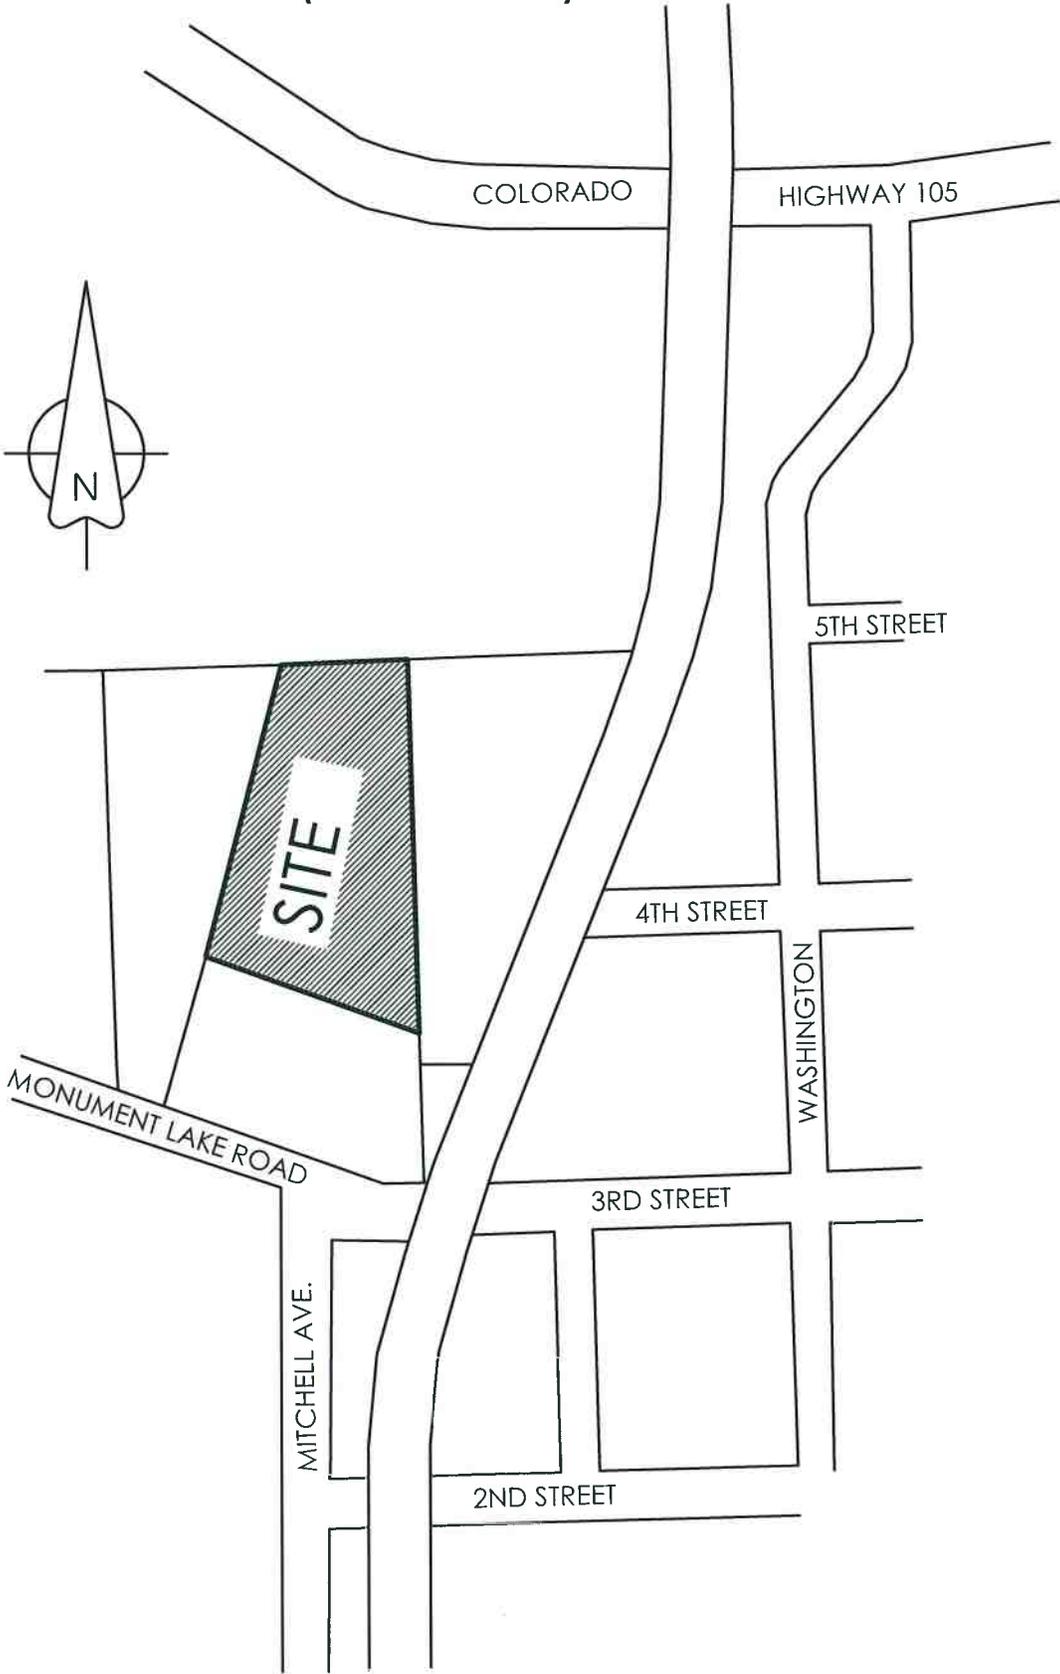

National Flood Hazard Layer FIRMette



39°51.60'N
104°52'49.12'W

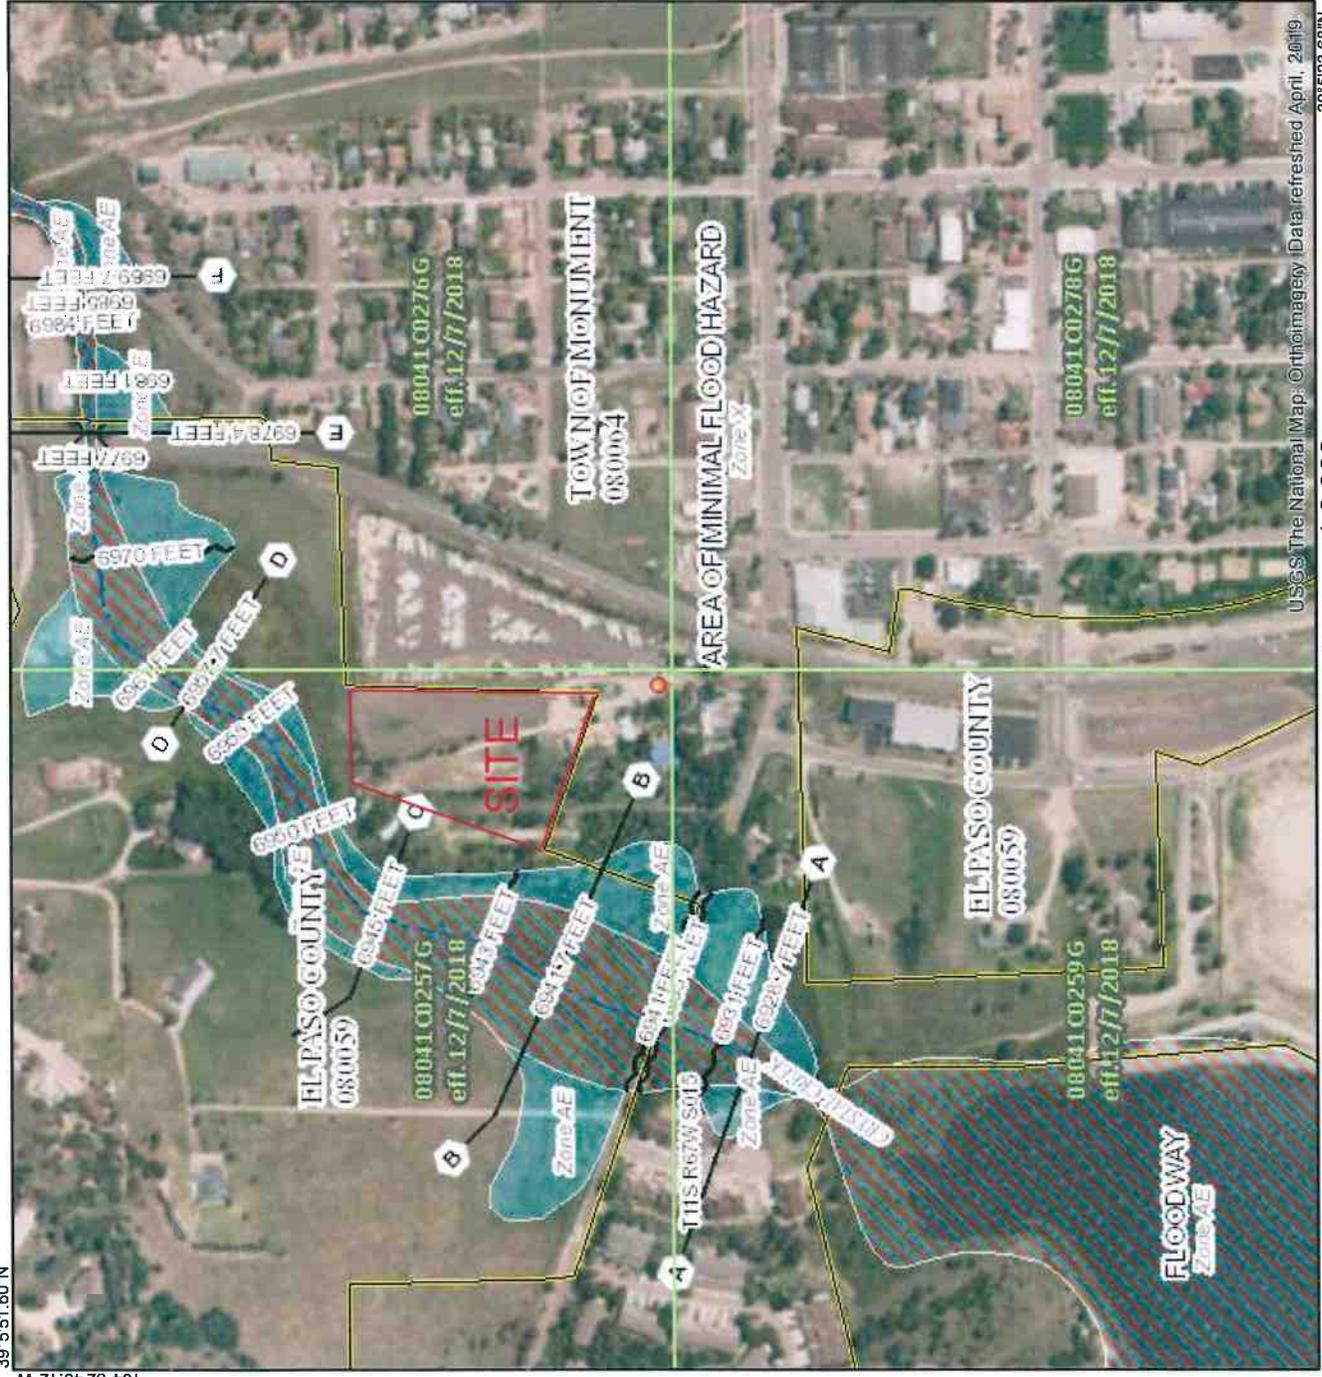

0 250 500 1,000 1,500 2,000 Feet 1:6,000

USGS: The National Map; ©thoimagery; Data refreshed April, 2019

104°52'11.67"W
39°52'38.88"N

Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

	Without Base Flood Elevation (BFE) Zone A, V, A99
	With BFE or Depth Zone AE, AO, AH, VE, AR
	Regulatory Floodway
	0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile Zone X
	Future Conditions 1% Annual Chance Flood Hazard Zone X
	Area with Reduced Flood Risk due to Levee. See Notes. Zone X
	Area with Flood Risk due to Levee Zone D
	Area of Minimal Flood Hazard Zone X
	Effective LOMFRs
	Area of Undetermined Flood Hazard Zone D
	Channel, Culvert, or Storm Sewer
	Levee, Dike, or Floodwall
	Cross Sections with 1% Annual Chance Water Surface Elevation
	Coastal Transect
	Base Flood Elevation Line (BFE)
	Limit of Study
	Jurisdiction Boundary
	Coastal Transect Baseline
	Profile Baseline
	Hydrographic Feature
	Digital Data Available
	No Digital Data Available
	Unmapped

SPECIAL FLOOD HAZARD AREAS

OTHER AREAS OF FLOOD HAZARD

OTHER FEATURES

MAP PANELS

The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards.

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on 9/27/2019 at 1:22:06 PM and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.

ARPENDER CREEK
PLPL0400

BALD MOUNTAIN
PLPL0200

CRYSTAL CREEK
FOMO 5300

PALMER LAKE

PALMER LAKE
FOMO 5400

DIRTY WOMAN CREEK
FOMO 5200

HERRY MOUNTAIN
SITE
FOMO 5600


CITY OF MONUMENT

MONUMENT ROCK
FOMO 5000


TEACHOUT CREEK
FOMO 4800

JACKSON CREEK
FOMO 4400

BLACK FOREST
FOMO 4200

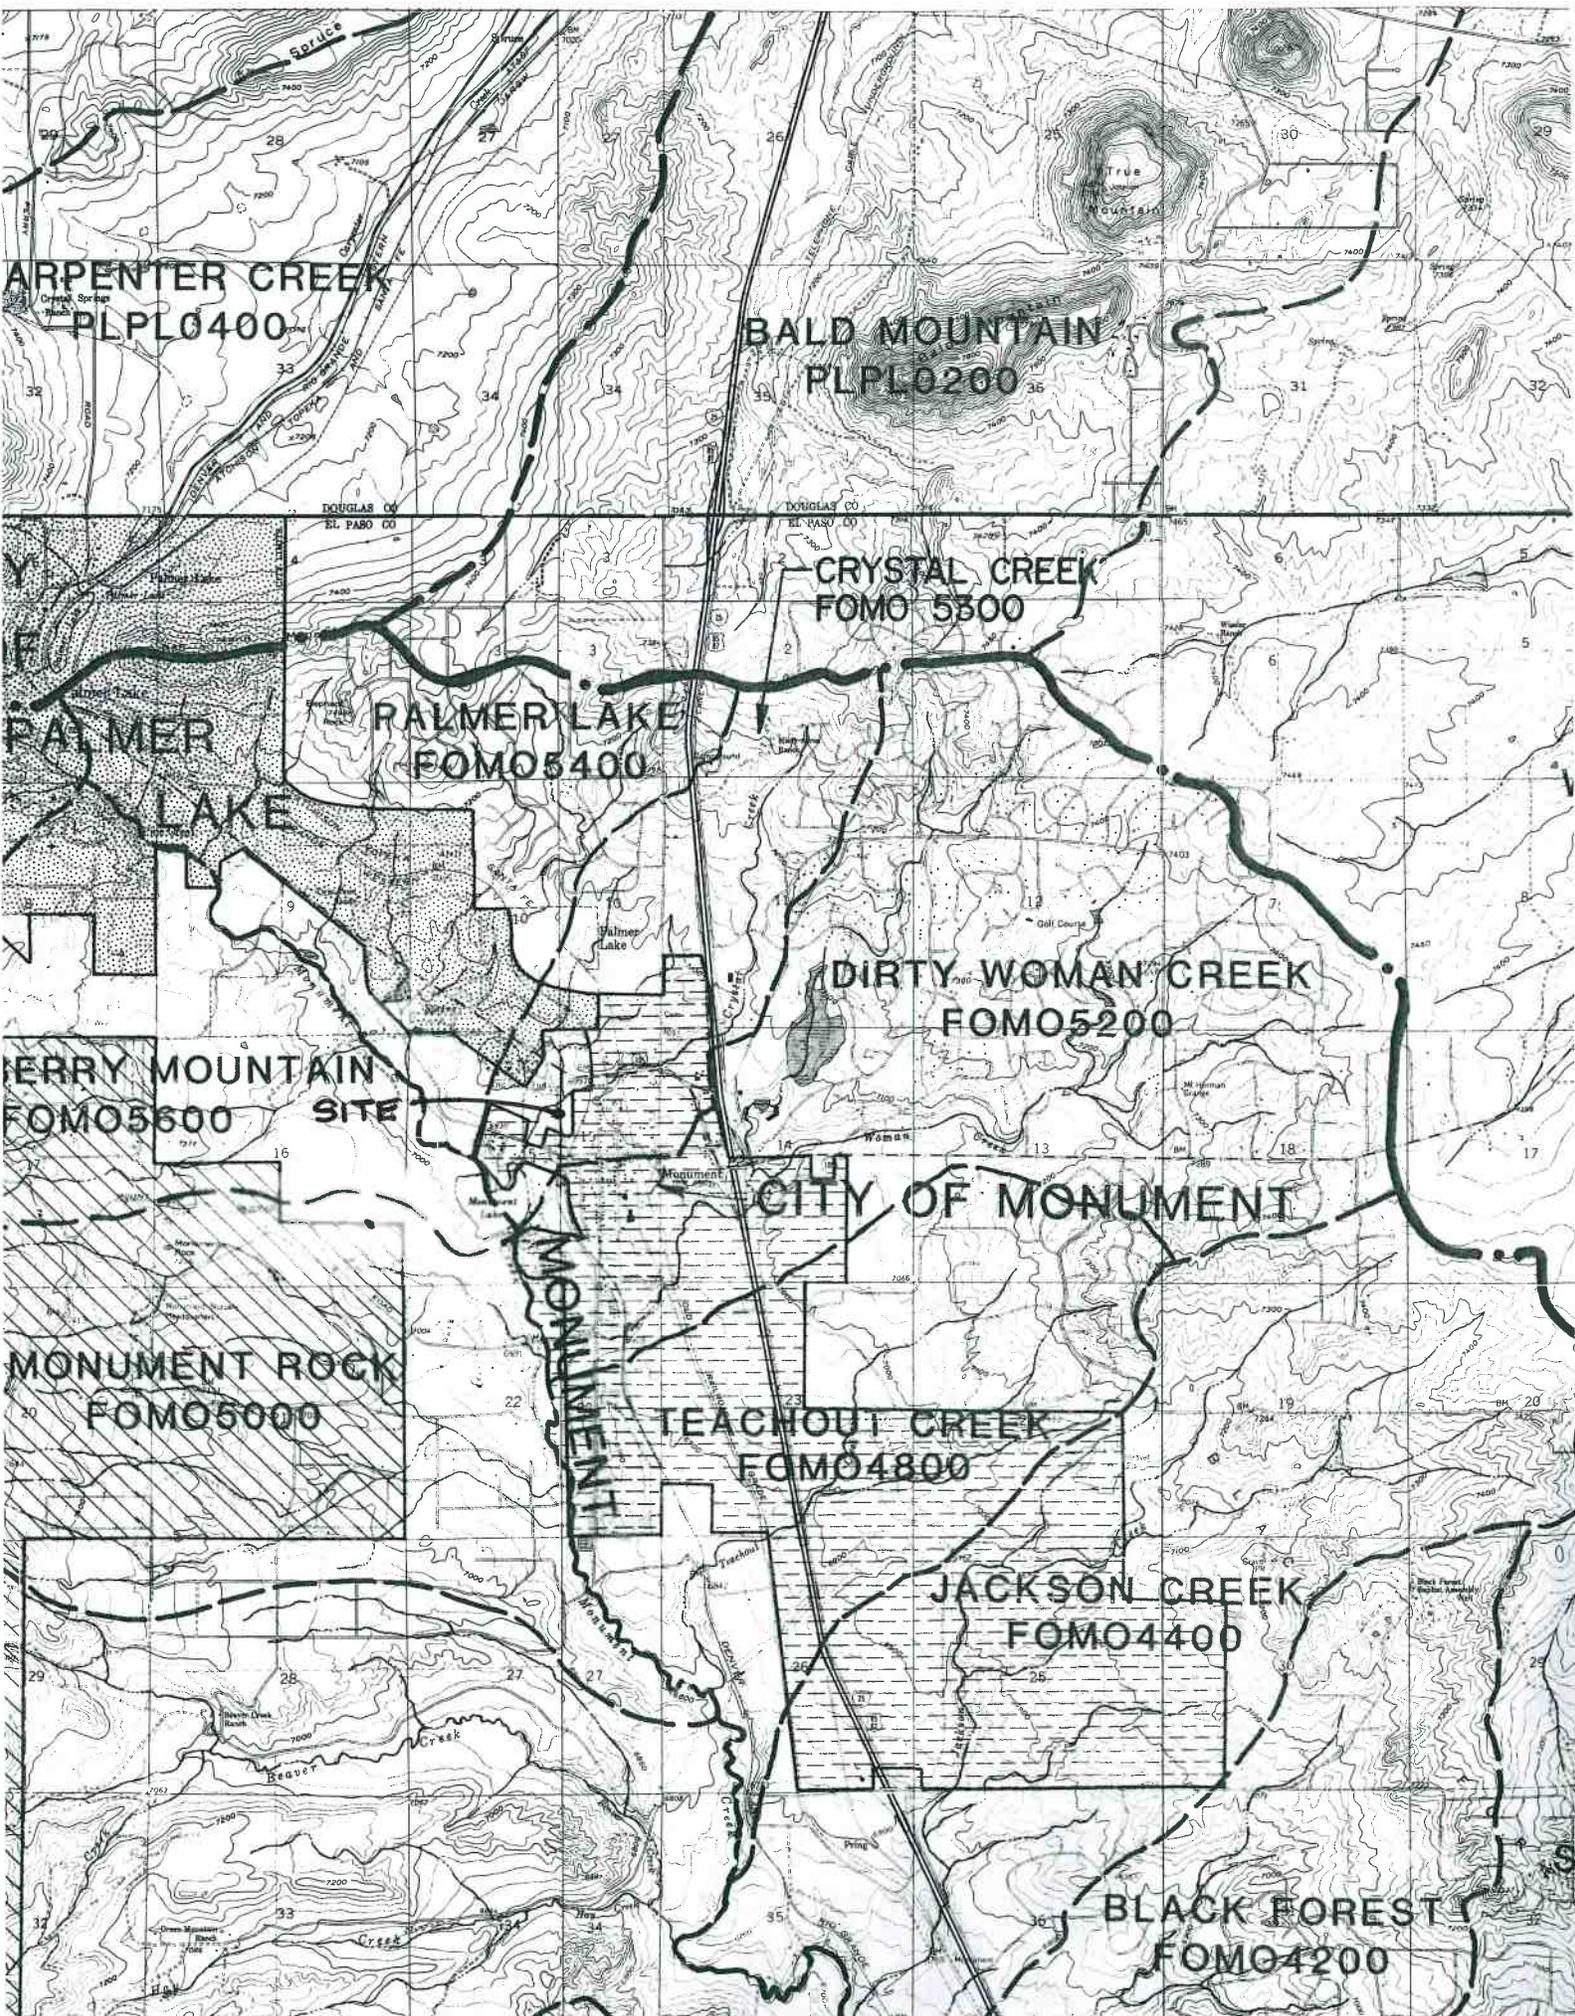

Soil Map—El Paso County Area, Colorado
(Monument Small Engine)

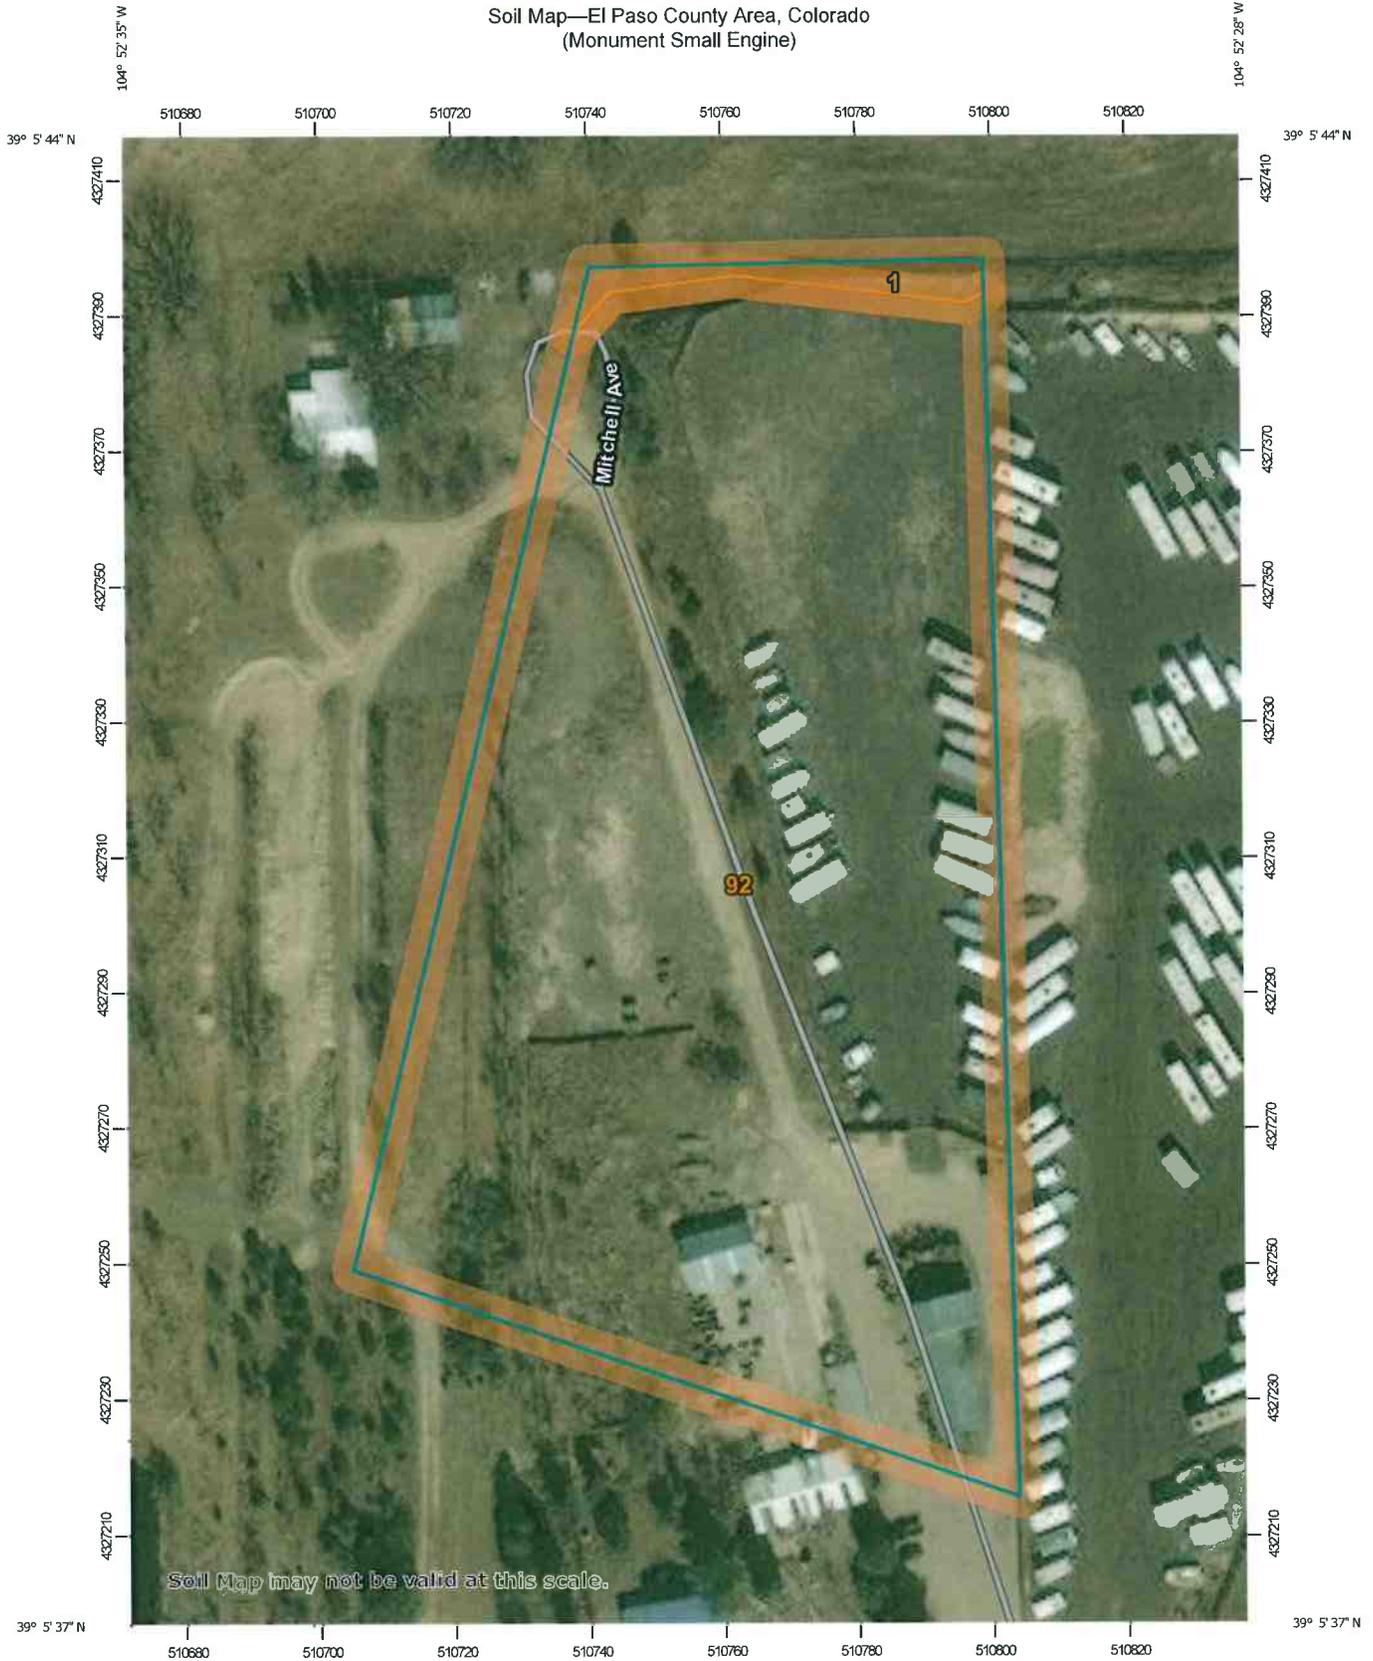

Map Scale: 1:1,070 if printed on A portrait (8.5" x 11") sheet.



Map projection: Web Mercator Corner coordinates: WGS84 Edge ticks: UTM Zone 13N WGS84



MAP LEGEND

-  Area of Interest (AOI)
-  Area of Interest (AOI)
- Soils**
-  Soil Map Unit Polygons
-  Soil Map Unit Lines
-  Soil Map Unit Points
- Special Point Features**
-  Blowout
-  Borrow Pit
-  Clay Spot
-  Closed Depression
-  Gravel Pit
-  Gravelly Spot
-  Landfill
-  Lava Flow
-  Marsh or swamp
-  Mine or Quarry
-  Miscellaneous Water
-  Perennial Water
-  Rock Outcrop
-  Saline Spot
-  Sandy Spot
-  Severely Eroded Spot
-  Sinkhole
-  Slide or Slip
-  Sodic Spot
-  Spoil Area
-  Stony Spot
-  Very Stony Spot
-  Wet Spot
-  Other
-  Special Line Features
- Water Features**
-  Streams and Canals
- Transportation**
-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads
- Background**
-  Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
Web Soil Survey URL:
Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado
Survey Area Data: Version 15, Oct 10, 2017

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Feb 22, 2014—Mar 9, 2017

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
1	Alamosa loam, 1 to 3 percent slopes	0.1	1.8%
92	Tomah-Crowfoot loamy sands, 3 to 8 percent slopes	3.2	98.2%
Totals for Area of Interest		3.3	100.0%

9 Hydrologic Calculations

Runoff Coefficients and Percent Imperviousness Table 6-6

Colorado Springs Rainfall Intensity Duration Frequency Table 6-5

Hydrologic Calculations Summary Form SF-1 for Existing & Developed Conditions

Hydrologic Calculations Summary 5-yr Form SF-2 for Existing & Developed Conditions


Hydrologic Calculations Summary 100-yr Form SF-2 for Existing & Developed Conditions

Percent Imperviousness Calculation for proposed Lots 1 & 2

Table 6-6. Runoff Coefficients for Rational Method
(Source: UDFCD 2001)

Land Use or Surface Characteristics	Percent Impervious	Runoff Coefficients																
		2-year		5-year		10-year		25-year		50-year		100-year						
		HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D					
Business																		
Commercial Areas	95	0.79	0.80	0.81	0.82	0.83	0.84	0.85	0.87	0.87	0.88	0.88	0.88	0.88	0.89	0.89	0.89	0.89
Neighborhood Areas	70	0.45	0.49	0.49	0.53	0.53	0.57	0.58	0.62	0.62	0.65	0.65	0.65	0.65	0.68	0.68	0.68	0.68
Residential																		
1/8 Acre or less	65	0.41	0.45	0.45	0.49	0.49	0.54	0.54	0.59	0.59	0.62	0.62	0.62	0.62	0.65	0.65	0.65	0.65
1/4 Acre	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.50	0.54	0.54	0.54	0.58	0.58	0.58	0.58	0.58
1/3 Acre	30	0.18	0.22	0.25	0.30	0.32	0.38	0.39	0.47	0.47	0.52	0.52	0.52	0.57	0.57	0.57	0.57	0.57
1/2 Acre	25	0.15	0.20	0.22	0.28	0.30	0.36	0.37	0.46	0.46	0.51	0.51	0.51	0.56	0.56	0.56	0.56	0.56
1 Acre	20	0.12	0.17	0.20	0.26	0.27	0.34	0.35	0.44	0.44	0.50	0.50	0.50	0.55	0.55	0.55	0.55	0.55
Industrial																		
Light Areas	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.70	0.72	0.70	0.70	0.74	0.74	0.74	0.74	0.74
Heavy Areas	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.81	0.83	0.83	0.83	0.83	0.83
Parks and Cemeteries	7	0.05	0.09	0.12	0.19	0.20	0.29	0.30	0.40	0.40	0.46	0.46	0.46	0.52	0.52	0.52	0.52	0.52
Playgrounds	13	0.07	0.13	0.16	0.23	0.24	0.31	0.32	0.42	0.42	0.48	0.48	0.48	0.54	0.54	0.54	0.54	0.54
Railroad Yard Areas	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.50	0.54	0.54	0.54	0.58	0.58	0.58	0.58	0.58
Undeveloped Areas																		
Historic Flow Analysis--																		
Greenbelts, Agriculture	2	0.03	0.05	0.09	0.16	0.17	0.26	0.26	0.38	0.38	0.45	0.45	0.45	0.51	0.51	0.51	0.51	0.51
Pasture/Meadow	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.37	0.44	0.44	0.44	0.50	0.50	0.50	0.50	0.50
Forest	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.37	0.44	0.44	0.44	0.50	0.50	0.50	0.50	0.50
Exposed Rock	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.94	0.95	0.95	0.95	0.96	0.96	0.96	0.96	0.96
Offsite Flow Analysis (when landuse is undefined)	45	0.26	0.31	0.32	0.37	0.38	0.44	0.44	0.51	0.51	0.55	0.51	0.51	0.59	0.59	0.59	0.59	0.59
Streets																		
Paved	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.94	0.95	0.95	0.95	0.96	0.96	0.96	0.96	0.96
Gravel	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.70	0.72	0.70	0.70	0.74	0.74	0.74	0.74	0.74
Drive and Walks	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.94	0.95	0.95	0.95	0.96	0.96	0.96	0.96	0.96
Roofs	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.81	0.83	0.83	0.83	0.83	0.83
Lawns	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.37	0.44	0.44	0.44	0.50	0.50	0.50	0.50	0.50

Figure 6-5. Colorado Springs Rainfall Intensity Duration Frequency

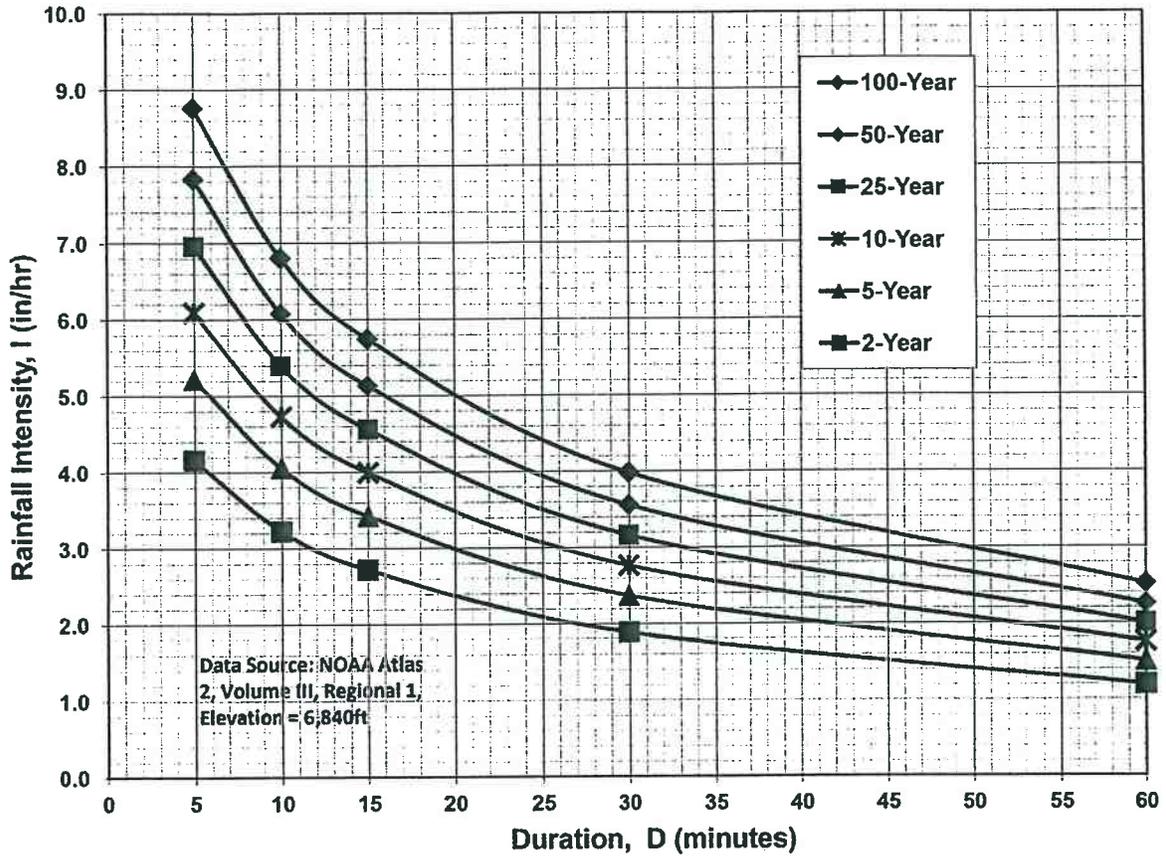

IDF Equations

$$I_{100} = -2.52 \ln(D) + 12.735$$

$$I_{50} = -2.25 \ln(D) + 11.375$$

$$I_{25} = -2.00 \ln(D) + 10.111$$

$$I_{10} = -1.75 \ln(D) + 8.847$$

$$I_5 = -1.50 \ln(D) + 7.583$$

$$I_2 = -1.19 \ln(D) + 6.035$$

Note: Values calculated by equations may not precisely duplicate values read from figure.

Job No.: 61092

Project: Monument Small Engine Storage

Date: 10/24/2019 9:06

Calcs By: D. Gorman

Checked By:

Time of Concentration (Modified from Standard Form SF-1)

Sub-Basin	Sub-Basin Data			Overland		Shallow Channel				Channelized				t _c Check				
	Area (Acres)	C ₅	C _{100/CN}	% Imp.	L ₀ (ft)	S ₀ (%)	t _i (min)	L _{0t} (ft)	S _{0t} (ft/ft)	V _{0sc} (ft/s)	t _i (min)	L _{0c} (ft)	S _{0c} (ft/ft)	V _{0c} (ft/s)	t _c (min)	L (min)	t _{c,alt} (min)	t _c (min)
EX-OSA1	4.05	0.48	0.62	62%	100	3%	7.7	335	0.022	1.5	3.7	0	0.000	0.0	0.0	435	N/A	11.4
EX-A1	1.42	0.13	0.39	8%	100	3%	11.9	50	0.140	3.7	0.2	285	0.032	3.0	1.6	435	N/A	13.7
EX-A2	0.32	0.17	0.41	13%	75	6%	8.0	94	0.074	2.7	0.6	0	0.000	0.0	0.0	169	N/A	8.6
EX-B1	2.15	0.26	0.48	27%	100	2%	12.0	195	0.041	1.4	2.3	85	0.082	4.5		380	N/A	14.7
DV-A1	0.51	0.49	0.63	61%	100	2%	9.7	137	0.015	1.2	1.9	156	0.019	1.8	1.4	393	N/A	13.0
DV-A2	1.97	0.49	0.63	65%	100	3%	7.5	50	0.140	3.7	0.2	177	0.051	4.1	0.7	327	N/A	8.4
DV-A3	0.42	0.53	0.66	70%	100	4%	6.5	137	0.011	1.0	2.2	116	0.039	2.5	0.8	353	N/A	9.5
DV-A4	0.89	0.08	0.35	0%	75	6%	8.7	94	0.074	2.7	0.6	0	0.000	0.0	0.0	169	N/A	9.3
DV-A5	0.11	0.08	0.35	0%	14	29%	2.3	0	0.000	0.0	0.0	0	0.000	0.0	0.0	14	N/A	5.0

Job No.: 61092
 Project: Monument Small Engine Storage
 Design Storm: 5-Year Storm (20% Probability)
 Jurisdiction: DCM

Date: 1/18/2020 19:18
 Calcs By: D. Gorman
 Checked By:

Sub-Basin and Combined Flows (Modified from Standard Form SF-2)

DP	Sub-Basin	Area (Acres)	C5	Direct Runoff			Combined Runoff			Streetflow			Pipe Flow			Travel Time		
				t _c (min)	CA (Acres)	i5 (in/hr)	Q5 (cfs)	t _c (min)	CA (Acres)	i5 (in/hr)	Q5 (cfs)	Slope (%)	Length (ft)	Q (cfs)	Slope (%)	Length (ft)	n	Length (ft)
EX DP1	EX-OSA1	4.05	0.48	11.4	1.93	3.93	7.6											
	EX-A1	1.42	0.13	13.7	0.19	3.65	0.7											
	OSA1,A1	5.47	0.13					13.7										
	EX-A2	0.32	0.17	8.6	0.05	4.36	0.2											
	OSA1,A1,A2	5.79	0.14					13.7										
EX DP1+A2	EX-B1	2.15	0.26	14.7	0.56	3.56	2.0											
DV DP1	DV-A1	0.51	0.49	13.0	0.25	3.74	0.9											
	DV-A2	0.51	0.49	8.4	0.97	4.39	4.3											
DV DP2	OSA1,A1,A2	2.48	0.49															
	DV-A3	0.42	0.53	9.5	0.22	4.21	0.9											
DV DP3	DP2,A3	2.90	0.50	9.3	0.07	4.24	0.3		1.44	3.74	5.4							
	DV-A4	0.89	0.08	9.3	0.07	4.24	0.3											
DV DP4	DP3 Out,A4	0.89	0.08	5.0	0.01	5.17	0.0		0.07	4.24	5.3							
	DV-A5	0.11	0.08															

DCM: I = C1 * In (tc) + C2
 C1: 1.5
 C1: 7.583

Job No.: 61092
 Project: Monument Small Engine Storage
 Design Storm: 100-Year Storm (1% Probability)
 Jurisdiction: DCM

Date: 1/18/2020 19:18
 Calcs By: D. Gorman
 Checked By:

Sub-Basin and Combined Flows (Modified from Standard Form SF-2)

DP	Sub-Basin	Area (Acres)	C100	Direct Runoff			Combined Runoff			Streetflow			Pipe Flow				Travel Time	
				t _c (min)	CA (Acres)	I100 (in/hr)	Q100 (cfs)	t _c (min)	CA (Acres)	I100 (in/hr)	Q (cfs)	Slope (%)	Length (ft)	n	Length (ft)	D _{Pipe} (in)	Length (ft)	V _{ave} (ft/s)
EX DP1	EX-OSA1	4.05	0.62	11.4	2.52	6.60	16.6											
	EX-A1	1.42	0.39	13.7	0.55	6.13	3.4											
	OSA1,A1	1.42	0.39					13.7	0.55	6.13	3.4							
	EX-A2	5.47	0.41	8.6	2.23	7.33	16.4											
	OSA1,A1,A2	1.74	0.39					13.7	0.68	6.13	4.2							
EX DP1+A2	EX-B1	5.79	0.48	14.7	2.76	5.97	16.5											
DV DP1	DV-A1	0.51	0.63	13.0	0.32	6.28	2.0											
	DV-A2	0.51	0.63					13.0	0.32	6.28	2.0							
DV DP2	DV-A2	5.47	0.63	8.4	3.47	7.37	25.6											
	OSA1,A1,A2	2.48	0.63					13.0	1.57	6.28	9.9							
DV DP3	DV-A3	5.79	0.66	9.5	3.81	7.07	26.9											
	DP2, A3	2.90	0.64					13.0	1.85	6.28	11.6							
DV DP4	DV-A4	0.89	0.35	9.3	0.31	7.12	2.2											
	DP3 Out, A4	0.89	0.35					9.3	0.31	7.12	20.3							
	DV-A5	0.11	0.35	5.0	0.04	8.68	0.3											

DCM: $I = C1 * In(tc) + C2$
 C1: 2.52
 C2: 12.735

Sub-Basin EX-OSA1 Runoff Calculations (offsite pond inflow)

Job No.:	<u>61092</u>	Date:	<u>9/26/2019 12:04</u>
Project:	<u>Monument Small Engine Storage</u>	Calcs by:	<u>D. Gorman</u>
Jurisdiction	DCM	Checked by:	
Runoff Coefficient	Surface Type	Soil Type	B
		Urbanization	Non-Urban

Basin Land Use Characteristics

Surface	Area		Runoff Coefficient						% Imperv.
	(SF)	(Acres)	C2	C5	C10	C25	C50	C100	
Gravel	137,170	3.15	0.57	0.59	0.63	0.66	0.68	0.7	80%
Landscaping	780	0.02	0.03	0.09	0.17	0.26	0.31	0.36	2%
Pasture/Meadow	38,537	0.88	0.02	0.08	0.15	0.25	0.3	0.35	0%
Combined	176,487	4.05	0.45	0.48	0.52	0.57	0.60	0.62	62.2%

176487

Basin Travel Time

	Shallow Channel Ground Cover		Nearly bare ground				
	$L_{max, Overland}$	100 ft			C_v	10	
	L (ft)	ΔZ_o (ft)	S_o (ft/ft)	v (ft/s)	t (min)	t_{AI} (min)	
Total	435	11	-	-	-	-	
Initial Time	100	3	0.032	-	7.7	N/A DCM Eq. 6-8	
Shallow Channel	335	8	0.022	1.5	3.7	- DCM Eq. 6-9	
Channelized			0.000	0.0	0.0	- V-Ditch	
				t_c	11.4 min.		

Rainfall Intensity & Runoff

	2-Yr	5-Yr	10-Yr	25-Yr	50-Yr	100-Yr
Intensity (in/hr)	3.14	3.93	4.59	5.24	5.90	6.60
Runoff (cfs)	5.7	7.6	9.7	12.1	14.2	16.6
Release Rates (cfs/ac)	-	-	-	-	-	-
Allowed Release (cfs)	5.7	7.6	9.7	12.1	14.2	16.6

$$DCM: I = C1 * \ln(tc) + C2$$

C1	1.19	1.5	1.75	2	2.25	2.52
C2	6.035	7.583	8.847	10.111	11.375	12.735

Notes

Sub-Basin Ex-A1 Runoff Calculations

Job No.: 61092 Date: 9/26/2019 12:04
 Project: Monument Small Engine Storage Calcs by: D. Gorman
 Checked by: _____
 Jurisdiction: DCM Soil Type: B
 Runoff Coefficient: Surface Type Urbanization: Non-Urban

Basin Land Use Characteristics

Surface	Area		Runoff Coefficient						% Imperv.
	(SF)	(Acres)	C2	C5	C10	C25	C50	C100	
Gravel	6,295	0.14	0.57	0.59	0.63	0.66	0.68	0.7	80%
Pasture/Meadow	55,489	1.27	0.02	0.08	0.15	0.25	0.3	0.35	0%
Combined	61,784	1.42	0.08	0.13	0.20	0.29	0.34	0.39	8.2%

61784

Basin Travel Time

-
Shallow Channel Ground Cover: Nearly bare ground

$L_{max, Overland}$ 100 ft C_v 10

	L (ft)	ΔZ_0 (ft)	S_0 (ft/ft)	v (ft/s)	t (min)	t_{AIR} (min)
Total	435	19	-	-	-	-
Initial Time	100	3	0.032	-	11.9	N/A DCM Eq. 6-8
Shallow Channel	50	7	0.140	3.7	0.2	- DCM Eq. 6-9
Channelized	285	9	0.032	3.0	1.6	- V-Ditch
t_c					13.7 min.	

Rainfall Intensity & Runoff

	2-Yr	5-Yr	10-Yr	25-Yr	50-Yr	100-Yr
Intensity (in/hr)	2.92	3.65	4.26	4.87	5.48	6.13
Runoff (cfs)	0.3	0.7	1.2	2.0	2.6	3.4
Release Rates (cfs/ac)	-	-	-	-	-	-
Allowed Release (cfs)	0.3	0.7	1.2	2.0	2.6	3.4

DCM* $I = C1 * \ln(t_c) + C2$

C1	1.19	1.5	1.75	2	2.25	2.52
C2	6.035	7.533	8.847	10.111	11.375	12.735

Notes

Sub-Basin Ex-A2 Runoff Calculations

Job No.: 61092 Date: 9/26/2019 12:04
 Project: Monument Small Engine Storage Calcs by: D. Gorman
 Checked by: _____
 Jurisdiction: DCM Soil Type: B
 Runoff Coefficient: Surface Type Urbanization: Non-Urban

Basin Land Use Characteristics

Surface	Area		Runoff Coefficient						% Imperv.
	(SF)	(Acres)	C2	C5	C10	C25	C50	C100	
Gravel	2,360	0.05	0.57	0.59	0.63	0.66	0.68	0.7	80%
Pasture/Meadow	11,765	0.27	0.02	0.08	0.15	0.25	0.3	0.35	0%
Combined	14,125	0.32	0.11	0.17	0.23	0.32	0.36	0.41	13.4%

14125

Basin Travel Time

	Shallow Channel Ground Cover		Nearly bare ground		C _v		10	
	L _{max, Overland}	100 ft	S ₀ (ft/ft)	v (ft/s)	t (min)	t _{Alt} (min)		
Total	169	12	-	-	-	-		
Initial Time	75	5	0.063	-	8.0	N/A	DCM Eq. 6-8	
Shallow Channel	94	7	0.074	2.7	0.6	-	DCM Eq. 6-9	
Channelized			0.000	0.0	0.0	-	V-Ditch	
				t _c		8.6 min.		

Rainfall Intensity & Runoff

	2-Yr	5-Yr	10-Yr	25-Yr	50-Yr	100-Yr
Intensity (in/hr)	3.48	4.36	5.09	5.82	6.55	7.33
Runoff (cfs)	0.1	0.2	0.4	0.6	0.8	1.0
Release Rates (cfs/ac)	-	-	-	-	-	-
Allowed Release (cfs)	0.1	0.2	0.4	0.6	0.8	1.0

DCM: $I = C1 * \ln(tc) + C2$

C1	1.19	1.5	1.75	2	2.25	2.52
C2	6.035	7.583	8.947	10.111	11.375	12.735

Notes

Sub-Basin Ex-B1 Runoff Calculations

Job No.:	<u>61092</u>	Date:	<u>9/26/2019 12:04</u>
Project:	<u>Monument Small Engine Storage</u>	Calcs by:	<u>D. Gorman</u>
Jurisdiction	DCM	Checked by:	
Runoff Coefficient	Surface Type	Soil Type	B
		Urbanization	Non-Urban

Basin Land Use Characteristics

Surface	Area		Runoff Coefficient						% Imperv.
	(SF)	(Acres)	C2	C5	C10	C25	C50	C100	
Roofs	3,525	0.08	0.71	0.73	0.75	0.78	0.8	0.81	90%
Gravel	22,940	0.53	0.57	0.59	0.63	0.66	0.68	0.7	80%
Paved	3,660	0.08	0.89	0.9	0.92	0.94	0.95	0.96	100%
Pasture/Meadow	63,448	1.46	0.02	0.08	0.15	0.25	0.3	0.35	0%
Combined	93,573	2.15	0.21	0.26	0.32	0.40	0.44	0.48	26.9%

93573

Basin Travel Time

	Shallow Channel	Ground Cover	Short Pasture/Lawns		
	$L_{max, Overland}$	100 ft	C_v	7	
	L (ft)	ΔZ_0 (ft)	S_0 (ft/ft)	v (ft/s)	t (min)
Total	380	17	-	-	-
Initial Time	100	2	0.020	-	12.0
Shallow Channel	195	8	0.041	1.4	2.3
Channelized	85	7	0.082	4.5	0.3
				t_c	14.7 min.

Rainfall Intensity & Runoff

	2-Yr	5-Yr	10-Yr	25-Yr	50-Yr	100-Yr
Intensity (in/hr)	2.84	3.56	4.15	4.74	5.33	5.97
Runoff (cfs)	1.3	2.0	2.9	4.0	5.0	6.1
Release Rates (cfs/ac)	-	-	-	-	-	-
Allowed Release (cfs)	1.3	2.0	2.9	4.0	5.0	6.1

DCM: $I = C1 * \ln(t_c) + C2$

C1	1.19	1.5	1.75	2	2.25	2.52
C2	6.035	7.583	8.847	10.111	11.375	12.735

Notes

Sub-Basin Dv-A2 Runoff Calculations

Job No.: 61092 Date: 10/24/2019 9:06
 Project: Monument Small Engine Storage Calcs by: D. Gorman
 Checked by: _____
 Jurisdiction: DCM Soil Type: B
 Runoff Coefficient: Surface Type Urbanization: Non-Urban

Basin Land Use Characteristics

Surface	Area		Runoff Coefficient						% Imperv.
	(SF)	(Acres)	C2	C5	C10	C25	C50	C100	
Gravel	68,463	1.57	0.57	0.59	0.63	0.66	0.68	0.7	80%
Pasture/Meadow	16,639	0.38	0.02	0.08	0.15	0.25	0.3	0.35	0%
Paved	618	0.01	0.89	0.9	0.92	0.94	0.95	0.96	100%
Combined	85,720	1.97	0.47	0.49	0.54	0.58	0.61	0.63	64.6%

85720

Basin Travel Time

	Shallow Channel Ground Cover		Nearly bare ground			
	$L_{max,Overland}$	100 ft			C_v	10
	L (ft)	ΔZ_0 (ft)	S_0 (ft/ft)	v (ft/s)	t (min)	t_{Alt} (min)
Total	327	19	-	-	-	-
Initial Time	100	3	0.032	-	7.5	N/A DCM Eq. 6-8
Shallow Channel	50	7	0.140	3.7	0.2	- DCM Eq. 6-9
Channelized	177	9	0.051	4.1	0.7	- V-Ditch
				t_c	8.4 min.	

Rainfall Intensity & Runoff

	2-Yr	5-Yr	10-Yr	25-Yr	50-Yr	100-Yr
Intensity (in/hr)	3.50	4.39	5.12	5.85	6.59	7.37
Runoff (cfs)	3.2	4.3	5.4	6.7	7.9	9.2
Release Rates (cfs/ac)	-	-	-	-	-	-
Allowed Release (cfs)	3.2	4.3	5.4	6.7	7.9	9.2

$$DCM: I = C1 * In (tc) + C2$$

C1 1.19 1.5 1.75 2 2.25 2.52

C2 6.035 7.583 8.847 10.111 11.375 12.735

Notes

Combined Sub-Basin Runoff Calculations (East ditch/swale) AT DP 2

Includes Basins DV-A1 DV-A2

+ OSA1 pond outflow

Job No.: 61092
 Project: Monument Small Engine Storage
 Jurisdiction: DCM
 Runoff Coefficient: Surface Type

Date: 10/24/2019 9:06
 Calcs by: D. Gorman
 Checked by: _____
 Soil Type: B
 Urbanization: Non-Urban

Basin Land Use Characteristics

Surface	Area		Runoff Coefficient						% Imperv.
	(SF)	(Acres)	C2	C5	C10	C25	C50	C100	
Gravel	78,686	1.81	0.57	0.59	0.63	0.66	0.68	0.7	80%
Pasture/Meadow	22,737	0.52	0.02	0.08	0.15	0.25	0.3	0.35	0%
Roofs	5,643	0.13	0.71	0.73	0.75	0.78	0.8	0.81	90%
Paved	846	0.02	0.89	0.9	0.92	0.94	0.95	0.96	100%
Combined	107,912	2.48	0.46	0.49	0.54	0.58	0.61	0.63	63.8%

Basin Travel Time

	Sub-basin or Channel Type	Material Type	L (ft)	Elev. ΔZ_0 (ft)	Q_i (cfs)	Base or Dia (ft)	Sides z:1 (ft/ft)	v (ft/s)	t (min)
Furthest Reach	DV-A1	-	393	7	-	-	-	-	13.0
Channelized-1									
Channelized-2									
Channelized-3									
Total			393	7					
								t_c (min)	13.0

Contributing Offsite Flows (Added to Runoff and Allowed Release, below.)

Contributing Basins/Areas	Offsite Basin OSA1 Existing Pond Outflow
Q_{Minor}	2.8 (cfs) - 5-year Storm
Q_{Major}	12.1 (cfs) - 100-year Storm

Rainfall Intensity & Runoff

	2-Yr	5-Yr	10-Yr	25-Yr	50-Yr	100-Yr
Intensity (in/hr)	2.99	3.74	4.36	4.99	5.61	6.28
Site Runoff (cfs)	3.43	4.56	5.81	7.19	8.46	9.86
OffSite Runoff (cfs)	-	2.80	-	-	-	12.10
Release Rates (cfs/ac)	-	-	-	-	-	-
Allowed Release (cfs)	-	7.4	-	-	-	22.0

DCM: $I = C1 * \ln(tc) + C2$

C1	1.19	1.5	1.75	2	2.25	2.52
C2	6.035	7.583	8.847	10.111	11.375	12.735

Notes

Runoff from pond outflows and other contributing basins are assumed constant, disregarding differing times of concentration.

Combined Sub-Basin Runoff Calculations (DP3 Pond Inflow)

Includes Basins DV-A1 DV-A2 DV-A3

+ OSA1 pond outflow

Job No.: 61092

Date: 10/24/2019 9:06

Project: Monument Small Engine Storage

Calcs by: D. Gorman

Jurisdiction: DCM
Runoff Coefficient: Surface Type

Checked by: _____

Soil Type: B
Urbanization: Non-Urban

Basin Land Use Characteristics

Surface	Area		Runoff Coefficient						% Imperv.
	(SF)	(Acres)	C2	C5	C10	C25	C50	C100	
Gravel	94,803	2.18	0.57	0.59	0.63	0.66	0.68	0.7	80%
Pasture/Meadow	24,966	0.57	0.02	0.08	0.15	0.25	0.3	0.35	0%
Roofs	5,643	0.13	0.71	0.73	0.75	0.78	0.8	0.81	90%
Paved	846	0.02	0.89	0.9	0.92	0.94	0.95	0.96	100%
Combined	126,258	2.90	0.47	0.50	0.54	0.59	0.61	0.64	64.8%

Basin Travel Time

	Sub-basin or Channel Type	Material Type	L (ft)	Elev. ΔZ_0 (ft)	Q_i (cfs)	Base or Dia (ft)	Sides z:1 (ft/ft)	v (ft/s)	t (min)
Furthest Reach	DV-A1	-	393	7	-	-	-	-	13.0
Channelized-1									
Channelized-2									
Channelized-3									
Total			393	7					
								t_c (min)	13.0

Contributing Offsite Flows (Added to Runoff and Allowed Release, below.)

Contributing Basins/Areas	Offsite Basin OSA1 Existing Pond Outflow
Q_{Minor}	2.8 (cfs) - 5-year Storm
Q_{Major}	12.1 (cfs) - 100-year Storm

Rainfall Intensity & Runoff

	2-Yr	5-Yr	10-Yr	25-Yr	50-Yr	100-Yr
Intensity (in/hr)	2.99	3.74	4.36	4.99	5.61	6.28
Site Runoff (cfs)	4.07	5.39	6.86	8.47	9.95	11.60
OffSite Runoff (cfs)	-	2.80	-	-	-	12.10
Release Rates (cfs/ac)	-	-	-	-	-	-
Allowed Release (cfs)	-	8.2	-	-	-	23.7

DCM: $I = C1 * \ln(tc) + C2$

C1	1.19	1.5	1.75	2	2.25	2.52
C2	6.035	7.583	8.847	10.111	11.375	12.735

Notes

Runoff from pond outflows and other contributing basins are assumed constant, disregarding differing times of concentration.

Combined Sub-Basin Runoff Calculations (DP3 Pond Outflow + A4)

Includes Basins DV-A4

Job No.:	61092	Date:	1/18/2020 19:07
Project:	Monument Small Engine Storage	Calcs by:	D. Gorman
Jurisdiction	DCM	Checked by:	
Runoff Coefficient	Surface Type	Soil Type	B
		Urbanization	Non-Urban

Basin Land Use Characteristics

Surface	Area		Runoff Coefficient						% Imperv.
	(SF)	(Acres)	C2	C5	C10	C25	C50	C100	
Gravel	-	0.00	0.57	0.59	0.63	0.66	0.68	0.7	80%
Pasture/Meadow	38,591	0.89	0.02	0.08	0.15	0.25	0.3	0.35	0%
Combined	38,591	0.89	0.02	0.08	0.15	0.25	0.30	0.35	0.0%

Basin Travel Time

	Sub-basin or Channel Type	Material Type	L (ft)	Elev. ΔZ ₀ (ft)	Q _i (cfs)	Base or Dia (ft)	Sides z:1 (ft/ft)	v (ft/s)	t (min)
Furthest Reach	DV-A4	-	169	12	-	-	-	-	9.3
Channelized-1									
Channelized-2									
Channelized-3									
Total			169	12					
								t_c (min)	9.3

Contributing Offsite Flows (Added to Runoff and Allowed Release, below.)

Contributing Basins/Areas DP1 Pond Outflow

Q _{Minor}	5.0 (cfs) - 5-year Storm
Q _{Major}	18.1 (cfs) - 100-year Storm

Rainfall Intensity & Runoff

	2-Yr	5-Yr	10-Yr	25-Yr	50-Yr	100-Yr
Intensity (in/hr)	3.38	4.24	4.95	5.66	6.36	7.12
Site Runoff (cfs)	0.06	0.30	0.66	1.25	1.69	2.21
OffSite Runoff (cfs)	-	5.00	-	-	-	18.10
Release Rates (cfs/ac)	-	-	-	-	-	-
Allowed Release (cfs)	-	5.3	-	-	-	20.3

DCM: $I = C1 * \ln(Ic) + C2$

C1	1.19	1.5	1.75	2	2.25	2.52
C2	6.035	7.583	8.847	10.111	11.375	12.735

Notes

Runoff from pond outflows and other contributing basins are assumed constant, disregarding differing times of concentration.

Sub-Basin Dv-A5 Runoff Calculations

Job No.:	<u>61092</u>	Date:	<u>10/24/2019 9:06</u>
Project:	<u>Monument Small Engine Storage</u>	Calcs by:	<u>D. Gorman</u>
Jurisdiction	DCM	Checked by:	
Runoff Coefficient	Surface Type	Soil Type	B
		Urbanization	Non-Urban

Basin Land Use Characteristics

Surface	Area		Runoff Coefficient						% Imperv.
	(SF)	(Acres)	C2	C5	C10	C25	C50	C100	
Pasture/Meadow	4,618	0.11	0.02	0.08	0.15	0.25	0.3	0.35	0%
Combined	4,618	0.11	0.02	0.08	0.15	0.25	0.30	0.35	0.0%

Basin Travel Time

	Shallow Channel Ground Cover		Nearly bare ground				
	$L_{max, Overland}$	100 ft			C_v	10	
	L (ft)	ΔZ_0 (ft)	S_0 (ft/ft)	v (ft/s)	t (min)	t_{AIR} (min)	
Total	14	4	-	-	-	-	
Initial Time	14	4	0.286	-	2.3	N/A	DCM Eq. 6-8
Shallow Channel			0.000	0.0	0.0	-	DCM Eq. 6-9
Channelized			0.000	0.0	0.0	-	V-Ditch
				t_c	5.0 min.		

Rainfall Intensity & Runoff

	2-Yr	5-Yr	10-Yr	25-Yr	50-Yr	100-Yr
Intensity (in/hr)	4.12	5.17	6.03	6.89	7.75	8.68
Runoff (cfs)	0.0	0.0	0.1	0.2	0.2	0.3
Release Rates (cfs/ac)	-	-	-	-	-	-
Allowed Release (cfs)	0.0	0.0	0.1	0.2	0.2	0.3

DCM: $I = C1 * \ln(t_c) + C2$

C1	1.19	1.5	1.75	2	2.25	2.52
C2	6.035	7.583	8.847	10.111	11.375	12.735

Notes

10 Hydraulic Calculations


Sand Filter Basin Calculations
Ditch Capacity Calculations

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

UD-Detention, Version 3.07 (February 2017)

Project: Mounty Herman RV Storage

Basin ID: Existing WQ/Detention Pond Basin OSA1 (existing pond - offsite)

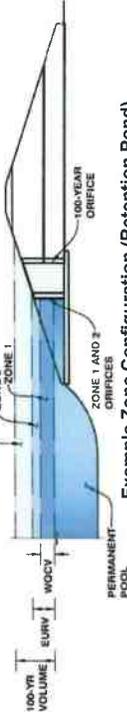

Example Zone Configuration (Retention Pond)

Required Volume Calculation

Selected BMP Type =	SF
Watershed Area =	4.05 acres
Watershed Length =	435 ft
Watershed Slope =	0.025 ft/ft
Watershed Imperviousness =	62.00% percent
Percentage Hydrologic Soil Group A =	0.0% percent
Percentage Hydrologic Soil Group B =	100.0% percent
Percentage Hydrologic Soil Groups C/D =	0.0% percent
Desired WQCV Drain Time =	12.0 hours
Location for 1-hr Rainfall Depths =	Denver - Capitol Building
Water Quality Capture Volume (WQCV) =	0.066 acre-feet
Excess Urban Runoff Volume (EURV) =	0.273 acre-feet
2-yr Runoff Volume (P1 = 1.19 in.) =	0.225 acre-feet
5-yr Runoff Volume (P1 = 1.5 in.) =	0.302 acre-feet
10-yr Runoff Volume (P1 = 1.75 in.) =	0.391 acre-feet
25-yr Runoff Volume (P1 = 2 in.) =	0.511 acre-feet
50-yr Runoff Volume (P1 = 2.25 in.) =	0.597 acre-feet
100-yr Runoff Volume (P1 = 2.52 in.) =	0.710 acre-feet
500-yr Runoff Volume (P1 = 3.4 in.) =	1.023 acre-feet
Approximate 2-yr Detention Volume =	0.211 acre-feet
Approximate 5-yr Detention Volume =	0.284 acre-feet
Approximate 10-yr Detention Volume =	0.364 acre-feet
Approximate 25-yr Detention Volume =	0.393 acre-feet
Approximate 50-yr Detention Volume =	0.409 acre-feet
Approximate 100-yr Detention Volume =	0.445 acre-feet

Optional User Override 1-hr Precipitation


1.19	inches
1.50	inches
1.75	inches
2.00	inches
2.25	inches
2.52	inches
3.40	inches

Depth Increment =	0.2	ft		Optional	Optional	Optional	Optional	Optional	Optional	Optional	Optional	Optional	Optional	Optional	Optional	Optional	Optional	Optional				
Stage - Storage Description	Stage (ft)	Stage (ft)	Length (ft)	Width (ft)	Area (ft ²)	Volume (ft ³)	Volume (ac-ft)															
Media Surface	--	0.00	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	178	0.004
	--	0.20	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	384	0.009
	--	0.40	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	608	0.014
	--	0.60	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	849	0.019
	--	0.80	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	1,110	0.025
	--	1.00	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	1,419	0.033
	--	1.20	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	1,812	0.042
	--	1.40	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	2,289	0.053
	--	1.60	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	2,851	0.065
	--	1.80	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	3,497	0.080
12" CMP Inv EI	--	2.00	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	4,242	0.097
	--	2.20	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	4,990	0.115
	--	2.40	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	5,775	0.133
	--	2.60	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	6,598	0.151
	--	2.80	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	7,458	0.171
	--	3.00	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	8,356	0.192
	--	3.20	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	9,295	0.213
	--	3.40	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	10,273	0.236
Em Spwy Crest	--	3.60	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	11,290	0.259
	--	3.80	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	12,347	0.283
	--	4.00	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--		
	--		--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--		
	--		--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--		
	--		--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--		
	--		--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--		

Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

Project: **Mount Herman RV Storage**
 Basin ID: **Existing WQ/Detention Pond Basin OSA1**

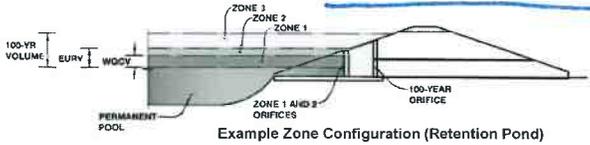

	Stage (ft)	Zone Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	1.80	0.066	Filtration Media
Zone 2 (5-year)		0.218	Circular Orifice
Zone 3			
		0.284	Total

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth = ft (distance below the filtration media surface)
 Underdrain Orifice Diameter = inches

Calculated Parameters for Underdrain

Underdrain Orifice Area = ft²
 Underdrain Orifice Centroid = feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice = ft (relative to basin bottom at Stage = 0 ft)
 Depth at top of Zone using Orifice Plate = ft (relative to basin bottom at Stage = 0 ft)
 Orifice Plate: Orifice Vertical Spacing = inches
 Orifice Plate: Orifice Area per Row = inches

Calculated Parameters for Plate

WQ Orifice Area per Row = ft²
 Elliptical Half-Width = feet
 Elliptical Slot Centroid = feet
 Elliptical Slot Area = ft²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (optional)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	N/A							
Orifice Area (sq. inches)	N/A							

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Orifice Area (sq. inches)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

User Input: Vertical Orifice (Circular or Rectangular)

	Zone 2 Circular	Not Selected	
Invert of Vertical Orifice =	<input type="text" value="2.00"/>	<input type="text" value=""/>	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice =	<input type="text" value="3.60"/>	<input type="text" value=""/>	ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter =	<input type="text" value="1.20"/>	<input type="text" value=""/>	inches

Calculated Parameters for Vertical Orifice

	Zone 2 Circular	Not Selected	
Vertical Orifice Area =	<input type="text" value="0.79"/>	<input type="text" value=""/>	ft ²
Vertical Orifice Centroid =	<input type="text" value="0.50"/>	<input type="text" value=""/>	feet

User Input: Overflow Weir (Dropbox) and Grate (Flat or Sloped)

	Not Selected	Not Selected	
Overflow Weir Front Edge Height, Ho =	<input type="text" value="2.00"/>	<input type="text" value=""/>	ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length =	<input type="text" value=""/>	<input type="text" value=""/>	feet
Overflow Weir Slope =	<input type="text" value=""/>	<input type="text" value=""/>	H:V (enter zero for flat grate)
Horiz. Length of Weir Sides =	<input type="text" value=""/>	<input type="text" value=""/>	feet
Overflow Grate Open Area % =	<input type="text" value=""/>	<input type="text" value=""/>	%, grate open area/total area
Debris Clogging % =	<input type="text" value=""/>	<input type="text" value=""/>	%

Calculated Parameters for Overflow Weir

	Not Selected	Not Selected	
Height of Grate Upper Edge, H ₁ =	<input type="text" value=""/>	<input type="text" value=""/>	feet
Over Flow Weir Slope Length =	<input type="text" value=""/>	<input type="text" value=""/>	feet
Grate Open Area / 100-yr Orifice Area =	<input type="text" value=""/>	<input type="text" value=""/>	should be ≥ 4
Overflow Grate Open Area w/o Debris =	<input type="text" value=""/>	<input type="text" value=""/>	ft ²
Overflow Grate Open Area w/ Debris =	<input type="text" value=""/>	<input type="text" value=""/>	ft ²

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

	Not Selected	Not Selected	
Depth to Invert of Outlet Pipe =	<input type="text" value=""/>	<input type="text" value=""/>	ft (distance below basin bottom at Stage = 0 ft)
Circular Orifice Diameter =	<input type="text" value=""/>	<input type="text" value=""/>	inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

	Not Selected	Not Selected	
Outlet Orifice Area =	<input type="text" value=""/>	<input type="text" value=""/>	ft ²
Outlet Orifice Centroid =	<input type="text" value=""/>	<input type="text" value=""/>	feet
Half-Central Angle of Restrictor Plate on Pipe =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>	radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage =	<input type="text" value="3.60"/>	ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length =	<input type="text" value="20.00"/>	feet
Spillway End Slopes =	<input type="text" value="3.00"/>	H:V
Freeboard above Max Water Surface =	<input type="text" value="0.02"/>	feet

Calculated Parameters for Spillway




Spillway Design Flow Depth =	<input type="text" value="0.38"/>	feet
Stage at Top of Freeboard =	<input type="text" value="4.00"/>	feet
Basin Area at Top of Freeboard =	<input type="text" value="0.12"/>	acres

Routed Hydrograph Results

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =									
One-Hour Rainfall Depth (in) =	0.53	1.07	1.19	1.50	1.75	2.00	2.25	2.52	3.40
Calculated Runoff Volume (acre-ft) =	0.066	0.273	0.225	0.302	0.391	0.511	0.597	0.710	1.023
OPTIONAL Override Runoff Volume (acre-ft) =									
Inflow Hydrograph Volume (acre-ft) =	0.066	0.273	0.225	0.302	0.391	0.511	0.597	0.710	1.024
Predevelopment Unit Peak Flow, q (cfs/acre) =	0.00	0.00	0.02	0.03	0.28	0.87	1.20	1.60	2.55
Predevelopment Peak Q (cfs) =	0.0	0.0	0.1	0.1	1.1	3.5	4.9	6.5	10.3
Peak Inflow Q (cfs) =	1.4	5.7	4.7	6.3	8.2	10.6	12.4	14.7	21.1
Peak Outflow Q (cfs) =	0.1	2.4	1.7	2.8	3.6	6.2	8.8	12.1	20.1
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	25.1	3.2	1.8	1.8	1.9	1.9
Structure Controlling Flow =	Filtration Media	Vertical Orifice 1	Vertical Orifice 1	Vertical Orifice 1	Vertical Orifice 1	Spillway	Spillway	Spillway	Spillway
Max Velocity through Gate 1 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Max Velocity through Gate 2 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours) =	12	17	17	17	16	15	15	14	13
Time to Drain 99% of Inflow Volume (hours) =	12	18	18	18	18	18	17	17	17
Maximum Ponding Depth (ft) =	1.65	2.93	2.76	3.02	3.37	3.70	3.77	3.85	3.99
Area at Maximum Ponding Depth (acres) =	0.06	0.10	0.10	0.10	0.11	0.12	0.12	0.12	0.12
Maximum Volume Stored (acre-ft) =	0.056	0.164	0.148	0.173	0.209	0.247	0.256	0.264	0.282

Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

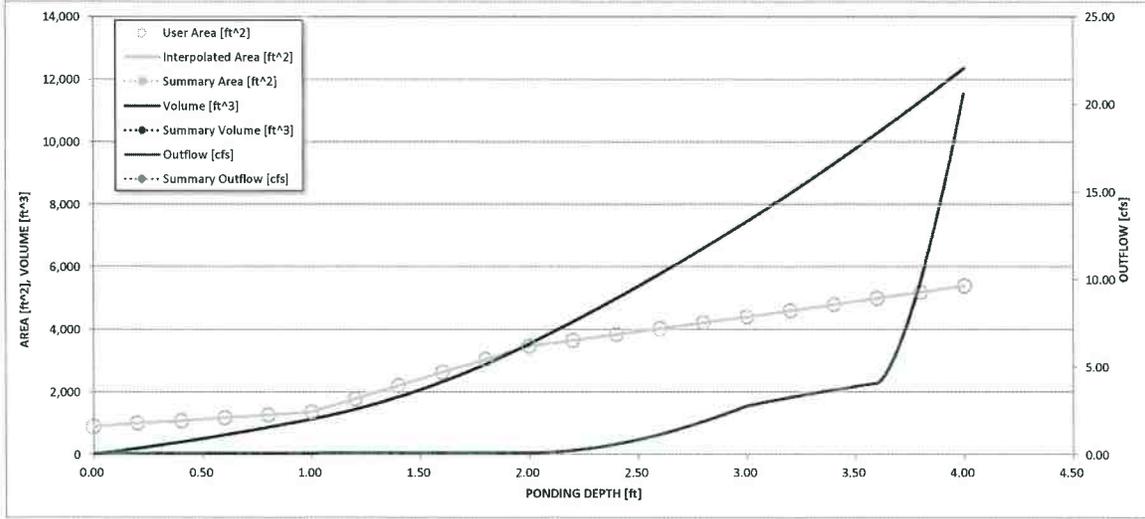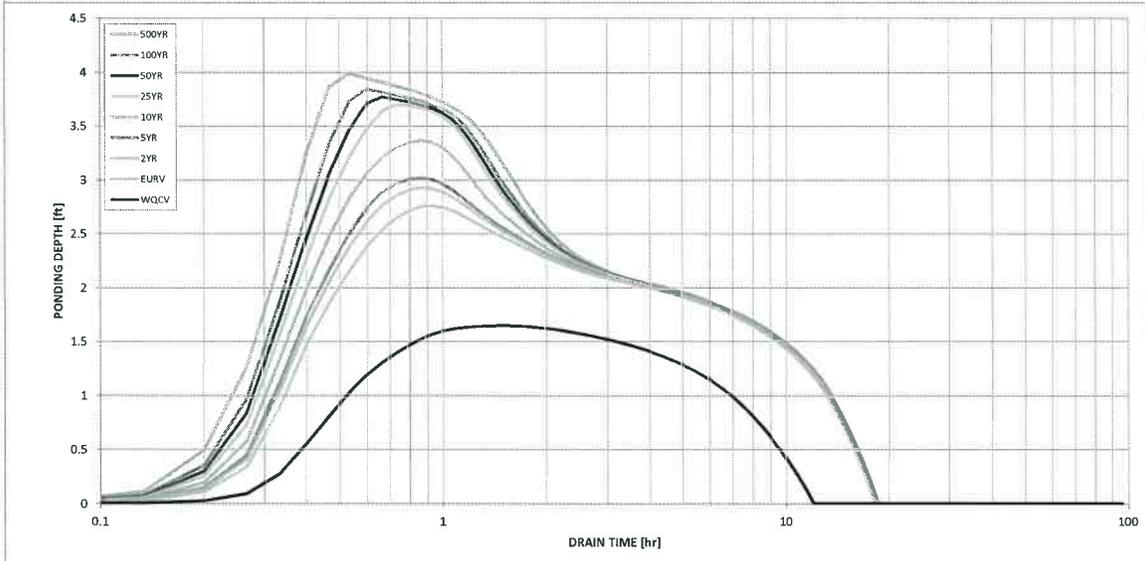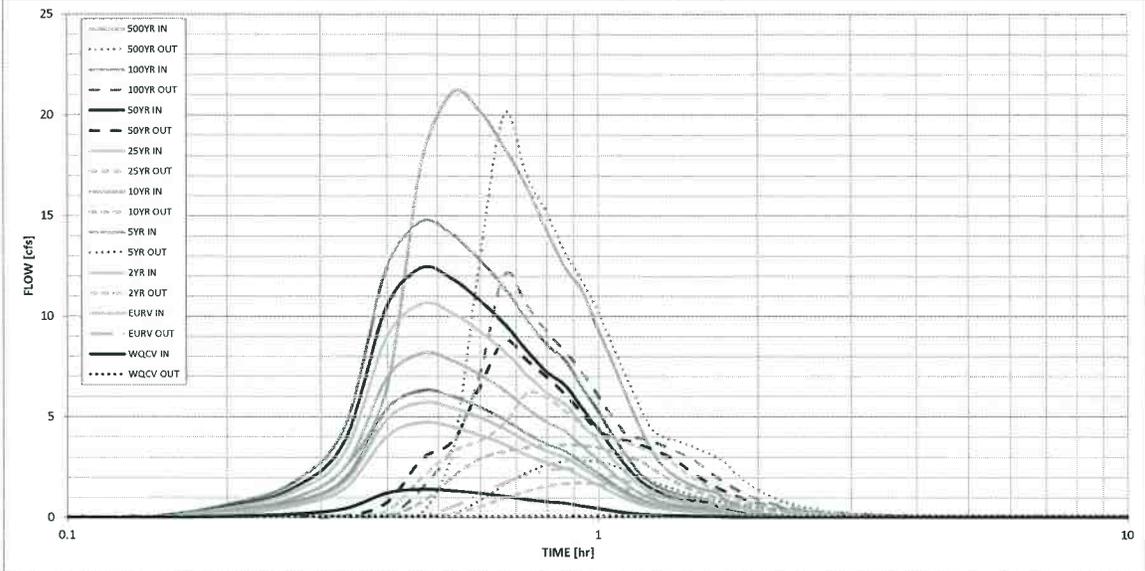

S-A-V-D Chart Axis Override

	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

Existing Penewell Pond Outflow Hydrographs (UD Detention)

Time (min)	WQ (cfs)	EURV (cfs)	2YR (cfs)	5YR (cfs)	10YR (cfs)	25YR (cfs)	50YR (cfs)	100YR (cfs)	500YR (cfs)
0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8	0.03	0.05	0.05	0.06	0.06	0.06	0.06	0.06	0.06
12	0.05	0.06	0.06	0.06	0.06	0.06	0.06	0.06	0.06
16	0.06	0.06	0.06	0.06	0.06	0.06	0.07	0.07	0.07
20	0.06	0.07	0.07	0.07	0.07	0.07	0.07	0.08	0.29
24	0.06	0.07	0.07	0.08	0.08	0.35	0.76	1.47	3.39
28	0.06	0.10	0.08	0.19	0.80	2.02	2.92	3.56	12.97
32	0.07	0.56	0.18	0.86	2.03	3.29	3.81	7.22	20.06
36	0.07	1.20	0.56	1.63	2.94	3.83	6.53	12.06	17.04
40	0.07	1.75	0.98	2.24	3.29	4.70	8.77	10.60	15.16
44	0.07	2.13	1.32	2.61	3.48	6.19	7.82	9.24	13.16
48	0.07	2.35	1.56	2.79	3.58	5.95	6.98	8.23	11.74
52	0.07	2.43	1.69	2.82	3.62	5.28	6.11	7.20	10.24
56	0.07	2.38	1.72	2.77	3.57	4.52	5.16	6.03	8.50
60	0.07	2.24	1.66	2.58	3.47	4.04	4.33	4.97	6.91
64	0.07	2.04	1.54	2.33	3.30	3.91	4.00	4.12	5.47
68	0.07	1.81	1.40	2.05	3.08	3.72	3.84	3.95	4.35
72	0.07	1.59	1.25	1.79	2.83	3.49	3.63	3.77	3.99
76	0.07	1.40	1.11	1.56	2.42	3.23	3.39	3.55	3.84
80	0.07	1.23	0.99	1.36	2.04	2.96	3.13	3.32	3.65
84	0.07	1.09	0.88	1.20	1.74	2.61	2.86	3.06	3.45
88	0.07	0.97	0.79	1.06	1.50	2.18	2.47	2.80	3.23
92	0.07	0.86	0.72	0.95	1.31	1.86	2.09	2.39	3.01
96	0.07	0.78	0.65	0.85	1.15	1.59	1.78	2.03	2.75
100	0.07	0.69	0.58	0.75	1.00	1.36	1.52	1.73	2.31
104	0.07	0.62	0.52	0.67	0.88	1.17	1.30	1.47	1.94
108	0.07	0.55	0.47	0.59	0.77	1.00	1.11	1.25	1.63
112	0.07	0.49	0.42	0.53	0.67	0.87	0.95	1.07	1.38
116	0.07	0.44	0.38	0.47	0.59	0.75	0.82	0.92	1.17
120	0.07	0.39	0.34	0.42	0.52	0.65	0.71	0.79	1.00
124	0.07	0.35	0.31	0.37	0.46	0.57	0.62	0.68	0.85
128	0.07	0.32	0.28	0.34	0.41	0.50	0.54	0.60	0.73
132	0.07	0.29	0.25	0.30	0.36	0.44	0.48	0.52	0.63
136	0.07	0.26	0.23	0.27	0.33	0.39	0.42	0.46	0.55
140	0.07	0.24	0.21	0.25	0.29	0.35	0.37	0.40	0.48
144	0.07	0.22	0.20	0.23	0.27	0.31	0.33	0.36	0.42
148	0.07	0.20	0.18	0.21	0.24	0.28	0.30	0.32	0.38
152	0.07	0.18	0.17	0.19	0.22	0.26	0.27	0.29	0.34
156	0.07	0.17	0.16	0.18	0.20	0.23	0.25	0.26	0.30
160	0.07	0.16	0.15	0.17	0.19	0.21	0.23	0.24	0.27

Existing Penewell Pond Outflow Hydrographs (UD Detention)

Time (min)	WQ (cfs)	EURV (cfs)	2YR (cfs)	5YR (cfs)	10YR (cfs)	25YR (cfs)	50YR (cfs)	100YR (cfs)	500YR (cfs)
164	0.07	0.15	0.14	0.15	0.17	0.20	0.21	0.22	0.25
168	0.07	0.14	0.13	0.15	0.16	0.18	0.19	0.20	0.23
172	0.07	0.13	0.12	0.14	0.15	0.17	0.18	0.19	0.21
176	0.07	0.13	0.12	0.13	0.14	0.16	0.16	0.17	0.19
180	0.07	0.12	0.11	0.12	0.13	0.15	0.15	0.16	0.18
184	0.07	0.11	0.11	0.12	0.13	0.14	0.14	0.15	0.17
188	0.07	0.11	0.10	0.11	0.12	0.13	0.14	0.14	0.15
192	0.07	0.10	0.10	0.11	0.11	0.12	0.13	0.13	0.14
196	0.07	0.10	0.10	0.10	0.11	0.12	0.12	0.13	0.14
200	0.07	0.10	0.09	0.10	0.10	0.11	0.12	0.12	0.13
204	0.07	0.09	0.09	0.09	0.10	0.11	0.11	0.11	0.12
208	0.07	0.09	0.09	0.09	0.10	0.10	0.11	0.11	0.12
212	0.07	0.09	0.08	0.09	0.09	0.10	0.10	0.10	0.11
216	0.07	0.09	0.08	0.09	0.09	0.10	0.10	0.10	0.11
220	0.07	0.08	0.08	0.08	0.09	0.09	0.09	0.10	0.10
224	0.07	0.08	0.08	0.08	0.09	0.09	0.09	0.09	0.10
228	0.07	0.08	0.08	0.08	0.08	0.09	0.09	0.09	0.09
232	0.07	0.08	0.08	0.08	0.08	0.08	0.09	0.09	0.09
236	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.09	0.09
240	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.09
244	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
248	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
252	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
256	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
260	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
264	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
268	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
272	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
276	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
280	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
284	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
288	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
Max	0.1	2.4	1.7	2.8	3.6	6.2	8.8	12.1	20.1

Proposed DP 3 Hellbusch Site Inflow Hydrographs (UD-Detention)

Time (min)	WQ (cfs)	EURV (cfs)	2YR (cfs)	5YR (cfs)	10YR (cfs)	25YR (cfs)	50YR (cfs)	100YR (cfs)	500YR (cfs)
164	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
168	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
172	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
176	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
180	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
184	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
188	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
192	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
196	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
200	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
204	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
208	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
212	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
216	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
220	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
224	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
228	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
232	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
236	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
240	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
244	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
248	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
252	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
256	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
260	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
264	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
268	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
272	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
276	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
280	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
284	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
288	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Max	0.8	3.2	2.7	3.6	4.6	5.9	6.9	8.2	11.7

TOTAL DP 3 Inflow Hydrograph by Addition (ADDITION OF HELIBUSCH SITE & OFFSITE POND OUTFLOW)

Time (min)	WQ (cfs)	EURV (cfs)	2YR (cfs)	5YR (cfs)	10YR (cfs)	25YR (cfs)	50YR (cfs)	100YR (cfs)	500YR (cfs)
0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8	0.03	0.05	0.05	0.06	0.06	0.06	0.06	0.06	0.06
12	0.09	0.20	0.18	0.22	0.26	0.32	0.37	0.42	0.58
16	0.15	0.45	0.38	0.49	0.61	0.78	0.89	1.04	1.47
20	0.31	1.07	0.90	1.18	1.49	1.90	2.20	2.59	3.88
24	0.74	2.83	2.36	3.12	3.98	5.38	6.60	8.37	13.24
28	0.85	3.32	2.75	3.76	5.38	7.94	9.81	11.73	24.69
32	0.81	3.62	2.71	4.25	6.39	8.94	10.39	15.02	31.25
36	0.74	3.99	2.87	4.72	6.91	8.97	12.51	19.15	27.23
40	0.66	4.22	3.02	4.98	6.82	9.28	14.11	16.93	24.27
44	0.57	4.24	3.07	4.96	6.51	10.13	12.41	14.69	21.03
48	0.51	4.20	3.09	4.84	6.23	9.38	10.99	12.99	18.60
52	0.47	4.11	3.08	4.68	6.01	8.39	9.74	11.51	16.45
56	0.39	3.75	2.84	4.29	5.53	7.08	8.14	9.58	13.64
60	0.33	3.34	2.57	3.81	5.06	6.11	6.76	7.86	11.11
64	0.26	2.87	2.22	3.25	4.51	5.49	5.85	6.34	8.71
68	0.20	2.42	1.89	2.73	3.97	4.89	5.21	5.59	6.77
72	0.17	2.04	1.61	2.29	3.47	4.34	4.63	4.96	5.74
76	0.15	1.75	1.40	1.95	2.92	3.90	4.17	4.48	5.19
80	0.14	1.52	1.23	1.68	2.46	3.51	3.78	4.08	4.77
84	0.13	1.33	1.09	1.47	2.10	3.07	3.41	3.71	4.40
88	0.12	1.18	0.97	1.30	1.82	2.59	2.95	3.37	4.06
92	0.12	1.06	0.88	1.17	1.59	2.23	2.52	2.91	3.75
96	0.12	0.96	0.80	1.05	1.41	1.93	2.18	2.51	3.44
100	0.11	0.82	0.69	0.90	1.20	1.61	1.81	2.07	2.81
104	0.10	0.71	0.60	0.78	1.02	1.35	1.51	1.72	2.31
108	0.09	0.62	0.53	0.67	0.87	1.14	1.27	1.44	1.90
112	0.09	0.54	0.46	0.58	0.75	0.96	1.07	1.20	1.58
116	0.08	0.47	0.41	0.51	0.64	0.82	0.90	1.01	1.31
120	0.08	0.42	0.36	0.45	0.56	0.70	0.77	0.86	1.10
124	0.08	0.37	0.32	0.39	0.49	0.60	0.66	0.73	0.92
128	0.08	0.33	0.29	0.35	0.43	0.52	0.57	0.63	0.78
132	0.07	0.29	0.26	0.31	0.37	0.45	0.49	0.54	0.66
136	0.07	0.26	0.23	0.28	0.33	0.40	0.43	0.47	0.57
140	0.07	0.24	0.21	0.25	0.30	0.35	0.38	0.41	0.49
144	0.07	0.22	0.20	0.23	0.27	0.31	0.33	0.36	0.42
148	0.07	0.20	0.18	0.21	0.24	0.28	0.30	0.32	0.38
152	0.07	0.18	0.17	0.19	0.22	0.26	0.27	0.29	0.34
156	0.07	0.17	0.16	0.18	0.20	0.23	0.25	0.26	0.30
160	0.07	0.16	0.15	0.17	0.19	0.21	0.23	0.24	0.27

TOTAL DP 3 Inflow Hydrograph by Addition

Time (min)	WQ (cfs)	EURV (cfs)	2YR (cfs)	5YR (cfs)	10YR (cfs)	25YR (cfs)	50YR (cfs)	100YR (cfs)	500YR (cfs)
164	0.07	0.15	0.14	0.15	0.17	0.20	0.21	0.22	0.25
168	0.07	0.14	0.13	0.15	0.16	0.18	0.19	0.20	0.23
172	0.07	0.13	0.12	0.14	0.15	0.17	0.18	0.19	0.21
176	0.07	0.13	0.12	0.13	0.14	0.16	0.16	0.17	0.19
180	0.07	0.12	0.11	0.12	0.13	0.15	0.15	0.16	0.18
184	0.07	0.11	0.11	0.12	0.13	0.14	0.14	0.15	0.17
188	0.07	0.11	0.10	0.11	0.12	0.13	0.14	0.14	0.15
192	0.07	0.10	0.10	0.11	0.11	0.12	0.13	0.13	0.14
196	0.07	0.10	0.10	0.10	0.11	0.12	0.12	0.13	0.14
200	0.07	0.10	0.09	0.10	0.10	0.11	0.12	0.12	0.13
204	0.07	0.09	0.09	0.09	0.10	0.11	0.11	0.11	0.12
208	0.07	0.09	0.09	0.09	0.10	0.10	0.11	0.11	0.12
212	0.07	0.09	0.08	0.09	0.09	0.10	0.10	0.10	0.11
216	0.07	0.09	0.08	0.09	0.09	0.10	0.10	0.10	0.11
220	0.07	0.08	0.08	0.08	0.09	0.09	0.09	0.10	0.10
224	0.07	0.08	0.08	0.08	0.09	0.09	0.09	0.09	0.10
228	0.07	0.08	0.08	0.08	0.08	0.09	0.09	0.09	0.09
232	0.07	0.08	0.08	0.08	0.08	0.08	0.09	0.09	0.09
236	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.09	0.09
240	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.09
244	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
248	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
252	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
256	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
260	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
264	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
268	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
272	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
276	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
280	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
284	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
288	0.07	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
Max	0.9	4.2	3.1	5.0	6.9	10.1	14.1	19.2	31.3

DP 3 Pond Outflow Hydrograph (UD-Detention)

FROM UD-DETENTION RESULTS

Time (min)	WQ (cfs)	EURV (cfs)	2YR (cfs)	5YR (cfs)	10YR (cfs)	25YR (cfs)	50YR (cfs)	100YR (cfs)	500YR (cfs)
0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4	0.01	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02
8	0.04	0.04	0.04	0.04	0.04	0.04	0.04	0.04	0.04
12	0.04	0.04	0.04	0.04	0.04	0.04	0.05	0.05	0.05
16	0.04	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05
20	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	1.93
24	0.05	0.05	0.05	0.05	0.06	1.70	4.71	9.02	25.14
28	0.05	0.20	0.05	0.72	4.59	10.11	11.83	15.03	29.34
32	0.05	2.63	0.61	4.26	7.22	8.56	11.30	17.96	29.19
36	0.05	4.40	2.31	5.00	6.76	9.32	14.09	18.08	24.08
40	0.05	4.19	3.14	4.96	6.64	9.84	12.93	14.85	21.98
44	0.05	4.23	3.07	4.89	6.30	9.73	11.23	13.43	18.83
48	0.05	4.13	3.08	4.73	6.07	8.60	10.05	11.79	16.95
52	0.05	3.88	2.94	4.42	5.69	7.46	8.56	10.08	14.24
56	0.05	3.47	2.67	3.96	5.19	6.34	7.10	8.25	11.64
60	0.05	3.04	2.36	3.44	4.67	5.66	6.08	6.75	9.28
64	0.05	2.59	2.04	2.91	4.13	5.06	5.39	5.75	7.24
68	0.05	2.19	1.75	2.45	3.63	4.50	4.79	5.15	5.97
72	0.05	1.88	1.52	2.09	3.11	4.03	4.30	4.61	5.33
76	0.05	1.64	1.33	1.81	2.62	3.63	3.90	4.20	4.88
80	0.05	1.44	1.21	1.59	2.24	3.22	3.53	3.83	4.50
84	0.05	1.29	1.11	1.40	1.94	2.77	3.11	3.48	4.16
88	0.05	1.19	1.01	1.27	1.71	2.37	2.68	3.08	3.85
92	0.05	1.09	0.92	1.18	1.52	2.06	2.32	2.65	3.54
96	0.05	0.98	0.83	1.07	1.33	1.77	1.98	2.25	3.05
100	0.05	0.87	0.74	0.94	1.19	1.50	1.67	1.88	2.49
104	0.05	0.77	0.65	0.83	1.05	1.28	1.41	1.59	2.07
108	0.05	0.67	0.58	0.73	0.92	1.15	1.23	1.35	1.74
112	0.05	0.59	0.51	0.64	0.80	1.01	1.10	1.19	1.46
116	0.05	0.52	0.45	0.56	0.70	0.88	0.96	1.05	1.25
120	0.05	0.46	0.40	0.50	0.61	0.76	0.83	0.92	1.12
124	0.05	0.41	0.36	0.44	0.54	0.66	0.72	0.79	0.98
128	0.05	0.37	0.33	0.39	0.48	0.58	0.63	0.69	0.84
132	0.05	0.33	0.29	0.35	0.42	0.51	0.55	0.60	0.73
136	0.05	0.30	0.27	0.31	0.37	0.45	0.48	0.52	0.63
140	0.05	0.27	0.24	0.28	0.34	0.40	0.43	0.46	0.55
144	0.05	0.25	0.22	0.26	0.30	0.36	0.38	0.41	0.48
148	0.05	0.23	0.21	0.24	0.28	0.32	0.34	0.36	0.42
152	0.05	0.21	0.19	0.22	0.25	0.29	0.31	0.33	0.38
156	0.05	0.19	0.18	0.20	0.23	0.26	0.28	0.30	0.34
160	0.05	0.18	0.17	0.19	0.21	0.24	0.26	0.27	0.31

DP 3 Pond Outflow Hydrograph (UD-Detention)

Time (min)	WQ (cfs)	EURV (cfs)	2YR (cfs)	5YR (cfs)	10YR (cfs)	25YR (cfs)	50YR (cfs)	100YR (cfs)	500YR (cfs)
164	0.05	0.17	0.16	0.18	0.20	0.22	0.23	0.25	0.28
168	0.05	0.16	0.15	0.16	0.18	0.21	0.22	0.23	0.26
172	0.05	0.15	0.14	0.15	0.17	0.19	0.20	0.21	0.24
176	0.05	0.14	0.13	0.15	0.16	0.18	0.19	0.20	0.22
180	0.05	0.13	0.13	0.14	0.15	0.17	0.17	0.18	0.20
184	0.05	0.13	0.12	0.13	0.14	0.16	0.16	0.17	0.19
188	0.05	0.12	0.11	0.12	0.14	0.15	0.15	0.16	0.17
192	0.05	0.12	0.11	0.12	0.13	0.14	0.14	0.15	0.16
196	0.05	0.11	0.11	0.11	0.12	0.13	0.14	0.14	0.15
200	0.05	0.11	0.10	0.11	0.12	0.13	0.13	0.13	0.14
204	0.05	0.10	0.10	0.10	0.11	0.12	0.12	0.13	0.14
208	0.05	0.10	0.10	0.10	0.11	0.11	0.12	0.12	0.13
212	0.05	0.10	0.09	0.10	0.10	0.11	0.11	0.12	0.12
216	0.05	0.09	0.09	0.09	0.10	0.11	0.11	0.11	0.12
220	0.05	0.09	0.09	0.09	0.10	0.10	0.10	0.11	0.11
224	0.05	0.09	0.09	0.09	0.09	0.10	0.10	0.10	0.11
228	0.05	0.09	0.08	0.09	0.09	0.10	0.10	0.10	0.10
232	0.05	0.08	0.08	0.09	0.09	0.09	0.09	0.10	0.10
236	0.05	0.08	0.08	0.08	0.09	0.09	0.09	0.09	0.10
240	0.05	0.08	0.08	0.08	0.08	0.09	0.09	0.09	0.09
244	0.05	0.08	0.08	0.08	0.08	0.09	0.09	0.09	0.09
248	0.05	0.08	0.08	0.08	0.08	0.08	0.09	0.09	0.09
252	0.05	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.09
256	0.05	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.09
260	0.05	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
264	0.05	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
268	0.05	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
272	0.05	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
276	0.05	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
280	0.05	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
284	0.05	0.08	0.08	0.08	0.08	0.08	0.08	0.08	0.08
288	0.05	0.07	0.07	0.07	0.07	0.07	0.07	0.07	0.07
Max	0.1	4.4	3.1	5.0	7.2	10.1	14.1	18.1	29.3

Design Procedure Form: Sand Filter (SF)

UD-BMP (Version 3.06, November 2016)

Sheet 1 of 2

Designer: D. Gorman
Company: M.V.E., Inc.
Date: September 27, 2019
Project: Monument Small Engine Storage
Location: Basin A2- Pond at DP3

<p>1. Basin Storage Volume</p> <p>A) Effective Imperviousness of Tributary Area, I_a (100% if all paved and roofed areas upstream of sand filter)</p> <p>B) Tributary Area's Imperviousness Ratio ($i = I_a/100$)</p> <p>C) Water Quality Capture Volume (WQCV) Based on 12-hour Drain Time $WQCV = 0.8 * (0.91 * i^3 - 1.19 * i^2 + 0.78 * i)$</p> <p>D) Contributing Watershed Area (including sand filter area)</p> <p>E) Water Quality Capture Volume (WQCV) Design Volume $V_{WQCV} = WQCV / 12 * Area$</p> <p>F) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm</p> <p>G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume</p> <p>H) User Input of Water Quality Capture Volume (WQCV) Design Volume (Only if a different WQCV Design Volume is desired)</p>	<p>$I_a =$ <u>63.3</u> %</p> <p>$i =$ <u>0.633</u></p> <p>WQCV = <u>0.20</u> watershed inches</p> <p>Area = <u>129,121</u> sq ft</p> <p>$V_{WQCV} =$ <u>2,132</u> cu ft</p> <p>$d_g =$ _____ in</p> <p>$V_{WQCV\ OTHER} =$ _____ cu ft</p> <p>$V_{WQCV\ USER} =$ _____ cu ft</p>
<p>2. Basin Geometry</p> <p>A) WQCV Depth</p> <p>B) Sand Filter Side Slopes (Horizontal distance per unit vertical, 4:1 or flatter preferred). Use "0" if sand filter has vertical walls.</p> <p>C) Minimum Filter Area (Flat Surface Area)</p> <p>D) Actual Filter Area</p> <p>E) Volume Provided</p>	<p>$D_{WQCV} =$ <u>1.3</u> ft</p> <p>$Z =$ <u>3.00</u> ft / ft DIFFICULT TO MAINTAIN, INCREASE WHERE POSSIBLE</p> <p>$A_{Min} =$ <u>1022</u> sq ft</p> <p>$A_{Actual} =$ <u>1322</u> sq ft</p> <p>$V_T =$ <u>2637</u> cu ft</p>
<p>3. Filter Material</p>	<p>Choose One _____</p> <p><input checked="" type="radio"/> 18" CDOT Class B or C Filter Material</p> <p><input type="radio"/> Other (Explain): _____</p>
<p>4. Underdrain System</p> <p>A) Are underdrains provided?</p> <p>B) Underdrain system orifice diameter for 12 hour drain time</p> <p style="margin-left: 20px;">i) Distance From Lowest Elevation of the Storage Volume to the Center of the Orifice</p> <p style="margin-left: 20px;">ii) Volume to Drain in 12 Hours</p> <p style="margin-left: 20px;">iii) Orifice Diameter, 3/8" Minimum</p>	<p>Choose One _____</p> <p><input checked="" type="radio"/> YES</p> <p><input type="radio"/> NO</p> <p>$y =$ <u>2.0</u> ft</p> <p>$Vol_{12} =$ <u>2,132</u> cu ft</p> <p>$D_o =$ <u>1 - 1 / 16</u> in</p>

Design Procedure Form: Sand Filter (SF)

Sheet 2 of 2

Designer: D. Gorman
Company: M.V.E., Inc.
Date: September 27, 2019
Project: Monument Small Engine Storage
Location: Basin A2- Pond at DP3

5. Impermeable Geomembrane Liner and Geotextile Separator Fabric

A) Is an impermeable liner provided due to proximity of structures or groundwater contamination?

Choose One _____
 YES NO

6-7. Inlet / Outlet Works

A) Describe the type of energy dissipation at inlet points and means of conveying flows in excess of the WQCV through the outlet

12" pvc pipe outlet and 15' wide emergency spillway

Notes: _____

Channel Report

61092-DP1 Culvert

Circular

Diameter (ft) = 0.66

Invert Elev (ft) = 6971.00

Slope (%) = 2.00

N-Value = 0.011

Calculations

Compute by: Known Q

Known Q (cfs) = 2.00

Highlighted

Depth (ft) = 0.56

Q (cfs) = 2.000

Area (sqft) = 0.31


Velocity (ft/s) = 6.46

Wetted Perim (ft) = 1.55

Crit Depth, Y_c (ft) = 0.63

Top Width (ft) = 0.47

EGL (ft) = 1.21

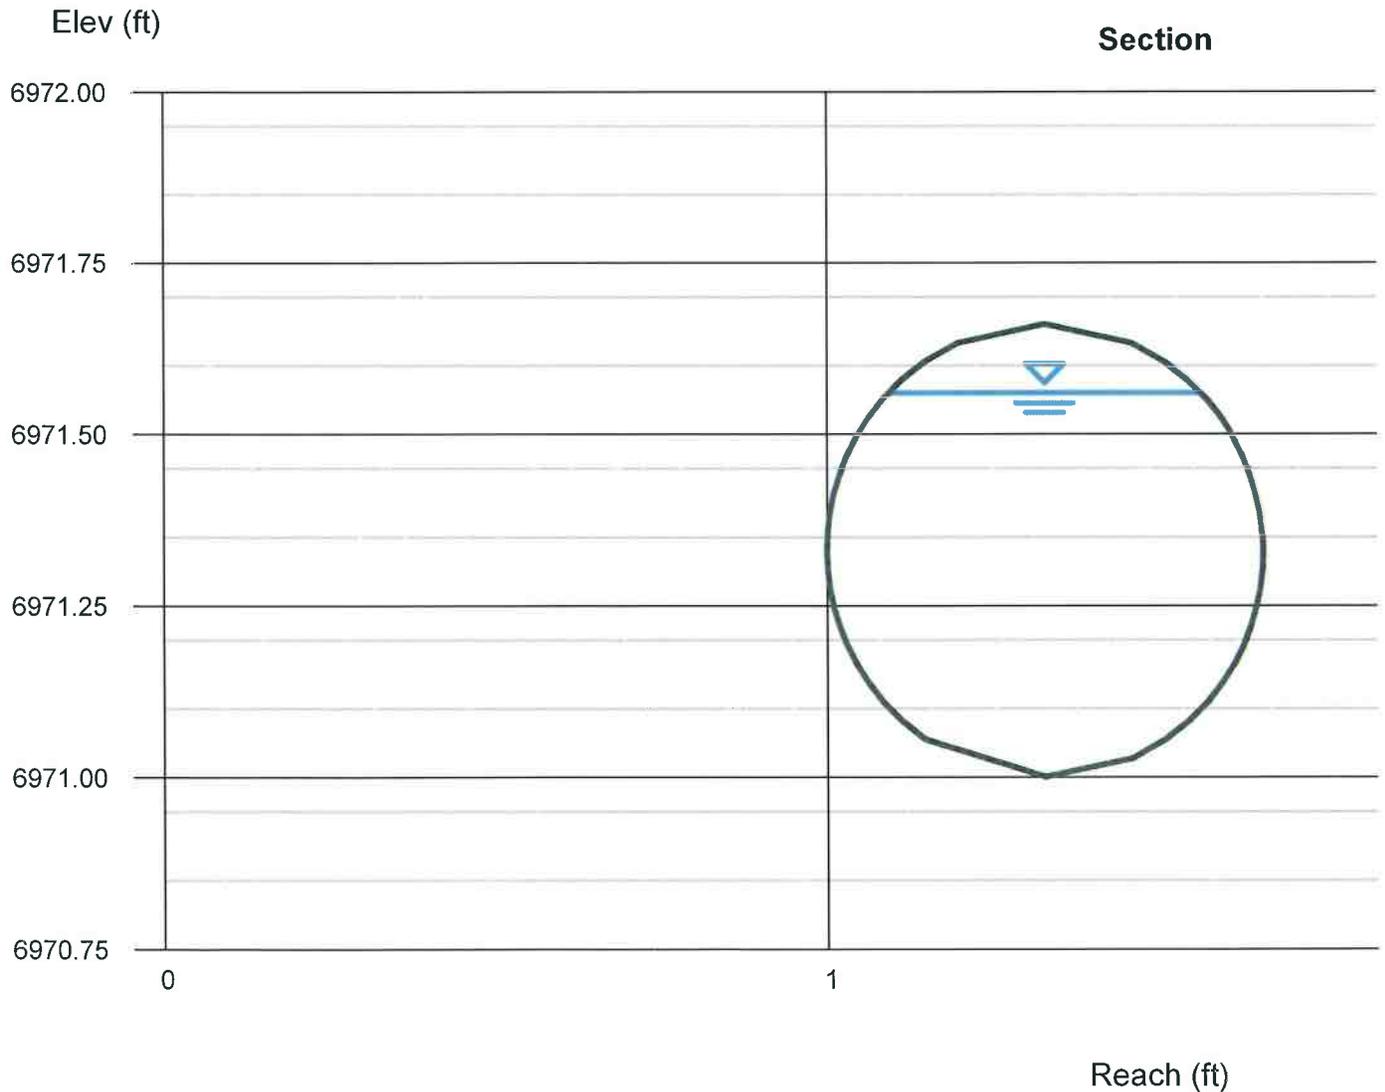

Channel Report

Proposed V-Ditch Swale A

Triangular

Side Slopes (z:1) = 3.00, 3.00
Total Depth (ft) = 1.00


Invert Elev (ft) = 100.00
Slope (%) = 4.00
N-Value = 0.025

Calculations

Compute by: Known Q
Known Q (cfs) = 2.00

Highlighted

Depth (ft) = 0.41
Q (cfs) = 2.000
Area (sqft) = 0.50
Velocity (ft/s) = 3.97
Wetted Perim (ft) = 2.59
Crit Depth, Yc (ft) = 0.49
Top Width (ft) = 2.46
EGL (ft) = 0.65

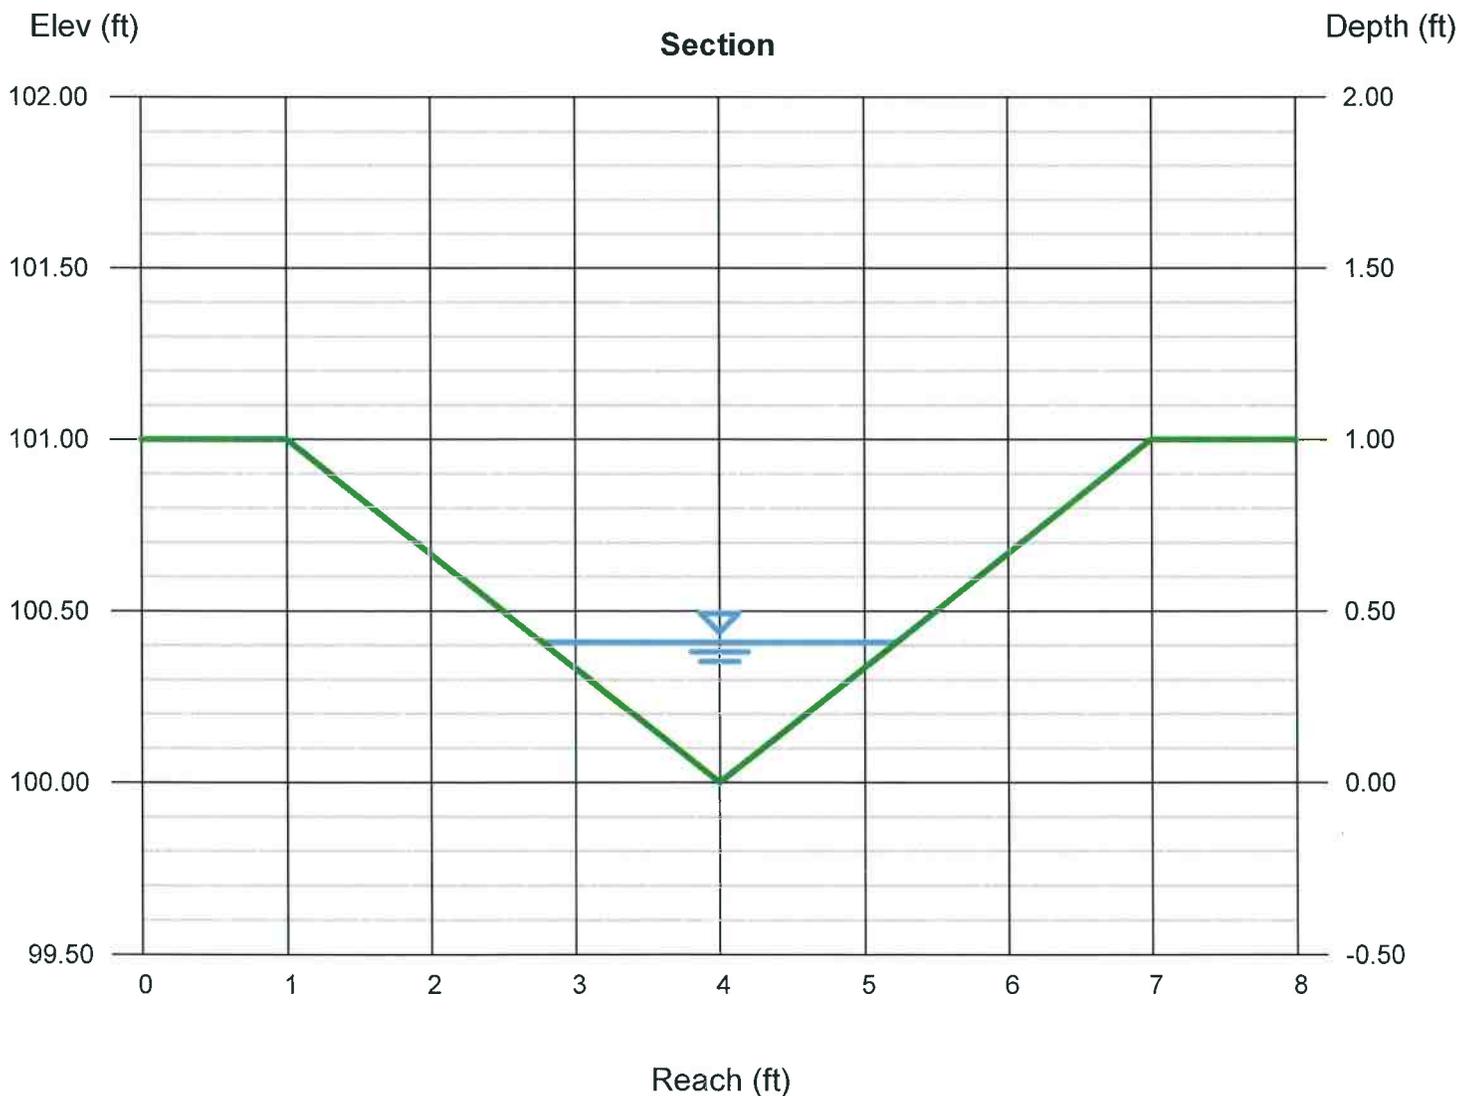

Channel Report

Proposed V-Ditch Swale B

Triangular

Side Slopes (z:1) = 3.00, 3.00
Total Depth (ft) = 1.50


Invert Elev (ft) = 100.00
Slope (%) = 2.00
N-Value = 0.025

Calculations

Compute by: Known Q
Known Q (cfs) = 23.80

Highlighted

Depth (ft) = 1.18
Q (cfs) = 23.80
Area (sqft) = 4.18
Velocity (ft/s) = 5.70
Wetted Perim (ft) = 7.46
Crit Depth, Yc (ft) = 1.32
Top Width (ft) = 7.08
EGL (ft) = 1.68

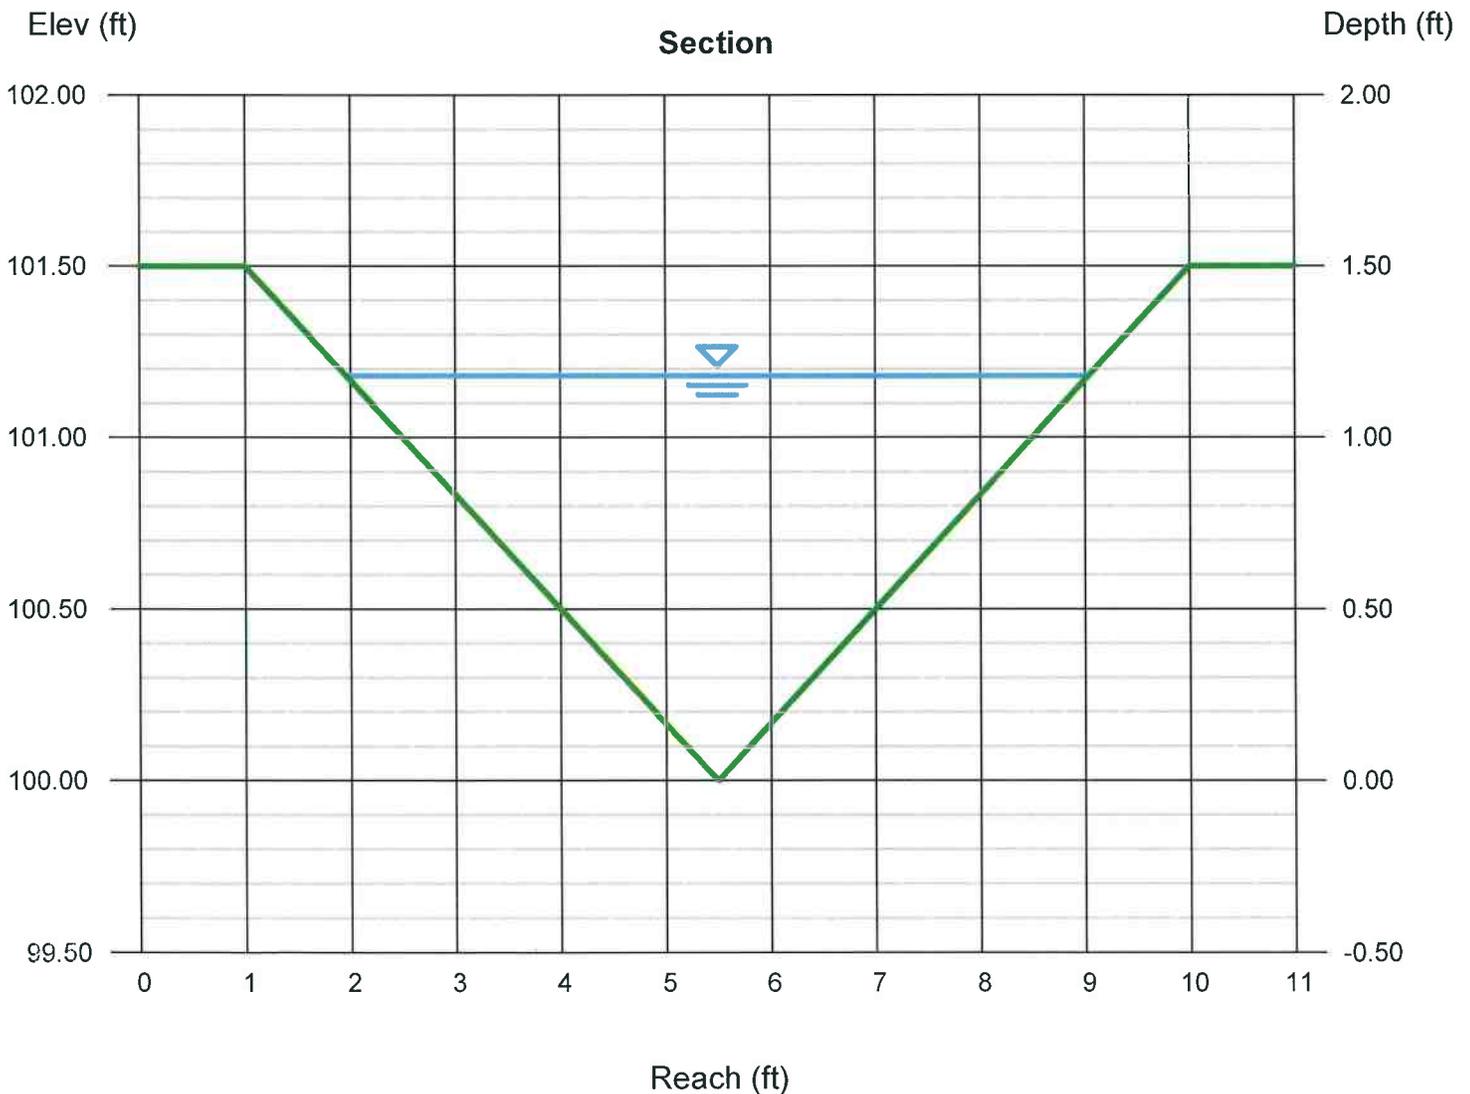

Channel Report

Pond Outfall Swale C

Trapezoidal


Bottom Width (ft) = 2.00
Side Slopes (z:1) = 3.00, 3.00
Total Depth (ft) = 1.50
Invert Elev (ft) = 48.00
Slope (%) = 4.00
N-Value = 0.035

Highlighted

Depth (ft) = 0.90
Q (cfs) = 23.80
Area (sqft) = 4.23
Velocity (ft/s) = 5.63
Wetted Perim (ft) = 7.69
Crit Depth, Yc (ft) = 1.03
Top Width (ft) = 7.40
EGL (ft) = 1.39

Calculations

Compute by: Known Q
Known Q (cfs) = 23.80

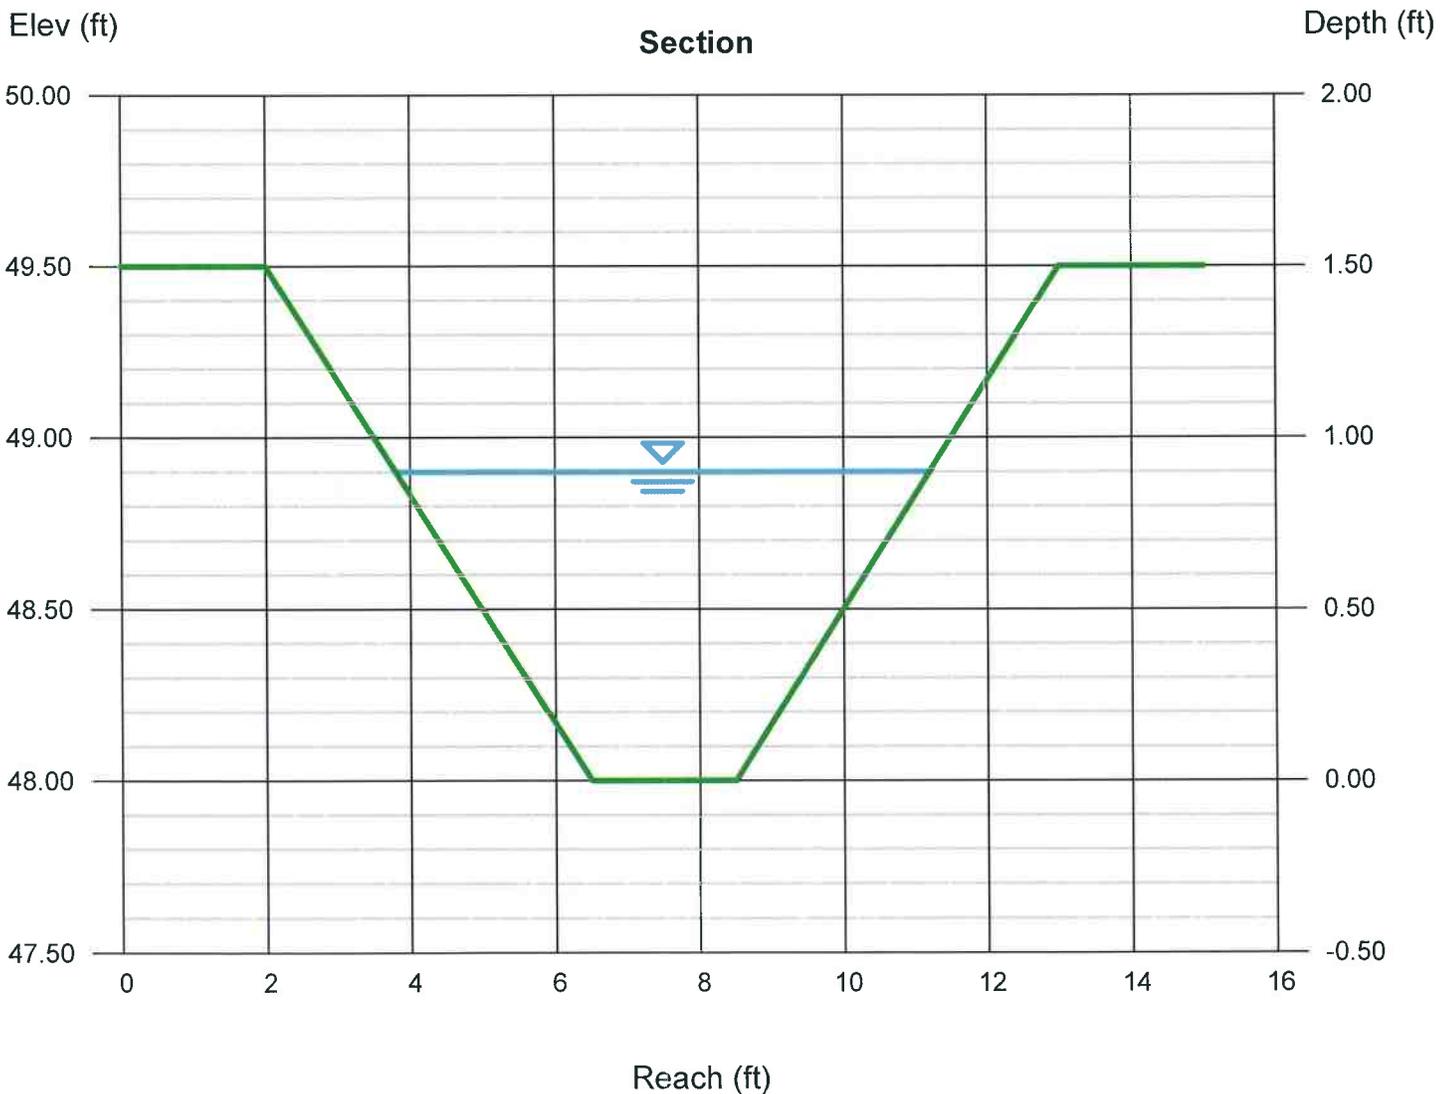

61092 Monument Small Engine RV Storage

Date: 9/26/2019

Riprap Type sizing

$$S_s = 2.65$$

Swale	Slope	Velocity	$\frac{V \cdot S_s^{1.7}}{(S_s - 1)^{1.66}}$	Riprap size From Eq
Swale A	4.00%	4.00	1.66	VL
Swale B	2.00%	5.70	2.11	VL
Swale C	4.00%	5.60	2.33	VL

Channel Report

Monument Small Engine Downstream Outfall to Creek - 100-year

User-defined

Invert Elev (ft) = 6649.95
 Slope (%) = 3.79
 N-Value = 0.035

Highlighted


Depth (ft) = 0.43
 Q (cfs) = 20.30
 Area (sqft) = 7.26
 Velocity (ft/s) = 2.79
 Wetted Perim (ft) = 33.69
 Crit Depth, Yc (ft) = 0.45
 Top Width (ft) = 33.67
 EGL (ft) = 0.55

Calculations

Compute by: Known Q
 Known Q (cfs) = 20.30


(Sta, El, n)-(Sta, El, n)...

(0.00, 6651.00)-(63.00, 6650.00, 0.035)-(66.00, 6649.95, 0.035)-(67.00, 6650.00, 0.035)-(82.00, 6651.00, 0.035)

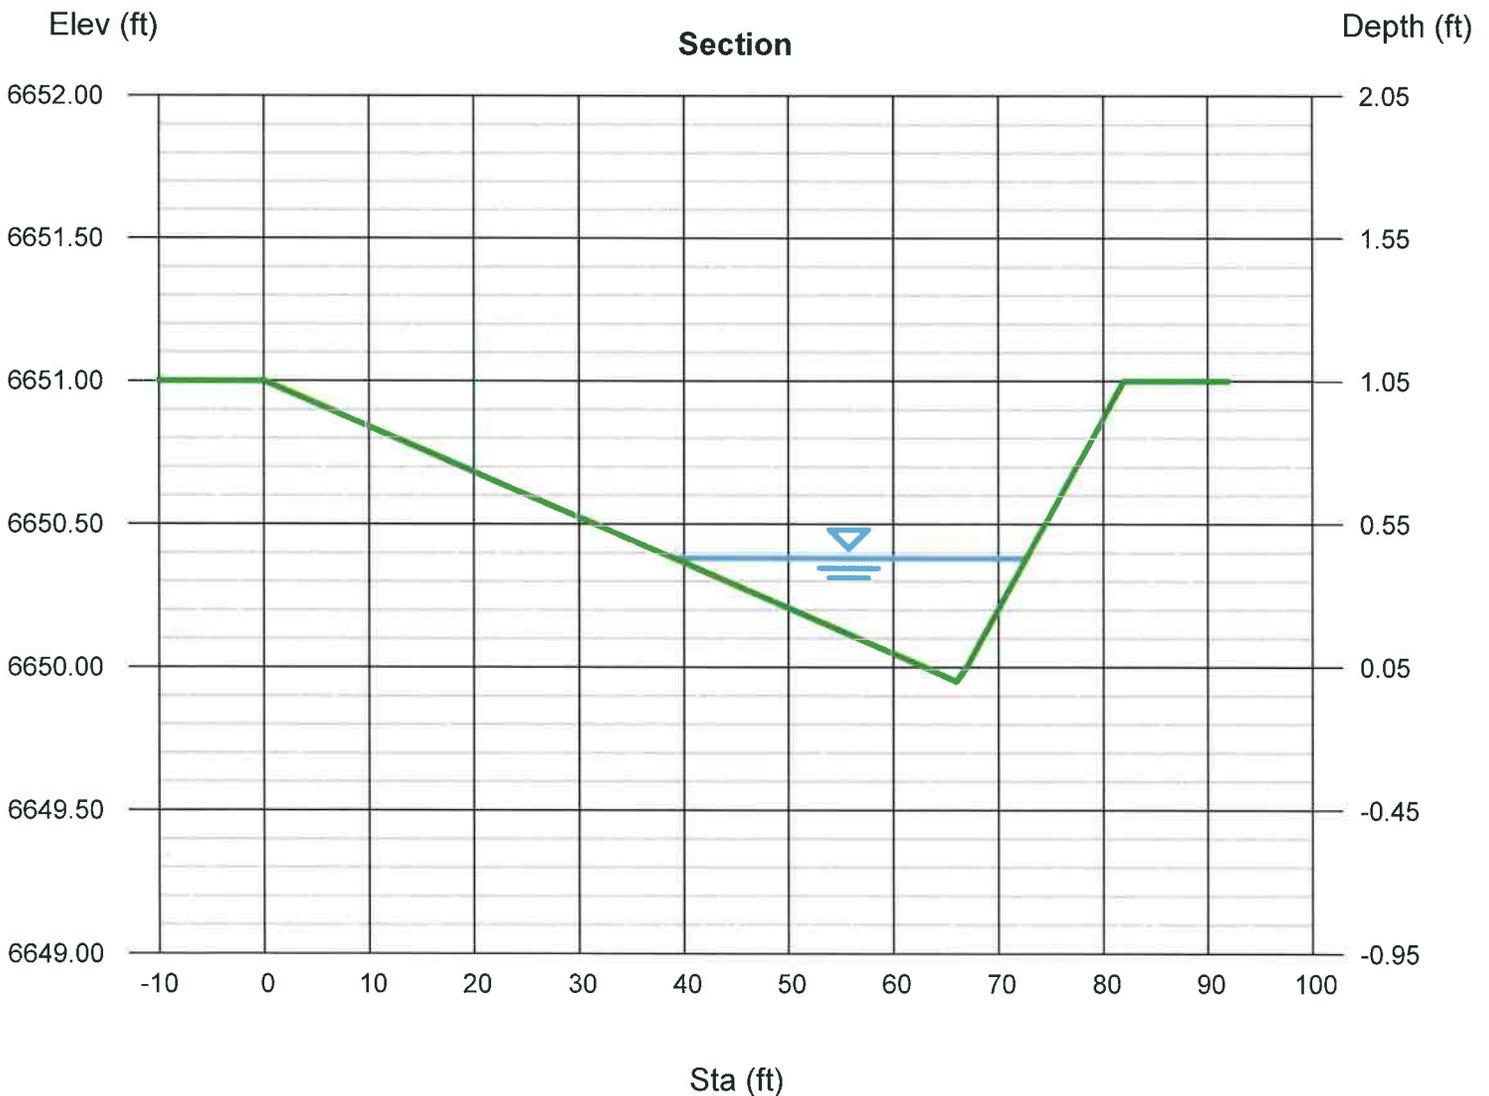


11 Report Maps



Existing Condition Hydraulic Analysis Map (Map Pocket)
Proposed Condition Hydraulic Analysis Map (Map Pocket)

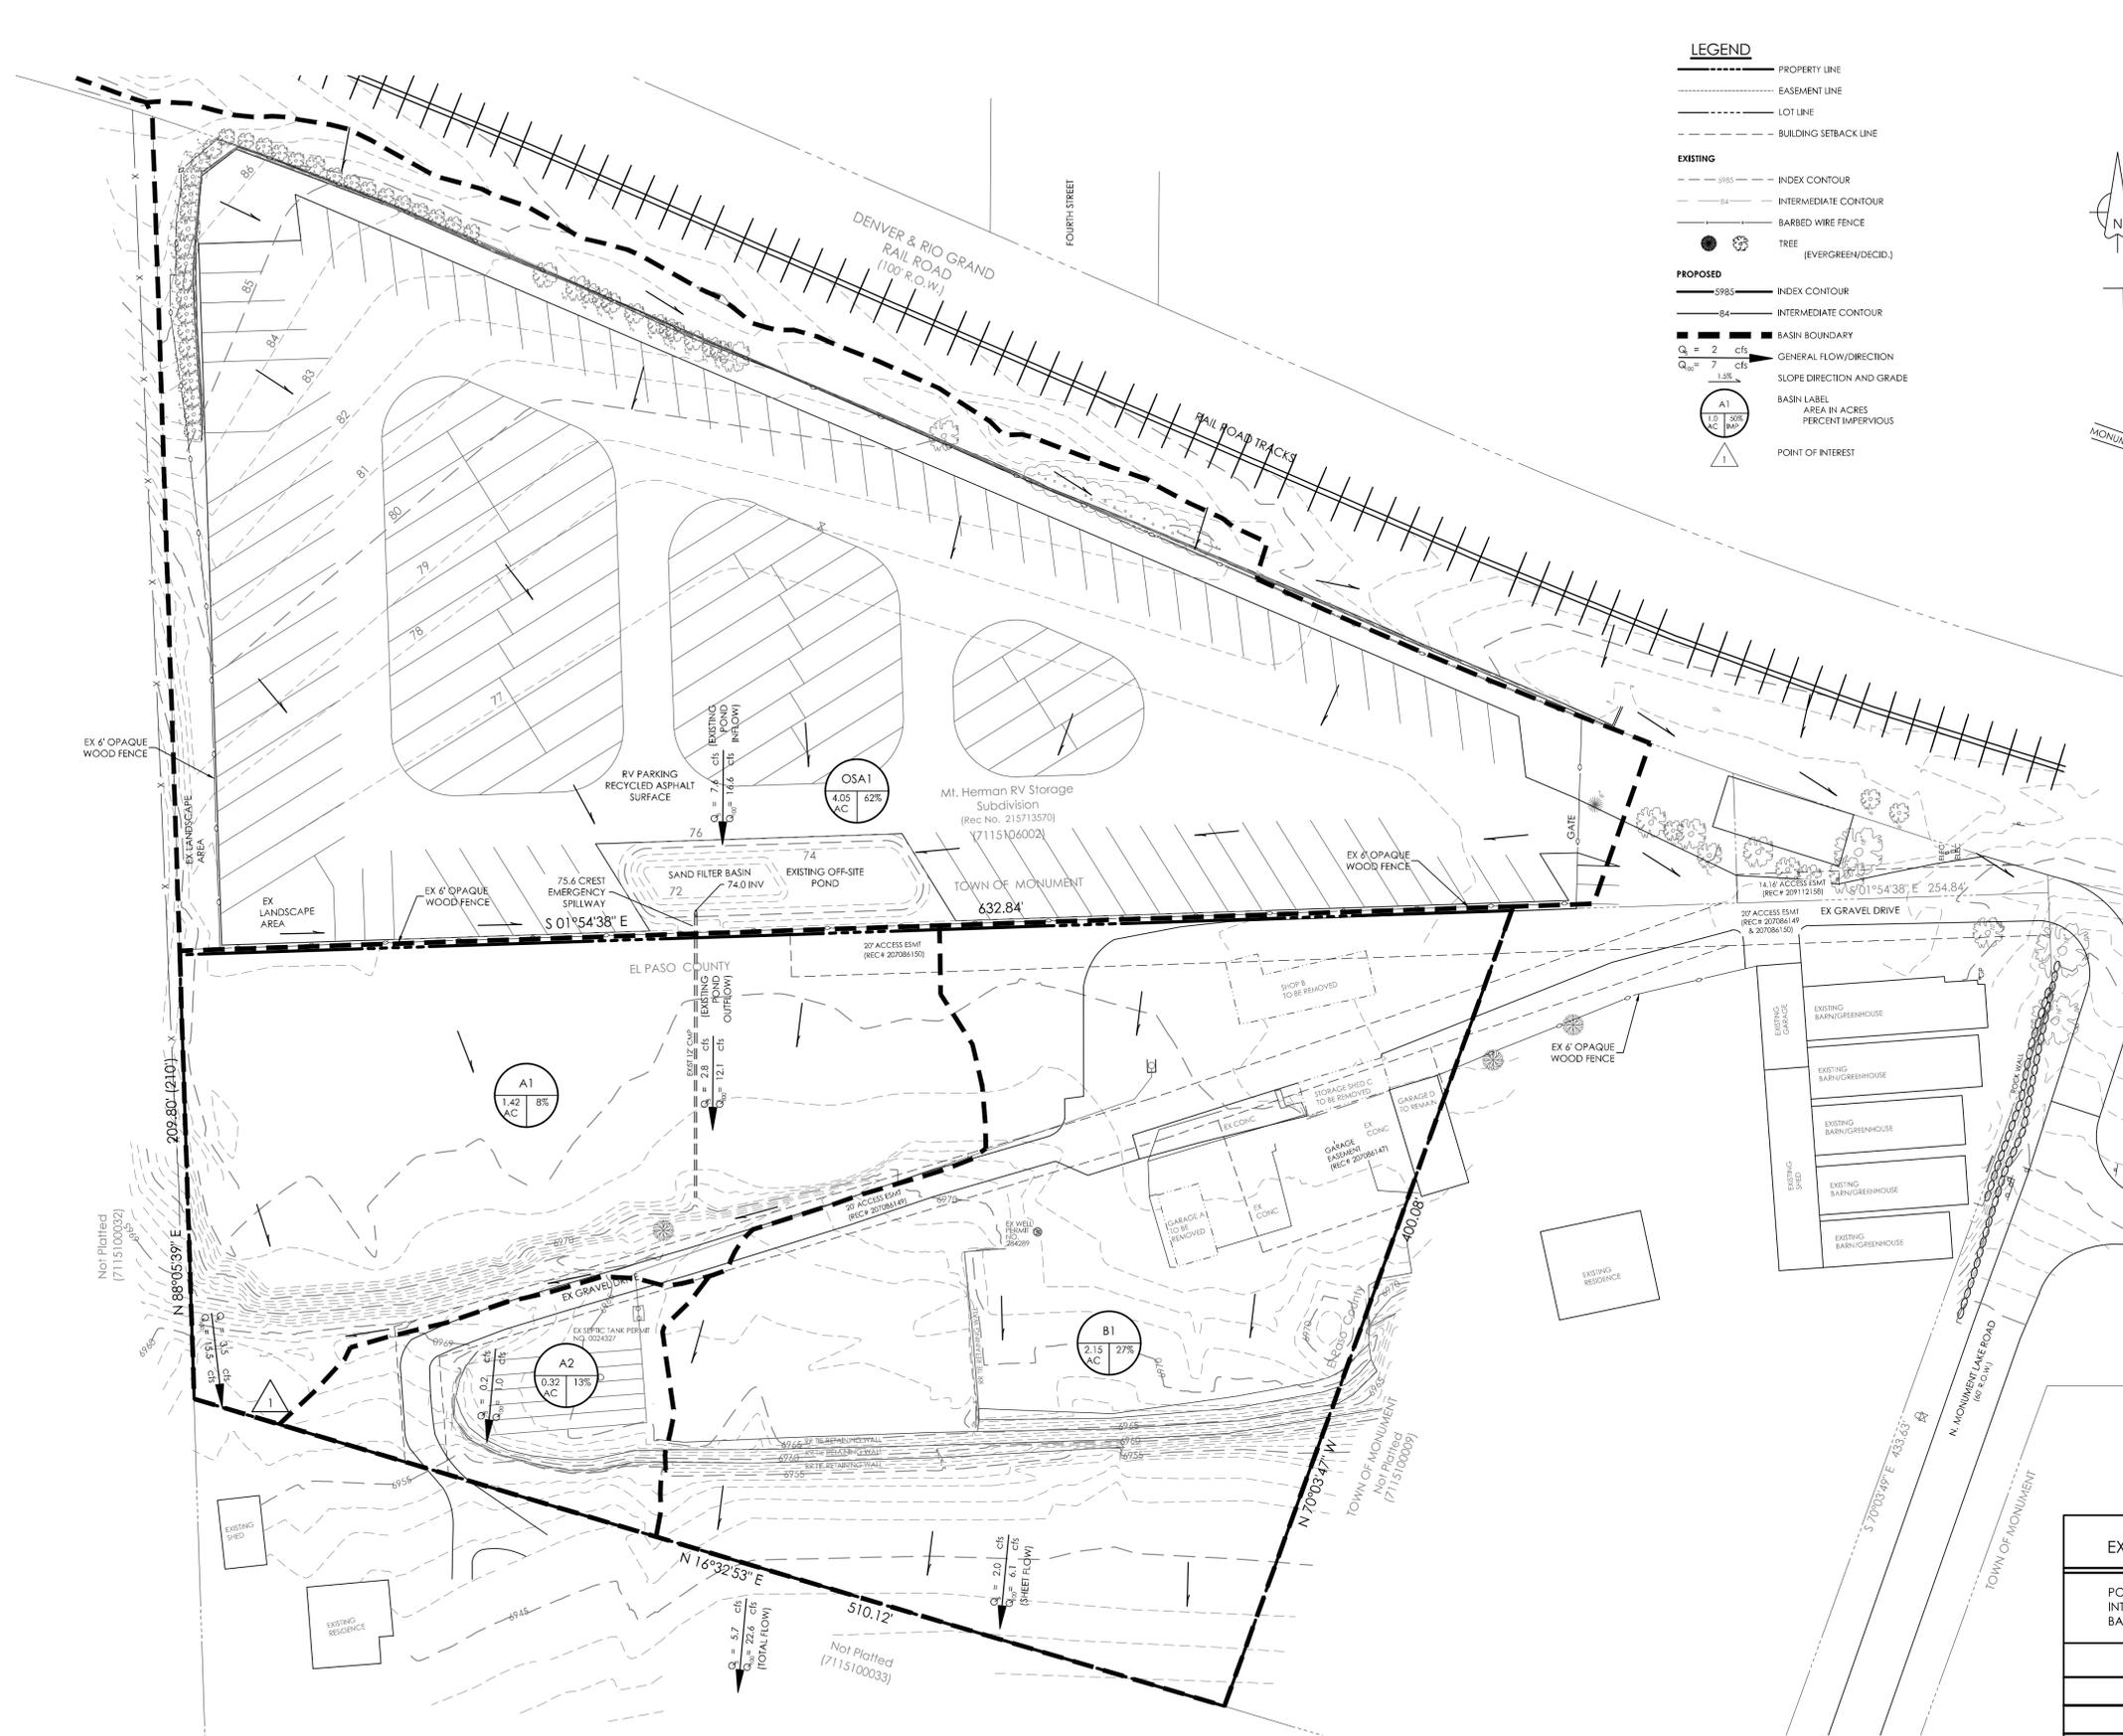

- LEGEND**
- PROPERTY LINE
 - EASEMENT LINE
 - LOT LINE
 - BUILDING SETBACK LINE
- EXISTING**
- INDEX CONTOUR
 - INTERMEDIATE CONTOUR
 - BARBED WIRE FENCE
 - TREE (EVERGREEN/DECID.)
- PROPOSED**
- INDEX CONTOUR
 - INTERMEDIATE CONTOUR
 - BASIN BOUNDARY
 - GENERAL FLOW/DIRECTION
 - SLOPE DIRECTION AND GRADE
 - BASIN LABEL
 - AREA IN ACRES
 - PERCENT IMPERVIOUS
 - POINT OF INTEREST

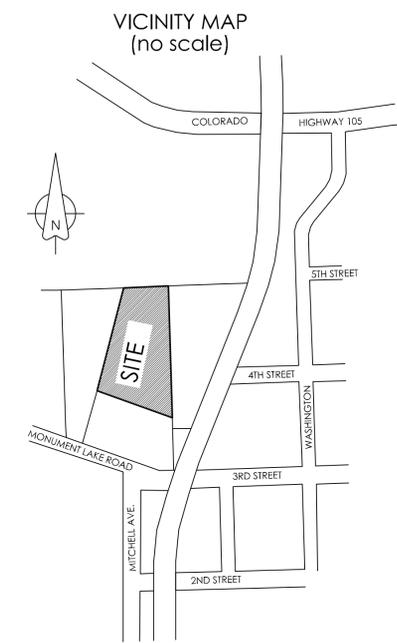

BENCHMARK

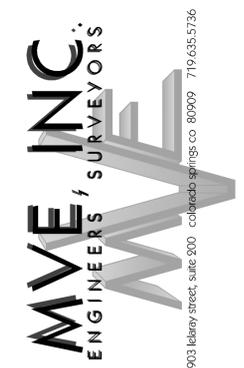

1903 Library Street, Suite 200 Colorado Springs, CO 80909 719.635.5736

REVISIONS
1. SITE CHANGES 9/27/2019

DESIGNED BY _____
DRAWN BY _____
CHECKED BY _____
AS-BUILT BY _____
CHECKED BY _____


Monument Small Engine Storage

Existing Drainage Map

POINT OF INTEREST/BASIN(S)	AREA (AC)	RUNOFF	
		Q5 (CFS)	Q100 (CFS)
OSA1	4.05	7.6	16.6
POND OUTFLOW	4.05	2.8	12.1
A1	1.42	0.7	3.4
DP 1	A1 + POND OUTFLOW	3.5	15.5
A2	0.32	0.2	1.0
DP1 + A2	5.79	3.7	16.3
B1	2.15	2.0	6.1
TOTAL	DP1 + A2 + B1	7.94	22.6

MVE PROJECT 61092
MVE DRAWING-Ex-Drain-Map

JANUARY 17, 2020
SHEET 1 OF 1

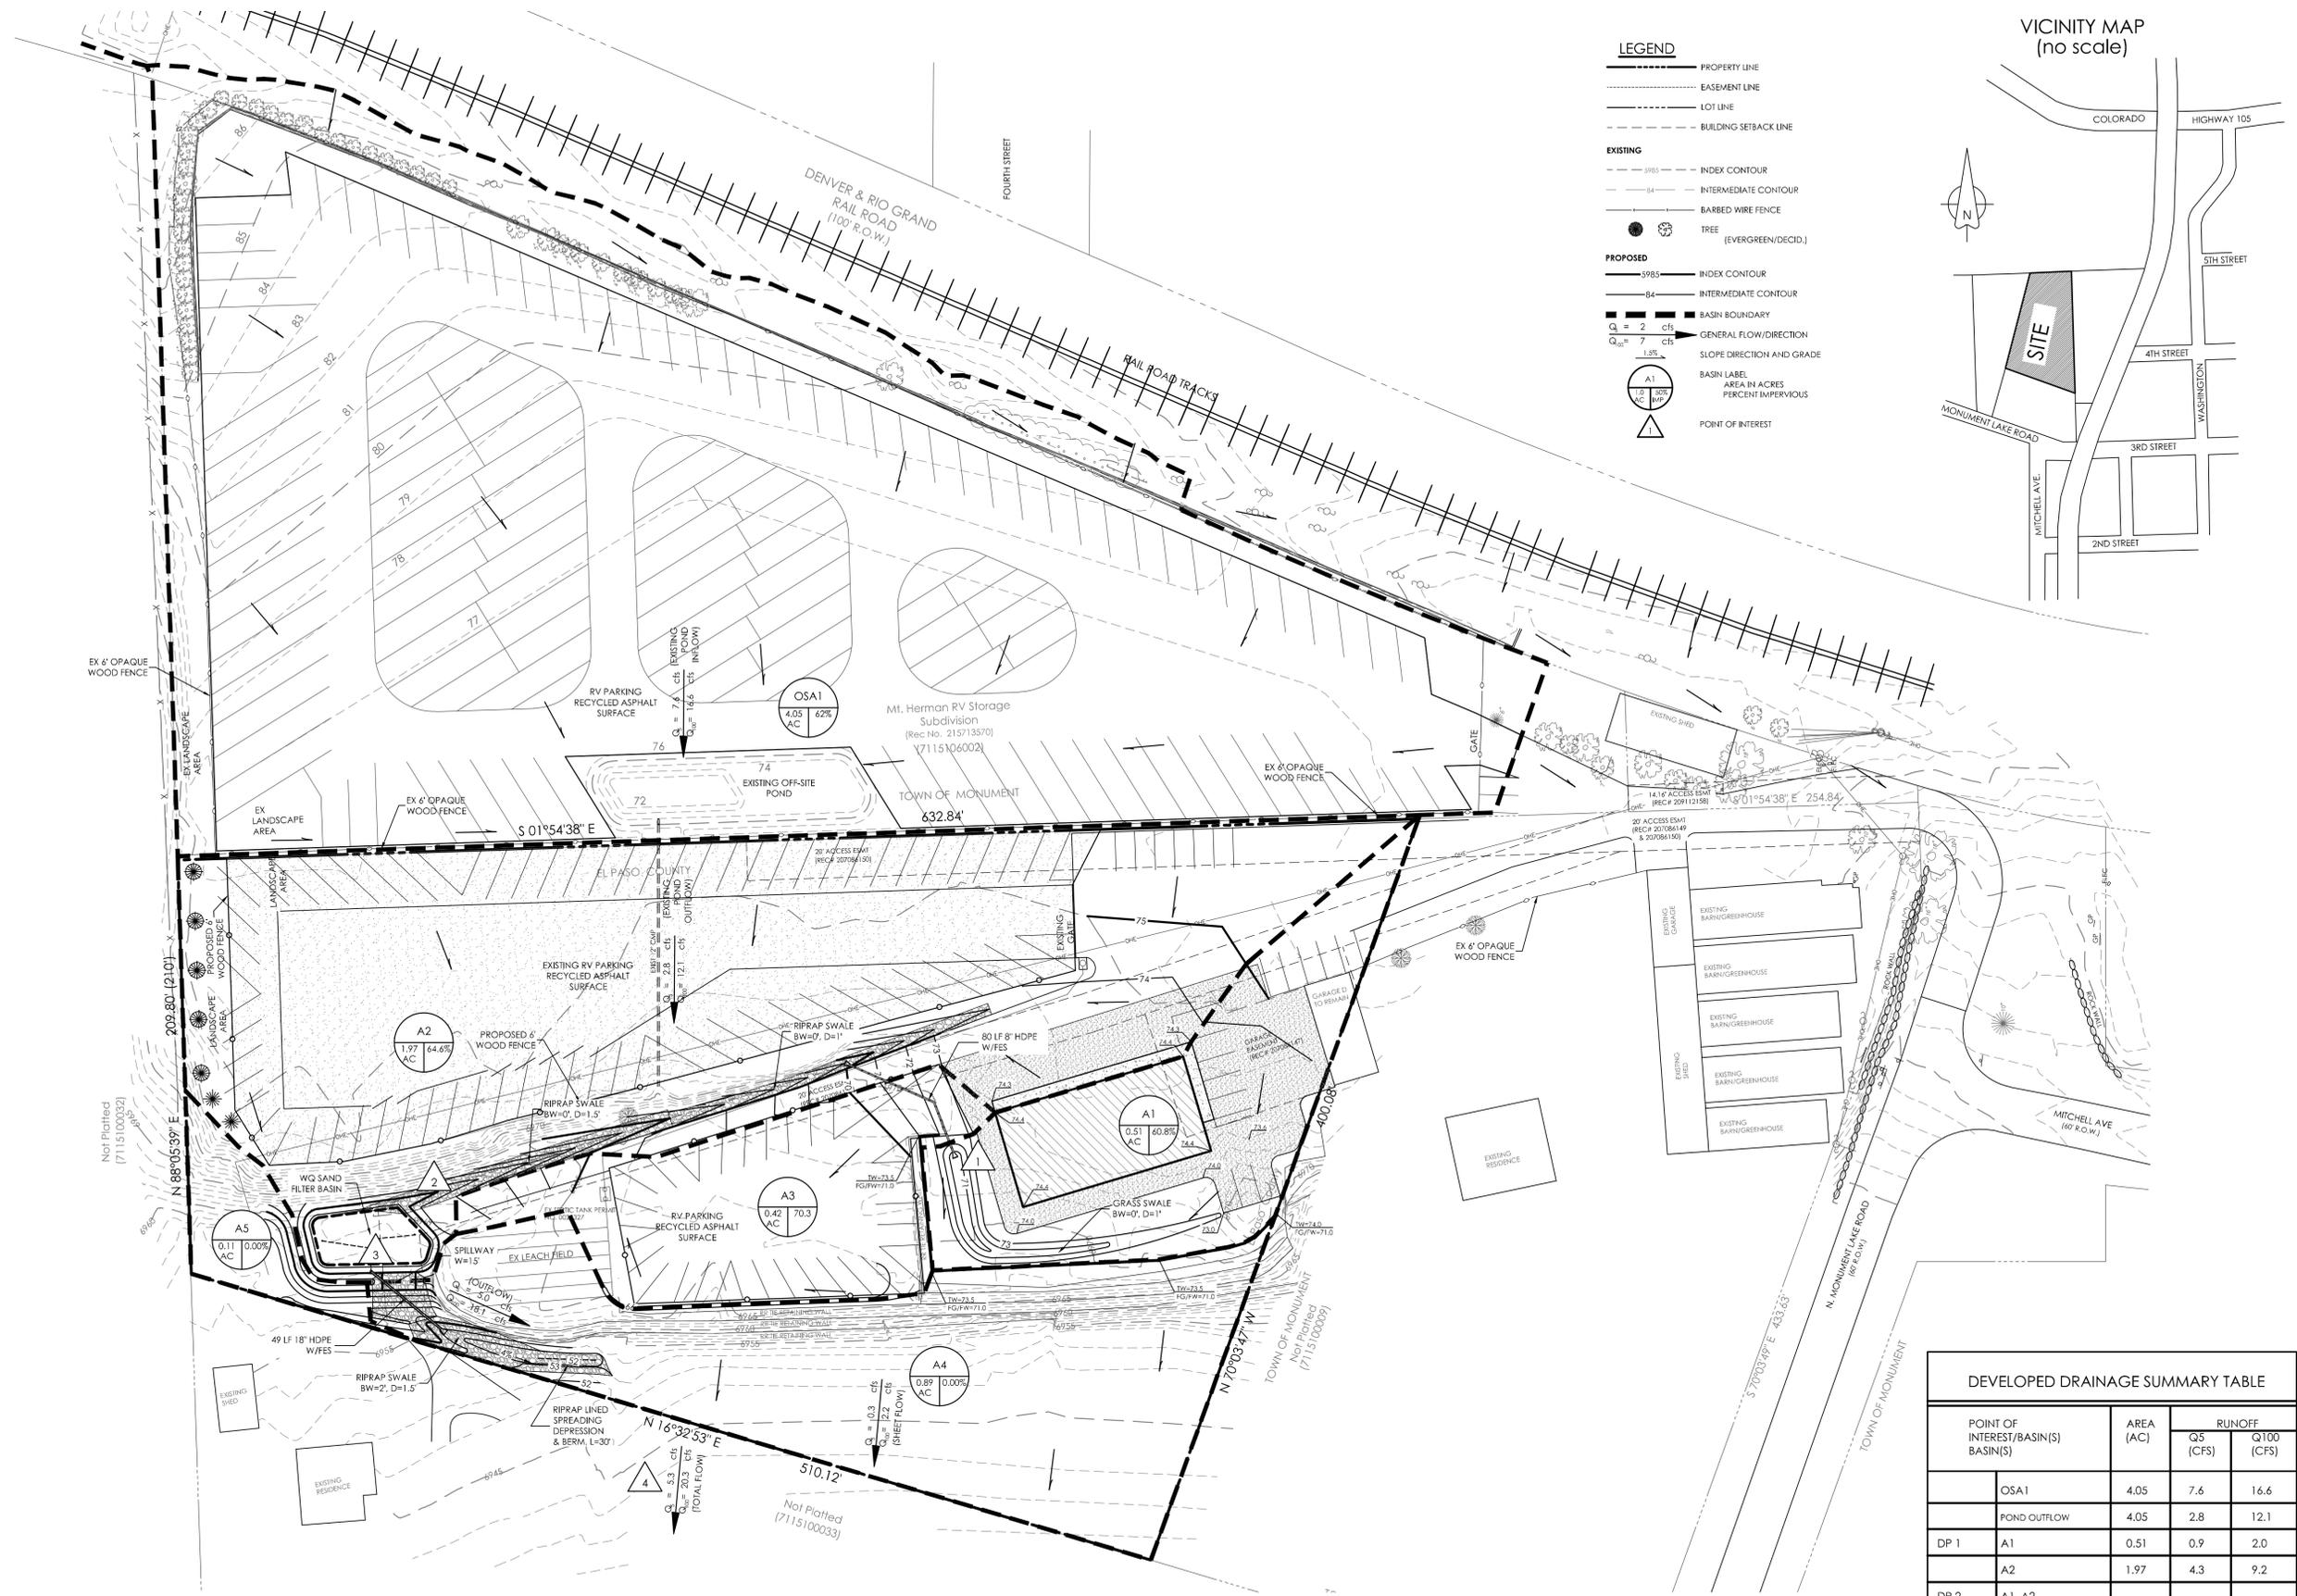

LEGEND


PROPERTY LINE
 EASEMENT LINE
 LOT LINE
 BUILDING SETBACK LINE

EXISTING


INDEX CONTOUR
 INTERMEDIATE CONTOUR
 BARBED WIRE FENCE
 TREE (EVERGREEN/DECID.)

PROPOSED

INDEX CONTOUR
 INTERMEDIATE CONTOUR
 BASIN BOUNDARY
 GENERAL FLOW/DIRECTION
 Q_{in} = 2 cfs
 Q_{out} = 7 cfs
 SLOPE DIRECTION AND GRADE
 BASIN LABEL
 AREA IN ACRES
 PERCENT IMPERVIOUS
 POINT OF INTEREST

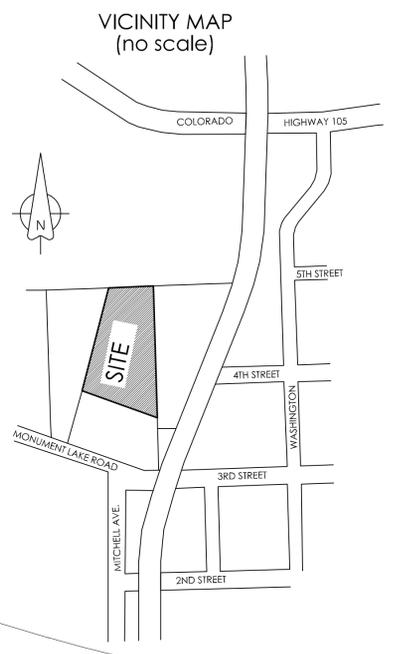

BENCHMARK



MVE, INC.
 ENGINEERS & SURVEYORS

1903 Library Street, Suite 200 Colorado Springs, CO 80909 719.635.5736

REVISIONS
 1. SITE CHANGES 9/27/2019

DEVELOPED DRAINAGE SUMMARY TABLE

POINT OF INTEREST/BASIN(S)	AREA (AC)	RUNOFF	
		Q _S (CFS)	Q ₁₀₀ (CFS)
OSA1	4.05	7.6	16.6
POND OUTFLOW	4.05	2.8	12.1
DP 1	A1	0.9	2.0
DP 2	A1, A2, + POND OUTFLOW	7.4	22.0
	A3	0.9	2.0
DP 3 (IN)	A1, A2, A3 + POND OUTFLOW	8.2	23.7
DP 3 (OUT)	WQCV POND OUTFLOW	5.0	18.1
	A4	0.3	2.2
DP 4	DP3 (OUT) + A4	5.3	20.3
	A5	0.0	0.3

DESIGNED BY _____
 DRAWN BY _____
 CHECKED BY _____
 AS-BUILT BY _____
 CHECKED BY _____

Monument Small Engine Storage

Developed Drainage Map

MVE PROJECT 61092
 MVE DRAWING -PP-Drain-Map

JANUARY 17, 2020
 SHEET 1 OF 1